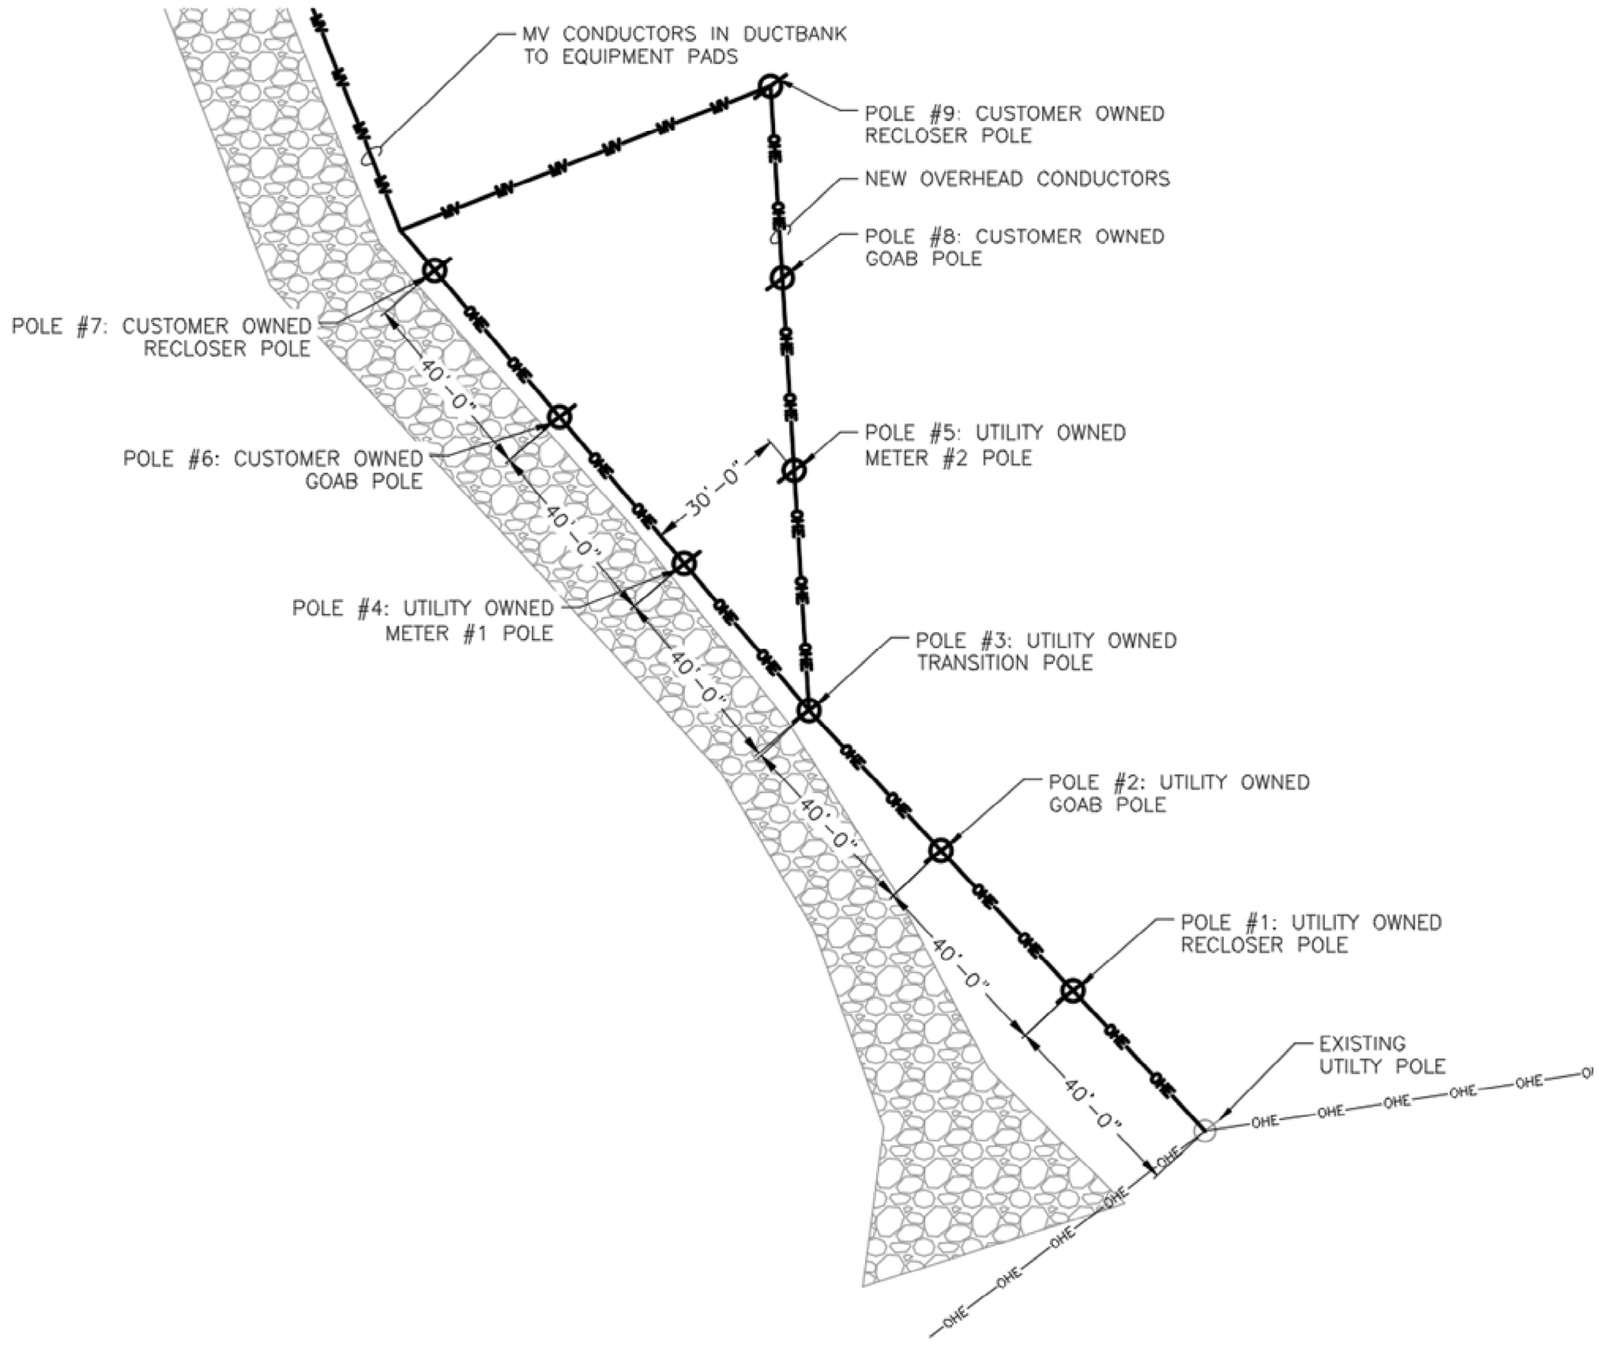
MV CONDUCTORS IN DUCTBANK
TO EQUIPMENT PADS
POLE #9: CUSTOMER OWNED
RECLOSER POLE
NEW OVERHEAD CONDUCTORS
POLE #8: CUSTOMER OWNED
GOAB POLE
POLE #7: CUSTOMER OWNED
RECLOSER POLE
40'-0"
POLE #6: CUSTOMER OWNED
GOAB POLE
POLE #5: UTILITY OWNED
METER #2 POLE
30'-0"
40'-0"
POLE #4: UTILITY OWNED
METER #1 POLE
POLE #3: UTILITY OWNED
TRANSITION POLE
40'-0"
40'-0"
POLE #2: UTILITY OWNED
GOAB POLE
POLE #1: UTILITY OWNED
RECLOSER POLE
40'-0"
EXISTING
UTILTY POLE
40'-0"
OHE