

Appendix F:
115-kV Double Circuit Underground Transmission Line
Map Book and Line List



This Page Left Intentionally Blank



GREENWICH SUBSTATION AND LINE PROJECT 115-KV DOUBLE CIRCUIT UNDERGROUND TRANSMISSION LINES GREENWICH, CONNECTICUT

TRANSMISSION LINE DEVELOPMENT
AND MANAGEMENT PLAN
VOLUME 2 – PART 1

OCTOBER 2018

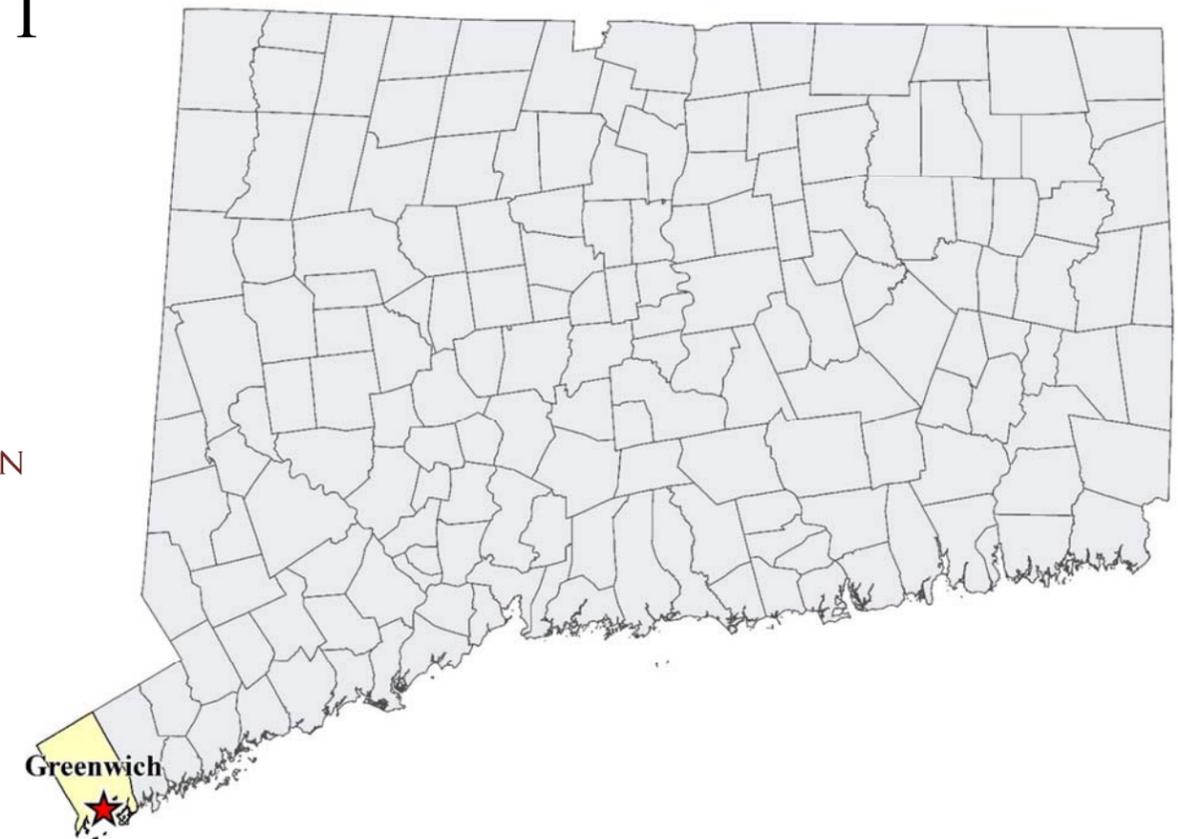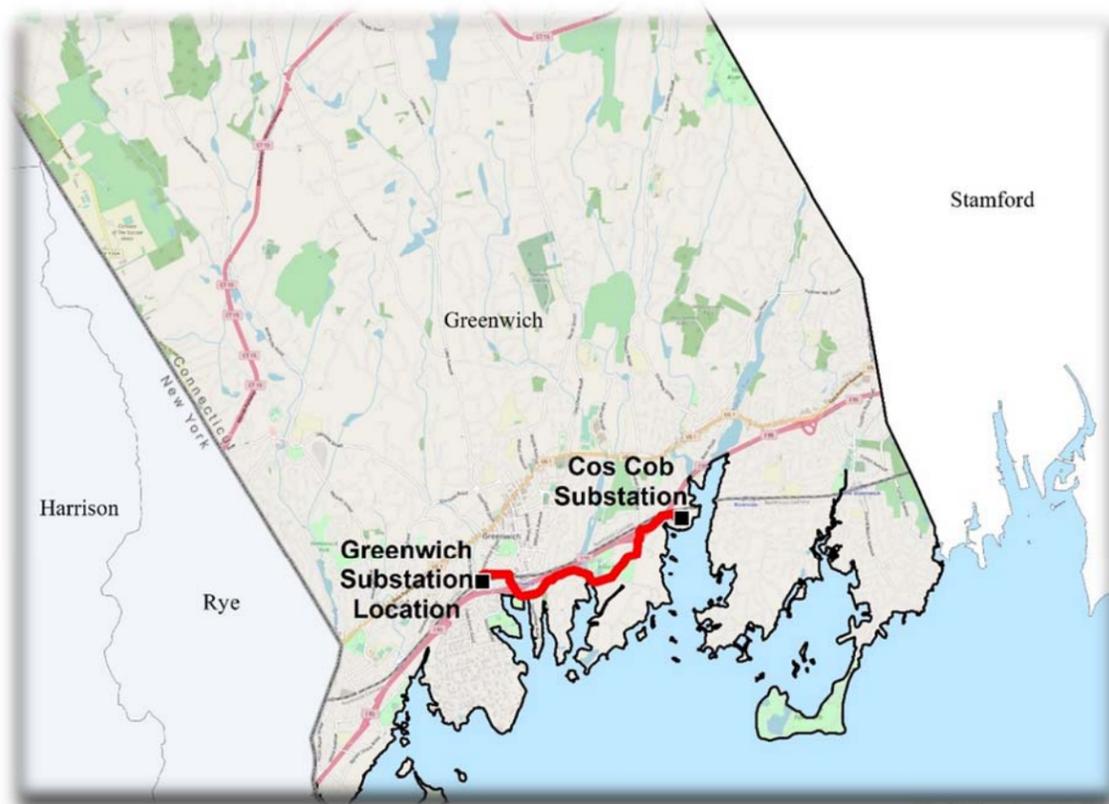

THIS PAGE INTENTIONALLY LEFT BLANK



MAPSHEETS

DESCRIPTION


INDEX MAP

USGS 1:24,000 SCALE

MAP TABLES AND
MAP SHEETS 1-17

115-KV DOUBLE CIRCUIT UNDERGROUND TRANSMISSION LINES
TRANSMISSION LINE DEVELOPMENT AND MANGEMENT PLAN
VOLUME 2 – PART 1

THIS PAGE INTENTIONALLY LEFT BLANK

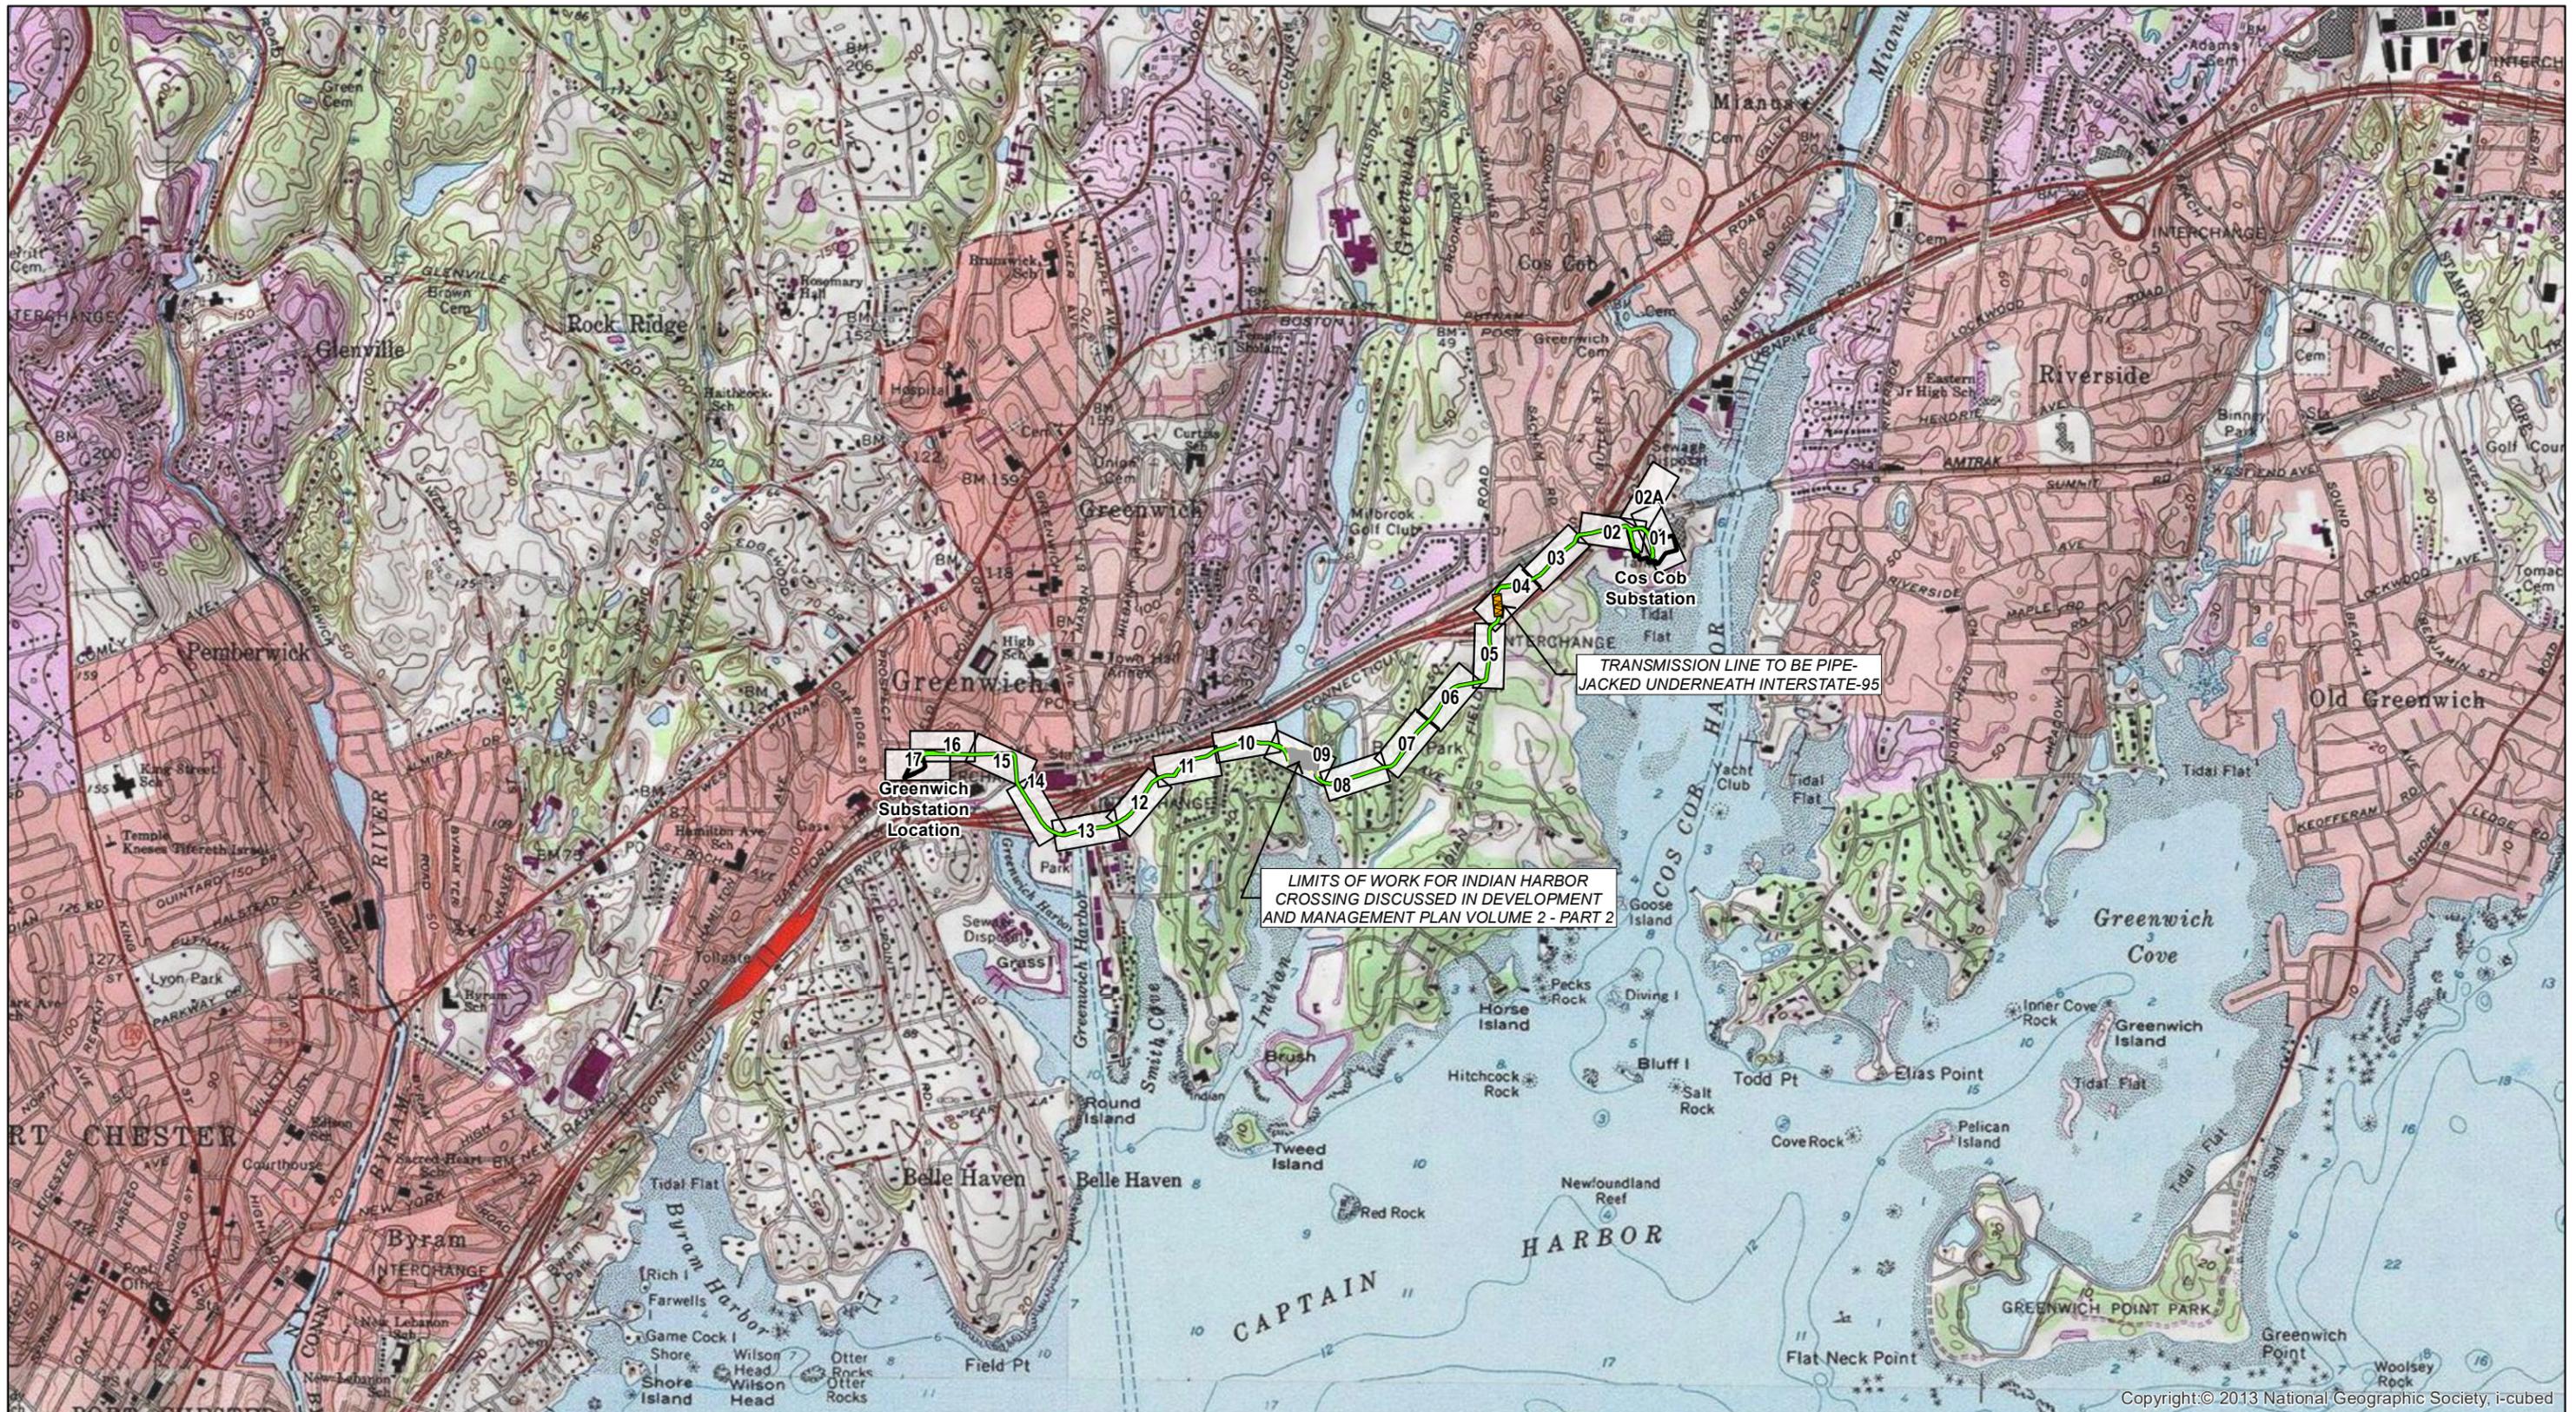

Copyright © 2013 National Geographic Society, I-cubed



Legend

- Underground Transmission-Line Duct (4' wide)
- Trenchless Crossing Underneath Interstate-95
- Map Sheet

Base Map: ESRI USGS Topographic Map

1:24,000

2,000 1,000 0 2,000

Feet

GREENWICH SUBSTATION AND LINE PROJECT
115-KV DOUBLE CIRCUIT UNDERGROUND TRANSMISSION LINES
GREENWICH, CONNECTICUT
TRANSMISSION LINE DEVELOPMENT & MANAGEMENT PLAN
VOLUME 2 - PART 1


INDEX MAP

October 2018

MAP SHEET 01 of 17
GREENWICH SUBSTATION AND LINE PROJECT
115-KV DOUBLE CIRCUIT UNDERGROUND TRANSMISSION LINES
GREENWICH, CONNECTICUT

Map Sheet Notes


LL #	Parcel Address	City	State	Owner Name
100	12 SOUND SHORE DRIVE	GREENWICH	CT	CONNECTICUT LIGHT & POWER COMPANY (EVERSOURCE)
101	SOUND SHORE DRIVE	GREENWICH	CT	STATE OF CONNECICUT FINANCE DEPARTMENT
102	SOUND SHORE DRIVE	GREENWICH	CT	TOWN OF GREENWICH
103	SOUND SHORE DRIVE	GREENWICH	CT	STATE OF CONNECICUT FINANCE DEPARTMENT
104	STRICKLAND ROAD	GREENWICH	CT	METRO-NORTH RAILROAD
107	8 SOUND SHORE DRIVE	GREENWICH	CT	8 SOUND SHORE ASSOCIATES LLC C/O EUGENE A. HOFFAN MANAGEMENT INC
114	4 SOUND SHORE DRIVE	GREENWICH	CT	4 SOUND SHORE DRIVE CONDO (24 UNITS - SEE INDIVIDUAL UNIT LISTINGS BELOW)
114.01	4 SOUND SHORE DRIVE, UNIT 1	GREENWICH	CT	BRUCE L & ANN MARGARET WARWICK
114.02	4 SOUND SHORE DRIVE, UNIT 2	GREENWICH	CT	IGOR TULCHINSKY
114.03	4 SOUND SHORE DRIVE, UNIT 3	GREENWICH	CT	TDC JR FAMILY INVESTMENT LLC C/O CABOT-WELLINGTON LLC
114.04	4 SOUND SHORE DRIVE, UNIT 4	GREENWICH	CT	ALICE P MELLY & BENSLEY TRUSTEES
114.05	4 SOUND SHORE DRIVE, UNIT 5	GREENWICH	CT	VJHC DEVELOPMENT CORP C/O MOTT & PRINCE MANAGEMENT INC
114.06	4 SOUND SHORE DRIVE, UNIT 6	GREENWICH	CT	LILLIAN C ANDERSON REVOCABLE TRUST
114.07	4 SOUND SHORE DRIVE, UNIT 7	GREENWICH	CT	ROBERT F FULLER REVOCABLE TRUST
114.08	4 SOUND SHORE DRIVE, UNIT 8	GREENWICH	CT	GENSSLER ENTERPRISES LLLP
114.09	4 SOUND SHORE DRIVE, UNIT 9	GREENWICH	CT	ROBERT H, JR & ROSLIE CLARK
114.10	4 SOUND SHORE DRIVE, UNIT 10	GREENWICH	CT	DAVID J & DONALD T MACNAUGHTON
114.11	4 SOUND SHORE DRIVE, UNIT 11	GREENWICH	CT	HENRY VOLQUARDEN
114.12	4 SOUND SHORE DRIVE, UNIT 12	GREENWICH	CT	KELESHIAN INVESTMENTS LLC
114.13	4 SOUND SHORE DRIVE, UNIT 13	GREENWICH	CT	HOLLIANN LLC
114.14	4 SOUND SHORE DRIVE, UNIT 14	GREENWICH	CT	MAUREEN R SMITH & RYAN J JAMES TRUST C/O RYAN J JAMES
114.15	4 SOUND SHORE DRIVE, UNIT 15	GREENWICH	CT	JAMES A LASH & DEBORAH JONES
114.16	4 SOUND SHORE DRIVE, UNIT 16	GREENWICH	CT	LUCY F GREENE TRUST C/O LUCY F GREEN
114.17	4 SOUND SHORE DRIVE, UNIT 17	GREENWICH	CT	LYNDA M BRIGGS TRUST
114.18	4 SOUND SHORE DRIVE, UNIT 18	GREENWICH	CT	JONATHAN P & LAURIE P NELSON, THE WATERFORD
114.19	4 SOUND SHORE DRIVE, UNIT 20	GREENWICH	CT	DONALD C WAITE III LIVING TRUST
114.20	4 SOUND SHORE DRIVE, UNIT 19	GREENWICH	CT	FRED G & REGINE LANGHAMMER
114.21	4 SOUND SHORE DRIVE, UNIT 21	GREENWICH	CT	BOBTERRI REALTY LLC
114.22	4 SOUND SHORE DRIVE, UNIT 22	GREENWICH	CT	HEIDENREIGH REAL ESTATE INVESTMENTS LLC
114.23	4 SOUND SHORE DRIVE, UNIT 23	GREENWICH	CT	PER & ASTRID HEIDENREIGH
114.24	4 SOUND SHORE DRIVE, UNIT 24	GREENWICH	CT	JOSEPH J SHROPSHIRE TRUST

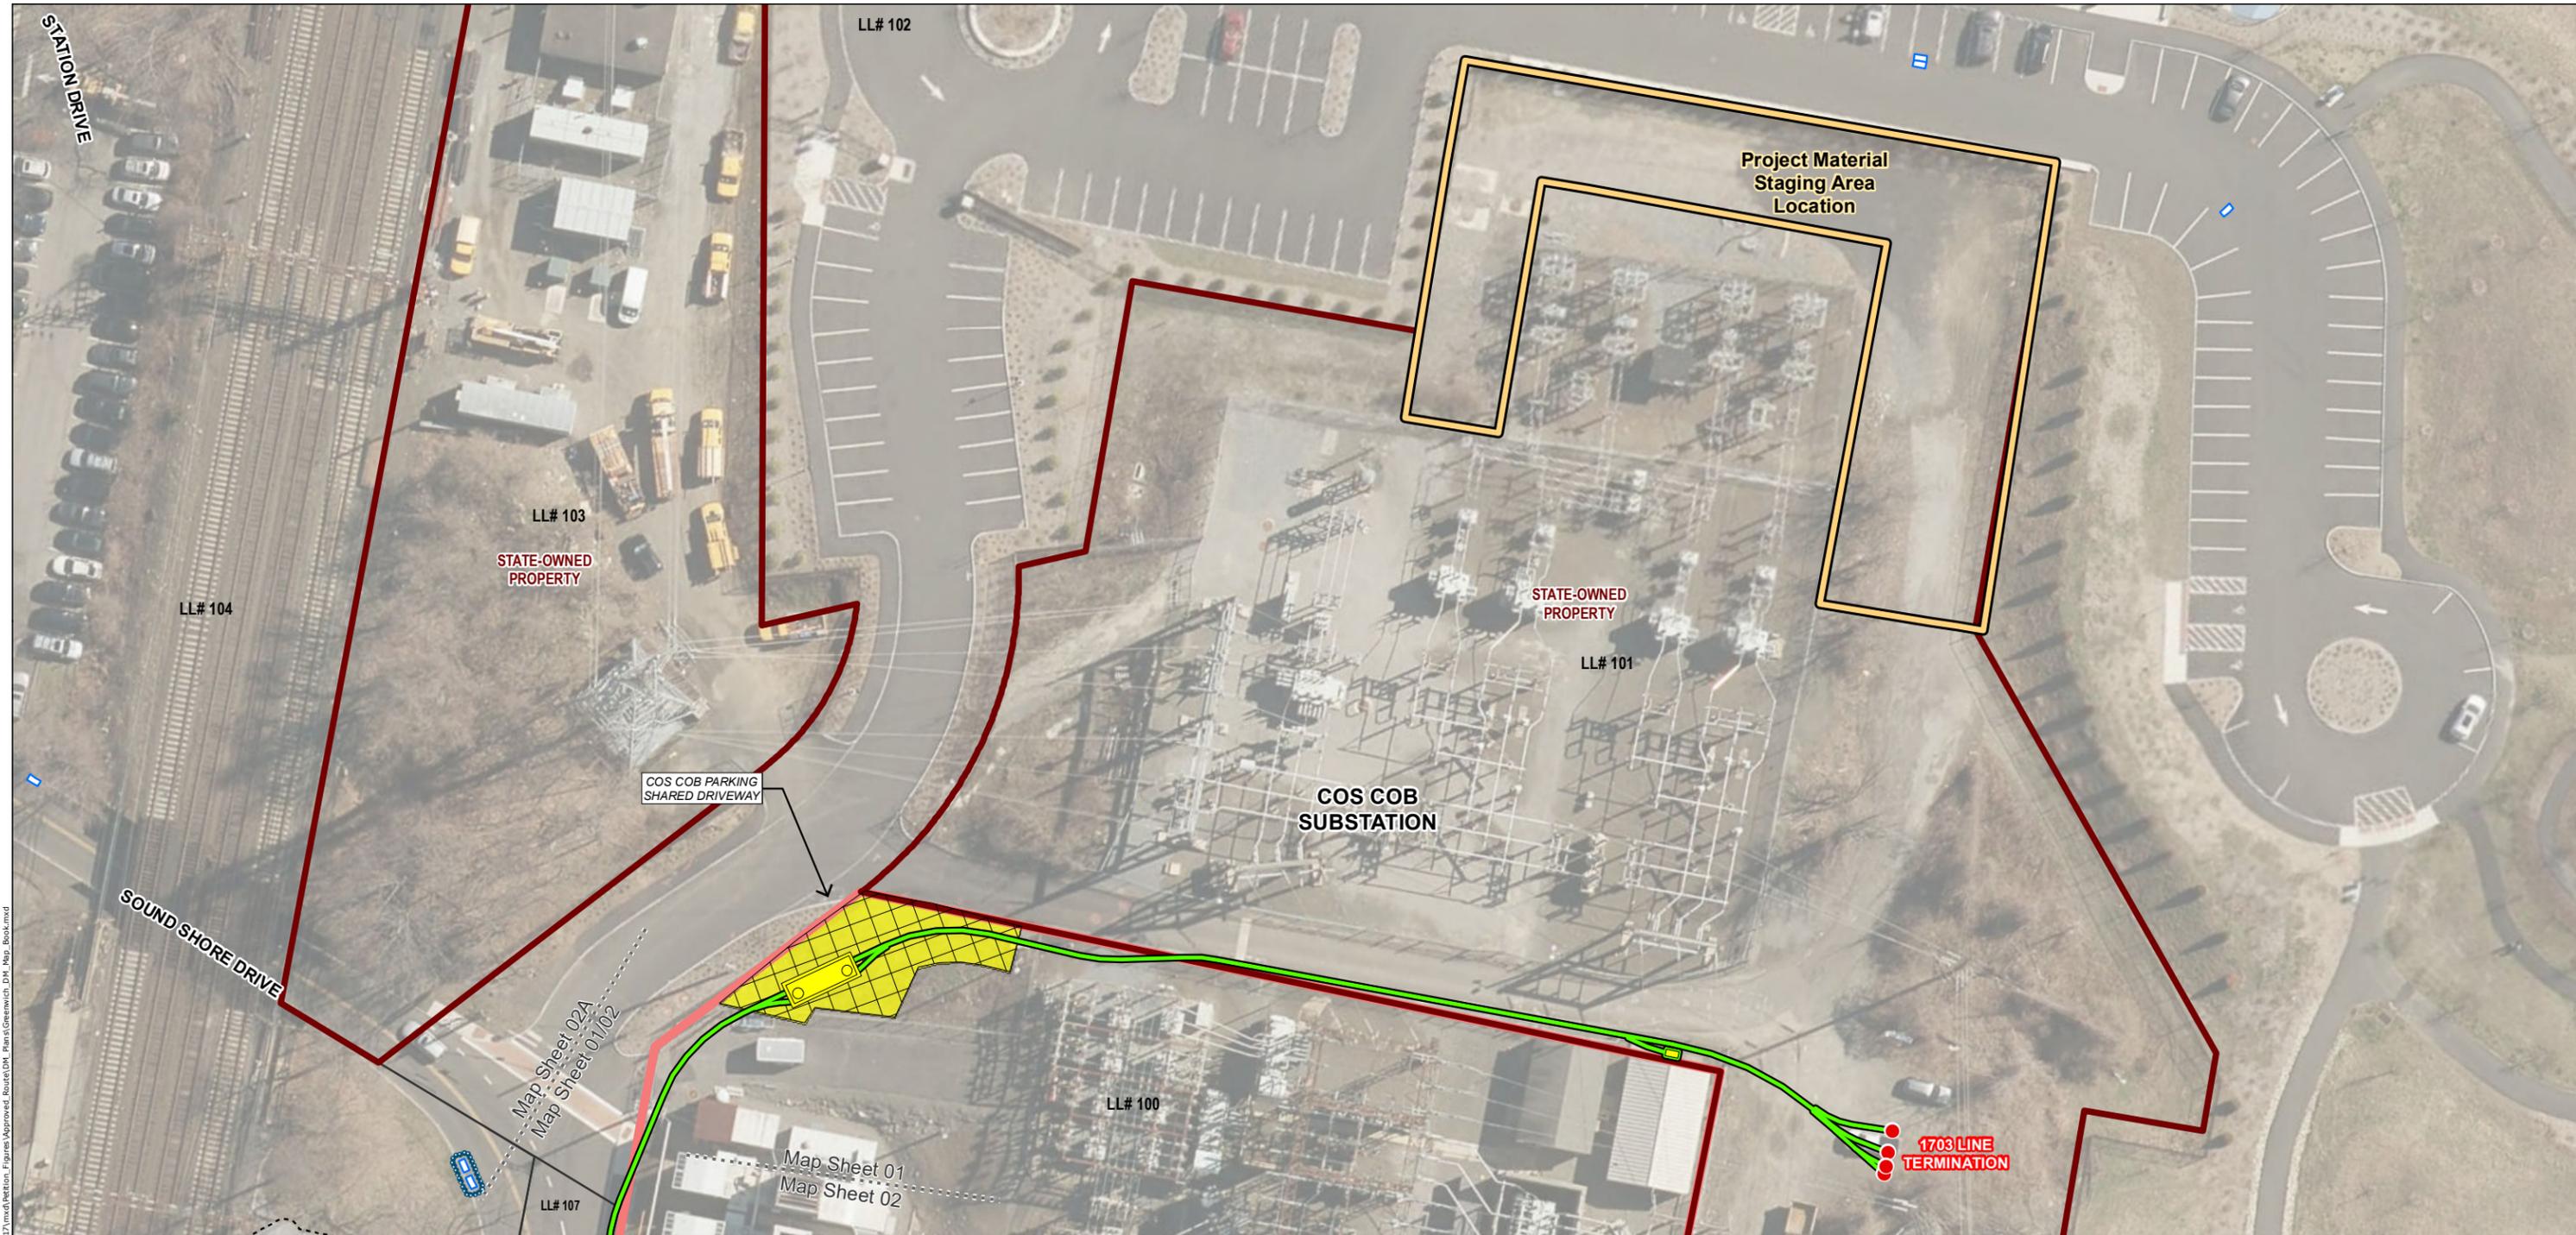

GENERAL NOTES:

- PLEASE REFER TO THE TRAFFIC MANAGEMENT PLAN IN APPENDIX C.
- THE LIMITS OF DISTURBANCE AS SHOWN DEFINE AREAS WHERE VEGETATION REMOVAL AND GRUBBING, GRADING, AND EXCAVATION MAY OCCUR.
- ALL WORK WILL BE CONDUCTED IN ACCORDANCE WITH THE RELEVANT PORTIONS OF EVERSOURCE'S BMP MANUAL: CONNECTICUT CONSTRUCTION AND MAINTENANCE ENVIRONMENTAL REQUIREMENTS (BMP MANUAL), UNLESS MORE STRINGENT PROJECT-SPECIFIC MEASURES APPLY.
- ALL WORK WILL BE CONDUCTED IN ACCORDANCE WITH THE REQUIREMENTS OF REGULATORY APPROVALS FROM THE CONNECTICUT SITING COUNCIL, U.S. ARMY CORPS OF ENGINEERS, THE CONNECTICUT DEPARTMENT OF ENERGY AND ENVIRONMENTAL PROTECTION, AND THE CONNECTICUT DEPARTMENT OF TRANSPORTATION, AND WITH ALL PROJECT PROTOCOLS.
- EROSION AND SEDIMENTATION CONTROL MEASURES WILL BE INSTALLED AND MAINTAINED (IN REFERENCE TO E&S CONTROLS) DURING CONSTRUCTION, AS REQUIRED, TO COMPLY WITH THE 2002 CONNECTICUT GUIDELINES FOR SOIL EROSION AND SEDIMENT CONTROL, AND EVERSOURCE'S BMP MANUAL, AND APPLICABLE REGULATORY APPROVALS.
- ALL SIDEWALK AND CURBING SECTIONS THAT INTERSECT WITH THE PROPOSED TRANSMISSION LINE SHALL BE REPLACED IN KIND.

These Maps are not intended for construction. Construction notes and details are included in Appendix B: 115-kV Double Circuit Underground Transmission Line Drawings.



Legend	
● Substation Termination	■ Limits of Work for Indian Harbor Crossing Discussed in Development and Management Plan Volume 2 - Part 2
□ Splice Vault	■ Temporary Construction Matting
● Hand Hole	■ Construction Entrance
— Underground Transmission-Line Duct (Approx. 4' wide)	■ Stormwater Dewatering Pit
— Underground Transmission-Line Duct Underneath Overpass	■ Stormwater Monitoring Outfall
■ Trenchless Crossing Sending/Receiving Pit	■ Existing Tree to be removed
■ Trenchless Crossing Underneath Interstate-95	■ Existing Tree to be removed and replaced
■ Inlet Protection	■ Work Pad
■ Filter Sock	■ Parking Impact
■ Silt Fence	■ Stockpile
■ Drainage Structure	■ Compensatory Parking
■ Stormwater Monitoring Outfall	■ Project Material Staging Area
■ Existing Tree to be removed	■ Approximate Parcel Boundary
■ Existing Tree to be removed and replaced	■ State-Owned Property
■ Work Pad	■ Eversource Owned Property
■ Parking Impact	--- Map Sheet Matchline

Base Map Source: 2012 Aerial Imagery (CTECO)

1 inch = 50 feet

NO.	DATE	REVISIONS	BY	CHK	APP	APP

EVERSOURCE ENERGY

GREENWICH SUBSTATION AND LINE PROJECT
115-KV DOUBLE CIRCUIT UNDERGROUND TRANSMISSION LINES
GREENWICH, CONNECTICUT
TRANSMISSION LINE DEVELOPMENT & MANAGEMENT PLAN
VOLUME 2 - PART 1

Map Sheet 01 of 17

October 2018


ALL-POINTS TECHNOLOGY CORPORATION

C:\Users\Wolfe\OneDrive\Documents\Projects\Greenwich\GIS\Map_Sheet_01.mxd

MAP SHEET 02 of 17
GREENWICH SUBSTATION AND LINE PROJECT
115-KV DOUBLE CIRCUIT UNDERGROUND TRANSMISSION LINES
GREENWICH, CONNECTICUT

Map Sheet Notes

<u>LL #</u>	<u>Parcel Address</u>	<u>City</u>	<u>State</u>	<u>Owner Name</u>
100	12 SOUND SHORE DRIVE	GREENWICH	CT	CONNECTICUT LIGHT & POWER COMPANY (EVERSOURCE)
102	SOUND SHORE DRIVE	GREENWICH	CT	TOWN OF GREENWICH
103	SOUND SHORE DRIVE	GREENWICH	CT	STATE OF CONNECICUT FINANCE DEPARTMENT
104	STRICKLAND ROAD	GREENWICH	CT	METRO-NORTH RAILROAD
107	8 SOUND SHORE DRIVE	GREENWICH	CT	8 SOUND SHORE ASSOCIATES LLC C/O EUGENE A. HOFFAN MANAGEMENT INC
109	99 LOUGHLIN AVENUE	GREENWICH	CT	MIROSLAV & BARBARA WIECZOREK
110	97 LOUGHLIN AVENUE	GREENWICH	CT	TOMOFUMI & YUMI NAKANISHI
113	35 SACHEM ROAD	GREENWICH	CT	JAMES & LISA MCDONALD
114	4 SOUND SHORE DRIVE	GREENWICH	CT	4 SOUND SHORE DRIVE CONDO (24 UNITS - - SEE INDIVIDUAL UNIT LISTINGS BELOW)
114.01	4 SOUND SHORE DRIVE, UNIT 1	GREENWICH	CT	BRUCE L & ANN MARGARET WARWICK
114.02	4 SOUND SHORE DRIVE, UNIT 2	GREENWICH	CT	IGOR TULCHINSKY
114.03	4 SOUND SHORE DRIVE, UNIT 3	GREENWICH	CT	TDC JR FAMILY INVESTMENT LLC C/O CABOT-WELLINGTON LLC
114.04	4 SOUND SHORE DRIVE, UNIT 4	GREENWICH	CT	ALICE P MELLY & BENSLEY TRUSTEES
114.05	4 SOUND SHORE DRIVE, UNIT 5	GREENWICH	CT	VJHC DEVELOPMENT CORP C/O MOTT & PRINCE MANAGEMENT INC
114.06	4 SOUND SHORE DRIVE, UNIT 6	GREENWICH	CT	LILLIAN C ANDERSON REVOCABLE TRUST
114.07	4 SOUND SHORE DRIVE, UNIT 7	GREENWICH	CT	ROBERT F FULLER REVOCABLE TRUST
114.08	4 SOUND SHORE DRIVE, UNIT 8	GREENWICH	CT	GENSSLER ENTERPRISES LLLP
114.09	4 SOUND SHORE DRIVE, UNIT 9	GREENWICH	CT	ROBERT H, JR & ROSLIE CLARK
114.10	4 SOUND SHORE DRIVE, UNIT 10	GREENWICH	CT	DAVID J & DONALD T MACNAUGHTON
114.11	4 SOUND SHORE DRIVE, UNIT 11	GREENWICH	CT	HENRY VOLQUARDEN
114.12	4 SOUND SHORE DRIVE, UNIT 12	GREENWICH	CT	KELESHIAN INVESTMENTS LLC
114.13	4 SOUND SHORE DRIVE, UNIT 13	GREENWICH	CT	HOLLIANN LLC
114.14	4 SOUND SHORE DRIVE, UNIT 14	GREENWICH	CT	MAUREEN R SMITH & RYAN J JAMES TRUST C/O RYAN J JAMES
114.15	4 SOUND SHORE DRIVE, UNIT 15	GREENWICH	CT	JAMES A LASH & DEBORAH JONES
114.16	4 SOUND SHORE DRIVE, UNIT 16	GREENWICH	CT	LUCY F GREENE TRUST C/O LUCY F GREEN
114.17	4 SOUND SHORE DRIVE, UNIT 17	GREENWICH	CT	LYNDA M BRIGGS TRUST
114.18	4 SOUND SHORE DRIVE, UNIT 18	GREENWICH	CT	JONATHAN P & LAURIE P NELSON, THE WATERFORD
114.19	4 SOUND SHORE DRIVE, UNIT 20	GREENWICH	CT	DONALD C WAITE III LIVING TRUST
114.20	4 SOUND SHORE DRIVE, UNIT 19	GREENWICH	CT	FRED G & REGINE LANGHAMMER
114.21	4 SOUND SHORE DRIVE, UNIT 21	GREENWICH	CT	BOBTERRI REALTY LLC
114.22	4 SOUND SHORE DRIVE, UNIT 22	GREENWICH	CT	HEIDENREIGH REAL ESTATE INVESTMENTS LLC
114.23	4 SOUND SHORE DRIVE, UNIT 23	GREENWICH	CT	PER & ASTRID HEIDENREIGH
114.24	4 SOUND SHORE DRIVE, UNIT 24	GREENWICH	CT	JOSEPH J SHROPSHIRE TRUST
115	INDIAN FIELD ROAD	GREENWICH	CT	TOWN OF GREENWICH C/O FINANCE DEPT

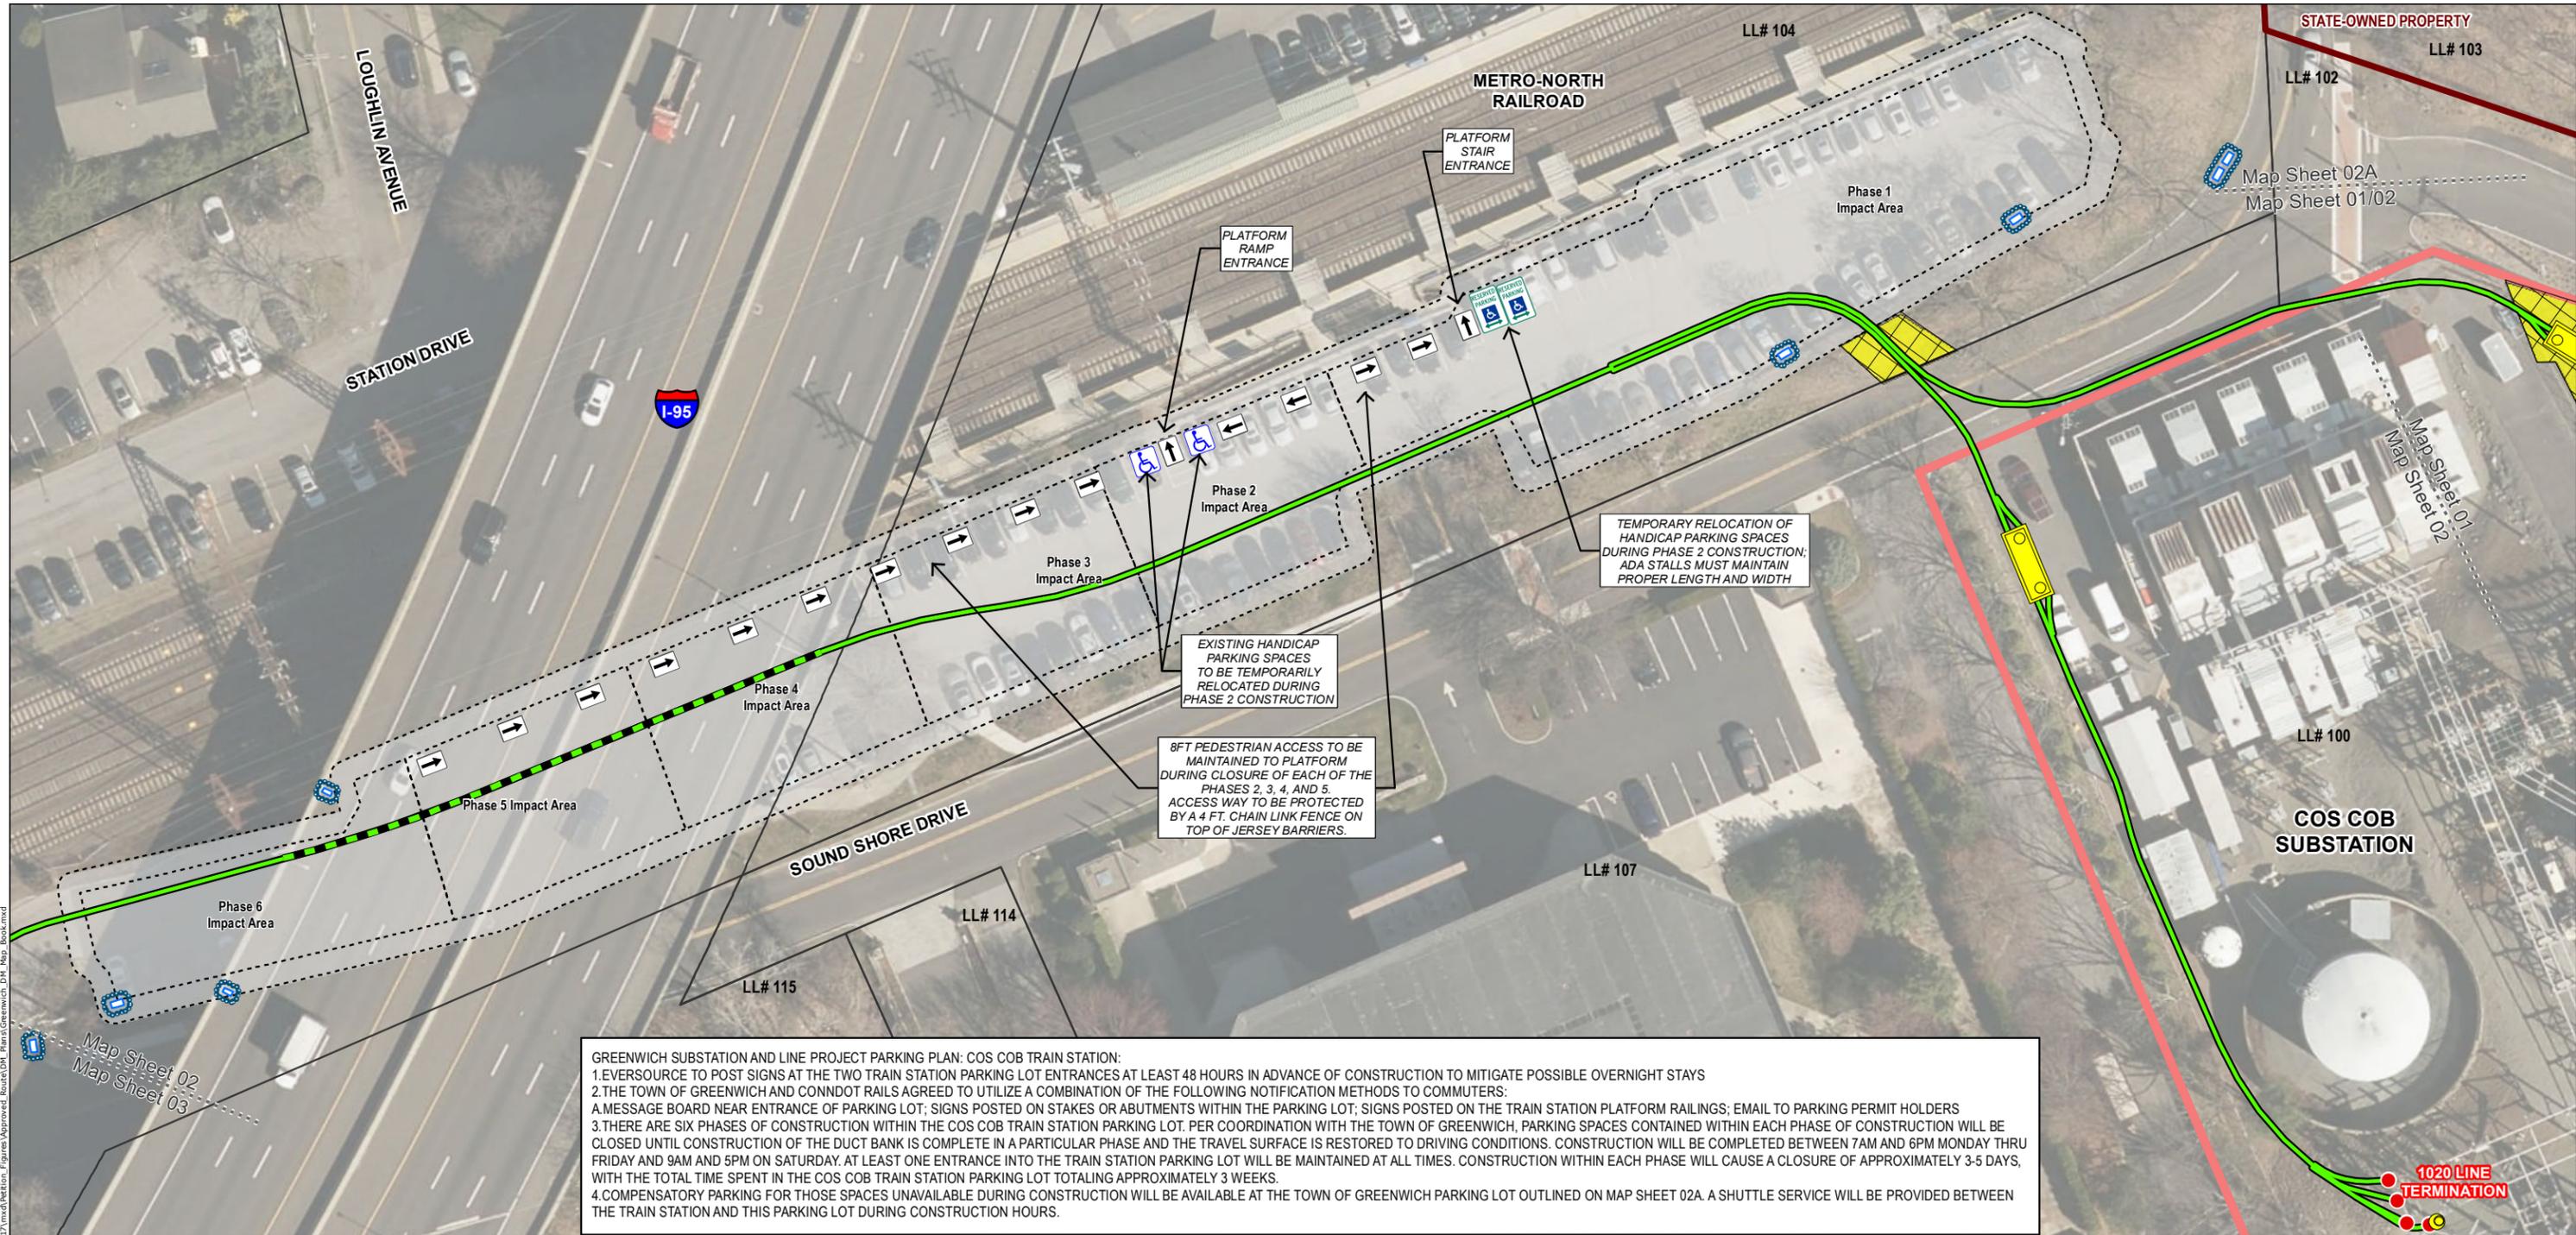


GREENWICH SUBSTATION AND LINE PROJECT PARKING PLAN: COS COB TRAIN STATION:

- EVERSOURCE TO POST SIGNS AT THE TWO TRAIN STATION PARKING LOT ENTRANCES AT LEAST 48 HOURS IN ADVANCE OF CONSTRUCTION TO MITIGATE POSSIBLE OVERNIGHT STAYS
- THE TOWN OF GREENWICH AND CONNDOT RAILS AGREED TO UTILIZE A COMBINATION OF THE FOLLOWING NOTIFICATION METHODS TO COMMUTERS:
A. MESSAGE BOARD NEAR ENTRANCE OF PARKING LOT; SIGNS POSTED ON STAKES OR ABUTMENTS WITHIN THE PARKING LOT; SIGNS POSTED ON THE TRAIN STATION PLATFORM RAILINGS; EMAIL TO PARKING PERMIT HOLDERS
- THERE ARE SIX PHASES OF CONSTRUCTION WITHIN THE COS COB TRAIN STATION PARKING LOT. PER COORDINATION WITH THE TOWN OF GREENWICH, PARKING SPACES CONTAINED WITHIN EACH PHASE OF CONSTRUCTION WILL BE CLOSED UNTIL CONSTRUCTION OF THE DUCT BANK IS COMPLETE IN A PARTICULAR PHASE AND THE TRAVEL SURFACE IS RESTORED TO DRIVING CONDITIONS. CONSTRUCTION WILL BE COMPLETED BETWEEN 7AM AND 6PM MONDAY THRU FRIDAY AND 9AM AND 5PM ON SATURDAY. AT LEAST ONE ENTRANCE INTO THE TRAIN STATION PARKING LOT WILL BE MAINTAINED AT ALL TIMES. CONSTRUCTION WITHIN EACH PHASE WILL CAUSE A CLOSURE OF APPROXIMATELY 3-5 DAYS, WITH THE TOTAL TIME SPENT IN THE COS COB TRAIN STATION PARKING LOT TOTALING APPROXIMATELY 3 WEEKS.
- COMPENSATORY PARKING FOR THOSE SPACES UNAVAILABLE DURING CONSTRUCTION WILL BE AVAILABLE AT THE TOWN OF GREENWICH PARKING LOT OUTLINED ON MAP SHEET 02A. A SHUTTLE SERVICE WILL BE PROVIDED BETWEEN THE TRAIN STATION AND THIS PARKING LOT DURING CONSTRUCTION HOURS.

- GENERAL NOTES:**
- PLEASE REFER TO THE TRAFFIC MANAGEMENT PLAN IN APPENDIX C.
 - THE LIMITS OF DISTURBANCE AS SHOWN DEFINE AREAS WHERE VEGETATION REMOVAL AND GRUBBING, GRADING, AND EXCAVATION MAY OCCUR.
 - ALL WORK WILL BE CONDUCTED IN ACCORDANCE WITH THE RELEVANT PORTIONS OF EVERSOURCE'S BMP MANUAL: CONNECTICUT CONSTRUCTION AND MAINTENANCE ENVIRONMENTAL REQUIREMENTS (BMP MANUAL), UNLESS MORE STRINGENT PROJECT-SPECIFIC MEASURES APPLY.
 - ALL WORK WILL BE CONDUCTED IN ACCORDANCE WITH THE REQUIREMENTS OF REGULATORY APPROVALS FROM THE CONNECTICUT SITING COUNCIL, U.S. ARMY CORPS OF ENGINEERS, THE CONNECTICUT DEPARTMENT OF ENERGY AND ENVIRONMENTAL PROTECTION, AND THE CONNECTICUT DEPARTMENT OF TRANSPORTATION, AND WITH ALL PROJECT PROTOCOLS.
 - EROSION AND SEDIMENTATION CONTROL MEASURES WILL BE INSTALLED AND MAINTAINED (IN REFERENCE TO E&S CONTROLS) DURING CONSTRUCTION, AS REQUIRED, TO COMPLY WITH THE 2002 CONNECTICUT GUIDELINES FOR SOIL EROSION AND SEDIMENT CONTROL, AND EVERSOURCE'S BMP MANUAL, AND APPLICABLE REGULATORY APPROVALS.
 - ALL SIDEWALK AND CURBING SECTIONS THAT INTERSECT WITH THE PROPOSED TRANSMISSION LINE SHALL BE REPLACED IN KIND.

These Maps are not intended for construction. Construction notes and details are included in Appendix B: 115-kV Double Circuit Underground Transmission Line Drawings.



Legend	
	Substation Termination
	Splice Vault
	Hand Hole
	Underground Transmission-Line Duct (Approx. 4' wide)
	Underground Transmission-Line Duct Underneath Overpass
	Trenchless Crossing Sending/Receiving Pit
	Trenchless Crossing Underneath Interstate-95
	Limits of Work for Indian Harbor Crossing Discussed in Development and Management Plan Volume 2 - Part 2
	Drainage Structure
	Inlet Protection
	Filter Sock
	Silt Fence
	Stockpile
	Work Pad
	Temporary Construction Matting
	Construction Entrance
	Stormwater Dewatering Pit
	Stormwater Monitoring Outfall
	Existing Tree to be removed
	Existing Tree to be removed and replaced
	Compensatory Parking
	Project Material Staging Area
	Approximate Parcel Boundary
	State-Owned Property
	Eversource Owned Property
	Map Sheet Matchline
	Base Map Source: 2012 Aerial Imagery (CTECO)
	1 inch = 50 feet

EVERSOURCE ENERGY					
GREENWICH SUBSTATION AND LINE PROJECT 115-KV DOUBLE CIRCUIT UNDERGROUND TRANSMISSION LINES GREENWICH, CONNECTICUT TRANSMISSION LINE DEVELOPMENT & MANAGEMENT PLAN VOLUME 2 - PART 1					
Map Sheet 02 of 17				October 2018	
NO.	DATE	REVISIONS	BY	CHK	APP

C:\Users\Nico\OneDrive\Documents\Projects\Greenwich\SS_Route_2017\mxd\Greenwich\SS_Route_2017\mxd\Greenwich_DH_Map_Background

MAP SHEET 02A of 17
GREENWICH SUBSTATION AND LINE PROJECT
115-KV DOUBLE CIRCUIT UNDERGROUND TRANSMISSION LINES
GREENWICH, CONNECTICUT

<u>LL #</u>	<u>Parcel Address</u>	<u>City</u>	<u>State</u>	<u>Owner Name</u>
100	12 SOUND SHORE DRIVE	GREENWICH	CT	CONNECTICUT LIGHT & POWER COMPANY (EVERSOURCE)
102	SOUND SHORE DRIVE	GREENWICH	CT	TOWN OF GREENWICH
103	SOUND SHORE DRIVE	GREENWICH	CT	STATE OF CONNECICUT FINANCE DEPARTMENT
104	STRICKLAND ROAD	GREENWICH	CT	METRO-NORTH RAILROAD
107	8 SOUND SHORE DRIVE	GREENWICH	CT	8 SOUND SHORE ASSOCIATES LLC C/O EUGENE A. HOFFAN MANAGEMENT INC


Map Sheet Notes



TOWN OF GREENWICH PARKING LOT TO BE USED AS COMPENSATORY PARKING LOT FOR THOSE SPACES UNAVAILABLE DURING CONSTRUCTION. A SHUTTLE SERVICE WILL BE PROVIDED BETWEEN THE TRAIN STATION AND THIS PARKING LOT DURING CONSTRUCTION. VALET PARKING SERVICE WILL BE PROVIDED AT THE STATION DRIVE PARKING LOT SO THAT VEHICLES MAY BE DOUBLE PARKED WITHIN THE PARKING LOT.

- GENERAL NOTES:**
- PLEASE REFER TO THE TRAFFIC MANAGEMENT PLAN IN APPENDIX C.
 - THE LIMITS OF DISTURBANCE AS SHOWN DEFINE AREAS WHERE VEGETATION REMOVAL AND GRUBBING, GRADING, AND EXCAVATION MAY OCCUR.
 - ALL WORK WILL BE CONDUCTED IN ACCORDANCE WITH THE RELEVANT PORTIONS OF EVERSOURCE'S BMP MANUAL: CONNECTICUT CONSTRUCTION AND MAINTENANCE ENVIRONMENTAL REQUIREMENTS (BMP MANUAL), UNLESS MORE STRINGENT PROJECT-SPECIFIC MEASURES APPLY.
 - ALL WORK WILL BE CONDUCTED IN ACCORDANCE WITH THE REQUIREMENTS OF REGULATORY APPROVALS FROM THE CONNECTICUT SITING COUNCIL, U.S. ARMY CORPS OF ENGINEERS, THE CONNECTICUT DEPARTMENT OF ENERGY AND ENVIRONMENTAL PROTECTION, AND THE CONNECTICUT DEPARTMENT OF TRANSPORTATION, AND WITH ALL PROJECT PROTOCOLS.
 - EROSION AND SEDIMENTATION CONTROL MEASURES WILL BE INSTALLED AND MAINTAINED (IN REFERENCE TO E&S CONTROLS) DURING CONSTRUCTION, AS REQUIRED, TO COMPLY WITH THE 2002 CONNECTICUT GUIDELINES FOR SOIL EROSION AND SEDIMENT CONTROL, AND EVERSOURCE'S BMP MANUAL, AND APPLICABLE REGULATORY APPROVALS.
 - ALL SIDEWALK AND CURBING SECTIONS THAT INTERSECT WITH THE PROPOSED TRANSMISSION LINE SHALL BE REPLACED IN KIND.

These Maps are not intended for construction. Construction notes and details are included in Appendix B: 115-kV Double Circuit Underground Transmission Line Drawings.

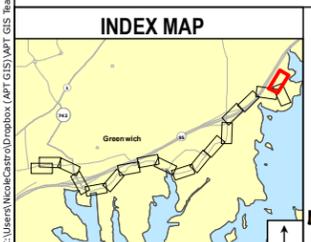

Legend	
● Substation Termination	■ Limits of Work for Indian Harbor Crossing Discussed in Development and Management Plan Volume 2 - Part 2
□ Splice Vault	■ Temporary Construction Matting
● Hand Hole	□ Construction Entrance
— Underground Transmission-Line Duct (Approx. 4' wide)	□ Stormwater Dewatering Pit
— Underground Transmission-Line Duct Underneath Overpass	□ Stormwater Monitoring Outfall
□ Trenchless Crossing Sending/Receiving Pit	● Existing Tree to be removed
□ Trenchless Crossing Underneath Interstate-95	● Existing Tree to be removed and replaced
— Drainage Structure	□ Work Pad
□ Inlet Protection	□ Parking Impact
□ Filter Sock	
□ Silt Fence	
□ Stockpile	

Base Map Source:
2012 Aerial Imagery (CTECO)

1 inch = 50 feet

NO.	DATE	REVISIONS	BY	CHK	APP	APP

EVERSOURCE ENERGY

GREENWICH SUBSTATION AND LINE PROJECT

115-KV DOUBLE CIRCUIT UNDERGROUND TRANSMISSION LINES

GREENWICH, CONNECTICUT

TRANSMISSION LINE DEVELOPMENT & MANAGEMENT PLAN

VOLUME 2 - PART 1


Map Sheet 02A of 17

October 2018

MAP SHEET 03 of 17
GREENWICH SUBSTATION AND LINE PROJECT
115-KV DOUBLE CIRCUIT UNDERGROUND TRANSMISSION LINES
GREENWICH, CONNECTICUT

<u>LL #</u>	<u>Parcel Address</u>	<u>City</u>	<u>State</u>	<u>Owner Name</u>
115	INDIAN FIELD ROAD	GREENWICH	CT	TOWN OF GREENWICH C/O FINANCE DEPT
116	1 SOUND SHORE DRIVE	GREENWICH	CT	SOUND SHORE PARTNERS LLC. MANAGEMENT OFFICE


Map Sheet Notes

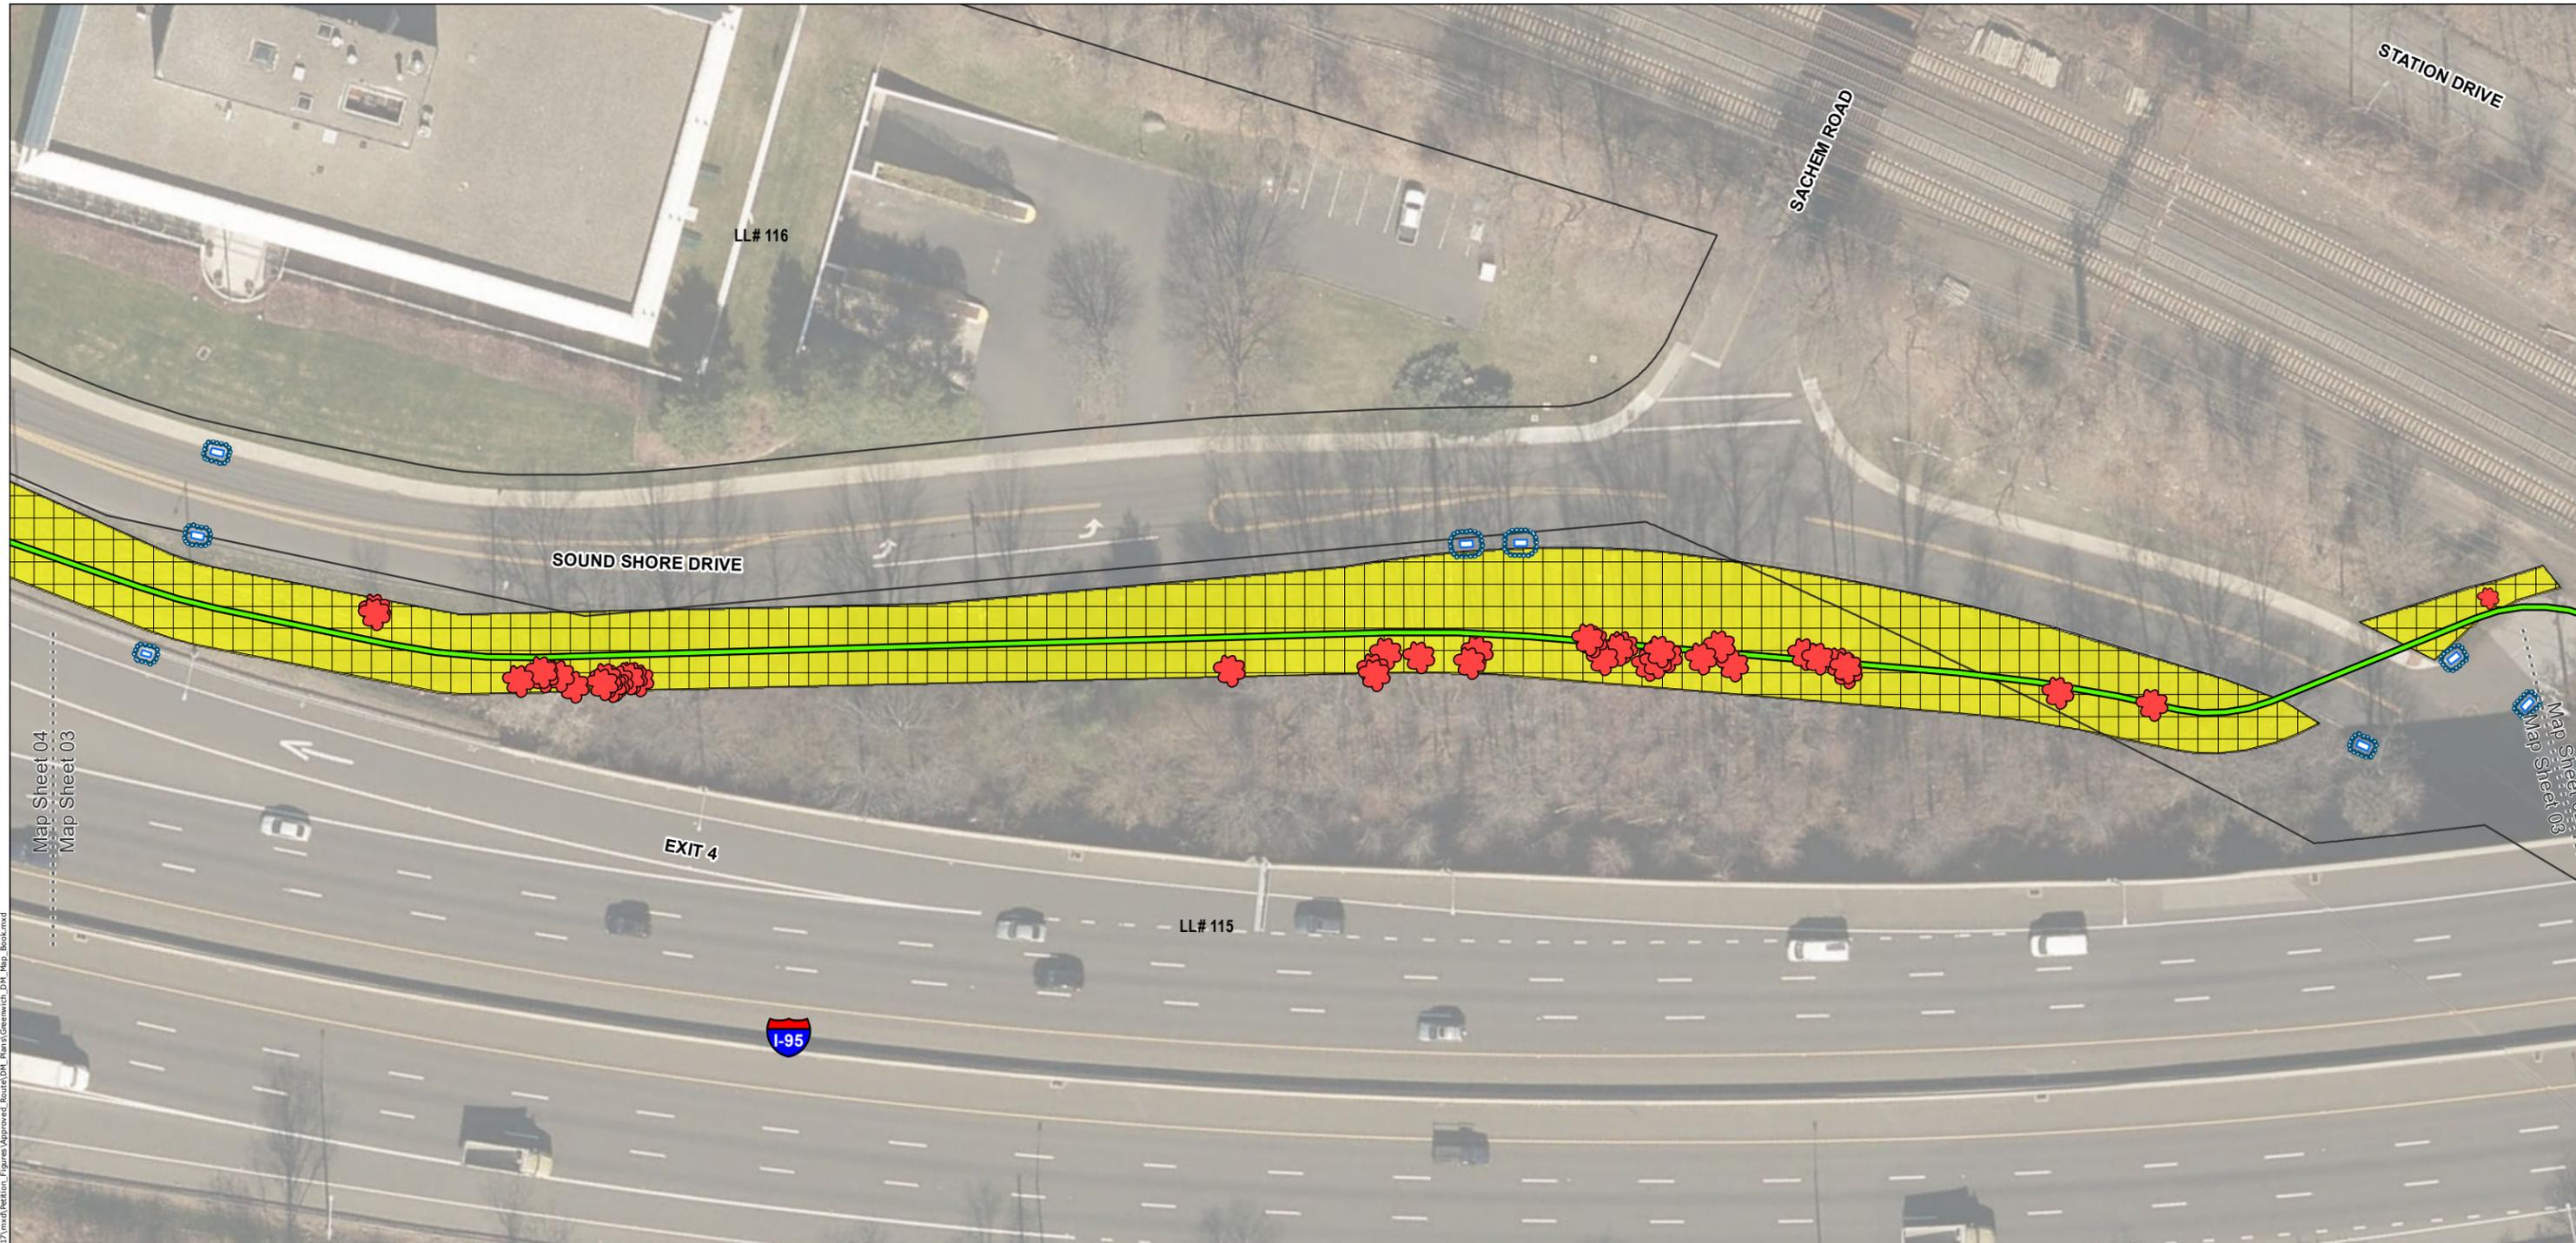

GENERAL NOTES:

- PLEASE REFER TO THE TRAFFIC MANAGEMENT PLAN IN APPENDIX C.
- THE LIMITS OF DISTURBANCE AS SHOWN DEFINE AREAS WHERE VEGETATION REMOVAL AND GRUBBING, GRADING, AND EXCAVATION MAY OCCUR.
- ALL WORK WILL BE CONDUCTED IN ACCORDANCE WITH THE RELEVANT PORTIONS OF EVERSOURCE'S BMP MANUAL: CONNECTICUT CONSTRUCTION AND MAINTENANCE ENVIRONMENTAL REQUIREMENTS (BMP MANUAL), UNLESS MORE STRINGENT PROJECT-SPECIFIC MEASURES APPLY.
- ALL WORK WILL BE CONDUCTED IN ACCORDANCE WITH THE REQUIREMENTS OF REGULATORY APPROVALS FROM THE CONNECTICUT SITING COUNCIL, U.S. ARMY CORPS OF ENGINEERS, THE CONNECTICUT DEPARTMENT OF ENERGY AND ENVIRONMENTAL PROTECTION, AND THE CONNECTICUT DEPARTMENT OF TRANSPORTATION, AND WITH ALL PROJECT PROTOCOLS.
- EROSION AND SEDIMENTATION CONTROL MEASURES WILL BE INSTALLED AND MAINTAINED (IN REFERENCE TO E&S CONTROLS) DURING CONSTRUCTION, AS REQUIRED, TO COMPLY WITH THE 2002 CONNECTICUT GUIDELINES FOR SOIL EROSION AND SEDIMENT CONTROL, AND EVERSOURCE'S BMP MANUAL, AND APPLICABLE REGULATORY APPROVALS.
- ALL SIDEWALK AND CURBING SECTIONS THAT INTERSECT WITH THE PROPOSED TRANSMISSION LINE SHALL BE REPLACED IN KIND.

These Maps are not intended for construction. Construction notes and details are included in Appendix B: 115-kV Double Circuit Underground Transmission Line Drawings.



Legend	
● Substation Termination	■ Limits of Work for Indian Harbor Crossing Discussed in Development and Management Plan Volume 2 - Part 2
□ Splice Vault	■ Temporary Construction Matting
● Hand Hole	■ Construction Entrance
— Underground Transmission-Line Duct (Approx. 4' wide)	■ Stormwater Dewatering Pit
— Underground Transmission-Line Duct Underneath Overpass	■ Stormwater Monitoring Outfall
■ Trenchless Crossing Sending/Receiving Pit	■ Existing Tree to be removed
■ Trenchless Crossing Underneath Interstate-95	■ Existing Tree to be removed and replaced
■ Inlet Protection	■ Work Pad
■ Filter Sock	■ Parking Impact
■ Silt Fence	
■ Stockpile	

■ Compensatory Parking	■ Project Material Staging Area
■ Approximate Parcel Boundary	■ State-Owned Property
■ Eversource Owned Property	--- Map Sheet Matchline

Base Map Source: 2012 Aerial Imagery (CTECO)

1 inch = 50 feet

NO.	DATE	REVISIONS	BY	CHK	APP	APP

EVERSOURCE ENERGY

GREENWICH SUBSTATION AND LINE PROJECT
115-KV DOUBLE CIRCUIT UNDERGROUND TRANSMISSION LINES
GREENWICH, CONNECTICUT
TRANSMISSION LINE DEVELOPMENT & MANAGEMENT PLAN
VOLUME 2 - PART 1

Map Sheet 03 of 17


October 2018

C:\Users\Nico\OneDrive\Documents\GIS\Team Folder\Projects\Eversource\Greenwich, SS - Route, 2017\mxd\petition_figures\Approved_Route\DH_Plans\Greenwich_DH_Map_Book.mxd

MAP SHEET 04 of 17
GREENWICH SUBSTATION AND LINE PROJECT
115-KV DOUBLE CIRCUIT UNDERGROUND TRANSMISSION LINES
GREENWICH, CONNECTICUT

Map Sheet Notes


<u>LL #</u>	<u>Parcel Address</u>	<u>City</u>	<u>State</u>	<u>Owner Name</u>
115	INDIAN FIELD ROAD	GREENWICH	CT	TOWN OF GREENWICH C/O FINANCE DEPT
116	1 SOUND SHORE DRIVE	GREENWICH	CT	SOUND SHORE PARTNERS LLC. MANAGEMENT OFFICE
117	99 INDIAN FIELD ROAD	GREENWICH	CT	AMERICAN NATIONAL RED CROSS ATTN: ANDREA GRAFFER
129	101 INDIAN FIELD ROAD	GREENWICH	CT	INDIAN FIELD SCHOOL

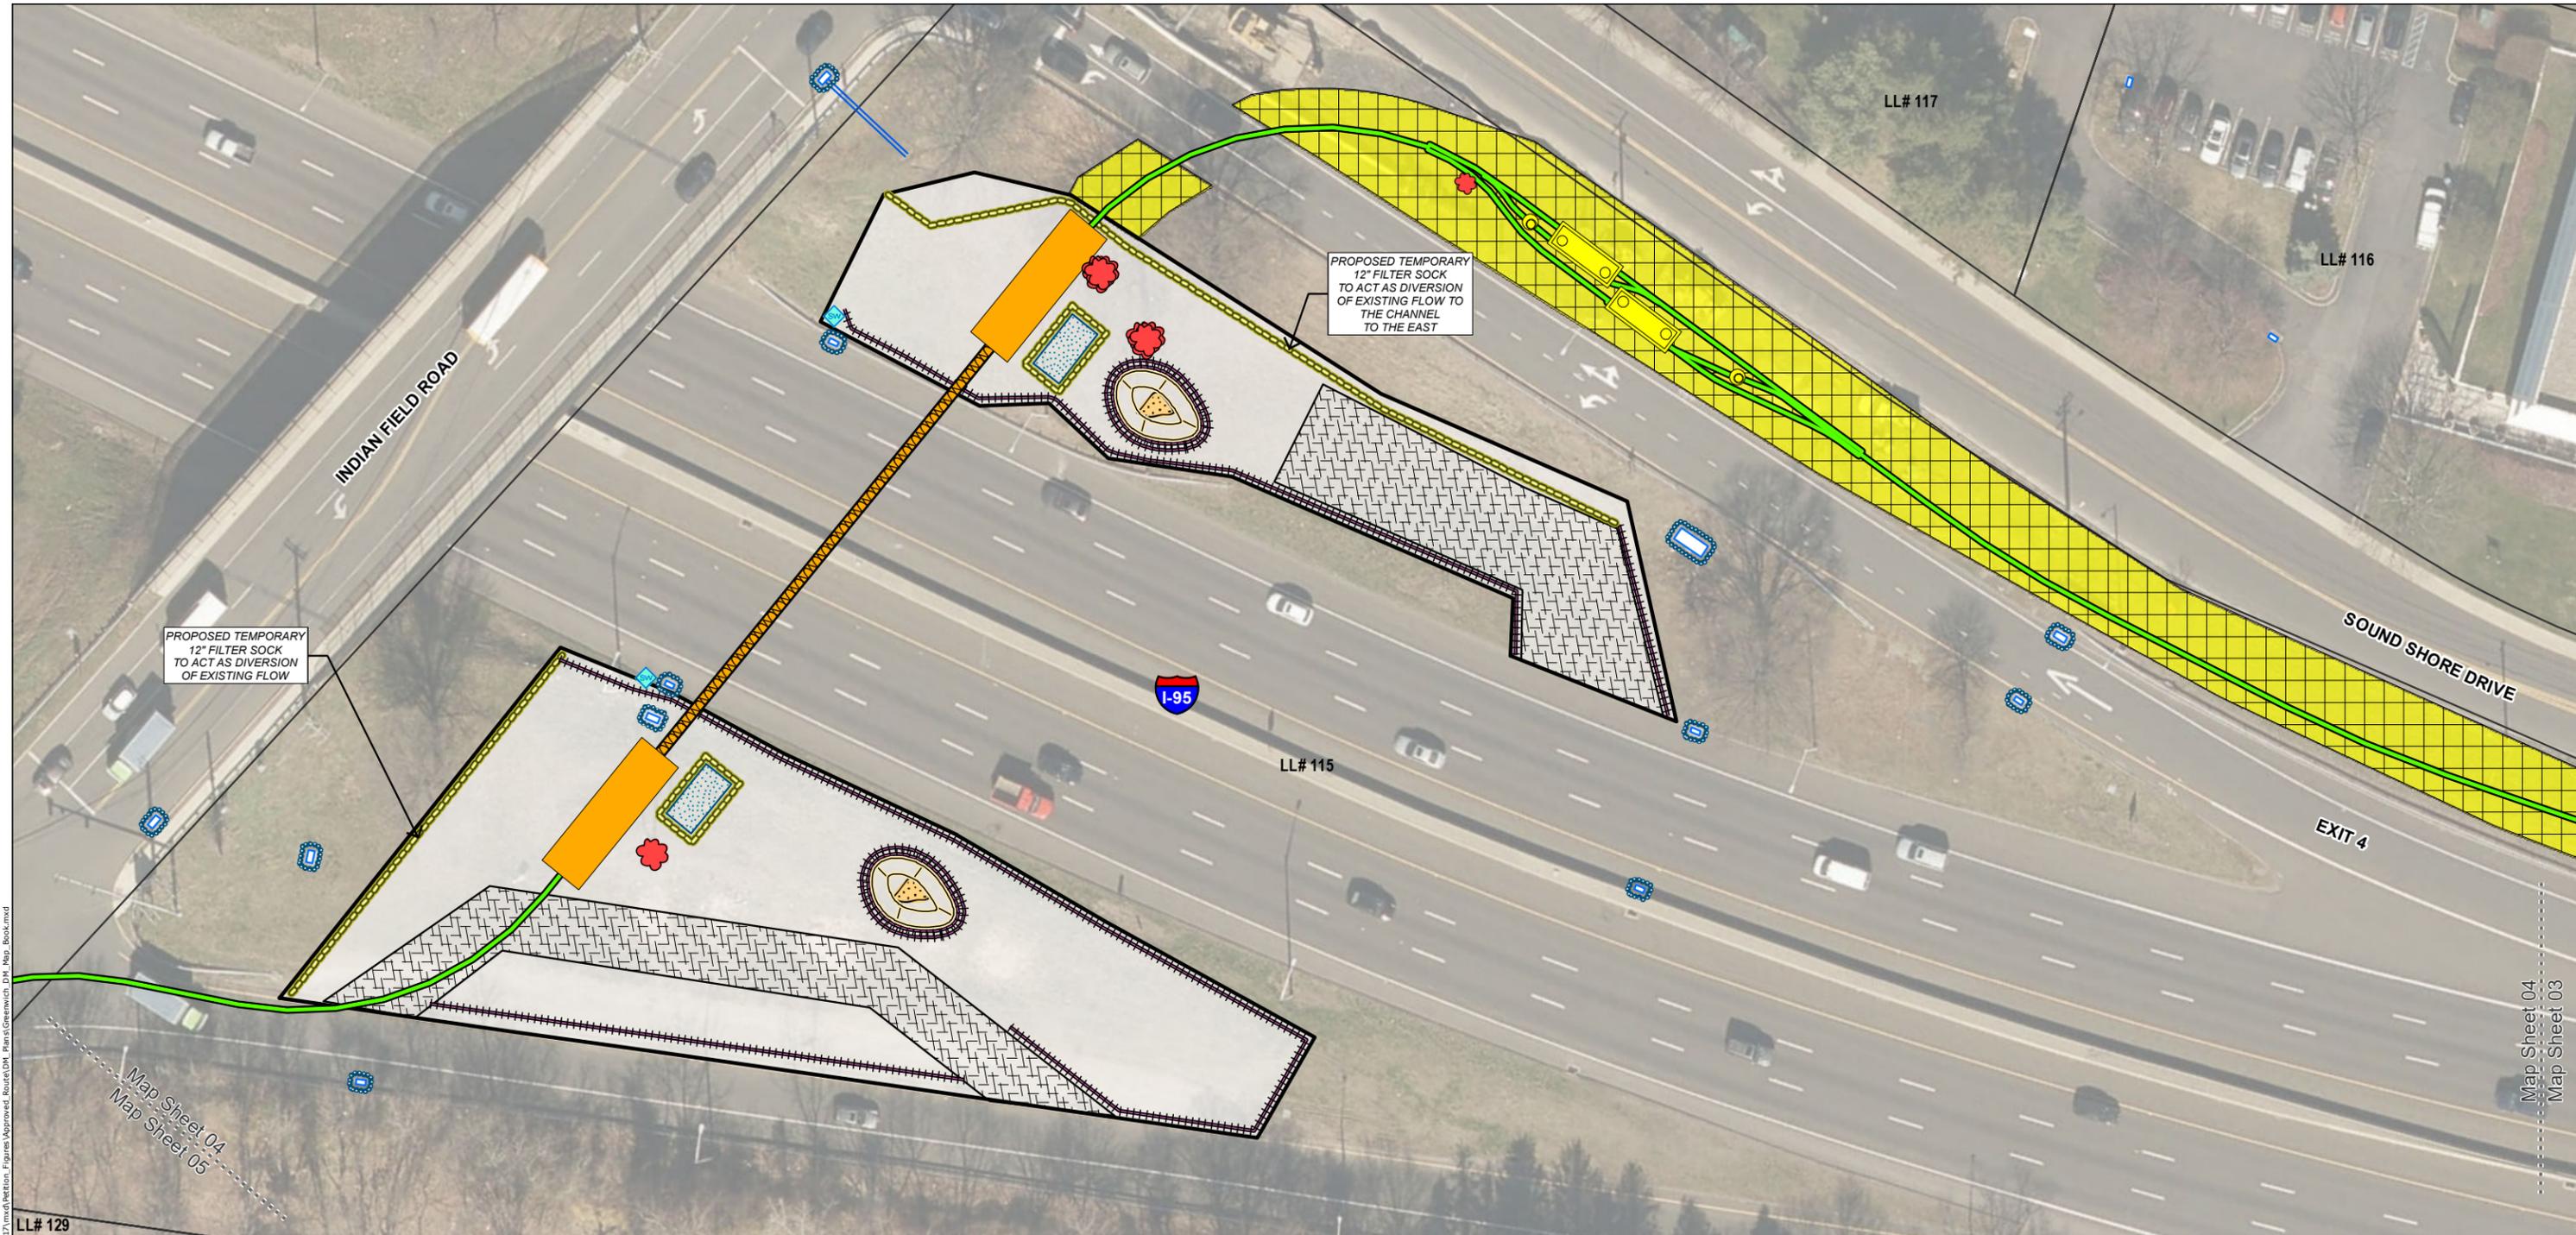

GENERAL NOTES:


- PLEASE REFER TO THE TRAFFIC MANAGEMENT PLAN IN APPENDIX C.
- THE LIMITS OF DISTURBANCE AS SHOWN DEFINE AREAS WHERE VEGETATION REMOVAL AND GRUBBING, GRADING, AND EXCAVATION MAY OCCUR.
- ALL WORK WILL BE CONDUCTED IN ACCORDANCE WITH THE RELEVANT PORTIONS OF EVERSOURCE'S BMP MANUAL: CONNECTICUT CONSTRUCTION AND MAINTENANCE ENVIRONMENTAL REQUIREMENTS (BMP MANUAL), UNLESS MORE STRINGENT PROJECT-SPECIFIC MEASURES APPLY.
- ALL WORK WILL BE CONDUCTED IN ACCORDANCE WITH THE REQUIREMENTS OF REGULATORY APPROVALS FROM THE CONNECTICUT SITING COUNCIL, U.S. ARMY CORPS OF ENGINEERS, THE CONNECTICUT DEPARTMENT OF ENERGY AND ENVIRONMENTAL PROTECTION, AND THE CONNECTICUT DEPARTMENT OF TRANSPORTATION, AND WITH ALL PROJECT PROTOCOLS.
- EROSION AND SEDIMENTATION CONTROL MEASURES WILL BE INSTALLED AND MAINTAINED (IN REFERENCE TO E&S CONTROLS) DURING CONSTRUCTION, AS REQUIRED, TO COMPLY WITH THE 2002 CONNECTICUT GUIDELINES FOR SOIL EROSION AND SEDIMENT CONTROL, AND EVERSOURCE'S BMP MANUAL, AND APPLICABLE REGULATORY APPROVALS.
- ALL SIDEWALK AND CURBING SECTIONS THAT INTERSECT WITH THE PROPOSED TRANSMISSION LINE SHALL BE REPLACED IN KIND.

These Maps are not intended for construction. Construction notes and details are included in Appendix B: 115-kV Double Circuit Underground Transmission Line Drawings.

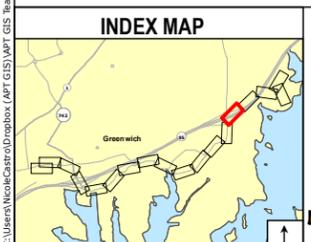

Legend	
● Substation Termination	■ Limits of Work for Indian Harbor Crossing Discussed in Development and Management Plan Volume 2 - Part 2
□ Splice Vault	■ Temporary Construction Matting
● Hand Hole	□ Construction Entrance
— Underground Transmission-Line Duct (Approx. 4' wide)	□ Stormwater Dewatering Pit
— Underground Transmission-Line Duct Underneath Overpass	□ Stormwater Monitoring Outfall
□ Trenchless Crossing Sending/Receiving Pit	● Existing Tree to be removed
□ Trenchless Crossing Underneath Interstate-95	● Existing Tree to be removed and replaced
— Drainage Structure	□ Work Pad
— Inlet Protection	□ Parking Impact
— Filter Sock	
— Silt Fence	
— Stockpile	

NO.	DATE	REVISIONS	BY	CHK	APP	APP



EVERSOURCE ENERGY
GREENWICH SUBSTATION AND LINE PROJECT
115-KV DOUBLE CIRCUIT UNDERGROUND TRANSMISSION LINES
GREENWICH, CONNECTICUT
TRANSMISSION LINE DEVELOPMENT & MANAGEMENT PLAN
VOLUME 2 - PART 1

Map Sheet 04 of 17
 October 2018

C:\Users\Nico\OneDrive\Documents\GIS\Team Folder\Projects\Eversource\Greenwich\SS_Route_2017\mxd\action\Figures\Approved_Route\DH_Plan\Greenwich_DH_Map_Book.mxd

Map Sheet 04
 Map Sheet 03

MAP SHEET 05 of 17
GREENWICH SUBSTATION AND LINE PROJECT
115-KV DOUBLE CIRCUIT UNDERGROUND TRANSMISSION LINES
GREENWICH, CONNECTICUT

Map Sheet Notes

<u>LL #</u>	<u>Parcel Address</u>	<u>City</u>	<u>State</u>	<u>Owner Name</u>
115	INDIAN FIELD ROAD	GREENWICH	CT	TOWN OF GREENWICH C/O FINANCE DEPT
129	101 INDIAN FIELD ROAD	GREENWICH	CT	INDIAN FIELD SCHOOL
130	3 COBB ISLAND DRIVE	GREENWICH	CT	3 COBB ISLAND LLC C/O FOX HORAN & CAMERINI LLP
136	100 INDIAN FIELD ROAD	GREENWICH	CT	TOWN OF GREENWICH
137	108 INDIAN FIELD ROAD	GREENWICH	CT	BURNICE F. HUBBARD
138	110 INDIAN FIELD ROAD	GREENWICH	CT	CHRISTOPHER A. & CYNTHIA P. SALVO
139	66 INDIAN FIELD ROAD	GREENWICH	CT	JOHN E. D. GRUNOW, III & EMILY NOYES
140	200 INDIAN FIELD ROAD	GREENWICH	CT	TOWN OF GREENWICH C/O FINANCE DEPT

MAP SHEET 06 of 17
GREENWICH SUBSTATION AND LINE PROJECT
115-KV DOUBLE CIRCUIT UNDERGROUND TRANSMISSION LINES
GREENWICH, CONNECTICUT

Map Sheet Notes


<u>LL #</u>	<u>Parcel Address</u>	<u>City</u>	<u>State</u>	<u>Owner Name</u>
138	110 INDIAN FIELD ROAD	GREENWICH	CT	CHRISTOPHER A. & CYNTHIA P. SALVO
139	66 INDIAN FIELD ROAD	GREENWICH	CT	JOHN E. D. GRUNOW, III & EMILY NOYES
140	200 INDIAN FIELD ROAD	GREENWICH	CT	TOWN OF GREENWICH C/O FINANCE DEPT
141	48 BRUCE PARK DRIVE	GREENWICH	CT	CHRISTOPHER P JONES & PAMELA D KUHN
142	54 BRUCE PARK DRIVE	GREENWICH	CT	JOHN & SARYNA YOUNG
143	52 BRUCE PARK DRIVE	GREENWICH	CT	ANDREA DOUGLAS
145	46 BRUCE PARK DRIVE	GREENWICH	CT	JOSE R GESTAL & LAURA FILKA
146	44 BRUCE PARK DRIVE	GREENWICH	CT	MIRANDA M & DANIEL J BRODERICK
147	42 BRUCE PARK DRIVE	GREENWICH	CT	TIMOTHY P & SUSAN U SCHIEFFELIN
150	40 BRUCE PARK DRIVE	GREENWICH	CT	SERENA D DUBOIS
151	38 BRUCE PARK DRIVE	GREENWICH	CT	MARY ANNE CLINE



GENERAL NOTES:

- PLEASE REFER TO THE TRAFFIC MANAGEMENT PLAN IN APPENDIX C.
- THE LIMITS OF DISTURBANCE AS SHOWN DEFINE AREAS WHERE VEGETATION REMOVAL AND GRUBBING, GRADING, AND EXCAVATION MAY OCCUR.
- ALL WORK WILL BE CONDUCTED IN ACCORDANCE WITH THE RELEVANT PORTIONS OF EVERSOURCE'S BMP MANUAL: CONNECTICUT CONSTRUCTION AND MAINTENANCE ENVIRONMENTAL REQUIREMENTS (BMP MANUAL), UNLESS MORE STRINGENT PROJECT-SPECIFIC MEASURES APPLY.
- ALL WORK WILL BE CONDUCTED IN ACCORDANCE WITH THE REQUIREMENTS OF REGULATORY APPROVALS FROM THE CONNECTICUT SITING COUNCIL, U.S. ARMY CORPS OF ENGINEERS, THE CONNECTICUT DEPARTMENT OF ENERGY AND ENVIRONMENTAL PROTECTION, AND THE CONNECTICUT DEPARTMENT OF TRANSPORTATION, AND WITH ALL PROJECT PROTOCOLS.
- EROSION AND SEDIMENTATION CONTROL MEASURES WILL BE INSTALLED AND MAINTAINED (IN REFERENCE TO E&S CONTROLS) DURING CONSTRUCTION, AS REQUIRED, TO COMPLY WITH THE 2002 CONNECTICUT GUIDELINES FOR SOIL EROSION AND SEDIMENT CONTROL, AND EVERSOURCE'S BMP MANUAL, AND APPLICABLE REGULATORY APPROVALS.
- ALL SIDEWALK AND CURBING SECTIONS THAT INTERSECT WITH THE PROPOSED TRANSMISSION LINE SHALL BE REPLACED IN KIND.

These Maps are not intended for construction. Construction notes and details are included in Appendix B: 115-kV Double Circuit Underground Transmission Line Drawings.



Legend	
● Substation Termination	■ Limits of Work for Indian Harbor Crossing Discussed in Development and Management Plan Volume 2 - Part 2
□ Splice Vault	■ Temporary Construction Matting
● Hand Hole	■ Construction Entrance
— Underground Transmission-Line Duct (Approx. 4' wide)	■ Stormwater Dewatering Pit
— Underground Transmission-Line Duct Underneath Overpass	■ Stormwater Monitoring Outfall
■ Trenchless Crossing Sending/Receiving Pit	■ Existing Tree to be removed
■ Trenchless Crossing Underneath Interstate-95	■ Existing Tree to be removed and replaced
■ Inlet Protection	■ Work Pad
■ Filter Sock	■ Parking Impact
■ Silt Fence	
■ Stockpile	

EVERSOURCE ENERGY										
GREENWICH SUBSTATION AND LINE PROJECT										
115-KV DOUBLE CIRCUIT UNDERGROUND TRANSMISSION LINES										
GREENWICH, CONNECTICUT										
TRANSMISSION LINE DEVELOPMENT & MANAGEMENT PLAN										
VOLUME 2 - PART 1										
					Map Sheet 06 of 17					
					October 2018					
NO.	DATE	REVISIONS	BY	CHK	APP	APP				

C:\Users\Waco\OneDrive\Documents\GIS\Team Folder\Projects\Eversource\Greenwich\SS_Route_2017\mxd\petition_figures\Approved_Route\DH_Plan\Greenwich_DH_Map_Book.mxd

MAP SHEET 07 of 17
GREENWICH SUBSTATION AND LINE PROJECT
115-KV DOUBLE CIRCUIT UNDERGROUND TRANSMISSION LINES
GREENWICH, CONNECTICUT

Map Sheet Notes

<u>LL #</u>	<u>Parcel Address</u>	<u>City</u>	<u>State</u>	<u>Owner Name</u>
140	200 INDIAN FIELD ROAD	GREENWICH	CT	TOWN OF GREENWICH C/O FINANCE DEPT
151	38 BRUCE PARK DRIVE	GREENWICH	CT	MARY ANNE CLINE
157	200 INDIAN FIELD ROAD	GREENWICH	CT	TOWN OF GREENWICH
158	410 DAVIS AVENUE	GREENWICH	CT	NORMA J STANTON
169	1 MEAD POINT DRIVE	GREENWICH	CT	MICHAEL F & SARAH S MCNULTY

MAP SHEET 08 of 17
GREENWICH SUBSTATION AND LINE PROJECT
115-KV DOUBLE CIRCUIT UNDERGROUND TRANSMISSION LINES
GREENWICH, CONNECTICUT


Map Sheet Notes

<u>LL #</u>	<u>Parcel Address</u>	<u>City</u>	<u>State</u>	<u>Owner Name</u>
157	200 INDIAN FIELD ROAD	GREENWICH	CT	TOWN OF GREENWICH
169	1 MEAD POINT DRIVE	GREENWICH	CT	MICHAEL F & SARAH S MCNULTY
170	409 DAVIS AVENUE	GREENWICH	CT	409 DAVIS AVENUE LLC
171	4 INDIAN CHASE DRIVE	GREENWICH	CT	LISA MARIE AUDET
183	1 INDIAN CHASE DRIVE	GREENWICH	CT	NELLY & YURI TRAISMAN

MAP SHEET 09 of 17
GREENWICH SUBSTATION AND LINE PROJECT
115-KV DOUBLE CIRCUIT UNDERGROUND TRANSMISSION LINES
GREENWICH, CONNECTICUT

Map Sheet Notes

<u>LL #</u>	<u>Parcel Address</u>	<u>City</u>	<u>State</u>	<u>Owner Name</u>
156	BRUCE PARK DRIVE	GREENWICH	CT	TOWN OF GREENWICH C/O FINANCE DEP
157	200 INDIAN FIELD ROAD	GREENWICH	CT	TOWN OF GREENWICH
183	1 INDIAN CHASE DRIVE	GREENWICH	CT	NELLY & YURI TRAISMAN
187	ONEIDA DRIVE	GREENWICH	CT	INDIAN HARBOR ASSOCIATION
188	DAVIS AVENUE	GREENWICH	CT	TOWN OF GREENWICH C/O FINANCE DEPT
189	131 ONEIDA DRIVE	GREENWICH	CT	SARA M. CARTER
198	1 HOME PLACE	GREENWICH	CT	1 HOME PLACE CONDO (3 UNITS - SEE INDIVIDUAL UNIT LISTING)
198.01	1 HOME PLACE UNIT A	GREENWICH	CT	392 DAVIS AVENUE ASSOCIATES LLC
198.02	1 HOME PLACE UNIT B	GREENWICH	CT	392 DAVIS AVENUE ASSOCIATES LLC
198.03	1 HOME PLACE UNIT C	GREENWICH	CT	ROBERT MICHAEL KCH

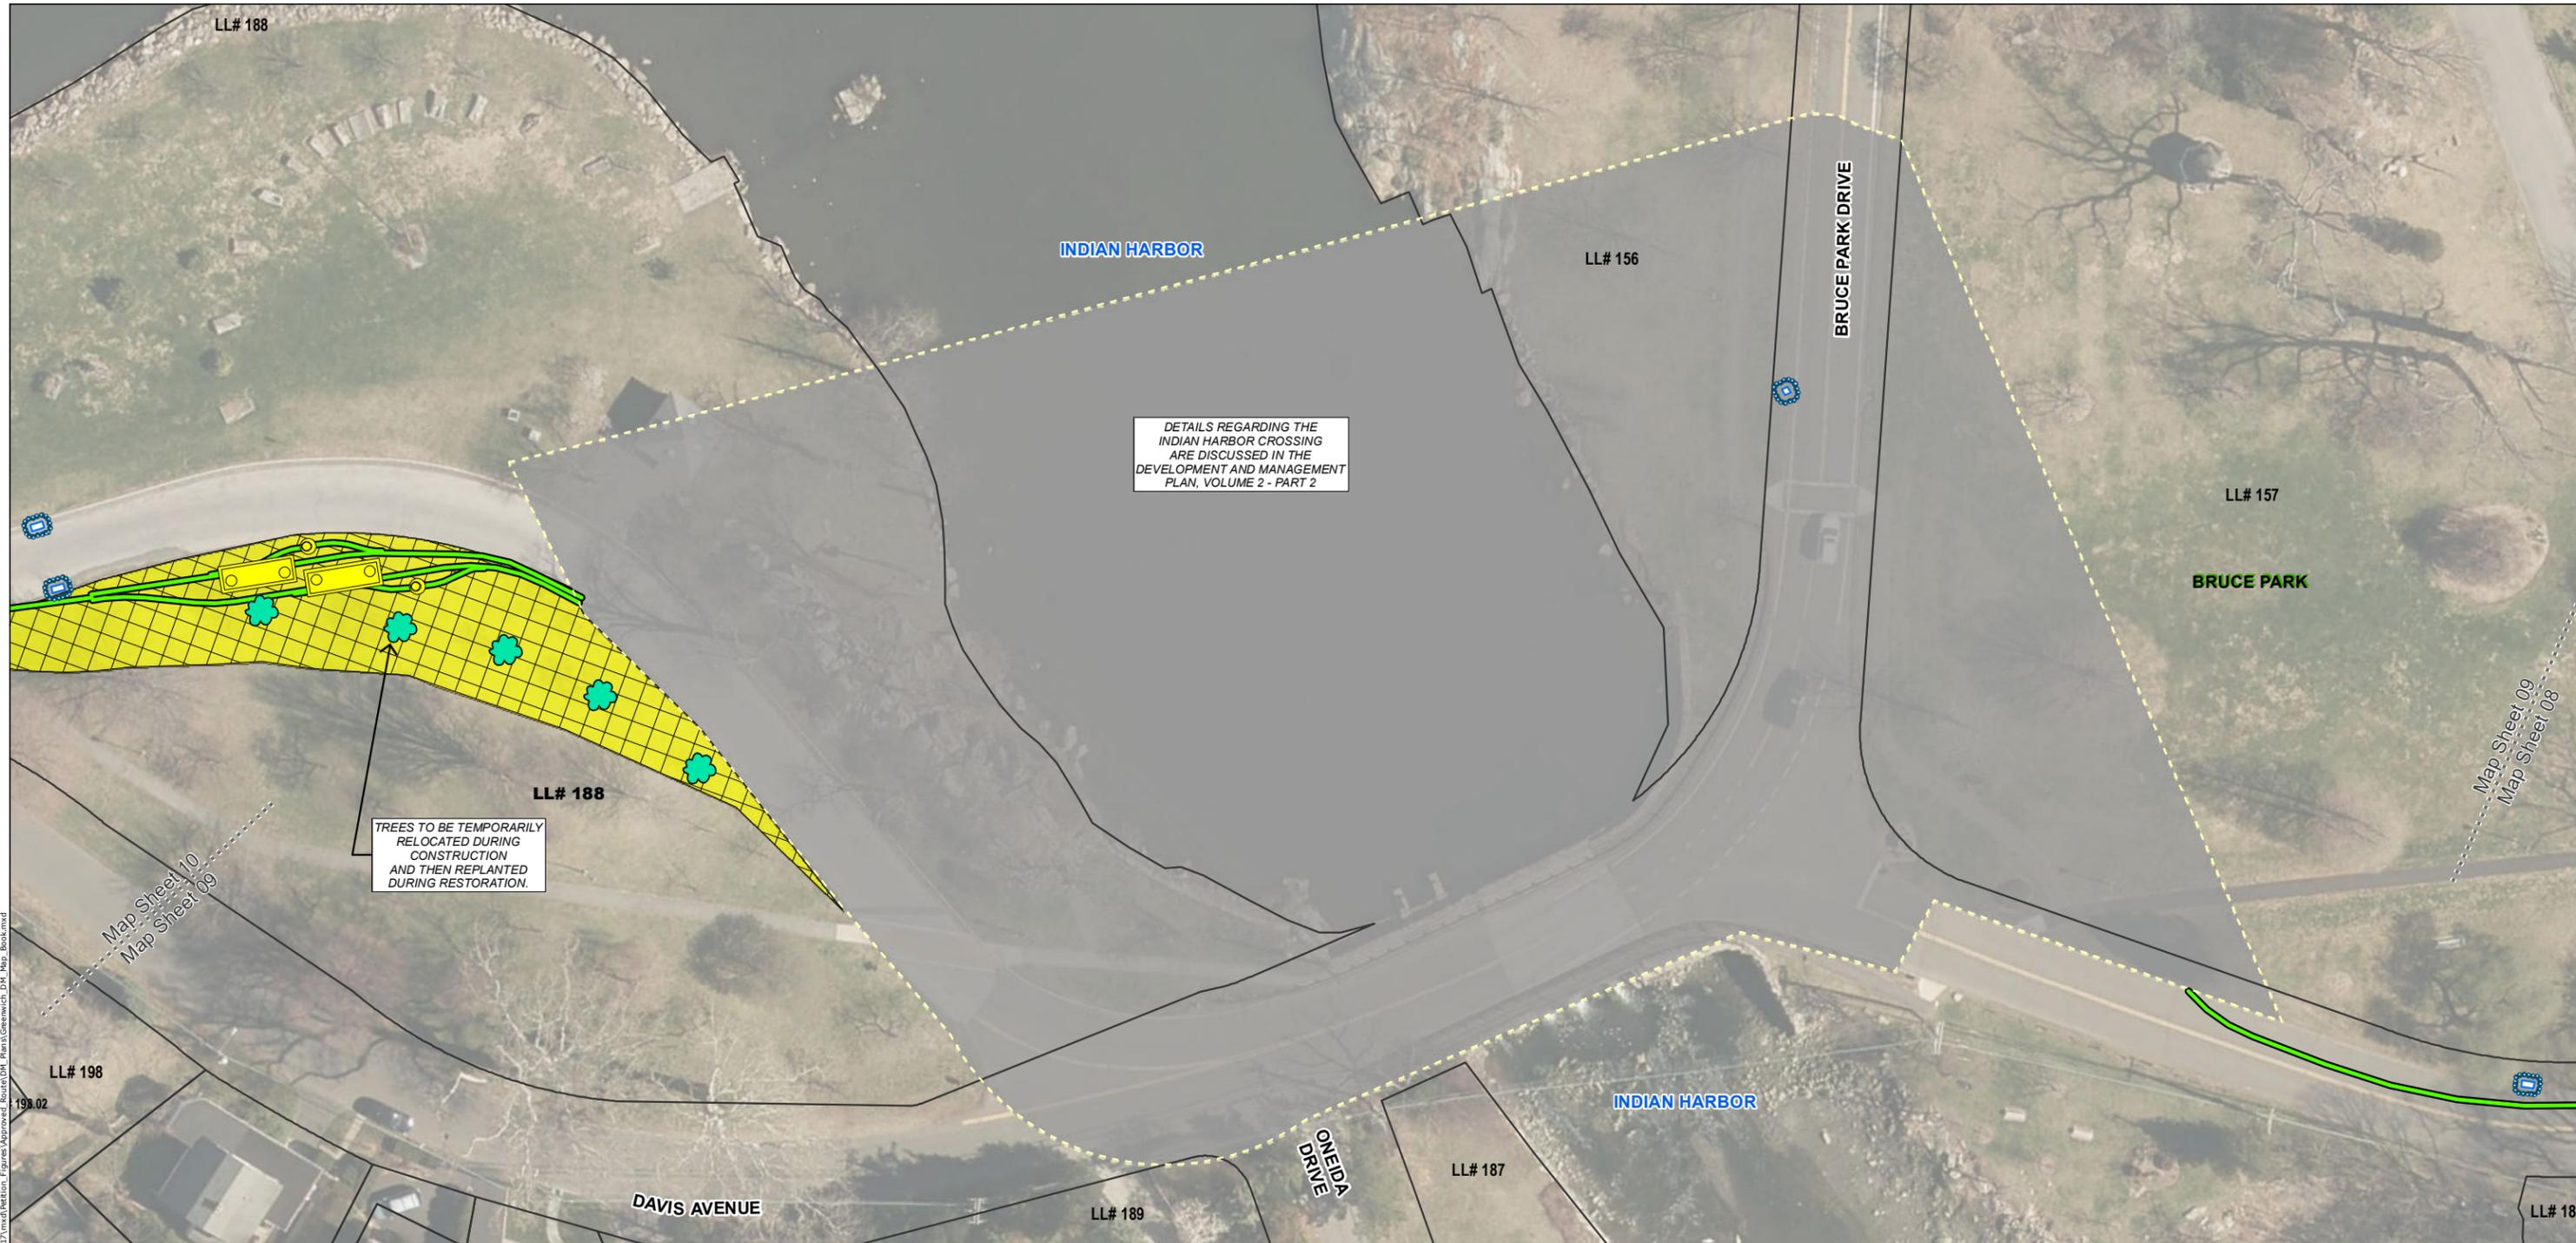


DETAILS REGARDING THE INDIAN HARBOR CROSSING ARE DISCUSSED IN THE DEVELOPMENT AND MANAGEMENT PLAN, VOLUME 2 - PART 2

TREES TO BE TEMPORARILY RELOCATED DURING CONSTRUCTION AND THEN REPLANTED DURING RESTORATION.

- GENERAL NOTES:
- PLEASE REFER TO THE TRAFFIC MANAGEMENT PLAN IN APPENDIX C.
 - THE LIMITS OF DISTURBANCE AS SHOWN DEFINE AREAS WHERE VEGETATION REMOVAL AND GRUBBING, GRADING, AND EXCAVATION MAY OCCUR.
 - ALL WORK WILL BE CONDUCTED IN ACCORDANCE WITH THE RELEVANT PORTIONS OF EVERSOURCE'S BMP MANUAL: CONNECTICUT CONSTRUCTION AND MAINTENANCE ENVIRONMENTAL REQUIREMENTS (BMP MANUAL), UNLESS MORE STRINGENT PROJECT-SPECIFIC MEASURES APPLY.
 - ALL WORK WILL BE CONDUCTED IN ACCORDANCE WITH THE REQUIREMENTS OF REGULATORY APPROVALS FROM THE CONNECTICUT SITING COUNCIL, U.S. ARMY CORPS OF ENGINEERS, THE CONNECTICUT DEPARTMENT OF ENERGY AND ENVIRONMENTAL PROTECTION, AND THE CONNECTICUT DEPARTMENT OF TRANSPORTATION, AND WITH ALL PROJECT PROTOCOLS.
 - EROSION AND SEDIMENTATION CONTROL MEASURES WILL BE INSTALLED AND MAINTAINED (IN REFERENCE TO E&S CONTROLS) DURING CONSTRUCTION, AS REQUIRED, TO COMPLY WITH THE 2002 CONNECTICUT GUIDELINES FOR SOIL EROSION AND SEDIMENT CONTROL, AND EVERSOURCE'S BMP MANUAL, AND APPLICABLE REGULATORY APPROVALS.
 - ALL SIDEWALK AND CURBING SECTIONS THAT INTERSECT WITH THE PROPOSED TRANSMISSION LINE SHALL BE REPLACED IN KIND.

These Maps are not intended for construction. Construction notes and details are included in Appendix B: 115-kV Double Circuit Underground Transmission Line Drawings.



Legend	
● Substation Termination	■ Limits of Work for Indian Harbor Crossing Discussed in Development and Management Plan Volume 2 - Part 2
□ Splice Vault	■ Temporary Construction Matting
● Hand Hole	□ Construction Entrance
— Underground Transmission-Line Duct (Approx. 4' wide)	□ Stormwater Dewatering Pit
— Underground Transmission-Line Duct Underneath Overpass	□ Stormwater Monitoring Outfall
□ Trenchless Crossing Sending/Receiving Pit	● Existing Tree to be removed
□ Trenchless Crossing Underneath Interstate-95	● Existing Tree to be removed and replaced
□ Inlet Protection	□ Project Material Staging Area
□ Filter Sock	□ Approximate Parcel Boundary
□ Silt Fence	□ State-Owned Property
□ Stockpile	□ Eversource Owned Property
□ Work Pad	--- Map Sheet Matchline
□ Parking Impact	

Base Map Source: 2012 Aerial Imagery (CTECO)

1 inch = 50 feet

NO.	DATE	REVISIONS	BY	CHK	APP	APP

EVERSOURCE ENERGY

GREENWICH SUBSTATION AND LINE PROJECT
115-KV DOUBLE CIRCUIT UNDERGROUND TRANSMISSION LINES
GREENWICH, CONNECTICUT
TRANSMISSION LINE DEVELOPMENT & MANAGEMENT PLAN
VOLUME 2 - PART 1

Map Sheet 09 of 17

October 2018

ALL-POINTS TECHNOLOGY CORPORATION

MAP SHEET 10 of 17
GREENWICH SUBSTATION AND LINE PROJECT
115-KV DOUBLE CIRCUIT UNDERGROUND TRANSMISSION LINES
GREENWICH, CONNECTICUT

Map Sheet Notes


LL #	Parcel Address	City	State	Owner Name
188	DAVIS AVENUE	GREENWICH	CT	TOWN OF GREENWICH C/O FINANCE DEPT
198	1 HOME PLACE	GREENWICH	CT	1 HOME PLACE CONDO (3 UNITS -SEE INDIVIDUAL UNIT LISTINGS BELOW)
198.01	1 HOME PLACE UNIT A	GREENWICH	CT	392 DAVIS AVENUE ASSOCIATES LLC
198.02	1 HOME PLACE UNIT B	GREENWICH	CT	392 DAVIS AVENUE ASSOCIATES LLC
198.03	1 HOME PLACE UNIT C	GREENWICH	CT	ROBERT MICHAEL KCH
199	8 HOME PLACE	GREENWICH	CT	HO POI KWONG & MING KUEN (A/K/A PAUL K. & DIANE HO)
215	376 DAVIS AVENUE	GREENWICH	CT	TPF DEVELOPMENT CORPORATION
216	368 DAVIS AVENUE	GREENWICH	CT	TPF DEVELOPMENT CORPORATION
217	362 & 364 DAVIS AVENUE	GREENWICH	CT	362 & 364 DAVIS AVENUE CONDO (4 UNITS - SEE INDIVIDUAL UNIT LISTINGS BELOW)
217.01	364 DAVIS AVENUE UNIT 1	GREENWICH	CT	CHARLOTTE MONIQUE PARKER
217.02	364 DAVIS AVENUE UNIT 2	GREENWICH	CT	WILLY J & SHARON L WOLTER
217.03	364 DAVIS AVENUE UNIT 3	GREENWICH	CT	JANETTE DILLER
217.04	364 DAVIS AVENUE UNIT 4	GREENWICH	CT	MICHAEL & SUSAN SAMPSON
218	356 DAVIS AVENUE	GREENWICH	CT	LUKE T. FRANGIONE, EST
263	6 ORCHARD PLACE	GREENWICH	CT	LUKE T. JR. & THERESA A. FRANGIONE
264	354 DAVIS AVENUE	GREENWICH	CT	LUKE T., JR. & THERESA A. FRANGIONE



GENERAL NOTES:

- PLEASE REFER TO THE TRAFFIC MANAGEMENT PLAN IN APPENDIX C.
- THE LIMITS OF DISTURBANCE AS SHOWN DEFINE AREAS WHERE VEGETATION REMOVAL AND GRUBBING, GRADING, AND EXCAVATION MAY OCCUR.
- ALL WORK WILL BE CONDUCTED IN ACCORDANCE WITH THE RELEVANT PORTIONS OF EVERSOURCE'S BMP MANUAL: CONNECTICUT CONSTRUCTION AND MAINTENANCE ENVIRONMENTAL REQUIREMENTS (BMP MANUAL), UNLESS MORE STRINGENT PROJECT-SPECIFIC MEASURES APPLY.
- ALL WORK WILL BE CONDUCTED IN ACCORDANCE WITH THE REQUIREMENTS OF REGULATORY APPROVALS FROM THE CONNECTICUT SITING COUNCIL, U.S. ARMY CORPS OF ENGINEERS, THE CONNECTICUT DEPARTMENT OF ENERGY AND ENVIRONMENTAL PROTECTION, AND THE CONNECTICUT DEPARTMENT OF TRANSPORTATION, AND WITH ALL PROJECT PROTOCOLS.
- EROSION AND SEDIMENTATION CONTROL MEASURES WILL BE INSTALLED AND MAINTAINED (IN REFERENCE TO E&S CONTROLS) DURING CONSTRUCTION, AS REQUIRED, TO COMPLY WITH THE 2002 CONNECTICUT GUIDELINES FOR SOIL EROSION AND SEDIMENT CONTROL, AND EVERSOURCE'S BMP MANUAL, AND APPLICABLE REGULATORY APPROVALS.
- ALL SIDEWALK AND CURBING SECTIONS THAT INTERSECT WITH THE PROPOSED TRANSMISSION LINE SHALL BE REPLACED IN KIND.

These Maps are not intended for construction. Construction notes and details are included in Appendix B: 115-kV Double Circuit Underground Transmission Line Drawings.



Legend	
● Substation Termination	■ Limits of Work for Indian Harbor Crossing Discussed in Development and Management Plan Volume 2 - Part 2
□ Splice Vault	■ Temporary Construction Matting
● Hand Hole	□ Construction Entrance
— Underground Transmission-Line Duct (Approx. 4' wide)	□ Stormwater Dewatering Pit
— Underground Transmission-Line Duct Underneath Overpass	□ Stormwater Monitoring Outfall
□ Trenchless Crossing Sending/Receiving Pit	● Existing Tree to be removed
□ Trenchless Crossing Underneath Interstate-95	● Existing Tree to be removed and replaced
□ Inlet Protection	□ Project Material Staging Area
□ Filter Sock	□ Approximate Parcel Boundary
□ Silt Fence	□ State-Owned Property
□ Stockpile	□ Eversource Owned Property
□ Work Pad	□ Map Sheet Matchline
□ Parking Impact	

Base Map Source: 2012 Aerial Imagery (CTECO)

1 inch = 50 feet

NO.	DATE	REVISIONS	BY	CHK	APP	APP

EVERSOURCE ENERGY

GREENWICH SUBSTATION AND LINE PROJECT
115-KV DOUBLE CIRCUIT UNDERGROUND TRANSMISSION LINES
GREENWICH, CONNECTICUT
TRANSMISSION LINE DEVELOPMENT & MANAGEMENT PLAN
VOLUME 2 - PART 1

Map Sheet 10 of 17

October 2018

ALL-POINTS TECHNOLOGY CORPORATION

C:\Users\mccarroll\Documents\GIS\Map_Sheet_10.mxd; Project: EverSource\Greenwich\SS_Route_2017\mxd\action; Figures\Approved; Route\DH; Plans\Greenwich_DH_Map_Book.mxd

**MAP SHEET 11
GREENWICH SUBSTATION AND LINE PROJECT
115-KV DOUBLE CIRCUIT UNDERGROUND TRANSMISSION LINES
GREENWICH, CONNECTICUT**

Map Sheet Notes

LL #	Parcel Address	City	State	Owner Name
262	16 ORCHARD PLACE	GREENWICH	CT	DAVID DECK
263	6 ORCHARD PLACE	GREENWICH	CT	LUKE T. JR. & THERESA A. FRANGIONE
264	354 DAVIS AVENUE	GREENWICH	CT	LUKE T., JR. & THERESA A. FRANGIONE
265	25 INDIAN HARBOR DRIVE	GREENWICH	CT	25 INDIAN HARBOR DRIVE CONDO (12 UNITS - SEE INDIVIDUAL UNIT LISTINGS BELOW)
265.01	25 INDIAN HARBOR DRIVE, UNIT 12	GREENWICH	CT	ANNIKA HEBRAND
265.02	25 INDIAN HARBOR DRIVE, UNIT 11	GREENWICH	CT	DONNA KOZAK
265.03	25 INDIAN HARBOR DRIVE, UNIT 10	GREENWICH	CT	ELIZABETH A KRISTOFF
265.04	25 INDIAN HARBOR DRIVE, UNIT 9	GREENWICH	CT	KARL TAN & LISA LAW
265.05	25 INDIAN HARBOR DRIVE, UNIT 8	GREENWICH	CT	ELLEN P TARTAGLIONE & ROBIN GUERRIERI BRADSHAW
265.06	25 INDIAN HARBOR DRIVE, UNIT 7	GREENWICH	CT	ANDREW MARK FRITZ
265.07	25 INDIAN HARBOR DRIVE, UNIT 6	GREENWICH	CT	DAVID KALITA & ALICIA WLODINGUER
265.08	25 INDIAN HARBOR DRIVE, UNIT 5	GREENWICH	CT	ARCHIE T WALLACE & BEVERLEY E SHAW
265.09	25 INDIAN HARBOR DRIVE, UNIT 1	GREENWICH	CT	MARK ENGBRETSON, TR ETAL
265.10	25 INDIAN HARBOR DRIVE, UNIT 2	GREENWICH	CT	LYNN FERGUSON
265.11	25 INDIAN HARBOR DRIVE, UNIT 3	GREENWICH	CT	HANNAH UTLEY & BRENDAN LETARTE
265.12	25 INDIAN HARBOR DRIVE, UNIT 4	GREENWICH	CT	SAMANTHA BEHRINGER
266	35 INDIAN HARBOR DRIVE	GREENWICH	CT	WHITE SHADE LLC
266.01	35 INDIAN HARBOR DRIVE UNIT B	GREENWICH	CT	ANN H FORSTER
266.02	35 INDIAN HARBOR DRIVE UNIT A	GREENWICH	CT	ZM FAMILY PARTNERS LLC
267	39 INDIAN HARBOR DRIVE UNIT A	GREENWICH	CT	39 INDIAN HARBOR DRIVE CONDO (2 UNITS - SEE INDIVIDUAL UNIT LISTINGS BELOW)
267.01	39 INDIAN HARBOR DRIVE UNIT A	GREENWICH	CT	INDIAN HARBOR LLC
267.02	39 INDIAN HARBOR DRIVE UNIT B	GREENWICH	CT	KONRAD R KRUGER & LISA WARREN
268	47 49 INDIAN HARBOR DRIVE	GREENWICH	CT	47 49 INDIAN HARBOR DRIVE CONDO (6 UNITS - SEE INDIVIDUAL UNIT LISTINGS BELOW)
268.01	49 INDIAN HARBOR DRIVE UNIT 9	GREENWICH	CT	XU YAO
268.02	49 INDIAN HARBOR DRIVE UNIT 5	GREENWICH	CT	JEAN P MOORE & STEVEN J RUBIN TRUSTEES OF
268.03	49 INDIAN HARBOR DRIVE UNIT 4	GREENWICH	CT	TODOR DELEV & ALEXANDRA ABSTOSS
268.04	49 INDIAN HARBOR DRIVE UNIT 1	GREENWICH	CT	WACHOVIA BANK NA TRUSTEE
268.05	49 INDIAN HARBOR DRIVE UNIT 2	GREENWICH	CT	HOWARD WEINTRAUB
268.06	49 INDIAN HARBOR DRIVE UNIT 3	GREENWICH	CT	MARVIN C KELLY JR
288	STEAMBOAT ROAD	GREENWICH	CT	TOWN OF GREENWICH



GENERAL NOTES:

- PLEASE REFER TO THE TRAFFIC MANAGEMENT PLAN IN APPENDIX C.
- THE LIMITS OF DISTURBANCE AS SHOWN DEFINE AREAS WHERE VEGETATION REMOVAL AND GRUBBING, GRADING, AND EXCAVATION MAY OCCUR.
- ALL WORK WILL BE CONDUCTED IN ACCORDANCE WITH THE RELEVANT PORTIONS OF EVERSOURCE'S BMP MANUAL: CONNECTICUT CONSTRUCTION AND MAINTENANCE ENVIRONMENTAL REQUIREMENTS (BMP MANUAL), UNLESS MORE STRINGENT PROJECT-SPECIFIC MEASURES APPLY.
- ALL WORK WILL BE CONDUCTED IN ACCORDANCE WITH THE REQUIREMENTS OF REGULATORY APPROVALS FROM THE CONNECTICUT SITING COUNCIL, U.S. ARMY CORPS OF ENGINEERS, THE CONNECTICUT DEPARTMENT OF ENERGY AND ENVIRONMENTAL PROTECTION, AND THE CONNECTICUT DEPARTMENT OF TRANSPORTATION, AND WITH ALL PROJECT PROTOCOLS.
- EROSION AND SEDIMENTATION CONTROL MEASURES WILL BE INSTALLED AND MAINTAINED (IN REFERENCE TO E&S CONTROLS) DURING CONSTRUCTION, AS REQUIRED, TO COMPLY WITH THE 2002 CONNECTICUT GUIDELINES FOR SOIL EROSION AND SEDIMENT CONTROL, AND EVERSOURCE'S BMP MANUAL, AND APPLICABLE REGULATORY APPROVALS.
- ALL SIDEWALK AND CURBING SECTIONS THAT INTERSECT WITH THE PROPOSED TRANSMISSION LINE SHALL BE REPLACED IN KIND.

These Maps are not intended for construction. Construction notes and details are included in Appendix B: 115-kV Double Circuit Underground Transmission Line Drawings.

<p>INDEX MAP</p>		<p>Legend</p> <ul style="list-style-type: none"> ● Substation Termination □ Splice Vault ● Hand Hole — Underground Transmission-Line Duct (Approx. 4' wide) — Underground Transmission-Line Duct Underneath Overpass □ Trenchless Crossing Sending/Receiving Pit — Trenchless Crossing Underneath Interstate-95 ▭ Limits of Work for Indian Harbor Crossing Discussed in Development and Management Plan Volume 2 - Part 2 — Drainage Structure ● Inlet Protection — Filter Sock — Silt Fence ▲ Stockpile □ Work Pad ▭ Temporary Construction Matting □ Construction Entrance □ Stormwater Dewatering Pit ◆ Stormwater Monitoring Outfall ● Existing Tree to be removed ● Existing Tree to be removed and replaced □ Parking Impact — Compensatory Parking ▭ Project Material Staging Area □ Approximate Parcel Boundary ▭ State-Owned Property ▭ Eversource Owned Property — Map Sheet Matchline 		<p>Base Map Source: 2012 Aerial Imagery (CTECO)</p> <p>1 inch = 50 feet</p>		<p>EVERSOURCE ENERGY</p> <p>GREENWICH SUBSTATION AND LINE PROJECT 115-KV DOUBLE CIRCUIT UNDERGROUND TRANSMISSION LINES GREENWICH, CONNECTICUT TRANSMISSION LINE DEVELOPMENT & MANAGEMENT PLAN VOLUME 2 - PART 1</p> <p>Map Sheet 11 of 17</p> <p>October 2018</p>		<table border="1"> <thead> <tr> <th>NO.</th> <th>DATE</th> <th>REVISIONS</th> <th>BY</th> <th>CHK</th> <th>APP</th> <th>APP</th> </tr> </thead> <tbody> <tr> <td> </td> </tr> </tbody> </table>		NO.	DATE	REVISIONS	BY	CHK	APP	APP								<p>ALL-POINTS TECHNOLOGY CORPORATION</p>	
NO.	DATE	REVISIONS	BY	CHK	APP	APP																			

MAP SHEET 12 of 17
GREENWICH SUBSTATION AND LINE PROJECT
115-KV DOUBLE CIRCUIT UNDERGROUND TRANSMISSION LINES
GREENWICH, CONNECTICUT

Map Sheet Notes


<u>LL #</u>	<u>Parcel Address</u>	<u>City</u>	<u>State</u>	<u>Owner Name</u>
288	STEAMBOAT ROAD	GREENWICH	CT	TOWN OF GREENWICH
289	1 MUSEUM DRIVE	GREENWICH	CT	TOWN OF GREENWICH
290	475 STEAMBOAT ROAD	GREENWICH	CT	BERKLEY INSURANCE COMPANY



GENERAL NOTES:

- PLEASE REFER TO THE TRAFFIC MANAGEMENT PLAN IN APPENDIX C.
- THE LIMITS OF DISTURBANCE AS SHOWN DEFINE AREAS WHERE VEGETATION REMOVAL AND GRUBBING, GRADING, AND EXCAVATION MAY OCCUR.
- ALL WORK WILL BE CONDUCTED IN ACCORDANCE WITH THE RELEVANT PORTIONS OF EVERSOURCE'S BMP MANUAL: CONNECTICUT CONSTRUCTION AND MAINTENANCE ENVIRONMENTAL REQUIREMENTS (BMP MANUAL), UNLESS MORE STRINGENT PROJECT-SPECIFIC MEASURES APPLY.
- ALL WORK WILL BE CONDUCTED IN ACCORDANCE WITH THE REQUIREMENTS OF REGULATORY APPROVALS FROM THE CONNECTICUT SITING COUNCIL, U.S. ARMY CORPS OF ENGINEERS, THE CONNECTICUT DEPARTMENT OF ENERGY AND ENVIRONMENTAL PROTECTION, AND THE CONNECTICUT DEPARTMENT OF TRANSPORTATION, AND WITH ALL PROJECT PROTOCOLS.
- EROSION AND SEDIMENTATION CONTROL MEASURES WILL BE INSTALLED AND MAINTAINED (IN REFERENCE TO E&S CONTROLS) DURING CONSTRUCTION, AS REQUIRED, TO COMPLY WITH THE 2002 CONNECTICUT GUIDELINES FOR SOIL EROSION AND SEDIMENT CONTROL, AND EVERSOURCE'S BMP MANUAL, AND APPLICABLE REGULATORY APPROVALS.
- ALL SIDEWALK AND CURBING SECTIONS THAT INTERSECT WITH THE PROPOSED TRANSMISSION LINE SHALL BE REPLACED IN KIND.

These Maps are not intended for construction. Construction notes and details are included in Appendix B: 115-kV Double Circuit Underground Transmission Line Drawings.



Legend	
● Substation Termination	■ Limits of Work for Indian Harbor Crossing Discussed in Development and Management Plan Volume 2 - Part 2
□ Splice Vault	■ Temporary Construction Matting
● Hand Hole	■ Construction Entrance
— Underground Transmission-Line Duct (Approx. 4' wide)	■ Stormwater Dewatering Pit
— Underground Transmission-Line Duct Underneath Overpass	■ Stormwater Monitoring Outfall
■ Trenchless Crossing Sending/Receiving Pit	■ Existing Tree to be removed
■ Trenchless Crossing Underneath Interstate-95	■ Existing Tree to be removed and replaced
■ Inlet Protection	■ Work Pad
■ Filter Sock	■ Silt Fence
■ Stockpile	■ Parking Impact
■ Compensatory Parking	■ Project Material Staging Area
■ State-Owned Property	■ Eversource Owned Property
■ Map Sheet Matchline	

Base Map Source: 2012 Aerial Imagery (CTECO)

1 inch = 50 feet

NO.	DATE	REVISIONS	BY	CHK	APP	APP

EVERSOURCE ENERGY

GREENWICH SUBSTATION AND LINE PROJECT
115-KV DOUBLE CIRCUIT UNDERGROUND TRANSMISSION LINES
GREENWICH, CONNECTICUT
TRANSMISSION LINE DEVELOPMENT & MANAGEMENT PLAN
VOLUME 2 - PART 1

Map Sheet 12 of 17

October 2018

ALL-POINTS TECHNOLOGY CORPORATION

C:\Users\Nico\OneDrive\Documents\GIS\Team Folder\Projects\Eversource\Greenwich_SS_Route_2017\mxd\petition_figures\approved_Route\DH_Plans\Greenwich_DH_Map_Book.mxd

MAP SHEET 13 of 17
GREENWICH SUBSTATION AND LINE PROJECT
115-KV DOUBLE CIRCUIT UNDERGROUND TRANSMISSION LINES
GREENWICH, CONNECTICUT

Map Sheet Notes


<u>LL #</u>	<u>Parcel Address</u>	<u>City</u>	<u>State</u>	<u>Owner Name</u>
288	STEAMBOAT ROAD	GREENWICH	CT	TOWN OF GREENWICH
290	475 STEAMBOAT ROAD	GREENWICH	CT	BERKLEY INSURANCE COMPANY
311	500 STEAMBOAT ROAD	GREENWICH	CT	GREENWICH HARBOR (DEL) LLC
312	100 ARCH STREET	GREENWICH	CT	TOWN OF GREENWICH
313	STEAMBOAT ROAD	GREENWICH	CT	TOWN OF GREENWICH



GENERAL NOTES:

- PLEASE REFER TO THE TRAFFIC MANAGEMENT PLAN IN APPENDIX C.
- THE LIMITS OF DISTURBANCE AS SHOWN DEFINE AREAS WHERE VEGETATION REMOVAL AND GRUBBING, GRADING, AND EXCAVATION MAY OCCUR.
- ALL WORK WILL BE CONDUCTED IN ACCORDANCE WITH THE RELEVANT PORTIONS OF EVERSOURCE'S BMP MANUAL: CONNECTICUT CONSTRUCTION AND MAINTENANCE ENVIRONMENTAL REQUIREMENTS (BMP MANUAL), UNLESS MORE STRINGENT PROJECT-SPECIFIC MEASURES APPLY.
- ALL WORK WILL BE CONDUCTED IN ACCORDANCE WITH THE REQUIREMENTS OF REGULATORY APPROVALS FROM THE CONNECTICUT SITING COUNCIL, U.S. ARMY CORPS OF ENGINEERS, THE CONNECTICUT DEPARTMENT OF ENERGY AND ENVIRONMENTAL PROTECTION, AND THE CONNECTICUT DEPARTMENT OF TRANSPORTATION, AND WITH ALL PROJECT PROTOCOLS.
- EROSION AND SEDIMENTATION CONTROL MEASURES WILL BE INSTALLED AND MAINTAINED (IN REFERENCE TO E&S CONTROLS) DURING CONSTRUCTION, AS REQUIRED, TO COMPLY WITH THE 2002 CONNECTICUT GUIDELINES FOR SOIL EROSION AND SEDIMENT CONTROL, AND EVERSOURCE'S BMP MANUAL, AND APPLICABLE REGULATORY APPROVALS.
- ALL SIDEWALK AND CURBING SECTIONS THAT INTERSECT WITH THE PROPOSED TRANSMISSION LINE SHALL BE REPLACED IN KIND.

These Maps are not intended for construction. Construction notes and details are included in Appendix B: 115-kV Double Circuit Underground Transmission Line Drawings.



Legend	
● Substation Termination	■ Limits of Work for Indian Harbor Crossing Discussed in Development and Management Plan Volume 2 - Part 2
□ Splice Vault	■ Temporary Construction Matting
● Hand Hole	□ Construction Entrance
— Underground Transmission-Line Duct (Approx. 4' wide)	□ Stormwater Dewatering Pit
— Underground Transmission-Line Duct Underneath Overpass	□ Stormwater Monitoring Outfall
□ Trenchless Crossing Sending/Receiving Pit	● Existing Tree to be removed
□ Trenchless Crossing Underneath Interstate-95	● Existing Tree to be removed and replaced
— Drainage Structure	□ Work Pad
— Inlet Protection	□ Parking Impact
— Filter Sock	
— Silt Fence	
— Stockpile	

NO.	DATE	REVISIONS	BY	CHK	APP	APP

EVERSOURCE ENERGY
GREENWICH SUBSTATION AND LINE PROJECT
115-KV DOUBLE CIRCUIT UNDERGROUND TRANSMISSION LINES
GREENWICH, CONNECTICUT
TRANSMISSION LINE DEVELOPMENT & MANAGEMENT PLAN
VOLUME 2 - PART 1

Map Sheet 13 of 17
 October 2018

C:\Users\Nico\OneDrive\Documents\GIS\Map_Sheet_13.mxd | Project: EverSource Greenwich, SS - Route, 2017 | User: Nico | Date: 10/18/2018 | Scale: 1 inch = 50 feet

MAP SHEET 14 of 17
GREENWICH SUBSTATION AND LINE PROJECT
115-KV DOUBLE CIRCUIT UNDERGROUND TRANSMISSION LINES
GREENWICH, CONNECTICUT

Map Sheet Notes


<u>LL #</u>	<u>Parcel Address</u>	<u>City</u>	<u>State</u>	<u>Owner Name</u>
312	100 ARCH STREET	GREENWICH	CT	TOWN OF GREENWICH
313	STEAMBOAT ROAD	GREENWICH	CT	TOWN OF GREENWICH
315	ARCH STREET	GREENWICH	CT	TOWN OF GREENWICH
333	1 HORSENECK LANE	GREENWICH	CT	TOWN OF GREENWICH



GENERAL NOTES:

- PLEASE REFER TO THE TRAFFIC MANAGEMENT PLAN IN APPENDIX C.
- THE LIMITS OF DISTURBANCE AS SHOWN DEFINE AREAS WHERE VEGETATION REMOVAL AND GRUBBING, GRADING, AND EXCAVATION MAY OCCUR.
- ALL WORK WILL BE CONDUCTED IN ACCORDANCE WITH THE RELEVANT PORTIONS OF EVERSOURCE'S BMP MANUAL: CONNECTICUT CONSTRUCTION AND MAINTENANCE ENVIRONMENTAL REQUIREMENTS (BMP MANUAL), UNLESS MORE STRINGENT PROJECT-SPECIFIC MEASURES APPLY.
- ALL WORK WILL BE CONDUCTED IN ACCORDANCE WITH THE REQUIREMENTS OF REGULATORY APPROVALS FROM THE CONNECTICUT SITING COUNCIL, U.S. ARMY CORPS OF ENGINEERS, THE CONNECTICUT DEPARTMENT OF ENERGY AND ENVIRONMENTAL PROTECTION, AND THE CONNECTICUT DEPARTMENT OF TRANSPORTATION, AND WITH ALL PROJECT PROTOCOLS.
- EROSION AND SEDIMENTATION CONTROL MEASURES WILL BE INSTALLED AND MAINTAINED (IN REFERENCE TO E&S CONTROLS) DURING CONSTRUCTION, AS REQUIRED, TO COMPLY WITH THE 2002 CONNECTICUT GUIDELINES FOR SOIL EROSION AND SEDIMENT CONTROL, AND EVERSOURCE'S BMP MANUAL, AND APPLICABLE REGULATORY APPROVALS.
- ALL SIDEWALK AND CURBING SECTIONS THAT INTERSECT WITH THE PROPOSED TRANSMISSION LINE SHALL BE REPLACED IN KIND.

These Maps are not intended for construction. Construction notes and details are included in Appendix B: 115-kV Double Circuit Underground Transmission Line Drawings.



Legend	
● Substation Termination	■ Limits of Work for Indian Harbor Crossing Discussed in Development and Management Plan Volume 2 - Part 2
⊞ Splice Vault	⊞ Temporary Construction Matting
● Hand Hole	⊞ Construction Entrance
— Underground Transmission-Line Duct (Approx. 4' wide)	⊞ Stormwater Dewatering Pit
— Underground Transmission-Line Duct Underneath Overpass	⊞ Stormwater Monitoring Outfall
⊞ Trenchless Crossing Sending/Receiving Pit	⊞ Existing Tree to be removed
⊞ Trenchless Crossing Underneath Interstate-95	⊞ Existing Tree to be removed and replaced
— Drainage Structure	⊞ Work Pad
⊞ Inlet Protection	⊞ Filter Sock
⊞ Silt Fence	⊞ Stockpile
⊞ Parking Impact	⊞ Compensatory Parking
	⊞ Project Material Staging Area
	⊞ Approximate Parcel Boundary
	⊞ State-Owned Property
	⊞ Eversource Owned Property
	⋯ Map Sheet Matchline

Base Map Source:
2012 Aerial Imagery (CTECO)

1 inch = 50 feet

NO.	DATE	REVISIONS	BY	CHK	APP	APP

EVERSOURCE ENERGY

GREENWICH SUBSTATION AND LINE PROJECT
115-KV DOUBLE CIRCUIT UNDERGROUND TRANSMISSION LINES
GREENWICH, CONNECTICUT
TRANSMISSION LINE DEVELOPMENT & MANAGEMENT PLAN
VOLUME 2 - PART 1

Map Sheet 14 of 17

October 2018

MAP SHEET 15 of 17
GREENWICH SUBSTATION AND LINE PROJECT
115-KV DOUBLE CIRCUIT UNDERGROUND TRANSMISSION LINES
GREENWICH, CONNECTICUT

Map Sheet Notes


<u>LL #</u>	<u>Parcel Address</u>	<u>City</u>	<u>State</u>	<u>Owner Name</u>
314	2 STEAMBOAT ROAD	GREENWICH	CT	GREENWICH PLAZA INC. C/O ALBERT BASHFORTH
315	ARCH STREET	GREENWICH	CT	TOWN OF GREENWICH
316	2-28 RAILROAD AVENUE	GREENWICH	CT	GREENWICH PLAZA C/O ALBERT B ASHFORD
331	2 ARCH STREET	GREENWICH	CT	41ST STREET REALTY HOLDING CO LLC ETAL C/O ALBERT B ASHFORTH INC
332	142 RAILROAD AVENUE	GREENWICH	CT	142 RAILROAD AVENUE LLC
333	1 HORSENECK LANE	GREENWICH	CT	TOWN OF GREENWICH
335	144 RAILOAD AVENUE	GREENWICH	CT	SAUGATUCK MOTORS INC.
336	151 RAILROAD AVENUE	GREENWICH	CT	NUTMEG REAL ESTATE LLC
337	177 RAILROAD AVENUE	GREENWICH	CT	177 RAILROAD AVENUE CONDO (4 UNITS - SEE INDIVIDUAL UNIT LISTINGS BELOW)
337.01	177 RAILROAD AVENUE UNIT RA-A	GREENWICH	CT	JOHN A GIBBONS JR
337.02	177 RAILROAD AVENUE UNIT RA-B	GREENWICH	CT	ROBERT & SUSAN SOLOMON
337.03	177 RAILROAD AVENUE UNIT RA-C	GREENWICH	CT	GINA D SILVESTRI
337.04	177 RAILROAD AVENUE UNIT RA-D	GREENWICH	CT	ANDREA JAGARIC & STJEPAN SPANJOL
349	23 WOODLAND DRIVE	GREENWICH	CT	MICHAEL & SEAN & KIM TIERNEY C/O PUC BAMSE PARTNERS
350	25 WOODLAND DRIVE	GREENWICH	CT	NUTMEG REAL ESTATE LLC
351	44 RAILOAD AVENUE	GREENWICH	CT	SAUGATUCK MOTORS INC.
352	200 RAILROAD AVENUE	GREENWICH	CT	200 RAILROAD AVENUE LLC C/O ALLIED PROPERTY GROUP



GENERAL NOTES:

- PLEASE REFER TO THE TRAFFIC MANAGEMENT PLAN IN APPENDIX C.
- THE LIMITS OF DISTURBANCE AS SHOWN DEFINE AREAS WHERE VEGETATION REMOVAL AND GRUBBING, GRADING, AND EXCAVATION MAY OCCUR.
- ALL WORK WILL BE CONDUCTED IN ACCORDANCE WITH THE RELEVANT PORTIONS OF EVERSOURCE'S BMP MANUAL: CONNECTICUT CONSTRUCTION AND MAINTENANCE ENVIRONMENTAL REQUIREMENTS (BMP MANUAL), UNLESS MORE STRINGENT PROJECT-SPECIFIC MEASURES APPLY.
- ALL WORK WILL BE CONDUCTED IN ACCORDANCE WITH THE REQUIREMENTS OF REGULATORY APPROVALS FROM THE CONNECTICUT SITING COUNCIL, U.S. ARMY CORPS OF ENGINEERS, THE CONNECTICUT DEPARTMENT OF ENERGY AND ENVIRONMENTAL PROTECTION, AND THE CONNECTICUT DEPARTMENT OF TRANSPORTATION, AND WITH ALL PROJECT PROTOCOLS.
- EROSION AND SEDIMENTATION CONTROL MEASURES WILL BE INSTALLED AND MAINTAINED (IN REFERENCE TO E&S CONTROLS) DURING CONSTRUCTION, AS REQUIRED, TO COMPLY WITH THE 2002 CONNECTICUT GUIDELINES FOR SOIL EROSION AND SEDIMENT CONTROL, AND EVERSOURCE'S BMP MANUAL, AND APPLICABLE REGULATORY APPROVALS.
- ALL SIDEWALK AND CURBING SECTIONS THAT INTERSECT WITH THE PROPOSED TRANSMISSION LINE SHALL BE REPLACED IN KIND.

These Maps are not intended for construction. Construction notes and details are included in Appendix B: 115-kV Double Circuit Underground Transmission Line Drawings.



Legend	
● Substation Termination	■ Limits of Work for Indian Harbor Crossing Discussed in Development and Management Plan Volume 2 - Part 2
⊠ Splice Vault	— Drainage Structure
● Hand Hole	⊠ Inlet Protection
— Underground Transmission-Line Duct (Approx. 4' wide)	⊠ Filter Sock
— Underground Transmission-Line Duct Underneath Overpass	⊠ Silt Fence
⊠ Trenchless Crossing Sending/Receiving Pit	⊠ Stockpile
⊠ Trenchless Crossing Underneath Interstate-95	⊠ Work Pad
■ Temporary Construction Matting	⊠ Construction Entrance
⊠ Stormwater Dewatering Pit	⊠ Stormwater Monitoring Outfall
⊠ Existing Tree to be removed	⊠ Existing Tree to be removed and replaced
⊠ Parking Impact	⊠ Compensatory Parking
	⊠ Project Material Staging Area
	⊠ Approximate Parcel Boundary
	⊠ State-Owned Property
	⊠ Eversource Owned Property
	⊠ Map Sheet Matchline

Base Map Source: 2012 Aerial Imagery (CTECO)						
1 inch = 50 feet						
0 25 50						
NO.	DATE	REVISIONS	BY	CHK	APP	APP

EVERSOURCE ENERGY

GREENWICH SUBSTATION AND LINE PROJECT
115-KV DOUBLE CIRCUIT UNDERGROUND TRANSMISSION LINES
GREENWICH, CONNECTICUT
TRANSMISSION LINE DEVELOPMENT & MANAGEMENT PLAN
VOLUME 2 - PART 1

Map Sheet 15 of 17

October 2018

ALL-POINTS TECHNOLOGY CORPORATION

MAP SHEET 16 of 17
GREENWICH SUBSTATION AND LINE PROJECT
115-KV DOUBLE CIRCUIT UNDERGROUND TRANSMISSION LINES
GREENWICH, CONNECTICUT

Map Sheet Notes


<u>LL #</u>	<u>Parcel Address</u>	<u>City</u>	<u>State</u>	<u>Owner Name</u>
349	23 WOODLAND DRIVE	GREENWICH	CT	MICHAEL & SEAN & KIM TIERNEY C/O PUC BAMSE PARTNERS
350	25 WOODLAND DRIVE	GREENWICH	CT	NUTMEG REAL ESTATE LLC
351	44 RAILOAD AVENUE	GREENWICH	CT	SAUGATUCK MOTORS INC.
352	200 RAILROAD AVENUE	GREENWICH	CT	200 RAILROAD AVENUE LLC C/O ALLIED PROPERTY GROUP
355	222 RAILROAD AVENUE	GREENWICH	CT	NATIONAL RAILROAD PASSENGER CORPORATION C/O JOEL PAUL BERGER ET AL
356	205 RAILROAD AVENUE	GREENWICH	CT	KEL REALTY LLC. C/O MILL MANAGEMENT
357	29 WOODLAND DRIVE	GREENWICH	CT	PETER KEN CHEW & DENISE WONE
358	27 WOODLAND DRIVE	GREENWICH	CT	PETER W & MELINDA R WELLINGTON
365	33 WOODLAND DRIVE	GREENWICH	CT	CAROL M. COFONE
366	35 WOODLAND DRIVE	GREENWICH	CT	ROBERT L. & BARBARA JILL AILLOO LLC.
368	249 RAILROAD AVENUE	GREENWICH	CT	JOHN A. & SHIRLEY M. VIESTA TRST
370	249 RAILROAD AVENUE	GREENWICH	CT	JOHN A. & SHIRLEY M. VIESTA TRST
371	280 RAILOAD AVENUE	GREENWICH	CT	JOEL PAUL BERGER, ET AL
372	WOODLAND DRIVE	GREENWICH	CT	CONNECTICUT RAILWAY & LIGHTING COMPANY
381	WOODLAND DRIVE	GREENWICH	CT	CONNECTICUT RAILWAY & LIGHTING COMPANY
384	193 FIELD POINT ROAD	GREENWICH	CT	RIDGEGREEN CORP C/O THOMAS F HARTCH
385	195 FIELD POINT ROAD	GREENWICH	CT	TIFFANY PROPERTIES & MANAGEMENT INC.
386	290 RAILOAD AVENUE	GREENWICH	CT	290 RAILROAD AVE LLC C/O FRIEDBERG SMITH & CO PC-ATT JOSEPH ROSEMAN
387	282 RAILROAD AVENUE	GREENWICH	CT	NATIONAL RAILROAD PASSENGER CORPORATION C/O JOEL PAUL BERGER ET AL
404	204 FIELD POINT ROAD	GREENWICH	CT	JOHN & KIMBERLY A. TUNG



GENERAL NOTES:

- PLEASE REFER TO THE TRAFFIC MANAGEMENT PLAN IN APPENDIX C.
- THE LIMITS OF DISTURBANCE AS SHOWN DEFINE AREAS WHERE VEGETATION REMOVAL AND GRUBBING, GRADING, AND EXCAVATION MAY OCCUR.
- ALL WORK WILL BE CONDUCTED IN ACCORDANCE WITH THE RELEVANT PORTIONS OF EVERSOURCE'S BMP MANUAL: CONNECTICUT CONSTRUCTION AND MAINTENANCE ENVIRONMENTAL REQUIREMENTS (BMP MANUAL), UNLESS MORE STRINGENT PROJECT-SPECIFIC MEASURES APPLY.
- ALL WORK WILL BE CONDUCTED IN ACCORDANCE WITH THE REQUIREMENTS OF REGULATORY APPROVALS FROM THE CONNECTICUT SITING COUNCIL, U.S. ARMY CORPS OF ENGINEERS, THE CONNECTICUT DEPARTMENT OF ENERGY AND ENVIRONMENTAL PROTECTION, AND THE CONNECTICUT DEPARTMENT OF TRANSPORTATION, AND WITH ALL PROJECT PROTOCOLS.
- EROSION AND SEDIMENTATION CONTROL MEASURES WILL BE INSTALLED AND MAINTAINED (IN REFERENCE TO E&S CONTROLS) DURING CONSTRUCTION, AS REQUIRED, TO COMPLY WITH THE 2002 CONNECTICUT GUIDELINES FOR SOIL EROSION AND SEDIMENT CONTROL, AND EVERSOURCE'S BMP MANUAL, AND APPLICABLE REGULATORY APPROVALS.
- ALL SIDEWALK AND CURBING SECTIONS THAT INTERSECT WITH THE PROPOSED TRANSMISSION LINE SHALL BE REPLACED IN KIND.

These Maps are not intended for construction. Construction notes and details are included in Appendix B: 115-kV Double Circuit Underground Transmission Line Drawings.

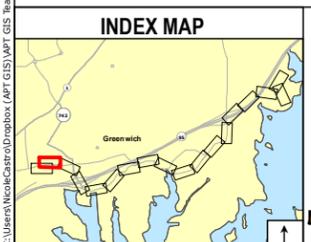

Legend	
● Substation Termination	■ Limits of Work for Indian Harbor Crossing Discussed in Development and Management Plan Volume 2 - Part 2
□ Splice Vault	■ Temporary Construction Matting
● Hand Hole	□ Construction Entrance
— Underground Transmission-Line Duct (Approx. 4' wide)	□ Stormwater Dewatering Pit
— Underground Transmission-Line Duct Underneath Overpass	□ Stormwater Monitoring Outfall
□ Trenchless Crossing Sending/Receiving Pit	● Existing Tree to be removed
□ Trenchless Crossing Underneath Interstate-95	● Existing Tree to be removed and replaced
□ Drainage Structure	□ Work Pad
□ Inlet Protection	□ Parking Impact
□ Filter Sock	
□ Silt Fence	
□ Stockpile	

Base Map Source:
2012 Aerial Imagery (CTECO)

1 inch = 50 feet

EVERSOURCE ENERGY

GREENWICH SUBSTATION AND LINE PROJECT

115-KV DOUBLE CIRCUIT UNDERGROUND TRANSMISSION LINES

GREENWICH, CONNECTICUT

TRANSMISSION LINE DEVELOPMENT & MANAGEMENT PLAN

VOLUME 2 - PART 1

Map Sheet 16 of 17

October 2018


NO.	DATE	REVISIONS	BY	CHK	APP	APP

C:\Users\Waco\OneDrive\Documents\Projects\Greenwich\SS_Route_2017\mxd\Section_Figures\Approved_Route\DH_Plans\Greenwich_DH_Map_Book.mxd

MAP SHEET 17 of 17
GREENWICH SUBSTATION AND LINE PROJECT
115-KV DOUBLE CIRCUIT UNDERGROUND TRANSMISSION LINES
GREENWICH, CONNECTICUT

Map Sheet Notes

<u>LL #</u>	<u>Parcel Address</u>	<u>City</u>	<u>State</u>	<u>Owner Name</u>
355	222 RAILROAD AVENUE	GREENWICH	CT	NATIONAL RAILROAD PASSENGER CORPORATION C/O JOEL PAUL BERGER ET AL
368	249 RAILROAD AVENUE	GREENWICH	CT	JOHN A. & SHIRLEY M. VIESTA TRST
370	249 RAILROAD AVENUE	GREENWICH	CT	JOHN A. & SHIRLEY M. VIESTA TRST
371	280 RAILOAD AVENUE	GREENWICH	CT	JOEL PAUL BERGER, ET AL
372	WOODLAND DRIVE	GREENWICH	CT	CONNECTICUT RAILWAY & LIGHTING COMPANY
381	WOODLAND DRIVE	GREENWICH	CT	CONNECTICUT RAILWAY & LIGHTING COMPANY
385	195 FIELD POINT ROAD	GREENWICH	CT	TIFFANY PROPERTIES & MANAGEMENT INC.
386	290 RAILOAD AVENUE	GREENWICH	CT	290 RAILROAD AVE LLC C/O FRIEDBERG SMITH & CO PC-ATT JOSEPH ROSEMAN
387	282 RAILROAD AVENUE	GREENWICH	CT	NATIONAL RAILROAD PASSENGER CORPORATION C/O JOEL PAUL BERGER ET AL
389	255 FIELD POINT ROAD	GREENWICH	CT	BARRY GREENWICH LLC
390	255 FIELD POINT ROAD	GREENWICH	CT	BARRY GREENWICH LLC
393	330 RAILROAD AVENUE	GREENWICH	CT	CONNECTICUT LIGHT & POWER COMPANY (EVERSOURCE)
404	204 FIELD POINT ROAD	GREENWICH	CT	JOHN & KIMBERLY A. TUNG

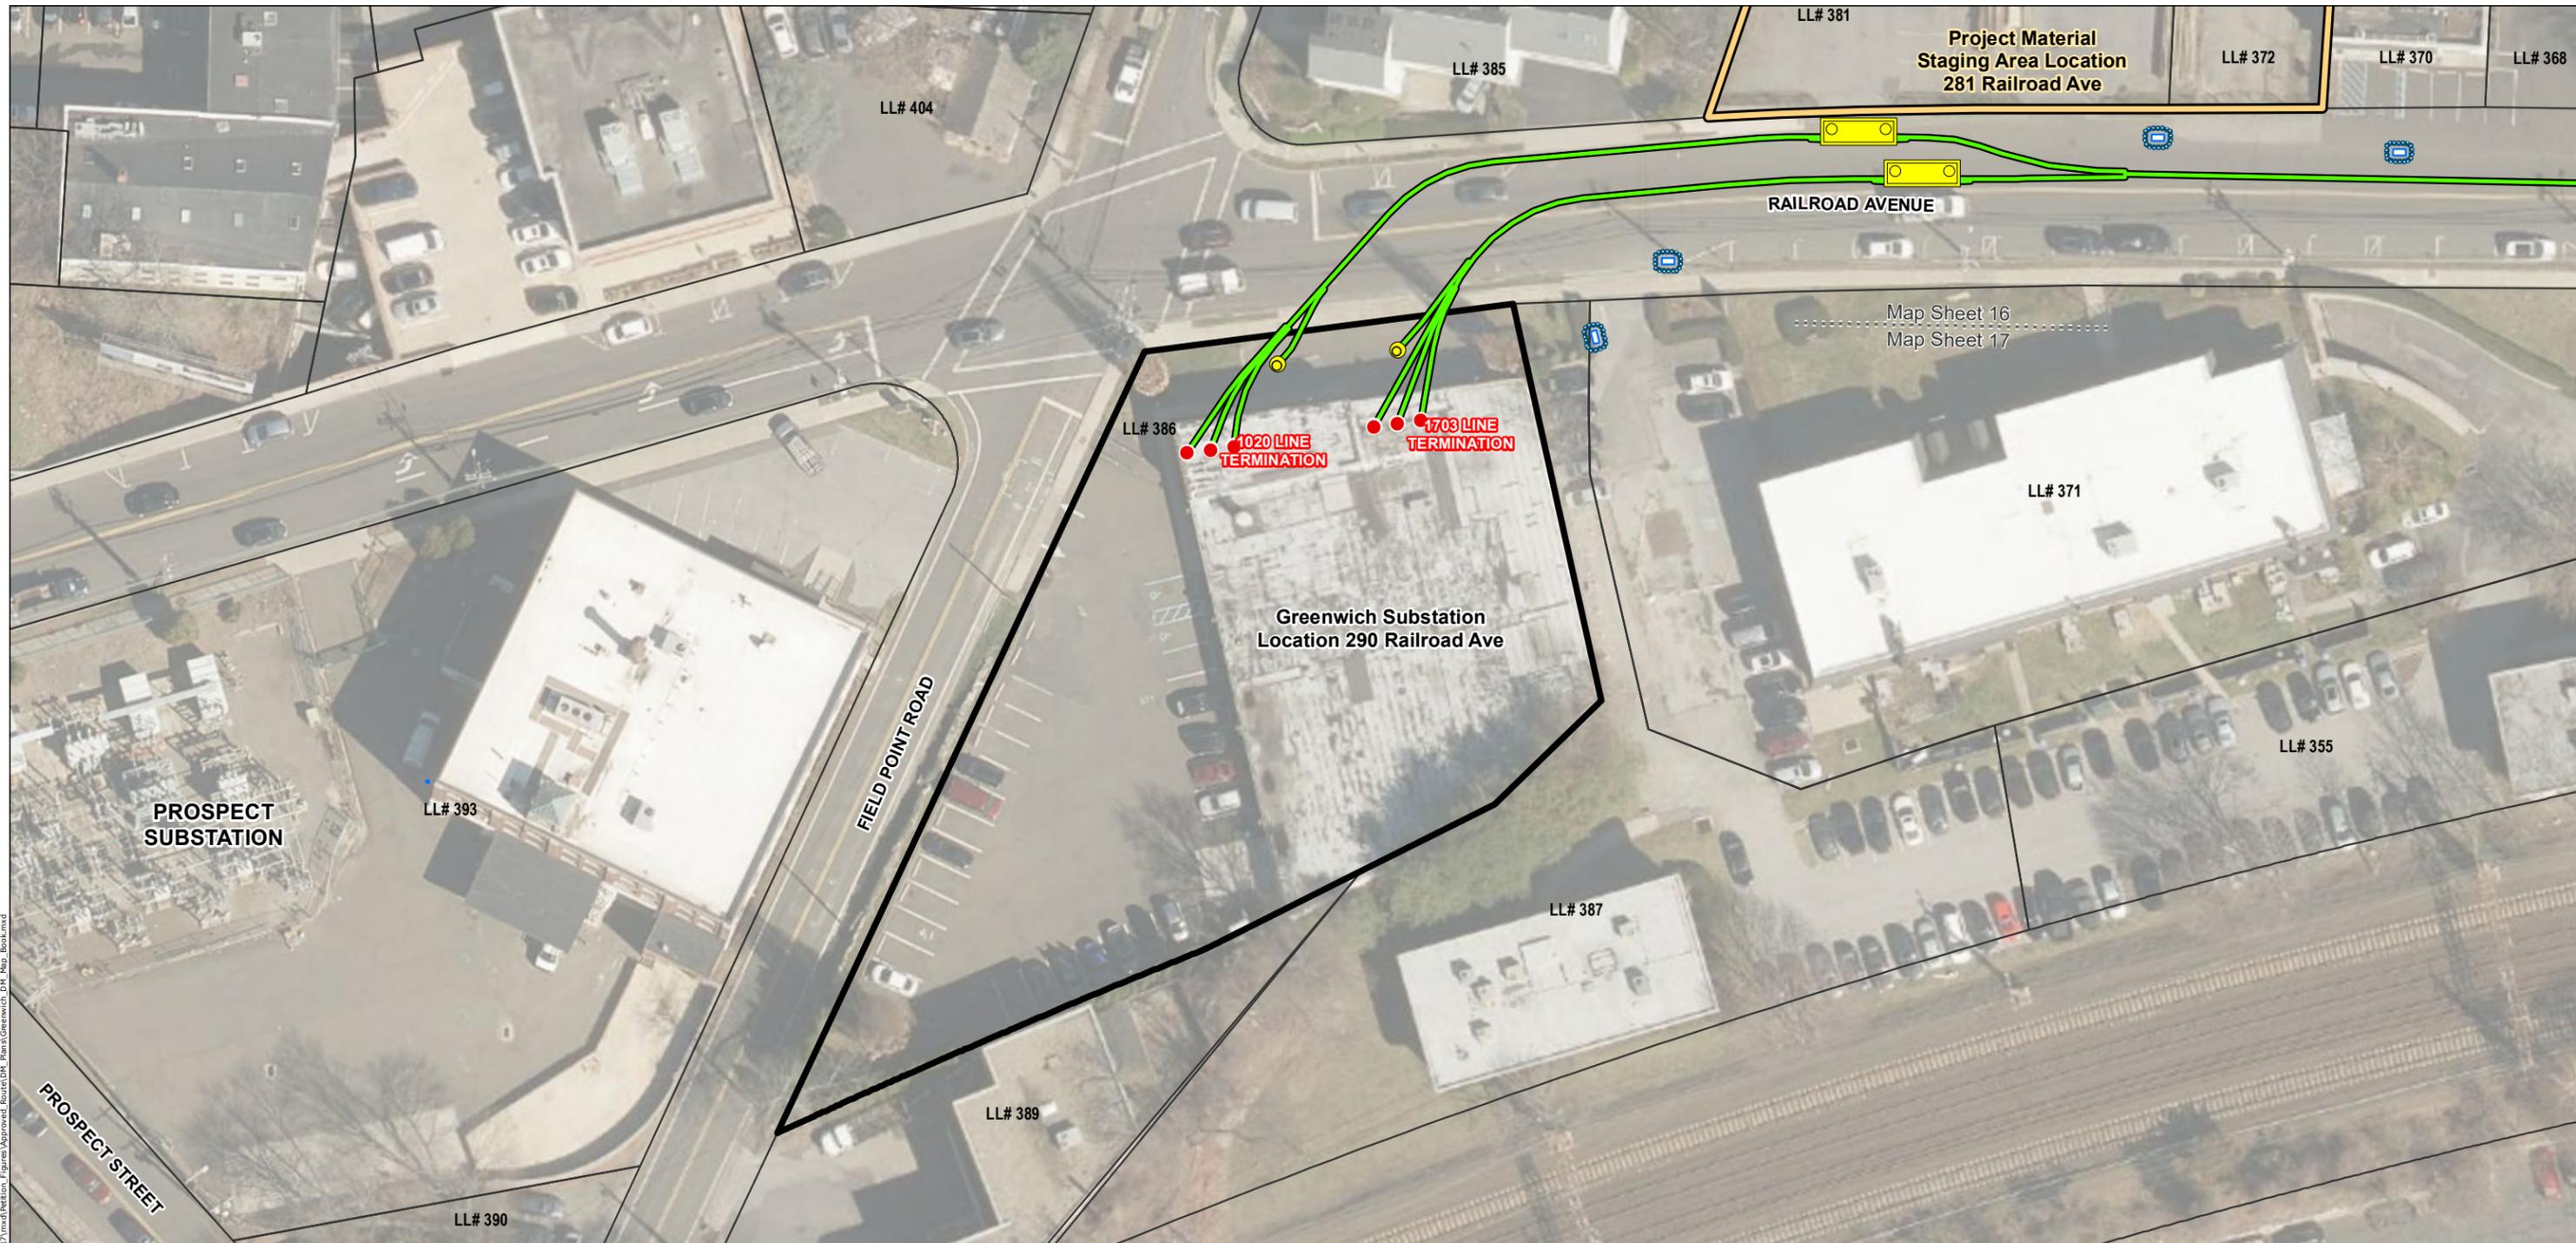

GENERAL NOTES:
 1. PLEASE REFER TO THE TRAFFIC MANAGEMENT PLAN IN APPENDIX C.
 2. THE LIMITS OF DISTURBANCE AS SHOWN DEFINE AREAS WHERE VEGETATION REMOVAL AND GRUBBING, GRADING, AND EXCAVATION MAY OCCUR.
 3. ALL WORK WILL BE CONDUCTED IN ACCORDANCE WITH THE RELEVANT PORTIONS OF EVERSOURCE'S BMP MANUAL: CONNECTICUT CONSTRUCTION AND MAINTENANCE ENVIRONMENTAL REQUIREMENTS (BMP MANUAL), UNLESS MORE STRINGENT PROJECT-SPECIFIC MEASURES APPLY.
 4. ALL WORK WILL BE CONDUCTED IN ACCORDANCE WITH THE REQUIREMENTS OF REGULATORY APPROVALS FROM THE CONNECTICUT SITING COUNCIL, U.S. ARMY CORPS OF ENGINEERS, THE CONNECTICUT DEPARTMENT OF ENERGY AND ENVIRONMENTAL PROTECTION, AND THE CONNECTICUT DEPARTMENT OF TRANSPORTATION, AND WITH ALL PROJECT PROTOCOLS.
 5. EROSION AND SEDIMENTATION CONTROL MEASURES WILL BE INSTALLED AND MAINTAINED (IN REFERENCE TO E&S CONTROLS) DURING CONSTRUCTION, AS REQUIRED, TO COMPLY WITH THE 2002 CONNECTICUT GUIDELINES FOR SOIL EROSION AND SEDIMENT CONTROL, AND EVERSOURCE'S BMP MANUAL, AND APPLICABLE REGULATORY APPROVALS.
 6. ALL SIDEWALK AND CURBING SECTIONS THAT INTERSECT WITH THE PROPOSED TRANSMISSION LINE SHALL BE REPLACED IN KIND.

These Maps are not intended for construction. Construction notes and details are included in Appendix B: 115-kV Double Circuit Underground Transmission Line Drawings.

	Legend <ul style="list-style-type: none"> ● Substation Termination □ Splice Vault ● Hand Hole — Underground Transmission-Line Duct (Approx. 4' wide) — Underground Transmission-Line Duct Underneath Overpass □ Trenchless Crossing Sending/Receiving Pit — Trenchless Crossing Underneath Interstate-95 ▭ Limits of Work for Indian Harbor Crossing Discussed in Development and Management Plan Volume 2 - Part 2 — Drainage Structure □ Inlet Protection — Filter Sock — Silt Fence — Stockpile □ Work Pad 	<ul style="list-style-type: none"> ▭ Temporary Construction Matting □ Construction Entrance □ Stormwater Dewatering Pit □ Stormwater Monitoring Outfall ● Existing Tree to be removed ● Existing Tree to be removed and replaced □ Parking Impact 	<ul style="list-style-type: none"> — Compensatory Parking □ Project Material Staging Area □ Approximate Parcel Boundary □ State-Owned Property □ Eversource Owned Property — Map Sheet Matchline 		<table border="1"> <tr> <td>NO.</td> <td>DATE</td> <td>REVISIONS</td> <td>BY</td> <td>CHK</td> <td>APP</td> <td>APP</td> </tr> <tr> <td> </td> </tr> </table>	NO.	DATE	REVISIONS	BY	CHK	APP	APP								
						NO.	DATE	REVISIONS	BY	CHK	APP	APP								
<p align="center">GREENWICH SUBSTATION AND LINE PROJECT 115-KV DOUBLE CIRCUIT UNDERGROUND TRANSMISSION LINES GREENWICH, CONNECTICUT TRANSMISSION LINE DEVELOPMENT & MANAGEMENT PLAN VOLUME 2 - PART 1</p> <p align="right">Map Sheet 17 of 17</p> <p align="right">October 2018</p>																				

C:\Users\Nico\OneDrive\Documents\GIS\Team Folder\Projects\Eversource\Greenwich, SS - Route, 2017.mxd (Location: Figures\Approved - Route\DH - Plans\Greenwich_DH_Map_Book.mxd)

THIS PAGE INTENTIONALLY LEFT BLANK