


CONNECTICUT RELEASE REPORTING REGULATIONS – REPORTABLE QUANTITIES

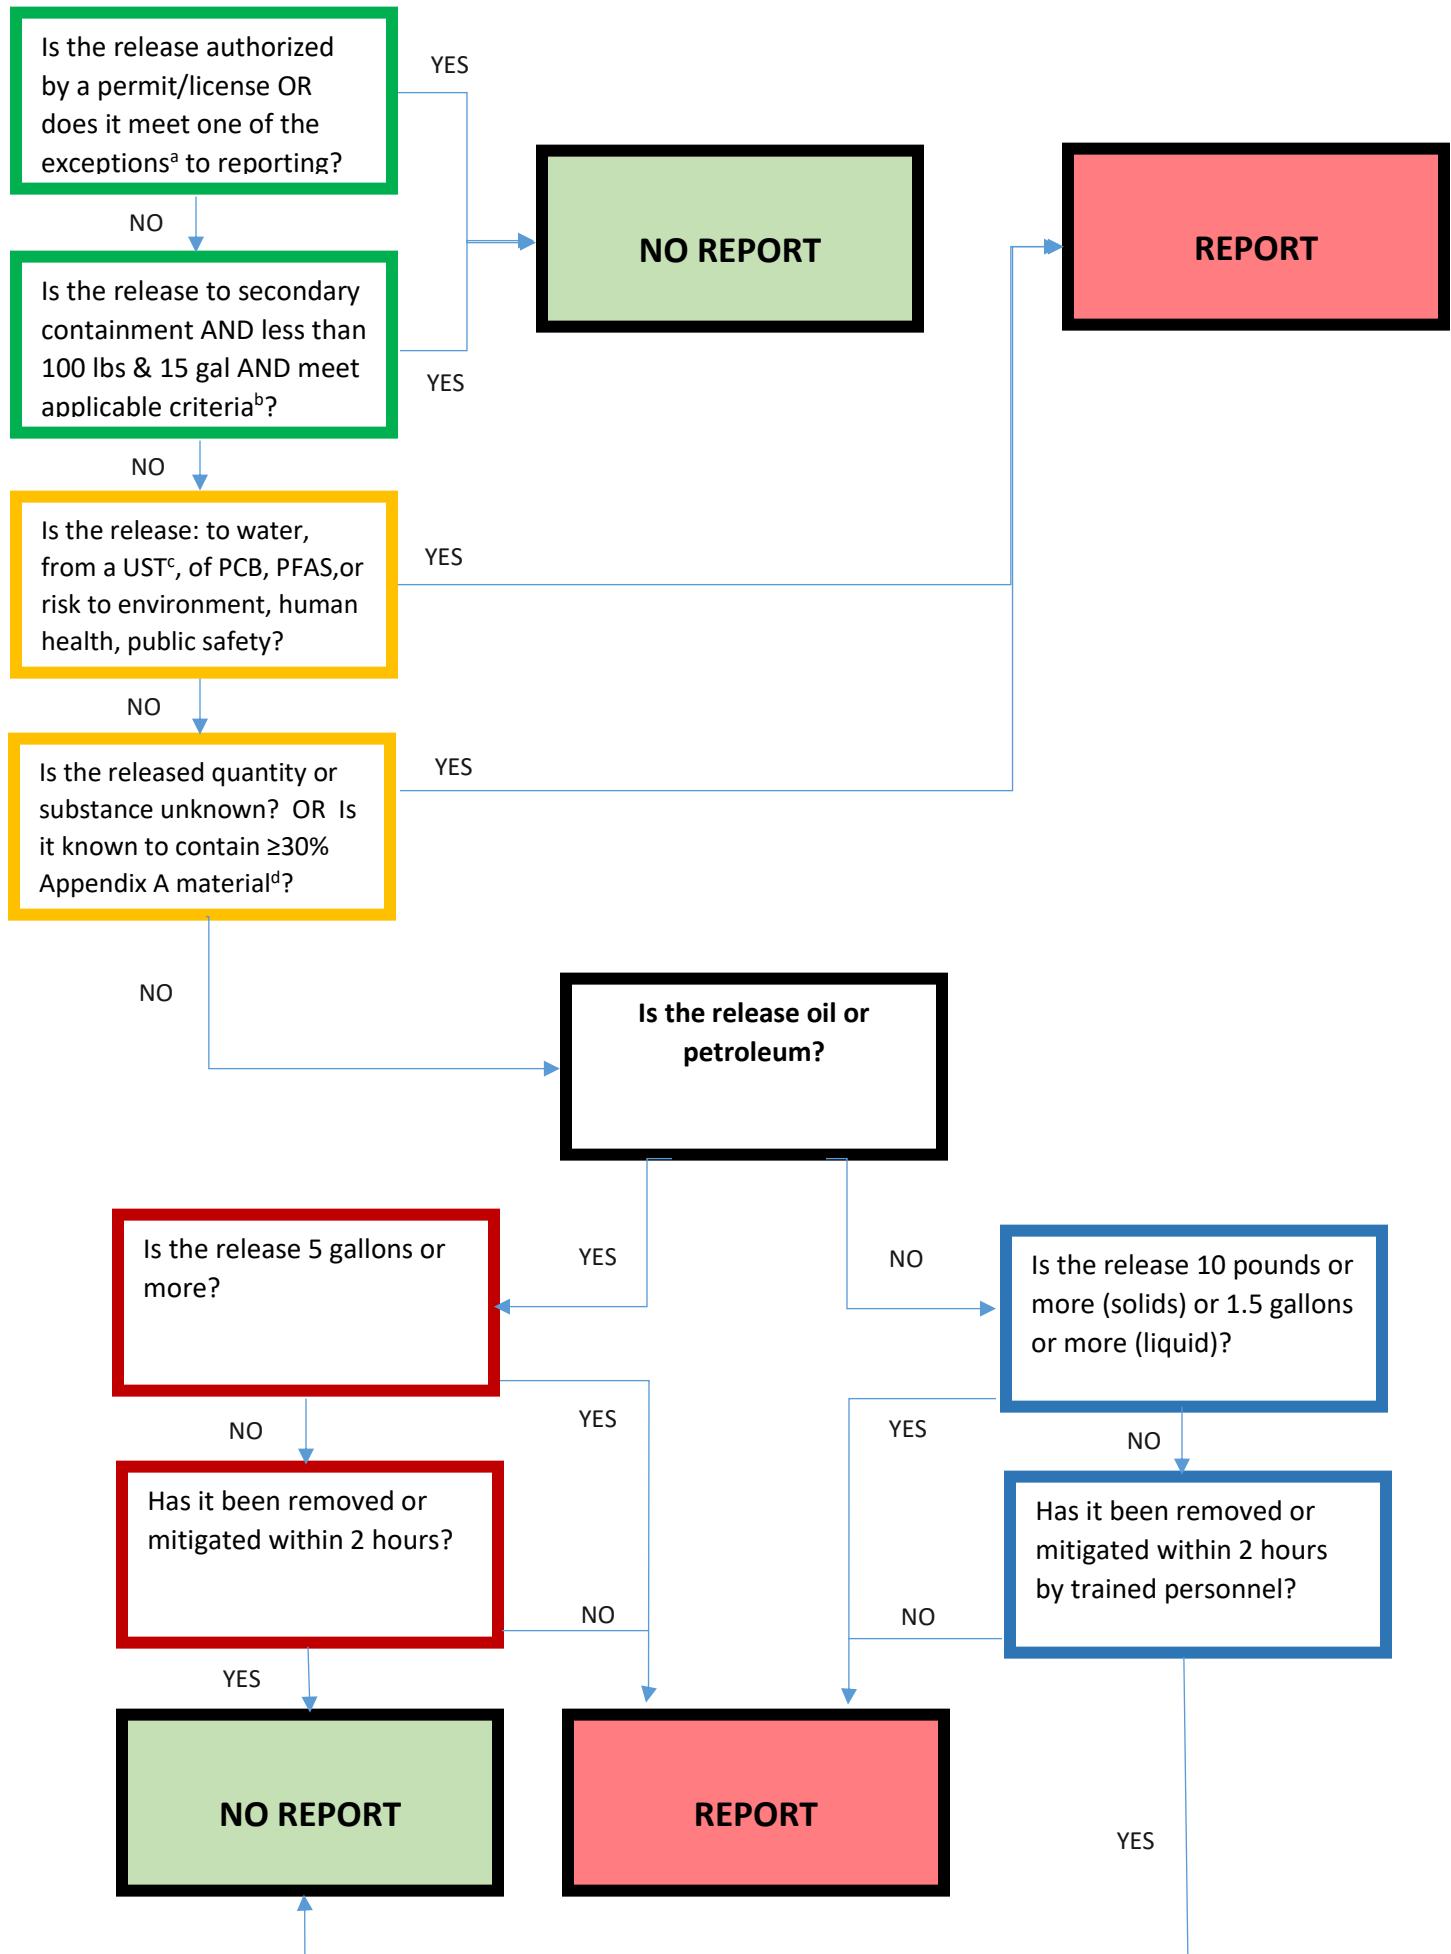

Footnotes

<sup>a</sup>Exceptions – Allowed (regardless of exceedance or violation) by:

- 1) State or federal law;
- 2) Judgement or order of the court;
- 3) Contained under a laboratory fume hood;
- 4) Minor sheen from roadway, parking lot, driveway normal vehicle use;
- 5) Food products;
- 6) Domestic sewage less than 100 gallons;

<sup>b</sup>Criteria for releases to containment, must be cleaned within 2 hours AND must NOT be:

- 1) more than 100lbs or 15gal.; 2) involve a UST or PCB; 3) create an emergency

<sup>c</sup>Unless it is limited to drips from nozzle during dispensing

<sup>d</sup>Unless contained under a laboratory fume hood

| KEY  |                    |
|--|--------------------|
| <span style="background-color: green; border: 1px solid black; display: inline-block; width: 15px; height: 10px;"></span>  | = exceptions       |
| <span style="background-color: red; border: 1px solid black; display: inline-block; width: 15px; height: 10px;"></span>    | = oil or petroleum |
| <span style="background-color: blue; border: 1px solid black; display: inline-block; width: 15px; height: 10px;"></span>   | = non-petroleum    |
| <span style="background-color: yellow; border: 1px solid black; display: inline-block; width: 15px; height: 10px;"></span> | = always report    |