

The State of Connecticut
Department of Housing (DOH)
Community Development Block Grant Disaster Recovery Program
(CDBG-DR)

Owner Occupied Rehabilitation and Rebuilding Program (OORR)

BID PACKAGE

For

Rehabilitation Work to:

Rogers Residence

Roof Replacement, Exterior Repairs and Hazardous Materials Remediation

181 Trumbull Avenue

Bridgeport, CT 06606

Prepared by:

Capital Studio Architects, LLC.

1379 Main Street, East Hartford, CT 06108

860.289.3262

Project #: 2237

CSA Project # 1347-40

Dated: March 26, 2017



Project # 2237

Table of Contents

Section 1:	Number of Pages
Advertisement for Bids	1
Information to Bidders	3
Bid Form	2
Form of Non-Collusive Affidavit.....	1
Bidders Certification of Eligibility.....	1
Certification of General Bidders on CDBG-DR Construction Projects	1
Certification of Sub Bidders on CDBG-DR Construction Projects.....	1
Performance and Payment Bond	1
Subcontractor Identification.....	1
Certification of Bidder Regarding Equal Employment Opportunity.....	1
Green Building Standards Checklist	4
Section 2:	
General Conditions.....	6
Section 3:	
Technical Specifications	
DIVISION 0 – BIDDING AND CONTRACT REQUIREMENTS	
SECTION 00900 – SPECIAL CONDITIONS.....	7
DIVISION 1 - GENERAL REQUIREMENTS	
SECTION 01200 – SUMMARY OF THE WORK	3
SECTION 01270 - UNIT PRICES	2
SECTION 01300 - DEMOLITION	2
SECTION 01400 - SUBMITTALS	3
SECTION 01500 - CUTTING AND PATCHING	3
SECTION 01700 - PROJECT CLOSE-OUT	3

DIVISION 2 - SITEWORK

SECTION 02080 ASBESTOS ABATEMENT 20
SECTION 02090 LEAD BASED PAINT ABATEMENT..... 32
SECTION 02092 MOLD AND WATER REMEDIATION..... 14
SECTION 02094 RADON MITIGATION..... 5

DIVISION 3 - CONCRETE (NOT USED)

DIVISION 4 – MASONRY (NOT USED)

DIVISION 5 - METALS

SECTION 04310 CHIMNEY REPAIRS 13

DIVISION 6 - WOODS AND PLASTICS

SECTION 06100 – ROUGH CARPENTRY 5

DIVISION 7 - THERMAL AND MOISTURE PROTECTION

SECTION 07300 – ASPHALT SHINGLE ROOFING SYSTEM 5
SECTION 07600 – SHEET METAL FLASHING AND TRIM 2
SECTION 07630 – GUTTERS AND LEADERS 2
SECTION 07900 – SEALANTS 3

DIVISION 8 - DOORS AND WINDOWS

SECTION 08550 – VINYL REPLACEMENT WINDOWS..... 2

DIVISION 9 – FINISHES

SECTION 09900 – PAINTING..... 5

DIVISION 10 – SPECIALTIES (NOT USED)

DIVISION 11 - EQUIPMENT (NOT USED)

DIVISION 12 – FURNISHINGS (NOT USED)

DIVISION 13 - SPECIAL CONSTRUCTION (NOT USED)

DIVISION 14 - CONVEYING SYSTEMS (NOT USED)

DIVISION 15 – MECHANICAL (NOT USED)

DIVISION 16 - ELECTRICAL (NOT USED)

LIST OF DRAWINGS

TITLE SHEET

A-1.0 ROOF PLANS

A-1.1 ROOF DETAILS

Section 1

Section 1

ADVERTISEMENT FOR BIDS

The State of Connecticut Department of Housing (DOH) is seeking proposals through a Request for Proposal (RFP) process for the rehabilitation, reconstruction and/or mitigation of residential structures damaged by Superstorm Sandy in compliance with all applicable local, federal, and state statutory requirements with special attention paid to requirements for Community Development Block Grants under the United States Department of Housing and Urban Development (“HUD”) Disaster Recovery grant program.

Separated sealed bids for **Project #2237, Rogers Residence, 181 Trumbull Avenue, Bridgeport, CT 06606** will be received by Capital Studio Architects, LLC. located at 1379 Main Street, East Hartford, CT 06108 until **4:00 o’clock PM on Friday, April 21, 2017.**

A **Mandatory Walk Through** will be held at the Project Site located at **181 Trumbull Avenue, Bridgeport, CT 06606 at 9:00AM on Friday, April 07, 2017.**

The Information to Bidders, Form of Bid, Form of Contract, Plans, Specifications, Form of Bid Bond and Performance and Payment Bond and other contract documents may be examined on the Department of Housing Hurricane Sandy Recover website at www.ct.gov/doh/ and click on the “Hurricane Sandy” link, and at the office Capital Studio Architects, LLC. located at 1379 Main Street, East Hartford, CT 06108.

Copies of plans may be downloaded directly from the Department of Housing website under bid notices or obtained, when requested in advance, at the office of Capital Studio Architects, LLC. located at 1379 Main Street, East Hartford, CT 06108 upon payment of \$25.00 for each set.

DOH reserves the right to waive any informalities or to reject any or all bids.

Each bidder must deposit with his bid, security in the amount, form and subject to the conditions provided in the Information to Bidders.

Attention to bidders is particularly called to the requirements as to conditions of employment to be observed and minimum wages rates to be paid under the contract (if applicable), Section 3, Segregated Facilities, Section 109 and E. O. 11246.

No bidder may withdraw his bid within 30 calendar days after the actual date of the bid opening thereof.

INFORMATION FOR BIDDERS

Receipt and Opening of Bids:

The State of Connecticut Department of Housing (herein called the "DOH"), invites bids on the form attached. Bids will be received by DOH at the office of David Holmes, Project Manager at Capital Studio Architects, LLC. located at 1379 Main Street, East Hartford, CT 06108, until **4:00 o'clock PM on Friday, April 21, 2017.**

The envelopes containing the bids must be sealed, addressed to David Holmes, Project Manager at Capital Studio Architects, LLC. and designated as bid for **Project #2237, Rogers Residence, 181 Trumbull Avenue, Bridgeport, CT 06606.**

DOH may consider informal any bid not prepared and submitted in accordance with the provisions hereof and may waive any informalities or reject any and all bids. Any bid may be withdrawn prior to the above scheduled time for the opening of bids or authorized postponement there considered. NO bidder may withdraw a bid within 30 days after the actual date of the opening thereof.

Mandatory Walk Through: All bidders must attend a mandatory walk through of the property designated above. The date and time of the walk through is set for **9:00 AM on Friday, April 07, 2017.**

Preparation of Bids:

Each bid must be submitted on the prescribed form and accompanied by Certification by Bidder Regarding Equal Employment Opportunity, Form HUD-950.1, and Certification of Bidder Regarding Section 3 and Segregated Facilities. All blank spaces for bid process must be filled in, in ink or typewritten, in both words and figures, and the foregoing Certifications must be fully completed and executed when submitted.

Each bid must be submitted in a sealed envelope bearing on the outside the name of the bidder, his/her address, and the name of the project for which the bid is submitted. If forwarded by mail, the sealed envelope containing the bid must be enclosed in another envelope addressed as specified in the bid form.

Subcontracts: The bidder is specifically advised that any person, for, or other party to whom it is proposed to award a subcontract under this contract:

1. Must be acceptable to the DOH after verification by the State of the current eligibility status; and,
2. Must submit Form HUD-950.2, Certification by Proposed Subcontractor Regarding Equal Employment Opportunity and Certification of Proposed Subcontractor Regarding Section 3 and Segregated Facilities. Approval of the proposed subcontractor award cannot be given by the DOH unless and until the proposed subcontractor has submitted the Certifications and/or other evidence showing that it has fully complied with any reporting requirements to which it is or was subject. Although the bidder is not required to attach such Certifications by proposed subcontractors to his/her bid, the bidder is here advised of this requirement so that appropriate action can be taken to prevent subsequent delay in subcontract awards.

Method of Bidding: DOH invites the following bid(s):

Qualifications of Bidder: The DOH may make such investigations as he/she deems necessary to determine the ability of the bidder to perform the work, and the bidder shall furnish to the DOH all such information and date for this purpose as the DOH may request. The DOH reserves the right to reject any bid if the evidence submitted by, or

investigation of, such bidder fails to satisfy the DOH that such bidder is properly qualified to carry out the obligations of the contract and to complete the work contemplated therein. Conditional bids will not be accepted. The State's set Contractor Prequalifications are available at the Department of Housing's Hurricane Sandy Recovers website www.ct.gov/doh/ and click on the "Hurricane Sandy" link.

Conditions of Work: Each bidder must inform him/herself fully of the conditions relating to the construction of the project and the employment of labor thereon. Failure to do so will not relieve a successful bidder of his/her obligation to furnish all material and labor necessary to carry out the provision of his/her contract. Insofar as possible the contractor, in carrying out the work, must employ such methods or means as will not cause any interruption of or interference with the work of any other contractor.

Addenda and Interpretations: No interpretation of the meaning of the plans, specifications or other pre-bid documents will be made to any bidder orally.

Every request for such interpretation should be in writing addressed to: David Holmes, Project Manager at Capital Studio Architects, LLC. located at 1379 Main Street, East Hartford, CT 06108 and, to be given consideration, must be received at least three days prior to the date fixed for the opening of bids. Any and all such interpretations and any supplemental instruction will be in the form of written addenda to the specifications which, if issued, will be forwarded by electronic mail and posted on DOH's Hurricane Sandy website to all prospective bidders (at the respective email addresses furnished for such purposes), not later than two days prior to the date fixed for the opening of bids. Failure of any bidder to receive any such addendum or interpretation shall not relieve such bidder from any obligation under his/her bid as submitted. All addenda so issued shall become part of the contract documents.

Performance and Payment Bonds: A performance and payment bond will be required of the successful bidder (contractor) for 100 percent of the contract price on contracts over \$100,000.

Contract Progress Schedule: Each bid shall be accompanied by a Contract Progress Schedule. Such Schedule shall list the bidder's timetable for completion of the contract.

Notice of Special Conditions: Attention is particularly called to those parts of the contract documents and specifications which deal with the following:

1. Inspection and testing of materials
2. Insurance requirements
3. Wage rates (if applicable)
4. State allowances

Laws and Regulations: The bidder's attention is directed to the fact that all applicable State laws, municipal ordinances, and the rules and regulations of all authorities having jurisdiction over construction of the project shall apply to the contract throughout, and they will be deemed to be included in the contract the same as though herein written out in full.

Method of Award-Lowest Qualified Bidder: If at the time this contract is to be awarded, the lowest base bid submitted by a responsible bidder does not exceed the amount of funds then estimated by the DOH as available to finance the contract; the contract will be awarded on the base bid only. If such bid exceeds such amount, the DOH may reject all bids or may award the contract on the base bid combined with such deductible alternatives applied in numerical order in which they are listed in the Form of Bids, as produces a net amount which is within the available funds.

If the homeowner wishes to select a prequalified bidding contractor other than the lowest and most responsible bidder, said owner is responsible for paying the difference between the lowest bidder and their chosen bidder from their own financing.

Obligation of Bidder: At the time of the opening of bids, each bidder will be presumed to have inspected the site and to have read and to be thoroughly familiar with the plans and contract documents (including all addenda). The failure or omission of any bidder to examine any form, instrument or document shall in no way relieve any bidder from any obligation in respect of his/her bid.

Safety Standards and Accident Prevention: With respect to all work performed under this contract, the contractor shall:

1. Comply with the safety standards provision of applicable laws, building and construction codes and the “Manual of Accident Prevention in Construction” published by the Associated General Contractors of America, the requirements of the Occupational Safety and Health Act of 1970 (Public Law 91-596), and the requirements of Title 29 of the Code of Federal Regulations, Section 1518 as published in the “Federal Register,” Volume 36, No 75, Saturday, April 17, 1971.
2. Exercise every precaution at all times for the prevention of accidents and the protection of persons (including employees) who may be injured on the job site before the employer has made a standing arrangement for removal of injured persons to a hospital or a doctor’s care.

BID FORM

The undersigned, being familiarized with the local conditions affecting the cost of the work and with the Drawings, Specifications, Invitation to Bidders, Instructions to Bidders, General Conditions, Bid Form, Form of Contract and Form of Bonds for **Project No. 2237** and Addenda No. _____ and _____ thereto, as prepared by Capital Studio Architects, LLC. East Hartford, Connecticut, and on file in the office of DOH, hereby proposes to furnish all permits, labor, materials, tools, equipment and related items required for the rehabilitation and reconstruction including general construction, site improvements, plumbing, heating, electrical and finish items for said **Project No. 2237 located at 181 Trumbull Avenue in Bridgeport, State of Connecticut 06606**, all in accordance with the Drawings and Specifications, for the sum of:

_____ Dollars (\$ _____).

Section #	Scope of Work	Subcontractor	Labor Cost	Material	Total
TOTAL COST					

ALTERNATE PROPOSALS AND UNIT PRICES

The undersigned bidder further proposes and agrees that should any or all of the following Alternates be accepted and included in the Contract, the amount of the Base Bid, as heretofore stated, shall be adjusted by the amount stated for each Alternate, or Unit Price. All materials and workmanship shall be in strict accordance with the Drawings and Specifications and shall be in-place prices.

Alternates

None

<u>Unit Price</u>	<u>Unit Measure</u>
No. <u>1</u> \$ _____	/ SF
No. <u>2</u> \$ _____	/ LF
No. <u>3</u> \$ _____	/ LF
No. <u>4</u> \$ _____	/ LF
No. <u>5</u> \$ _____	/ LF

The undersigned agrees to commence the work on a date to be specified in the contract and to complete such work within **60** consecutive calendar days.

The undersigned agrees that if within the period of one hundred eighty (180) days after the opening of bids, or when extended to the next work day immediately following said period, notice of the acceptance of this bid shall be mailed, or delivered to him/her at the business address given below, or at any time thereafter before this bid is withdrawn, will within fifteen (15) days thereafter deliver to the DOH, where directed, a contract properly executed in such number of counterparts as may be required by said DOH, on the forms annexed, with such changes therein as shall have been made by DOH, prior to the time named for delivery of this proposal, together with an executed Completion Assurance Agreement with a Letter of Credit in a form satisfactory to the DOH and a letter indicating those Small/Minority Business Enterprises that will perform work and/or provide materials, equipment or services as part of the contract.

In submitting this bid, it is understood that the right is reserved by the abovementioned DOH to reject any and all bids; and it is agreed that this bid may not be withdrawn for a period of one hundred eighty (180) days from the date of bid opening or until the next work day immediately following said period if such period ends on a weekend or a State holiday. It is the intent of DOH to award and sign contract within ninety (90) days of the Notice to Award a contract. For contracts not signed within said ninety day period, Contractors shall be allowed to increase their bids by a rate of 3% annum, prorated on a monthly basis until the date of contract award and signing.

Attached hereto is an affidavit, in proof that the undersigned has not entered into any collusion with any person in respect to this proposal, or any other proposal, or the submitting of proposals for the above Project. Also attached is a statement of contractor's qualifications, Certification of Bidder Regarding Equal Employment Opportunity, and Segregated Facilities.

Acknowledgement of Bidder

I, THE UNDERSIGNED AS AN AUTHORIZED OFFICER OF:

(Company Name)

(Date)

(Address)

(Telephone)

(City/State/Zip)

(Fax No.)

(FEIN)

I HEREBY SUBMIT THE FOLLOWING PRICES FOR THE PROJECT IDENTIFIED ABOVE: (Indicate in words and numerals)

BASE BID PRICE: Cost _____

AMOUNT IN WORDS: _____

(Signature)

(Date)

(Printed Name)

(Title/Position)

(Email address) _____

FORM OF NON-COLLUSIVE AFFIDAVIT
AFFIDAVIT

State of _____)

County of _____)

_____, being first duly sworn, deposes and says:

That he/she is, _____ the party making the foregoing proposal for bid, that such proposal or bid is genuine and not collusive or sham; that said bidder has not colluded, conspired, connived or agreed, directly or indirectly, with any bidder or person, to put in a sham bid or to refrain from bidding, and has not, in any manner, directly or indirectly, sought by agreement or collusion, or communication or conference, with any person, to fix the bid price of affiant or of any other bidder, or to fix any overhead, profit or cost element of said bid price, or of that of any other bidder, or to secure any advantage against DOH or any person interested in the proposed contract, and that all statements in said proposal for bid are true.

Project No. _____

Location _____

Signature

Name and Title

Date

(Signature should be notarized.)

BIDDER'S CERTIFICATION OF ELIGIBILITY

By the submission of this bid, the bidder certifies that to the best of its knowledge and belief, neither it, nor any person or firm which has an interest in the bidder's firm, nor any of the bidder's subcontractors, is ineligible to:

- (1) Be awarded contracts by any agency of the United States Government or HUD; or,
- (2) Participate in HUD programs pursuant to 24 CFR part 24.

(Name of Bidder)

(Address)

BY: _____

Title: _____

NOTE: This certification is a material representation of fact upon which reliance is placed when making award. If it is later determined that the bidder knowingly rendered an erroneous certification, the contract may be terminated for default, and the bidder may be debarred or suspended from participation in HUD programs and other Federal programs.

CERTIFICATION OF GENERAL BIDDERS ON CDBG-DR CONSTRUCTION PROJECTS

I. CERTIFICATION REGARDING HEALTH AND SAFETY

The undersigned hereby certifies that he/she is able to furnish labor that can work in harmony with all other elements of labor employed or to be employed on the work; that all employees to be employed at the worksite will have successfully completed a course in construction safety and health approved by the United States Occupational Safety and Health Administration that is at least ten hours in duration at the time the employee begins work and who shall furnish documentation of successful completion of said course with the first certified payroll report for each employee

II. CERTIFICATION REGARDING NON-COLLUSION AND DEBARMENT

The undersigned further certifies under the penalties of perjury that this bid is in all respects bona fide, fair and made without collusion or fraud with any other person. As used in this subsection the word "person" shall mean any natural person, joint venture, partnership, corporation or other business or legal entity. The undersigned further certifies that neither he/she nor any firm, corporation, partnership or association in which he/she has a substantial interest is designated as an ineligible contractor by the Comptroller General of the United States pursuant to Section 5.6 (b) of the Regulations of the Secretary of Labor, Part 5 (29 CFR, Part 5), or pursuant to Section 3 (a) of the Davis-Bacon Act, as amended (40 USC 276a). The undersigned further certifies that said undersigned is not presently debarred from doing public construction work in the State of Connecticut.

Date: _____

Name of General Bidder

By _____

Signature

Print name and title

Business Address

Street Address City and State

OSHA-10 OSHA-10

CERTIFICATION OF SUB- BIDDERS (IF ANY) ON CDBG-DR CONSTRUCTION PROJECTS

I. CERTIFICATION REGARDING HEALTH AND SAFETY

The undersigned hereby certifies that he/she is able to furnish labor that can work in harmony with all other elements of labor employed or to be employed on the work; that all employees to be employed at the worksite will have successfully completed a course in construction safety and health approved by the United States Occupational Safety and Health Administration that is at least ten hours in duration at the time the employee begins work and who shall furnish documentation of successful completion of said course with the first certified payroll report for each employee

II. CERTIFICATION REGARDING NON-COLLUSION AND DEBARMENT

The undersigned further certifies under penalties of perjury that this subbid is in all responses bona fide, fair and made without collusion or fraud with any other person. As used in this subsection the “person” shall mean any natural person, joint venture, partnership, corporation or other business or legal entity. The undersigned further certifies that neither he/she nor any firm, corporation, partnership or association in which he/she has a substantial interest is designated as an ineligible contractor by the Comptroller General of the United States pursuant to Section 5.6 (b) of the Regulations of the Secretary of Labor, Part 5 (29 CFR, Part 5), or pursuant to Section 3 (a) of the Davis-Bacon Act, as amended (40 USC 276a). The undersigned further certifies that said undersigned is not presently debarred from doing public construction work in the State of Connecticut.

Date _____

Name of Sub-bidder

By _____

Signature

Print Name and Title

Business Name

Street Address, City and State

SUBCONTRACTOR IDENTIFICATION

(Provide additional forms for more subcontractors, as needed.)

This form is a part of your bid package and must be submitted along with the itemized and formal bid forms at the time of the bid opening. Failure to submit a completed document could result in the disqualification of your bid.

Name of Subcontractor: _____

Address: _____

Trade: _____

Hourly Wage: \$_____ Full Contract Price: \$_____

Federal Tax# or SSN #: _____

Male Owned Business _____ Female Owned Business _____

Is he/she of Hispanic or Latino ethnicity? Yes _____ No _____

Race: (Please check one)

- White American Indian/Alaskan Native
 Black/African American Hasidic Jew
 Asian/Pacific American

Name of Subcontractor: _____

Address: _____

Trade: _____

Hourly Wage: \$_____ Full Contract Price: \$_____

Federal Tax# or SSN #: _____

Male Owned Business _____ Female Owned Business _____

Is he/she of Hispanic or Latino ethnicity? Yes _____ No _____

Race: (Please check one)

- White American Indian/Alaskan Native
 Black/African American Hasidic Jew
 Asian/Pacific American

Name of Subcontractor: _____

Address: _____

Trade: _____

Hourly Wage: \$_____ Full Contract Price: \$_____

Federal Tax# or SSN #: _____

Male Owned Business _____ Female Owned Business _____

Is he/she of Hispanic or Latino ethnicity? Yes _____ No _____

Race: (Please check one)

- White American Indian/Alaskan Native
 Black/African American Hasidic Jew
 Asian/Pacific American

Contractor's Signature

Date

U.S. DEPARTMENT OF HOUSING AND URBAN DEVELOPMENT
CERTIFICATION OF BIDDER REGARDING EQUAL EMPLOYMENT OPPORTUNITY

INSTRUCTIONS

This certification is required pursuant to Executive Order 11246 (30 F R 12319-25). The implementing rules and regulations provide that any bidder or prospective contractor, or any of their proposed subcontractors shall state as an initial part of the bid or negotiations of the contract whether it has participated in any previous contract or subcontract subject to the equal opportunity clause; and, if so, whether it has filed all compliance reports due under applicable instructions.

Where the certification indicates that the bidder has not filed a compliance report due under applicable instructions, such bidder shall be required to submit a compliance report within seven calendar days after bid opening. No contract shall be awarded unless such report is submitted.

CERTIFICATION OF BIDDER

Name and address of Bidder (include zip code)

1. Bidder has participated in a previous contract or subcontract subject to the Equal Opportunity Clause.
 YES NO
2. Compliance reports were required to be filed in connection with such contract or subcontract.
 YES NO
3. Bidder has filed all compliance reports due under applicable instructions, including SF.100.
 YES NO NOT REQUIRED
4. Have you ever seen or are you being considered for sanction due to violation of Executive Order 11246, as amended?
 YES NO
5. No segregated facilities will be maintained.

NAME AND TITLE OF SIGNER (Please type.)

SIGNATURE

DATE

Green Building Standards Checklist

HUD CPD Green Building Retrofit Checklist

The CPD Green Retrofit Checklist promotes energy efficiency and green building practices for residential retrofit projects. Grantees must follow the checklist in its entirety and apply all measures within the Checklist to the extent applicable to the particular building type being retrofitted. The phrase “when replacing” in the Checklist refers to the mandatory replacement with specified green improvements, products, and fixtures only when replacing those systems during the normal course of the retrofit.

WATER AND ENERGY CONSERVATION MEASURES

N/A

Water-Conserving Fixtures

Install or retrofit water conserving fixtures in any unit and common facility, use the following specifications: Toilets-- 1.28 gpf; Urinals-- 0.5 gpf; Showerheads-- 2.0 gpm; Kitchen faucets-- 2.0 gpm; and Bathroom faucets-- 1.5gpm. [gpf = gallons per flush; gpm = gallons per minute]

N/A

ENERGY STAR Appliances

Install ENERGY STAR-labeled clothes washers, dishwashers, and refrigerators, if these appliance categories are provided in units or common areas.

N/A

Air Sealing: Building Envelope

Seal all accessible gaps and penetrations in the building envelope. If applicable, use low VOC caulk or foam.

N/A

Insulation: Attic (if applicable to building type)

For attics with closed floor cavities directly above the conditioned space, blow in insulation per manufacturer's specifications to a minimum density of 3.5 Lbs. per cubic foot (CF). For attics with open floor cavities directly above the conditioned space, install insulation to meet or exceed IECC levels.

N/A

Insulation: Flooring (if applicable to building type)

Install \geq R-19 insulation in contact with the subfloor in buildings with floor systems over vented crawl spaces. Install a 6-mil vapor barrier in contact with 100% of the floor of the crawl space (the ground), overlapping seams and piers at least 6 inches.

N/A

Duct Sealing (if applicable to building type)

In buildings with ducted forced-air heating and cooling systems, seal all penetrations of the air distribution system to reduce leakage in order to meet or exceed ENERGY STAR for Homes' duct leakage standard.

N/A

Air Barrier System

Ensure continuous unbroken air barrier surrounding all conditioned space and dwelling units. Align insulation completely and continuously with the air barrier.

N/A

Radiant Barriers: Roofing

When replacing or making a substantial repair to the roof, use radiant barrier sheathing or other radiant barrier material; if economically feasible, also use cool roofing materials.

X	<p>Windows</p> <p>When replacing windows, install geographically appropriate ENERGY STAR rated windows.</p>
N/A	<p>Sizing of Heating and Cooling Equipment</p> <p>When replacing, size heating and cooling equipment in accordance with the Air Conditioning Contractors of America (ACCA) Manuals, Parts J and S, or 2012 ASHRAE Handbook--HVAC Systems and Equipment or most recent edition.</p>
N/A	<p>Domestic Hot Water Systems</p> <p>When replacing domestic water heating system(s), ensure the system(s) meet or exceed the efficiency requirements of ENERGY STAR for Homes' Reference Design. Insulate pipes by at least R-4.</p>
N/A	<p>Efficient Lighting: Interior Units</p> <p>Follow the guidance appropriate for the project type: install the ENERGY STAR Advanced Lighting Package (ALP); OR follow the ENERGY STAR MFHR program guidelines, which require that 80% of installed lighting fixtures within units must be ENERGY STAR-qualified or have ENERGY STAR-qualified lamps installed; OR when replacing, new fixtures and ceiling fans must meet or exceed ENERGY STAR efficiency levels.</p>
N/A	<p>Efficient Lighting: Common Areas and Emergency Lighting (if applicable to building type)</p> <p>Follow the guidance appropriate for the project type: use ENERGY STAR-labeled fixtures or any equivalent high-performance lighting fixtures and bulbs in all common areas; OR when replacing, new common space and emergency lighting fixtures must meet or exceed ENERGY STAR efficiency levels. For emergency lighting, if installing new or replacing, all exist signs shall meet or exceed LED efficiency levels and conform to local building codes.</p>
N/A	<p>Efficient Lighting: Exterior</p> <p>Follow the guidance appropriate for the project type: install ENERGY STAR-qualified fixtures or LEDs with a minimum efficacy of 45 lumens/watt; OR follow the ENERGY STAR MFHR program guidelines, which require that 80% of outdoor lighting fixtures must be ENERGY STAR-qualified or have ENERGY STAR-qualified lamps installed; OR when replacing, install ENERGY STAR compact fluorescents or LEDs with a minimum efficacy of 45 lumens/watt.</p>

INDOOR AIR QUALITY

N/A	<p>Air Ventilation: Single Family and Multifamily (three stories or fewer)</p> <p>Install an in-unit ventilation system capable of providing adequate fresh air per ASHRAE 62.2 requirements.</p>
N/A	<p>Air Ventilation: Multifamily (four stories or more)</p> <p>Install apartment ventilation systems that satisfy ASHRAE 62.2 for all dwelling units and common area ventilation systems that satisfy ASHRAE 62.1 requirements. If economically feasible, consider heat/energy recovery for 100% of corridor air supply.</p>
N/A	<p>Composite Wood Products that Emit Low/No Formaldehyde</p>

Composite wood products must be certified compliant with California 93120. If using a composite wood product that does not comply with California 93120, all exposed edges and sides must be sealed with low-VOC sealants.

- | | |
|-----|--|
| N/A | <p>Environmentally Preferable Flooring</p> <p>When replacing flooring, use environmentally preferable flooring, including the FloorScore certification. Any carpet products used must meet the Carpet and Rug Institute's Green Label or Green Label Plus certification for carpet, pad, and carpet adhesives.</p> |
| X | <p>Low/No VOC Paints and Primers</p> <p>All interior paints and primers must be less than or equal to the following VOC levels: Flats--50 g/L; Non-flats--50 g/L; Floor--100 g/L. [g/L = grams per liter; levels are based on a combination of the Master Painters Institute (MPI) and GreenSeal standards.]</p> |
| X | <p>Low/No VOC Adhesives and Sealants</p> <p>All adhesives must comply with Rule 1168 of the South Coast Air Quality Management District. All caulks and sealants must comply with regulation 8, rule 51, of the Bay Area Air Quality Management District.</p> |
| N/A | <p>Clothes Dryer Exhaust</p> <p>Vent clothes dryers directly to the outdoors using rigid-type duct work.</p> |
| X | <p>Mold Inspection and Remediation</p> <p>Inspect the interior and exterior of the building for evidence of moisture problems. Document the extent and location of the problems, and implement the proposed repairs according to the Moisture section of the EPA Healthy Indoor Environment Protocols for Home Energy Upgrades.</p> |
| N/A | <p>Combustion Equipment</p> <p>When installing new space and water-heating equipment, specify power-vented or direct vent combustion equipment.</p> |
| N/A | <p>Mold Prevention: Water Heaters</p> <p>Provide adequate drainage for water heaters that includes drains or catch pans with drains piped to the exterior of the dwelling.</p> |
| N/A | <p>Mold Prevention: Surfaces</p> <p>When replacing or repairing bathrooms, kitchens, and laundry rooms, use materials that have durable, cleanable surfaces.</p> |
| N/A | <p>Mold Prevention: Tub and Shower Enclosures</p> <p>When replacing or repairing tub and/or shower enclosures, use non-paper-faced backing materials such as cement board, fiber cement board, or equivalent in bathrooms.</p> |
| N/A | <p>Integrated Pest Management</p> <p>Seal all wall, floor, and joint penetrations with low-VOC caulking or other appropriate sealing methods to prevent pest entry. [If applicable, provide training to multifamily buildings staff.]</p> |
| X | <p>Lead-Safe Work Practices</p> |

For properties built before 1978, if the project will involve disturbing painted surfaces or cleaning up lead contaminated dust or soil, use certified renovation or lead abatement contractors and workers using lead-safe work practices and clearance examinations consistent with the more stringent of EPA's Renovation, Repair, and Painting Rule and HUD's Lead Safe Housing Rule.

X

Radon Testing and Mitigation (if applicable based on building location)

For buildings in EPA Radon Zone 1 or 2, test for radon using the current edition of American Association of Radon Scientists and Technologists (AARST)'s Protocols for Radon Measurement in Homes Standard for Single-Family Housing or Duplexes, or AARST's Protocol for Conducting Radon and Radon Decay Product Measurements in Multifamily Buildings. To install radon mitigation systems in buildings with radon level of 4 pCi/L or more, use ASTM E 2121 for single-family housing or duplexes, or AARST's Radon Mitigation Standards for Multifamily Buildings. For new construction, use AARST's Reducing Radon in New Construction of 1 & 2 Family Dwellings and Townhouses, or ASTM E 1465.

Section 2

Section 2

General Conditions

1. The purpose of this HUD and DOH sponsored 0% interest loan Owner Occupied Rehabilitation and Rebuilding program is to make good faith efforts to assist qualified property owners in making repairs to their property damaged by Superstorm Sandy. Eligible repairs include code, health and safety compliance modifications, including but not limited to building envelope and energy efficiency upgrades (See Green Building Standards).
2. In the event that the homeowner is dissatisfied with the work performed although the work has been completed to industry standards, approved by the local municipality's code enforcement officials and approved by the DOH or its agent, the homeowner's approval will be overridden, full payment will be issued to the contractor and the project will be officially closed.
3. The owner is responsible for removal or relocation from the respective work areas the following, including but not necessarily limited to: personal belongings, window treatments, small furniture, fixtures, area carpets, interior and exterior plants. The contractor will be responsible for covering and protecting large furniture unable to be removed from the respective work areas.
4. The Contractor, unless otherwise specified, shall provide all labor, materials, tools, equipment, and related items required for the erection and completion of all work indicated in this project manual and as may be inferred, implied or otherwise necessary for the proper execution of the work.
5. The Contractor shall pay all necessary taxes, fees, and permits necessary to complete all of his work as detailed on the attached scope of work.
6. The premises herein shall be occupied during the course of the construction work.
7. All rehabilitation, alterations, repairs, or extensions shall be in compliance with all applicable codes of the Municipality, HUD requirements or compliance with the latest edition of the International Building Code, which ever applies and is the more strict. All electrical, heating, and plumbing work shall comply with the rules and regulations of the National, State and Local Codes. Before commencing work, contractors and/or subcontractors shall obtain all necessary permits.
8. The Contractor certifies that he has familiarized himself with the requirements of the specifications and plans and understands the extent and character of the work to be done, and inspected the premises and given his full attention to any and all areas with which he might become specifically involved. He must familiarize himself with all conditions relating to and affecting his work and bid.
9. The selected Contractor must, prior to contract signing, supply the DOH and the Owner with the original certificates of insurance in accordance with the following insurance requirements:
 - A. Contractor shall procure and maintain for the duration of the Agreement the following types of insurance, in amounts no less than the stated limits, against claims for injuries to persons or damages to property which may arise from or in connection with the performance of the work hereunder:
 - 1) **Workers' Compensation Insurance:** The Contractor shall maintain full and complete Workers' Compensation Insurance for all of its employees and those of its subcontractors engaged in work on the premises, in accordance with the local and state laws governing the same, in the minimum amounts of \$100,000 each accident, \$500,000 disease – Policy limit, \$100,000 disease – each employee.
 - 2) **General Liability Insurance:** The Contractor shall furnish evidence of a comprehensive general liability insurance coverage with a combined single limit for bodily injury, death, and property damage in the amount of \$1,000,000 per occurrence, naming the Owner and the State as additional insured. This shall cover the use of all equipment, hoists and vehicles on the Premises not covered by any automobile liability policy. If the Contractor has a "claims-made" policy, then the following additional requirements apply: (a) the policy must provide a retroactive date which must be on or before the execution date of this Agreement and (b) the extended reporting period may not be less than five (5) years following the Construction Completion Date.
 - 3) **Automobile Liability:** The Contractor shall furnish evidence of Automobile Liability insurance with minimum limits of \$1,000,000 per occurrence, combined single limit for bodily injury and property damage liability. This shall include owned vehicles, non-owned vehicles and employee non-ownership.
 - 4) **Cargo Insurance:** The Contractor shall furnish evidence of all-risk cargo insurance, with a minimum limit of \$_____ per occurrence when the project involves raising a structure above the Base Flood Elevation.
 - 5) **Builders Risk:** The Contractor shall maintain Builder's Risk (fire and extended coverage) insurance providing coverage for the entire work at the project site, including all work in place, all materials stored at the building site, foundations and building equipment. Coverage shall be on a completed value form basis in an amount equal to the projected value of the project. The Contractor agrees to endorse the State of Connecticut and the Owner as Loss Payees.

B. Additional Insurance Provisions

- 1) Each of the Owner and the State of Connecticut Department of Housing, and their successors and assigns, as their interests may appear, shall be named as an Additional Insured on the Commercial General Liability policy.
 - 2) Described insurance shall be primary coverage and Applicant and Applicant's insurer shall have no right of subrogation recovery or subrogation against the State of Connecticut.
 - 3) Applicant shall assume any and all deductibles in the described insurance policies.
 - 4) Without limiting Applicant's obligation to procure and maintain insurance for the duration identified in (A) above, each insurance policy shall not be suspended, voided, cancelled or reduced except after thirty (30) days prior written notice by certified mail has been given to the State of Connecticut, with the exception that a ten (10) day prior written notice by certified mail for non-payment of premium is acceptable.
 - 5) Each policy shall be issued by an Insurance Company licensed to do business by Connecticut Department of Insurance and having a minimum Best Rating of A- or equivalent or as otherwise approved by the State.
10. DOH and its agents must be notified prior to start of work of any subcontractor to be paid for work on the job who is different from the subcontractor identified in original bid proposal.
 11. Working times for the project shall be Monday through Friday 8 am to 5 pm (EST). Contractors must request permission from owner and be in compliance with local municipal ordinances prior to working longer hours or weekends.
 12. All materials shall be new and of acceptable quality. The Contractor shall submit proof of purchase of warrantee items at closeout. The property Owner shall select all colors, models, etc. as per scope of work. All materials and work must be applied in accordance with the applicable manufacturer's latest instructions and specifications, and in accordance with Federal prohibitions against the use of lead paint.
 13. All manufacturers' warranties are to be extended to the property Owner free and clear of all liens. Unless otherwise specified, all labor, material, and workmanship provided by the Contractor shall be guaranteed by the Contractor, including that of subcontractors, for a one (1) year period from the date of the Final Payment. This guarantee shall be in addition to and not in limitation of, in lieu of, or modify and other guarantee that is due the property Owner from any manufacturer.
 14. The Contractor shall repair or replace all work, materials and equipment which are found to be defective during construction and the guarantee period. Repair shall include all damage to surrounding work caused by the failure and/or necessary for the repair or replacement of the defect. All repairs and replacements shall be performed at no additional expense to the Owner and shall be completed promptly after the Contractor receives notice of the defect.
 15. The Contractor shall take all necessary measures and precautions to protect the surroundings from damage occurring due to performance of the work. All areas and surfaces of the existing building which are affected by the execution of the new work (removals, demolition, repairs etc.) shall be patched and restored to either match the existing adjacent conditions or to match the new work, whichever is applicable. If such damage occurs it will be repaired by the Contractor at no cost to the Owner. Contractor shall provide all temporary shoring, bracing and other construction (interior and exterior) required to perform the work of this contract.
 16. The Contractor shall dispose of all debris and remove all material resulting from his work in accordance with local and State law. The Contractor shall police and maintain a clean and safe job site daily. He shall reinstall accessories taken down and clean up all scrap around the project and remove fingerprints. All on-site maintenance relating to the performance of the work shall be the responsibility of the Contractor until the Certificate of Completion is issued. The project shall be maintained in a habitable and safe condition daily if the project is to remain occupied.
 17. Materials and products not otherwise specified in these documents shall be to match building standards and existing conditions, provided such items are in compliance with all applicable codes. Such codes set the minimum standards to be achieved.
 18. All work shall be neat and accurate and done in a manner in accordance with customary trade practices. **The Contractor, at a minimum, shall leave the premises broom clean and orderly after each working day and shall keep the premises free from accumulation of materials and rubbish by disposing of such debris in an onsite disposal container (provided by the contractor) or removed by vehicle in accordance with all applicable state and local regulations.** At the completion of the project the Contractor shall remove all excess materials from the site. Any surplus material agreed to be left for the owner shall be stored neatly by the contractor in a location directed by the owner free from weather, spoilage or pilferage.
 19. The Contractor shall coordinate any work which interfaces with other Contractors or with the operations of the Owner. The Contractor shall take all necessary precautions to prevent fire, bodily injury, damage to property and any other calamities that may arise which pose a threat to life, limb property.
 20. The Contractor shall not make any changes to the scope of work unless a change order is processed and fully executed by the DOH.

21. The Owner may cancel this contract within three days of signing and not be liable to the Contractor or DOH. Should the Owner opt to cancel they must sign and send a Notice of Cancellation to DOH, otherwise DOH shall issue a Notice to Proceed authorizing the contractor to commence with the proposed improvements.
22. The Contractor shall commence work under this contract within 15 work days of the date of the notice to proceed and complete work within **60** calendar days of the notice to proceed.
23. If the Contractor is delayed at any time in the progress of the work by any act or neglect of the Owner or by any employee of the Owner, or by any separate Contractor employed by the Owner, or by changes ordered in the work or by labor disputes, fire, unusual delay in delivery of materials, transportation, adverse weather conditions not reasonably anticipatable, unavoidable casualties, or any cause beyond the Contractor's control, or by delay authorized by the Owner pending arbitration, or by any other cause which justifies the delay, the contract time may be extended by Change Order for such reasonable time as may be agreed upon by all parties. It shall be the responsibility of the Contractor to request and document in writing such extensions within three (3) work days.
24. In the event that the Contractor does not commence or pursue the work as hereinafter stated, then DOH shall have the right to terminate this agreement and to hire a successor Contractor to perform the work. Any such termination shall be by certified mail to the address noted in this agreement, and shall be effective as of the date of mailing. Payments by the DOH/Owner in the event of termination shall be as follows:
25. The successor Contractor shall first be paid and then the terminated Contractor. Payments to the terminated Contractor shall be limited both as to those funds remaining after payment to the successor Contractor but shall not exceed the value of the work actually performed by the terminated Contractor. Further, should the total cost for work performed under this contract exceed the amount stated in this agreement due to the Contractor's termination, then the Owner shall have a cause of action against the terminated Contractor for any such additional cost.
26. If, through any cause, the Contractor shall fail to fulfill in a timely and proper manner his obligations under this Contract, or if the Contractor shall violate any of the covenants, agreements, or stipulations of this Contract, DOH shall, thereupon, have the right to terminate this Contract by giving written notice to the Contractor of such termination and specifying the effective date of such termination. In such event, all unfinished work required by the Contractor under this Contract shall, at the option of the DOH, be completed or not.
27. **Payments**
 - 1) DOH/Homeowner shall pay the Contractor the price as provided in this contract.
 - 2) DOH shall make progress payments approximately every 30 days as the work proceeds, on estimates of work accomplished which meets the standards of quality established under the contract, as approved by the Contracting Officer. DOH may, subject to written determination and approval of the Contracting Officer, make more frequent payments to contractors which are qualified small businesses.
 - 3) Before the first progress payment under this contract, the Contractor shall furnish, in such detail as requested by the Contracting Officer, a breakdown of the total contract price showing the amount included therein for each principal category of the work, which shall substantiate the payment amount requested in order to provide a basis for determining progress payments. The breakdown shall be approved by the Contracting Officer and must be acceptable to DOH. The values and quantities employed in making up this breakdown are for determining the amount of progress payments and shall not be construed as a basis for additions to or deductions from the contract price. The Contractor shall prorate its overhead and profit over the construction period of the contract.
 - 4) The Contractor shall submit, on AIA forms provided by DOH, periodic estimates showing the value of the work performed during each period based upon the approved breakdown of the contract price. Such estimates shall be submitted not later than 14 days in advance of the date set for payment and are subject to correction and revision as required. The estimates must be approved by the Contracting Officer with the concurrence of the Architect prior to payment. If the contract covers more than one project, the Contractor shall furnish a separate progress payment estimate for each.
 - 5) Along with each request for progress payments and the required estimates, the Contractor shall furnish lien waivers and labor releases as good and sufficient evidence that the premises are free from all liens, damages, and anything chargeable to said contractor.
 - 6) Except as otherwise provided in State law, DOH shall retain five (5) percent of the amount of progress payments until completion and acceptance of all work under the contract; except, that if upon completion of 50 percent of the work, the Contracting Officer, after consulting with the Architect, determines that the Contractor's performance and progress are satisfactory, DOH may make the remaining payments in full for the work subsequently completed. If the Contracting Officer subsequently determines that the Contractor's performance and progress are unsatisfactory, DOH shall reinstate the five (5) percent retainage until such time as the Contracting Officer determines that performance and progress are satisfactory. Retainage will be released 90 days after project completion.
 - 7) The Contracting Officer may authorize material delivered on the site and preparatory work done to be taken into consideration when computing progress payments. Material delivered to the Contractor at locations other than the site may also be taken into consideration if the Contractor furnishes satisfactory evidence that (1) it has acquired title to such material; (2) the material is properly stored in a bonded warehouse, storage yard, or similar suitable place as may be approved by the Contracting Officer; (3) the material is insured to cover its full value; and (4) the material will be used to perform this contract. Before any progress payment which includes delivered material is made, the Contractor shall furnish such documentation as the Contracting Officer may require to assure the protection of DOH's/Homeowner's interest in such materials. The Contractor shall remain responsible for such stored material notwithstanding the transfer of title to the Homeowner.
 - 8) All material and work covered by progress payments made shall, at the time of payment become the sole property of the Homeowner, but this shall not be construed as (1) relieving the Contractor from the sole responsibility for all material and work upon which payments have been made or the restoration of any damaged work; or, (2) waiving the right of DOH/Homeowner to require the fulfillment of all of the terms of the contract. In the event the work of the Contractor has been damaged by other contractors or persons other than employees of DOH in the course of their employment, the Contractor shall restore such damaged work without cost to DOH/Homeowner and to seek redress for its damage only from those who directly caused it.

- 9) DOH shall make the final payment due the Contractor under this contract after (1) completion and final acceptance of all work; and (2) presentation of release of all claims against DOH/Homeowner arising by virtue of this contract, other than claims, in stated amounts, that the Contractor has specifically excepted from the operation of the release. Each such exception shall embrace no more than one claim, the basis and scope of which shall be clearly defined. The amounts for such excepted claims shall not be included in the request for final payment. A release may also be required of the assignee if the Contractor's claim to amounts payable under this contract has been assigned.
 - 10) Prior to making any payment, the Contracting Officer may require the Contractor to furnish receipts or other evidence of payment from all persons performing work and supplying material to the Contractor, if the Contracting Officer determines such evidence is necessary to substantiate claimed costs.
 - 11) DOH shall not; (1) determine or adjust any claims for payment or disputes arising there under between the Contractor and its subcontractors or material suppliers; or, (2) withhold any moneys for the protection of the subcontractors or material suppliers. The failure or refusal of DOH to withhold moneys from the Contractor shall in nowise impair the obligations of any surety or sureties under any bonds furnished under this contract.
28. Disputes
- 1) "Claim," as used in this clause, means a written demand or written assertion by one of the contracting parties seeking, as a matter of right, the payment of money in a sum certain, the adjustment or interpretation of contract terms, or other relief arising under or relating to the contract. A claim arising under the contract, unlike a claim relating to the contract, is a claim that can be resolved under a contract clause that provides for the relief sought by the claimant. A voucher, invoice, or other routine request for payment that is not in dispute when submitted is not a claim. The submission may be converted to a claim by complying with the requirements of this clause, if it is disputed either as to liability or amount or is not acted upon in a reasonable time.
 - 2) Except for disputes arising under the clauses entitled Labor Standards - Davis Bacon and Related Acts, herein, all disputes arising under or relating to this contract, including any claims for damages for the alleged breach thereof which are not disposed of by agreement, shall be resolved under this clause.
 - 3) All claims by the Contractor shall be made in writing and submitted to the Contracting Officer for a written decision.
 - 4) A claim by the Homeowner against the Contractor shall be subject to a written decision by the Contracting Officer.
 - 5) The Contracting Officer shall, within calendar 60 (unless otherwise indicated) days after receipt of the request, decide the claim or notify the Contractor of the date by which the decision will be made.
 - 6) The Contracting Officer's decision shall be final unless the Contractor (1) appeals in writing to a higher level in DOH in accordance with DOH's policy and procedures, (2) refers the appeal to an independent mediator or arbitrator, or (3) files suit in a court of competent jurisdiction. Such appeal must be made within (30 unless otherwise indicated) calendar days after receipt of the Contracting Officer's decision.
 - 7) The Contractor shall proceed diligently with performance of this contract, pending final resolution of any request for relief, claim, appeal, or action arising under or relating to the contract, and comply with any decision of the Contracting Officer.
29. The Contractor will not discriminate against any employee or applicant for employment because of race, color, creed, religion, sex, sexual preference, national origin, or mental or physical disability during the performance of this agreement. The Contractor will take affirmative action to ensure that applicants are employed, and that employees are treated during employment, in all employment practices such as the following: employment upgrading, demotion or transfer, recruitment, advertising, layoff or termination, rates of pay or other forms of compensation and selection for training, including apprenticeship, without regard to their race, color, creed, religion, sex, sexual preference, national origin or mental or physical disability. This provision will be inserted in all subcontracts, if any, for work covered by this agreement.
30. Equal Employment Opportunity (EEO) Clause
- During the performance of this contract, the Contractor agrees as follows:
- 1) The Contractor will not discriminate against any employee or applicant for employment because of race, color, religion, sex or national origin. The Contractor will take affirmative action to ensure that applicants are employed, and the employees are treated during employment without regard to their race, color, religion, sex or national origin. Such action shall include, but not be limited to the following: Employment, upgrading, demotion, or transfer; recruitment or recruitment advertising; layoff or termination; rates of pay or other forms of compensation; and selection for training, including apprenticeship. The Contractor agrees to post in conspicuous places, available to employees and applicants for employment, notices to be provided setting forth the provisions of this nondiscrimination clause.
 - 2) The Contractor will, in all solicitations or advertisements for employees placed by or on behalf of the Contractor, state that all qualified applicants will receive consideration for employment without regard to race, color, religion, sex or national origin.
 - 3) The Contractor will send to each labor union or representative of workers with which he has a collective bargaining agreement or other contract or understanding, a notice to be provided advising the said labor union or workers' representative of the Contractor's commitments under this section, and shall post copies of the notice in conspicuous places available to employees and applicants for employment.
 - 4) The Contractor will comply with all provisions of Executive Order 11246 of September 24, 1965, and of the rules, regulations and relevant orders of the Secretary of Labor.
 - 5) The Contractor will furnish all information and reports required by Executive Order 11246 of September 24, 1965, and by rules, regulations and orders of the Secretary of Labor, or pursuant thereto, and will permit access to his books, records and accounts by the administering agency and the Secretary of Labor for purposes of investigation to ascertain compliance with such rules, regulations and orders.
 - 6) In the event of the Contractor's noncompliance with the nondiscrimination clauses of this contract or with any of the said rules, regulations, or orders, this contract may be canceled, terminated or suspended in whole or in part and the contractor may be declared ineligible for further Government contracts or federally assisted construction contracts in accordance with procedures authorized in Executive Order 11246 of September 24, 1965, and such other sanctions may be imposed and remedies invoked as provided in Executive Order 11246 of September 24, 1965, or by the rule, regulation, or order of the Secretary of Labor, or as otherwise provided by law.

- 7) The Contractor will include the portion of the sentence immediately preceding paragraph (1) and the provisions of paragraphs (1) through (7) in every subcontract or purchase order unless exempted by rules, regulations, or orders of the Secretary of Labor issued pursuant to Section 204 of Executive Order 11246 of September 24, 1965, so that such provisions will be binding upon each subcontractor or vendor. The Contractor will take such action with respect to any subcontract or purchase order as the administering agency may direct as a means of enforcing such provisions, including sanctions for noncompliance. Provided, however, that in the event a Contractor becomes involved in, or is threatened with litigation with a subcontractor or vendor as a result of such direction by the administering agency the contractor may request the United States to enter into such litigation to protect the interests of the United States.
31. In the event of the Contractor's noncompliance with this equal opportunity clause or with any of the said rules, regulations, or orders, this contract may be canceled, terminated, or suspended in whole or in part and the Contractor may be declared ineligible for further contracts in accordance with procedures authorized in Presidential Executive Order 11246, or by rule, regulations, or order of the Secretary of Labor or as provided by law.
32. The following applies to all contracts of \$10,000,000.00 or more: SECTION 402 VETERANS OF THE VIETNAM ERA. AFFIRMATIVE ACTION FOR DISABLED VETERANS AND VETERANS OF THE VEITNAM ERA. The Contractor will not discriminate against any employee or applicant for employment because he or she is a disabled veteran of the Vietnam era in regard to any position for which the employee or applicant for employment is qualified. The Contractor agrees to take affirmative action to employ, advance in employment and otherwise treat qualified disabled veterans and veterans of the Vietnam era without discrimination based upon their disability or veteran status in all employment practices such as the following: employment upgrading, demotion or transfer, recruitment, advertising, layoff or termination, rates of pay or other forms of compensation and selection for training, including apprenticeship.
33. No officer, employee or member of the Governing Body of the Municipality shall have any financial interest, direct or indirect, in this contract or the proceeds of this loan.
34. DOH retains the right to reject any or all bids or any part of any bid in part or in whole if deemed to be in the best interest of the project.
35. Substitutions of materials from that specified are only allowed on an approved/equal basis. The Contractor must submit written documentation of the substitute item or material for approval by the Owner and Program prior to making such substitution. Any items or material substituted by the Contractor without prior written approval of the Owner and Program will at the Contractor's expense be replaced if it is determined not to be equal to the item or material specified. Any surrounding, adjoining, or dependent items affected by replacement of the unequal substituted material shall also be replaced, reworked, and reinstalled at no cost to the Owner.
36. Bids shall contain prices for general categories of work and/or items as specified on the provided bid sheets. In the case of a mathematical error by the Contractor, the correct sum of the individual line items in the cost summary shall be the Contractor's bid.
37. All bids shall remain in effect for thirty (30) calendar days.
38. The Owner will supply all necessary power required by the Contractor at no additional cost to complete his work. Power shall be limited to the use of existing outlets and shall not exceed the existing capacity of the system. Power required over the capacity of the existing electrical system shall be the responsibility of the Contractor. Heating during construction shall be supplied by the Owner.
39. If any unseen or unknown asbestos related conditions arise during the work the Contractor shall stop all work immediately and notify the DOH of such.
40. OTHER PROVISIONS – LEAD BASED PAINT

For properties built before 1978, if the project will involve disturbing painted surfaces or cleaning up lead contaminated dust or soil, use certified renovation or lead abatement contractors and workers using lead-safe work practices and clearance examinations consistent with the more stringent of EPA's Renovation, Repair, and Painting Rule and HUD's Lead Safe Housing Rule. The Contractor shall comply with the requirements concerning lead-based paint contained in the Lead-Based Paint Poisoning Prevention Act (42 U.S.C. 4821-4846) as implemented by 24 CFR Part 35 and EPA's Repair Renovation, and Painting Rule at 40 CFR.80 Subpart E.

Any and all rehabilitation work under this Agreement will comply with the requirements of the Federal Lead-Based Paint Poisoning Prevention Act (42 U.S.C. 4831) which prohibits the use of lead-based paint in residential structures constructed or rehabilitated with Federal Assistance in any form.

The construction or rehabilitation of residential structures with assistance provided under this contract is subject to the final regulations "Requirements for Notification, Evaluation and Reduction of Lead-Based Paint Hazards in Federally owned Residential Property and Housing Receiving Federal Assistance." The regulation is at 24 CFR part 35. It implements sections 1012 and 1013 of the Residential Lead-Based Paint Hazard Reduction Act of 1992, Title X, of the Housing and Community Development Act of 1992. Sections 1012 and 1013 amend the Lead-Based Paint Poisoning Prevention Act of 1971.

Beginning April 22, 2010, the Contractor is required to have a certificate from a 6 hour EPA/HUD RRP lead remediation course.

41. The Contractor shall comply with the provisions of the immigration Reform and Control Act of 1986 effective and enforceable as of June 6, 1987 which Act makes unlawful the hiring for employment or subcontracting individuals failing to provide documentation of legal eligibility to work in the United States. The Contractor shall hold DOH, its agents and the Homeowner harmless for the failure to comply with the provisions of said Act.

Section 3

SECTION 00900
SPECIAL CONDITIONS

1. SPECIAL CONDITIONS DEFINITIONS

A. Where the Specifications refer to Owner, or the DOH this shall be construed to mean the Connecticut Department of Housing, 505 Hudson Street, Hartford, CT 06106. Its designated agent shall be referred to as the "Contracting Officer" in these specifications.

2. BIDDING REQUIREMENTS

A. Contractor shall contact the DOH regarding site visit questions. Contact should be by the telephone to:

Ms. Erma Esangbedo, Grants and Contracts Specialist
CDBG-Disaster Recovery Program
Connecticut Department of Housing
505 Hudson Street
Hartford, CT 06106
(860) 270-8152

B. Architectural questions on specifications and drawings are to be addressed to:

Mr. David Holmes, or Mr. Jason Pitts
Capital Studio Architects, LLC
1379 Main Street
East Hartford, CT 06108
Tel: (860) 289-3262
Fax: (860) 289-3163
Email: dholmes@capitalstudio.net, or jpitts@capitalstudio.net

3. SALES TAX

A. The DOH is **NOT** exempt from Connecticut Sales Tax. Other fees assessed by the State of Connecticut may be passed through to the contractor.

4. INSURANCE

A. No insurance shall be terminated by the Contractor without ten (10) days notice to the DOH.

B. All insurance companies shall be licensed and registered in the State of Connecticut.

5. INTERPRETATIONS OF DRAWINGS

A. Any questions or disagreements arising as to the true intent of this specification or the drawings, or the kind and quality of work required thereby, shall be decided by the Architect, whose interpretations thereof shall be final, conclusive, and binding on all parties.

B. In the case of disagreement between drawings and specifications, or within either document itself, the better quality, greater quantity, or more costly work shall be included in the contract price, and the matter referred to the Architect's attention for decision and/or adjustment.

C. If the disagreement between the drawings and specification cannot be resolved through

either A. or B. above, the specifications shall take precedence over the drawings.

6. VISITING THE SITE

A. Before submitting his final proposal, the Contractor shall examine the site of the proposed work to determine the existing conditions that may affect his work, as he will be held responsible for any assumptions made by him in regard thereto.

7. CONTRACTOR'S PROPOSAL

A. The Contractor's proposal and bid must cover all items on the drawings and in the specifications exactly as drawn and specified.

B. Proposals and bids that do not conform to drawings and specifications will not be accepted.

8. SUBSTITUTIONS

A. Substitutions of equipment or materials other than those indicated on the drawings or in the specifications, shall be limited to those approved in advance, in writing, by the Architect.

9. SUB-CONTRACTORS

A. All sub-contractors shall be subject to approval of the DOH and listed on the Form of Bid.

B. When requested by the DOH, the prospective contractors should submit a list with names, addresses, and telephone numbers of similar type projects previously completed.

10. LAWS, ORDINANCES, PERMITS AND FEES

A. The Contractor shall give all necessary notices, obtain all permits and pay for governmental taxes, fees, and other costs in connection with his work; file all necessary plans, prepare all documents and obtain all necessary plans, prepare all documents and obtain all necessary approvals of the Governmental departments having jurisdiction; obtain all required Certificates of Inspection for his work and deliver to the Architect before request for acceptance and final payment for the work. The DOH is not exempt from paying Building Permit Fees to the City of New Haven. The Contractor shall include for any and all State of Connecticut Department of Environmental Protection Permits in addition to all Local Permits.

11. APPROVALS

A. The materials, workmanship, design and arrangement of all work installed under the contract shall be subject to the approval of the Architect. If material or equipment is installed before it is approved, the contractor shall be liable for the removal and replacement, at no extra charge to the owner, if, in the opinion of the Architect, the material or equipment does not meet the intent of the drawings and specifications.

B. The words "approved equal" shall be understood to apply only to those items of equipment and material approved in advance by the Architect.

C. Equipment and materials that do not conform to the specifications or the previous paragraph will not be approved.

12. NON-SEGREGATED FACILITIES

A. By signing the bid, the bidder certifies that he does not maintain or provide for his employees any segregated facilities at any of his establishments, and that he does not permit his employees to perform their services at any location, or under his control, where segregated facilities are maintained. He certifies further that he will not maintain or provide for his employees any segregated facilities at any of his establishments, and that he will not permit his employees to perform their services at any location under his control where segregated facilities are maintained. The bidder agrees that a breach of this certification is a violation of the Equal Opportunity Clause in this Contract. As used in this certification, the term "segregated facilities" mean any waiting room, work areas, restrooms, restaurants and other eating areas, time clocks, locker rooms and other storage or dressing areas, parking lots, drinking fountains, recreation or entertainment areas, transportation, and housing facilities provided for employees which are segregated by explicit directive or are in fact segregated on the basis of race, color, religion, or national origin, because of habit, local custom or otherwise. He further agrees that (except where he has obtained identical certification from proposed sub-contractors for specific time periods) he will obtain identical certification from proposed sub-contractors prior to the award of sub-contracts exceeding \$10,000.00, which are not exempt from the provisions of the Equal Opportunity Clause; that he will retain such certifications in his files; that he will forward a notice to his proposed sub-contractors as provided in the Instruction to Bidders

13. JOB MEETINGS

- A. The contractor and others concerned with the project whose presence is necessary as determined by the DOH and/or the Architect shall attend job meetings when requested for the purpose of discussing and expediting the prosecution of the work.
- B. The schedule for meetings will be established by the DOH and/or the Architect.
- C. The proceedings of these meetings will be recorded by the DOH and/or the Architect; the contractor will be furnished a copy for his use and distribution as required.

14. DRAWINGS

A. Drawings are generally schematic and may differ to some degree from field conditions. Specifically, certain drawings may be opposite hand from actual conditions and/or requirements. All dimensions are \pm . The contractor shall ascertain for himself the actual field conditions and shall be fully responsible for the indicated, specified and required work as designated and/or implied.

15. SCHEDULE OF THE WORK

- A. The project area is tenant occupied. All work shall be carried out in such a manner so as to cause minimal interference with the use of the project by the tenant.
- B. Other work in progress concurrently with work under this contract shall be affected by the performance of this contract. Conformance with this provision shall be the responsibility of this contractor.
- C. The standard working hours shall be from 8:00 a.m., until 4:30 p.m., Monday through Friday. The Contractor shall confirm working hours with the Owner prior to starting the work. Holidays shall include those observed by the DOH and the State of Connecticut.

D. The contractor shall at all times, maintain the fire integrity of the structures and shall maintain, free and clear all exitways.

E. The Contractor is required to submit to the Architect, for approval, prior to commencement of the work, a Project Schedule which identifies the time frame and sequence of construction. The Contractor is to provide an updated Project Schedule with each Application for Payment.

F. The Contractor must provide the DOH 48 hours' notice prior to the start of work so the owner may provide notice to the tenants.

16. MATERIALS AND EQUIPMENT

A. New materials and equipment installed into existing work shall be compatible with the existing work.

B. The contractor shall advise the Architect before ordering and/or installing any materials and equipment if he disputes those items and/or methods specified, otherwise he shall take full responsibility for their performance and suitability.

17. STORAGE OF MATERIALS

A. Storage space for materials and equipment is limited, Property Owner must approve in advance the locations of stored materials and/or dumpster(s).

B. Equipment and materials stored on the project site is the full responsibility of the contractor.

18. TEMPORARY FACILITIES

A. The contractor shall provide and maintain an adequate office at the project site at his discretion. If provided, it shall be located as directed by the DOH. It shall be kept clean, have adequate light and ventilation.

B. The contractor shall provide and maintain telephone service for his own use. No telephone service is available at the sites.

19. TEMPORARY SERVICE

A. The Contractor may connect to water available at the project without payment to the Owner.

B. The Contractor may connect to the existing electrical service without payment to the Owner.

C. Fixtures, or other modifications, shall be the responsibility of the contractor.

20. SANITARY FACILITIES

A. Sanitary facilities are not available at the project site. The Contractor shall provide temporary facilities at the site for his workers, at his own expense. Coordinate final locations with the DOH project representative.

21. DEMOLITION

A. This work includes the furnishing of all labor, materials, equipment and services necessary for, and reasonable incidental to, completion of all Demolition, as required for the installation

of the work, whether or not listed below.

B. The Contractor shall be confirm with Property Owner if a dumpster shall be permitted to remain on site for the purpose of disposal of demolished materials and debris. Final location of the dumpster to be coordinated with the Property Owner.

22. SALVABLE MATERIALS

A. NO SALVABLE MATERIALS.

23. SHOP DRAWINGS AND SUBMITTALS

A. Prior to delivery of materials and equipment to the project site, submit five (5) copies of Shop Drawings or Submittals of each item for approval by the Architect.

B. Submittals shall consist of manufacturer's scale drawings, cuts or catalogs, including descriptive literature and complete characteristics of equipment showing dimensions, capacity, code compliance, motor and drive and testing, all as required for this project.

C. Architect may designate submittal of physical samples for approval on items where actual color, texture or other characteristics might not be adequately described by drawing or written material.

24. PROTECTION OF WORK AND PROPERTY

A. The contractor shall be responsible for the maintenance and protection of all equipment, materials and tools, supplied by him and stored or installed on the job site, from loss or damage of all causes, until final acceptance by the DOH.

B. The contractor shall be responsible for the protection of any finished work of other trades or existing buildings and tenant's property and damage or defacement by his operation and must remedy any such injury at his own expense.

C. It shall be the Contractor's responsibility to protect all parts of the existing site, all trees, roads, streets, sidewalks, driveways, plantings, landscaping, lawns and curbs against damage caused by trucks, etc., driving over them. If they are damaged, the Contractor without cost to the Owner shall replace them.

D. The building is owner occupied. The Contractor shall take the necessary precautions to protect work areas and debris from potential dangers. Clear paths of egress must be maintained from the building at all times.

25. ACCESSIBILITY

A. The Contractor shall install all work so that all parts required and readily accessible for inspection, operation, maintenance and repair. Minor deviations from the drawings may be made to accomplish this, but changes of magnitude shall not be made without prior written approval from the Architect.

26. SCAFFOLDING, RIGGING, HOISTING

A. The Contractor shall provide all scaffolding, rigging, hoisting and services necessary for

erection and delivery into the premises for all equipment and materials furnished, and remove same from premises when no longer required.

B. The Contractor shall coordinate in advance with the Owner the methods and locations for lifting of materials to the roof. The Contractor cannot assume that any existing site fixture can be temporarily removed or relocated during this construction process, this can only be discussed with the Owner after bids have been awarded.

27. GUARANTEE PERIOD

A. Refer to specific Sections of this project manual for warranty and guarantee periods.

28. FINAL PAYMENT REQUIREMENTS

A. Final Payment will not be approved until all items as outlined in Section 01700 have been completed.

B. All guarantees and warranties for new materials shall commence at date of written Final Acceptance of the Work, by the DOH, or its designated agent.

C. Upon completion of the project, the roofing manufacturer shall provide installation and material inspection warranties and certification of the roof system.

29. CLEAN UP

A. Project shall be cleaned daily or as required to keep project area free from rubbish and debris. Burning of rubbish shall not be allowed. All debris shall be removed from the site and deposited legally off-site.

B. Final clean up shall include all debris, stains, and other defacement caused by the work.

30. LIQUIDATED DAMAGES

A. In case of failure on the part of the contractor to complete the work within the time fixed in the Contract, or any extension thereof, the Contractor shall pay to the DOH as fixed, agreed and liquidated damages the sum of \$100.00 for each calendar day of delay.

31. HAZARDOUS MATERIALS

A. A hazardous material report has been completed by Eagle Environmental; this report is available within these Specifications, please refer to this report for handling, removal and disposal of all hazardous materials. It is the intention that this project's Scope of Work be completed in coordination with any hazardous materials encountered and be done within the quantities allowed, as specified by state and local authorities regulating abatement of these materials. If the Contractor suspects that certain building materials may contain hazardous materials, he shall notify the Architect in writing and the Architect will have the suspect materials tested.

32. CHANGE ORDERS

- A. For all change orders, the general contractor shall be allowed 10% for overhead, above the direct costs and 5% for profit, above the direct costs to be calculated at 15% total above direct costs, for work performed by the general contractor.

- B. For all change orders, the sub-contractors shall be allowed 10% for overhead, above the direct costs and 5% for profit, above the direct costs to be calculated at 15% total above direct costs, for work performed by the sub-contractor.

- C. For all change orders, the general contractor shall be allowed 5% for overhead, above the direct costs and 2-1/2% for profit, above the direct costs to be calculated at 7-1/2% total above direct costs, for work performed by the sub-contractor.

33. BUILDER'S RISK INSURANCE

- A. Item 36B of HUD General Conditions, Form 5370-A refers to Builder's Risk Insurance. It has been determined that the Builder's Risk Insurance is not required on this project.

34. OSHA REGULATIONS

- A. The contractor shall comply with all applicable State and Federal OSHA regulations.

- B. The contractor shall submit to the owner, a copy of the OSHA ten (10) hour construction safety and health card for each employee.

- C. The contractor shall maintain any and all required OSHA materials, on site, at all times.

35. CONTRACT PERIOD

- A. The Contract period will be Sixty (60) consecutive calendar days from day of "Notice to Proceed" until day of "Substantial Completion".

36. GENERAL CONDITIONS

- A. In the event a conflict between the Special Conditions and the General Conditions located in Section 2 of these Specifications occurs, the General Conditions shall take precedence.

END OF SECTION 00900

SECTION 01200
SUMMARY OF THE WORK

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and general provisions of the contract, including General and Special Conditions, and Division 1 Specification sections, apply to work specified in this section.

1.2 SUMMARY OF THE WORK

- A. The scope of this contract, Community Development Block Grant Disaster Recovery for the Owner Occupied Recovery and Rehabilitation Program for the Connecticut Department of Housing, **Project No. 2237 located at 181 Trumbull Avenue, Bridgeport, CT 06606..**

- B. Verbal Summary of the Work: Without force and effect on the requirements of the Contract Documents, the Base Bid work includes, but is not limited to the following:

1. Selective demolition.
2. Removal of all layers of existing asphalt shingle roofing systems down to existing roof sheathing.
3. Replace existing vent pipe boots.
4. Installation of new fiberglass based asphalt roof shingle system including ice and water shield, underlayment, trim and accessories.
5. Replacement of existing flashing systems, as indicated on the drawings.
6. Repair of existing chimney.
7. Installation of a new Radon Mitigation system.
8. Asbestos Abatement, Lead Based Paint and Microbial Remediation.

- C. Refer to Section 02080, 02090 and 02092 for Scope of Work, quantities and products required to accommodate the remediation of Hazardous Materials.

1.3 EXISTING CONDITIONS

- A. This project includes work which is affected by existing conditions. Existing conditions which may affect the Work may be discovered during the progress of the Work. Make adjustments in the work as required accommodating existing conditions. Where products are to be installed in existing construction, perform cutting, removal of old products (if applicable), installation of new products, rebuilding of adjacent construction, and other operations as required.

1. The Architect will issue prompt instructions when unanticipated conditions are encountered.
2. If unanticipated conditions are such as to impose a hardship on the Contractor as interpreted by the Architect, such as faulty structure which must be rebuilt, the Architect shall issue the appropriate change orders for approval by the DOH.
3. Make adjustments in the Work, other than those described in two above, without additional compensation.

- B. The Drawings do not attempt to show every item of existing work to be demolished and every item of repair required to existing surfaces. Perform work required to remove existing materials which are not to be saved and to restore existing surfaces to like-new condition.
1. If possible, repairs shall be indistinguishable from adjacent sound surfaces. Where it is impossible to achieve repairs which are indistinguishable from adjacent sound surfaces, notify the Architect, and proceed according to the Architect's instructions.

1.4 - USE OF PREMISES

- A. The following are in addition to requirements of the General and Special Conditions governing the Contractor's use of the premises.
1. Assume full responsibility for protection and storage of products stored on the premises.
 2. The Contractor shall have use of the premises between the hours of 8:00 a.m. and 4:30 p.m., Monday through Friday. It is during these hours that all work must take place. Additional hours must be approved in advance by the Owner.
 3. The Contractor shall not have use of the premises on holidays which the DOH is closed.
 4. The Contractor will have access to specific project site in accordance with the approved project schedule.
 5. Work on the building will not be allowed without providing the tenant 48 hour prior notice.

1.5 - REFERENCE STANDARDS

- A. Unless date is listed, reference to standard specifications shall mean latest edition of such specification legally adopted and published at the date the Contract is executed.
- B. Reference to technical society or organization is made in the project manual according to the following abbreviations:

A.A.M.A.	American Architectural Manufacturers Association
A.C.I.	American Concrete Institute
A.I.A.	American Institute of Architects
A.I.E.E.	American Institute of Electrical Engineers
A.I.S.C.	American Institute of Steel Construction
A.I.T.C.	American Institute of Timber Construction
A.N.S.I.	American National Standards Institute
A.P.A.	American Plywood Association
A.R.M.A.	Ashphalt Roofing Manufacturer's Association
A.S.H.R.A.E.	American Society of Heating, Refrigeration, and Air Conditioning Engineers
A.S.M.E.	American Society of Mechanical Engineers
A.S.T.M.	American Society of Testing Materials
A.W.I.	American Woodwork Institute
A.W.P.I.	American Wood Preservers Institute

A.W.S.	American Welding Society
C.H.F.A.	Connecticut Housing Finance Authority
C.P.S.C.	Consumer Products Safety Commission
C.S.I.	Construction Specification Institute
D.O.H.	Department of Housing
F.M.	Factory Mutual
F.S.	Federal Specification
H.U.D.	U.S. Department of Housing and Urban Development
I.B.C.	International Building Code
I.C.C.	International Code Council
I.R.C.	International Residential Code
I.S.D.S.I.	Insulated Steel Door Systems Institute
N.A.A.M.M.	National Association of Architectural Metal Manufacturers
N.B.F.U.	National Board of Fire Underwriters
N.B.S.	National Bureau of Standards
N.E.C.	National Electric Code
N.E.M.A.	National Electrical Manufacturers Association
N.F.P.A.	National Fire Protection Association
O.S.H.A.	Occupational Safety and Health Administration
S.I.G.M.A.	Sealed Insulating Glass Manufacturer's Association
S.M.A.C.N.A.	Sheetmetal and Air Conditioning Contractors National Association, Inc.
U.L.	Underwriters Laboratories, Inc.
W.W.P.A.	Western Wood Products Association

1.6 – FINAL PAYMENT REQUIREMENTS

- A. Final Payment will not be approved until all items as outlined in Section 01700 have been completed.
- B. All guarantees and warranties for new materials shall commence at date of written Final Acceptance of the Work, by the DOH, or its designated agent.
- C. Upon completion of the project, the roofing manufacturer shall provide installation and material inspection warranties and certification of the roof system.

1.7 - GENERAL INFORMATION

- A. The DOH is a governmental agency, but **is** responsible for paying sales tax. The Contractor shall assume that materials purchased for the use on this project shall be taxed.

1.8 - SCHEDULE

- A. Refer to Form of Contract for completion date.

PART 2 - PRODUCTS

NOT USED

PART 3 - EXECUTION

NOT USED

END OF SECTION 01200

SECTION 01270

UNIT PRICES

PART 1 - GENERAL

1.1 SUMMARY

- A. This Section includes administrative and procedural requirements for Unit Prices.
- B. Refer to other specification sections for specific requirements for this work.
- C. Enter Unit Price amounts on the enclosed Bid Form.

1.2 DEFINITIONS

- A. Unit price is an amount proposed by bidders, stated on the Bid Form, as a price per unit of measurement for materials or services added to or deducted from the Contract Sum by appropriate modification, if estimated quantities of Work required by the Contract Documents are increased or decreased.

1.3 PROCEDURES

- A. Unit prices include all necessary material, plus cost for delivery, installation, insurance, applicable taxes, overhead, and profit.
- B. Measurement and Payment: Refer to individual Specification Sections for work that requires establishment of unit prices. Methods of measurement and payment for unit prices are specified in those Sections.
- C. Owner reserves the right to reject Contractor's measurement of work-in-place that involves use of established unit prices and to have this work measured, at Owner's expense, by an independent surveyor acceptable to Contractor.
- D. List of Unit Prices: A list of unit prices is included in Part 3. Specification Sections referenced in the schedule contain requirements for materials described under each unit price.

PART 2 - PRODUCTS (Not Used)

PART 3 - EXECUTION

- A. Refer to drawings for details and locations for Unit Price work.

3.1 LIST OF UNIT PRICES

A. Unit Price No. 1 – Up to 3/4" Plywood Roof Sheathing (match existing)

1. Condition – Existing roof sheathing is a combination of 3/4" plywood and plank boards. Contractor shall verify in field, the thickness of all deteriorated sheathing that shall be removed and replaced.
2. Description – Install new 3/4" CDX plywood sheathing for the following:
 - a. Rotted roof sheathing being replaced.
 - b. Infill plywood at existing ridge vent cut-outs where deteriorated.
 - c. Existing openings for roof mounted attic vents being removed.
3. Unit of measure – Per square foot.

B. Unit Price No. 2 – Wood Fascia

1. Condition – Areas where the existing wood fascia is deteriorated, provide new wood fascia to match existing and prime and paint, two finish coats.
2. Unit of measure – Per linear foot.

C. Unit Price No. 3 – Wood Trim.

1. Condition – Areas where the existing wood trim is deteriorated, provide new wood trim to match existing and prime and paint, two finish coats.
2. Unit of measure – Per linear foot.

D. Unit Price No. 4 – Wood Soffit.

1. Condition – Areas where the existing wood soffit is deteriorated, provide new wood soffit to match existing and prime and paint, two finish coats.
2. Unit of measure – Per linear foot.

E. Unit Price No. 5 – Up to 2x10 Wood Roof Framing (match existing)

1. Condition – Areas where the existing wood roof framing is deteriorated, provide new wood roof framing to match existing.
2. Unit of measure – Per linear foot.

END OF SECTION 01270

SECTION 01300
DEMOLITION

PART 1 - GENERAL

1.1 - RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Special Conditions, and Division 1 Specification sections, apply to work specified in this section.

1.2 – RELATED WORK SPECIFIED ELSEWHERE

- A. Environmental Remediation is specified in Division 2.

1.3 - GENERAL REQUIREMENTS

A. "Demolition" denotes razing and removal of materials or portions of existing structures, installations and obstructions shown on Drawings or specified to be removed from the site, and includes taking possession of and removing from the site, all material, equipment and debris resulting from demolition work except as otherwise specified herein. Burning of materials on the site will not be permitted.

B. Upon completion remove all tools, equipment, temporary structures (if any) and installations and rubbish of every sort. Leave site in a level and orderly condition and the surrounding area in a broom-clean condition.

C. It is the responsibility of the Contractor to coordinate any demolition work with any general construction work and the work of other trades. The demolition work must be phased accordingly.

D. Provide any temporary weather protection which may be required as a result of demolition work.

1.4 - EXISTING PUBLIC SPACES

- A. Protect existing services indicated to remain on the site. Replace and/or repair services damaged as a result of demolition work, at no expense to the Owner.

PART 2 - PRODUCTS
NOT USED

PART 3 - EXECUTION

3.1 - SCOPE

A. Portions of structures, installations and obstructions to be demolished are as shown on the Contract Drawings and, in general but not necessarily limited to, those items as listed below:

1. Removal of existing asphalt shingle roofing systems, including vent stack boots.
2. Removal of existing deteriorated wood sheathing.
3. Removal of existing flashing systems, as indicated on the drawings.
4. Removal of existing masonry chimney to below roof line.

B. Demolition work shall not be limited to the above listing. The removal, relocation, or replacement of any item(s) by a trade as may be required (1) to complete the indicated scope of work or (2) to accomplish the intended result may require demolition work not specifically listed or shown on the Drawings. All such requirements shall be considered part of this work.

C. Demolition work involves the removal of hazardous wastes. Refer to the appropriate environmental remediation specifications for additional requirements.

1. Asbestos Abatement is specified in Section 02080.
2. Lead based Paint Abatement is specified in Section 02090.
3. Water and Mold Remediation is specified in Section 02092.

3.2 - PROTECTION

A. It shall be the Contractor's responsibility to protect all parts of the existing site, all trees, roads, streets, sidewalks, driveways, plantings, landscaping, lawns and curbs against damage caused by trucks, etc., driving over them. If they are damaged, the Contractor without cost to the Owner shall replace them.

B. Do not close or obstruct means of egress in connection with the work. Materials and debris shall not be placed or stored in egress paths. Conduct operations so as to interfere as little as possible with normal activities.

END OF SECTION 01300

SECTION 01400
SUBMITTALS

PART 1 - GENERAL

1.1 - RELATED DOCUMENTS

A. Drawings and general provisions of the Contract, including General and Special Conditions, and Division 1 Specification sections, apply to work specified in this section.

1.2 - RELATED REQUIREMENTS SPECIFIED ELSEWHERE

A. Substitutions and product options are indicated in Section 00900 of the Special Conditions.

B. Materials and methods requiring submittals are listed, where applicable, within each respective section of this specification.

1.3 IDENTIFICATION

A. Identify each submittal with the following information:

1. Date and revision date(s).
2. Project title.
3. The names of: Architect, Contractor, subcontractor supplier, manufacturer or separate detailer when pertinent.
4. Identification of products, materials and finishes.
5. Relation to adjacent structure or material.
6. Field dimensions, clearly identified as such.
7. The specification section number, and applicable standards, such as ASTM or FS number.
8. Quantities.
9. Blank spaces, 4" x 4 1/2" each, for the Architect's stamp, and Consultant's stamp where applicable.
10. Identification of deviations from Contract Documents.
11. Contractor's stamp, initials or signed, certifying to review of submittal, the verification of the field measurements and quantities, and compliance with Contract Documents.

B. Accompany the submittals with a transmittal letter containing:

1. Date.
2. Project Title and H.U.D. number (where applicable).
3. Contractor's name and address.
4. The number and name of each item submitted.
5. Notification of deviations from Contract Documents.

1.4 - SHOP DRAWINGS

A. Provide the following information, where applicable, on all shop drawings:

1. All necessary dimensions. Dimension work illustrated by shop drawings to fit actual field conditions.
2. Sufficient detailing to show appearance, method of assembly or fabrication, and the

- method of installation or erection.
3. Identification of details by reference to sheet and detail number shown on Contract Drawings.

1.5 - PRODUCT DATA

- A. Manufacturer's standard schematic drawings which are:
 1. Modified to delete any information which is not applicable to the Project.
 2. Supplemented to provide any additional information applicable to Project.
- B. Manufacturer's catalog sheets, brochures, diagrams schedules, performance charts, illustrations and other standard descriptive data.
 1. Clearly mark each copy to identify the pertinent materials, products, or models.
 2. Show dimensions and clearances required.
 3. Show performance characteristics and capacities.
 4. Show wiring diagrams and controls.
- C. Test reports performed by independent testing agencies for manufacturer. On test reports list:
 1. System, material or work tested.
 2. Test results and witnesses.
 3. Description of correction of faults.

1.6 - SAMPLES

- A. Samples shall be of sufficient size and quantity to clearly illustrate:
 1. Functional characteristics of product or material, with integrally related parts and attachment devices.
 2. Full range of color samples.
 3. After the review, approved samples may be used in construction of Project, where appropriate.

1.7 - SUBMISSION REQUIREMENTS

- A. Submit to the Architect all shop drawings, product data and samples required by the specification sections.
- B. Schedule submissions at least 10 working days before dates reviewed submittals will be needed.
- C. Submit six (6) bond copy prints of each shop drawing.
- D. Submit six (6) copies each of all product data.
- E. Submit two each of required samples unless a greater number is specified or requested by the Architect.
- F. Submit samples with delivery charges prepaid. Samples delivered in damaged condition may not be acceptable, and may have to be resubmitted, to Architect's discretion.

G. The Architect may, at his discretion, request submittals in addition to those specified.

1.8 - RESUBMISSION REQUIREMENTS

A. Shop Drawings:

1. Revise the initial drawings as required by General Conditions, and resubmit as specified for initial submission.
2. Indicate on drawings any changes which have been made other than those requested by Architect.

B. Product data and Samples: Submit new data and samples as required for initial submission.

1.9 - ARCHITECT'S DUTIES

A. Architect's responsibilities for processing submittals are defined in General Conditions.

B. Architect is not responsible for verifying quantities, dimensions, field measurements, or coordination of work of different trades. Architect's review of submittals shall not be construed to include or imply any such verification.

1.10 - CONTRACTOR'S DUTIES

A. In addition to requirements of the General Conditions,

1. Contractor shall be responsible for obtaining and distributing prints of shop drawings after, as well as before final approval, to all parties, including, but not limited to the Housing Authority, H.U.D. (where applicable), subcontractors and suppliers.
2. Prints of approved shop drawings shall be made from sepia transparencies which carry the Architect's and Consultant's stamp of approval.
3. Begin no work which requires shop drawings and product data unless the approved and stamp shop drawings and product data are on file at the job site.

B. The Contractor shall submit one (1) Submittal Package, which shall include all items required to complete any type, which shall be the basis of all units completed for the contract period, subject to any design changes which may result out of execution of the work.

END OF SECTION 01400

SECTION 01500
CUTTING AND PATCHING

Part 1 - GENERAL

1.1 - RELATED DOCUMENTS

A. Drawings and general provisions of the Contract, including General and Special Conditions, and Division 1 Specification sections, apply to work specified in this section.

1.2 - DESCRIPTION

A. Definition: "Cutting and Patching" is hereby defined to include, but not necessarily limited to the cutting and patching of nominally completed and previously existing work, in order to accommodate the coordination of work, or the installation of other work, or to uncover other work for access or inspection, or to obtain samples for testing, or for similar purposes; and is defined to exclude integral cutting and patching during manufacturing, fabricating, erecting and installing process for individual units of work.

B. Demolition is recognized as an example of a related, but separate category of work, which may or may not also require cutting and patching as defined in this Section. Refer to Section 01300.

1.3 - QUALITY ASSURANCE

A. Requirements for Structural Work:

1. General: Do not cut and patch structural work in a manner resulting in a reduction of bearing capacity or load/deflection ratio.

2. Call for a structural inspection, and/or obtain the Architect's approval prior to cutting and patching any of the following:

- a. Bearing Walls.
- b. Structural decking and roof or floor systems.
- c. Exterior wall construction.
- d. Pressurized piping, vessels and equipment.

B. Visual requirements: Do not cut and patch work which is exposed on the exterior or exposed in occupied spaces of the building in a manner resulting in a reduction of visual qualities or resulting in substantial evidence of cutting and patching work, both as judged solely by the Architect. Remove and replace work judged by the Architect as having been cut and patched in a visually unsatisfactory manner.

1.4 - SUBMITTALS

A. Requests for Architect's Consent:

1. Prior to cutting and patching of structural elements, submit written request to the Architect for permission to proceed with cutting.
2. Should conditions of the Work, or schedule indicate a required change of materials or methods for cutting and patching, so notify the Architect and secure his written permission and the required Change Order prior to proceeding.
3. Cutting and patching of deteriorated materials listed in the Bid Form as Unit Prices, may proceed without the Architect's prior approval, however, the Contractor shall document the quantity, location and date of materials replaced. The Contractor shall be compensated for this additional work based on the unit price established and the quantities replaced pursuant to Change Orders, and in accordance with Item 2.2 of this Section.

B. Notices to the Architect:

1. Prior to cutting and patching performed pursuant to the Architect's instructions, submit cost estimate to the Architect. Secure the Architect's approval of cost estimates and type of reimbursement before proceeding with cutting and patching.
2. Submit written notice to the Architect designating the time the work will be uncovered, to provide for the Architect's observation.

C. Approval by the Architect to proceed with proposed cutting and patching does not waive the right to later require complete removal and replacement of work found to be cut and patched in an unsatisfactory manner.

Part 2 - PRODUCTS

2.1 - MATERIALS

A. For replacement of items removed, use identical materials to those being removed, or materials complying with the various Sections of these Specifications, as appropriate. The end result of the cutting and patching operation shall result in equal or better work than the work being cut and patched, in terms of performance characteristics and including visual effects where applicable.

2.2 - PAYMENT FOR COSTS

A. Perform cutting and patching needed to comply with the Contract Documents at no additional cost to the Owner. The Owner will reimburse the Contractor for cutting and patching performed pursuant to written Change Orders, after claim for such reimbursement is submitted by the Contractor, and approved in advance by the Architect.

PART 3 - EXECUTION

3.1 - INSPECTION

A. Inspection:

1. Inspect existing conditions, including elements subject to movement or damage during cutting and patching.

2. After uncovering the work, inspect conditions affecting installation of new work.

B. Discrepancies:

1. If uncovered conditions are not as anticipated, immediately notify the Architect and secure needed directions.

2. Do not proceed until unsatisfactory conditions are corrected.

3.2 - PREPARATION

A. Provide adequate temporary support including, but not necessarily limited to shoring and bracing to maintain structural integrity of the Work. Do not endanger other work.

B. Provide adequate protection of other work during cutting and patching, to prevent damage. Provide protection of the Work from adverse weather exposure.

3.3 CUTTING AND PATCHING

A. Perform cutting and patching as required under pertinent other Sections of these Specifications.

B. Employ skilled tradesmen to perform all cutting and patching. Proceed with cutting and patching at the earliest feasible time, in each instance, and perform the work promptly.

C. Patch with seams which are durable and as invisible as possible. Perform fitting and adjusting of products to provide finished installation complying with the specified tolerances and finishes.

D. Select systems that adequately resist racking and provide acceptable deflection under live and dead loads. Reinforce to prevent cracking. Inspect and test patched areas to demonstrate integrity of work.

E. In all cases of repair and renovation, restore exposed finishes of patched areas and where necessary, extend finished restoration onto retained work adjoining, in a manner which eliminates evidence of patching.

END OF SECTION 01500

SECTION 01700
PROJECT CLOSEOUT

PART 1 - GENERAL

1.1 - RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Special Conditions, and Division 1 Specification sections, apply to work specified in this section.

1.2 - GENERAL

- A. The following requirements supplement those of the General Conditions.

1.3 - CLEANING

- A. Hazard Control:
1. Store all volatile wastes in covered non-flammable containers.
 2. Prevent accumulation of wastes, which create hazardous conditions.
 3. Provide adequate ventilation during use of volatile or noxious substances.
- B. Conduct cleaning and disposal operations to comply with local ordinances and anti-pollution laws.
1. Do not burn or bury any rubbish and waste materials on project site.
 2. Do not dispose of volatile wastes such as mineral spirits, oil or paint thinner in the storm or sanitary drains. Dispose of legally off the site.
 3. Do not dispose of wastes in streams or waterways.
 4. Dispose of demolition and waste materials, debris and rubbish legally off the site.
- C. During construction, in addition to cleaning required by the General Conditions, perform the following:
1. Keep building, grounds, and public properties free from accumulations of waste materials and rubbish.
 2. Provide on-site containers for the collection of all waste materials, all debris and rubbish. Dispose of waste materials, debris and rubbish at reasonable intervals, legally off the site.
- D. At completion, for the purposes of final acceptance, in addition to leaving the work clean as required by General Conditions, perform the following:
1. Clean site and clean up any debris or dirt off site, which resulted from work under this contract, and dispose of legally off the site.
 2. When workmen call back for "punch list" or guarantee work, clean up afterwards.

1.4 – PREREQUISITES TO SUBSTANTIAL COMPLETION

- A. General: Prior to requesting Certification Inspection for Substantial Completion, (for either entire work or portions thereof), complete the following and list know exceptions in the request.
- B. Submit written notice to Architect that Project, or a designated portion of Project, is complete, as required by General Conditions, and that the following items have been completed:
1. Contract documents have been reviewed.
 2. Project has been inspected for compliance with Contract Documents.

3. Work has been completed in accordance with Contract Documents and ready for inspection.
 4. Equipment and systems have been tested in presence of Owner's representative and are operational.
 5. Submission to the owner all required operating manuals, warranties and documentation.
 6. Request that Architect review the work completed.
 7. Submit payment request showing 100% completion for portion of work claimed as "substantially complete", or list the incomplete items, value of incomplete items, time to complete those items and reason for the incompleteness. Include supporting documents as required.
 8. Removal from the project site temporary facilities and services, along with construction tools and mock-ups.
- C. Inspection Procedures: Upon receipt of the Contractor's request for Substantial Completion Certification Inspection, the Architect will either proceed with the inspection or advise the Contractor of prerequisites not fulfilled. Following initial inspection, the Architect will note Substantial Completion or advise Contractor of work that must be performed and repeat inspection when requested and assured that work has been substantially completed. Results of completed inspection will form initial "punch-list" for final acceptance.
- D. Re-inspection Procedures: The Architect will re-inspect work upon receipt of notice from the Contractor that the work has been completed. The Architect will bill the owner directly for punch list items not accepted after the second inspection and requiring additional inspection. The dollar amount is to be agreed to with the owner. This amount is to be deducted from final payment to Contractor.
- E. When the Architect certifies that the Work is substantially complete, the Contractor shall immediately do the following:
1. Obtain Certificate of Occupancy, if required.
 2. Prepare and submit Closeout documents.

1.5 – PREREQUISITES TO FINAL ACCEPTANCE

- A. Prior to requesting Final Inspection for Certification of Final Acceptance and Final Payment as required by the General Conditions the following items must have been completed and/or submitted to the Owner or Owner's Representative:
1. Record Documents and related record information as outlined below.
 2. Submit final payment request with final releases and supporting documentation not previously submitted and accepted.
 3. Submit copy of final punch-list of itemized work to be completed or corrected, stating that each item has been completed or otherwise resolved for acceptance.
 4. Deliver tools, spare parts, extra stocks of materials, and similar physical items.
 5. Operation and Maintenance Data.
 6. The guarantees, warranties and bonds.
 7. Parts and Maintenance Materials.
 8. Complete final clean-up requirements, including touch-up painting of marred surfaces.
 9. Evidence of Compliance with requirements of governing authorities, including:
 - a. Certificate of Occupancy, if required.
- B. Send Closeout submittals to Owner with transmittal letter in duplicate containing the following:

1. Date
2. Project title and number.
3. Contractor's name and address.
4. Certification that each Project Record Document, as submitted is complete and accurate.
5. Signature of the Contractor, or his authorized representative.

1.6 - RECORD DOCUMENTS

- A. As work progresses prepare and maintain record documents as specified below, including amendment and change order drawings, these shall be referred to as "Record Documents." Do not use record documents for construction purposes; protect from deterioration. The Contractor shall keep an up to date copy of all documents and have accessible to the Architect for reference during working hours. Upon completion of project turn record documents over to Owner.
1. Record Drawings: Maintain one (1) print set of contract drawings in clean, undamaged condition, with mark-up of actual installations which vary from the work as originally shown. Give particular attention to concealed work, which would be difficult to measure and record at a later date.
 2. Record Specifications: Maintain one (1) copy with mark-up of variations in actual work from that specified. Give particular attention to substitutions, option selections, etc.
 3. Record Shop Drawings: This includes Product Data, Certifications and Laboratory Test Reports: Maintain one (1) copy of each approved shop drawing and product data submittal, certification or report. Show all shop drawing items on the Record Drawings where the shop drawing item caused a change in the contract documents.

1.7 – OPERATION AND MAINTENANCE MANUALS

- A. Provide operation and maintenance manuals for each system or piece of equipment specified. Organize information into binder form with a table of contents and tabbed sections. The cover of the binder should read "Operations and Maintenance Manual" it should list the name of the project and project number and date of completion. The Manual's contents should include, but not be limited to the following:
1. Description of each system.
 2. Installation instructions.
 3. Maintenance instructions.
 4. Emergency instructions and safety requirements.
 5. Corrected shop drawings.
 6. Approved product data and system test procedure.
 7. Copies of approved certifications and laboratory test reports.
 8. Copies of Warranties.
 9. Parts list, including source of supply.
 10. Name, Address, and Phone number of each subcontractor who installed equipment and local system representative.

PART 2 - PRODUCTS
NOT USED

PART 3 - EXECUTION
NOT USED

END OF SECTION 01700

SECTION 020800
ASBESTOS ABATEMENT

PART 1 GENERAL

1.1 GENERAL PROVISIONS

- A. The structure located at 181 Trumbull Avenue, Connecticut is scheduled for renovation. The site building consists of two story wood framed structure. Asbestos abatement work will be performed to accommodate the renovation of the existing building.
- B. The work is being performed under the State of Connecticut Department of Housing Community Development Block Grant - Disaster Recovery Program (Program). Asbestos containing material (ACM) testing has identified materials that contain asbestos and will require removal prior to the work. The work covered in this section includes the minimum procedures that shall be employed during abatement of the ACM.
- C. The exterior aluminum storm window caulk is known to contain asbestos. Abatement of the storm window caulk is required on each window that will be repaired or replaced. The storm windows shall be cleaned of residual caulk and re-installed by the Asbestos Abatement Contractor (AAC). Caulk on the window casings/frames shall be removed in its entirety.
- D. Peter J. Folino of Eagle Environmental, Inc. is the designer of this Specification. Mr. Folino is a State of Connecticut Department of Public Health (CTDPH) Licensed Asbestos Project Designer (License #000195).

1.2 RELATED DOCUMENTS

- A. Drawings and General Provisions of the Owner Contractor Agreement and the General Conditions of the contract apply to this Section.
- B. Architect's Specifications
- C. Environmental Assessment Report Dated September 4, 2014
- D. Specification 020900 Lead-Based Paint Abatement
- E. Specification 020920 Microbial Remediation
- F. Specification 020940 Radon Mitigation

1.3 DESCRIPTION OF WORK

- A. The work includes filing and permitting all necessary applications, notifications, requirements and fees; insurance; necessary design services; providing skilled, licensed and certified labor; materials; and equipment necessary for proper preparation, handling, removal and legal disposal of the specified asbestos-containing materials in accordance with all requirements of applicable Federal, State and local regulations.
- B. The Asbestos Abatement Contractor (AAC) is responsible for reviewing the Architect's specifications to determine the extent of asbestos abatement work necessary to support the overall renovation work of the project. Refer to the Environmental Assessment Report for a list of known ACM's that will potentially be impacted by the renovation work.

- C. The AAC is responsible for the removal of ACM that will be impacted by the renovation work only. In some instances, ACM may be present but may not be impacted by the renovation work. It is the sole responsibility of the AAC to review the Architects specifications to determine the full extent of asbestos abatement.
- D. Under the base bid work, the AAC shall be responsible for removal and disposal of the following estimated quantities of asbestos containing materials.
 - 1. Asbestos-containing caulk (exterior) associated with aluminum storm windows (245 LF) .
- E. There is water and power available at the site. The AAC shall verify that the power and water sources are sufficient to support the work. Any additional fees associated with temporary power and water shall be borne by the AAC.

1.4 QUALITY ASSURANCE

- A. For regulated ACM, the AAC shall be licensed by the State of Connecticut Department of Public Health to perform asbestos abatement.
- B. The Asbestos Abatement Supervisor(s) and Asbestos Abatement Workers shall be accredited in accordance with EPA regulation 40 CFR Part 763, subpart E, Appendix C; and shall be licensed by the State of Connecticut Department of Public Health.
- C. Removal of exterior non-friable materials shall not render the material friable during the removal procedure.
- D. All asbestos-containing waste shall be properly disposed of at an authorized landfill.

1.5 APPLICABLE CODES

- A. The AAC shall be solely responsible for conducting this project and supervising all work in a manner that will be in conformance with all federal, state and local regulations and guidelines pertaining to asbestos abatement. Specifically, the AAC shall comply with the requirements of the following:
 - 1. USEPA AHERA Regulation (40 CFR 763 Final Rule and Notice);
 - 2. NESHAP Regulations (40 CFR 61, Subpart M);
 - 3. OSHA Asbestos Regulations (29 CFR 1910.1001 and 1926.1101);
 - 4. Connecticut DEP Regulations (Section 22a-209-8 (I) and Section 22a-220 of the Connecticut General Statutes);
 - 5. Connecticut DPH Standard for Asbestos Abatement Sections 19a-332-1 to 19a-332-16;
 - 6. Licensure and Training Requirements Section 20-440-1 to Section 20-440-9;
 - 7. Connecticut Basic Building Code;
 - 8. Connecticut Fire Safety Code;
 - 9. Local health and safety codes, ordinances or regulations pertaining to asbestos remediation and all national codes and standards including ASTM, ANSI, and Underwriter's Laboratories.

1.6 EXEMPTIONS

- A. This project was designed by a licensed State of Connecticut Department of Public Health Asbestos Abatement Designer (Peter J. Folino – license No. 000195). Any deviation from these specifications requires the written approval and authorization from the Owner.

- B. The designer must be notified in writing by the Program's Consultant that a change in scope is required to achieve the desired end results for the project. The designer in turn will assess the requested change and will issue a written approval for the change in the scope of work.

1.7 EXAMINATION OF CONTRACT DOCUMENTS AND SITE

- A. The AAC shall carefully examine and read and review all aspects of the Contract Documents and visit the site of work to become familiar with the existing site conditions.
- B. All work called for in the Contract Documents but not shown on the Contract Drawings in their present form, or visa versa, is required, and shall be performed by the AAC as though it were originally delineated or described.
- C. Work not particularly specified in the Contract Documents, but involved in carrying out their intent or in the complete and proper execution of work, is required pursuant to this Contract and shall be performed by the AAC.
- D. The apparent silence of the Contract Documents as to any detail, or the apparent omission from the Contract Documents of a detailed description concerning any work to be done and materials to be furnished, shall be interpreted to mean that only the best practice of the industry is to prevail and that only the best materials and workmanship is to be used.
- E. Should any conflict occur in or between the Contract Drawings, Specification and/or other elements of the Contract Documents, the AAC shall be deemed to have estimated on the most expensive way of performing the work unless the AAC shall have asked for and obtained a decision in writing from the Owner's Representative before the submission of its bid as to which shall govern.

1.8 INDEMNIFICATION

- A. The AAC and its subcontractors shall indemnify and hold harmless the Owner and the Owner's Representative, and their directors, officers, agents, employees and consultants from and against all claims, damages, losses, liabilities and expenses, out of or resulting from the performance of the work specified herein.

1.9 NOTIFICATIONS, POSTINGS AND PERMITS

- A. The AAC will make the following notifications, and provide the submittals to the following agencies ten (10) days prior to the commencement of work where regulated ACM will be removed:

Chief, Environmental Health Services
Department of Public Health
Division of Environmental Health
450 Capitol Ave., P.O. Box 340308
Hartford, CT 06134-0308

- B. The minimum information included in the notification includes:
 - 1. Name and address of building owner/operator
 - 2. Building location
 - 3. Building size, age, and use
 - 4. Amount of friable asbestos
 - 5. Work schedule, including proposed start and completion date
 - 6. Asbestos removal procedures to be used

7. Name and location of disposal site for generated asbestos waste, residue, and debris

1.10 WORK SITE SAFETY PLAN

- A. The AAC shall establish a set of emergency procedures and shall post them in a conspicuous place at the work site. The safety plan should include provisions for the following:
1. Evacuation of injured workers.
 2. Emergency and fire exit routes from all work areas.
 3. Emergency first aid treatment.
 4. Local telephone numbers for emergency services including ambulance, fire, and police.
 5. A method to notify workers in the event of a fire or other emergency requiring evacuation of the building.
 6. Confined space entry program.
 7. 24 hour site security program.
- B. The AAC is responsible for training all workers in these procedures.

1.11 ALTERNATE WORK PRACTICES (AWP)

- A. Any modification from the standard work practices identified in the State of Connecticut DPH Standard for Asbestos Abatement Section 19a-332a-1 to 19a-332a-16 must be requested in writing to the State DPH.
- B. No AWP has been approved for this project.

1.12 REOCCUPANCY CLEARANCE

- A. The Program shall be responsible for payment of the sampling and analysis of initial final air clearance samples only. The AAC shall be responsible for payment of all costs associated with the collection and analysis of additional final air clearance samples for areas that failed the initial test.
- B. Phase Contrast Microscopy (PCM) air samples will be analyzed on a twenty - four hour turn around. Transmission Electron Microscopy (TEM) air samples will be analyzed on a twenty-four hour turn around time.
- C. Re-occupancy air clearance sampling is not required for exterior removal work of non-friable ACM. A final visual inspection of the exterior work area(s) shall be performed by a State of Connecticut licensed Asbestos Project Monitor at the completion of exterior removal work.

1.13 CONTROL OVER REMOVAL WORK

- A. All AAC work procedures shall be monitored by the AAC's "competent person" to ensure that areas outside the designated work locations do not become contaminated. The following controls shall be implemented each working day to help ensure this:
1. Prior to work on any given day, the AAC's designated "competent person" shall evaluate job tasks with respect to safety procedures and requirements specified to prevent contamination of the building or the employees. This includes a visual survey of the work area and the decontamination enclosure systems.
- B. The AAC shall maintain control of and be responsible for access to all work areas to ensure the following requirements:

1. Nonessential personnel are prohibited from entering the area;
2. All authorized personnel entering the work area shall sign the work area entry log;
3. All authorized personnel entering the work area shall read the "worker protection procedures" which are posted at the entry points to the enclosure system, and shall be equipped with properly fitted respirators and protective clothing;
4. All personnel who are exiting from the decontamination enclosure system shall be properly decontaminated;
5. Asbestos waste that is taken out of the work area must be properly bagged and labeled in accordance with these specifications. The surface of the bags shall be decontaminated. Asbestos leaving the enclosure system must be transported off site or immediately placed in locked, posted temporary storage on site, and be removed within 24 hours of the project conclusion.
6. Any material, equipment, or supplies that are brought out of the decontamination enclosure system shall be cleaned and decontaminated by wet cleaning and/or HEPA vacuuming of all surfaces.

1.14 SITE SECURITY

- A. The AAC shall be responsible for the security of regulated areas. Post asbestos abatement warning signs at entrances to the work area including the waste loadout and worker decontamination chamber. The AAC shall have an outside supervisor monitoring the entrance of the worker decontamination chamber during abatement work.
- B. The AAC shall be responsible for the security of exterior regulated areas. Post asbestos abatement warning signs at ten (10) foot intervals around the exterior work zone. Construct the exterior regulated work area with warning tape secured with stakes.

1.15 CONTRACTOR'S AIR SAMPLING RESPONSIBILITY

- A. The AAC shall monitor airborne asbestos concentrations in the workers' breathing zone to establish conditions and work procedures for maintaining compliance with OSHA Regulations 29 CFR 1910.1001 and 1926.1001.
- B. The AAC's air sampling professional shall document all air sampling results and provide all air sampling reports as soon as feasible. OSHA air monitoring results shall be posted at a conspicuous location at the job site.
- C. All personnel air sampling shall be conducted in accordance with methods described in OSHA standards 29 CFR 1910.1001 and 1926.1101.

1.16 SUBMITTALS

- A. The AAC will submit two (2) copies of the following submittals to the Owner's Representative ten (10) calendar days prior to the commencement of removal work:
 1. AAC's construction schedule
 2. Waste generator label to be used
 3. Waste shipment and disposal form to be used with generated information
 4. Waste hauling contractor
 5. Landfill to be used
 6. Training and licenses of each employee who may be on the project site
 7. A notarized statement from the AAC that all their employees performing abatement operations at this site comply with the OSHA medical and respiratory protection requirements.

8. The qualifications of the hygiene firm that the AAC proposes to use for this project to analyze contractor employee OSHA monitoring samples and final visual inspections and reoccupancy air sampling
 9. Copies of all notifications and permits
 10. Copies of the written respirator plan compliant with the most current issue of OSHA 1910.134
 11. Copies of all MSDS sheets for materials to be used on site
 12. Work Site Safety Plan
 13. Negative Exposure Assessment (if applicable)
 14. Contractor's State of Connecticut Asbestos Contractor license
- B. The AAC will submit two (2) copies of the following submittals to the Owner's Representative no later than thirty (30) calendar days following the completion of removal work at each site:
1. State Notifications and any revisions
 2. Work area access logs for each containment area
 3. OSHA personnel monitoring results
 4. Worker and Supervisor training certificates and State of Connecticut licenses
 5. Completed waste shipment records

1.17 DEFINITIONS

- A. **ABATEMENT** - Procedures to control fiber release from asbestos-containing materials; includes removal, encapsulation, and enclosure.
- B. **AIRLOCK** - A system for permitting ingress and egress while assuring air movement to a contaminated area from an uncontaminated area. Two curtained doorways spaced a minimum of six feet apart can form an airlock.
- C. **AIR MONITORING** - The process of measuring the fiber concentration of an area or of a person.
- D. **AIR SAMPLING PROFESSIONAL** – A licensed professional capable of developing air sampling protocols and conducting air monitoring and analysis. This individual should be an industrial hygienist, an environmental scientist, or an engineer with experience in asbestos air monitoring and worker protection equipment and procedures. This individual should have demonstrated proficiency in conducting air sample collection in accordance with 29 CFR 1910.1001 and 1926.1101.
- E. **ADEQUATELY WETTED** - means sufficiently mixed or coated with water, amended or an aqueous solution; or the use of removal encapsulant to prevent dust emissions.
- F. **AMENDED WATER** - Water to which a surfactant has been added.
- G. **ASBESTOS** - The name given to a number of naturally occurring fibrous silicates. This includes the serpentine forms and the amphiboles and includes chrysotile, amosite, crocidolite, tremolite, anthophyllite, and actinolite, or any of these forms that have been chemically altered.
- H. **ASBESTOS ABATEMENT** - Means the removal, encapsulation, enclosure, renovation, or repair of asbestos-containing materials except activities that are related to the removal or repair of asbestos cement pipe and are performed by employees of a water company as defined in Section 25-32a of the Connecticut General Statutes.
- I. **ASBESTOS ABATEMENT SITE SUPERVISOR** - Means any licensed individual who is employed or engaged by an AAC to supervise an asbestos abatement project.

- J. ASBESTOS ABATEMENT WORKER - Means any employee of an AAC who engages in asbestos abatement.
- K. ASBESTOS CONSULTANT - Any person who engages in any activity directly involved with asbestos consultation services and who has been issued a certificate by the commissioner and a license by the department.
- L. ASBESTOS CONTAINING MATERIAL (ACM) - A material composed of asbestos of any type and in an amount greater than one percent by weight, either alone or mixed with other fibrous or nonfibrous material.
- M. ASBESTOS CONTRACTOR - Any person or entity engaged in asbestos abatement whose employees actually perform asbestos abatement work.
- N. ASBESTOS CONTROL AREA - An area where asbestos abatement operations are performed which is isolated by physical boundaries to prevent the spread of asbestos dust, fibers, or debris.
- O. ASBESTOS FIBERS - Those particles with a length greater than five (5) microns and a length to diameter ratio of 3: 1 or greater.
- P. ASBESTOS PERMISSIBLE EXPOSURE LIMIT (PEL) - The maximum airborne concentration of asbestos fibers to which an employee is allowed to be exposed. The current level established by OSHA is 0.1 fibers per cubic centimeter of air as an eight (8) hour time weighted average and 1.0 fibers/cc averaged over a sampling period of 30 minutes as an excursion limit. The AAC is responsible for maintaining work areas in a manner that this standard is not exceeded.
- Q. ASBESTOS PROJECT MONITOR - The licensed asbestos consultant who is certified as a project monitor and who functions as an on-site representative of the facility Owner or other persons by over-seeing the activities of the asbestos abatement contractor.
- R. AUTHORIZED VISITOR - Any person authorized by the Owner to enter the building.
- S. BUILDING OWNER - For this Contract only, the building Owner is Diane Rogers.
- T. CLEAN ROOM - An uncontaminated area or room, which is a part of the workers' decontamination enclosure with provisions for storage of workers' street clothes and protective equipment.
- U. CLEARANCE SAMPLING - Final air sampling performed aggressively after the completion of the abatement project in a regulated area. Five (5) air samples collected by the asbestos abatement project monitor inside the work area, and having a fiber concentration of less than 0.010 fibers/cc of air will denote acceptable clearance sampling by Phase Contrast Microscopy. Five air samples collected by the asbestos abatement project monitor having an average asbestos concentration of less than 70 asbestos structures mm/sq. will denote acceptable clearance sampling for Transmission Electron Microscopy.
- V. COMMISSIONER - Means the Commissioner of the Connecticut Department of Health Services or his/her authorized agent.
- W. COMPETENT PERSON - A representative of the AAC who is capable of identifying an asbestos hazard and who has the authority to take prompt corrective measures to eliminate the hazard during asbestos removal.
- X. CONFINED SPACE - A work zone where access and egress are restricted, a potential for gaseous vapors to accumulate exist, or a potential for low oxygen content exists.

- Y. DECONTAMINATION ENCLOSURE SYSTEM - A series of connected areas, with curtained doorways between any two adjacent areas, for the decontamination of workers and equipment. A decontamination enclosure system always contains at least one airlock and is adjacent and connected to the regulated area, where possible.
- Z. DEPARTMENT - The Department of Public Health.
- AA. EPA - Means the U.S. Environmental Protection Agency.
- BB. ENCAPSULANT - A liquid material that can be applied to asbestos-containing material that controls the possible release of asbestos fibers from the materials by either creating a membrane over the surface (bridging encapsulant) or penetrating the material and binding its components together (penetrating encapsulant).
- CC. ENCAPSULATION - A specified asbestos remediation strategy involving the application of an encapsulant to asbestos containing materials to control the release of asbestos fibers into the air.
- DD. EQUIPMENT DECONTAMINATION ENCLOSURE - That portion of a decontamination enclosure system designed for controlling the transfer of materials and equipment, typically consisting of a washroom and a holding area.
- EE. EQUIPMENT ROOM - A contaminated area or a room, which is part of the workers' decontamination enclosure with, provisions for storage of contaminated clothing and equipment.
- FF. FACILITY - Means any private or public building or structure including but not limited to those used for institutional, residential (including single family homes), commercial or industrial purposes and vessels while ashore or in dry-dock.
- GG. FIXED OBJECT - A unit of equipment or furniture in the work areas which cannot be removed from the work area.
- HH. FRIABLE ASBESTOS MATERIAL - Any material that contains more than 1% asbestos by weight, that can be crumbled, pulverized or reduced to powder by hand pressure.
- II. GLOVE BAG - An impervious plastic bag-like enclosure affixed around asbestos containing material, with glove-like appendages through which materials and tools may be handled.
- JJ. HAZARDOUS MATERIALS ABATEMENT CONTRACTOR (AAC) - Means the asbestos abatement contractor, lead based paint abatement contractor and or the pigeon guano removal.
- KK. HEPA FILTER - A high efficiency particulate air (HEPA) filter in compliance with ANSI Z9.2-1979.
- LL. HEPA VACUUM EQUIPMENT - Vacuum equipment with a HEPA filter system for filtering the effluent air from the unit.
- MM. HOLDING AREA - An air-locked chamber in the equipment decontamination enclosure located between the washroom and an uncontaminated area.
- NN. INSPECTOR (ASBESTOS ABATEMENT PROJECT MONITOR)- An individual, retained by the Building Owner, who is a "qualified asbestos abatement project monitor" as defined by the State of Connecticut Department of Public Health, and who will be responsible for monitoring the AAC during the asbestos abatement project.
- OO. MOVABLE OBJECT - A unit of equipment or furniture in the work area, which can be removed from the work area.

- PP. **NEGATIVE AIR FILTRATION EQUIPMENT** - A portable local exhaust system equipped with HEPA filtration used to create negative pressure in a regulated area (negative with respect to adjacent unregulated areas) and capable of maintaining a constant, low velocity air flow into regulated areas from adjacent unregulated areas.
- QQ. **OWNER'S REPRESENTATIVE** -The Asbestos Consultant for the project.
- RR. **NESHAPS** - National Emissions Standard for Hazardous Air Pollutants regulations enforced by the EPA.
- SS. **PLASTICIZE** - To cover floors and walls with plastic sheeting as specified herein.
- TT. **SEPARATION BARRIER** - A rigid barrier sealed with two (2) layers of six (6) mil polyethylene sheeting installed between an occupied area and the asbestos abatement work area.
- UU. **SHOWER ROOM** - A room between the clean room and the equipment room in the workers' decontamination enclosure with hot/cold running water and suitably arranged for employee showering during decontamination. The shower room is located in an airlock between the contaminated area and the clean area.
- VV. **STRIPPING** - Removing asbestos materials from any structural member, pipe surface, HVAC, or other equipment.
- WW. **WASHROOM** - A room between the work area and the holding area in the equipment decontamination enclosure with provisions for storage of contaminated clothing and equipment.
- XX. **WET CLEANING** - The process of reducing asbestos contamination from building surfaces and objects by using cloths, mops, or other cleaning tools, which have been dampened by amended water, and by then disposing of these cleaning items as asbestos contaminated waste.
- YY. **WORK AREA** - Designated rooms, spaces, or areas of the project in which asbestos abatement actions are occurring and which may become contaminated as a result of such abatement actions. The work area must be totally self-contained by sealing, plasticizing and equipping the area with a decontamination enclosure system.
- ZZ. **WORKER DECONTAMINATION ENCLOSURE SYSTEM** - That portion of a decontamination enclosure system designated for controlled passage of workers, other personnel, and authorized visitors, typically consisting of a clean room, a shower room, and an equipment room.
- AAA. **WORK STOPPAGE CLEANUP PROCEDURE** - A process following the issuance of a written stop work order, whereby the AAC thoroughly cleans and decontaminates the work area, the decontamination enclosure system, and any other areas of the building affected by the removal project, to the satisfaction of the Asbestos Abatement Project Monitor.
- BBB. **WORK ZONE** - The area of the decontamination enclosure system where asbestos is being removed.

PART 2 MATERIALS AND EQUIPMENT

2.1 Materials

- A. Deliver all materials in the original packages, containers, or bundles bearing the name of the manufacturer and the brand name and product technical description.

- B. Damaged or deteriorating materials shall not be used and shall be removed from the premises. Material that becomes contaminated with asbestos shall be decontaminated or disposed of as asbestos waste.
- C. Polyethylene sheet in a roll size to minimize the frequency of joints shall be delivered to job site with factory label indicating 4 or 6 mil.
- D. Polyethylene disposable bags shall be true six (6) mil with preprinted labels.
- E. Tape or adhesive spray will be capable of sealing joints in adjacent polyethylene sheets and for attachment of polyethylene sheets to finished or unfinished surfaces of dissimilar materials and capable of adhering under both dry and wet conditions, including use of amended water.
- F. Surfactant (wetting agent) - shall consist of fifty (50) percent polyoxyethylene ether and fifty (50) percent polyoxyethylene ester, or equivalent, and shall be mixed with water to provide a concentration of one (1) ounce surfactant to five (5) gallons of water or as directed by manufacturer.
- G. Impermeable containers are to be used to receive and retain any asbestos-containing or contaminated materials until disposal at an acceptable disposal site. (The containers shall be labeled in accordance with OSHA Standard 29 CFR 1926-1101.) Containers must be both air and watertight.
- H. Labels and signs, as required by OSHA Standard 29 CFR 1926.1001 will be used.
- I. Encapsulant shall be bridging or penetrating type which has been found acceptable to Eagle Environmental. Usage shall be in accordance with manufacturer's printed technical data.
- J. Disposal labels shall be preprinted on self-adhesive labels with the generator name, abatement site and contractor's name and address. Labels shall not be photocopied and applied with spray adhesive.

2.2 Tools and Equipment

- K. Provide suitable tools for asbestos removal, encapsulation and enclosure.
- L. The AAC shall have air monitoring equipment of type and quantity to monitor operations and conduct personnel exposure surveillance per OSHA requirements.
- M. The AAC shall have available sufficient inventory on site for materials necessary for the job including protective clothing, respirators, filter cartridges, polyethylene sheeting of proper size and thickness, tape, and air filters.
- N. The AAC shall provide temporary electrical power sources such as generators (when required).
- O. The AAC shall have available shower stalls and sufficient hose length and a drain system equipped with 5-micron filters.
- P. Exhaust air filtration system units shall contain HEPA filter(s) capable of sufficient air exhaust to create negative pressure of 0.02 inches of water within the enclosure with respect to the outside area. Equipment shall be checked for proper operation by smoke tubes or a differential pressure gauge before the start of each shift and at least twice during the shift. Adequate exhaust air shall be provided for a minimum of four (4) air changes per hour within the enclosure. No air movement system or air filtering equipment shall discharge unfiltered air outside.

- Q. Vacuum units, of suitable size and capacities for project, shall have HEPA filter(s) capable of trapping and retaining at least 99.97 percent of all monodispersed particles of 0.3 micrometers in diameter or larger.
- R. The AAC will have reserve exhaust air filtration system units in order to maintain negative air filtration in the event that a unit malfunctions during use.
- S. The AAC shall have available and use recording manometers to monitor pressure differential between the work area and occupied areas of the building. A minimum negative pressure differential of 0.02 inches of water column shall be maintained.
- T. The AAC shall have available spray equipment capable of mixing a wetting agent with water and capable of generating sufficient pressure and volume and having sufficient hose length to reach all areas with asbestos.
- U. HEPA filtered local exhaust ventilation shall be utilized during the installation of enclosures and supports where asbestos-containing materials may be disturbed.

PART 3 EXECUTION

3.1 Interior Work Area Preparation - General

- A. Provide GFCI devices, temporary power, and temporary lighting installed in compliance with the applicable electrical codes. All temporary installations are to be made by a licensed electrician.
- B. Shut down electrical power, including receptacles and light fixtures. Lock and tag out circuits associated with the electrical components in the work area(s). Under no circumstances during the abatement procedures will lighting fixtures be permitted to be operating when the spraying of amended water may contact the fixture.
- C. Shut down and/or isolate heating, cooling, and ventilation air systems or zones to prevent contamination and fiber dispersal to other areas of the structure. Lock and tag out circuits associated with heating and cooling units. During the work, vents within the work area shall be sealed with duct tape and polyethylene sheeting.
- D. Seal off all openings, including but not limited to windows, corridors, doorways, skylights, ducts, grills, diffuser, and any other penetration of the work areas, with polyethylene sheeting minimum of six (6) mils thick sealed with duct tape. This includes doorways and corridors which will not be used for passage during work areas and occupied areas. Install 5 micron water filtration socks in all floor drains prior to sealing.
- E. Pre-clean fixed objects within the work areas, using HEPA vacuum equipment and/or wet cleaning methods as appropriate, and enclose with minimum six (6) mil plastic sheeting sealed with duct tape.
- F. Where friable asbestos containing materials are present, establish worker decontamination facility, critical barriers and negative air filtration prior to conducting pre-cleaning activities.
- G. Pre-clean movable objects within the work areas, using HEPA vacuum equipment and wet cleaning methods as appropriate.
- H. Clean the proposed work areas using HEPA vacuum equipment or wet cleaning methods as appropriate. Do not use methods that raise dust, such as dry sweeping or vacuuming with equipment not equipped with HEPA filters.

- I. After HEPA vacuum pre-cleaning, conduct work area preparation in accordance with this Specification section.
- J. Where fixed walls are not used, one layer of six (6) mil polyethylene sheeting will be applied to a rigid framework of wood, metal, or PVC.
- K. Install two layers of four (4) mil polyethylene wall sheeting over all wall surfaces and critical barriers. All overlaps shall be sealed with tape or spray adhesive. Substitute one layer of four (4) mil wall polyethylene sheeting in lieu of two layers of four (4) mil where nonfriable floor tile associated mastic and wall tile adhesive are being removed.
- L. Cover all floors in the work area with a double layer of six (6)-mil polyethylene sheeting. Extend the polyethylene flooring a minimum of twelve (12) inches up the walls. Ensure that the wall sheeting overlaps the floor sheeting from the top.
- M. Maintain emergency and fire exits from the work area, or establish alternative exits satisfactory to fire officials.
- N. Create pressure differential between work areas and occupied areas by the use of acceptable negative air pressure equipment. The AAC shall ensure required negative air pressure is obtained throughout the containment and the total volume of air within the work area is changed every fifteen (15) minutes.
- O. Post all approaches to each work area with Asbestos Warning signs. Warning signs shall be of size and type that are easily readable and are visible from all approaches to the work areas.

3.2 Contiguous Personnel Decontamination System

- A. The AAC shall establish contiguous to each work area, where feasible, a personnel decontamination system consisting of equipment room, shower room and clean room in series. Access between the contaminated and uncontaminated areas shall be through this decontamination enclosure only. The decontamination system shall be constructed of two layers of six-mil polyethylene sheeting. Pre-fabricated "pop-up" decontamination chambers will not be permitted on this project.
- B. Access between rooms in decontamination system shall be through double flap-curtained openings. Clean room, shower and equipment room within decontamination system shall be completely sealed ensuring that the sole source of air flow through this area originates from uncontaminated areas outside the work area.
- C. The shower unit shall be equipped with an adequate supply of warm water. A shower filtration pump containing two 5 micron sock filters or the best available technology shall be installed to filter shower water. Filtered shower water shall be discharged into sanitation drains and shall not be discharged into storm drains or onto floor or ground surfaces.
- D. The shower shall contain soap and an adequate supply of drying towels. Provide an adequate number of shower units in accordance with OSHA 29 CFR 1926.1101.
- E. The AAC shall provide a heated area within the building or in a remote worker decontamination chamber for workers to dress in after showering.
- F. Worker decontamination chambers must be constructed prior to work area preparation if damaged friable ACM is present.

3.3 Exterior work area preparation - general

- A. Where exterior non-friable ACM is to be removed outdoors, post asbestos abatement warning signs and erect temporary barricades to create regulated areas. Regulated areas should be kept clear of any persons not fully trained and protected against exposure.
- B. Install single six (6) mil drop cloths extending a minimum of ten (10) feet from the exterior wall of the building or roofs. Extend polyethylene sheeting outward from the base of the structure in order to collect debris when working from higher elevations.
- C. Install single six (6) mil critical barriers over any louver, vent or penetration into the building interior within or directly adjacent to the regulated area.
- D. Maintain an operable remote worker decontamination system in accordance with Section 3.2 REMOTE PERSONNEL DECONTAMINATION SYSTEM during exterior abatement work.
- E. Maintain a work area access control log for each exterior work area.
- F. Post asbestos warning signs at 10 foot intervals around the exterior work area. Warning signs must be visible from all approaches to the area.

3.4 Remote Personnel Decontamination System

- A. The AAC shall establish a remote personnel decontamination system, where contiguous decontamination systems are not feasible, consisting of equipment room, shower room and clean room in series. Access between the contaminated and uncontaminated areas shall be through a single chamber airlock. The decontamination system shall be constructed of two layers of six-mil polyethylene sheeting. Pre-fabricated "pop-up" decontamination chambers will not be permitted on this project.
- B. Access between rooms in decontamination system shall be through double flap-curtained openings. Clean room, shower and equipment room within decontamination system shall be completely sealed between chambers.
- C. The shower unit shall be equipped with an adequate supply of warm water. A shower filtration pump containing two 5 micron sock filters or the best available technology shall be installed to filter shower water. Filtered shower water shall be discharged into sanitation drains and shall not be discharged into storm drains or onto floor or ground surfaces.
- D. The shower shall contain soap and an adequate supply of drying towels. Provide an adequate number of shower units in accordance with OSHA 29 CFR 1926.1101.

3.5 Waste Load Out Systems

- A. The AAC shall establish waste load out systems, where feasible, attached to the work areas. Waste load out systems shall consist of a minimum of two (2) chambers that are of suitable size for transporting waste out of the work area. Waste load out systems shall be constructed of two layers of six-mil polyethylene sheeting.
- B. Access between rooms in the waste load out system shall be through double flap-curtained openings. The waste load out system shall be used for decontaminating waste containers, bags, bundles, etc. prior to removal from the work area and transporting waste from the work area to the non-work area.

- C. Persons working inside the contaminated work area are not permitted to pass from the work area to the non-work area through the waste load out system. Persons inside the contaminated work area shall not be permitted to enter into the clean area of the waste load out system.
- D. The waste load out system shall remain sealed at all times except during decontamination of waste containers and transport of waste from the work area to the non-work area.

3.6 Asbestos Removal Procedure – General

- A. The AAC shall have a designated "competent person" on the job at all times to ensure establishment of a proper enclosure system and proper work practices throughout the project. At a minimum, the AAC competent person shall perform or supervise the following duties, as applicable:
 - 1. Ensure the integrity of the containment or enclosure.
 - 2. Set up procedures to control entry to and exit from the enclosure.
 - 3. Supervise employee exposure monitoring.
 - 4. Ensure that employees set up, use and remove engineering controls, use work practices and personal protective equipment in compliance with OSHA regulations.
 - 5. Ensure that employees use the worker decontamination facilities and observe decontamination procedures.
- B. Abatement work will not commence until all work area preparation is completed in accordance with this technical specification section.
- C. Spray asbestos materials with amended water using airless spray equipment or apply approved removal wetting agent to reduce the release of fibers during removal operation.
- D. Spraying of amended water shall be adequate enough to allow the ACM to absorb the water. Actual removal of ACM shall not be allowed until all ACM has become adequately wet.
- E. Fill disposal containers as removal proceeds, seal filled containers before moving to waste load out system. Wet clean each container thoroughly, double bag, drum or use other approved containerization methods and apply a caution label before moving to holding area. Floor tile waste shall be containerized in rigid lined drums.
- F. Remove and containerize all visible accumulations of asbestos-containing and/or asbestos-contaminated debris.
- G. Solidify all liquid waste prior to containerization for disposal.
- H. Sealed disposal containers and all equipment used in the work area shall be included in the cleanup and shall be removed from work areas, via the waste load out system at an appropriate time in the cleaning sequence.
- I. At any time during asbestos removal, should the competent person suspect contamination of areas outside the work area(s), they shall cause to stop all abatement work until steps to decontaminate these areas and eliminate causes of such contamination are completed. Unprotected individuals shall be prohibited from entering suspected contaminated areas until air sampling and visual inspections certify decontamination.
- J. Upon acceptance of the work area by the Owner's Representative, the AAC shall apply an even coating of bridging encapsulant to all exposed surfaces contained within the work area. Apply encapsulant in accordance with manufacturer's recommendation.

3.7 Waste Packaging and Removal Procedure

- A. The AAC shall strictly adhere to the requirements of this section for ACM waste packaging and transporting waste from the work area enclosure to the disposal dumpster.
- B. The AAC shall utilize lined drums for waste packaging of floor tiles.
- C. Waste disposal bags and drums shall be affixed with pre-printed OSHA warning labels, DOT labels and NESHAP labels.
- D. Each container of ACM waste shall be made adequately wet prior to sealing the container. Bags shall be sealed immediately following additional wetting procedures. Bags of ACM waste shall not be permitted to remain unsealed while in the work area enclosure.
- E. Each bag of ACM waste shall be doubled during waste load out procedures. The following waste load out procedure shall be strictly adhered to:
 - 1. Wet wipe inner bag or drum to remove all ACM contamination. Ensure the inner bag is sealed.
 - 2. Transport bag or drum to the equipment room located in the worker decontamination enclosure.
 - 3. One worker, equipped with personal protective equipment, shall be inside the clean room of the worker decontamination enclosure.
 - 4. The worker in the clean room of the decontamination enclosure shall open a six-mil disposal bag and hold it open inside the shower room where the inner bag containing the ACM waste shall be placed.
 - 5. The outer bag shall be sealed with duct tape inside the shower room.
 - 6. The double bagged or drummed waste shall be removed from the decontamination enclosure and waste generator labels shall be immediately affixed to the outer bag or drum.
 - 7. Waste generator labels shall be printed self-adhering labels and shall contain the Owner's name, the site location address, and the AAC's name.
 - 8. The properly labeled waste shall be transported directly to the lined waste container.
 - 9. The waste container shall be double lined with 6-mil polyethylene sheeting.
 - 10. OSHA warning signs shall be secured to the waste container prior to any loading operations.
 - 11. The waste container shall be kept locked at all times other than loading and unloading.

3.8 MINIMUM Specific Removal Procedure – Exterior nonfriable acm – Asbestos Caulk

- A. Coordinate the removal of all exterior asbestos containing materials with the General Contractor.
- B. The AAC shall sufficiently wet caulk with removal encapsulant, amended water, or a detergent solution.
- C. All ACM shall be placed directly into disposal bags or shall be transferred to the asbestos disposal dumpster. Do not allow waste to accumulate on the ground. The AAC shall ensure that no visible emissions are generated during any portion of the abatement operation.
- D. Remove asbestos caulk by carefully wet scraping caulk from window frames/casings. Avoid gouging or otherwise damaging wood substrate.
- E. Remove all residual asbestos caulk from aluminum storm windows and reinstall storm windows following final visual inspection by Asbestos Project Monitor.
- F. Material drop shall not exceed eight (8) feet. Remove caulk directly into disposal bags.
- G. Decontaminate storm windows prior to reinstallation.

3.9 Disposal of Asbestos And Asbestos Contaminated Waste

- A. All disposal of asbestos containing and or asbestos contaminated material must be in compliance with requirements of the Office of the Department of Environmental Protection, State of Connecticut Department of Public Health and the USEPA NESHAP regulations.
- B. Disposal approvals shall be obtained before commencing asbestos removal.
- C. Waste container storage locations shall be pre-approved by the Owner and Owner's Representative.
- D. A copy of approved disposal authorization shall be provided to the Owner and Owner's Representative and any required federal, state or local agencies.
- E. Copies of all landfill receipts will be retained by the Owner's Representative as part of the project file. The receipts will be signed by the landfill operator on receipt, and the quantity of asbestos debris leaving the job site and arriving at the landfill acknowledged.
- F. All asbestos debris shall be transported in covered, sealed vans, boxes or dumpsters, which are physically isolated from the driver by an airtight barrier. All vehicles must be properly licensed to meet United States Department of Transportation (US DOT) requirements.
- G. Friable ACM waste shall be placed in double lined enclosed waste containers equipped with a lockable hasp. Waste containers shall be posted with OSHA warning signs during loading and unloading.
- H. All liquid waste generated during the work shall be solidified. At no time will liquid wastes be permitted to be stored on site. Liquid waste generated during this project shall be solidified prior to the end of each work shift.
- I. Completed waste shipment records signed by the landfill must be returned to the Owner or Owner's Representative no later than 45 days from the time the waste was transported off-site. Completed waste shipment records that are not received by the Owner within 35 days shall require the AAC to begin tracking the waste. The AAC must notify the Owner of intentions on tracking the waste.
- J. The AAC must take appropriate actions as outlined in 40 CFR Part 61 NESHAP regulations when completed waste manifests are not forwarded to the Owner or Owner's Representative within 45 days from the time the waste was transported off-site.

3.10 Final Cleaning and Encapsulation

- A. Upon completion of gross removal of all ACM specified for removal, the AAC shall begin final cleaning of the effected work area. The AAC shall HEPA vacuum and wet wipe all surfaces contained within the work area.
- B. All tools or equipment that are not necessary for final cleaning shall be decontaminated or bagged and removed from the work area enclosure.
- C. The AAC shall begin final cleaning procedures at the furthest and highest most points from the personnel decontamination facility. The AAC shall ensure that all exposed building components and or surfaces are thoroughly HEPA vacuumed and wet wiped.
- D. The AAC shall HEPA vacuum and wet wipe any component specified to remain inside the work area enclosure.

- E. The AAC shall thoroughly wet wipe all polyethylene sheeting inside the work area enclosure.
- F. Once all surfaces and components within the work area have been thoroughly cleaned, the AAC's Competent Person shall perform a visual inspection of all surfaces and components within the work area enclosure. The AAC's Competent Person shall sign off on the work area stating that all abatement has been completed for this portion of work and that the work area has met final visual inspection requirements as outlined in ASTM E1368.
- G. The AAC's Competent Person shall then request a final visual inspection to be performed by the Owner's Representative. The Owner's Representative shall visually inspect all surfaces and components in the work area for residual debris and or dust. Additional cleaning shall be performed at the AAC's expense if the Owner's Representative identifies visual debris and or dust during the visual inspection. Additional cleaning shall be performed until the work area meets the Final Visual Inspection requirements outlined in ASTM E1368.
- H. Upon acceptance of the work area by the Owner's Representative, the AAC shall apply an even layer of bridging encapsulant to all surfaces contained within the work area. The Owner's Representative shall verify the completeness of work area encapsulation.

3.11 Reoccupancy Air Clearance Monitoring

- A. Re-occupancy air clearance monitoring is not required for this exterior abatement work. A final visual inspection shall be performed by the Program's Asbestos Project Monitor to verify the completeness of work.
- B. Areas that do not comply with the final visual inspection criteria shall continue to be cleaned by and at the AAC's expense until the specified criteria (no visible debris or residue) is achieved as evidenced by results of visual inspection

3.12 Program's Representative Responsibility

- A. The Program has retained the services of Eagle Environmental, Inc to monitor this project. The Program's Representative may collect and analyze air samples to ascertain the integrity of controls, which protect the building from asbestos contamination. Independently, the AAC may monitor air quality within the work area to ascertain the protection of employees and to comply with OSHA regulations.
- B. The Program's Representative may collect and analyze air samples during a minimum of three time periods:
 - 1. Pre-Abatement Sampling Period: The Asbestos Abatement Project Monitor shall collect a sufficient number of air samples, inside and outside the proposed work area locations, to establish background air quality conditions. At least one sample will be taken outside of the building.
 - a. Pre-Abatement air samples shall be collected for a minimum period of ninety minutes at a minimum flow rate of 12 liters per minute, or as required to obtain a volume of 1,000 liters. Samples shall be analyzed by phase contrast microscopy (PCM) using the NIOSH 7400 protocol.
 - 2. Abatement Period: The Asbestos Abatement Project Monitor shall collect samples on a daily basis during the work period. A sufficient number of background samples shall be taken outside of the work area, at the exhaust of the negative pressure filtration equipment, and outside of the building to evaluate the degree of cleanliness or contamination of the building

during asbestos removal. Additional samples may be taken inside the work area and decontamination enclosure system, at the discretion of the Asbestos Abatement Project Monitor.

- a. The Asbestos Abatement Project Monitor shall provide a continual evaluation of the air quality of the building during asbestos abatement, using his/her best professional judgments in respect to the State Department of Public Health guideline of .010 fibers/cc and the background air quality established during the pre-abatement period.
 - b. If the Asbestos Abatement Project Monitor determines that the building air quality has become contaminated from the project, he/she shall immediately inform the AAC to cease all removal operations and implement a work stoppage clean up procedure. The AAC shall conduct a thorough cleanup of areas of the building designated by the Asbestos Abatement Project Monitor. No further asbestos abatement work shall take place until the Asbestos Abatement Project Monitor has determined that the building's air has been decontaminated.
 - c. Abatement air samples shall be collected for a minimum period of ninety minutes at a minimum flow rate of 12 liters per minute, or as required to obtain a volume of 1,000 liters. Samples shall be analyzed by phase contrast microscopy (PCM) using the NIOSH 7400 protocol.
3. Post-Abatement Period: The Asbestos Abatement Project Monitor shall conduct air sampling following the final cleanup phase of the project, once the "no visible residue" criterion as established by Asbestos Abatement Project Monitor has been met. Five (5) samples shall be collected inside containment utilizing aggressive methods to comply with State of Connecticut DPH Standard for Asbestos Abatement sections 19a-332a-12, and 19a-332a-13. Analysis of the samples to determine airborne concentrations of asbestos shall be conducted by Transmission Electron Microscopy (TEM) with a limit of 70 asbestos structures per square millimeter and by Phase Contrast Microscopy (PCM) with a limit of 0.01 fibers per cubic centimeter of air in accordance with the above State of Connecticut DPH Standard for Asbestos Abatement regulations.
- C. Inspections may be conducted by the Owner's Representative throughout the progress of the abatement project. Inspections may be conducted in order to document the progress of the abatement work as well as the procedures and practices employed by the AAC. The Asbestos Abatement Project Monitor shall perform the following inspections during the course of abatement activities.
1. Pre-commencement Inspection: Pre-commencement inspections may be performed at the time requested by the AAC. The Asbestos Abatement Project Monitor shall be informed 48 hours prior to the time the inspection is needed. During the course of the precommencement inspection, the Asbestos Abatement Project Monitor shall inspect the containment. This shall include, but not be limited to, inspection of barrier integrity, the worker decontamination, facility, negative air filtration equipment ect. If during the course of the precommencement inspection, deficiencies are found, the AAC shall perform the necessary adjustments in order to obtain compliance.
 2. Work Area Inspections: Work area inspections may be conducted on a daily basis at the discretion of the Asbestos Abatement Project Monitor. During the course of the work area inspections, the Asbestos Abatement Project Monitor may observe the AAC removal procedures, verify barrier integrity, monitor negative air filtration devices, assess project progress, and inform the AAC of specific remedial activities if deficiencies are noted.

3. Pre-sealant Inspection: Upon the request of the AAC, The Asbestos Abatement Project Monitor shall conduct a pre-sealant inspection. The pre-sealant inspection shall be conducted after completion of the initial final cleaning procedures, but prior to work area encapsulation. The pre-sealant inspection shall verify that all ACM and residual debris have been removed from the work area. If, during the course of the pre-sealant inspection, the Asbestos Abatement Project Monitor identifies residual dust or debris, the AAC shall comply with the request of the Asbestos Abatement Project Monitor, in order to render the area is free of visible residue.
4. Final Visual Inspection: Following receipt of acceptable reoccupancy air monitoring results and concurrent with removal of the work area containment, the Asbestos Abatement Project Monitor shall conduct a final visual inspection. If residual dust or debris is identified during the course of the final inspection, the AAC shall comply with the request of the Asbestos Abatement Project Monitor, in order to render the area free of visible residue.

END OF SECTION

\\Eaglesvr\public\2014 Files\2014 Specs\CSA - Capital Studio Architects\Hurricane Sandy\181 Trumbull Ave, Bridgeport\020800 Asbestos Abatement 181 Trumbull Ave.doc

SECTION 020900
LEAD-BASED PAINT ABATEMENT

PART 1 - GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and General Provisions of Contract, including General Supplementary Conditions and Division 1 Specifications Sections, of the Contract Documents apply to this Section.

1.2 PROJECT DESCRIPTION

- A. A lead-based paint abatement project is being undertaken at 181 Trumbull Avenue in Bridgeport, Connecticut. The lead-based paint abatement work is being funded by a Community Development Block Grant (CDBG) under the Department of Housing Occupied Rehabilitation and Rebuilding Program (OORR).
- B. The site building consists of a single family residential building. Notification to the Connecticut Commission on Culture & Tourism has been made to determine if the building is eligible for listing on the National Register of Historic Places and the results are pending. The building is considered a child occupied facility as the homeowners grandchildren visit frequently. The presence of a child under the age of six (6) years old and the identification of defective lead-based paint triggers the State of Connecticut Childhood Lead Poisoning Prevention and Control Regulations. The lead-based paint abatement work must be performed by a State of Connecticut licensed Lead Abatement Contractor.
- C. A lead-based paint hazard screen was performed on the interior and exterior areas. Toxic levels of lead-based paint were identified on various components and surfaces. There are no known lead-based paint abatement orders on the inspected building.
- D. Under federal regulation 24 CFR 35, Subpart J, Rehabilitation, for a property receiving greater than \$25,000.00 per unit, all identified interior lead hazards are required to be abated and all exterior lead-based paint hazards shall be remediated through a combination of abatement and interim control (non-permanent) measures. Based on the frequency of visitation by children under the age of six (6), the building meets child occupied criteria under federal regulations. When a building meets child occupied status under federal regulation, the building is also considered child occupied under state regulation. All lead-based paint abatement work specified in the Scope of Work must be performed by a State of Connecticut licensed Lead Abatement Contractor.
- E. All lead-based paint abatement shall be conducted in compliance with all Federal, State and local regulations. Specifically, work shall conform with The Department of Housing and Urban Development (HUD) Guidelines For the Control and Evaluation of Lead Based Paint in Housing, The United States Environmental Protection Agency (USEPA), The State of Connecticut Department of Public Health (DPH) Lead Poisoning Prevention and Control Regulations, The State of Connecticut Department of Environmental Protection (DEP) Hazardous Waste Disposal regulations and the Department of Labor Occupational Safety and Health Administration (OSHA) Lead in Construction Final Rule 29 CFR 1926.62.
- F. The property owner is responsible for moving all items to the center of the room within areas where work is to be performed. They are also responsible for putting them back at the completion of work.

1.3 SCOPE OF WORK

A. The general scope of work entails the following:

1. Replacement of original double hung wood window systems
2. Removal of one (1) replacement vinyl window system
3. Replacement of limited interior surfaces
4. Liquid encapsulation of various surfaces on the interior
5. Liquid encapsulation of various surfaces on the exterior
6. Paint removal on limited interior surfaces
7. Enclosure of limited interior surfaces
8. Enclosure of leaded window jambs with new vinyl windows
9. Soil remediation
10. Any surface that was not defective at the time of inspection or was not intended to be disturbed by renovations must be assumed to contain toxic levels of lead-based paint. If any surfaces are disturbed or uncovered during the renovation project, they must be treated as lead-based paint and either abated or left in intact condition at the completion of the job.

SEE ATTACHED TABLE A FOR SCOPE OF WORK.

REPAIRS PRIOR TO LEAD HAZARD REDUCTION						
Item #	Location	Component	Side	Quantity	Repair	
NONE						

1.4 SITE EXAMINATION

- A. The Contractor shall visit the site and examine all structures located thereon. The specifications shall be compared with the existing field conditions. The Contractor will examine all parts of the existing structure to which new work will be connected, attached or applied, and notify Eagle Environmental of any conditions detrimental to the proper and timely completion of the work.
- B. The Contractor shall, as a part of their bid, notify Eagle Environmental of any discrepancies, errors, or omissions that might have been discovered in the specifications for the purpose of making such corrections or adjustments as may be necessary. Unless specifically noted otherwise in the bid, any additional work by other trades or by the contractor that is required in order for the Contractor to finish the job will be assumed to be included in the bid price. If it should appear that any work called for in the specifications is not in accordance with State, local or federal laws or ordinances, the Contractor shall immediately notify Eagle Environmental.

1.5 LEAD PLANNER/PROJECT DESIGNER INFORMATION

A. Name of Planner/Project Designer: Kristen Liljehult

Certificate Number: 002153
Firm: Eagle Environmental, Inc.
Address: 8 South Main Street
City: Terryville State: Connecticut Zip: 06786
Telephone Number: (860) 589-8257

1.6 INSPECTION REPORT INFORMATION

A. Inspector Name: Kristen Liljehult
Title: Lead Inspector/Risk Assessor
Certificate Number: 002206
Firm Name: Eagle Environmental, Inc.
Firm License Number: 001723
Telephone Number: (860) 589-8257

1.7 OWNER INFORMATION

A. Name: Diane Rogers
Address: 181 Trumbull Avenue
City: Bridgeport State: Connecticut Zip: 06606
Home Telephone:

1.8 CONTRACTOR INFORMATION

A. Company Name: State of Connecticut licensed Lead Abatement Contractor
Contractor License Number: Not applicable at this time
Contact Person: Not applicable at this time
Address: Not applicable at this time
City: N/A State: N/A Zip: N/A
Telephone Number: N/A

1.9 APPLICABLE CODES

A. The Contractor shall be solely responsible for conducting this project and supervising all work in a manner which will be in conformance with all federal, state and local regulations and guidelines pertaining to lead paint abatement. Specifically, the Contractor shall comply with the requirements of the following:

1. Occupational Safety and Health Administration: OSHA
 - a. 29 CFR 1910 General Industry Standards
 - b. 29 CFR 1910.1025 Lead Standard for General Inventory
 - c. 29 CFR 1910.134 Respiratory Protection
 - d. 29 CFR 1910.1200 Hazard Communication
 - e. 29 CFR 1910.245 Specifications for Accident Prevention (Sign and Tags)
 - f. 29 CFR 1926.62 Construction Industry Standard

2. State of Connecticut Department of Energy and Environmental Protection: DEEP
 - a. Connecticut DEEP Regulations (Section 22a-209-8(l) and Section 22a-220 of the Connecticut General Statutes)
3. State of Connecticut Department of Public Health: DPH
 - a. 19a-111-1 thru 19a111-11 Lead Poisoning Prevention and Control Regulations.
4. USEPA
 - a. 40 CFR 745.100 - .119 Final Rule
 - b. 40 CFR Part 261 United States Environmental Protection Agency
 - c. 40 CFR 745 Subpart E
5. Department of Housing and Urban Development: HUD
 - a. Guidelines for the Evaluation and Control of Lead-Based Paint Hazards in Housing, dated June 1995.
 - b. 24 CFR Part 35 Lead-Based Paint Poisoning in Certain Residential Structures.

1.10 FEES, PERMITS AND LICENSES

- A. The Contractor shall comply with the provisions of all permits or applications required by the work specified, as well as make all submittals required under those auspices.

1.11 SEQUENCING AND SCHEDULING

- A. The Contractor shall extend full cooperation to Owner in all matters involving the use of Owner's facilities. At no time shall the Contractor cause or allow to be caused conditions which may cause risk or hazard to the general public or conditions that might impair safe use of the facility. The Contractor shall provide electricity, water and portable sanitary facilities for this project.
- B. The Contractor shall submit a time-line schedule, not date specific, to Owner and Consultant for integration into the overall project schedule. Coordinate the work of this section with the needs of the Owner. Phasing and scheduling of this project will be at the discretion of the Owner and shall not proceed in any area without the express consent of the Owner. The Contractor shall be available within 24 hours' notice for additional work or rework, if after acceptance of the work, it is found that full abatement was not achieved from the initial work effort as determined by the Owner.
- C. The proposed time line for the work in this Section, as noted above, shall show the time involved from start to finish of abatement operations, including preparation, removal, clean-up, and tear-down portions of the job.
- D. A final written schedule shall be prepared for approval by the Owner and the Consultant.
- E. The Contractor shall complete all work in a unit prior to proceeding to the next unit.

1.12 SUBMITTALS

- A. Lead Abatement Contractors License
- B. Original and most recent certificate for lead abatement workers/supervisor trainings

- C. Current license for lead abatement workers/supervisors
- D. Medicals for all lead abatement workers/supervisors on the job site
- E. Fit tests for all lead abatement workers/supervisors on the job site
- F. The last four (4) digits of each lead abatement worker/supervisor's social security number

1.13 BUILDING OCCUPANCY

- A. The occupants shall be relocated during lead-based paint abatement work within their dwelling. Re-occupancy will be permitted after the clearance criteria have been achieved.

1.14 NOTIFICATION TO CONNECTICUT COMMISSION ON CULTURE & TOURISM

- A. Notification to the Connecticut Commission on Culture & Tourism has been made and the results are pending.

1.15 NOTIFICATIONS

- A. For RRP work, notifications shall include the following (NOT APPLICABLE TO THIS PROJECT):
 1. The Contractor shall provide written notification to the Architect's representative a minimum of five (5) days prior to work at the site.
 2. The Owner shall notify the tenants a minimum of five (5) days prior to any lead renovation work.
 3. The Contractor is required to comply with the following information distribution requirements. No more than 60 days before beginning renovation activities in any residential dwelling unit of target housing, the firm performing the renovation must:
 4. Provide the owner or adult occupant of each unit the pamphlet titled Renovate Right: Important Lead Hazard Information for Families, Child Care Providers and Schools and comply with one of the following:
 5. Obtain, from the owner, a written acknowledgement that the owner has received the pamphlet (Each Unit).
 6. Obtain a certificate of mailing at least 7 days prior to the renovation.
 7. If the Contractor is unsuccessful in obtaining written acknowledgement from an adult occupant, certify in writing that the pamphlet has been delivered to the dwelling. The certification must include the date and method of delivery of the pamphlet, names of the persons delivering the pamphlet, reason for lack of acknowledgement, signature of the representative of the Contractor performing the lead renovation work and the date of signature.
 8. The Contractor shall have an adult occupant sign the Pre-Renovation Disclosure Form. A signed copy of the disclosure form shall be submitted to Architect's representative with the notice of the start date.

- B. For lead-based paint abatement work, notifications shall include the following:
1. The Lead Abatement Contractor shall notify the Local Health Department a minimum of five days prior to the commencement of abatement activities. The notification shall be made in writing and copies shall be sent to the Owner and Eagle Environmental, Inc.
 2. The Owner shall notify the tenants a minimum of five (5) days prior to abatement work.
 3. The Owner shall provide a notice to occupants no more than fifteen (15) calendar days after the abatement activities have been completed. Notice of abatement shall include, but not be limited to:
 - a. A summary of the nature, scope and results (including clearance results) of abatement activities.
 - b. A contact name, address and telephone for more information.
 - c. Available information on the location of any remaining lead-based paint in the rooms, spaces or areas where abatement activities were conducted on a surface by surface basis.

1.16 EPA RENOVATE, REPAIR AND REPAINTING RULE (NOT APPLICABLE TO THIS PROJECT)

- A. The Contractor must apply, pay the fee and become an EPA Certified RRP firm.
- B. The Contractor must ensure that that all renovators working in target housing and child occupied facilities, common areas or exteriors are EPA certified renovators or trained by a certified EPA renovator. Renovators can become certified by successfully attending an Eight (8) hour RRP EPA accredited training course.
- C. The Contractor must provide all tenants with a copy of EPA's Renovate Right: Important Lead Hazard Information for Families, Child Care Providers and Schools pamphlet no earlier than sixty (60) days prior to the date renovation activities are to be performed.
- D. The Contractor shall have an adult occupant sign the Pre-Renovation Disclosure Form. A signed copy of the disclosure form shall be submitted to the Architect's representative with written notice within five days of the commencement of the work.
- E. The Contractor shall review the testing results and become familiar with the locations of lead-based paint within the scope of the tested areas. The Contractor must assume that all untested painted surfaces are lead-based paint unless inspected by a licensed lead inspector/risk assessor or tested with an EPA approved lead testing kit and proven otherwise.
- F. The Contractor is required to ensure renovators minimize lead paint/dust exposure by performing activities in a lead safe manner See Sections 3.1 through 3.4 in this document for requirements, including posting of lead warning signs in plain view of the occupants.
- G. The Contractor shall ensure all sub-contractors performing renovation activities on assumed lead-based paint above the EPA de minimus level are EPA RRP certified firms and employees are EPA certified renovators or trained by a certified EPA RRP renovator. The Contractor shall document the firm's and renovator's certification numbers.
- H. The Contractor shall provide documentation to include:
 1. The Contractor's EPA RRP Firm Certification Number.

2. The Contractor's EPA RRP Renovator's Certification Number.
3. Documentation that all other non-certified employees have been trained on RRP practices by an EPA RRP Certified Renovator.
4. The Contractor is required to keep all documents for a minimum of three (3) years.

1.17 INSURANCE

- A. The contractors shall carry per General Conditions the following insurances:
 1. Workman's Compensation
 2. Lead Abatement Liability Insurance
 3. Manufacturer's and Contractor's Liability Insurance

1.18 CONTRACT ASSIGNMENT

- A. The contractor shall not assign this contract without written consent of the Program's representative. A request for written consent shall be approved by DOH. Eagle Environmental, Inc. must be informed prior to the assignment of this contract.

PART 2 - PRODUCTS

2.1 MATERIALS

- A. Deliver all materials in the original packages, containers, or bundles bearing the name of the manufacturer and the brand name and product technical description.
- B. Damaged or deteriorating materials shall not be used and shall be removed from the premises.
- C. Polyethylene sheet in a roll size to minimize the frequency of joints shall be delivered to job site with factory label indicating 6 mil.
- D. Polyethylene disposable bags shall be six (6) mil. Tie wraps for bags shall be plastic, five (5) inches long (minimum), pointed and looped to secure filled plastic bags.
- E. Tape or adhesive spray will be capable of sealing joints in adjacent polyethylene sheets and for attachment of polyethylene sheet to finished or unfinished surfaces of dissimilar materials and capable of adhering under both dry and wet conditions.
- F. Impermeable containers are to be used to receive and retain any lead containing or contaminated materials until disposal at an acceptable disposal site. (The containers shall be labeled in accordance with EPA and DOT standards.)
- G. HEPA filtered exhaust systems shall be used during any dust generating deleading operations.
- H. For manual scraping activities, Contractor shall supply each worker with multiple newly sharpened scrapers on a daily basis.
- I. Sanders, grinders, wire brushes and needle gun removal equipment shall be equipped with a HEPA filtered vacuum dust pick-up system.

- J. Other materials such as lumber, nails and hardware necessary to construct and dismantle the decontamination enclosures and the barriers that isolate the work area shall be provided as appropriate for the work.
- K. Machine Sanding Equipment - Sanders shall be of the dual action, rotary action, orbital or straight line system type, fitted with a high efficiency particulate air (HEPA) dust collection system.
- L. Air compressors utilized to operate this equipment shall be designed to continuously provide 90 to 100 psi or as recommended by the manufacturer.
- M. Heat Blower Gun Equipment: Any electric operated heat-blower gun used shall be a flameless electrical-paint-softener type. Heat-blower shall have electronically controlled temperature settings to allow usage below a temperature of 700 degrees Fahrenheit.
- N. Liquid encapsulants used on this project shall be an approved encapsulant by the State of Connecticut Department of Public Health.
- O. Paints and primers shall contain less than 0.06% lead in wet film.

2.2 REPLACEMENT AND COVERING MATERIALS

- A. Unless stated otherwise, all replacement materials/products, shall meet the minimum code requirements for such applications.
- B. All materials shall have Energy Star ratings where applicable.
- C. Paints and primers must be less than or equal to the following VOC levels: Flats 50 g/L; non-flats 50 g/L; floor paint 100 g/L. Grams per Liter (g/L) levels are based on a combination of the Master Painters Institute (MPI) and Green Seal standards.
- D. All caulks, sealants and adhesives must comply with Rule 1168 of the South Coast Air Quality Management District. All caulks, sealants must comply with regulation 8, rule 51 of the Bay Area Quality Management District.
- E. Unless stated otherwise, replacement windows, doors and other materials and products shall be of equal or better quality of those specified in this Lead-Based Paint Hazard Control Plan.
- F. All liquid encapsulants shall be approved by CT DPH for use in Connecticut.
- G. Exterior Entrance Doors
 - 1. Unless otherwise noted, new exterior doors must be 1 3/4" thick 24 gauge thermally broken galvanized and bonderized steel insulated core doors, with an adjustable sill, magnetic weather stripping, and 1 1/2 pair 3 1/2 x 3 1/2 loose pin butt hinges, use Thermo-Tru Steel Foam Core Insulated Exterior Doors or approved equal.
 - 2. Install single cylinder deadbolt plus passage set as manufactured by Schlage or equivalent. Provide owner with 2 keys for each lock.
 - 3. Door shall be accurately cut and fitted to frames and must operate freely without binding. Insulate between doorjamb and rough opening with spun fiberglass prior to trimming the interior of the door.

H. Storm Doors

1. Existing storm/screen doors are to be re-hung or replaced with similar units. If re-hung, they must be fully operational.

I. Interior Doors

1. Unless otherwise noted, install 1 3/8" hollow core luan door manufactured by Brosco or equivalent.
2. If a hollow core door doesn't meet building and/or CT Fire Safety Code, install a door to meet code.
3. Shim doors plumb, level and square. New doors shall be installed in pine jambs with 1 pair of 3" loose pin butt hinges. Fasten doors to rough framing through shims with 10-penny finish nails. Trim out both sides of new doors with finger jointed casings to match existing. Glue miters before fastening trim to jamb and wall. Fasten trim to walls with 6-penny finish nails and to jambs with 4-penny nails. Set heads of nails below surface of wood and fill with putty. Install passage set as manufactured by Schlage, Kwikset, Harlock or approved equal.

J. Wood Replacement Windows - Historic

1. Furnish and install new wooden sashes with full screens. Contractor must measure the bevel of the sill if it is different from 14 degrees. The bevel must be custom specified to manufacturer. Sashes shall have insulated double-glazing with non-corroding fiberglass screens in aluminum frames. Windows must have tilt in sashes, Low E glazing, and must comply with Emergency Escape requirement of the building code for all bedrooms. Grid pattern must match prior windows being replaced.
2. Windows shall be manufactured by Harvey, Weathershield, Marvin or equivalent. Submit for approval prior to ordering. Windows shall be installed in accordance with the manufacturer's recommendations.
3. Frames and sash shall be properly adjusted for tight closure and easy operation. Frames shall be thoroughly sealed at the interfaces with the walls prior to completion of finish work. Screw in and caulk edges to seal. Install jamb liners. Cut aluminum coil stock or vinyl to fit the window well.
4. Remove sashes from opening; disconnect weights and pullys from lower sash and salvage. Then scrape window glazing compound and remove glazing points and glass, use a mild paint removal product and conditioner for wood. Install glass panes and glazing with points as well as pully and weight system. Jamb liners and aluminum coil stock shall be installed in opening then window sashes. Window sashes shall not be installed until XRF testing is performed.

K. Vinyl Replacement Windows

1. Furnish and install new rigid vinyl replacement windows with 5/8" Low E double-pane insulating glass and non-corroding half-height lockable fiberglass screens in aluminum frames. Windows must have tilt in sashes, welded frames, cam and sash locks, and must comply with Emergency Escape requirement of the building code for all bedrooms.

2. Windows shall be manufactured by Harvey (Classic Series), Viking, Mercury-Excellum, North East (DH 100) or equivalent. Windows shall be installed in accordance with the manufacturer's recommendations.
3. Frames and sash shall be properly adjusted for tight closure and easy operation. Frames shall be thoroughly sealed at the interfaces with the walls (inside & out) prior to completion of finish work.
4. Refer to Architect's specification for specific requirements for replacement window systems.

L. Basement Vinyl Replacement Windows

1. Remove and discard as lead waste any leaded basement windows.
2. Furnish and install new vinyl replacement basement windows manufactured by Harvey, Viking, Mercury-Excellum or equivalent. Windows shall be installed in accordance with the manufacturer's recommendations.

M. Vinyl Siding

1. Siding shall be of first quality manufactured by Vipco, Certainteed, or equivalent. Color by Owner. Provide 50-year warranty. Apply Amocor XP38 fanfold insulation board or equivalent, following the manufacturer's instructions to enclose lead paint.
2. Replace lead-based paint containing components of attic vents or combination gable and soffit vents to meet ventilation requirements for roof and attic areas.
3. Install vinyl siding and aluminum or vinyl wrapped trim following manufacturer specifications.

N. Exterior Porch Flooring

1. Tongue & Groove flooring, if specified or requested as an Alternate, is to be 5/4" Fir or 3/4" Mahogany. When Plywood is specified, materials to be 1/2" Exterior Grade Plywood.
2. Include edge moldings to cover any exposed leaded materials. Caulk all seams. Prime & paint using sand or other non-slip additive.

O. Interior Porch Flooring

1. When specified, material to be 1/4" luan.
2. Include edge moldings to cover any exposed leaded materials. Caulk all seams.

P. Radiator Covers

1. Radiators must be restored to a sound substrate using high heat paint before the cover is installed.
2. Radiator covers must be removable (for example by unscrewing a bracket) in case repairs are necessary. The cover must be a professionally manufactured radiator cover or be made using metal grille mounted in a pine frame. Note that heat must be able to rise through the top as well. Plywood is not acceptable for use in radiator covers.

- Q. Sheetrock and wood enclosure materials shall meet current code requirements for such products and specified applications.
- R. Overhead Garage Doors
1. Furnish and install new overhead garage doors (number required to replace those removed) and any and all tracks, rails, springs, hardware, etc. to make operational. Hardware should include an outside handle and keyed lock for each door installed. The doors must be three-layer pressure bonded construction (steel + insulation + steel) construction. Standard Colors – Owner to choose any standard color available from Manufacturer. Warranty must be a minimum of 20 years from Manufacturer.
 2. Manufacturer to be Clopay or equal and meet Clopay's Premium Series specifications or equal. No automatic openers are to be included. If, however, the existing Overhead door units being replaced have automatic openers, contractor to reuse and make operable or replace with new unit(s).
 3. Submittal of Manufacturers catalog cuts with all pertinent information, including warranty information, to be submitted to Waterbury Health Department and Owner for approval prior to placing order.

PART 3 - EXECUTION

3.1 WORKER HYGIENE PRACTICES

- A. Workers shall don protective gear prior to entering work area including respirators, disposable coveralls, and footwear. No street clothes shall be permitted to be worn under protective clothing. The Contractor shall provide a clean area for workers to store street clothes and personal belongings.
- B. Eye protection, head protection, and ear protection shall be provided to each worker.
- C. While leaving respirators on, workers shall remove all gross contamination, debris, and dust from disposable coveralls and remove coveralls and footwear and place in hazardous waste disposal bag prior to leaving work area.
- D. The Contractor shall establish a wash station in close proximity to the work area where workers shall decontaminate their person. The wash station shall be supplied with warm water and soap and an ample supply of drying towels. Wash water shall be tested for proper disposal.
- E. All equipment used by workers inside the work area shall be wet wiped or bagged for later decontamination before removal from work area.
- F. The Contractor is responsible for using safe procedures to avoid electrical hazards. All temporary electrical wiring will be protected by GFIs.

3.2 WORK AREA PREPARATION

- A. Interior
1. The tenants are responsible for packing all personal items for removal out of proposed abatement area(s). The Lead Abatement Contractor shall move the personal belongings to an easily accessible area to maintain tenant access to their belongings.

2. The Lead Abatement Contractor shall conduct pre-cleaning activities including HEPA vacuuming floors and horizontal surfaces in the proposed work area.
3. The Lead Abatement Contractor shall remove all moveable objects from the proposed work area.
4. The Lead Abatement Contractor shall cover all non-moveable objects with a single layer of six (6)-mil polyethylene sheeting.
5. The Lead Abatement Contractor shall cover the floors with two (2) layers of six (6)-mil polyethylene sheeting.
6. The Lead Abatement Contractor shall cover ducts, diffusers, exhausts, windows, door openings or other penetrations with a single layer of six (6)-mil polyethylene sheeting.
7. The Lead Abatement Contractor shall post lead warning signs at all ingresses to the work area.
8. The Lead Abatement Contractor shall establish a worker decontamination facility adjacent to the work area(s). The decontamination facility shall be equipped with warm running water, soap, and drying towels.
9. The Lead Abatement Contractor may elect to construct mini-enclosures around the interiors of the windows or components scheduled for abatement. If mini-enclosures are not constructed, the entire room shall be treated as the work area and must be cleaned in accordance with this Specification.
10. Install six (6)-mil critical barriers over the interior of window openings if window will be removed from the exterior of the building.

B. Exterior

1. Cover all shrubbery, plantings, stoops, etc. with opaque tarps, which will prevent damage or burning from the sun.
2. Regulate the exterior work area with lead-warning tape. The lead warning tape shall extend around the perimeter of the work area creating a minimum of a ten (10)-foot buffer zone between abatement operations and the warning tape.
3. Post lead-abatement warning signs at conspicuous areas around the perimeter of the abatement area. Unauthorized personnel shall be prohibited from entering the abatement area.
4. Utilize six (6)-mil polyethylene sheeting on the ground and/or porch floors. The sheeting shall extend a minimum of ten (10) feet from the foundation of the building. Sheeting shall be secured to the foundation utilizing duct tape.
5. The edges of the sheeting shall be weighted to avoid blowing or lifting.

3.3 LEAD ABATEMENT PROCEDURES

A. Window Removal and Replacement Procedures

1. The Contractor shall conduct work area abatement preparation as specified in Sections 3.1 and 3.2 prior to conducting abatement activities.
2. The Contractor shall HEPA vacuum any loose or flaking paint from the component prior to removing the component.
3. The Contractor shall manually remove the window sashes in the following sequence:
 - a. Remove exterior window screens/storms where necessary and reinstall.
 - b. Remove interior window stops
 - c. Remove inner sash by cutting sash cords
 - d. Remove wood parting beads
 - e. Remove outer sash by cutting sash cords
4. Stabilize all loose paint on window jambs, wells and exterior sills. HEPA vacuum window jambs, wells and exterior sills.
5. Prior to installation of new vinyl windows, the Lead Abatement Contractor shall label the components containing lead-based paint with the warning "Danger: Lead-Based Paint" in permanent ink behind the enclosure.
6. The Lead Hazard Reduction Contractor shall Remove window sash weights from cavities and insulate the entire cavity of the window jambs and header with insulation prior to or after window installation. If the Lead Abatement Contractor chooses to use a spray foam insulation, the MSDS must be provided to the Program's consultant for approval prior to use.
7. Exterior blind window stops shall abut the new vinyl window. Exterior blind window stops shall be liquid encapsulated or enclosed with aluminum coil stock depending on the scope of work. Re-use interior stops. Replace at Contractor's cost broken or un-useable interior stops.
8. The Lead Abatement Contractor shall immediately place components into appropriate waste container. All components containing LBP that were removed during the abatement project shall be assumed to be hazardous waste until analytical results of the TCLP test are received. Metal components shall be recycled at an approved recycling facility.

B. Door Removal and Replacement Procedures

1. The Lead Abatement Contractor shall conduct work area abatement preparation as specified in Sections 3.1 and 3.2 prior to conducting abatement activities.
2. Where doors are to be replaced, remove the door from the hinges and remove the hinges from the jamb. Avoid damaging the existing jamb if it is to remain.

3. Reinstall the new door, hinges and appropriate hardware. Ensure the door is plumb and open and closes smoothly.
4. All doors shall be accurately cut and fitted to frames and must operate freely without binding.
5. Entry doors shall be insulated between the door jambs and rough opening with spun fiberglass prior to trimming the interior of the door.
6. Where door systems are to be replaced with pre-hung doors, remove the door, casing if necessary and avoid damage, then remove the door stop and door jamb.
7. Reinstall new pre-hung system, level and plumb. The door should open and close smoothly.
8. Re-install the door casing if removed. If the door casing was damaged during removal, install a new door casing to match existing trim.

C. Enclosure Procedures

1. The Lead Abatement Contractor shall conduct work area abatement preparation as specified in Sections 3.1 and 3.2 prior to conducting abatement activities.
2. The Lead Abatement Contractor shall stabilize all loose paint on components prior to enclosure.
3. The Lead Abatement Contractor shall label the components containing lead-based paint with the warning "Danger: Lead-Based Paint" in permanent ink behind the enclosure.
4. The Lead Abatement Contractor shall utilize materials that will provide a permanent enclosure designed to be effective for twenty (20) years.
5. Aluminum coil stock enclosures shall be fastened with manufacturer recommended materials. All seams shall be caulked with compatible non-asbestos caulk.
6. Rigid enclosure materials such as paneling, sheetrock and plywood shall be mechanically fastened in conjunction with a non-asbestos compatible adhesive. All seams shall be caulked and or compounded with a compatible non-asbestos material.

D. Liquid Encapsulation Procedures

1. The Lead Abatement Contractor shall conduct work area abatement preparation as specified in Sections 3.1 and 3.2 prior to conducting abatement activities.
2. HEPA vacuum and wet scrape all loose and flaking paint from each component to be encapsulated. The surface shall be rendered intact prior to de-glossing activities.
3. Clean each component to be encapsulated. Cleaning solutions shall be compatible to the liquid encapsulant that will be applied. Ensure that encapsulants are not applied over dirt, grease, mildew, rust, oil or chalk. Measures shall be taken to remove dirt, grease, mildew, rust, oil or chalk prior to encapsulation.

4. De-gloss each surface prior to encapsulation in accordance with the manufacturer's recommended procedures for de-glossing.
5. Conduct patch tests on each type of architectural component to be encapsulated. Where feasible, the size of the patch test shall be a minimum of fifteen (15) inches by fifteen (15) inches on each component. The surface shall be rendered intact, cleaned and de-glossed prior to performing the patch test. The encapsulant shall be allowed to dry and cure as required by manufacturer specifications.
6. Cut an "X" into the center of the patch test area ensuring that the cut goes entirely through the encapsulant to the substrate. Each cut shall be a minimum of two (2) inches long. Use the cutting tool to lift the encapsulant from the substrate at the intersection of the cutting points. If greater than one-half (1/2) inch of encapsulant is removed, the patch test fails.
7. Failure of a patch test shall require a second patch test to be performed. The same procedures shall be followed for the second patch test.
8. Fill gouges, holes, gaps, or other imperfections or damage, which may result in failure of the encapsulant. The damaged areas shall be repaired with materials compatible to the encapsulant.
9. Encapsulants shall not be applied when the air temperature of the room where encapsulants are to be applied is below forty (40) degrees F or above ninety-five (95) degrees F. In addition, relative humidity is not to be above eighty-five (85) percent or the temperature of the target surface is above the dew point. Document temperature, relative humidity and the temperature of the target surface on a daily basis. Encapsulation procedures may not be conducted when the temperature, relative humidity or target surface temperature are not in compliance with this section or with the manufacturer's specification, whichever is more stringent.
10. All encapsulants shall be applied in accordance with the manufacturer's specifications, including but not limited to temperature requirements, humidity requirements, mil thickness requirements, number of coats, application methods, surface preparation requirements, dry time, cure time, and tinting.
11. Encapsulants used for this project shall be an encapsulant that has been approved by the State of Connecticut Department of Public Health for use in the State of Connecticut.
12. All lead-based painted components and surfaces that are liquid encapsulated shall be placed on a Lead-Based Paint Management Plan for continual surveillance.

E. Paint Stabilization Procedures

1. The Contractor shall conduct work area abatement preparation as specified in Sections 3.1 and 3.2 prior to conducting abatement activities.
2. Lightly mist the surface to be stabilized with water. Wet scrape the surface with a drag scraper or putty knife to remove the loose paint. Continuously mist during scraping. Do not dry scrape.

3. Feather paint edges as necessary to remove high spots in paint that may be subject to future peeling.
4. Remove all raised paint edges that may be present on surfaces or components.
5. Surface contaminants that prevent adhesion should be removed by cleaning with a five (5) percent trisodium phosphate (TSP) and water solution. These contaminants generally include dirt, grease, and soap films.
6. Once all loose paint is removed, clean the surface with a five (5) percent TSP and water solution.
7. Wet wipe the surface with clean water. Allow to dry, prime and repaint.

F. Paint Removal Procedure

1. Complete all necessary work area preparation in each area prior to commencing abatement in that area.
2. Conduct on-site paint removal utilizing one (1) of the following approved methods or combinations thereof:
 - a. Heat gun (not to be operated over seven hundred (700) degrees F).
 - b. Power equipment with attached HEPA dust collection device
 - c. Chemical removal agent
3. Remove all layers of paint and or primers down to a bare substrate. The contractor is responsible for reducing lead levels below the toxic level on components where paint removal is specified.
4. Eagle Environmental, Inc. shall conduct on site XRF testing of abated components to determine completeness of paint removal. The component(s) shall not be considered completely abated until XRF measurements are below the toxic level as defined by State regulations.

G. Specialized Cleaning Procedures

1. Complete all necessary work area preparation in each area prior to commencing abatement in that area.
2. Follow the cleaning procedure described below for hard smooth or semi-porous surfaces:
 - a. Conduct a thorough HEPA vacuuming of the surface.
 - b. Wash the floor with a string mop equipped with wringer. Use a five (5) percent phosphate and water solution. Wring the mop into an empty bucket after each cleaning and before dipping the mop back into the cleaning solution.
 - c. Conduct a clean rinse mopping on the floor.
 - d. Conduct a second HEPA vacuuming of the surface.
3. Follow the cleaning procedure described below for area rugs:
 - a. HEPA vacuum the top side of the rug for one (1) minute per ten (10) square feet.

- b. Fold the rug in half and HEPA vacuum the back side of the rug and underlying floor at a rate of one (1) minute per ten (10) square feet.
 - c. Repeat Step 2 for the other half of the rug.
 - d. Unfold the rug and HEPA vacuum the top at a rate of two (2) minutes per ten (10) square feet.
4. Follow the cleaning procedure described below for carpet:
 - a. HEPA vacuum the carpet at a rate no faster than two (2) minutes per ten (10) square feet. Vacuum in a side-to-side motion.
 - b. HEPA vacuum the carpet in the opposite direction at a rate no faster than 2 minutes per 10 square feet. Vacuum in a side-to-side motion.

H. Soil Abatement Procedures

1. Complete all necessary work area preparation in each area prior to commencing abatement in that area.
2. Where soil is to be covered, perform the following:
 - a. HEPA vacuum and or rake surface soil to remove loose paint chips.
 - b. Remove small and large debris through raking or manual pick-up.
 - c. Install rolled weed guard material where specified.
 - d. Install the following covering materials at the specified depths:
 - 1) Bark Mulch – four (4) inch minimum depth.
 - 2) Top Dressing Topsoil – two (2) inch minimum depth.
 - 3) Gravel, Pea Stone, etc. – four (4) inch minimum depth.
3. Where soil is to be removed, perform the following:
 - a. Regulate work area around soil removal location(s).
 - b. Remove visible surface paint chips prior to soil removal.
 - c. Manually remove soil to specified depth. Lightly mist soil with water to reduce dust.
 - d. Place soil in appropriate waste container.
 - e. Apply replacement soil or materials as specified. Replacement soil must contain less than two hundred (200) mg/kg of lead.
4. Where ground cover is to be applied, perform the following:
 - a. Perform steps specified in 3.3 and/or 3.3.
 - b. Where grass seed is to be planted, utilize a K31 Fescue or equivalent hearty seed.
 - c. Prepare soil for planting by lightly raking and loosening soil.
 - d. Apply seed at manufacturer's recommended covering rate.
 - e. Cover with straw mulch and water.
 - f. Install temporary caution tape around planted areas.
 - g. Caution tape to be removed by Owner once grass is established.

3.4 CLEANING

A. Interior

1. The Contractor shall ensure that all tools and materials are adequately cleaned at the completion of each shift.
2. The Contractor shall remove all gross waste from the lead abatement area prior to conducting final cleaning operations. All waste shall be treated as hazardous until the analytical results from the TCLP tests are received.
3. The Contractor shall thoroughly HEPA vacuum all flat surfaces and components including polyethylene sheeting within and/or adjacent to the lead abatement work area.
4. The Contractor shall remove polyethylene sheeting from floors and non-moveable objects following the initial cleaning. Polyethylene sheeting shall be folded inwards from the corners and folded upon itself.
5. The following final cleaning shall be conducted following removal of polyethylene sheeting:
 - a. HEPA vacuum floors and horizontal surfaces.
 - b. Wet clean floors and horizontal surfaces with a five (5) percent phosphate solution
 - c. Conduct second HEPA vacuuming on floors and horizontal surfaces.
 - d. Wait twenty-four (24) hour for dust settlement period.
 - e. Repeat steps a, b and c.

3.5 FINISH WORK AND WORKMANSHIP

- A. Refer to the project Architect's specifications for finish work and workmanship requirements.

3.6 DISPOSAL OF WASTE MATERIALS

A. The Contractor shall perform the following:

1. Assure that all waste is properly disposed of according to local, state and federal law and regulations and at the minimum practical cost.
2. All waste should be considered hazardous lead waste. The Contractor is responsible for proper disposal of all waste generated during the project.
3. All primary waste materials generated during lead hazard reduction, i.e. windows, doors, wood components, plaster, etc. shall be characterized for proper disposal utilizing the TCLP method. The cost associated with the TCLP sampling and analysis shall be the responsibility of the Contractor.
4. All secondary waste materials generated during lead hazard reduction, i.e. disposable clothing, polyethylene sheeting, waste water, etc., shall have confirmatory TCLP testing to determine waste characterization. This testing shall be performed and paid for by the Contractor.

5. The Lead Abatement Contractor shall comply with the requirements for small quantity generators (generates between one hundred (100) kg and one thousand (1000) kg of hazardous waste in a month or accumulates no more than one thousand (1000) kg of hazardous waste on-site at any one time and stores waste for no greater than ninety (90) days).
6. The Contractor shall ensure that all hazardous waste generated is sent off-site to permitted hazardous waste treatment, storage, or disposal facilities (TSDF).
7. The Contractor shall use DEEP permitted transporters for transport of hazardous waste.
8. The Contractor shall apply for a temporary EPA identification number, where applicable. Hazardous waste manifests must be utilized which bear this I.D. number.
9. The Contractor must comply with hazardous waste containerization requirements including but not limited to maintaining the containers in good condition, keeping containers closed and locked while in storage, properly labeling and dating containers, and using containers which are DEEP approved for over the road use.
10. The Contractor shall develop a written inspection schedule to inspect any containers of hazardous waste at least weekly.
11. The Contractor must designate an emergency coordinator who will be responsible for coordinating emergency response measures. Basic emergency information must be listed in writing, and posted next to the on-site telephone. This information must include the name and number of the emergency coordinator.
12. The Contractor must develop a written contingency plan for the site, which describe actions personnel will take in response to fires or other emergencies that may result in a release of hazardous waste constituents. The plan must meet certain content requirements and copies of the plan must be submitted to certain local emergency response officials.
13. The Contractor must provide written notification to local fire departments and/or police regarding the location, nature, and duration of the lead-removal project, and regarding the type and quantity of hazardous waste that may be stored at the site.
14. The Contractor must train their employees in hazardous waste management. They must maintain certain documentation regarding their training program, including the names, job titles, and job descriptions of the employees involved with hazardous waste management, a written description of the training that is given, and records documenting that employees have been trained. Annual updates of training must also be given.
15. The Contractor may not store hazardous waste on-site for greater than ninety (90) days without a TSDF permit.
16. Before leaving the site for the last time, the Contractor must remove any remaining hazardous waste and must decontaminate any equipment, storage areas, structures, soil, etc. contaminated as a result of the removal or storage of the hazardous waste generated at the site.

B. Contractor and Owner shall comply with the following:

1. Contractor agrees to assume responsibility of all waste. The homeowner will not participate with the waste disposal in any way.

3.7 POST ABATEMENT CLEARANCE

- A. The Lead Abatement Contractor must perform a visual inspection to determine whether dust, debris or residue is still present. If present, the abatement area shall be re-cleaned following the specified cleaning procedures.
- B. Dust sampling by the Program's Consultant shall be performed in each interior area where lead-hazard reduction work was performed. This includes specialized cleaning procedures and window replacement procedures performed from the exterior of the building.
- C. The following criteria must be met for final clearance dust wipe samples where renovation work is performed:
 1. Floors: 40ug/ft²
 2. Window Sills: 250ug/ft²
 3. Window Wells: 400ug/ft²
- D. Clearance dust wipe samples that fail shall be re-cleaned at the Contractor's expense until dust wipe sampling meets the applicable criteria.
- E. Final visual inspections of the exterior work area(s) shall be performed by the Program's Consultant to evaluate completeness of the work.

3.8 RECORDKEEPING

- A. The Contractor must retain and, if requested, make available to EPA all records necessary to demonstrate compliance with the RRP Rule for a period of 3 years following completion of the renovation.
- B. The Contractor must retain the following records and provide a copy to Program's Consultant at the completion of the project:
 1. Records or reports certifying that a determination had been made that lead-based paint was not present on components affected by the renovation including reports by a State of Connecticut licensed Lead Inspector, records by a Certified Renovator after using EPA-recognized test kits, including an identification of the manufacturer and model of any test kits used, a description of the components that were tested including their locations, and the results of each test kit used.
 2. Signed and dated acknowledgement of receipt of notification dissemination of pamphlet.
 3. Certifications of attempted delivery of pamphlet.
 4. Certificates of mailing of pamphlet.

5. Records of notification activities performed regarding common area and child occupied facilities renovations.
6. Documentation of compliance that a certified renovator was assigned to the project, the certified renovator provided on-the-job training for workers used on the project, the certified renovator performed or directed worker who performed all the tasks, the certified renovator performed the post-renovation cleaning verification.

**TABLE A
SCOPE OF WORK
181 TRUMBULL AVENUE
BRIDGEPORT, CONNECTICUT**

Item #	Room	Component	Side	Quantity	Abatement Method
INTERIORS					
1	Basement (001)	Column	-	All	Liquid Encapsulate
2		Window trim	B, D	2 Openings	Liquid Encapsulate
3		Door casing, door jamb, door stop	C	1 Opening	Strip friction/impact surfaces and liquid encapsulate remaining trim
4	Living Room (003)	Window casings, window sills, window stops	A, B, D	5 Openings	Liquid Encapsulate
5		Window trim components (on small window by stairs)	D	1 Opening	Liquid Encapsulate
6		Stair risers	-	All	Enclose risers with luan, install metal nosing at edges and caulk seams
7	Kitchen (004)	Door headers	A	2 Openings	Liquid Encapsulate
8		Window casings, window sills, window stops	B, D	2 Openings	Liquid Encapsulate
9		Closet walls, shelf support	A	All	Liquid Encapsulate
10		Stair risers	-	All	Enclose risers with luan, install metal nosing at edges and caulk seams
11	Rear Stair (006)	Wall	A	10 SF	Patch hole with new sheetrock, joint compound and liquid encapsulate
12		Baseboard	A, B, C, D	All	Liquid Encapsulate
13		Stair risers	-	All	Enclose risers with luan, install metal nosing at edges and caulk seams
14		Window sills	B, C, D	All	Specialized cleaning
15	Rear Stair (011)	Door casing, non-friction door jamb, non-friction door jamb stop (no door)	A	1 Opening	Liquid Encapsulate
16		Door threshold	A	1 Each	Replace with new threshold

**TABLE A
SCOPE OF WORK
181 TRUMBULL AVENUE
BRIDGEPORT, CONNECTICUT**

Item #	Room	Component	Side	Quantity	Abatement Method
EXTERIORS					
17	Facades	Window casings, window sills, window blindstops	A, B, C, D	21 Openings	Liquid Encapsulate
18		Original double hung wood window sashes	A, B, C, D	8 Openings	Replace with new vinyl window systems
19		Basement window sashes, window casings, window sills	B, D	2 Openings	Replace with new vinyl window systems and liquid encapsulate the remaining window trim components.
20		Vinyl and wood replacement window systems (See window replacement schedule - V-15, RW-17)	B, C	2 Openings	To be replaced per architects spec. The original jambs are assumed to be underneath the replacement window. Paint stabilize original jamb and enclose with new vinyl window system.
21		Upper trim, soffits, fascias	A, B, C, D	All	Liquid encapsulate (Replace damaged/rotted wood per architect's specification)
22		Drip line	C	90 SF	Install 2 inches of new loam, grass seed and straw

PROJECT ADDRESS: 181 TRUMBULL AVENUE, BRIDGEPORT
PROJECT NUMBER: 14-028.12T23

WINDOW REPLACEMENT SCHEDULE			
Location of Windows to be Replaced (From the Interior)	Side	Window ID #	Picture*
Living Room (003)	D	OW-10	
Kitchen (004)	B	OW-07	
	D	OW-09	
Bedroom 2 (008)	A	OW-13	X
Rear Stair (011)	B	OW-16	
	C-Left	OW-18	X
	C-Right	OW-19	X
	D	OW-20	X
WINDOW TOTALS:		Full Sized: 8 Basement: 2	

***NOTE: See attached photo log.**

Pictures = Windows that were either sealed off, sealed shut or blocked by furniture, preventing friction points from being inspected.

EAGLE ENVIRONMENTAL, INC
8 SOUTH MAIN STREET, SUITE #3, TERRYVILLE, CT

WINDOW REPLACEMENT PHOTO LOG

Project No.: 14-028.12T23

Project Name: 181 Trumbull Avenue, Bridgeport

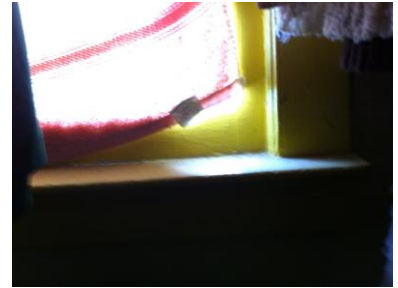


Photo #1:	Bedroom 2 OW-13
-----------	-----------------

Photo #2:	Rear Stair OW-18, 19
-----------	----------------------

Photo #3:	Rear Stair OW-20
-----------	------------------

CAPITAL STUDIO ARCHITECTS

181 TRUMBULL AVENUE
BRIDGEPORT, CONNECTICUT

EAGLE PROJECT NUMBER: 14-028.12T23

INDEX OF DRAWINGS

SP-1 SITE PLAN
FP-1 BASEMENT PLAN
FP-2 FIRST FLOOR PLAN
FP-3 SECOND FLOOR PLAN

LOCATION MAP



SEPTEMBER 4, 2014



8 SOUTH MAIN STREET, SUITE 3
TERRYVILLE, CONNECTICUT 06786
860-589-8257

SIDE-C

WINDOW KEY:

- B = BASEMENT
- BD = BOARDED UP
- OW = OLDER OR ORIGINAL WOOD SASH (TESTED POSITIVE FOR LEAD-BASED PAINT)
- V = VINYL SASH

SIDE-B

SIDE-D

B/OW-01

B/OW-02

BASEMENT
001

Plexi-glass

BASEMENT

NOT TO SCALE

SIDE-A (STREET SIDE)



EAGLE
Environmental, Inc.

8 SOUTH MAIN STREET, SUITE 3
TERRYVILLE, CONNECTICUT 06786
860-589-8257

SHEET NO.

FP-1

SHEET 2 OF 4

DATE: 07/31/2014
PROJECT NO.: 14-028.12-T23
DRAWN BY: VB
REVIEWED BY: AH

ENVIRONMENTAL REVIEW
181 TRUMBULL AVENUE
BRIDGEPORT, CONNECTICUT

SIDE-C

WINDOW KEY:

B = BASEMENT

BD = BOARDED UP

OW = OLDER OR ORIGINAL WOOD SASH (TESTED POSITIVE FOR LEAD-BASED PAINT)

V = VINYL SASH

RW = WOOD REPLACEMENT WINDOW (TESTED NEGATIVE FOR LEAD-BASED PAINT)

RW-08

REAR STAIR 006

BD (PLYWOOD)

BATH 005

KITCHEN 004

OW-09

SIDE-B

OW-07

OW-10

SIDE-D

C

LIVING ROOM 003

V-11

V-05 V-06

V-04

FOYER 002

V-03

FIRST FLOOR

NOT TO SCALE

SIDE-A (STREET SIDE)



EAGLE
Environmental, Inc.

8 SOUTH MAIN STREET, SUITE 3
TERRYVILLE, CONNECTICUT 06786
860-589-8257

SHEET NO.

FP-2

SHEET 3 OF 4

DATE: 07/31/2014
PROJECT NO.: 14-028.12-T23
DRAWN BY: VB
REVIEWED BY: AH


ENVIRONMENTAL REVIEW
181 TRUMBULL AVENUE
BRIDGEPORT, CONNECTICUT

SIDE-C

WINDOW KEY:

- B = BASEMENT
- BD = BOARDED UP
- OW = OLDER OR ORIGINAL WOOD SASH (TESTED POSITIVE FOR LEAD-BASED PAINT)
- V = VINYL SASH

RW = WOOD REPLACEMENT WINDOW (TESTED NEGATIVE FOR LEAD-BASED PAINT)

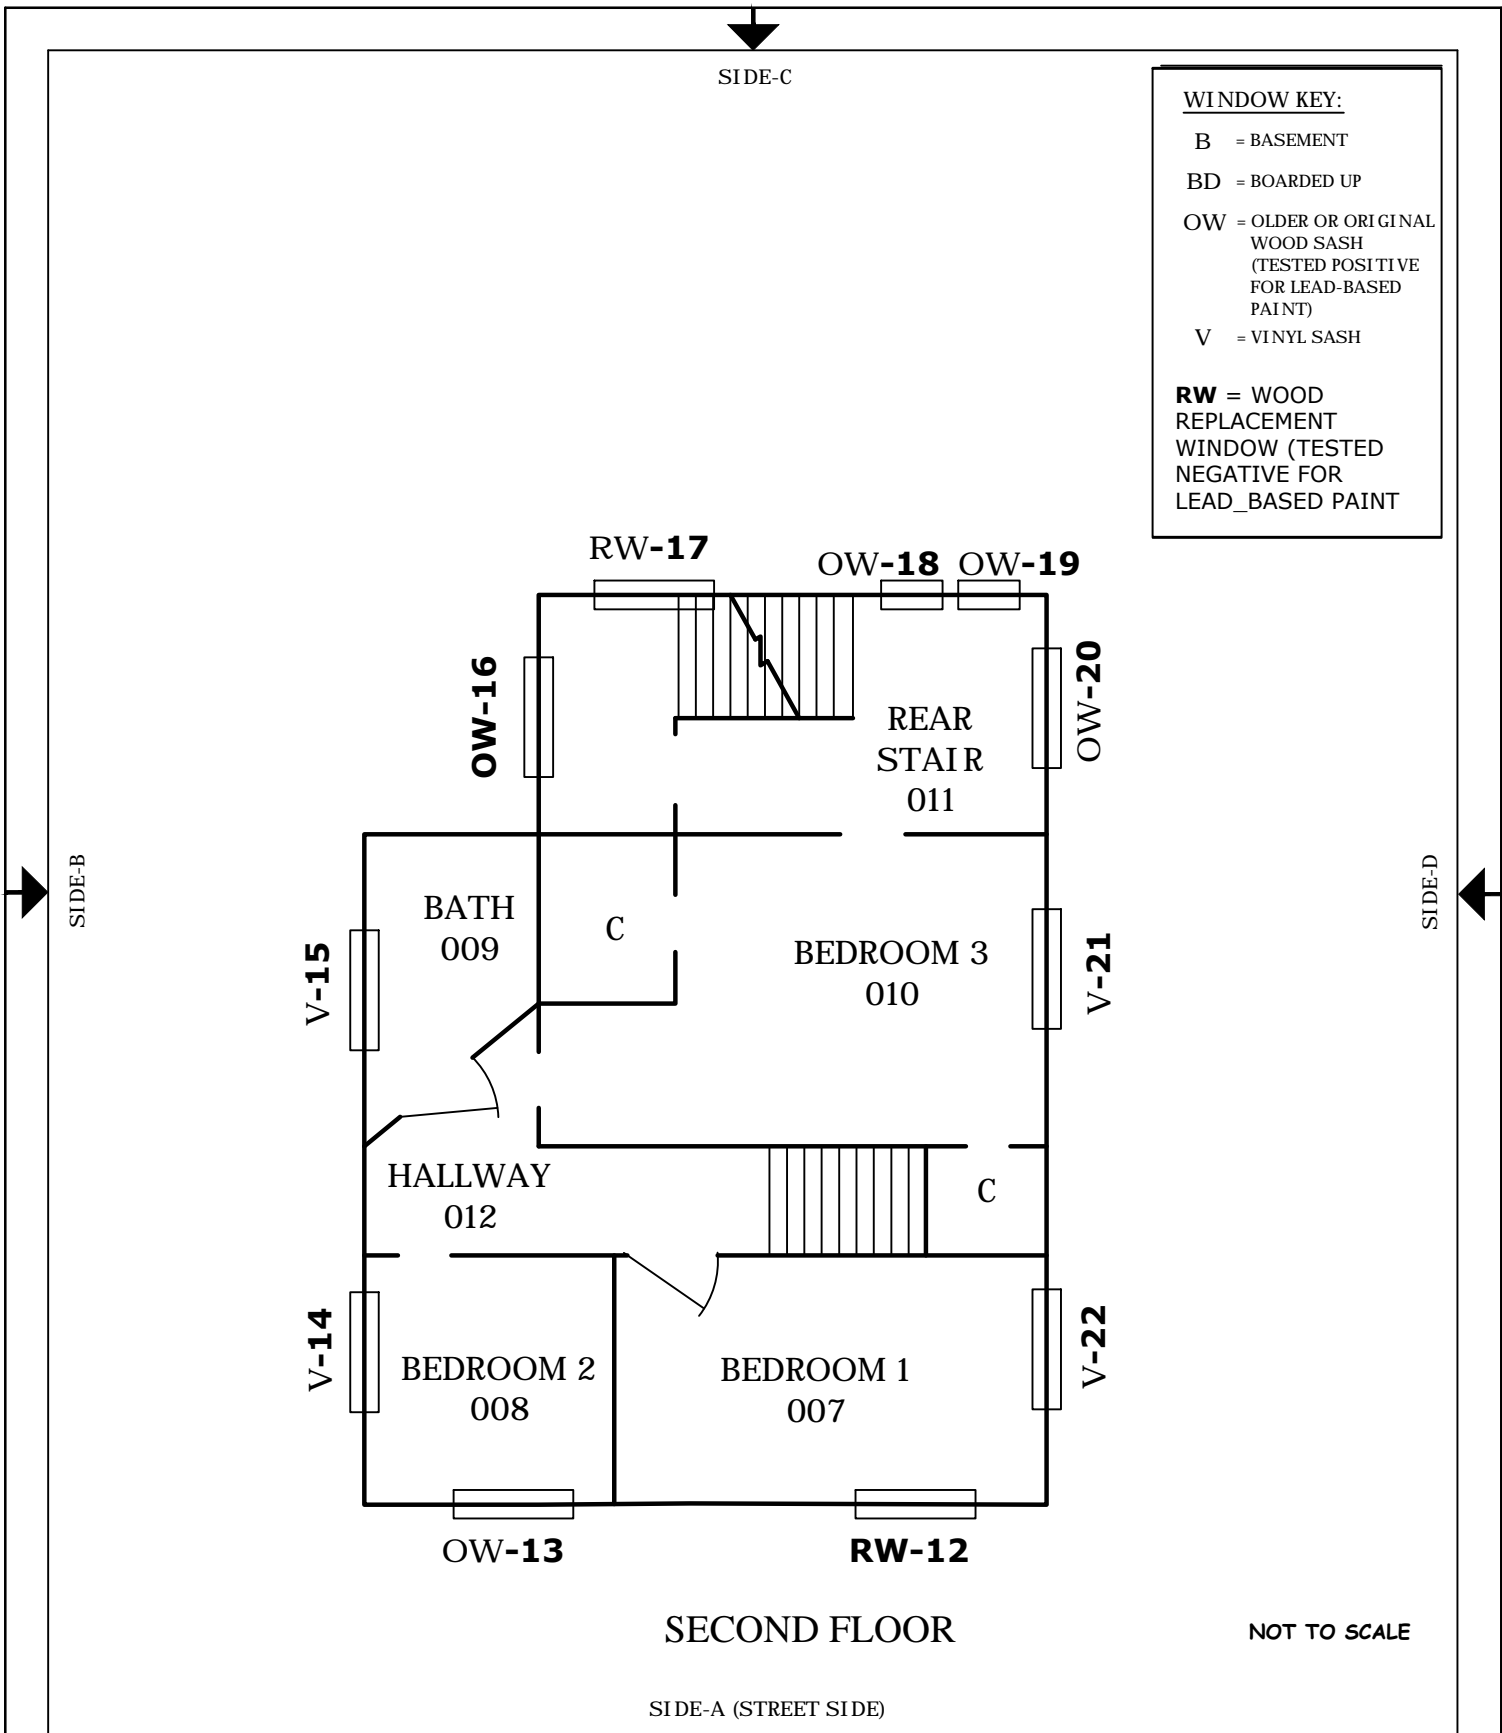

SECOND FLOOR

NOT TO SCALE

SIDE-A (STREET SIDE)



8 SOUTH MAIN STREET, SUITE 3
 TERRYVILLE, CONNECTICUT 06786
 860-589-8257


SHEET NO.

FP-3

SHEET 4 OF 4

DATE: 07/31/2014
 PROJECT NO.: 14-028.12-T23
 DRAWN BY: VB
 REVIEWED BY: AH

ENVIRONMENTAL REVIEW
 181 TRUMBULL AVENUE
 BRIDGEPORT, CONNECTICUT

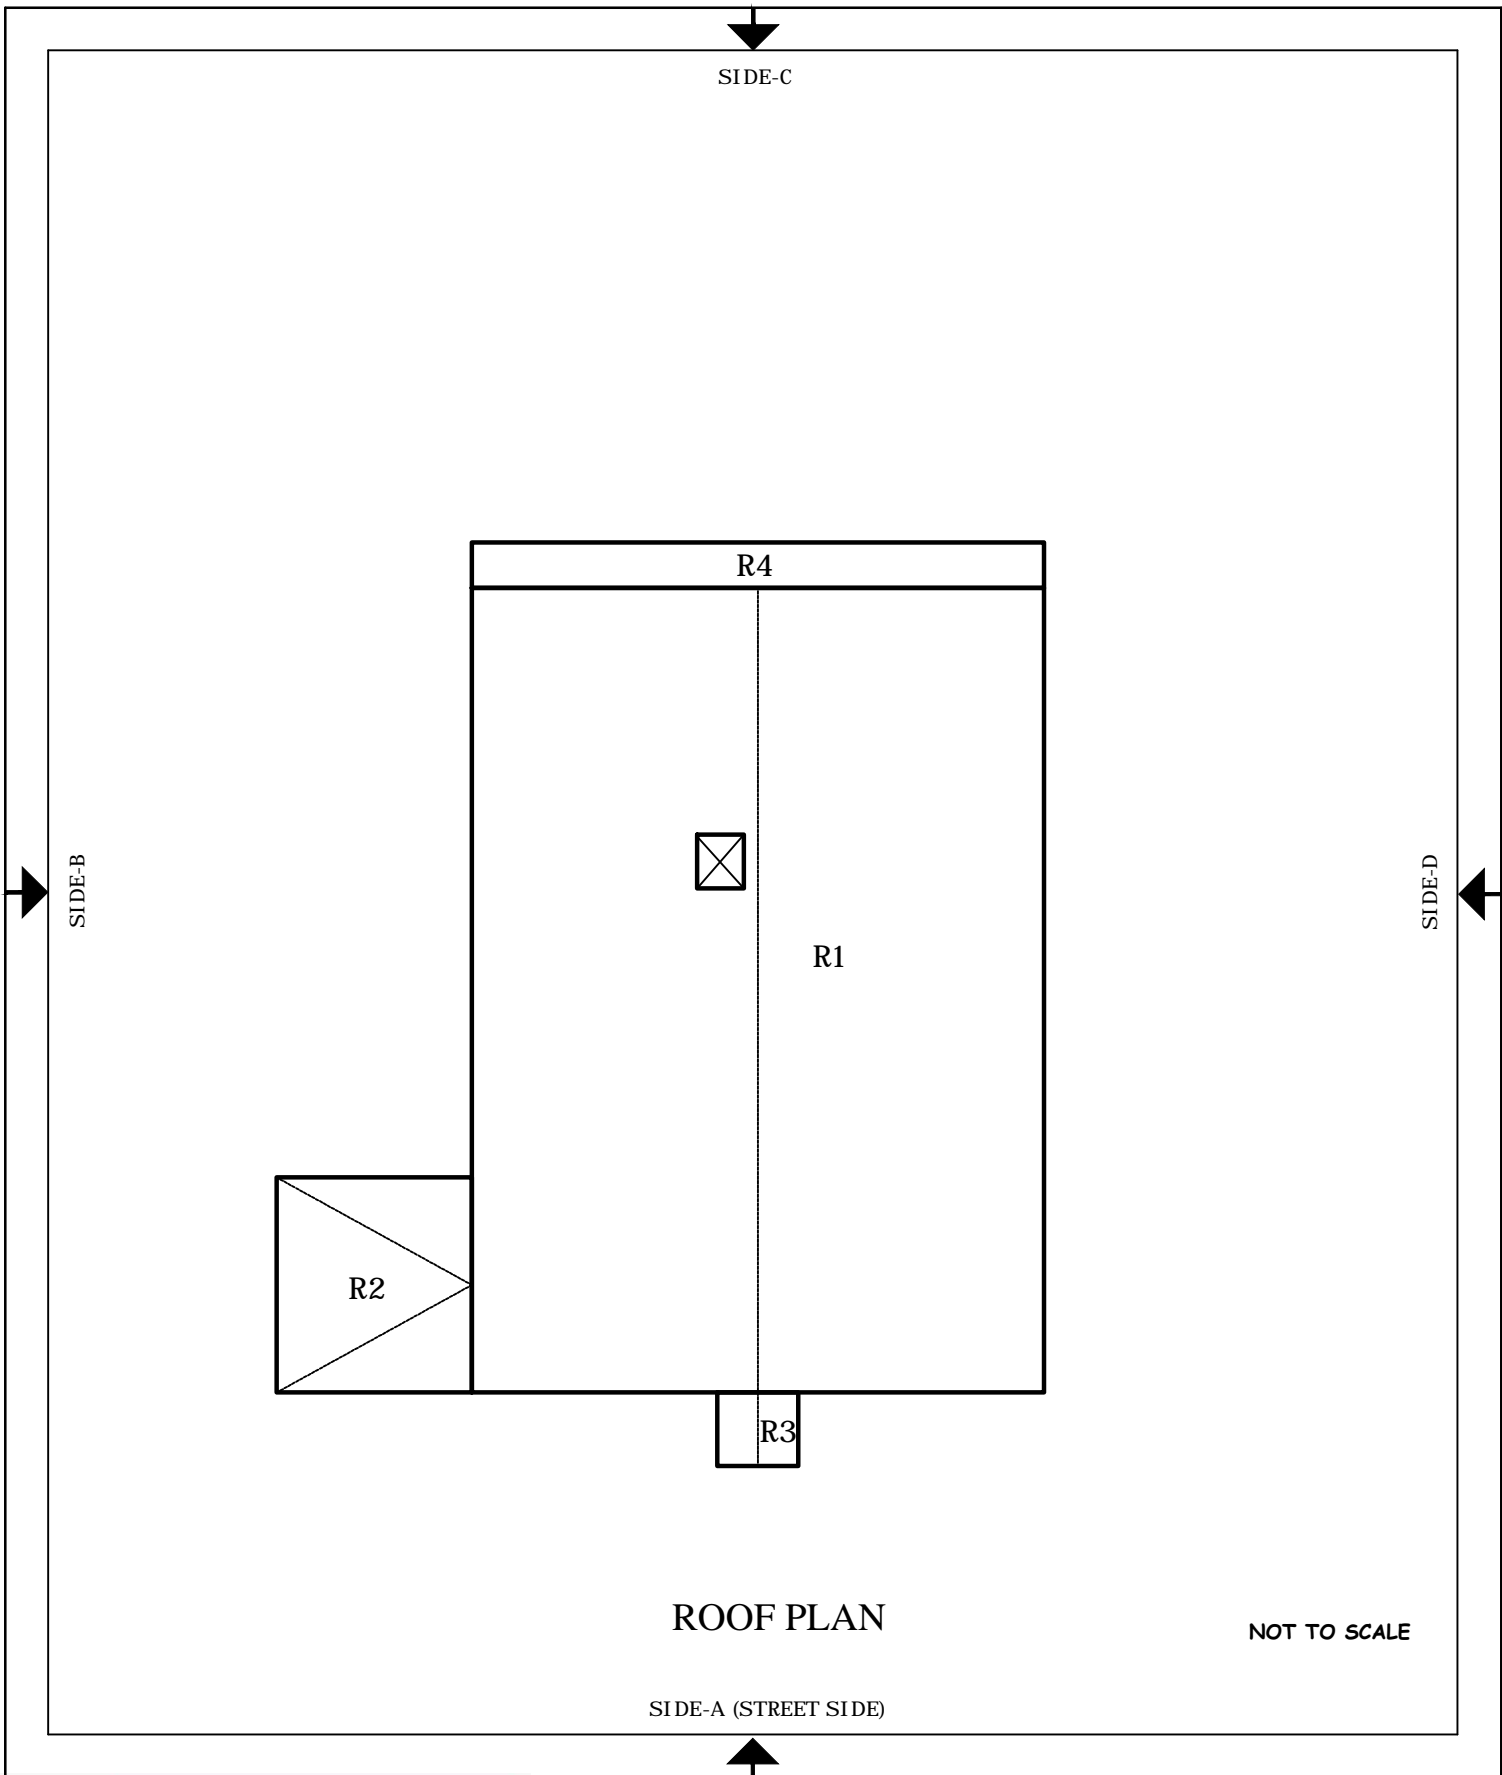

ROOF PLAN

NOT TO SCALE

SIDE-A (STREET SIDE)



8 SOUTH MAIN STREET, SUITE 3
 TERRYVILLE, CONNECTICUT 06786
 860-589-8257

SHEET NO.

FP-4

SHEET 5 OF 5

DATE: 09/03/2014
 PROJECT NO.: 14-028.12T23
 DRAWN BY: VB
 REVIEWED BY: AH


ENVIRONMENTAL REVIEW
 181 TRUMBULL AVENUE
 BRIDGEPORT, CONNECTICUT

SIDE-C

SAMPLE KEY:

■ = NUMBER AND
7/30 AH LOCATION OF SOIL
SOIL-01 SAMPLES

**BOLD TEXT INDICATES
A SOIL-LEAD HAZARD
FOUND**

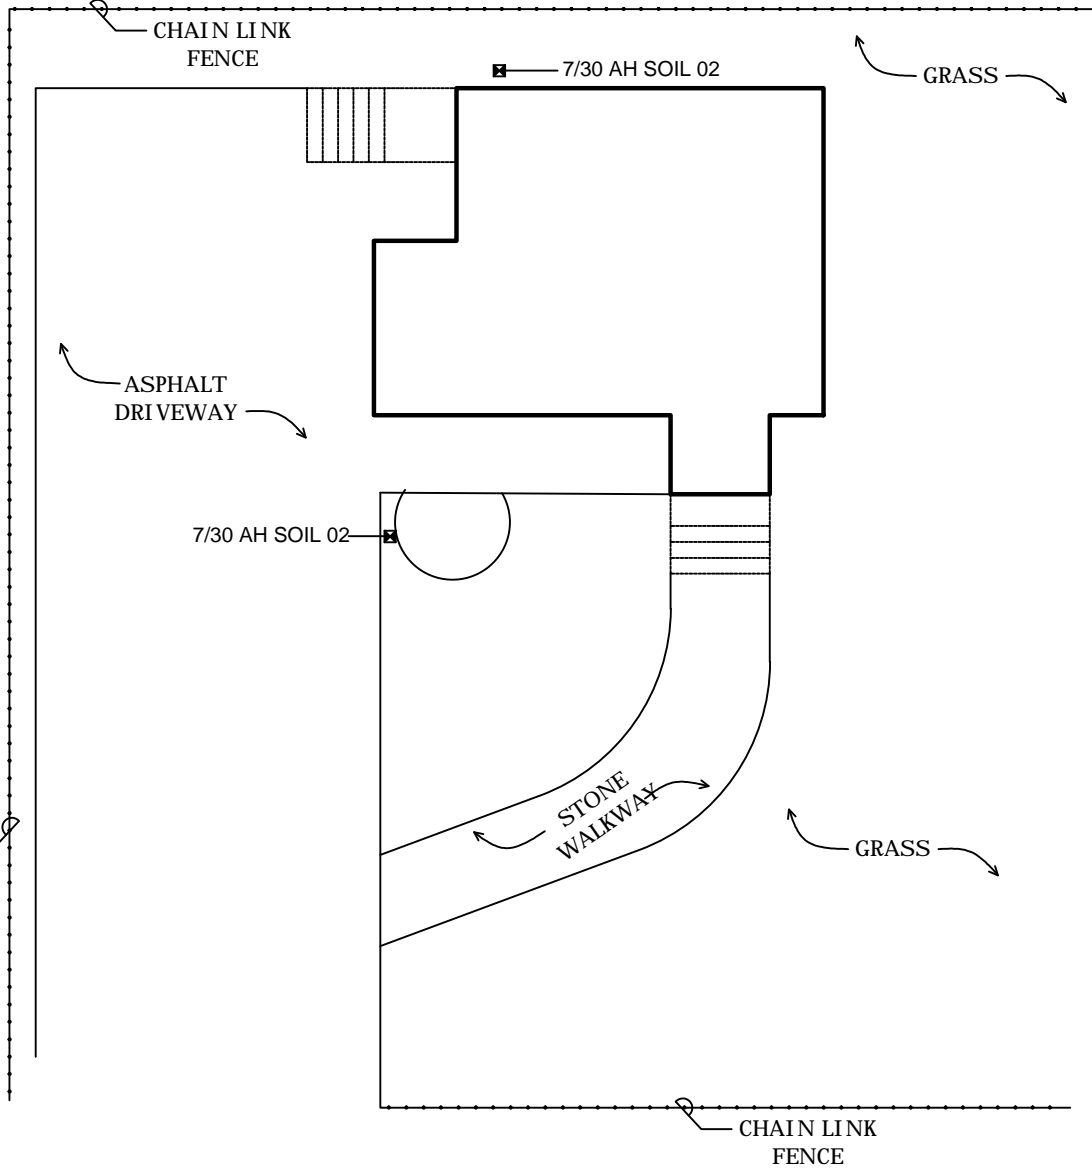

SIDE-B

SIDE-D

SITE PLAN

NOT TO SCALE

SIDE-A (STREET SIDE)



EAGLE
Environmental, Inc.

8 SOUTH MAIN STREET, SUITE 3
TERRYVILLE, CONNECTICUT 06786
860-589-8257

SHEET NO.

SP-1

SHEET 1 OF 4

DATE: 07/31/2014
PROJECT NO.: 14-028.12-T23
DRAWN BY: VB
REVIEWED BY: AH

ENVIRONMENTAL REVIEW
181 TRUMBULL AVENUE
BRIDGEPORT, CONNECTICUT

The State of Connecticut
Department of Housing (DOH)
Community Development Block Grant
Disaster Recovery Program (CDBG-DR)
DOH Occupied Rehabilitation and Rebuilding Program (OORR)

Bid Package for
Rogers Residence
181 Trumbull Avenue
Bridgeport, Connecticut 06606
Project # 2237

-END OF SECTION-

\\Eagle-server\public\2014 Files\2014 Specs\CSA - Capital Studio Architects\Hurricane Sandy\181 Trumbull Ave, Bridgeport\020900 \$25K -
LBP Abatement.docx

SECTION 020920
MOLD AND WATER REMEDIATION

PART 1 GENERAL

1.1 BACKGROUND

- A. A Mold and Moisture Assessment was conducted by Eagle Environmental, Inc. (Eagle) in the areas of the building scheduled for renovation at 181 Trumbull Avenue in Bridgeport, Connecticut. The Mold and Moisture Assessment was performed in response to water intrusion into the building during Storm Sandy (Event).
- B. Mold and water remediation and general renovation work is being performed to repair specific areas of the structure impacted during the Event.
- C. The work is being performed under the State of Connecticut Department of Housing Community Development Block Grant - Disaster Recovery Program (Program). Mold and moisture testing has identified materials that contain microbial growth and/or are holding high levels of moisture as a result of Storm Sandy. The work covered in this section includes the minimum procedures that shall be employed during the remediation of microbial and moisture impacted building materials.
- D. Information obtained through the site visits was used as the basis for this mold and moisture remediation specification. The scope of work was developed from this information based on site condition at the time of the site visits.

1.2 GENERAL PROVISIONS

- A. The work covered in this section includes the procedures that shall be employed during the remediation of mold and water impact at the Site.
- B. The goal of this remediation is to clean and disinfect or remove and dispose of water and/or mold impacted materials from areas of proposed renovation or repair work at the Site and in conjunction with planned renovation and repair work.
- C. The surfaces and/or areas requiring microbial and water remediation within the Rear Stair 2nd Floor (011) of the structure include the following:
 - 1. Impacted wood ceiling and associated wood framing, sheathing, joists and insulation.
 - 2. Impacted wood support beam along the exterior "C" wall
 - 3. Impacted wood window system and adjacent dry wall and associated insulation.

1.3 RELATED DOCUMENTS

- A. Drawings and General Provisions of the Owner Contractor Agreement and the General Conditions of the contract apply to this Section.
- B. Architect's Plans and Specifications
- C. Environmental Assessment Report Dated September 4, 2014

- D. Section 020800 Asbestos Abatement
- E. Section 020900 Lead-Based Paint Abatement
- F. Section 020940 Radon Mitigation

1.4 PROJECT DESCRIPTION

- A. Coordinate the work of this Specification with the General Contractor and the Owner and Eagle Environmental, Inc. (Architect's Representative).
- B. The work to be performed by the Remediation Contractor includes:
 - 1. Remediation of water impacted building materials throughout the Rear Stair 2nd Floor (011).
 - 2. Disinfect all remaining surfaces including but not limited to wall surfaces, studs, wall plates, framing, floors with an appropriate biocide and/or antimicrobial. Antimicrobials and/or biocides used in the remediation should be listed in the Environmental Protection Agency (EPA) Federal Insecticide, Fungicide, and Rodenticide FIFRA database and used in strict accordance with the manufacturer's recommendations
 - 3. Drying all surfaces to within two points of the "dry standard" determined by the Architect's Representative.
 - 4. All work shall be done in accordance with the recommendations of the Institute of Inspection, Cleaning, and Restoration Certification (IICRC) S-500, Standard and Reference Guide for Professional Water Damage Restoration – Third Edition, the IICRC S-520, Standard and Reference Guide for Professional Mold Remediation – Second Edition, and the Connecticut Department of Public Health, Guidance for Mold Abatement Contractors.

1.5 SCOPE OF WORK

- A. Observations and data obtained during the site visits represent conditions during that time span only. Moisture content, fungal ecology, moisture content of building materials, and psychometric variables are intrinsically dynamic and can vary dramatically and impact the scope of work. The Remediation Contractor shall verify conditions and quantities prior to submitting bid.
- B. The work specified herein shall be the removal, cleanup and remediation of water impacted materials by persons who are knowledgeable, qualified, and trained in the cleaning, removal, treatment, handling, and disposal of these materials (Remediation Contractor).
- C. The specific Scope of Work includes the following for the Rear 2nd Floor:
 - 1. Removal and disposal of existing wood ceiling and associated insulation. Insulate ceiling space with fiberglass bat insulation and install new gypsum ceiling. Tape and paint.
 - 2. Removal and disposal of one (1) impacted wood window system (Refer to Section 020800 and 020900 for additional requirements)

3. Removal of gypsum wall board and insulation 24" in each direction of existing wood window. Insulate exposed wall cavity and install gypsum wall board. Tape and paint.
 4. Replacement of rotted sill/framing on exterior wall.
 5. Microbial cleaning of all exposed surfaces in stairwell followed by drying of wood framing.
- D. The Remediation Contractor shall have a "Competent Person" in control on the job site at all times during the microbial remediation. This person must comply with this specification and the standards set forth in the Institute of Inspection, Cleaning, and Restoration Certification (IICRC) S-500, Standard and Reference Guide for Professional Water Damage Restoration – Third Edition, the IICRC S-520, Standard and Reference Guide for Professional Mold Remediation – Second Edition, and the Connecticut Department of Public Health, Guidance for Mold Abatement Contractors.
- E. Deviations from this Specification require the written approval of the Architect's Representative.
- F. Any damage caused during the performance of remediation activities shall be repaired by the Remediation Contractor (e.g., paint peeled off by barrier tape, nail holes, water damage, broken glass, etc.) will be the sole responsibility of the Remediation Contractor. The Remediation Contractor is responsible for protecting all objects in work areas that are permanent fixtures or too large to remove (except those which will be removed as part of the remediation or renovation such as roofing materials).
- G. The Remediation Contractor shall be responsible for the following general requirements:
1. Obtain all approvals and permits, and submit all notifications as required.
 2. Provide, erect, and maintain all bracing, barricades, and warning signs.
 3. Unless otherwise specified, all debris resulting from remediation shall become the property of the Remediation Contractor and shall be removed from the premises.
 4. Materials to be reused shall be cleaned and removed with the utmost care to prevent damage of any kind. All material to be reused shall be stored as directed.
 5. If signs of water damage or mold growth are revealed during remediation then contact the Architect's Representative for direction of how to proceed;
 6. Remove and dispose of all stained, damaged, wet, or moldy materials exposed by the work of this project;
 7. Disinfect all newly exposed substrates; and,
 8. Materials not scheduled for reuse shall be removed from the site and disposed of in accordance with all applicable Federal, State and Local requirements.
- H. It shall be the responsibility of the Remediation Contractor to protect and preserve in operating condition all utilities traversing the building and site. Damage to any utility due to work under this Contract shall be repaired to the satisfaction of the Architect at no cost to the Owner.

1.6 EXEMPTIONS

- A. Any deviation from these specifications requires the written approval and authorization from Architect's Representative.

1.7 QUALITY ASSURANCE

- A. The Remediation Contractor shall be responsible for maintaining compliance with the requirements of this specification section. If at any time during the course of the work, conditions arise that will affect the successful completion of this project and are not specifically addressed in this section, the Remediation Contractor shall immediately notify the Architect or Architect's representative.
- B. Applicable Codes
 1. The Remediation Contractor shall be solely responsible for conducting this project and supervising all work in a manner that will be in conformance with all federal, state and local regulations. This includes all local building codes.
- C. Description of Work
 1. The Remediation Contractor shall supply all labor, materials, equipment, services, insurance, and incidentals, which are necessary or required to perform the work in accordance with applicable governmental regulations and these specifications.
 2. The remediation work shall include the removal and/or cleaning of the following:
 - a. Removal and disposal of existing wood ceiling and associated insulation. Insulate ceiling space with fiberglass bat insulation and install new gypsum ceiling. Tape and paint.
 - b. Removal and disposal of one (1) impacted wood window system (Refer to Section 020800 and 020900 for additional requirements)
 - c. Removal of gypsum wall board and insulation 24" in each direction of existing wood window. Insulate exposed wall cavity and install gypsum wall board. Tape and paint.
 - d. Replacement of rotted sill/framing on exterior wall.
 - e. Microbial cleaning of all exposed surfaces in stairwell followed by drying of wood framing.
 - f. Decontamination of all exposed surfaces including but not limited to wood framing, floors, walls, ceilings, miscellaneous fixed items.
 - g. Dry all surfaces scheduled to remain in accordance with this Specifications.
 - h. Treat wood framing with anti-microbial sealant.
- D. Work area preparation
 1. Isolate work areas from adjacent indoor areas with critical barriers
 2. Establish airlocks and change rooms at indoor work areas
 3. Establish a negative pressure differential between indoor work areas and adjacent indoor areas

4. Isolate HVAC system where applicable
 5. Post warning signage.
 6. Regulate access to work areas
- E. Remediation:
1. Remove and dispose all scheduled impacted materials.
 2. Remove all visible mold from exposed surfaces and surfaces that become exposed during the work.
- F. Cleaning:
1. Brush, sand, or scrub specified building components including framing, floors, walls, miscellaneous items to remain as necessary to remove all visible debris and/or contamination within the limits of the defined locations. If the integrity of the framing or other building components is compromised, then remove and dispose of as required per unit price Contract. Authorization from the Architect or Architect's representative must be given prior to the performance of any unit price work.
- G. Disinfecting
1. Use an EPA registered fungicide as directed by the manufacturer to disinfect all exposed interior surfaces within the remediation areas.
 2. DO NOT apply any anti-microbial coating or other permanent coating.
- H. Drying
1. Prior to post remediation inspection, dry all remaining structural components, finishes, and furnishings to within two (2) points of a pre-determined "dry standard" as measured on a Protimeter Moisture Measurement System (MMS), Delmhorst TechCheck Plus, Extech MO290, or comparable moisture meter.
 2. Record psychometric data at least daily during the drying including, at a minimum, specific humidity in grains per pound inside of the regulated area and at the dehumidifier exhausts (grain depression).
- I. The Remediation Contractor is required to confirm all quantities of contaminated materials and their current conditions.
- J. The Remediation Contractor shall not apply any sealants (i.e. AfterShock™) or scented products prior to the final inspection or clearance testing.
- K. The cleanup work will be conducted in the following general sequence:
1. Removal of all water damaged and/or microbial contaminated materials from designated areas;
 2. Microbial cleanup of the remaining building components in the designated areas;
 3. Drying of building components and finishes in the designated areas; and
 4. Final inspection and clearance of the remediated areas.

- L. Unless otherwise specified in this work plan, all contaminated materials are to be removed under negative pressure with critical barriers, a change room, and airlocks.
- M. The Remediation Contractor shall coordinate the waste paths from the work area to the appropriate waste container or truck with the Owner.

1.8 DEFINITIONS

- A. Accessible - A space easily accessed and which can be entered or seen without demolition.
- B. Approved Landfill – A site for the disposal of microbial contaminated wastes and other hazardous wastes that has the necessary governmental approvals for accepting these types of wastes.
- C. Architect’s Representative – An individual retained by the Architect who will monitor the Contractor’s work practices, perform inspections and provide testing as required to support the work.
- D. Competent Person – An individual who is capable of identifying existing microbial hazards in the workplace and selecting the appropriate control strategy for microbial exposure and who has the authority to take prompt corrective measures to eliminate them.
- E. Remediation Contractor – Remediation Contractor providing demolition and removal services as defined in these specifications.
- F. Critical Barrier - A minimum of two layers of six (6) mil polyethylene sheeting taped securely over windows, doorways, diffusers, grilles and any other openings between the Work Area and uncontaminated areas outside of the Work Area, including the outside of the building.
- G. Deodorize – The process of odor removal. The four principals for effective deodorization are:
 - 1. Removal of primary source.
 - 2. Cleaning of all surfaces exposed to contaminant.
 - 3. Recreation of conditions of penetration with appropriate odor counteractants.
 - 4. Sealing of salvageable but heavily contaminated surfaces.
- H. Demolition - The wrecking or taking out of any load-supporting structural member of a facility together with any related handling operations or the intentional burning of any facility.
- I. Disinfect – A chemical or physical process used on surfaces or objects to destroy 99.99% of microorganisms in a specific period of time.
- J. Engineering Controls - Controls to include, but not be limited to, pressure differential equipment, decontamination enclosures, critical barriers and related procedures.
- K. Exposed - Open to view.
- L. Microbial Contamination – Visible infestation of materials by microbial growth as determined by bulk, air, microvac or wipe sampling or visual inspection.

- M. Microbial Contaminated – Any building material that has visible infestation of bacteria or fungi, as shown by bulk, air, microvac or wipe sampling or visual inspection.
- N. Respirator Program – A written program established by an employer that provides for the safe use of respirators on their job sites.
- O. Visible Residue - Any debris or dust on surfaces in areas within the Work Area where microbial abatement has taken place and which is visible to the unaided eye. All visible residue is assumed to contain microbial contamination.
- P. Wet Cleaning - The process of eliminating microbial contamination from building surfaces and objects by using cloths, mops, or other cleaning tools which have been dampened with an anti-microbial, and afterwards thoroughly decontaminated or disposed of as microbial-contaminated waste.
- Q. Work Area - Specific area or location where the actual work is being performed or such other area of a facility that it has been determined that it may be hazardous to public health as a result of the cleanup or abatement.

1.9 REFERENCES

- A. The current issue of each document shall govern. Where conflict among requirements or with these specifications exists, the more stringent requirements shall apply.
 - 1. Occupational Safety and Health Administration (OSHA)
 - a. 29 CFR 1910.134 - Respiratory Protection
 - b. 29 CFR 1926.21 - Safety Training and Education
 - c. 29 CFR 1926.32 - Competent Person
 - d. 29 CFR 1926.51 - Sanitation
 - e. 29 CFR 1910.1200 - Hazard Communication
 - f. 29 CFR 1926.200 - Accident Prevention Signs and Tags
 - g. 29 CFR 1926.417 - Lockout and Tagging of Circuits
 - 2. Environmental Protection Agency (EPA)
 - a. 40 CFR 763, Subpart G - Worker Protection Rule
 - 3. New York City Department of Health and Mental Hygiene
 - a. Guidelines on Assessment and Remediation of Fungi in Indoor Environments (issued November, 2008)
 - 4. American National Standards Institute (ANSI)
 - a. ANSI Z9.2 - Fundamentals Governing the Design and Operation of Local Exhaust Systems
 - b. ANSI Z88.2 - Respiratory Protection
 - 5. American Society of Testing and Materials (ASTM)
 - a. ASTM E 96 - Water Vapor Transmission of Materials

6. Underwriters Laboratories, Inc. (UL)
 - a. UL 586 - High-Efficiency, Particulate, Air Filter Units
7. Institute of Inspection, Cleaning, and Restoration Certification (IICRC)
 - a. S-500, Standard and Reference Guide for Professional Water Damage Restoration – Third Edition
 - b. S-520, Standard and Reference Guide for Professional Mold Remediation – Second Edition
8. The Connecticut Department of Public Health, Guidance for Mold Abatement Contractors.

1.10 DOCUMENTATION

- A. The following documentation shall be obtained by the Remediation Contractor to ensure compliance with the applicable regulations. An up to date copy shall be retained at the job site at all times.
 1. Manufacturer's Catalog Data for:
 - a. Vacuum Equipment and Negative Air Exhaust Fans
 - b. Respirators
 - c. Polyethylene Sheeting
 - d. Adhesive Removal Chemicals
 - e. MSDS for All Materials Delivered to the Site
 - f. EPA registration number and MSDS for all fungicides
 - g. EPA registration number and MSDS for mold-retardant sealants
 2. Statements:
 - a. Worker Medical Certification
 - b. Worker Respirator Fit Testing
 - c. Safety Plan
 - d. Respirator Protection Plan
 - e. Copies of all required notifications, approvals and permits for the environmentally contaminated materials.
 - f. Documentation from a physician certifying that all employees who may be exposed to microbial contamination in excess of the background level have been provided with an opportunity to be medically monitored to determine whether they are physically capable of working while wearing the respirator required without suffering adverse health effects. They shall also be informed of the specific types of respirators the employee shall be required to wear and the work he/she will be required to perform as well as special work place conditions such as high temperature, high humidity and chemical contaminants to which he/she may be exposed. Individuals with immune suppression, asthma, hypersensitivity pneumonitis, severe allergies, sinusitis, or other chronic inflammatory lung diseases, or who have undergone recent surgery, shall not be permitted into the remediation Work Area.
 - g. Documentation certifying that all employees have received training in the proper cleaning method and handling of materials that contain microbial contamination; understand the health implications and risks involved, including

- the illnesses possible from exposure to these airborne contaminants; and understands the use and limits of respiratory equipment to be used. The training can be performed as part of a program to comply with the requirements of the OSHA Hazard Communication Standard 29 CFR 1910.1200.
- h. Documentation of respiratory fit testing for all employees who must enter the Work Area in accordance with the OSHA Respiratory Protection Standard 29 CFR 1910.134.
 - i. Establish and supervise in accordance with 29 CFR 1926.21, a program for the education and training of workers in the recognition, avoidance and prevention of unsafe conditions and the regulations applicable to the work environment to control or eliminate any hazards or other exposure to illness or injury. Include any site-specific information to address health and safety procedures unique to this project.
 - j. Establish a written Respiratory Protection Plan in accordance with 29 CFR 1910.134. This plan shall establish procedures governing the selection and use of respirators and shall include such information as training in the proper use of respirators; medical examination of workers to determine whether or not they may be assigned an activity where respiratory protection is required; training in proper use and limitations of respirators; respirator fit testing; regular inspection and evaluation of the continued effectiveness of the program; and other elements included in the standard.

3. Records:

- a. Sign-in/out Logs
- b. Psychometric Records

1.11 PERSONNEL PROTECTION

- A. Instruct workers in all aspects of personnel protection, work procedures, emergency evacuation procedures and use of equipment including procedures unique to this project.
- B. Ensure workers are fully protected with respirators and protective clothing during work in the Cleanup Control Area, where there is the possibility of disturbing microbial containing or microbial contaminated materials.
- C. Respiratory protection shall meet the requirements of OSHA as required in 29 CFR 1910.134. Provide appropriate respiratory protection for each worker and ensure usage during potential exposure. As a minimum, workers shall be equipped with ½-face negative respirators with HEPA filters.
- D. Select respirators from among those approved as being acceptable for protection by the National Institute for Occupational Safety and Health (NIOSH) under the provisions of 30 CFR Part 11. Provide an adequate supply of filter elements for respirators in use.
- E. Provide all authorized persons entering microbial contaminated areas with proper respirators and protective clothing. This shall include: a half-face respirator with HEPA filters; disposable protective clothing covering both head and shoes; and protective gloves.
- F. Ensure workers do not eat, drink, smoke or chew gum or tobacco while in the Work Area.

1.12 EQUIPMENT REMOVAL PROCEDURE

- A. Clean surfaces of contaminated containers and equipment thoroughly by vacuuming with HEPA filtered equipment and wet wiping before final cleaning and removal to uncontaminated areas.

1.13 SEQUENCE OF WORK

- A. Proceed in accordance with the sequence of work as mutually agreed upon with the Architect's Representative.
- B. The following sequence of work shall be used for the remediation work:
 - 1. All equipment and temporary utilities required for the project shall be on site and operational prior to the initiation of the remediation work.
 - 2. Preparation of work areas.
 - 3. Cleanup and remediation of all designated microbial contaminated materials by the Remediation Contractor.
 - 4. Disinfection of building components and finishes.
 - 5. Drying of building components and finishes.
 - 6. The Remediation Contractor shall not apply any sealants (i.e. AfterShock™) or scented products prior to the final inspection and re-occupancy clearance testing (if required for asbestos abatement).
 - 7. Visual inspection and microbial sampling (if necessary) of the microbial cleanup by the Architect's Representative.
 - 8. Final cleanup by the Contractor.

PART 2 PRODUCTS

2.1 DELIVERY, STORAGE AND HANDLING

- A. Deliver all materials in the original packages, containers, or bundles bearing the name of the manufacturer and the brand name and product technical description. Do not use damaged or deteriorating materials. Material that becomes contaminated shall be decontaminated or disposed of as contaminated waste.

2.2 MATERIALS

- A. Material Data Safety Sheets (MSDSs) shall be on site for all products used.
- B. Fungicides shall be registered with the United States Environmental Protection Agency (US EPA) and listed in the US EPA Federal Insecticide, Fungicide, and Rodenticide Act (FIFRA) database and approved by Norwich Housing Authority and the Consultant.

- C. Polyethylene sheet in roll size to minimize the frequency of joints, shall be delivered to job site with factory label indicating four (4) or six (6) mil.
- D. Polyethylene disposable bags shall be six (6) mil.
- E. Tape shall be capable of sealing joints in adjacent polyethylene sheets and for attachment of polyethylene sheet to finished or unfinished surfaces. Tape must be capable of adhering under both dry and wet conditions.
- F. Containers must be impermeable and shall be both air and watertight.

2.3 TOOLS AND EQUIPMENT

- A. Tools and equipment shall be suitable for microbial contamination.
- B. Protective clothing, respirators, filter cartridges, air filters and sample filter cassettes shall be provided in sufficient quantities for the project.
- C. Electrical equipment, protective devices, emergency generators (if any) and power cables shall conform to all applicable codes.
- D. Exhaust air filtration units shall be equipped with HEPA filters capable of providing sufficient air exhaust to allow a sufficient flow of air through the area. No air movement system or air filtering equipment shall discharge unfiltered air outside the Cleanup Control Area.
- E. Other materials such as lumber, nails and hardware necessary to construct and dismantle the decontamination enclosures and the barriers that isolate the Work Area shall be provided as appropriate for the work.

PART 3 EXECUTION

3.1 PREPARATION OF OUTDOOR WORK AREAS

- A. Prior to beginning work, the Architect's Representative and the Remediation Contractor shall perform a visual survey of the Work Area and list all pre-existing damage to building components.
- B. Utilize engineering controls and personnel protective equipment while installing enclosures and supports when contaminated materials may be disturbed.
- C. Provide temporary power and lighting as required and ensure safe installation, including ground fault protection, of temporary power sources and equipment in compliance with applicable electrical code and OSHA requirements. The Remediation Contractor is responsible for proper connection and installation of electrical wiring.
- D. Seal off the windows, grilles, diffusers, attic hatches, and any other openings between the Work Area and the uncontaminated indoor areas outside of the Work Area with critical barriers.
- E. Use signage and barrier tape or fencing to identify work area boundaries.

3.2 PREPARATION OF INDOOR WORK AREAS

- A. Utilize engineering controls and personnel protective equipment while installing enclosures and supports when contaminated materials may be disturbed.
- B. Provide temporary power and lighting as required and ensure safe installation, including ground fault protection, of temporary power sources and equipment in compliance with applicable electrical code and OSHA requirements. The Remediation Contractor is responsible for proper connection and installation of electrical wiring.
- C. Seal off all openings between the Work Area and the uncontaminated indoor areas outside of the Work Area but within the units, with critical barriers. Construct an airlock door flap system and a change room at and adjacent to entry to work areas so that personnel must pass through the change room when entering or exiting the work area.
- D. Maintain the contained work area under negative pressure with HEPA filtered exhaust system. Vent the exhaust outside the building.

3.3 MOLD AND MOISTURE REMEDIATION

- A. A Supervisor employed by the Remediation Contractor and qualified in mold and moisture remediation shall be on the job at all times to ensure the establishment and maintenance of the negative pressure enclosure (NPE) where required and proper work practices throughout the project.
- B. Protect surfaces that will not to be removed with polyethylene sheeting.
- C. Cleaning shall be accomplished by scrubbing with brushes, sanding, or other method deemed appropriate by the Architect's Representative.
- D. The standard for cleaning shall be no visible mold, dust, dirt, or debris. Stains on lumber resulting from fungal growth are acceptable.
- E. Remove all mold or moisture impacted materials from the designated locations.
- F. Efforts shall be made to reduce dust generation. This includes lightly misting the surface with a dilute soap or detergent solution prior to removal, the use of HEPA vacuum-shrouded tools at the point of dust generation. Moldy materials that can be cleaned should be cleaned using a soap or detergent solution.
- G. Fill disposal containers (six mil polyethylene bags or fiber drums) as remediation proceeds, seal filled containers. Bags shall be securely sealed to prevent accidental opening and leakage by taping in gooseneck fashion. Bags shall be decontaminated by damp cleaning before being removed from Work Area and placed in containers for transport and disposal by the Remediation Contractor.
- H. Ensure that workers do not enter from uncontaminated areas into the change room or the work area.

- I. The use of household bleach as a disinfectant is not permitted due to its corrosive effect on metal building components and potential adverse physiological impact on residents. Appropriate disinfectants are those that are specified as a fungicide and registered with the EPA.
- J. All surfaces to be microbial cleaned are to be HEPA vacuumed prior to the use of the disinfectant. The disinfectant can then be applied by hand or spray applied on all appropriate surfaces. Following the use of the disinfectant, the area must be re-cleaned and rinsed using water, dried, and then HEPA vacuumed again.
- K. All surfaces that have been cleaned shall be subject, at the discretion of the Architect's Representative, to be treated with an anti-microbial sealant (e.g., AfterShock™) following successful completion of the post remediation testing.
- L. The work area and areas used by workers for egress shall be HEPA-vacuumed and cleaned with a damp cloth or mop and a light soap or detergent solution.
- M. If at any time during the remediation work, should the Remediation Contractor and/or the Architect's Representative suspect contamination of areas outside the Work Area, the Remediation Contractor shall stop all remediation work and take steps to decontaminate these areas and eliminate causes of such contamination. Unprotected individuals shall be prohibited from entering contaminated areas until air and swab sampling and/or visual inspections determine decontamination.
- N. All areas should be left dry and visibly free from mold, dust and debris. Remove microbial contamination waste material daily.

3.4 CLEAN-UP PROCEDURE AND INSPECTION

- A. Remove all environmental contamination from the exteriors of the negative air machines, hoses and other equipment inside the Work Area. Cleaning may be accomplished by brushing, sanding, or scrubbing.

3.5 DISPOSAL OF MICROBIAL CONTAMINATION AND DEBRIS

- A. There are no special requirements of disposal of moldy materials unless they are also contaminated by other hazardous materials such as asbestos or lead. Disposal of microbial contaminated material shall occur in compliance with the requirements of designated State agency having jurisdiction over solid waste disposal.

3.6 REMEDIATION CONTRACTOR RESPONSIBILITY

- A. For the microbial contamination cleanup, conduct worksite audits to assure that workers are using appropriate respiratory protection.

3.7 POST-REMEDATION MICROBIAL SAMPLING

- A. After the remediation, disinfection, and cleanup, all components have been dried to within two (2) points of the pre-determined "dry standard, and after a high degree of cleanliness has been verified by visual inspection by the Architect's Representative, non-viable fungal post-remediation sampling utilizing air and/or bulk sampling methods may be conducted.

- B. For the purposes of the visual inspection, no visible dust/residue shall be allowed on the surfaces that have been cleaned and disinfected. The Architect's Representative will make the decision on the type and number of microbial samples to be taken in order to verify the acceptability of the microbial remediation work by the Contractor.

\\Eaglesvr\public\2014 Files\2014 Specs\CSA - Capital Studio Architects\Hurricane Sandy\181 Trumbull Ave, Bridgeport\020920 Microbial Remediation 181 Trumbull Ave.doc

SECTION 020940

Active Sub -Slab Suction Radon Mitigation Systems (Sub-Slab Depressurization)

PART 1 GENERAL

1.1 RELATED DOCUMENTS

- A. Drawings and General Provisions of Contract, including General Supplementary Conditions and Division 1 Specifications Sections, of the Contract Documents apply to this Section.
- B. The work is being performed under the State of Connecticut Department of Housing Community Development Block Grant - Disaster Recovery Program (Program). Radon testing has identified levels of radon within the basement, which are slightly below the USEPA action level of 4 pCi/L. The Radon Mitigation System is an Add Alternate for this project in the event that the average result between the first and second round of testing are greater than 4 pCi/L. The second round of testing has not yet been performed.

1.2 GENERAL DESIGN

- A. The radon mitigation system shall be designed and installed as a permanent integral addition to the building;
- B. The radon mitigation system shall be designed and installed so as to avoid the creation of other health, safety, or environmental hazards to building occupants such as back drafting, spillage, constricting or blocking building access/egress with pipe runs, or degradation of fire rated assemblies with pipe or cabling penetrations;
- C. The installation and components of the radon mitigation system shall be in compliance with all applicable state and local mechanical, electrical, building, plumbing, energy, and fire prevention codes, standards, and regulations.
- D. The radon mitigation system shall be installed per ASTM International E2121-03 Standard Practice for Installing Radon Mitigation Systems in Existing Low-Rise Residential Buildings (or subsequent updated versions of such standard), per state-of-the-art criteria, and as described in the following sections.
- E. Painted surfaces impacted during installation of the Radon Mitigation System shall be assumed to be lead-based and lead-safe work practices shall be utilized during the work.

1.3 SUCTION PIT (ALTERNATIVES):

- A. A minimum 4 inch diameter opening shall be cut through the existing basement floor slab. A suction pit shall be manually excavated through the opening beneath the floor slab. Gravel fill is not required.
- B. A two (2) feet by two (2) feet by one (1) foot deep pit shall be excavated in a suitable location into the subslab area beneath the basement floor and filled with ½ to ¾ inch screened gravel to the bottom of the existing basement floor slab. The contractor shall refinish the excavated pit to match the existing concrete floor slab.

1.4 PIPING:

- A. Piping and fittings shall be Schedule 40 PVC or better. All suction point piping shall be rigid pipe not less than 3 inches inside diameter. The terminus of the suction point pipe shall be located such that the suction pit excavation extends at least one pipe diameter directly beneath the terminus of the pipe. All vent stack piping shall be solid, rigid pipe not less than 3 inches inside diameter. When practicable, minimum 4 inches inside diameter piping shall be used. All manifold piping shall be rigid pipe not less than 3 inches inside diameter. Manifold piping inside diameter shall be at least as large as that used in the suction pit. The vent stack piping shall be at least as large as the largest manifold piping. Manifold piping to which two or more suction points are connected shall be at least 4 inches inside diameter. Pipe bends and length shall be minimized to the extent possible. Exterior piping and piping in unconditioned spaces shall be insulated.

1.5 SUPPORT FOR PIPING:

- A. Radon mitigation system piping shall be fastened to the structure of the building with hangers, strapping, or other supports that will provide adequate support for the piping. Radon system piping shall not be attached to or supported by existing pipes, ducts, conduits, or any kind of equipment. The supports shall be installed as follows:
1. Horizontal runs shall be secured at least every 6 feet;
 2. Vertical runs shall be secured either above or below the points of penetration through floors, ceilings, and roofs or at a minimum every 8 feet;
 3. Horizontal runs shall be sloped $\frac{3}{8}$ " per foot toward the suction pit to ensure that condensation or water from rain does not collect in the pipe, but rather drains to the ground beneath the slab of the home.

1.6 VENT STACK PIPE DISCHARGE:

- A. The vent stack shall extend vertical and upward (no bends in the pipe permitted at the exhaust point) to the outside of the structure, and shall terminate at least 10 feet above ground level, above the edge of the roof, and shall meet the separation requirements described below. Whenever practicable, the radon discharge point shall be located above the highest roof ridge of the building. The discharge point shall be at least 2 feet above the top of any window, door, or other opening into an occupiable space. If the discharge point is not at least 2 feet above the top of any such opening, the discharge point shall be a minimum of ten feet away from any such opening.
- B. The discharge point shall be a minimum of ten feet away from any opening into the conditioned or occupiable spaces of any adjacent building.
- C. If the vent stack pipe penetrates the roof, the point of discharge shall be at least 12 inches above the surface of the roof.
- D. If the vent stack pipe is attached to or penetrates the side of the building, the point of discharge shall be vertical (no bend at the end) and shall be at least 12 inches above the surface of the roof.

1.7 FAN INSTALLATION:

- A. Preferred locations for the radon mitigation fan include (1) the exterior of the building, (2) an unconditioned attic that is not suitable for occupancy, or (3) another unconditioned area in the house or a garage that is not suitable for occupancy and which has no occupiable space above. Basements are not a suitable fan location.
- B. The radon fan shall comply with the following specifications and criteria:
 - 1. The radon fan shall be sized so as to meet a depressurization goal of 0.025 to 0.035 in. WG (6-9 Pa) everywhere under the slab when inside and outside air pressures are equal.
 - 2. WG (6-9 Pa) everywhere under the slab when inside and outside air pressures are equal.
 - 3. The radon fan shall be Energy Star rated.
 - 4. A pressure field extension (PFE) test shall be performed with a shop vacuum or radon fan sized for the project to verify that a minimum PFE of -0.0002 in. WC has been attained.
 - 5. The radon fan shall be connected to the vent stack pipe, draw radon gas and other soil gases from beneath the building, and release these gases into the outdoor air while simultaneously creating a negative pressure (vacuum) beneath the building slab. To facilitate maintenance and future replacement, the fan shall be installed in the vent stack pipe using removable couplings or flexible connections that can be tightly secured to both the radon fan and the vent stack pipe.
 - 6. The radon fan shall be installed vertically in a configuration that will avoid the buildup of condensation in the radon fan housing.
 - 7. The radon fan shall be mounted and secured in a manner that minimizes transfer of vibration to the structural framing of the building.
 - 8. There shall be no pipe bends on the discharge side of the fan within 10 pipe diameters of the fan location.
 - 9. If the radon fan is mounted on the exterior of the building, it shall be rated for outdoor use.

1.8 GENERAL SEALING REQUIREMENTS:

- A. The Contractor is to seal all openings, cracks, and crevices in the concrete basement floor (including any slab perimeter cracks, suction point piping, utility penetrations and other slab penetrations/openings) and walls with polyurethane caulk to prevent radon gas and other soil gases from entering the home. When the joint is greater than ½ inch in width, a foam backer rod or other comparable filler material shall be inserted into the joint before application of the sealant.
- B. Any floor drain that drains to the soil beneath the slab shall be trapped or provided with a one-way valve. Any HVAC condensate drain that drains to the soil beneath the slab shall be trapped. Perimeter (French or channel) drains shall be sealed in a manner that permits proper drain function. Sump pits shall be covered in a manner that permits proper function.

- C. All interior and exterior pipe joints and connections in the radon mitigation system (with the exception of the radon fan connection and any sump pit cover) shall be permanently sealed.

1.9 ELECTRICAL CONSIDERATIONS:

- A. The Contractor shall install an electrical junction box (outlet) in the attic or other suitable unconditioned building space for use with the radon fan. A suitable existing electrical junction box may be used if available. Wiring shall not be located inside the radon system piping or within any other heating or cooling ductwork. Any plugged cord used to supply power to a radon fan shall not be more than 6 feet in length. No plugged cord may penetrate a wall or be concealed within a wall. A means of disconnection shall be present in the electrical circuit that powers the radon fan, and shall be located within sight of the radon fan. Disconnection of the radon fan shall not interrupt the power to other electrical devices in the dwelling.

1.10 MONITORS AND LABELING:

- A. The radon mitigation system shall include a mechanism to monitor system performance (air flow or pressure) that shall provide a visual or audible indication of system degradation and failure. A mechanical monitoring device (such as manometer type pressure gauges) may be installed. If so, the gauges shall be clearly marked to indicate initial pressure readings. A system failure audible warning device (i.e., alarm) may be provided and installed. If an audible alarm is installed, the alarm controls shall be installed on a non-switched circuit and be designed to reset automatically after power failure. The device shall sound an alarm due to system malfunction including a decrease in suction flow. The alarm shall be easily discernable in the first floor living space.
- B. Radon mitigation system description labels shall be placed on the radon mitigation system, electrical panel, and/or other prominent location. Labels shall be legible from a distance of 3 feet and display the following information:
 - 1. The words "Radon Reduction System" and the name of the installer and telephone number;
 - 2. The date of installation;
 - 3. An advisory that the building should be tested for radon every two years.
- C. All exposed and visible interior radon system piping shall be identified with at least one label on each floor that identifies the pipe as part of a radon reduction system by affixing a label to the pipe that reads "Radon System Pipe", "Radon Reduction System", or "Radon Pipe".
- D. Circuit breakers controlling the circuits that supply power to the radon fan and any system failure warning device (i.e., alarm) shall be labeled using the word "Radon".

1.11 POST-MITIGATION TESTING:

- A. Upon completion of work, the Program's Consultant will conduct post-mitigation testing no sooner than one day (24 hours) and no later than 30 days after installation and activation of the radon mitigation system. The Program's Consultant will provide a copy of test results to the Contractor. A successful post-mitigation testing result shall verify a reduction of the radon level to a level less than 2 pCi/L.

1.12 RECORDS, WARRANTIES, GUARANTEES, INFORMATION, ETC. THAT ARE TO BE PROVIDED TO THE PROGRAM AND THE PROPERTY OWNER:

- A. Radon mitigation system design drawings shall be submitted to the owner and Project Consultant for review and acceptance prior to installation.
- B. A description of the radon mitigation system and the basic operating principles. Copies of contracts.
- C. Warranties for radon fans and other system components. Manufacturer's operation and maintenance instructions.
- D. Radon mitigation system "as built" drawings if substantial deviation from the design drawings was required or (2) a statement that the system was installed in substantial conformance with the design drawings.
- E. A list of appropriate actions for the owner to take if the system failure warning device indicates system degradation and failure.
- F. Contractor certified results of the pressure field extension (PFE) test.
- G. If the radon mitigation system does not pass post-mitigation testing (i.e., a level less than 2 pCi/L) the Contractor shall return to the site and modify the system until a passing post-mitigation test is achieved.
- H. The name, address, and telephone number of the Contractor shall be provided to the owner.
- I. The Contractor shall be National Environmental Health Association (NEHA) or National Radon Safety Board (NRSB) certified as a Radon Mitigation Professional. The Contractor is responsible for code compliance, all required permits, and use of appropriately licensed tradesmen. All electrical work is to be performed by an electrician licensed in the State of Connecticut.

\\Eaglesvr\public\2014 Files\2014 Specs\CSA - Capital Studio Architects\Hurricane Sandy\181 Trumbull Ave, Bridgeport\020940Radon Mitigation Specification 181 Trumbull Ave.docx

SECTION 04910
CHIMNEY REPAIRS

PART 1 - GENERAL

1.1 SCOPE OF WORK

- A. Section includes all work as related to chimney repairs as listed below.
 - 1. Repairing chimney brick face, including replacing units.
 - 2. Repointing joints, assume 50% of brick chimneys to be re-pointed.
 - 3. Replacing all existing concrete chimney caps.
 - 4. Replacement of damaged chimney clay flues.
 - 5. Repair/reparge of stucco finished chimney masonry.

1.2 RELATED WORK IN OTHER SECTIONS

- A. Section 01270 - Unit Prices.
- B. Section 07600 - Sheet Metal Flashing and Trim.
- C. Section 07900 - Sealants.

1.3 SUBMITTALS

- A. Product Data: For each type of product indicated or used on site.
- B. Samples: Brick replacements, Stucco finish texture samples and standard colors.

1.4 QUALITY ASSURANCE

- A. Masonry Repair - Engage an experienced, preapproved masonry firm to perform work of this Section. Firm shall have completed work similar in material, design, and extent to that indicated for this Project with a record of successful in-service performance. Experience installing standard unit masonry is not sufficient experience for masonry restoration work.
 - 1. Masonry Worker Qualifications: Persons who are experienced in restoration work of types they will be performing. When masonry units are being patched, assign at least one worker among those performing patching work who is trained and certified by manufacturer of patching compound to apply its products.
- B. Stucco Repair – Applicator shall be experienced and competent in the application of plaster like materials. All materials shall be obtained from single manufacturer for compatibility and warranty purposes.

PART 2 - PRODUCTS

2.1 MASONRY MATERIALS

- A. Face Brick: Provide face brick, including specially molded, ground, cut, or sawed shapes where required to complete masonry restoration work.
1. Provide units with physical properties, colors, color variation within units, surface texture, size, and shape to match existing brickwork.
 - a. Physical Properties per ASTM C 67:
 - 1) Compressive Strength: 3,000 psi.
 - 2) 24-Hour Cold-Water Submersion Absorption: $\leq 8\%$ ave.
 - 3) 5-Hour Boil Absorption: $\leq 17\%$ ave.
 - 4) Saturation Coefficient: $\leq 0.78\%$ ave.
 - 5) Initial Rate of Absorption: ≤ 9.8 grams/min.
 - b. For existing brickwork that exhibits a range of colors or color variation within units, provide brick that proportionally matches that range and variation rather than brick that matches an individual color within that range.
- B. Clay Flue Liner: Provide clay flue liner per ASTM C315-91. Size to match existing, saw cut in field as needed.

2.2 MORTAR MATERIALS

- A. Portland Cement: ASTM C 150, Type I or Type II, white or gray or both where required for color matching of exposed mortar.
1. Provide cement containing not more than 0.60 percent total alkali when tested according to ASTM C 114.
- B. Hydrated Lime: ASTM C 207, Type S.
- C. Mortar Sand: ASTM C 144 unless otherwise indicated.
1. Color: Provide natural sand or ground marble, granite, or other sound stone of color necessary to produce required mortar color.
 2. For pointing mortar, provide sand with rounded edges.
 3. Match size, texture, and gradation of existing mortar sand as closely as possible. Blend several sands if necessary to achieve suitable match.
- D. Mortar Pigments: Natural and synthetic iron oxides, compounded for mortar mixes. Use only pigments with a record of satisfactory performance in masonry mortars.
- E. Water: Potable.

2.3 MANUFACTURED REPAIR MATERIALS

- A. Masonry Patching Compound: Factory-mixed cementitious product that is custom manufactured for patching masonry.
1. Products: Subject to compliance with requirements, provide one of the following:
 - a. Cathedral Stone Products, Inc.; Jahn M100 Terra Cotta and Brick Repair Mortar.
 - b. Conproco Corporation; Mimic.
 - c. Edison Coatings, Inc.; Custom System 45.
 2. Use formulation that is vapor and water permeable (equal to or more than the masonry unit), exhibits low shrinkage, has lower modulus of elasticity than the masonry units being repaired, and develops high bond strength to all types of masonry.
 3. Formulate patching compound used for patching brick in colors and textures to match each masonry unit being patched.

2.4 CLEANING MATERIALS

- A. Clean surfaces only as needed to install and repair masonry and stucco. It is not the intent to require every chimney to be 100% cleaned beyond that required for repair work.
- B. Water: Potable.
- C. Hot Water: Water heated to a temperature of 140 to 160 deg F.
- D. Job-Mixed Detergent Solution: Solution prepared by mixing 2 cups of tetrasodium polyphosphate, 1/2 cup of laundry detergent, and 20 quarts of hot water for every 5 gallons of solution required.
- E. Job-Mixed Mold, Mildew, and Algae Remover: Solution prepared by mixing 2 cups of tetrasodium polyphosphate, 5 quarts of 5 percent sodium hypochlorite (bleach), and 15 quarts of hot water for every 5 gallons of solution required.
- F. Nonacidic Gel Cleaner: Manufacturer's standard gel formulation, with pH between 6 and 9, that contains detergents with chelating agents and is specifically formulated for cleaning masonry surfaces.
1. Products: Subject to compliance with requirements, Provide one of the following:
 - a. Price Research, Ltd.; Price Marble Cleaner-Gel.
 - b. PROSOCO; Sure Klean 942 Limestone and Marble Cleaner.
- G. Nonacidic Liquid Cleaner: Manufacturer's standard mildly alkaline liquid cleaner formulated for removing mold, mildew, and other organic soiling from ordinary building materials, including polished stone, brick, aluminum, plastics, and wood.
1. Products: Subject to compliance with requirements, provide one of the following:
 - a. Diedrich Technologies Inc.; Diedrich 910PM Polished Marble Cleaner.
 - b. Dominion Restoration Products, Inc.; Bio-Cleanse.

- c. Dumond Chemicals, Inc.; Safe n' Easy Architectural Cleaner/Restorer.
 - d. Price Research, Ltd.; Price Non-Acid Masonry Cleaner.
 - e. PROSOCO; Enviro Klean 2010 All Surface Cleaner.
- H. Mild Acidic Cleaner: Manufacturer's standard mildly acidic cleaner containing no muriatic (hydrochloric), hydrofluoric, or sulfuric acid; or ammonium bifluoride or chlorine bleaches.
- 1. Products: Subject to compliance with requirements, provide one of the following:
 - a. ABR Products, Inc.; X-190 Limestone & Concrete Cleaner.
 - b. Diedrich Technologies Inc.; Envirostore 100.
 - c. Dominion Restoration Products, Inc.; DR-60 Stone and Masonry Cleaner.
 - d. PROSOCO; Enviro Klean BioWash.
- I. Acidic Cleaner: Manufacturer's standard acidic masonry cleaner composed of hydrofluoric acid or ammonium bifluoride blended with other acids, detergents, wetting agents, and inhibitors.
- 1. Products: Subject to compliance with requirements, provide one of the following:
 - a. ABR Products, Inc.; 801 Heavy Duty Masonry Cleaner.
 - b. Diedrich Technologies Inc.; Diedrich 101 Masonry Restorer.
 - c. Dumond Chemicals, Inc.; Safe n' Easy Heavy Duty Restoration Cleaner.
 - d. EaCo Chem, Inc.; GS-Restoration.
 - e. Hydroclean, Hydrochemical Techniques, Inc.; Hydroclean Brick, Granite, Sandstone and Terra Cotta Cleaner (HT-626).
 - f. PROSOCO; Sure Klean Restoration Cleaner.

2.5 ACCESSORY MATERIALS

- A. Setting Buttons: Resilient plastic buttons, nonstaining to masonry, sized to suit joint thicknesses and bed depths of masonry units without intruding into required depths of pointing materials.

2.6 MORTAR MIXES

- A. Measurement and Mixing: Measure cementitious materials and sand in a dry condition by volume or equivalent weight. Do not measure by shovel; use known measure. Mix materials in a clean, mechanical batch mixer.
 - 1. Mixing Pointing Mortar: Thoroughly mix cementitious materials and sand together before adding any water. Then mix again adding only enough water to produce a damp, unworkable mix that will retain its form when pressed into a ball. Maintain mortar in this dampened condition for 15 to 30 minutes. Add remaining water in small portions until mortar reaches desired consistency. Use mortar within one hour of final mixing; do not retemper or use partially hardened material.
- B. Do not use admixtures in mortar unless otherwise indicated.
- C. Mortar Proportions: Mix mortar materials in the following proportions:
 - 1. Pointing Mortar for Brick: Type K - 1 part portland cement, 3 parts lime, and 10 parts sand adjusted to suit/match existing.

2. Rebuilding (Setting) Mortar: Same as pointing mortar except mortar pigments are not required.
3. Rebuilding (Setting) Mortar: 1 part portland cement, 2 parts lime, and 6 parts sand.
4. Rebuilding (Setting) Mortar: Comply with ASTM C 270, Proportion Specification, Type N unless otherwise indicated; with cementitious material limited to portland cement and lime.

2.7 CHEMICAL CLEANING SOLUTIONS

- A. Dilute chemical cleaners with water to produce solutions not exceeding concentration recommended by chemical-cleaner manufacturer.
- B. Acidic Cleaner Solution for Brick: Dilute with water to produce hydrofluoric acid content of 3 percent or less, but not greater than that recommended by chemical-cleaner manufacturer.

2.8 STUCCO COMPONENTS

- A. As a Basis-for-Design products and drawings are based on "StucCoat" as manufactured by Dryvit Systems, Inc. Provide shop drawing submittal with manufacturer's standard finishes and colors.

PART 3 - EXECUTION

3.1 PROTECTION

- A. Protect persons, motor vehicles, surrounding surfaces of building being restored, building site, plants, and surrounding buildings from harm resulting from masonry restoration work.
- B. Comply with chemical-cleaner manufacturer's written instructions for protecting building and other surfaces against damage from exposure to its products. Prevent chemical-cleaning solutions from coming into contact with people, motor vehicles, landscaping, buildings, and other surfaces that could be harmed by such contact.
 1. Cover adjacent surfaces with materials that are proven to resist chemical cleaners used unless chemical cleaners being used will not damage adjacent surfaces. Use materials that contain only waterproof, UV-resistant adhesives. Apply masking agents to comply with manufacturer's written instructions. When no longer needed, promptly remove masking to prevent adhesive staining.
 2. Keep wall wet below area being cleaned to prevent streaking from runoff.

3.2 BRICK REMOVAL AND REPLACEMENT

- A. At locations indicated, remove bricks that are damaged, spalled, or deteriorated or are to be reused. Carefully demolish or remove entire units from joint to joint, without damaging surrounding masonry, in a manner that permits replacement with full-size units.

- B. Support and protect remaining masonry that surrounds removal area. Maintain flashing, reinforcement, lintels, and adjoining construction in an undamaged condition.
- C. Notify Architect of unforeseen detrimental conditions including voids, cracks, bulges, and loose units in existing masonry backup, rotted wood, rusted metal, and other deteriorated items.
- D. Remove in an undamaged condition as many whole bricks as possible.
 - 1. Remove mortar, loose particles, and soil from brick by cleaning with hand chisels, brushes, and water.
 - 2. Remove sealants by cutting close to brick with utility knife and cleaning with solvents.
- E. Clean bricks surrounding removal areas by removing mortar, dust, and loose particles in preparation for replacement.
- F. Replace removed damaged brick with other removed brick in good quality, where possible, or with new brick matching existing brick, including size. Do not use broken units unless they can be cut to usable size.
- G. Install replacement brick into bonding and coursing pattern of existing brick. If cutting is required, use a motor-driven saw designed to cut masonry with clean, sharp, unchipped edges.
 - 1. Maintain joint width for replacement units to match existing joints.
 - 2. Use setting buttons or shims to set units accurately spaced with uniform joints.
- H. Lay replacement brick with completely filled bed, head, and collar joints. Butter ends with sufficient mortar to fill head joints and shove into place. Wet both replacement and surrounding bricks that have ASTM C 67 initial rates of absorption (suction) of more than 30 g/30 sq. in. per min. Use wetting methods that ensure that units are nearly saturated but surface is dry when laid.
 - 1. Tool exposed mortar joints in repaired areas to match joints of surrounding existing brickwork.
 - 2. Rake out mortar used for laying brick before mortar sets and point new mortar joints in repaired area to comply with requirements for repointing existing masonry, and at same time as repointing of surrounding area.
 - 3. When mortar is sufficiently hard to support units, remove shims and other devices interfering with pointing of joints.

3.3 MASONRY UNIT PATCHING

- A. Patching Bricks:
 - 1. Remove loose material from masonry surface. Carefully remove additional material so patch will not have feathered edges but will have square or slightly undercut edges on area to be patched and will be at least 1/4 inch thick, but not less than recommended by patching compound manufacturer.
 - 2. Mask adjacent mortar joint or rake out for repointing if patch will extend to edge of masonry unit.
 - 3. Mix patching compound in individual batches to match each unit being patched.
 - 4. Rinse surface to be patched and leave damp, but without standing water.

5. Brush-coat surfaces with slurry coat of patching compound according to manufacturer's written instructions.
6. Place patching compound in layers as recommended by patching compound manufacturer, but not less than 1/4 inch or more than 2 inches thick. Roughen surface of each layer to provide a key for next layer.
7. Trowel, scrape, or carve surface of patch to match texture and surrounding surface plane or contour of the masonry unit. Shape and finish surface before or after curing, as determined by testing, to best match existing masonry unit.
8. Keep each layer damp for 72 hours or until patching compound has set.

3.4 PRELIMINARY CLEANING

- A. Removing Plant Growth: Completely remove visible plant, moss, and shrub growth from masonry surfaces. Carefully remove plants, creepers, and vegetation by cutting at roots and allowing drying as long as possible before removal. Remove loose soil and debris from open masonry joints to whatever depth they occur.

3.5 REPOINTING MASONRY

- A. Rake out and repoint joints to the following extent:
 1. All joints in areas indicated.
 2. Joints where mortar is missing or where they contain holes.
 3. Cracked joints where cracks can be penetrated at least 1/4 inch by a knife blade 0.027 inch thick.
 4. Cracked joints where cracks are 1/16 inch or more in width and of any depth.
 5. Joints where they sound hollow when tapped by metal object.
 6. Joints where they are worn back 1/4 inch or more from surface.
 7. Joints where they are deteriorated to point that mortar can be easily removed by hand, without tools.
 8. Joints where they have been filled with substances other than mortar.
 9. Joints indicated as sealant-filled joints.
- B. Do not rake out and repoint joints where not required.
- C. Rake out joints as follows, according to procedures demonstrated in approved mockup:
 1. Remove mortar from joints to depth of 2-1/2 times joint width, but not less than 1/2 inch or not less than that required to expose sound, unweathered mortar.
 2. Remove mortar from masonry surfaces within raked-out joints to provide reveals with square backs and to expose masonry for contact with pointing mortar. Brush, vacuum, or flush joints to remove dirt and loose debris.
 3. Do not spall edges of masonry units or widen joints. Replace or patch damaged masonry units as directed by Architect.
 - a. Cut out mortar by hand with chisel and resilient mallet. Do not use power-operated grinders.
 - b. Cut out center of mortar bed joints using angle grinders with diamond-impregnated metal blades. Remove remaining mortar by hand with chisel and resilient mallet.

- D. Notify Architect of unforeseen detrimental conditions including voids in mortar joints, cracks, loose masonry units, rotted wood, rusted metal, and other deteriorated items.
- E. Pointing with Mortar:
1. Rinse joint surfaces with water to remove dust and mortar particles. Contractor to time rinsing application so, at time of pointing, joint surfaces are damp but free of standing water. If rinse water dries, dampen joint surfaces before pointing.
 2. Apply pointing mortar first to areas where existing mortar was removed to depths greater than surrounding areas. Apply in layers not greater than 3/8 inch until a uniform depth is formed. Fully compact each layer thoroughly and allow it to become thumbprint hard before applying next layer.
 3. After low areas have been filled to same depth as remaining joints, point all joints by placing mortar in layers not greater than 3/8 inch. Fully compact each layer and allow to become thumbprint hard before applying next layer. Where existing masonry units have worn or rounded edges, slightly recess finished mortar surface below face of masonry to avoid widened joint faces. Take care not to spread mortar beyond joint edges onto exposed masonry surfaces or to featheredge the mortar.
 4. When mortar is thumbprint hard, tool joints to match original appearance of joints as demonstrated in approved mockup. Remove excess mortar from edge of joint by brushing.
 5. Cure mortar by maintaining in thoroughly damp condition for at least 72 consecutive hours including weekends and holidays.
 - a. Acceptable curing methods include covering with wet burlap and plastic sheeting, periodic hand misting, and periodic mist spraying using system of pipes, mist heads, and timers.
 6. Hairline cracking within the mortar or mortar separation at edge of a joint is unacceptable. Completely remove such mortar and repaint.
- F. Where repointing work precedes cleaning of existing masonry, allow mortar to harden at least 30 days before beginning cleaning work.

3.6 CHIMNEY CAPS

- A. Chimney caps are to be removed and replaced per current standards and technical notes of "The Brick Industry Association", Reston, VA.
- B. All unit chimney caps are to be replaced; this includes, but is not limited to the removal of all existing concrete, existing flashing and sealants.
- C. Form new concrete cap with non-combustible board such as cement board and temporary wooden forms as needed.
1. Install new aluminum flashing and adhere.
 2. Install new "ethafoam" expansion joint and wrap around all flues.
 3. Install new poured-in-place concrete cap with wire mesh reinforcement to minimize shrinkage. Set high end of concrete 2 inches minimum below flue and slope away from flue with a 2 1/2" overhang.
 4. Install backer-rod and sealant around all flues and remove forms.

3.7 STUCCO REPAIR AND REPARGING

- A. Cleaning: Substrates shall be clean, dry and free of efflorescence or other surface containments, which may affect the bond the stucco finish.
- B. Unit Masonry: The masonry shall be smooth and all new joints struck flush. All masonry being refinished to be skim coated with appropriate "Dryvit" base coat product for conditions as recommended by manufacturer.
- C. Prime Coat: Install "Dryvit Prime-W" for all applications over concrete, cement plaster/stucco and unit masonry.
- D. Finish Coat:
 - 1. Mixing.
 - a. The contents of the pails shall be mixed to a uniform consistency.
 - 2. Application
 - a. All manufacturers' published application instructions shall be followed.
 - b. Using a stainless steel trowel, the "StucCoat" finish shall be applied and leveled to a uniform thickness no thicker than the size of the largest aggregate. The texture is achieved by uniform hand motion using a stainless steel trowel, plastic or wooden float.
 - c. The "StucCoat" finish shall be applied to distinct wall areas in a continuous manner to avoid "cold joints".
 - d. For better color consistency, enough "StucCoat" pails shall be batched together to cover distinct wall areas.

3.8 FINAL CLEANING

- A. After mortar has fully hardened, thoroughly clean exposed masonry surfaces of excess mortar and foreign matter; use wood scrapers, stiff-nylon or -fiber brushes, and clean water, spray applied at low pressure.
 - 1. Do not use metal scrapers or brushes.
 - 2. Do not use acidic or alkaline cleaners.

END OF SECTION 04910

SECTION 06100
ROUGH CARPENTRY

PART 1 - GENERAL

1.1 - RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Special Conditions, and Division 1 Specification sections, apply to work specified in this Section.

1.2 - RELATED WORK SPECIFIED ELSEWHERE

- A. Interior woodwork exposed to view is specified in Section 06200.

1.3 - REFERENCE STANDARDS

- A. Use lumber and plywood grade-marked in accordance with the following standards:
1. Western wood: "Standard Grading Rules for Western Lumber", published by Western Wood Products Association.
 2. Southern Pine: "Standard Grading Rules for Southern Pine Lumber", published by Southern Pine Inspection Bureau.
 3. Plywood: Comply with PS 1 (ANSI A 199.1) or, for products not manufactured under PS 1 provisions, with applicable APA Performance Standard for type of panel indicated.
- B. Preservative pressure treated lumber and plywood shall comply with AWPA C2 and C9, respectively, and with the requirements listed below:
1. Wood for ground contact use: AWPB LP-22.
 2. Wood for above-ground use: AWPB LP-2.
- C. Requirements for all lumber:
1. Lumber shall be seasoned to 19% or less moisture content.
 2. Lumber and plywood shall be grade marked to show conformity to specifications.

PART 2 - PRODUCTS

2.1 - MATERIALS

- A. Sills, bucks, blocking, and nailers for use in conjunction with wood construction and where exposed to concrete, masonry, roofing or other sources of dampness: Any species of structural lumber, construction grade, pressure treated, meeting the requirements listed above.
- B. Joists, rafters, headers, stringers, beams, posts, studs, plates and other structural support members except those listed below: Douglas Fir-Larch, No.2 grade or better.
- C. Blocking, nailers, and other non-structural uses: Any species of structural lumber, construction grade or better.
- D. Exterior wall sheathing: nominal 1/2" tongue & groove, APA rated sheathing, Exposure 1.
- E. Roof Sheathing: Nominal 5/8", square edge, APA Rated Sheathing, Exposure 1.

PART 3 -EXECUTION

3.1 – WORKMANSHIP

- A. Produce joints which are tight, true and well nailed, with members assembled in accordance with the Drawings and with pertinent codes and regulations.
- B. Selection of lumber pieces:
 - 1. Carefully select the members.
 - 2. Select individual pieces so that knots and obvious defects will not interfere with placing bolts or proper nailing, and will allow making of proper connections.
 - 3. Cut out and discard defects which render a piece unable to serve its intended function.
 - 4. Lumber may be rejected by the Architect, whether or not it has been installed, for excessive warp, twist, bow, crook, mildew, fungus, or mold, as well as for improper cutting and fitting.
- C. Do not shim any framing component.

3.2 – GENERAL FRAMING

- A. General:
1. Provide framing members of the size(s) and spacing shown on the Drawings.
 2. In addition to framing operation normal to the fabrication and erection indicated on the Drawings, install solid wood blocking and backing required for fastening of grab bars and other accessories as required. All exterior blocking to be pressure treated.
 3. Do not notch, cut, or bore members for pipes, ducts, or conduits, or for other reasons except as shown on the Drawings or as specifically approved in advance by the Architect.
- B. Bearings:
1. Make bearings full unless otherwise indicated on the Drawings.
 2. Finish bearing surface on which structural members are to rest so as to give sure and even support.
 3. Where framing members slope, cut or notch the ends as required to give uniform bearing surface.

3.3 – ALIGNMENT

- A. On framing members to receive a finished surface, align the finish subsurface to vary not more than 1/8" from the plane of surfaces of adjacent furring and framing members.

3.4 – INSTALLATION OF PLYWOOD SHEATHING & UNDERLAYMENT

- A. Placements:
1. Place plywood with face grain perpendicular to supports and continuously over at least two supports, except where otherwise shown on the Drawings.
 2. Center joints accurately over supports, unless otherwise shown on the Drawings.
- B. Protect plywood from moisture by use of waterproof coverings until the plywood in turn has been covered with the next succeeding component or finish.

3.5 - FASTENING

A. Fasteners:

1. Where rough carpentry is exposed to weather, in ground contact, or in area of high relative humidity, provide fasteners with hot-dip zinc coating complying with ASTM A 153/A 153M.
2. Power-Driven Fasteners: CABO NER-272.
3. Bolts: Steel bolts complying with ASTM A 307, Grade A; with ASTM A 563 hex nuts and, where indicated, flat washers.

B. Metal framing anchors: Provide timber connection hardware by Simpson or approved equal of the gauges shown on the Drawings, or as otherwise required. Provide galvanized anchors for attaching carpentry to masonry or concrete.

C. Nailing:

1. Use only common wire nails or spike of the sizes shown in Table 2304.9.1 of the Connecticut State Building Code, except where otherwise specifically noted on the Drawings.
2. For conditions not covered in the Table, provide penetration into the piece receiving the point of not less than $\frac{1}{2}$ the length of the nail or spike, provided, however, that 16d nails may be used to connect two pieces of 2" (nominal) thickness.
3. Nail without splitting wood.
4. Pre-bore as required.
5. Remove split members and replace with members complying with the specified requirements.

D. Bolting:

1. Drill holes $\frac{1}{16}$ " larger in diameter than the bolts being used.
2. Drill straight and true from one side only.
3. Do not bear bolt threads on wood, but use washers under head and nut where both bear on wood, and use washers under all nuts.

E. Screws:

1. For lag screws and wood screws, pre-bore holes same diameter as root of threads, enlarging holes to shank diameter for length of shank.
2. For screws at plywood underlayment, countersink screws such that head of screw is 1/32" below the uppermost surface of the plywood.

END OF SECTION 06100

SECTION 07310
FIBERGLASS BASED ASPHALT SHINGLES

PART 1 - GENERAL

1.1 - RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Special Conditions, and Division 1 Specification sections, apply to work specified in this section.

1.2 - WORK INCLUDED

- A. Provide all materials, labor, equipment and services necessary to furnish, deliver and install asphalt shingle roofing and related work as required by the Drawings and/or herein specified, generally as follows:
 - 1. Asphalt shingle roofing on all re-roofed areas of existing roof as shown on the Drawings.
 - 2. Felt underlayment under all new asphalt roofs.
 - 3. Ice and water barrier at all new eaves, all new valleys and elsewhere as shown.

1.3 - RELATED WORK SPECIFIED ELSEWHERE

- A. Rough Carpentry is specified in Section 06100.
- B. Gutters and leaders are specified in Section 07630.

1.4 - REFERENCES

- A. The National Roofing Contractors Association Roofing and Waterproofing Manual, "Steep Roofing" section, is hereby incorporated by reference. Contractor shall be familiar with this reference, and a copy shall be on the job.
- B. Follow roof shingle manufacturer's recommendations unless they are less stringent than these specifications. If roof shingle manufacturer's recommendations prohibit parts of these Specifications, notify Architect.

1.5 - SUBMITTALS

- A. Samples: Submit samples of asphalt shingles for matching existing roofing.
- B. Certificate: Furnish manufacturer's certification that asphalt shingles furnished meet or exceed the requirements of this section.
- C. Manufacturer's Literature: Material description and recommended installation procedures.

D. Manufacturer's Warranty.

1.6 - DELIVERY, STORAGE & HANDLING

- A. Deliver materials with manufacturer's labels intact and legible.
- B. Deliver materials in sealed packages with Underwriters Laboratories, Inc. labels.
- C. Store materials on raised platforms and protect with coverings at outdoor locations.
- D. Do not stack bundles of shingles more than 4 high.
- E. Store rolled goods on end.

1.7 - WARRANTY

- A. The asphalt roof shingle shall be guaranteed against material defects for a period of 30 years minimum by the manufacturer.

PART 2 - PRODUCTS

2.1 - ASPHALT ROOF SHINGLES

- A. Self-sealing "Architectural" style fiberglass shingles, UL Class "A", Standard Weight: Mineral-surfaced, self-sealing, 3-tab asphalt fiberglass strip shingles complying with ASTM D 3018, bearing UL Class "A" external fire exposure label and UL "Wind Resistant" label, with thirty (30) year warranty. Color, texture and style as selected. Basis of Design: GAF "Timberline". Subject to compliance with requirements of the Contract, equal products from one of the following manufacturers may also be acceptable:
 - 1. CertainTeed.
 - 2. Owens – Corning.

2.2 - OTHER MATERIALS

- A. Underlayment: Manufacturer's recommended fiberglass-reinforced asphalt-saturated roofing felt underlayment conforming to the requirements of ASTM D226, Type 1, or ASTM D4869, Type 1, and manufactured for use as fiberglass-asphalt shingle underlayment. Product shall be GAF "Shingle-Mate" or equivalent by same manufacturer as shingles.
- B. Nails: Aluminum or hot-dip galvanized, minimum 12 gauge, sharp pointed conventional roofing nails with barbed shanks, 3/8" diameter head. Nails length shall be of sufficient length to penetrate minimum 3/4" into sheathing.

- C. Eave Flashing (Ice & Water Barrier): GAF "Weatherwatch" or equivalent by same manufacturer of shingles, 36" wide rolls to dimensions indicated on drawings.
- D. Metal Rake and Drip Edge: Minimum .024" thick aluminum sheet as manufactured by Alcoa, or approved equal, with 3" roof deck flange, and 1-1/2" fascia flange and 3/8" drip at lower edge. Furnish in 8' or 10' lengths. Color shall be white.
- E. Ridge ventilator: Use one of the following, complete with all parts required for complete installation. Ventilators shall not allow rain or snow infiltration.

Air Vent, Inc., "Shinglevent II" ridge vent.
"Cor-A-Vent". Manufacturer's phone: (219) 255-1910.
GAF "Cobra Rigid Vent II".
North American Building Products, Inc., "Ridgeline Vent".
- F. Roof Cement: Complying with ASTM D 4586.
- G. Provide auxiliary products such as rubber-metal boots for flashing vents and other penetrations. Such products shall be manufactured by the shingle manufacturer or recommended by them.

PART 3 - EXECUTION

3.1 - PREPARATION

- A. Assure the surfaces to which shingles are to be applied are uniform, smooth, sound, clear, dry and free of irregularities. Do not start shingle installation until all unsatisfactory conditions are corrected. The installation of shingles shall represent the acceptance of existing conditions by the installer.
- B. When the outside temperature is expected to be 40 degrees or below, the shingles shall be warmed sufficiently so as to prevent cracking. All cracked or damaged shingles shall be discarded as debris.

3.2 - DEMOLITION

- A. Where specifically shown on the Drawings, remove existing layer(s) of asphalt shingle, wood shake starter course, underlayment, metal drip and rake edges, etc., down to the existing sheathing. Avoid damage to the existing sheathing. Set or replace any loose or missing nails.
- B. Protect the public, the building and the landscaping from damage from materials removed from the roof. Use plywood chutes or other approved method.
- C. All demolition materials shall be legally disposed of off-site, at the Contractor's expense including disposal fees and permits.

- D. Inspect all existing sheathing, fasciae, soffits and framing for damage (rotting, delaminating, structural impairments) and notify Architect in writing.

3.3 - INSTALLATION

- A. Coordinate work with flashings specified in Section 07600 and work specified in Divisions 15 and 16 which passes through roof. Build in flashings for mechanical and electrical work.
- B. Apply materials generally in the following order:
1. Apply eave flashings. At bottom edge turn eave flashing material over and down wall to the bottom of the gutter or to the bottom of the metal drip or fascia. Install eave flashings to extend from the eaves up the roof slope to a point 24" or more inside and above the projected interior plane of the exterior wall of the building, measured on the slope. Within 8'-0" of dormers and at dormers, extend eave flashings up the roof slope to a point 48" or more inside and above the projected interior plane of the exterior wall of the building. Apply eave flashing material up valleys, 33" to both side of valleys. If roof slope is less than 6:12, extend eave flashing material 48" to both sides of valleys. Lap flashing 6", and seal laps.
 2. Apply metal fascia or metal eave drips.
 3. Apply underlayment over all roof surfaces, including over eave and valley flashings down to the edge. Lap joints 12", the upper over the lower. Apply patches where underlayment is cut, broken, or fitted around penetrations. Tape patches and all penetration and edge joints.
 4. At valleys, weave underlayment.
 5. At intersections between sloped roof and walls, install metal step flashing as recommended by SMACNA. Lower flashings shall extend 5" or more out between shingles, and shall extend 5" or more up wall, behind siding.
 6. At eaves for which gutters are indicated, install gutter hangers. Install gutter hangers before installing shingles, so that hangers are under shingles. Install gutter hangers so that gutter will slope downward toward drains. If slope toward drains is not possible, notify Architect and modify installation as directed.
 7. Install shingles as recommended by manufacturer. Apply six nails per shingle. If the temperature and season at the time of installation are not such that self-sealing shingles will bond, warm them with hot air gun and press them to adhere self-sealing material, or apply mastic and press shingles into it to adhere them.
 8. At ridges install ventilators as shown on the Drawings.
 9. Make all shingles, including lowest courses and rake shingles, tight to the wind.

10. Follow manufacturer's instructions for installation of starter shingles to ensure that there are self-sealing strips under the butts of the lowest courses of shingles. This may require removing tabs from shingles. In addition to following manufacturer's and reference recommendations, set lowest two courses of shingles with full bed of roof cement between all layers.
11. In addition to following manufacturer's and reference recommendations, set rake shingles with full bed of roof cement between all layers, 12" wide.
12. If the shingles are not effectively self-sealed within 1 month of installation provide a bed of roof cement or "Blackjack" asphalt sealant to hold them.
13. Flatten all shingles which do not naturally lie flat, and cement them in place. Note that fiberglass shingles do not always flatten by themselves.

3.4 - EXTRA STOCK

- A. At the conclusion of the Work, the Contractor shall provide the Owner with a minimum of 2% of shingle used. Provide in unopened clearly labeled bundles.

END OF SECTION 07310

SECTION 07600
FLASHING AND SHEET METAL

PART 1 - GENERAL

1.1 - RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Special Conditions, and Division 1 Specification sections, apply to work specified in this section.

1.2 - RELATED WORK SPECIFIED ELSEWHERE

- A. Fiberglass based asphalt shingles are specified in Section 07310.
- B. Gutters & leaders are specified in Section 07630.
- C. Sealants are specified in Section 07900.

PART 2 - PRODUCTS

2.1 - FLASHING MATERIALS

- A. For use in Contact with Concrete or Concrete Masonry Units: Galvanized sheet metal. Thickness: 24 gauge.
- B. For all other uses: Aluminum, .027" thick.

2.2 - ACCESSORIES

- A. Fasteners: Use broad-head deformed shank roofing nails for nailing, and use screws, pop-rivets, and other fasteners where appropriate. Use double galvanized or stainless steel fasteners to fasten galvanized steel. Use double galvanized or aluminum fasteners to fasten aluminum. Use of improper fasteners shall be cause for rejection of the work.
- B. Solder: ASTM B32, of grade recommended for metal being specified.
- C. Sealant: See Section 07900.

PART 3 - EXECUTION

3.1 - INSTALLATION, GENERAL

- A. Unless shown otherwise, installation of sheet metal work shall conform to the recommendations of "Roofing and Waterproofing Manual", published by the National Roofing Contractors Association (NRCA), and "Architectural Sheet Metal Manual", published by Sheet Metal and Air Conditioning Contractors National Association, Inc. (SMACNA).

- B. Wherever metal comes in contact with dissimilar metals, insulation shall be provided between same consisting of a layer of 15 lb. saturated roofing felt bonded in mastic, or the surfaces in contact shall be given a coat of bituminous base paint.

END OF SECTION 07600

SECTION 07630
GUTTERS AND LEADERS

PART 1 - GENERAL

1.1 - RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Special Conditions, and Division 1 Specification sections, apply to work specified in this section.

1.2 - RELATED WORK SPECIFIED ELSEWHERE

- A. Fiberglass based asphalt shingles are specified in Section 07310.
- B. Flashing and sheet metal are specified in Section 07600.

1.3 - REFERENCES

- A. Unless shown otherwise, standard details shall conform to the recommendations of "Architectural Sheet Metal Manual", published by Sheet Metal and Air Conditioning Contractors' National Association, Inc.

PART 2 - PRODUCTS

2.1 – GUTTERS

- A. Gutters shall be an "OGEE" or "K" style gutter fabricated from 0.032" thick aluminum. Finish shall be baked on enamel. Color shall be white.
- B. All miscellaneous items shall be the manufacturer's standard including end caps, corners, fasteners, gutter straps, and support brackets.

2.2 – LEADERS

- A. Leaders shall be a rectangular, corrugated leaders fabricated from 0.024" thick aluminum. Finish shall be baked on enamel. Color shall be white.

PART 3 - EXECUTION

3.1 - GENERAL REQUIREMENTS

- A. All metal work shall be fabricated and installed in accordance with details shown on the Drawings unless otherwise recommended by the gutter and leader manufacturers. Details shown on the Drawings shall be considered typical and shall apply for all similar conditions or features where not otherwise shown. Where details are not shown and typical details do not apply, details of the work shall comply with reference standard stated in 1.3 above.

- B. Adequate provisions shall be made in all metal work to compensate for thermal expansion and contraction. Provide expansion joints where required as directed by the material's manufacturer.
- C. Wherever metal comes in contact with dissimilar metals, insulation shall be provided between same consisting of a layer of 15 lb. saturated roofing felt bonded in mastic, or the surfaces in contact shall be given a coat of bituminous base paint or elastic cement.
- D. Surfaces upon which metal will be applied shall be made smooth, free from projections and depressions, and surface irregularities.
- E. All fasteners proposed shall be corrosion and rust resistant and electrolytically compatible with material being fastened.

3.2 – INSTALLATION

- A. Install gutters at all roof eaves and elsewhere as indicated. Slope all gutters not less than 1/16" per foot toward downspouts locations. Place gutter to allow snow and ice to slide clear; vary with roof pitch. Install gutters with adjustable hangers fastened directly to the roof sheathing under the shingles. Typical spacing to be 3'-0" o.c., maximum. Reduce spacing to 2'-0" o.c. maximum on north exposure and other areas where ice and snow may accumulate. In all instances, hangers shall be uniformly spaced.
- B. Secure leaders plumb by use of matching strap anchors. Fasten strap anchors using corrosion resistant machine driven screws of sufficient length to fully penetrate exterior sheathing. Secure at top, bottom, and at a maximum spacing of 8'-0" o.c. or minimum of two anchors per piece. Provide eave offsets and drainage shoes where required.
- C. Provide expansion joints at 40'-0" maximum. At expansion joints, provide concealed joint covers. Prior to installing joint covers, provide a bead of caulking on each side of the expansion joint.
- D. All work shall be installed so that it is water-tight and free from visible waves, buckles, cracks, tool marks, dirt, stain and other defects of materials and workmanship which would affect its strength, durability and appearance.

END OF SECTION 07630

SECTION 07900
SEALANTS

PART 1 - GENERAL

1.1 - RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Special Conditions, and Division 1 Specification sections, apply to work specified in this section.

1.2 - WORK INCLUDED

- A. Caulk all openings in exterior walls, including doors, windows, mechanical openings, and control joints and elsewhere as shown. Caulk both inside and outside.
- B. The required interior applications of sealant work include, but are not necessarily limited to the following general locations:
 - 1. Sound sealed and waterproof joints.
 - 2. Joints between metal door frames and other finished surfaces.
 - 3. Joints between wood frames or wood trim and other finished surfaces.

1.3 - RELATED WORK SPECIFIED ELSEWHERE

- A. Finish Carpentry is specified in Section 06200.
- B. Acoustical sealant is specified in Section 09250.

1.4 - SUBMITTALS

- A. Submit manufacturer's color charts for color selection.

1.5 - DELIVERY, STORAGE AND HANDLING

- A. Do not retain at the job site material which has exceeded the shelf life recommended by its manufacturer.

1.6 - PROJECT/SITE CONDITIONS

- A. Apply sealants only to dry surfaces.
- B. Do not apply sealants when temperature is below 40 degrees F. or less than 46 degrees F. and falling.

PART 2 - PRODUCTS

2.1 - MATERIALS

- A. General Exterior sealant: 1-Part type silicone joint sealant complying with Federal Specification TT-S-001543A, Dow Corning 790 Silicone Building Sealant. Equal products by Pecora or General Electric are also acceptable. Color: As selected by the Architect.
- B. Sealant for use in filling interior cracks at door and window trim, countertops, wood base, etc.: Acrylic Latex Caulk (ASTM C384) suitable for painting. Color: white.
- C. Joint Backing: Rod stock compatible with sealant being used, size as required.

PART 3 - EXECUTION

3.1 - INSPECTION

- A. Prior to application of sealants, the Contractor shall examine the surfaces of the work to which sealants will be applied. Correct conditions detrimental to timely and proper completion of the Work. Do not proceed until unsatisfactory conditions are corrected.

3.2 - PREPARATION

- A. Bonding surfaces on both new and remedial jobs must be clean, dust and frost free. Solvent wipe the surfaces using a clean oil-free rag saturated with solvent compatible with surface being cleaned, as recommended by sealant manufacturer. Do not flood surfaces with more solvent than necessary.
- B. Do not clean surfaces with soap, detergent or any water-based cleaner. Make sure that apparently clean surfaces are not covered with a thin film of construction dust.

3.3 - APPLICATION

- A. Apply joint backing to joints open in back or over 1/2" deep. Compress backing so as to form a firm stop which will resist sealant pressure.
- B. Sealants shall be installed with either a hand operated or air-operated caulking gun with sufficient pressure to completely fill voids and joints solidly. Extreme care shall be taken to prevent smearing onto adjacent surfaces. Material shall be heated as recommended by the manufacturer. Joints shall have a neat, uniform, slightly concave appearance.
- C. All sealant work shall strictly conform to the sealant manufacturer's technical instructions for surface preparation and application procedures to accomplish a weathertight seal.
- D. Tool joints within 10 minutes of application. If masking tape is used, remove tape before a

surface skin begins to form.

- E. After applying the sealant and after a "skin" has formed, do not disturb the joint for 48 hours.

3.4 - REMEDIAL WORK AND LIMITATIONS

- A. Should sealant not completely fill or fully adhere to intended surfaces on first pass, remove bead and reapply. Do not apply successive beads to fill opening or obtain adhesion.
- B. If cleaning solvents stain, abrade, or otherwise damage adjacent materials or surfaces, all repair, replacement, etc. shall be performed at no additional cost.

3.5 - CLEAN UP

- A. Completely remove excesses, spillage, "tails", and properly dispose of same; use solvents recommended by manufacturer of sealant being applied.
- B. Select solvents that are compatible with surfaces being cleaned.

END OF SECTION 07900

SECTION 08550
VINYL REPLACEMENT WINDOWS

PART 1 - GENERAL

1.1 - RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Special Conditions, and Division 1 Specification sections, apply to work specified in this section.

1-2 - WORK INCLUDED

- A. Provide insulated glass, vinyl replacement windows, complete with screens, in the locations shown on the Drawings and in the Lead Paint Abatement Window Schedule. Size and type of window shall match existing.

1.3 - RELATED WORK SPECIFIED ELSEWHERE

- A. Flashing and sheet metal are specified in Section 07600.
- B. Sealants are specified in Section 07900.

1.4 – QUALITY ASSURANCE

- A. Windows/window performance shall comply with the requirements of the 2012 International Energy Conservation Code as published by the International Code Council and amended by the State of Connecticut.

PART 2 - PRODUCTS

2.1 - MATERIALS

- A. Vinyl Replacement Windows: Where shown, provide 400 series vinyl windows as manufactured by Andersen Windows, Inc. Subject to compliance with the requirements of the contract, equal products by Marvin Windows, and Harvey Building Products may also be acceptable when approved in advance by the Architect.
 - 1. Color: White.
 - 2. Glazing: Provide 5/8" low-E insulating glazing for all sash.
 - 3. Windows must have tilt-in sash, welded frames, and cam & sash locks.
 - 4. Screens: Provide one (1) lockable half screen for each double hung window, fiberglass mesh in aluminum frame. Provide full screens for awning and casement windows.
 - 5. Provide manufacturer's standard extension sills & headers, panning systems, etc. and any other accessories required to complete the installation. Color to match windows.

6. Emergency escape windows: Bedroom windows scheduled for replacement must comply with the emergency escape requirements of the 2012 International Residential Code, as amended by the State of Connecticut.
7. Where conditions warrant, windows must comply with the requirements for window opening limiting devices of the 2012 International Residential Code, as amended by the State of Connecticut.
8. All windows must comply with "Energy Star" requirements.

PART 3 - EXECUTION

3.1 - INSTALLATION

- A. Install windows in accordance with manufacturer's recommendations and instructions. Anchor windows securely into existing construction, plumb and true.
- B. As required for watertightness, furnish and install continuous vinyl sections of profiles required to accomplish a watertight closure condition. Where aluminum is existing or shown on the drawings, use aluminum. Seal entire window perimeter and all other joints with sealant. Color to match windows.
- A. Adjust sash for tight closure and easy operation without binding or racking.
- B. Adjust sash lock, screens and other features for smooth operation.

END OF SECTION 08550

SECTION 09900
PAINTING

PART 1 - GENERAL

1.1 - RELATED DOCUMENTS

- A. Drawings and general provisions of the Contract, including General and Special Conditions, and Division 1 Specification sections, apply to work specified in this Section.

1.2 - WORK INCLUDED

- A. Paint all new interior and exterior surfaces as set forth below. Painting work includes, but is not necessarily limited to, the following:
1. Paint all new interior wood trim provided at windows scheduled to be replaced.
 2. Paint all existing interior surfaces disturbed by the work of this Contract, entire surface, to next corner or break point.
 3. Paint all new exterior wood trim, soffits, and fasciae provided on a unit price basis as a part of this Contract.
 4. Paint lead based paint wall surfaces encapsulated during the remediation process of specification Section 02090. Provide 2 finish coats over encapsulated surface.

1.3 – RELATED WORK SPECIFIED ELSEWHERE

- A. Unit Prices are specified in Section 01270.
- B. Lead-Based Paint Abatement is specified in Section 020900.

1.4- SUBMITTALS

- A. Submit complete list of proposed materials. For each surface, list materials by manufacturer and name, and list number of coats. List thinners, if any.
- B. Submit complete range of standard and custom mix colors of the selected manufacturer for color selections.

1.5 - DELIVERY, STORAGE & HANDLING

- A. Deliver all products to job site in manufacturers' unopened containers with seals unbroken and labels intact.
- B. Store products so as to minimize danger of fire and protect building surfaces from spills.

1.6 - PROJECT/SITE CONDITIONS

- A. Do not paint when temperature of air or surfaces being painted is below 40 degrees F. Do not apply epoxy paint when temperature of air or surfaces being painted is below 60 degrees F. Do not paint when atmosphere is damp, and do not paint when surfaces are damp, unless paint manufacturer states that paint is intended for such use.
- B. Do not paint unless lighting is adequate.
- C. Provide ventilation during painting and drying periods.

PART 2 - PRODUCTS

2.1 - ACCEPTABLE MANUFACTURERS

- A. Besides manufacturer listed in schedule (PPG Industries, Inc. - Pittsburgh Paints), the following manufacturers are also acceptable:

Benjamin Moore Co.
Sherwin-Williams Co.

No other paint manufacturer will be accepted.

2.2 - MATERIALS

- A. Use first quality products of the types specified in schedule. "First quality" means best, most expensive line of professional quality paints produced by selected manufacturer.
 - 1. If requested, submit formulations to Architect to demonstrate compliance with above requirements.
 - 2. Deliver all materials to job site in unopened containers, bearing names of manufacturer and contents.
- B. All paints and primers must be less than or equal to the following VOC levels:
 - 1. Flats: 50 grams/liter.
 - 2. Non-Flats: 50 grams/liter.
 - 3. Floor Paint: 100 grams/liter.
- B. Use thinners recommended by manufacturers. In general, use mineral spirits to thin oleoresinous paints.
- C. Materials shall meet all requirements of ANSI Z66.1, "Specifications to Minimize Hazards to Children from Residual Surface Coating Materials".

2.3 - COLORS

- A. For interior and exterior surfaces, the Architect shall select colors from full range of standard ready-mixed and custom-mixed colors offered by supplying manufacturer. Architect shall submit color selections in schedule form. Follow Architect's schedule exactly.
- B. Concealed surfaces, such as door bottoms, may be painted grey.

PART 3 - EXECUTION

3.1 - INSPECTION

- A. Examine all surfaces to receive paint.
 - 1. If surfaces are not fit to receive paint; scrape, brush, or remove unsatisfactory materials by mechanical means, then clean and prepare surfaces for painting operation. Follow manufacturer's instructions concerning surface suitability.
- B. The start of work on any surface shall constitute acceptance of the condition of that surface.

3.2 - PREPARATION

- A. Broom-clean entire area before painting.
- B. Clean surfaces to be painted.
- C. Remove rust. If, in Architect's opinion, primed products have corroded significantly, strip all primer from such products, prepare again and reprime.
- D. Sand and fill rough surfaces, which are not intended to be rough. Spackle interior holes and cracks. Putty fastener holes after applying prime coat.
- E. Seal knots and pitch spots. Wash sap and pitch from surface, and apply Western Pine Association Formula WP-578 sealer or equivalent as recommended by selected manufacturer.
- F. Protect adjacent surfaces and items. Remove or protect such items as electrical plates and hardware. After painting, reinstall items removed for protection.
- G. On galvanized metal products scheduled to be painted, remove factory applied stabilizers using solvent, brush blasting or chemical treatment as required.

3.3 - APPLICATION

- A. Architect has specified number of coats of paint based on the assumption that quality of paint, opacity of pigments, extent of thinning, and quality of workmanship will be good. If Contractor disputes Architect's schedule, notify Architect in writing before starting work.

- B. Use products as packaged, unless manufacturer specifically directs thinning or other alteration for proper application. Mix all products thoroughly before, and regularly during application.
- C. Follow manufacturer's directions for millage thickness application and rate of coverage.
- D. Apply paint evenly. Produce uniform surfaces. Avoid runs, sags, brush or roller marks, "holidays", differences in sheen or color, and other blemishes.
- E. If specified number of coats is not sufficient to satisfy requirements specified in D. above, as adjudged by Architect, apply additional coats as required to do so.
- F. Brush paint into cracks and seams. Cut straight, neat edges.
- G. Do not allow paint to get on adjacent surfaces. Clean up spills and spatters as soon as possible, and no later than end of same day.
- H. Allow each coat to dry as recommended by manufacturer before applying following coat.
- I. Between coats, trowel in place drywall compound to cover defects in surface and sand smooth to match adjacent surfaces. Reprime those areas.
- J. At substantial completion, all surfaces shall be clean. If painted surfaces cannot be uniform, rectify condition by cleaning, or repaint them in accordance with 3.2 and 3.3 of this specification section.
- K. Sand smooth finish enamel between coats.

3.4 - SCHEDULE

- A. General
 - 1. Paint concealed surfaces such as door tops and bottoms and panel frames and edges.
 - 2. Paint mechanical/electrical products unless they are fully concealed and corrosion-resistant.
 - 3. If shop-applied primer coat is in good condition, field prime coat is not required. Patch primer where scratched or abraded.
 - 4. If shop-applied finish coat is in good condition, and if it matches Architect's selected color, field finishing is not required. Patch where not smooth, uniform, and in tact.
- B. Paint all new exposed interior surfaces and any existing surfaces disturbed by the work of this Contract, except the following:

1. Items such as window glass, acoustical tile, ceramic tile, plastic laminates, and resilient flooring which are customarily not painted.
 2. Shop-finished items such as cabinets, window frames, and toilet partitions, except as required in A. above.
 3. Wood doors, wood trim, and architectural woodwork scheduled for transparent finish.
 4. Concrete floors and walls, except where schedule on the Drawings specifically calls for painted concrete floors or walls.
 5. Floor, wall, and ceiling surfaces listed in finish schedule not to be painted.
- C. Schedule by surfaces. The following schedule is based on the products of Pittsburgh Paints as manufactured by PPG Industries, Inc. Equal products of other manufacturers listed in 2.1 above are also acceptable. Submit schedule to the Architect as required in 1.4 above. Primer coat may be deleted on previously painted surfaces or surfaces receiving liquid encapsulation performed under specification section 020900.
1. Interior Gypsum Wallboard Surfaces:
Primer: 1 coat Speedhide Quick-drying Latex Primer-Sealer, 6-2.
Finish: 2 coats Speedhide Interior Enamel Eggshell Latex, 6-411 series.
 2. Interior Wood Trim scheduled for opaque finish:
Primer: 1 Coat Speedhide Quick-drying Latex Primer-Sealer, 6-2.
Finish: 2 coats Speedhide Interior Semi-Gloss Acrylic Latex, 6-500.
 5. Exterior Wood Trim:
Primer: 1 Coat Speedhide Exterior Latex Wood Primer, 6-609.
Finish: 2-coats Sun-Proof Exterior House and Trim Satin Latex 100% Acrylic, 76-110.
 4. Other Surfaces:

Follow master specification of selected paint manufacturer for three (3) coat work in normal service area.

END OF SECTION 09900