

September 15, 2015

VIA ELECTRONIC MAIL

Mr. Michael Perrone, Siting Analyst
Connecticut Siting Council
10 Franklin Square
New Britain, CT 06051
Michael.Perrone@ct.gov

Re: Docket 449 - Development and Management Plan ("D&M Plan")
Telecommunications Facility at Redding Ridge Fire Department
186 Black Rock Turnpike, Redding, Connecticut


Dear Mr. Perrone:

Please accept this letter on behalf of the Certificate Holder Message Center Management, Inc. providing the following information in response to your inquiries:

1. Noise: The air conditioning units will have acoustical shielding (Marvair External Low Noise Blower or approved equal) on each unit. In addition, the vinyl slats proposed on the eastern fencing are being used as a means of acoustical shielding from the closest property line to bring the units in to compliance with applicable noise regulations.
2. Generator run time: As the Council is aware the Fire District and MCM will be sharing a 2000 gal propane tank to serve the two (2) generators on site. The overall run time for this tank will depend on the required load for each of these generators but the following is anticipated:
 - 100% Carrier Load + 100% FD Load = 2.6 days
 - 100% Carrier Load + 50% FD Load = 3.6 days
 - 75% Carrier Load + 50% FD Load = 4.2 days

Please note that the Fire District advises that they normally do not require anything more than a 50% load. Please let me know if you require anything further regarding the foregoing.

Very truly yours,

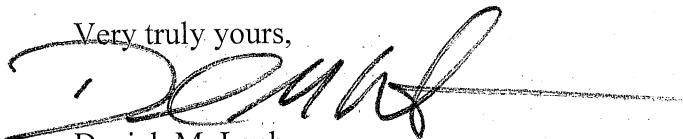

Daniel M. Laub

cc: Melanie Bachman, Esq., Executive Director
Virginia King, MCM
Christopher B. Fisher, Esq.