




Measured Electric Field at Waterbury Waste Treatment Facility Lines 1570 and 1990 adjacent to Baldwin Substation

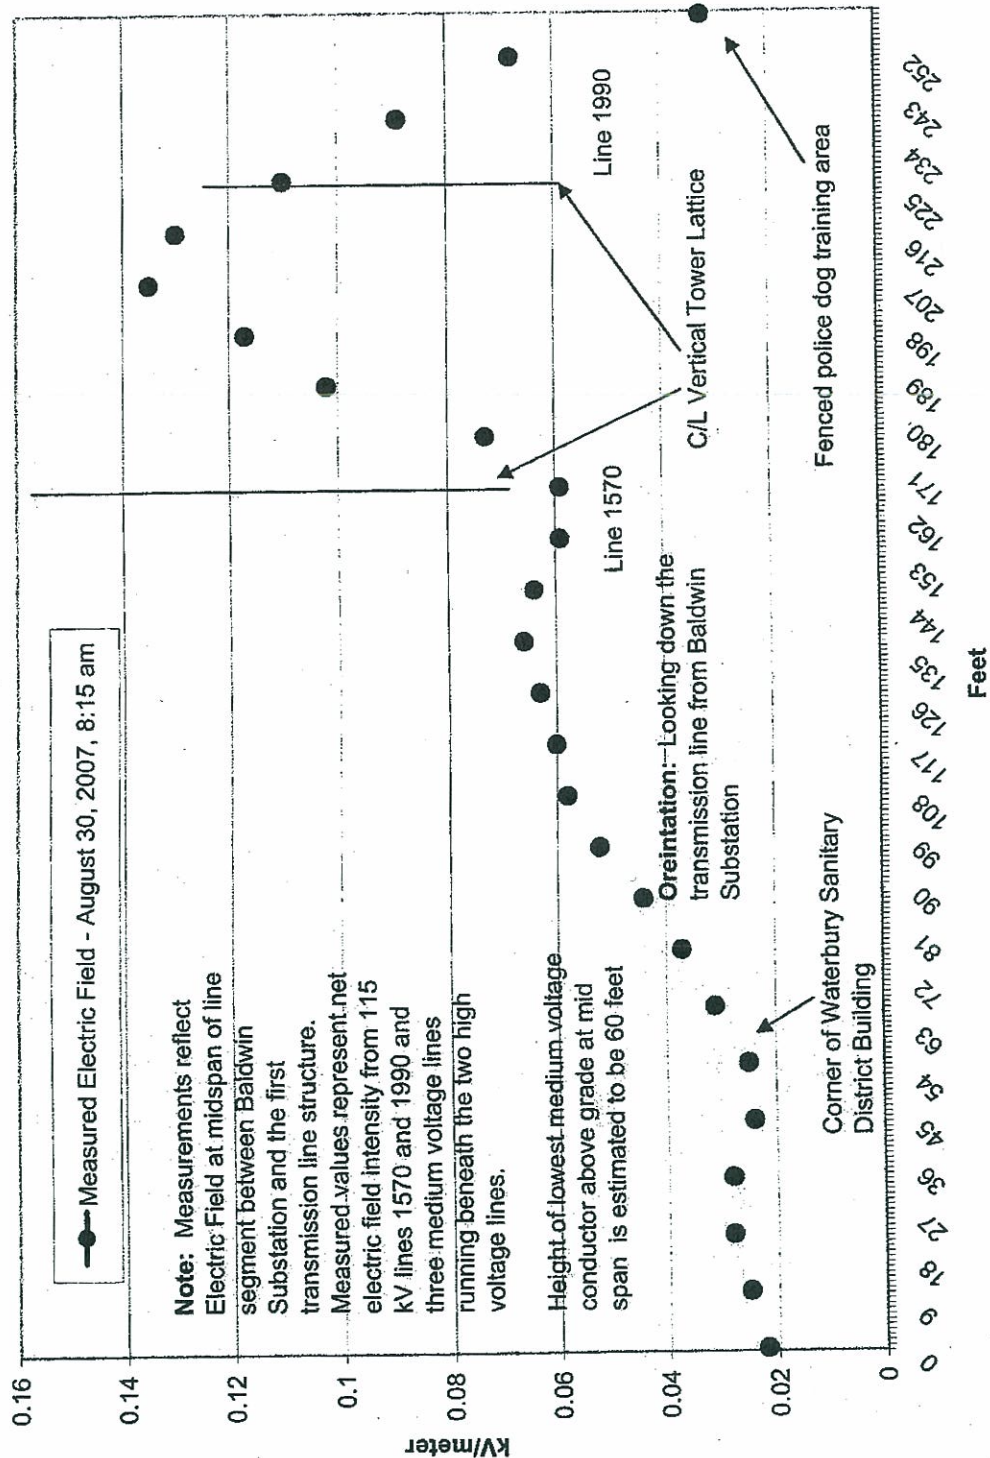

Measured Magnetic Flux Density at Waterbury Waste Treatment Facility Lines 1570 and 1990 adjacent to Baldwin Substation

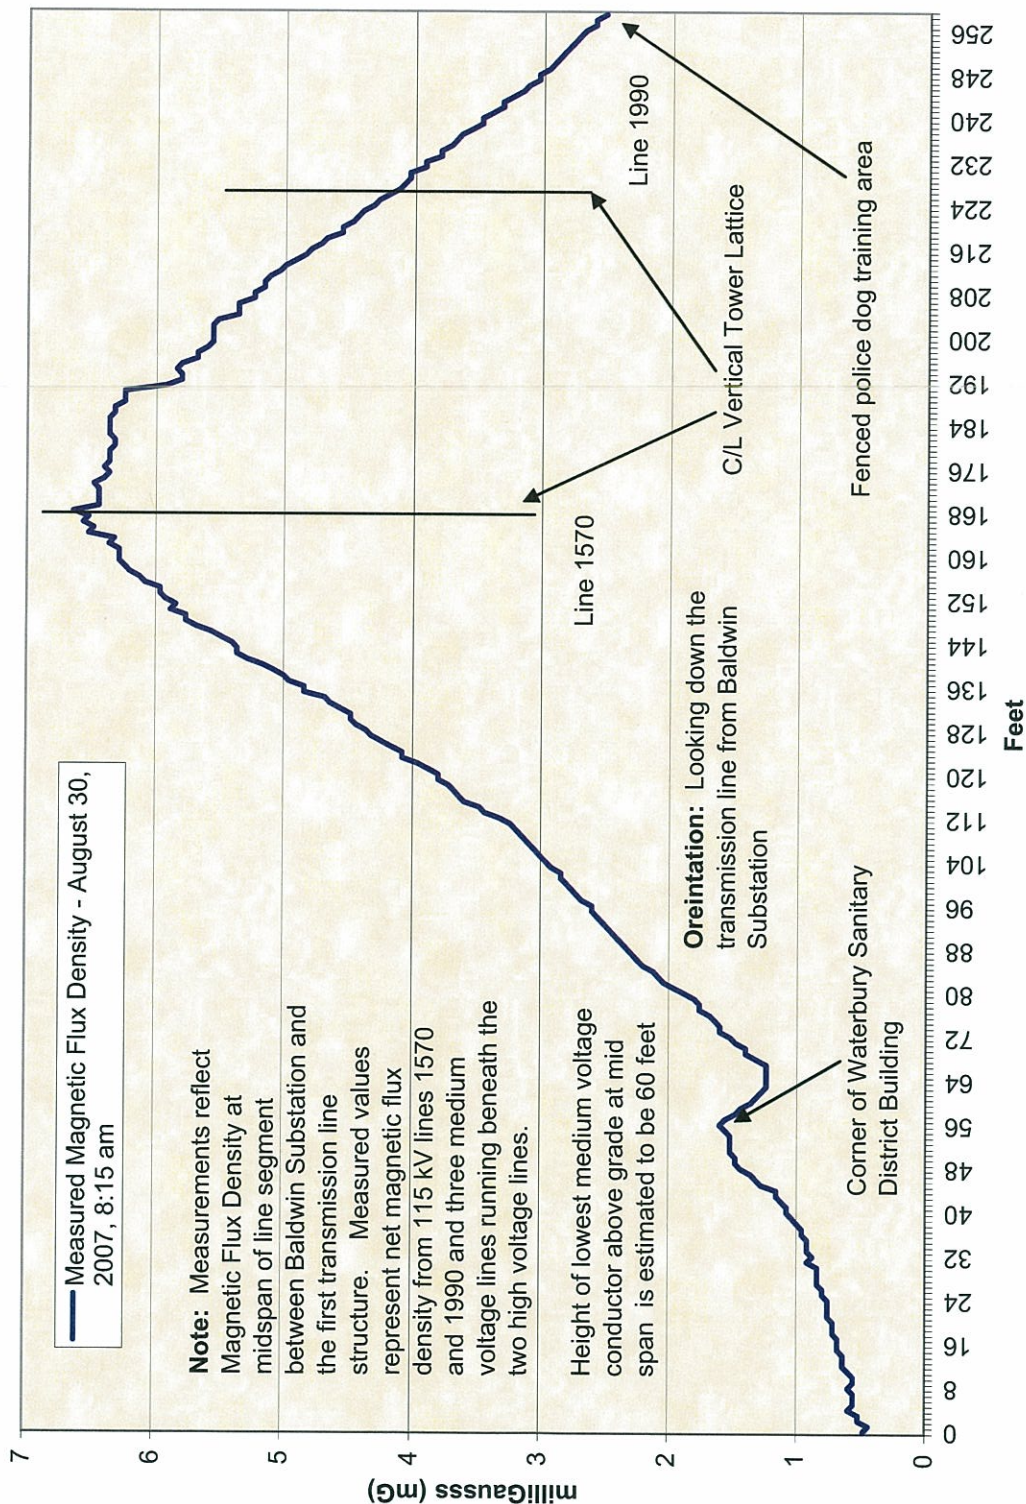

Projected Magnetic Flux Density
Proposed 115 kV Transmission Line
Firstlight Waterbury Combustion Turbine Peaking Facility

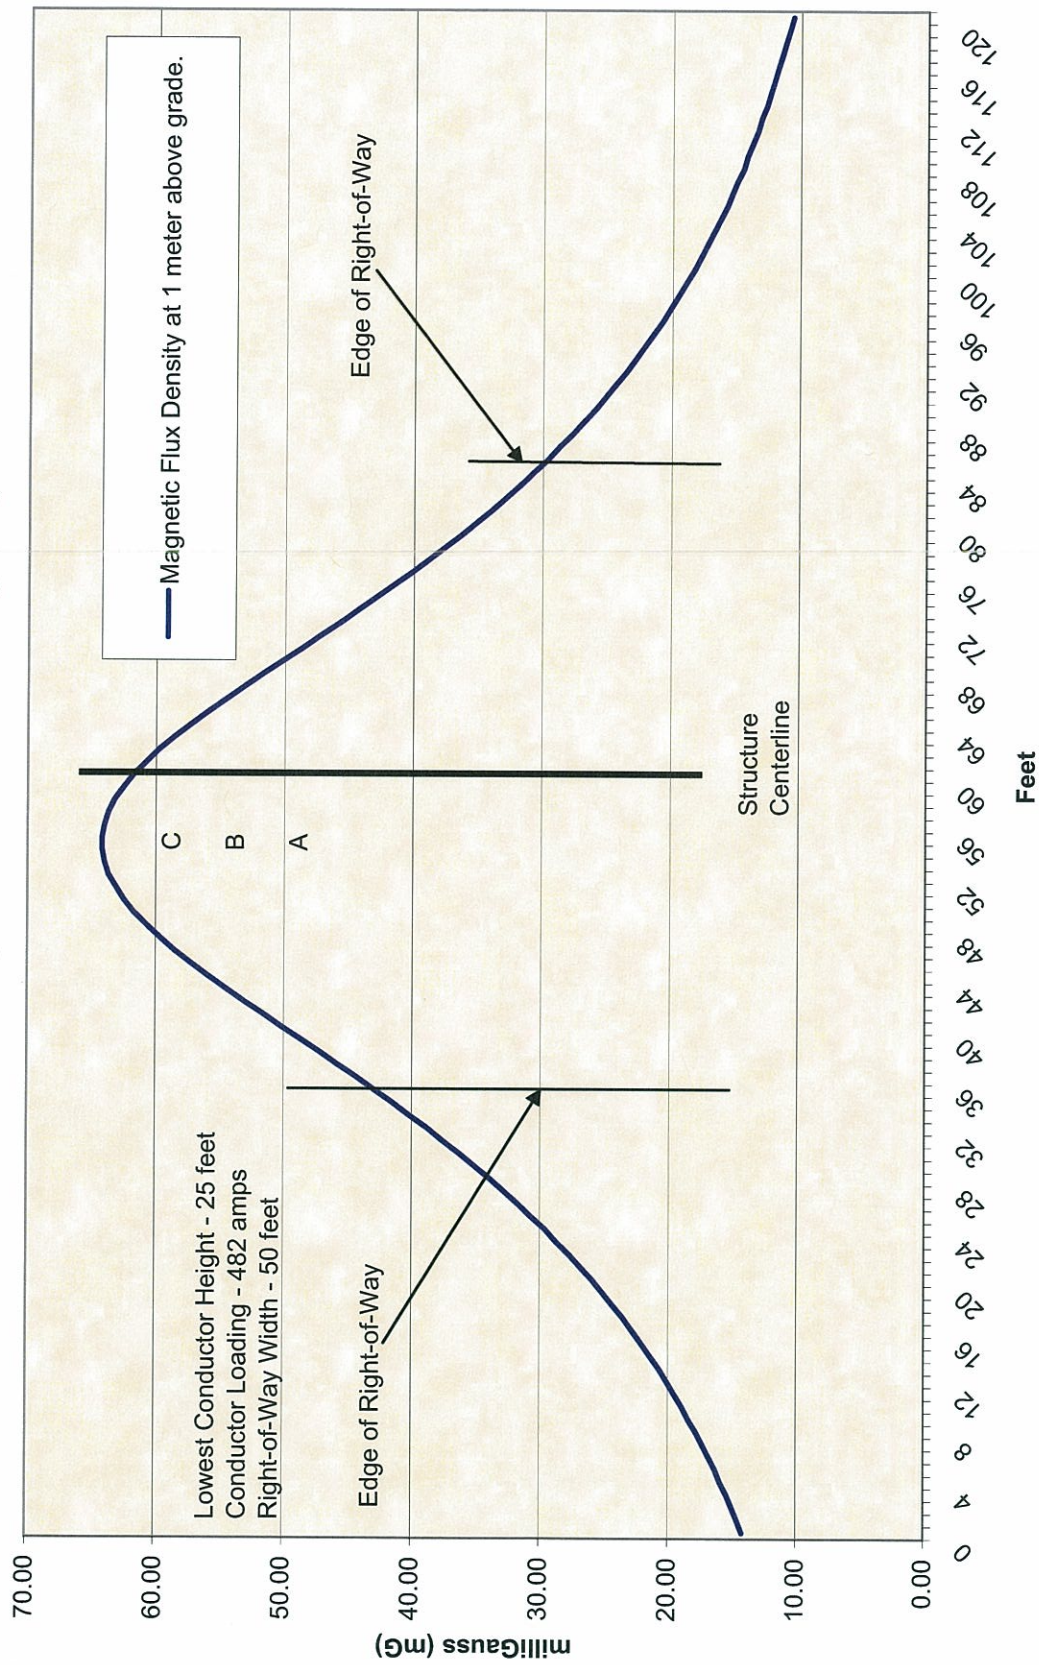

Projected Magnetic Flux Density
Proposed 115 kV Transmission Line
Firstlight Waterbury Combustion Turbine Peaking Facility

