



July 25, 2022

VIA ELECTRONIC AND FEDERAL EXPRESS

Melanie A. Bachman, Executive Director  
Connecticut Siting Council  
10 Franklin Square  
New Britain, CT 06051

Re: New Cingular Wireless PCS, LLC (“AT&T”)  
Notice of Exempt Modification  
Emergency Back-up Generator  
4 Hoffman Road, Canton, CT 06019  
Lat.: 41.85527000; Long.: - 72.89249890

Dear Ms. Bachman:

This letter and enclosures are respectfully submitted on behalf of New Cingular Wireless PCS, LLC (“AT&T”). AT&T currently maintains its wireless telecommunications facility on the existing tower located at 4 Hoffman Road in the Town of Canton, Connecticut. The underlying property is owned by James H. Hart and Katherine E. Hart and the tower structure is owned by SBA. AT&T submits this letter and enclosures to the Connecticut Siting Council (“Council”) to notify the Council of AT&T’s intent to perform modifications to the existing facility that do not have substantial adverse environmental effects and thus do not require a certificate pursuant to Section 16-50k of the Connecticut General Statutes.

AT&T intends to install one (1) new Generac 30kW Diesel Generator within the existing grade-level fenced equipment compound as demonstrated on the plans enclosed as Attachment 1. AT&T’s existing facility supports its FirstNet program which provides first responders with priority access to AT&T’s network to ensure adequate communication capabilities in the event of emergency. AT&T’s proposed generator will ensure that critical communication capability for first responders and the public are not lost in the event of a loss of power.

AT&T’s proposed generator will also advance the State’s goal of natural disaster and emergency preparedness. As discussed in the Council’s Docket 432 Findings and Report and Docket 440 proceedings and Findings of Fact (Nos. 76- 77), in response to two significant storm events in 2011, the State formed a Two Storm Panel (the “Panel”) that evaluated Connecticut’s approach to planning and mitigation of impacts associated with emergencies and natural disasters. The Panel found that “wireless telecommunications service providers were not prepared to serve residential and business customers during a power outage” because certain companies had limited backup generator capacity.

The Panel also noted that “[t]he failure of a large portion of Connecticut’s telecommunications system during the two storms is a life safety issue.” The Panel recommended that State regulatory bodies review “telecommunications services currently in place to verify that the vendors have sufficient generator and backhaul capacity to meet the emergency needs of consumers and businesses” and that the “Connecticut Siting Council should require continuity of service plans for any cellular tower to be erected.” The planned modifications will ensure continuity of services by reinforcing AT&T’s backup power and backhaul capacity to meet the emergency needs of first responders, consumers, and businesses in the event of a power outage.

The planned modifications to the facility fall squarely within the activities explicitly provided for in R.C.S.A. § 16-50j-72(b)(2) as the planned modifications:

- Will not result in an increase in the height of the existing structure;
- Will not require the extension of the site boundary;
- Will not increase noise levels at the facility by more than six decibels or more, or to levels that exceed state or local criteria since emergency backup generators are exempt from noise regulations as “noise created as a result of, or relating to, an emergency”;
- Will not increase radio frequency emission at the facility to a level at or above the Federal Communications Commission safety standards;
- Will not cause a change or alteration in the physical or environmental characteristics of the site; and
- Will not impair the structural integrity of the facility.

This modification complies with the aforementioned approval. AT&T’s proposed modification will maintain compliance with any relevant conditions these original approvals and any other subsequent approvals. The proposed modifications will have no impact on the existing tower structure itself or the radiofrequency emissions as the proposed modifications only consist of the addition of one new generator within the grade-level equipment compound. Thus, AT&T respectfully requests a waiver from submission of information relating to the existing tower structure or the radio-frequency emissions.



Please accept this letter as notification pursuant to R.C.S.A. § 16-50j-73 for construction that constitutes an exempt modification pursuant to R.C.S.A. § 16-50j-73. In accordance with R.C.S.A. § 16-50j-73, a copy of this letter and enclosure are being sent to the Town of Canton First Selectman Robert Bessel and the Town of Canton Planning Department as well as the property owner and structure owner identified above. Certification of Service is enclosed as Attachment 3.

For the foregoing reasons, AT&T respectfully submits that the proposed modification to the above referenced wireless telecommunications facility constitutes an exempt modification under R.C.S.A. § 16-50j-72(b)(2).

Very truly yours,

*Steven Volkert*

Steven J. Volkert Site Acquisition Specialist

General Dynamics Wireless Services

2586 Industry Lane, Ste. 100

Norristown, Pa 19403

(318) 642-6190 phone

[steven.volpert@gdit.com](mailto:steven.volpert@gdit.com)

**GENERAL DYNAMICS**  
Information Technology

CC: J Robert Bessel, Town of Canton First Selectman

James H. Hart and Katherine E. Hart, Property owner

Town of Canton Planning Department

# ATTACHMENT 1



# at&t Mobility

**SITE NAME: CANTON**  
**FA LOCATION CODE: 10034984**  
**ATC ID: CT-302488**









## GENERATOR PROJECT 30KW GENERAC DIESEL GENERATOR 200A GENERAC ATS

**4 HOFFMANN ROAD  
CANTON, CT 06019**

**CONSULTANT:  
GENERAL DYNAMICS**

Information Technology, Inc.  
GENERAL DYNAMICS  
101 STATION DR  
WESTWOOD, MA 02090

Certification & Seal:  
I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly licensed Professional Engineer under the laws of the State of Connecticut.

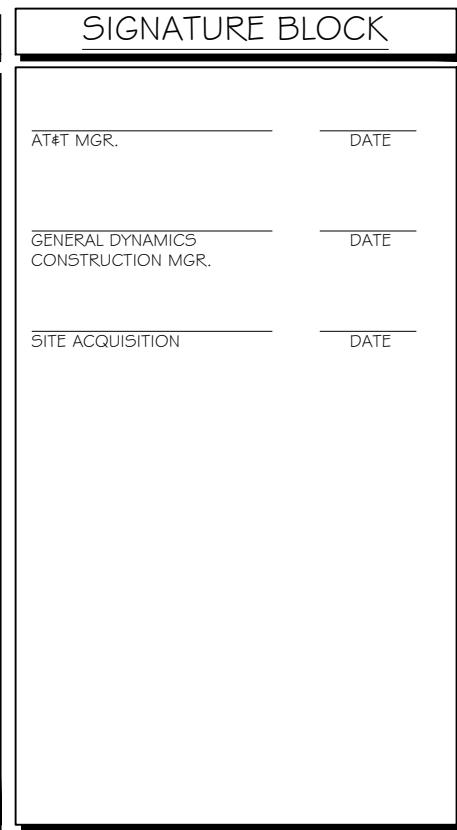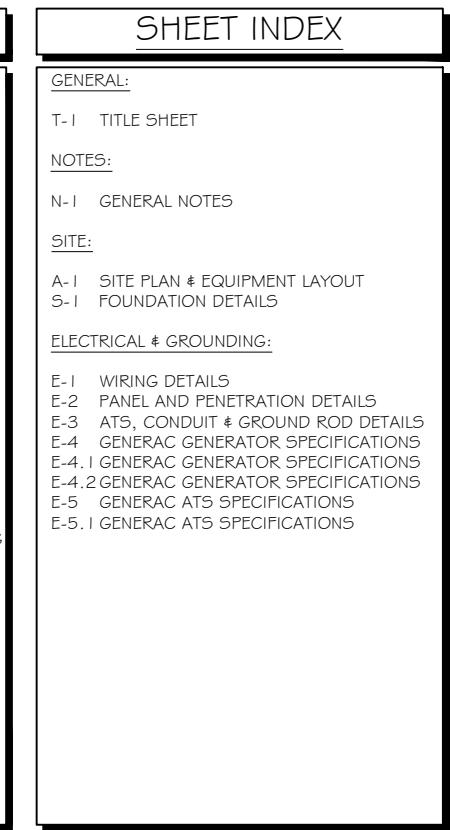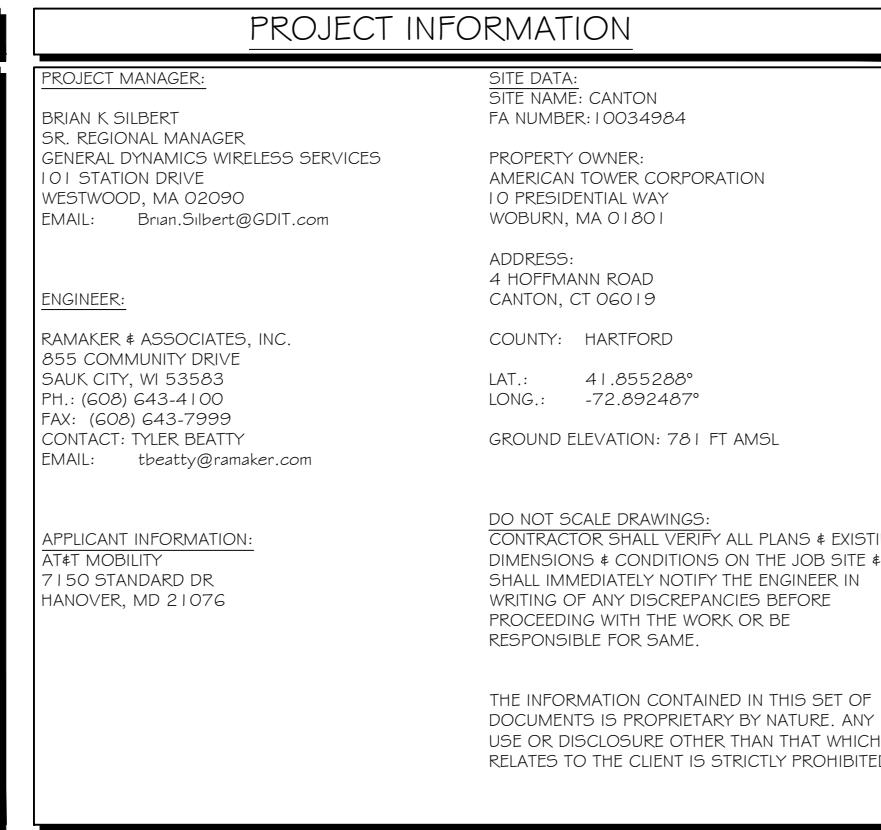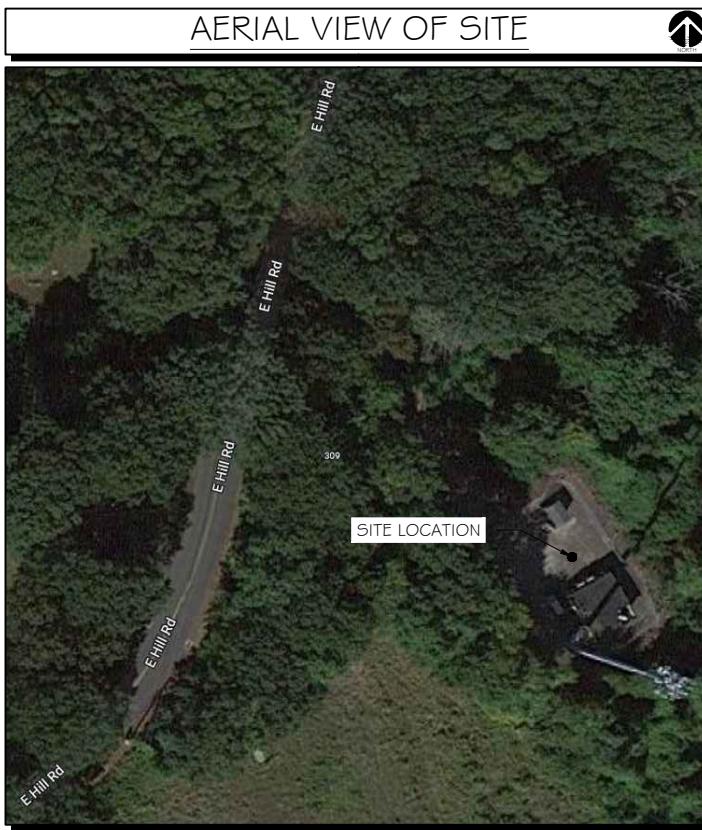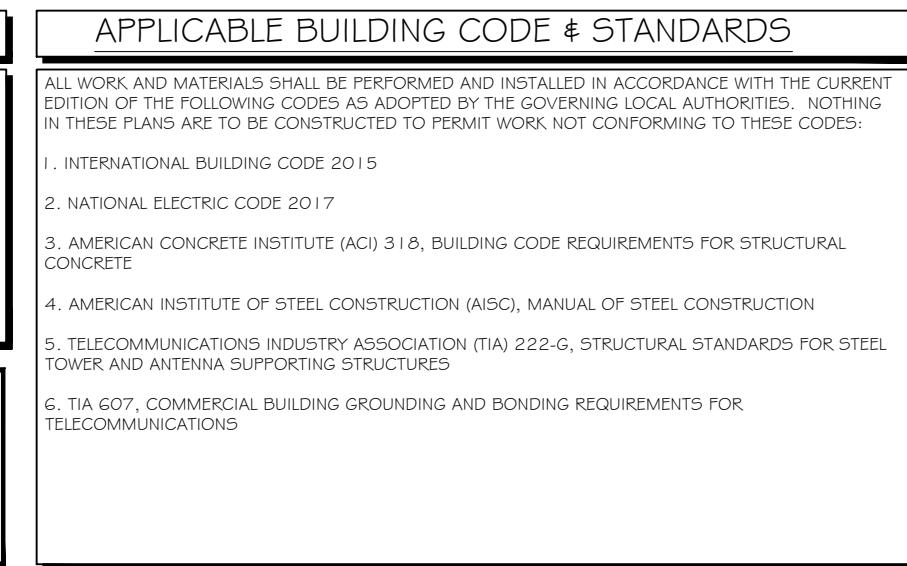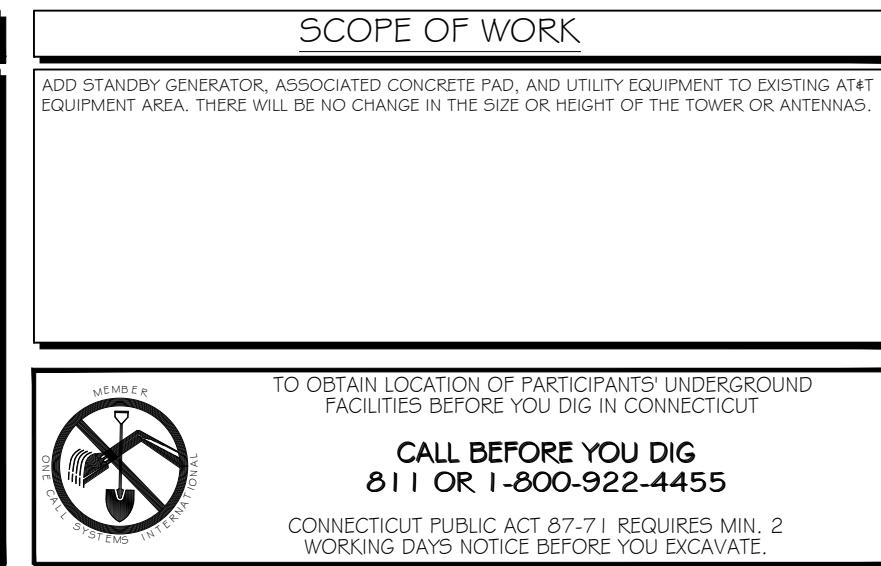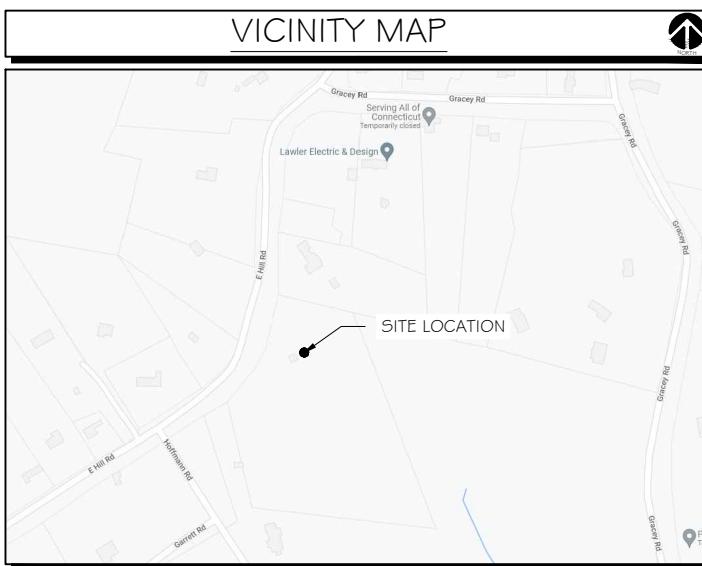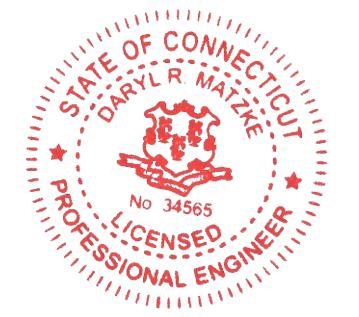

## NOTES TO SUBCONTRACTOR:

1. THE GENERAL SUBCONTRACTOR MUST VERIFY ALL DIMENSIONS, CONDITIONS AND ELEVATIONS BEFORE PROCEEDING WITH THE WORK. ALL WORK SHALL BE PERFORMED IN A WORKMANLIKE MANNER IN ACCORDANCE WITH ACCEPTED CONSTRUCTION PRACTICES.
2. IT IS THE INTENTION OF THESE DRAWINGS TO SHOW THE COMPLETED INSTALLATION. THE SUBCONTRACTOR SHALL BE RESPONSIBLE FOR ALL TEMPORARY BRACING, SHORING, TIES, FORM WORK, ETC. IN ACCORDANCE WITH ALL NATIONAL, STATE, AND LOCAL ORDINANCES, TO SAFELY EXECUTE ALL WORK AND SHALL BE RESPONSIBLE FOR SAME. ALL WORK SHALL BE IN ACCORDANCE WITH LOCAL CODES.
3. THE SUBCONTRACTOR SHALL USE ADEQUATE NUMBER OF SKILLED WORKMAN WHO ARE THOROUGHLY TRAINED AND EXPERIENCED IN THE NECESSARY CRAFTS AND WHO ARE COMPLETELY FAMILIAR WITH THE SPECIFIED REQUIREMENTS AND METHOD NEEDED FOR PROPER PERFORMANCE OF THE WORK.
4. CONSTRUCTION SUBCONTRACTOR AGREES THAT IN ACCORDANCE WITH GENERALLY ACCEPTED CONSTRUCTION PRACTICES, CONSTRUCTION SUBCONTRACTOR WILL BE REQUIRED TO ASSUME SOLE AND COMPLETE RESPONSIBILITY FOR JOB SITE CONDITIONS DURING THE COURSE OF CONSTRUCTION OF THE PROJECT, INCLUDING THE SAFETY OF ALL PERSONS AND PROPERTY, THAT THIS REQUIREMENT SHALL BE MADE TO APPLY CONTINUOUSLY AND NOT BE LIMITED TO NORMAL WORKING HOURS AND CONSTRUCTION SUBCONTRACTOR FURTHER AGREES TO INDEMNIFY AND HOLD DESIGN ENGINEER HARMLESS FROM ANY AND ALL LIABILITY, REAL OR ALLEGED, IN CONNECTION WITH PERFORMANCE OF WORK ON THIS PROJECT.
5. SITE GROUNDING SHALL COMPLY WITH AT&T WIRELESS SERVICES TECHNICAL SPECIFICATIONS FOR FACILITY GROUNDING FOR CELL SITE STANDARDS, LATEST EDITION, AND COMPLY WITH AT&T TOWERS GROUNDING CHECKLIST, LATEST VERSION. WHEN NATIONAL AND LOCAL GROUNDING CODES ARE MORE STRINGENT THEY SHALL GOVERN. GROUNDING SHALL BE COMPLETED BEFORE ERECTION OF TOWER.
6. ALL WORK SHALL COMPLY WITH OSHA AND STATE SAFETY REQUIREMENTS. PROCEDURES FOR THE PROTECTION OF EXCAVATIONS, EXISTING CONSTRUCTION AND UTILITIES SHALL BE ESTABLISHED PRIOR TO FOUNDATION INSTALLATION, IF TEMPORARY LIGHTING AND MARKING IS REQUIRED BY THE FEDERAL AVIATION ADMINISTRATION (FAA), IT IS THE SUBCONTRACTOR'S RESPONSIBILITY TO MAINTAIN THE NECESSARY LIGHTS AND NOTIFY THE PROPER AUTHORITIES IN THE EVENT OF A PROBLEM.
7. ALL WORK SHALL BE ACCOMPLISHED IN ACCORDANCE WITH ALL LOCAL, STATE, AND FEDERAL CODES OR ORDINANCES. THE MOST STRINGENT CODE WILL APPLY IN THE CASE OF DISCREPANCIES OR DIFFERENCES IN THE CODE REQUIREMENTS.
8. ANY DAMAGE TO THE ADJACENT PROPERTIES WILL BE CORRECTED AT THE SUBCONTRACTOR'S EXPENSE TO THE SATISFACTION OF THE LANDOWNER AND THE ENGINEER.
9. THE COMPLETE BID PACKAGE INCLUDES THESE CONSTRUCTION DRAWINGS ALONG WITH THE SPECIFICATIONS. SUBCONTRACTOR IS RESPONSIBLE FOR REVIEW OF TOTAL BID PACKAGE PRIOR TO BID SUBMITTAL..
10. SUBCONTRACTOR SHALL VERIFY LOCATION OF ALL EXISTING UTILITIES WITHIN CONSTRUCTION LIMITS PRIOR TO CONSTRUCTION.
11. THE SUBCONTRACTOR IS RESPONSIBLE FOR MAINTAINING POSITIVE DRAINAGE ON THE SITE AT ALL TIMES. SILT AND EROSION CONTROL SHALL BE MAINTAINED ON THE DOWNSTREAM SIDE OF THE SITE AT ALL TIMES. ANY DAMAGE TO ADJACENT PROPERTIES WILL BE CORRECTED AT THE SUBCONTRACTOR'S EXPENSE.
12. CLEARING OF TREES AND VEGETATION ON THE SITE SHOULD BE HELD TO A MINIMUM. ONLY THE TREES NECESSARY FOR CONSTRUCTION OF THE FACILITIES SHALL BE REMOVED. ANY DAMAGE TO THE PROPERTY OUTSIDE THE LEASED PROPERTY SHALL BE REPAIRED BY THE SUBCONTRACTOR.
13. ALL SUITABLE BORROW MATERIAL FOR BACK FILL OF THE SITE SHALL BE INCLUDED IN THE BID. EXCESS TOPSOIL AND UNSUITABLE MATERIAL SHALL BE DISPOSED OF OFF SITE AT LOCATIONS APPROVED BY GOVERNING AGENCIES PRIOR TO DISPOSAL.
14. SEEDING AND MULCHING OF THE SITE WILL BE ACCOMPLISHED AS SOON AS POSSIBLE AFTER COMPLETION OF THE SITE DEVELOPMENT. THE SUBCONTRACTOR IS RESPONSIBLE FOR PROVIDING AND MAINTAIN AN ADEQUATE COVER OF VEGETATION OVER THE SITE FOR A ONE YEAR PERIOD.
15. PERMITS: THE SUBCONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING AND INCURRING THE COST OF ALL REQUIRED PERMITS, INSPECTIONS, CERTIFICATES, ETC.
16. RECORD DRAWINGS: MAINTAIN A RECORD OF ALL CHANGES, SUBSTITUTIONS BETWEEN WORK AS SPECIFIED AND INSTALLED. RECORD CHANGES ON A CLEAN SET OF CONTRACT DRAWINGS WHICH SHALL BE TURNED OVER TO THE CONSTRUCTION MANAGER UPON COMPLETION OF THE PROJECT.
17. THE PLANS SHOW SOME KNOWN SUBSURFACE STRUCTURES, ABOVE GROUND STRUCTURES AND/OR EXISTING UTILITIES BELIEVED TO BE IN THE WORKING AREA. IT IS THE RESPONSIBILITY OF THE SUBCONTRACTOR TO VERIFY ALL UTILITIES, PIPELINES AND OTHER STRUCTURES SHOWN OR NOT SHOWN ON THESE PLANS. THE SUBCONTRACTOR SHALL CONTACT THE LOCAL JURISDICTION'S DIGGER'S HOTLINE BEFORE DIGGING OR DRILLING. ANY DAMAGE TO EXISTING UTILITIES SHALL BE REPAIRED TO THE SATISFACTION OF THE OWNER AND ENGINEER AT THE SUBCONTRACTOR'S EXPENSE.

## GENERAL NOTES:

1. THIS PROPOSAL IS FOR THE ADDITION OF A NEW GENERATOR ON A CONCRETE PAD TO AN EXISTING UNMANNED TELECOMMUNICATIONS FACILITY CONSISTING OF AN EQUIPMENT SHELTER AND TOWER.
2. THE PROPOSED FACILITY WILL BE UNMANNED AND DOES NOT REQUIRE POTABLE WATER OR SEWER SERVICE.
3. THE PROPOSED FACILITY IS UNMANNED AND IS NOT FOR HUMAN HABITAT. (NO HANDICAP

## ACCESS IS REQUIRED)

4. OCCUPANCY IS LIMITED TO PERIODIC MAINTENANCE AND INSPECTION, APPROXIMATELY 2 TIMES PER MONTH BY AT&T TECHNICIANS.
5. OUTDOOR STORAGE AND SOLID WASTE CONTAINERS ARE NOT PROPOSED.
6. ALL MATERIAL SHALL BE FURNISHED AND WORK SHALL BE PERFORMED IN ACCORDANCE WITH THE PROJECT SPECIFICATIONS.
7. SUBCONTRACTOR SHALL BE RESPONSIBLE FOR REPAIRING ANY DAMAGE CAUSED BY THE CONSTRUCTION OPERATION.
8. SUBCONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL PERMITS AND INSPECTION REQUIRED FOR CONSTRUCTION.
9. SUBCONTRACTOR SHALL REMOVE ALL TRASH AND DEBRIS FROM THE SITE ON A DAILY BASIS.

## ELECTRICAL NOTES:

## A. GENERAL

1. COORDINATE LOCATION AND POWER REQUIREMENTS OF ALL EQUIPMENT WITH AT&T AND EQUIPMENT SUPPLIER PRIOR TO INSTALLATION.
2. COORDINATE LOCATION AND REQUIREMENTS FOR ELECTRICAL AND TELEPHONE SERVICES WITH THE PROPERTY REPRESENTATIVE, AT&T AND UTILITY COMPANIES. ROUTING OF CONDUITS MAY BE MODIFIED TO MEET SITE REQUIREMENTS. EXACT CONDUIT ROUTING TO BE DETERMINED IN THE FIELD.
3. ALL WIRING AND EQUIPMENT SHOWN ON ELECTRICAL SHEETS SHALL BE FURNISHED AND INSTALLED UNDER ELECTRICAL PORTION OF CONTRACT UNLESS OTHERWISE NOTED

4. UNINTERRUPTED ELECTRICAL SERVICE FOR EXISTING EQUIPMENT SHALL BE MAINTAINED DURING THE INSTALLATION OF THE WORK DESCRIBED UNDER THESE DOCUMENTS. TEMPORARY EQUIPMENT, CABLES AND WHATEVER ELSE IS NECESSARY SHALL BE PROVIDED AS REQUIRED TO MAINTAIN ELECTRICAL SERVICE. TEMPORARY SERVICE FACILITIES, IF REQUIRED AT ANY TIME, SHALL NOT BE DISCONNECTED OR REMOVED UNTIL NEW SERVICE EQUIPMENT IS IN PROPER OPERATION. IF ANY SERVICE OR SYSTEM MUST BE INTERRUPTED, THE CONTRACTOR SHALL REQUEST PERMISSION IN WRITING STATING THE DATE, TIME, ETC. THE SERVICE WILL BE INTERRUPTED AND THE AREAS AFFECTED. THIS REQUEST SHALL BE MADE IN SUFFICIENT TIME FOR PROPER ARRANGEMENTS TO BE MADE. WRITTEN PERMISSION SHALL BE OBTAINED FROM THE OWNER BEFORE INTERRUPTING ELECTRICAL SERVICE.

5. COORDINATE NEW WORK WITH OTHER TRADES AND VERIFY EXISTING CONDITIONS TO AVOID INTERFERENCE. IN CASE OF INTERFERENCE, AT&T'S REPRESENTATIVE WILL DECIDE WHICH WORK IS TO BE RELOCATED, REGARDLESS OF WHICH WAS FIRST INSTALLED.
6. THE INSTALLATION MUST COMPLY WITH NEC AND ALL FEDERAL, STATE AND LOCAL RULES AND REGULATIONS.
7. THE DRAWINGS ARE DIAGRAMMATIC AND INDICATE THE GENERAL ARRANGEMENT OF SYSTEMS AND EQUIPMENT UNLESS OTHERWISE DEFINED BY DIMENSIONS OR DETAILS. EXACT EQUIPMENT LOCATIONS AND RACEWAY ROUTING SHALL BE GOVERNED BY ACTUAL FIELD CONDITIONS AND/OR DIRECTIONS FROM AT&T'S REPRESENTATIVE.
8. CONTRACTOR SHALL PAY ALL PERMITS AND FEES REQUIRED.

9. ALL MATERIALS SHALL BE FURNISHED AND WORK SHALL BE PERFORMED IN ACCORDANCE WITH THE APPLICABLE SECTIONS OF THE STANDARDS REFERENCED BELOW:
  - a. ANSI (AMERICAN NATIONAL STANDARDS INSTITUTE)
  - b. ASTM (AMERICAN SOCIETY FOR TESTING MATERIALS)
  - c. ETL (ELECTRICAL TESTING LABORATORY)
  - d. IEC (INSULATED CABLE ENGINEERS ASSOCIATION)
  - e. IEEE (INSTITUTE OF ELECTRICAL AND ELECTRONIC ENGINEERS)
  - f. MFBU (NATIONAL BOARD OF FIRE UNDERWRITERS)
  - g. NESC (NATIONAL ELECTRICAL SAFETY CODE)
  - h. NEMA (NATIONAL ELECTRICAL MANUFACTURER'S ASSOCIATION)
  - i. NFPA (NATIONAL FIRE PROTECTION ASSOCIATION)
  - j. UL (UNDERWRITER'S LABORATORY)

10. CONTRACTOR SHALL REVIEW PLANS, DETAILS AND SPECIFICATIONS IN DETAIL AND ADJUST WORK TO CONFORM WITH ACTUAL SITE CONDITIONS SO THAT ELECTRICAL DEVICES AND EQUIPMENT WILL BE LOCATED AND READILY ACCESSIBLE. QUANTITIES LISTED IN MATERIAL LISTS ON THE DRAWINGS ARE FOR INFORMATION ONLY. THE CONTRACTOR SHALL PROVIDE HIS OWN TAKEOFF FOR MATERIAL QUANTITY AND TYPES BASED ON ACTUAL SITE CONDITIONS, IN ADDITION, CONTRACTOR SHALL PROVIDE ALL NECESSARY MATERIALS TO INSTALL EQUIPMENT FURNISHED BY AT&T OR ITS SUPPLIERS. ALL ITEMS NOT SPECIFICALLY MENTIONED HEREIN OR SHOWN ON THE DRAWINGS, BUT WHICH ARE OBVIOUSLY NECESSARY TO MAKE A COMPLETE WORKING INSTALLATION, SHALL BE INCLUDED.

11. THE CONTRACTOR OR BIDDER SHALL BEAR THE RESPONSIBILITY OF NOTIFYING (IN WRITING) AT&T'S REPRESENTATIVE OF ANY CONFLICTS PRIOR TO THE SUBMISSION OF CONTRACTOR'S PROPOSAL OR PERFORMANCE OF WORK. IN THE EVENT OF DISCREPANCIES THE CONTRACTOR SHALL PRICE THE MORE COSTLY OR EXTENSIVE WORK, UNLESS DIRECTED IN WRITING OTHERWISE.

12. ALL FLOORS WHERE PENETRATIONS ARE REQUIRED IN BUILDING ARE TO BE CORE DRILLED AND THEN FIREPROOFED.

## B. WIRING/CONDUIT

1. PROVIDE PULL BOXES AND JUNCTION BOXES WHERE SHOWN OR AS REQUIRED BY CODE SUCH THAT NO MORE THAN THE EQUIVALENT OF FOUR QUARTER BENDS (360 DEGREES TOTAL) EXIST IN A CONDUIT RUN.
2. ALL POWER AND CONTROL/INDICATION WIRING SHALL BE TYPE THHN/THWN 800V RATED 75 DEGREES CELSIUS, UNLESS NOTED OTHERWISE.

3. SCHEDULE 80 PVC CONDUIT SHALL BE USED ABOVE GROUND, WHERE ABOVE GRADE IS DEFINED AS THE GROUND OF THE TURN-UP

4. BELL END OR TERMINAL ADAPTER MUST BE INSTALLED ON END OF PVC CONDUIT PER NEC 352.46. 300.4 F, (3)

5. CONDUIT BENDS SHALL BE MADE IN ACCORDANCE WITH NEC TABLE 346-10. NO RIGHT ANGLE DEVICE OTHER THAN STANDARD CONDUIT ELBOWS WITH 12" MINIMUM INSIDE SWEEPS FOR ALL CONDUITS 2" OR LARGER.

6. POWER WIRING SIZE SHALL NOT BE SMALLER THAN #12 AWG.

7. ALL WIRING SHALL BE COPPER. ALUMINUM WILL NOT BE ACCEPTABLE ALL POWER CIRCUITS SHALL CONTAIN A GROUND WIRE.

8. PHASE MARKINGS TO BE USED AT POWER CONDUCTOR TERMINATIONS.

9. CONTRACTOR SHALL ENSURE INTEGRITY IS MAINTAINED WHEN INSTALLING CONDUIT AND WIRING.

10. INSTALL PULL STRING IN ALL CONDUIT.

11. FOR ROOFTOP INSTALLS AND BUILD-OUTS, CONDUITS INSIDE BUILDING AND ON ROOF SHALL BE RG5, UNLESS OTHERWISE NOTED. FOR RAW LAND SITES AND CO-LOCATES, PVC SCHEDULE 80 SHALL BE UTILIZED UNLESS NOTED OTHERWISE.

12. MAINTAIN MINIMUM 1'-0" VERTICAL AND 1'-0" HORIZONTAL SEPARATIONS FROM ANY MECHANICAL GAS PIPING.

13. ALL WIRING ROUTED IN PLUMIN TO BE RATED OR IN METALLIC FLEX (LIQUIDITE) CONDUIT.

## C. EQUIPMENT

1. EQUIPMENT/PARTS CONNECTED TO EXISTING PANELS, DUCTS, ETC. SHALL MATCH THE CHARACTERISTICS (A/C, V, A) OF THAT EQUIPMENT.

2. ALL ELECTRICAL EQUIPMENT OUTSIDE SHALL BE NEMA OR 3R RATED.

## D. GROUNDING

1. ALL GROUND CONNECTIONS TO BUILDING SHALL BE MADE USING TWO-HOLE CONNECTORS. PROVIDE STAINLESS STEEL BOLTS AND LOCK WASHERS ON ALL MECHANICAL GROUND CONNECTIONS.

2. ALL EQUIPMENT SURFACES TO BE BONDED TO GROUNDING SYSTEM SHALL BE STRIPPED OF ALL PAINT AND DIRT. CONNECTIONS TO VARIOUS METALS SHALL BE OF A TYPE AS TO CAUSE A GALVANIC OR CORROSIVE REACTION. AREA SHALL BE REPAINTED FOLLOWING BONDING.

3. ANY METALLIC ITEM WITHIN 6' OF GROUND CONDUCTORS MUST BE CONNECTED TO THE GROUNDING SYSTEM.

4. EXTERIOR, ABOVE GRADE GROUND CONNECTIONS SHALL BE FURNISHED WITH A LIBERAL PROTECTIVE COATING OF ANTI-OXIDE COMPOUND.

5. ALL MATERIALS AND LABOR REQUIRED FOR THE GROUNDING SYSTEM AS INDICATED ON THE PLANS AND DETAILS, AND AS DESCRIBED HEREIN SHALL BE FURNISHED BY THIS CONTRACTOR UNLESS OTHERWISE NOTED.

6. EXACT LOCATION OF GROUND CONNECTION POINTS SHALL BE DETERMINED IN FIELD. ADJUST LOCATIONS INDICATED ON PLANS ACCORDING TO ACTUAL EQUIPMENT LOCATIONS TO KEEP THE GROUND CONNECTION CABLES AS SHORT AS PRACTICAL.

7. PROVIDE ALL ELECTRICAL SYSTEM AND EQUIPMENT GROUNDS AS REQUIRED BY THE CURRENT EDITION OF THE NATIONAL ELECTRIC CODE AND THE CURRENT EDITION OF THE NATIONAL ELECTRICAL SAFETY CODE. BONDING JUMPERS WITH APPROVED GROUND FITTINGS SHALL BE INSTALLED AT ALL RACEWAYS, EQUIPMENT ENCLOSURES, PULL BOXES, ETC. TO MAINTAIN GROUND CONTINUITY WHERE REQUIRED BY CODE.

8. ALL EQUIPMENT GROUND CONDUCTORS SHALL BE TIN COATED, #2 AWG COPPER UNLESS NOTED OTHERWISE ON THE DRAWINGS.

9. PROVIDE PRE AND POST GROUND TEST RESULTS, USING CLAMP-ON TESTER. TEST RESULTS SHALL BE PHOTOS WITH DIGITAL TIME AND GPS STAMPED/EMBEDDED.

## E. INSPECTION/DOCUMENTATION

1. THE CONTRACTOR, UPON COMPLETION OF HIS WORK, SHALL PROVIDE AS-BUILT DRAWINGS. INFORMATION SHOULD BE GIVEN TO THE GENERAL CONTRACTOR FOR INCLUSION IN FINAL AS-BUILT SURVEY DOCUMENTS TO BE GIVEN TO THE OWNER.

2. CONTRACTOR SHALL SUPPLY DOCUMENTATION ATTESTING TO THE COMPLETE GROUND SYSTEM'S RECEIPTIVITY (MAX. 5 OHMS).

3. AN ELECTRICAL INSPECTION SHALL BE MADE BY AND INSPECTING AGENCY APPROVED BY AT&T'S REPRESENTATIVE. CONTRACTOR SHALL COORDINATE ALL INSPECTIONS AND OBTAIN POWER COMPANY APPROVAL.

4. CONTRACTOR SHALL HAVE ATS AND GENERATOR RELAY INSTALLATION AND CONNECTIONS INSPECTED BY OTHERS TO ENSURE THAT UL LISTING FOR THAT EQUIPMENT IS NOT VOIDED.




**RAMAKER**  
employee-owned  
(608) 643-4100 www.ramaker.com

PREPARED FOR:  
  
at&t  
Mobility

CONSULTANT:  
**GENERAL DYNAMICS**  
Information Technology, Inc.  
GENERAL DYNAMICS  
101 STATION DR  
WESTWOOD, MA 02090

Certification & Seal:  
I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly licensed Professional Engineer under the laws of the State of Connecticut;

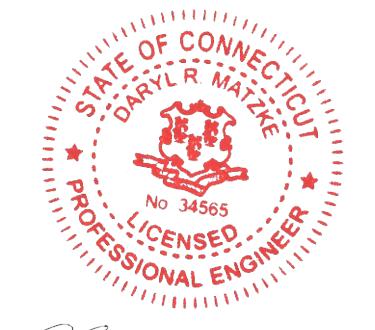

Signature:   
Date: 7/21/2022  
Issue Phase: FINAL  
Date Issued: 07/21/2022  
Project Title:

CANTON  
FA ID # 10034984

Project Information:  
4 HOFFMANN ROAD  
CANTON, CT 06019

Sheet Title:  
GENERAL NOTES

Scale: NONE

Project Number: 54176  
Sheet Number: N-1

SCOPE OF WORK DETAILS

**GENERAL:**


- REPLACE EXISTING WITH NEW GENERAC DIESEL GENERATOR PROVIDED BY GENERAL DYNAMICS & INSTALLED BY GENERAL CONTRACTOR, SEE E-4.
- NEW 4'-0" X 10'-0" CONCRETE PAD PROVIDED & INSTALLED BY GENERAL CONTRACTOR (AS REQUIRED) SEE S-1
- NEW GENERAC AUTOMATIC TRANSFER SWITCH PROVIDED BY GENERAL DYNAMICS & INSTALLED BY CONTRACTOR (AS REQUIRED) SEE E-3 & E-5.
- CONTRACTOR TO VERIFY ALL EXISTING UTILITIES PRIOR TO CONSTRUCTION
- CONTRACTOR SHALL RESTORE & REPAIR ANY DAMAGED AREAS CAUSED BY CONSTRUCTION TO ORIGINAL OR BETTER CONDITION

**CONDUITS:**

- INSTALL PULL STRING IN EACH CONDUIT
- (1) NEW 2" AND (1) NEW 1" ELECTRICAL CONDUITS WITH CONDUCTORS TO RUN FROM NEW GENERATOR TO NEW ATS. CONDUIT PROVIDED AND INSTALLED BY GENERAL CONTRACTOR. SEE E-1, E-2 & E-3.
- (1) NEW 1" ELECTRICAL CONDUIT WITH CONDUCTORS TO RUN FROM NEW GENERATOR TO AC PANEL. CONDUIT PROVIDED & INSTALLED BY GENERAL CONTRACTOR. SEE E-1, E-2 & E-3.
- (1) NEW 1" ALARM CONDUIT & CABLEING PROVIDED & INSTALLED BY GENERAL CONTRACTOR. SEE E-1, E-2 & E-3.

**GROUNDING:**

- NEW EXOTHERMIC CONNECTION FROM EXISTING GROUND RING TO NEW MECHANICAL CONNECTION AT GENERATOR CHASSIS. GENERAL CONTRACTOR TO VERIFY LOCATION IN FIELD. LOCATE GROUND RODS NO MORE THAN 8'-0" APART.

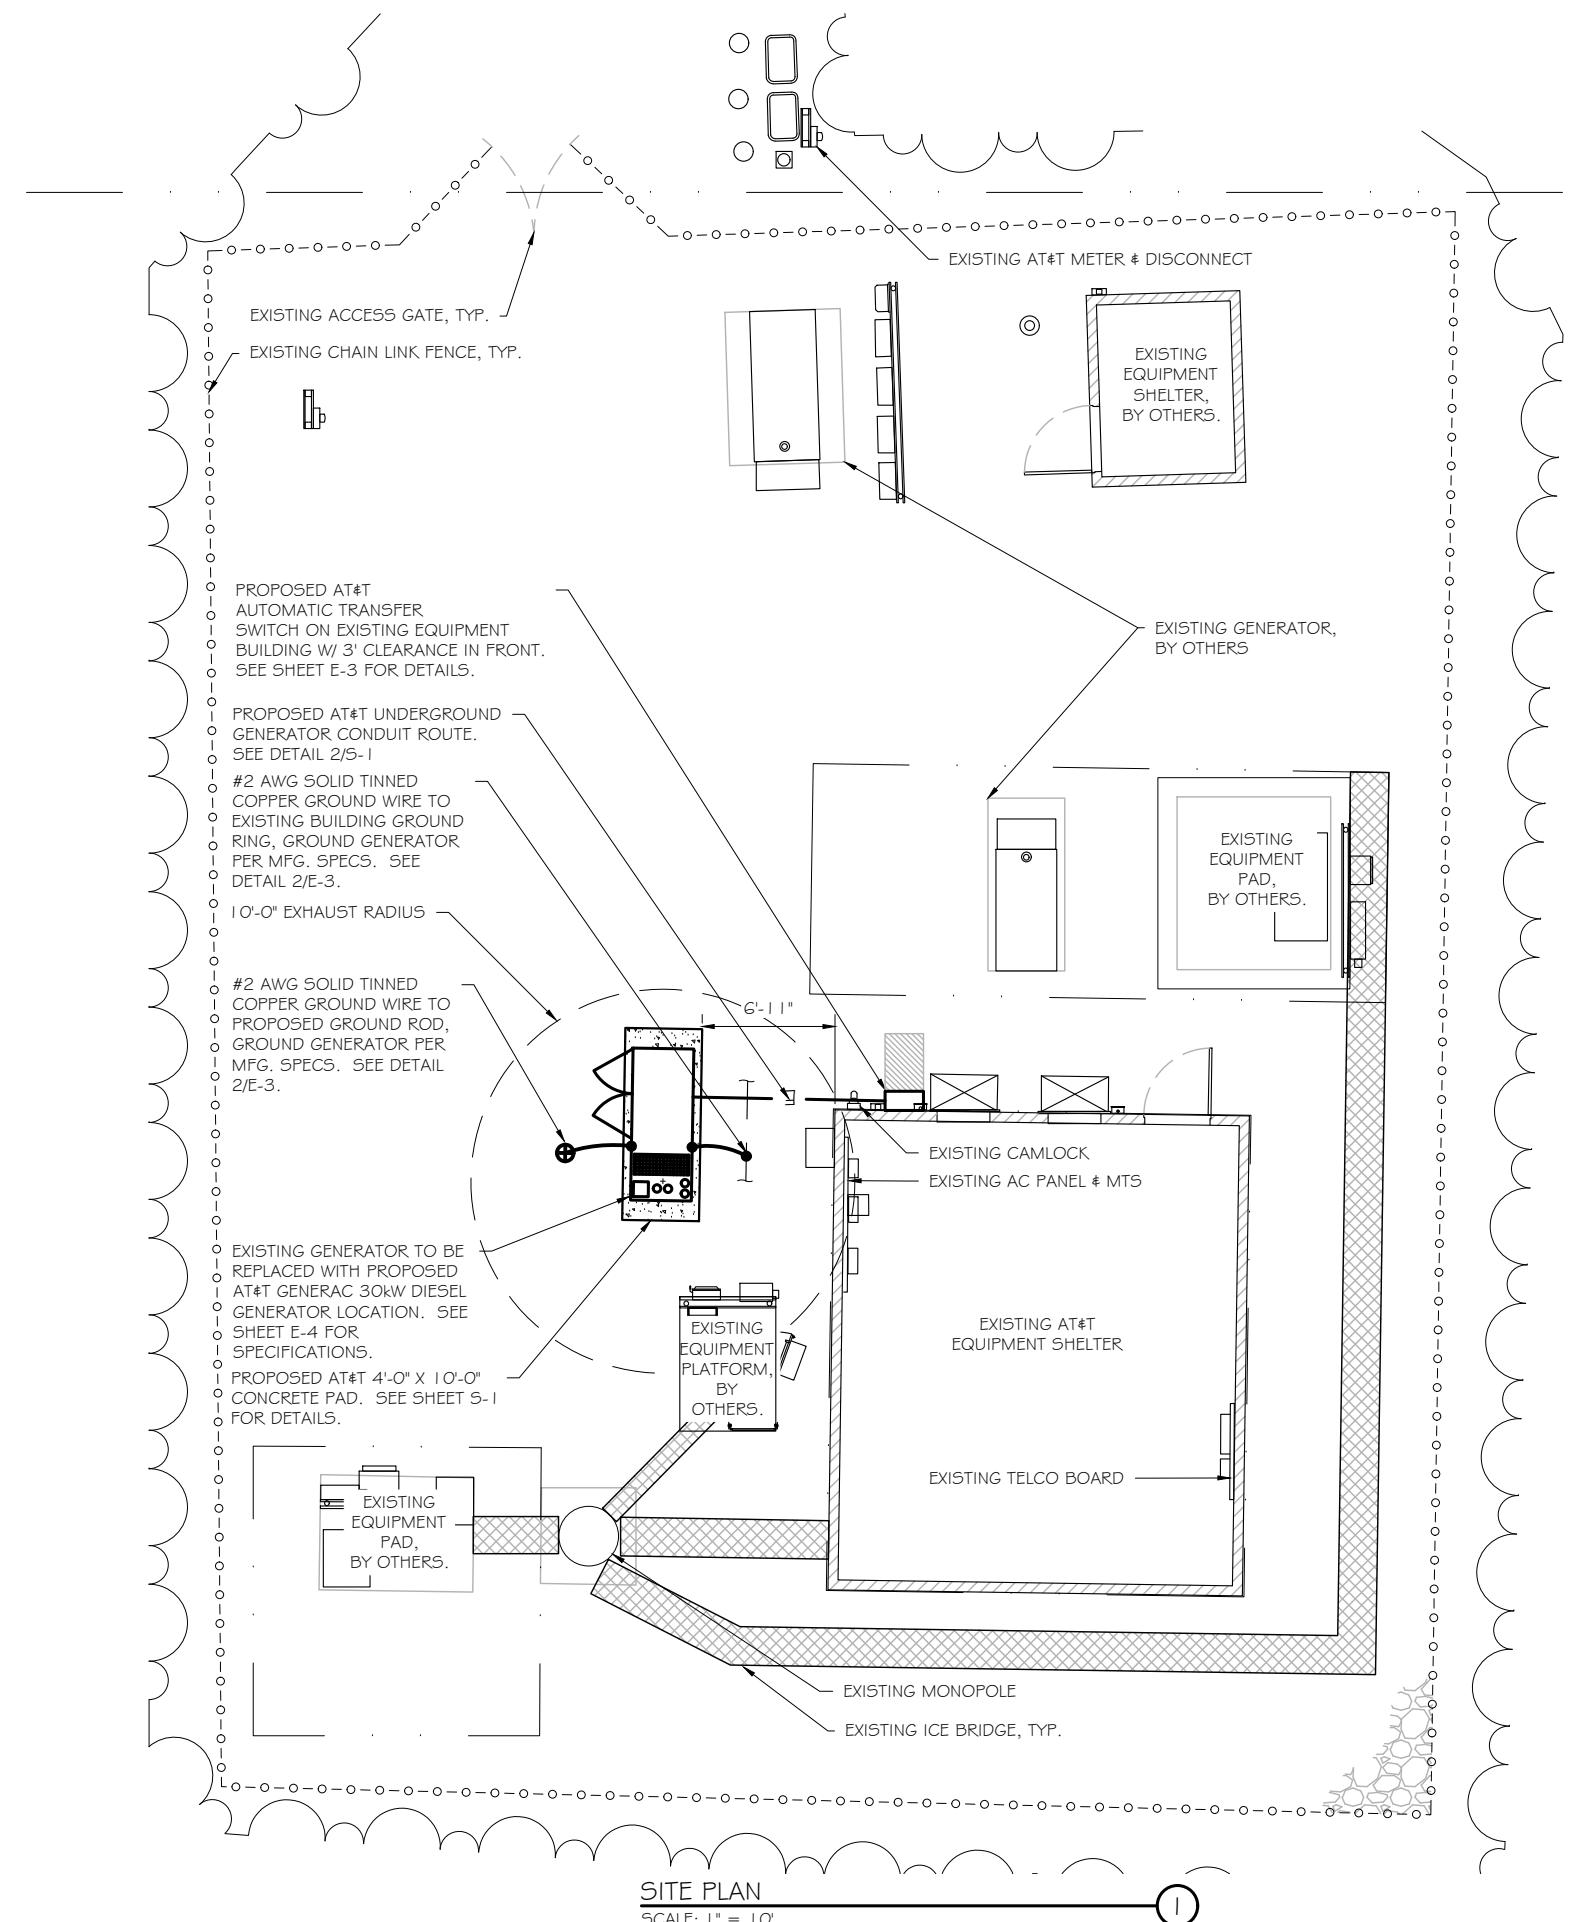

**RAMAKER**  
employee-owned  
(608) 643-4100 www.ramaker.com

PREPARED FOR:  
**at&t Mobility**

CONSULTANT:  
**GENERAL DYNAMICS**  
Information Technology, Inc.

GENERAL DYNAMICS  
101 STATION DR  
WESTWOOD, MA 02090

Certification & Seal:  
I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly licensed Professional Engineer under the laws of the State of Connecticut.



7/21/2022  
Signature: Date:


MARK DATE DESCRIPTION  
ISSUE PHASE FINAL DATE ISSUED 07/21/2022  
PROJECT TITLE:


CANTON  
FA ID # 10034984

PROJECT INFORMATION:  
4 HOFFMANN ROAD  
CANTON, CT 06019

SHEET TITLE:  
SITE PLAN & EQUIPMENT LAYOUT

0 5' 10' 20'  
11" x 17" - 1" = 10'  
22" x 34" - 1" = 5'  
PROJECT NUMBER 54176  
SHEET NUMBER A-1

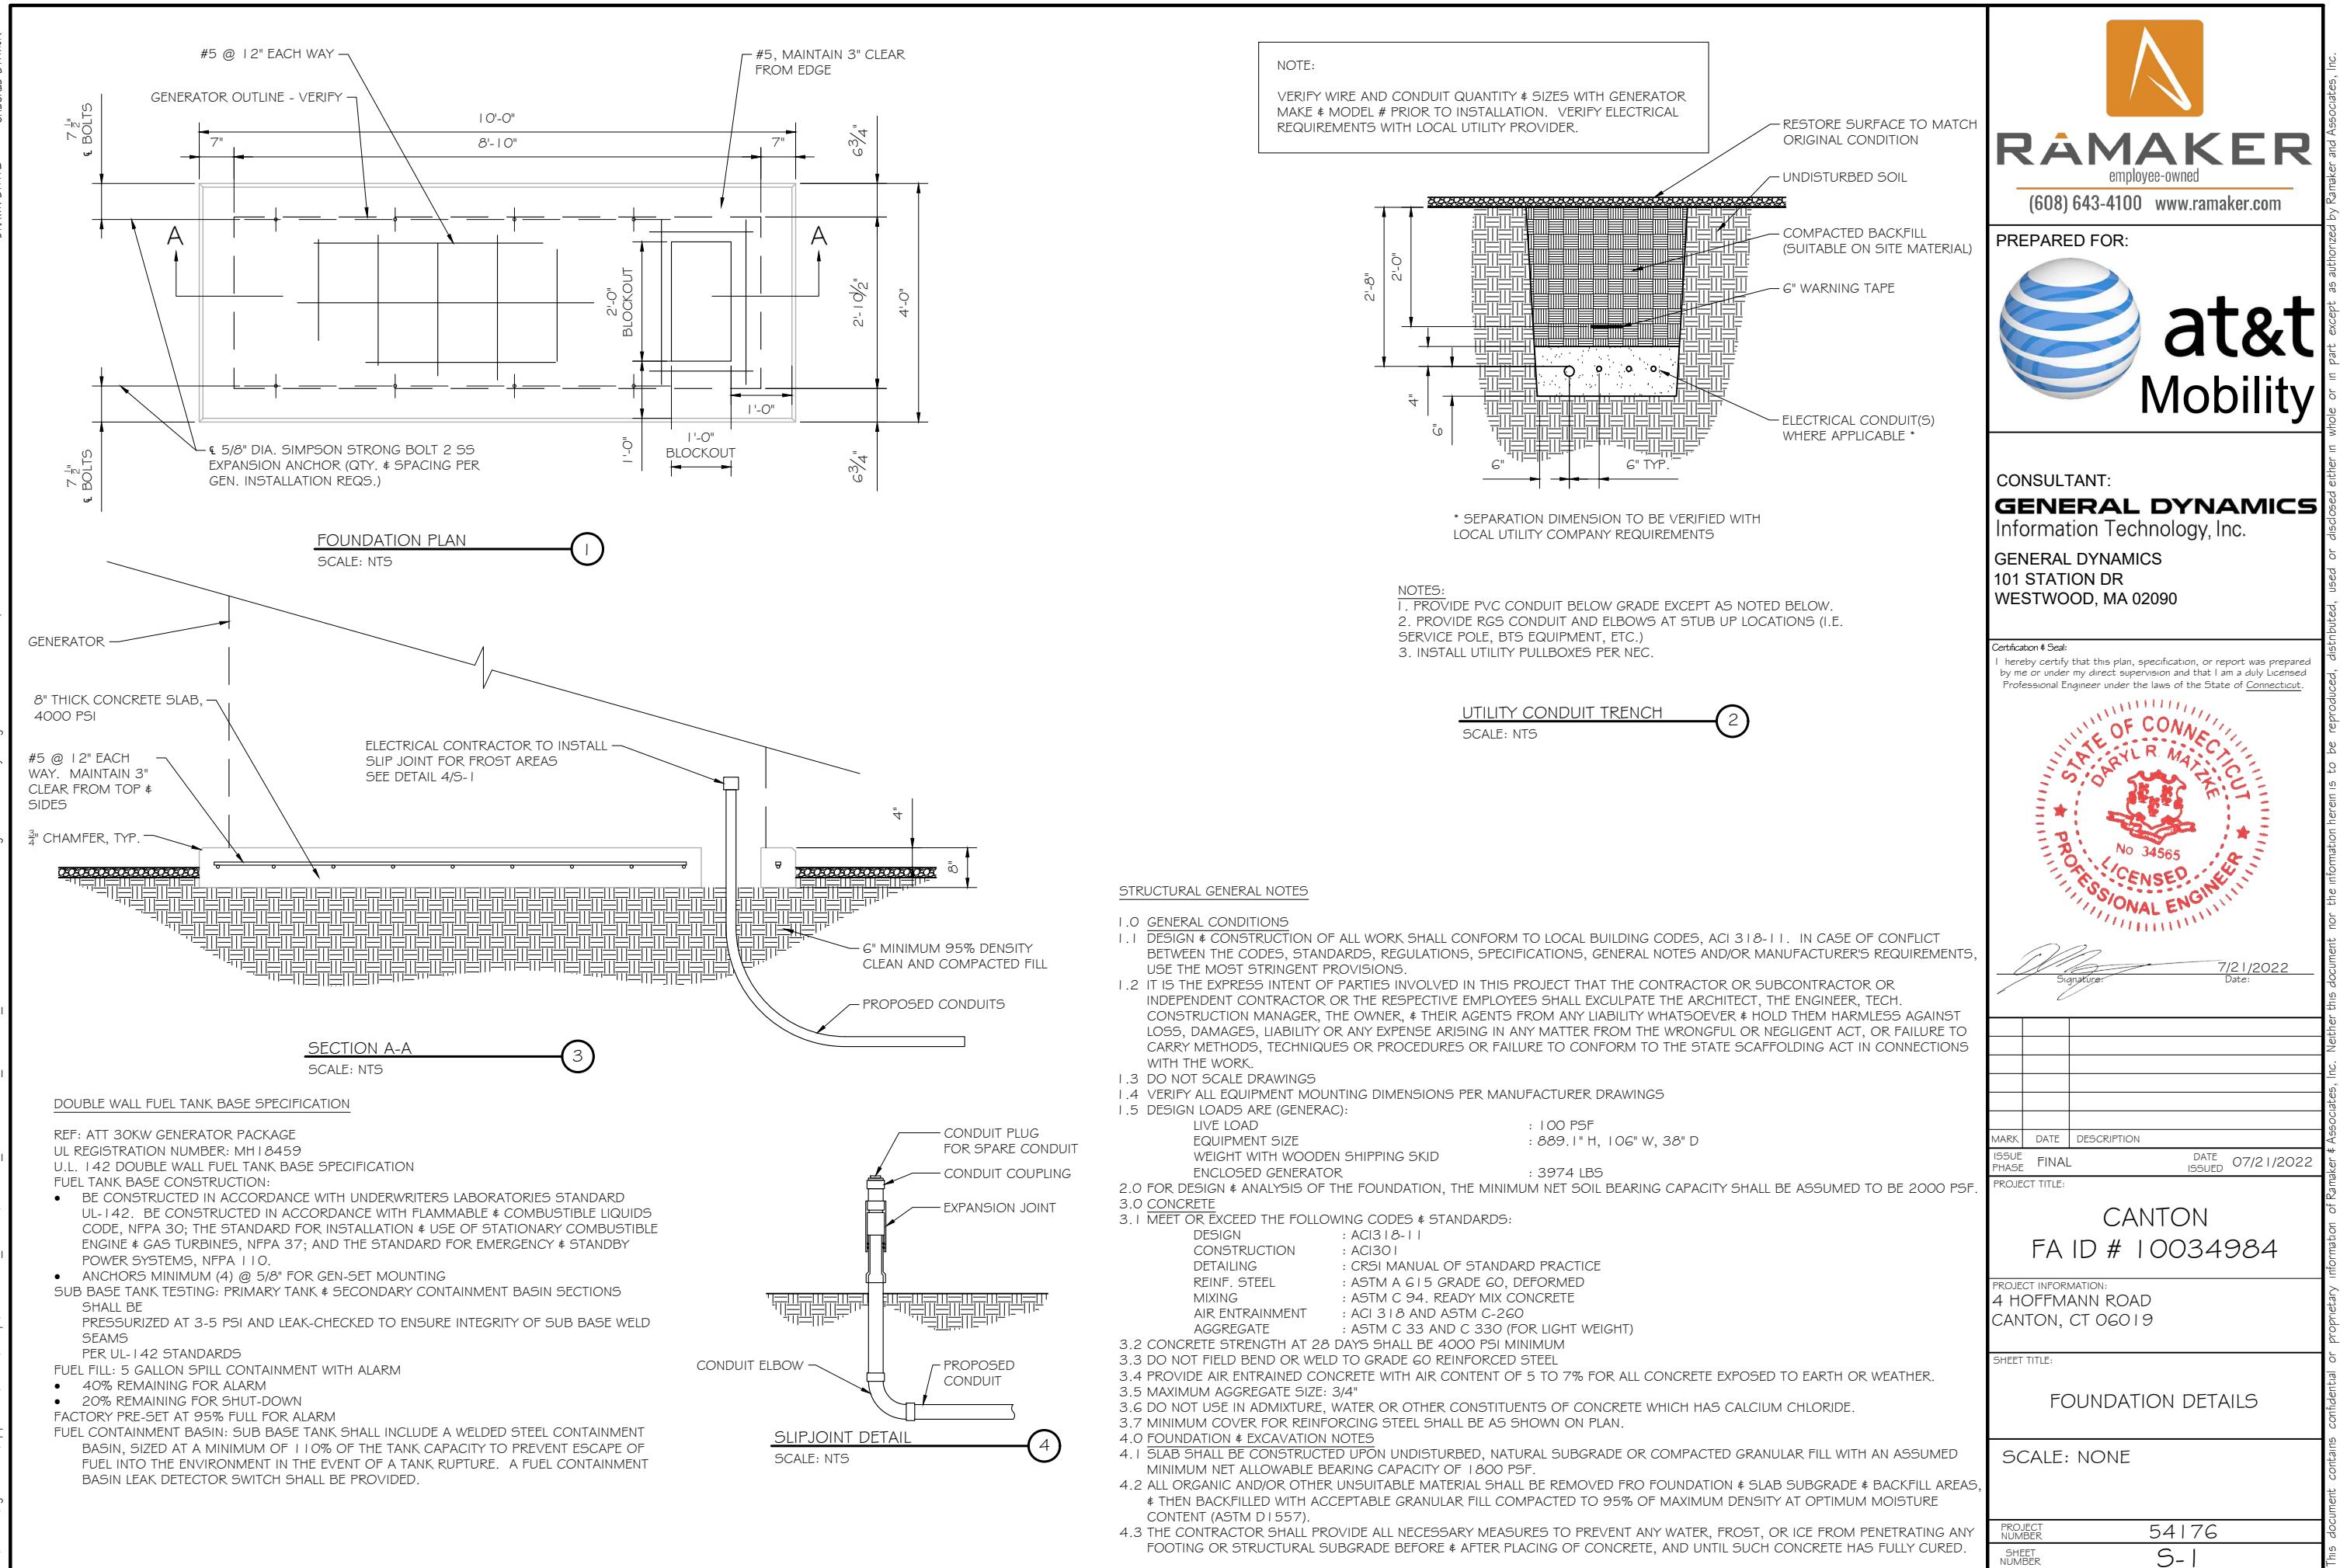

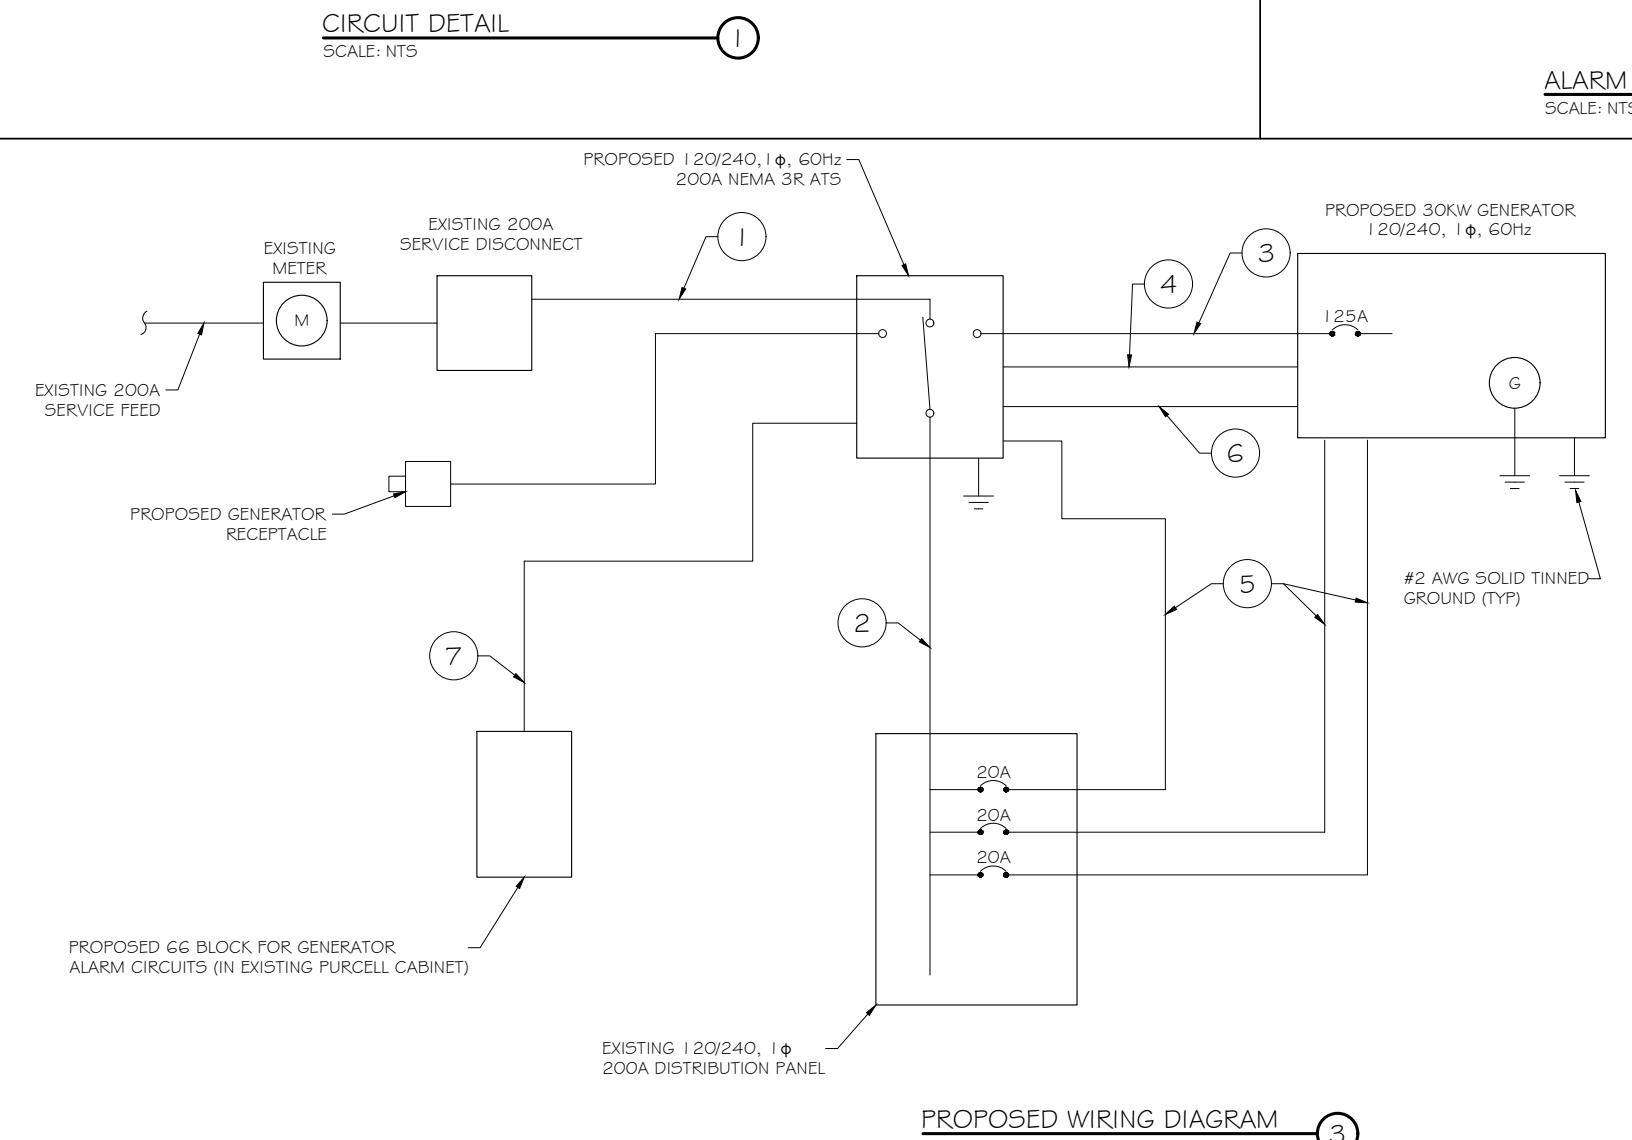

ALARM WIRE IDENTIFICATION CHART


WIRE	ALARM
BROWN	GENERATOR RUNNING
BROWN / WHITE	
GREEN	CRITICAL FAULT
GREEN / WHITE	
BLUE	MINOR FAULT
BLUE / WHITE	
ORANGE	LOW FUEL
ORANGE / WHITE	
BROWN *	FUEL LEAK
BROWN / WHITE *	

\*CAT5 CABLE ONLY, FROM 2ND CAT5 CABLE



CONSULTANT:  
**GENERAL DYNAMICS**  
Information Technology, Inc.  
GENERAL DYNAMICS  
101 STATION DR  
WESTWOOD, MA 02090

Certification & Seal:  
I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly licensed Professional Engineer under the laws of the State of Connecticut.

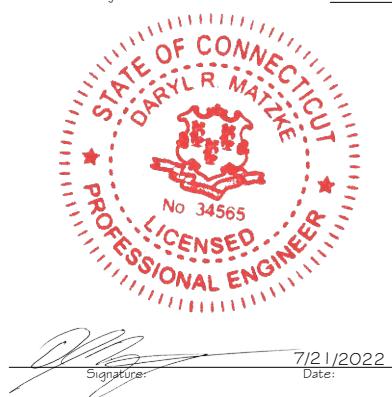

MARK DATE DESCRIPTION  
ISSUE PHASE FINAL DATE ISSUED 07/21/2022  
PROJECT TITLE:

CANTON  
FA ID # 10034984

PROJECT INFORMATION:  
4 HOFFMANN ROAD  
CANTON, CT 06019

SHEET TITLE:  
WIRING DETAILS


SCALE: NONE

PROJECT NUMBER 54176  
SHEET NUMBER E-1

AC Distribution Panel - Layout Diagram									
Breaker Position	Breaker Type	On/Off	Size	Circuit Label	Breaker Position	Breaker Type	On/Off	Size	Circuit Label
1	2P	ON			2	2P	ON		
3					4				
5	2P	ON			6				
7					8	2P	ON		
9	1P	ON	20	BLOCK HEATER	10	1P	ON	20	ATS
11	1P	ON	20	BATTERY CHARGER	12	1P	ON	20	
13	1P	ON	20		14	1P	ON	20	
15	1P	OFF	20		16	1P	ON	20	
17	1P	ON	20		18	1P	ON	20	
19	2P	ON			20	1P	ON	20	
21					22	1P	ON	20	
23	2P	ON	20		24	2P	OFF	50	
25					26				
27	2P	ON	50		28	2P	OFF	50	
29					30				
31	2P	OFF	60		32	2P	ON	60	
33					34				
35	2P	ON	60		36	2P	ON	100	
37					38				
39	2P	ON	20		40	2P	OFF	100	
41					42				

EXISTING PANEL SCHEDULE

SCALE: NTS

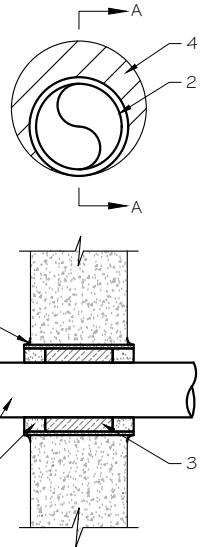

U.L. SYSTEM NO. C-AJ-1150  
CONDUIT THROUGH BEARING WALL SIMILAR TO U.L. DESIGN NO. U902  
F RATING = 3 HR  
T RATING = 0 HR

1. FLOOR OR WALL ASSEMBLY : MINIMUM 4-1/2" THICK REINFORCED LIGHTWEIGHT OR NORMAL WEIGHT (100-150 PCF) CONCRETE. WALL MAY ALSO BE CONSTRUCTED OF ANY UL CLASSIFIED CONCRETE BLOCKS\*. MAX DIAMETER OF OPENING IS 4". SEE CONCRETE BLOCKS 9CATZ) CATEGORY IN THE FIRE RESISTANCE DIRECTORY FOR NAMES OF MANUFACTURERS.
2. THROUGH PENETRATIONS : ONE METALLIC PIPE OR CONDUIT TO BE RIGIDLY SUPPORTED ON BOTH SIDES OF FLOOR OR WALL ASSEMBLY. THE ANNULAR SPACE SHALL BE MINIMUM 0". (POINT CONTACT) TO MAXIMUM 1-3/8". THE FOLLOWING TYPES AND SIZES OF METALLIC PIPES OR CONDUITS MAY BE USED:
  - A. STEEL PIPE-NOMINAL 6" DIAMETER (OR SMALLER) SCHEDULE 40 (OR HEAVIER) STEEL PIPE.
  - B. IRON PIPE-NOMINAL 6" DIAMETER (OR SMALLER) CAST OR DUCTILE IRON PIPE.
  - C. CONDUIT - NOMINAL 4" DIAMETER (OR SMALLER) STEEL ELECTRICAL METALLIC TUBING OR NOMINAL 3-1/2" DIAMETER (OR SMALLER) STEEL CONDUIT.
3. PACKING MATERIAL: MINIMUM 6" THICKNESS OF MIN 4.0 PCF MINERAL WOOL BATTING INSULATION FIRMLY PACKED INTO OPENING AS A PERMANENT FORM. PACKING MATERIAL TO BE RECESSED FROM TOP SURFACE OF FLOOR OR FROM BOTH SURFACES OF WALL AS REQUIRED TO ACCOMMODATE THE REQUIRED THICKNESS OF FILL MATERIAL.
4. FILL, VOID, OR CAVITY MATERIAL: SEALANT: MINIMUM 1/4" THICKNESS OF FILL MATERIAL APPLIED WITHIN THE ANNULUS, FLUSH WITH TOP SURFACE OF FLOOR AND WITH BOTH SURFACES OF WALL. AT THE POINT CONTACT LOCATION BETWEEN PIPE AND CONCRETE, A MINIMUM 1/2" DIAMETER BEAD OF FILL MATERIAL SHALL BE APPLIED AT THE CONCRETE/PIPE INTERFACE ON THE TOP SURFACE OF FLOOR AND ON BOTH SURFACES OF WALL. W RATING APPLIES ONLY WHEN CP6015 OR CP604 SEALANT IS USED.


NOTE:  
1. IF EXISTING CONSTRUCTION VARIES FROM THIS DETAIL, AN EQUAL 3-HR U.L. PENETRATION APPROPRIATE FOR THE EXISTING WALL TYPE SHALL BE CONSTRUCTED  
2. GC SHALL USE NON-SHRINKING CAULK TO WEATHERSEAL ALL PENETRATIONS INTO OR THRU SHELTER WALL.

HILTI CONSTRUCTION CHEMICALS, DIV OF HILTI INC. : CP6015, CP604, CP606, OR FS-ONE SEALANT.

\* BEARING THE UL CLASSIFICATION MARK

OUTER WALL PENETRATION DETAIL (IF APPLICABLE)

SCALE: NTS

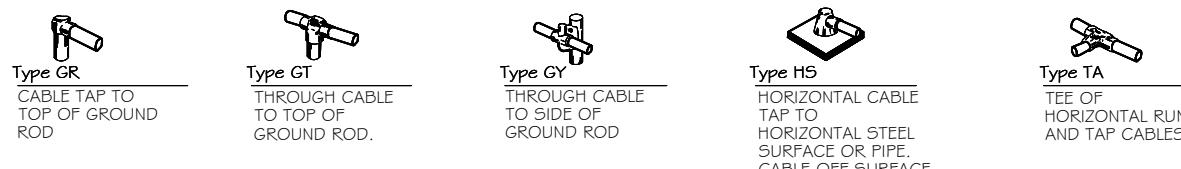

Type GR  
CABLE TAP TO TOP OF GROUND ROD

Type GT  
THROUGH CABLE TO TOP OF GROUND ROD.

Type GY  
THROUGH CABLE TO SIDE OF GROUND ROD

Type HS  
HORIZONTAL CABLE TAP TO HORIZONTAL STEEL SURFACE OR PIPE. CABLE OFF SURFACE.

Type TA  
TEE OF HORIZONTAL RUN AND TAP CABLES.

Type VN  
HORIZONTAL CABLE TAP DOWN AT 45° TO VERTICAL STEEL SURFACE OR THE SIDE OF HORIZONTAL PIPE.

Type VS  
CABLE TAP DOWN AT 45° TO VERTICAL STEEL SURFACE OR SIDE OF HORIZONTAL OR VERTICAL PIPE.

Type VV  
THROUGH VERTICAL CABLE TO VERTICAL STEEL SURFACE OR TO THE SIDE OF EITHER HORIZONTAL OR VERTICAL PIPE

Type GR  
CABLE TAP TO TOP OF GROUND ROD

NOTE:  
CONTRACTOR TO LABEL WIRES WITH P-TOUCH OR  
SIMILAR LABELS ONLY. ABSOLUTELY NO  
HANDWRITTEN LABELS.

\*CONTRACTOR TO UTILIZE NEXT AVAILABLE IN  
SEQUENCE SINGLE BREAKER POSITION FOR  
GENERATOR, BATTERY CHARGER, BATTERY HEATER  
AND BLOCK HEATER

CADWELD DETAILS

SCALE: NTS




PREPARED FOR:



CONSULTANT:  
**GENERAL DYNAMICS**  
Information Technology, Inc.  
GENERAL DYNAMICS  
101 STATION DR  
WESTWOOD, MA 02090

Certification & Seal:  
I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly licensed Professional Engineer under the laws of the State of Connecticut.

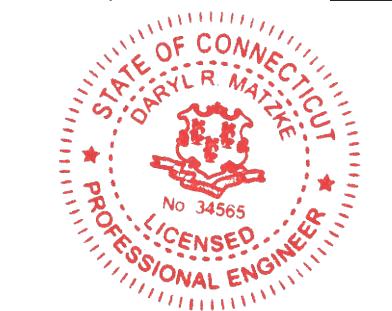

Signature: 7/21/2022  
Date:

MARK DATE DESCRIPTION  
ISSUE PHASE FINAL DATE ISSUED 07/21/2022  
PROJECT TITLE:

CANTON  
FA ID # 10034984

PROJECT INFORMATION:  
4 HOFFMANN ROAD  
CANTON, CT 06019

SHEET TITLE:  
PANEL AND PENETRATION  
DETAILS


SCALE: NONE

PROJECT NUMBER 54176  
SHEET NUMBER E-2


- 1 CONDUIT (TYP)
- 2 BUTTERFLY CLAMP AS REQUIRED
- 3 EXISTING WALL/CEILING
- 4 VERTICAL "UNISTRUT" P1000 'T' SERIES LENGTH BASED ON NUMBER OF CONDUIT TO BE MOUNTED

WALL CONSTRUCTION TYPE	USE
HOLLOW	3/8" DIA. TOGGLE BOLT
HOLLOW, AT STUD	3/8" DIA. LAG SCREW
CONCRETE BLOCK (HOLLOW)	3/8" DIA. HILTI HY-20 WITH SCREEN, MINIMUM EMBEDMENT 2-1/2"
CONCRETE (SOLID)	3/8" DIA. HILTI HY-150 WITH SCREEN, MINIMUM EMBEDMENT 2-1/2"

NOTE: USE GALVANIZED OR STAINLESS STEEL HARDWARE FOR WALL MOUNT & CONNECTIONS OF CHANNELS SPACE UNITS @ 5'-0" O.C. LENGTH OF RUN

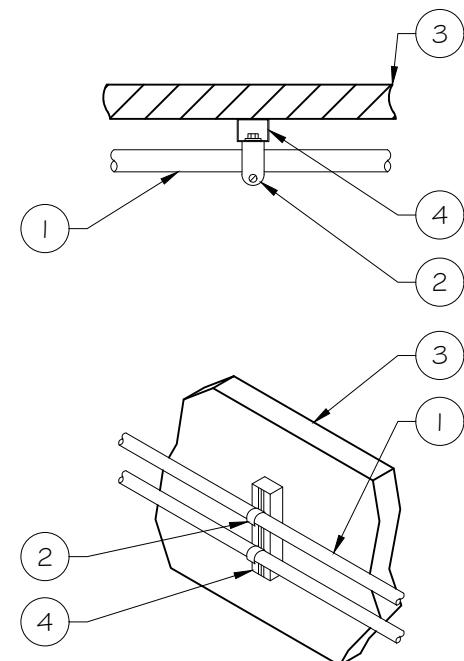


CONDUIT WALL MOUNT  
SCALE: NTS

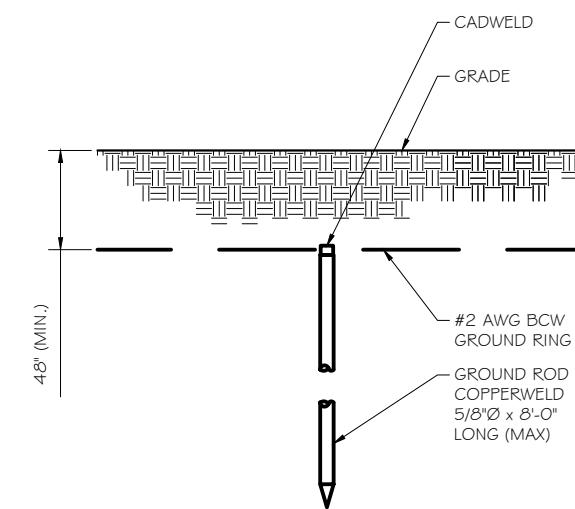

GROUND ROD DETAIL  
SCALE: NTS

WALL CONSTRUCTION TYPE	USE
HOLLOW	3/8" DIA. TOGGLE BOLT
HOLLOW, AT STUD	3/8" DIA. LAG SCREW
CONCRETE BLOCK (HOLLOW)	7/16" DIA. HILTI HY-20 WITH SCREEN MINIMUM EMBEDMENT 2-1/2"
CONCRETE (SOLID)	7/16" DIA. HILTI HY-150 WITH SCREEN MINIMUM EMBEDMENT 2-1/2"

NOTE:  
1. USE GALVANIZED OR STAINLESS STEEL HARDWARE FOR WALL MOUNT AND CONNECTION OF CHANNELS  
2. GC SHALL USE NON-SHRINKING CAULK TO WEATHER SEAL ALL PENETRATIONS INTO OR THROUGH SHELTER WALL

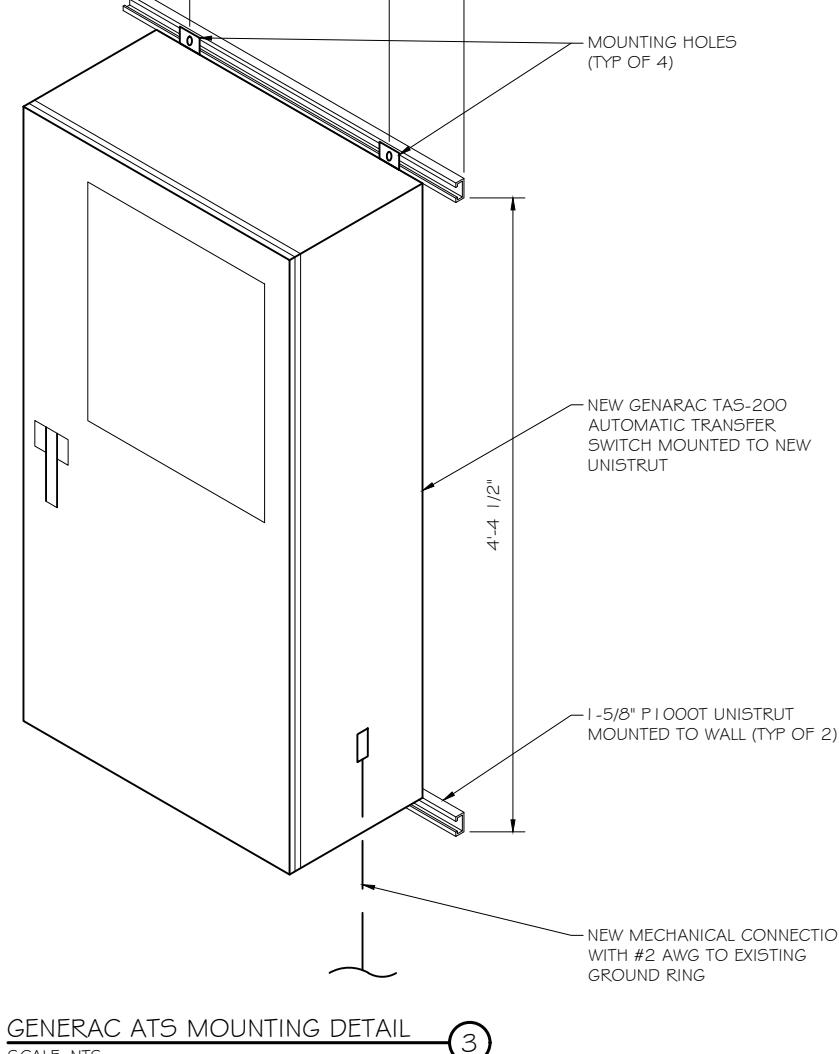

GENERAC ATS MOUNTING DETAIL  
SCALE: NTS

NOTE:

1. GROUND RODS MAY BE:
  - COPPER CLAD STEEL
  - SOLID COPPER
2. GROUND RODS SHALL HAVE A MAXIMUM SPACING TWICE THE LENGTH OF ROD
3. SEE RESISTIVITY REPORT FOR VERIFICATION AS AVAILABLE
4. A LARGER CONDUCTOR SHALL BE REQUIRED IN AREAS HIGHLY PRONE TO LIGHTNING AND/OR AREAS WITH HIGHLY ACIDIC SOIL
5. GROUND RODS INSTALLED WITHIN CLOSE PROXIMITY TO TOWER OR WHEN SOIL IS AT OR BELOW 2,000 OHM-CM, SHALL BE GALVANIZED TO PREVENT GALVANIC CORROSION OF TOWER, (SEE ANSI/TIA-EIA-222-G)
6. PROVIDE (1) GROUND LEAD TO EACH SIDE OF THE GENERATOR

CONSULTANT:  
**GENERAL DYNAMICS**  
Information Technology, Inc.

GENERAL DYNAMICS  
101 STATION DR  
WESTWOOD, MA 02090

Certification & Seal:  
I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly licensed Professional Engineer under the laws of the State of Connecticut.



MARK DATE DESCRIPTION  
ISSUE PHASE FINAL DATE ISSUED 07/21/2022  
PROJECT TITLE:

CANTON  
FA ID # 10034984

PROJECT INFORMATION:  
4 HOFFMANN ROAD  
CANTON, CT 06019

SHEET TITLE:  
ATS, CONDUIT & GROUND ROD DETAILS

SCALE: NONE

PROJECT NUMBER 54176  
SHEET NUMBER E-3



**SD030 | 2.2L | 30 kW**  
INDUSTRIAL DIESEL GENERATOR SET

EPA Certified Stationary Emergency

**CONFIGURABLE OPTIONS**

**ENGINE SYSTEM**

- Oil Heater
- Critical Silencer (Open Set Only)
- Radiator Stone Guard
- Level 1 Fan and Belt Guards (Open Set Only)

**FUEL SYSTEM**

- NPT Flexible Fuel Line

**ELECTRICAL SYSTEM**

- 10A UL Listed Battery Charger
- Battery Warmer

**ALTERNATOR SYSTEM**

- Alternator Upsizing
- Anti-Condensation Heater
- Tropical Coating
- Permanent Magnet Excitation

**GENERATOR SET**

- Extended Factory Testing
- 8 Position Load Center
- Pad Vibration Isolation

**ENGINEERED OPTIONS**

**ENGINE SYSTEM**

- Coolant Heater Isolation Ball Valves
- Fluid Containment Pan

**CONTROL SYSTEM**

- Spare Inputs (x4) / Outputs (x4)
- Battery Disconnect Switch

**GENERAC | INDUSTRIAL POWER**

**SD030 | 2.2L | 30 kW**

INDUSTRIAL DIESEL GENERATOR SET

EPA Certified Stationary Emergency

**CONFIGURABLE OPTIONS**

**CIRCUIT BREAKER OPTIONS**

- Main Line Circuit Breaker
- 2nd Main Line Circuit Breaker
- Shunt Trip and Auxiliary Contact
- Electronic Trip Breakers

**ENCLOSURE**

- Weather Protected Enclosure
- Level 1 Sound Attenuation
- Level 2 Sound Attenuation
- Level 2 Sound Attenuation with Motorized Dampers
- Steel Enclosure
- Aluminum Enclosure
- Up to 200 MPH Wind Load Rating (Contact Factory for Availability)
- AC/DC Enclosure Lighting Kit
- Door Alarm Switch
- Enclosure Heater
- Damper Alarm Contacts

**WARRANTY (Standby Gensets Only)**

- 2 Year Extended Limited Warranty
- 5 Year Limited Warranty
- 5 Year Extended Limited Warranty
- 7 Year Extended Limited Warranty
- 10 Year Extended Limited Warranty

**CONTROL SYSTEM**

- NFPA 110 Compliant 21-Light Remote Annunciator
- Remote Relay Assembly (8 or 16)
- Oil Temperature Indication and Alarm
- Remote E-Stop (Break Glass-Type, Surface Mount)
- Remote E-Stop (Red Mushroom-Type, Surface Mount)
- Remote E-Stop (Red Mushroom-Type, Flush Mount)
- 100 dB Alarm Horn
- Ground Fault Annunciation
- 120V GFCI and 240V Outlets
- Remote Communication - Modem
- 10A Engine Run Relay

**FUEL TANKS (Size On Last Page)**

- 8 in (203.2 mm) Fill Extension
- 13 in (330.2 mm) Fill Extension
- 19 in (482.6 mm) Fill Extension
- Overfill Protection Valve
- 5 Gallon Spill Box Return Hose
- 5 Gallon Spill Box
- Tank Risers
- Fuel Level Switch and Alarm
- 12' Vent System
- Fire Rated Stainless Steel Fuel Hose

**SD030 | 2.2L | 30 kW**

INDUSTRIAL DIESEL GENERATOR SET

EPA Certified Stationary Emergency

**APPLICATION AND ENGINEERING DATA**

**ENGINE SPECIFICATIONS**

**General**

Make	Perkins
EPA Emissions Compliance	Stationary Emergency
EPA Emissions Reference	See Emission Data Sheet

Cylinder #	4
Type	In-Line

Displacement - in <sup>3</sup> (L)	135 (2.22)
Bore - in (mm)	3.3 (84)

Stroke - in (mm)	3.9 (100)
Compression Ratio	23.3:1

Intake Air Method	Turbocharged
Cylinder Head	Cast Iron

Piston Type	Aluminum
Crankshaft Type	Forged Steel

Engine Governing	
Governor	Electronic Isochronous

Frequency Regulation (Steady State)	±0.5%
-------------------------------------	-------

**Cooling System**

Cooling System Type	Closed Recovery
Water Pump Type	Pre-Lubed, Self Sealing

Fan Type	Pusher
Fan Speed - RPM	1,980

Fan Diameter - in (mm)	18 (457)
------------------------	----------

**Fuel System**

Fuel Type	Ultra Low Sulfur Diesel Fuel #2
Fuel Specifications	ASTM

Fuel Filtering (Microns)	5
--------------------------	---

Fuel Inject Pump	Distribution Injection Pump
Fuel Pump Type	Engine Driven Gear

Injector Type	Mechanical
Fuel Supply Line - in (mm)	0.31 (7.9) ID

Fuel Return Line - in (mm)	0.2 (4.8) ID
----------------------------	--------------

**Engine Electrical System**

System Voltage	12 VDC
Battery Charger Alternator	Standard

Battery Size	See Battery Index 0161970SBY
Battery Voltage	12 VDC

Ground Polarity	Negative
-----------------	----------

**ALTERNATOR SPECIFICATIONS**

Standard Model	K0035124Y21
Poles	4

Standard Excitation	Brushless
Bearings	Single Sealed

Field Type	Revolving
Coupling	Direct via Flexible Disc

Coupling	Direct via Flexible Disc
Load Capacity - Standby	100%

Insulation Class - Rotor	H
Insulation Class - Stator	H

Load Capacity - Standby	100%
Prototype Short Circuit Test	Yes

Total Harmonic Distortion	<5% (3-Phase)
Telephone Interference Factor (TIF)	

**SD030 | 2.2L | 30 kW**  
INDUSTRIAL DIESEL GENERATOR SET

EPA Certified Stationary Emergency

**OPERATING DATA**

**POWER RATINGS**

Standby		
Single-Phase 120/240 VAC @1.0pf	30 kW	Amps: 125
Three-Phase 120/208 VAC @0.8pf	30 kW	Amps: 104
Three-Phase 120/240 VAC @0.8pf	30 kW	Amps: 90
Three-Phase 277/480 VAC @0.8pf	30 kW	Amps: 45
Three-Phase 346/600 VAC @0.8pf	30 kW	Amps: 36

**MOTOR STARTING CAPABILITIES (skVA)**

skVA vs. Voltage Dip			
277/480 VAC	30%	208/240 VAC	30%
K0035124Y21	61	K0035124Y21	46
K0040124Y21	76	K0040124Y21	58
K0050124Y21	98	K0050124Y21	75

**FUEL CONSUMPTION RATES\***

Diesel - gph (Lph)		
Fuel Pump Lift- ft (m)	Percent Load	Standby
3 (1)	25%	1.0 (3.7)
	50%	1.4 (5.2)
	75%	2.0 (7.5)
	100%	2.8 (10.5)
16.6 (63)		

\* Fuel supply installation must accommodate fuel consumption rates at 100% load.

**COOLING**

Standby		
Coolant Flow	gpm (Lpm)	14.9 (56.2)
Coolant System Capacity	gal (L)	2.5 (9.5)
Heat Rejection to Coolant	BTU/hr (kW)	128,638 (136)
Inlet Air	scfm (m³/hr)	2,800 (4,757)
Maximum Operating Ambient Temperature	°F (°C)	122 (50)
Maximum Operating Ambient Temperature (Before Derate)	See Bulletin No. 0199280SSD	
Maximum Radiator Backpressure	in H <sub>2</sub> O (kPa)	0.5 (0.12)

**COMBUSTION AIR REQUIREMENTS**

Standby	
Flow at Rated Power scfm (m³/min)	88 (2.5)

**ENGINE**

Standby	
Rated Engine Speed	RPM
Horsepower at Rated kW**	hp
Piston Speed	ft/min (m/min)
BMEP	psi (kPa)

\*\* Refer to "Emissions Data Sheet" for maximum bHP for EPA and SCAQMD permitting purposes.

Derate - Operational characteristics consider maximum ambient conditions. Derate factors may apply under atypical site conditions.

Please contact a Generac Power Systems Industrial Dealer for additional details. All performance ratings in accordance with ISO3046, BS5514, ISO8528, and DIN6271 standards.


Standby - See Bulletin 0187500SSB

Prime - See Bulletin 0187510SSB

**SD030 | 2.2L | 30 kW**  
INDUSTRIAL DIESEL GENERATOR SET

EPA Certified Stationary Emergency

**DIMENSIONS AND WEIGHTS\***

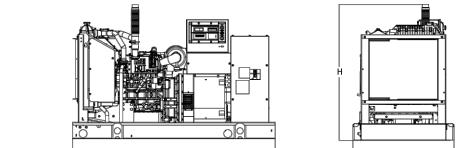


**GENERAC | INDUSTRIAL POWER**

EPA Certified Stationary Emergency


**OPEN SET (Includes Exhaust Flex)**

Run Time - Hours	Usable Capacity - Gal (L)	L x W x H - in (mm)	Weight - lbs (kg)
No Tank	-	76.0 (1,930) x 37.4 (950) x 44.8 (1,138)	1,641 (745)
19	54 (204)	76.0 (1,930) x 37.4 (950) x 57.8 (1,468)	2,121 (963)
47	132 (501)	76.0 (1,930) x 37.4 (950) x 69.8 (1,773)	2,351 (1,067)
75	211 (799)	76.0 (1,930) x 37.4 (950) x 81.8 (2,078)	2,560 (1,162)
107	300 (1,136)	92.9 (2,360) x 37.4 (950) x 81.8 (2,078)	2,623 (1,190)

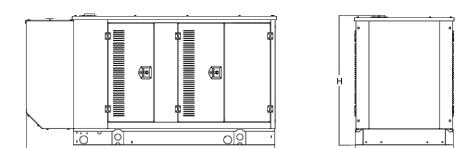


**WEATHER PROTECTED ENCLOSURE**

Run Time - Hours	Usable Capacity - Gal (L)	L x W x H - in (mm)	Weight - lbs (kg)
No Tank	-	94.8 (2,409) x 38.0 (965) x 49.5 (1,258)	
19	54 (204)	94.8 (2,409) x 38.0 (965) x 62.5 (1,588)	372 (241)
47	132 (501)	94.8 (2,409) x 38.0 (965) x 74.5 (1,893)	(170)
75	211 (799)	94.8 (2,409) x 38.0 (965) x 86.5 (2,198)	
107	300 (1,136)	94.8 (2,409) x 38.0 (965) x 86.5 (2,198)	

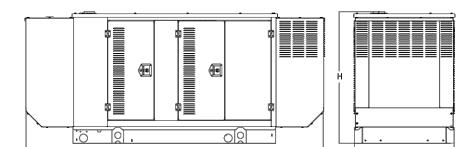

**LEVEL 1 ACOUSTIC ENCLOSURE**


Run Time - Hours	Usable Capacity - Gal (L)	L x W x H - in (mm)	Weight - lbs (kg)
No Tank	-	112.5 (2,857) x 38.0 (965) x 49.5 (1,258)	
19	54 (204)	112.5 (2,857) x 38.0 (965) x 62.5 (1,582)	505 (338)
47	132 (501)	112.5 (2,857) x 38.0 (965) x 74.5 (1,893)	(230)
75	211 (799)	112.5 (2,857) x 38.0 (965) x 86.5 (2,198)	
107	300 (1,136)	112.5 (2,857) x 38.0 (965) x 86.5 (2,198)	

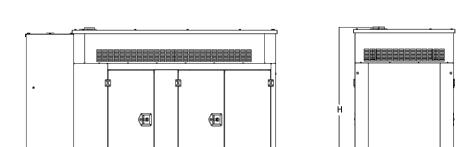

**LEVEL 2 ACOUSTIC ENCLOSURE**

Run Time - Hours	Usable Capacity - Gal (L)	L x W x H - in (mm)	Weight - lbs (kg)
No Tank	-	94.8 (2,407) x 38.0 (965) x 61.1 (1,551)	
19	54 (204)	94.8 (2,407) x 38.0 (965) x 74.1 (1,881)	510 (341)
47	132 (501)	94.8 (2,407) x 38.0 (965) x 86.1 (2,186)	(232)
75	211 (799)	94.8 (2,407) x 38.0 (965) x 98.1 (2,491)	
107	300 (1,136)	94.8 (2,407) x 38.0 (965) x 98.1 (2,491)	

\* All measurements are approximate and for estimation purposes only. Specification characteristics may change without notice. Please contact a Generac Power Systems Industrial Dealer for detailed installation drawings.

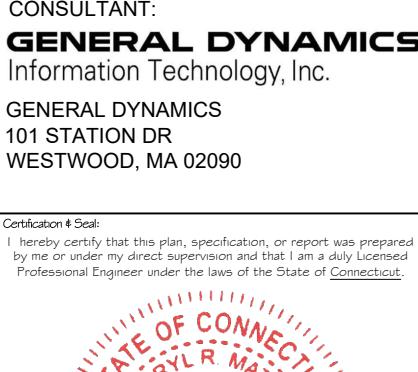

Signature: \_\_\_\_\_ Date

## TTS Series Switches

200 Amps  
600 VAC



## TAS200 200A Automatic Transfer Switch

TAS200  
TAS200

1 of 3 2 of 3

### The Generac TAS200 Automatic Transfer Switch

Flexibility for multiple application installations

Multiple generator support with 3 source panel

Designed with a 6 inch touch screen controller for improved user interface

Camlock functionality for mobile generator sources



Image used for illustration purposes only.

### Features

- STEEL CONSTRUCTION
- NEMA 3R ENCLOSURE WITH HINGED "PADLOCKING" DOORS
- STAINLESS STEEL HARDWARE
- CAMLOCK "QUICK CONNECT" CAPABILITY
- OPERATIONAL STATUS VIEW VIA 6 INCH TOUCH SCREEN
- TEST FUNCTION - FAST TEST & NORMAL TEST
- UL1008 LISTED - FOR EMERGENCY SYSTEMS

### Codes and Standards

Generac products are designed to the following standards:



UL1008,  
UL508,  
UL50,  
CSA C22.2 No. 178



NEC 700, 701 and 702



NEMA 250

### Optional Features

- EXTENDED WARRANTY
- THREE-PHASE VOLTAGE CONFIGURATIONS

### Application and Engineering Data

Cabinet Specifications	
Dimensions	24"W x 12"D x 48"H
Weight	210 lbs.
Construction	Single Chamber with Main Door Steel UL Type / NEMA 3R Rated Powder Coat Finish for Corrosion Resistance C-UL-US Listed - Automatic Transfer Switch Stainless Steel Hardware 3-Point Latching System with Pad-Lockable Handles
Mounting Options	Wall H-frame
Installed	Pre-wired alarm terminal strip

Electrical Specifications	
Voltage/Phase/Amps	120/240 Single-Phase, 200A 120/208 3-Phase, 200A 120/240 3-Phase, 200A
Breaker	Eaton 200 amp Utility Breaker Eaton 200 amp Generator Breaker
Maximum RMS Symmetrical Fault Current - Amps	25k AIC Rated
Protective Device Continuous Rating (Max) Amp	200
Input to Generator	350MCM - #6 AWG
Output to Site	350MCM - #6 AWG
Generator Announcer Connector	Deutsch DTM04-12PA-L012
Alarm Terminal Board	Generator Run Alarm
	Generator Fail - Shutdown Alarm
	Generator Fail - Non Shutdown Alarm
	Low Fuel Alarm
	Generator Theft Alarm
	AC Utility Fail Alarm

Camlock Component	
Camlock Component	Shipped loose for multiple installation options
Dimensions	9" W x 9.4" D x 24.25" H
200A Camlock Generator Connection	Single-Phase: Black L1, Red L2, White-Neutral, Green-Ground 3-Phase: Black L1, Red L2, Blue L3, White-Neutral, Green-Ground Uses 4 CH E1016 Male Connectors Mating Connector - CH E1016 Female




PREPARED FOR:



CONSULTANT:  
**GENERAL DYNAMICS**  
Information Technology, Inc.  
GENERAL DYNAMICS  
101 STATION DR  
WESTWOOD, MA 02090

Certification & Seal:  
I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly licensed Professional Engineer under the laws of the State of Connecticut.

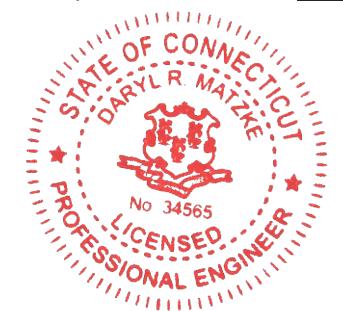

Signature: 7/21/2022  
Date:

MARK	DATE	DESCRIPTION
ISSUE PHASE	FINAL	DATE ISSUED 07/21/2022
PROJECT TITLE:		

CANTON  
FA ID # 10034984


PROJECT INFORMATION:  
4 HOFFMANN ROAD  
CANTON, CT 06019

SHEET TITLE:  
GENERAC ATS SPECIFICATIONS

SCALE: NONE

PROJECT NUMBER 54176  
SHEET NUMBER E-5

### Touch Screen Interface



### TTS Control Systems

TAS200

3 of 3

### INDICATORS AND BUTTONS

<ul style="list-style-type: none"><li>System Ready indicator</li><li>Standby Operating indicator</li><li>Utility Available indicator</li><li>GEN/UTIL Switch Position indicator</li><li>TVSS status</li></ul>	<ul style="list-style-type: none"><li>Normal Test button</li><li>Fast Test button</li><li>Return to Normal button</li><li>Reset button</li><li>Exercising indicator</li></ul>
---	---

### DETAILS SCREEN

<b>System Settings:</b> <ul style="list-style-type: none"><li>System Voltage/Phases:<ul style="list-style-type: none"><li>120/240V single phase (standard)</li><li>120/208V three phase (optional)</li><li>120/240V three phase (optional)</li></ul></li><li>Utility Fail Monitor:<ul style="list-style-type: none"><li>Under Voltage: 75-95% of nominal voltage</li><li>Over Voltage: 105%-125% of nominal voltage</li><li>Pickup (hysteresis): fixed at 5 volts</li><li>Delay time: 0-60s</li></ul></li><li>Utility Interrupt Delay: 0-60s</li><li>Return to Utility Timer: 1-30 minutes</li><li>Transfer:<ul style="list-style-type: none"><li>In-phase, or</li><li>Time-Delay-Neutral at 0.0-10.0s in 1 second increments</li></ul></li></ul>	<b>Exercise Settings:</b> <ul style="list-style-type: none"><li>Time of day</li><li>Day of week</li><li>Exercise:<ul style="list-style-type: none"><li>Exercise with/without load</li><li>Exercise once every 1, 2, or 4 weeks.</li><li>Exercise time-of-day</li><li>Exercise day of week</li><li>Exercise duration: 15-30 minutes</li></ul></li></ul>
<b>Engine Settings:</b> <ul style="list-style-type: none"><li>Engine Warm-up timer: 0-20 minutes</li><li>Generator Load Accept:<ul style="list-style-type: none"><li>Time-Delay-Neutral at 0.0-10.0s in 1 second increments</li><li>Voltage: 85-95% of nominal</li><li>Frequency: 85-95% of nominal</li></ul></li><li>Engine Minimum Run Timer: 5-30 minutes</li><li>Engine Cooldown Timer: 0-20 minutes</li></ul>	<b>Screen Settings:</b> <ul style="list-style-type: none"><li>Brightness &amp; Contrast button</li><li>Screen Calibration button</li><li>Startup/Clean screen</li></ul> <b>Diagnostics:</b> <ul style="list-style-type: none"><li>Digital I/O bits status</li><li>Voltage A/D readings</li></ul> <b>Mimic Diagram:</b> <ul style="list-style-type: none"><li>System Ready</li><li>Transfer switch position</li><li>Utility available</li><li>Standby available</li><li>Maintenance/Auto switch position</li><li>Generator source TS position</li><li>TVSS status</li></ul>

Generac Power Systems, Inc. • S45 W29290 HWY. 59, Waukesha, WI 53189 • generac.com  
©2013 Generac Power Systems, Inc. All rights reserved. All specifications are subject to change without notice. Bulletin 0195670SBY-B / Printed in U.S.A. 03/13/13

PREPARED FOR:



CONSULTANT:  
**GENERAL DYNAMICS**  
Information Technology, Inc.

GENERAL DYNAMICS  
101 STATION DR  
WESTWOOD, MA 02090

Certification & Seal:  
I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly licensed Professional Engineer under the laws of the State of Connecticut.



7/21/2022  
Signature: \_\_\_\_\_ Date: \_\_\_\_\_  
PROJECT TITLE: \_\_\_\_\_  
CANTON  
FA ID # 10034984  
PROJECT INFORMATION: 4 HOFFMANN ROAD  
CANTON, CT 06019  
SHEET TITLE: GENERAC ATS SPECIFICATIONS  
SCALE: NONE  
PROJECT NUMBER: 54176  
SHEET NUMBER: E-5.1

# ATTACHMENT 2

The Assessor's office is responsible for the maintenance of records on the ownership of properties. Assessments are computed at 70% of the estimated market value of real property at the time of the last revaluation which was 2018.



# TOWN OF CANTON CT

Information on the Property Records for the Municipality of Canton was last updated on 7/22/2022.

## Property Summary Information

Parcel Data And Values

Building ▾

Sales

### Parcel Information

Location:	309 EAST HILL ROAD	Property Use:	Vacant Land	Primary Use:	Commercial Vacant Land
Unique ID:	2430309	Map Block Lot:	19/243/0309	Acres:	2.0100
490 Acres:	0.00	Zone:	R-3	Volume / Page:	360/841
Developers Map / Lot:	B	Census:			

### Value Information

	Appraised Value	Assessed Value
Land	150,240	105,170
Buildings	0	0
Detached Outbuildings	0	0

	Appraised Value	Assessed Value
Total	150,240	105,170

## Owner's Information

### Owner's Data

HART JAMES H & KATHERINE E  
90 PARK ROAD  
BARKHAMSTEAD, CT 06063

[Back To Search](#)[Save Field Card](#)[Print View](#)

Information Published With Permission From The Assessor

DOCKET NO. 62

AN APPLICATION OF THE SOUTHERN NEW ENGLAND : CONNECTICUT SITING  
TELEPHONE COMPANY FOR A CERTIFICATE OF ENVIRONMENTAL COMPATIBILITY AND PUBLIC  
NEED FOR THE CONSTRUCTION, MAINTENANCE, AND OPERATION OF FACILITIES TO PROVIDE  
CELLULAR SERVICE IN THE TOWN OF CANTON, CONNECTICUT. : COUNCIL  
: August 4, 1986

DECISION AND ORDER

Pursuant to the foregoing Opinion, the Connecticut Siting Council (Council) hereby directs that a certificate of environmental compatibility and public need (certificate) as provided by section 16-50k of the General Statutes of Connecticut (CGS) be issued to the Southern New England Telephone Company (SNET) for the construction, maintenance, and operation of a cellular mobile telephone telecommunication tower and associated equipment in the Town of Canton, subject to the conditions below.

1. The tower shall be no taller than necessary to provide the proposed service, and in no event shall exceed 167', including antennas, at the Hoffmann Road site.
2. A fence not lower than eight feet shall surround the tower and associated equipment building.
3. The applicant or its successor shall notify the Council if and when directional antennas or any other equipment is added to these facilities.
4. The applicant or its successor shall permit, in accordance with representations made by it during the proceeding, public or private entities to share space on the tower, for due consideration received, or shall provide any requesting entity with specific legal, technical, environmental, or economic reasons precluding such tower sharing.

5. Unless necessary to comply with condition number six, below, no lights shall be installed on this tower.
6. The facilities shall be constructed, operated, and maintained as specified in the Council's record on this matter, and shall be constructed in accordance with all applicable federal, state, and municipal laws and regulations.
7. The applicant shall submit a Development and Management Plan (D&M) for the tower site pursuant to sections 16-50j-75 through 16-50j-77 of the Regulations of State Agencies, except that irrelevant items in section 16-50j-76 need only be identified as such. In addition to the requirements of section 16-50j-76, the D&M plan shall provide a plan for evergreen screening around the fenced perimeter of the tower site. The D&M plan must be approved prior to facility construction. Any changes to specifications in the D&M plan must be approved by the Council prior to facility operation.
8. Construction activities shall take place during daylight working hours.
9. The certificate holder shall comply with any future radiofrequency (RF) standards promulgated by state or federal regulatory agencies. Upon the establishment of any new governmental RF standards, the facilities granted in this decision shall comply with such standards.
10. This decision and order shall be void and the towers and associated equipment shall be dismantled and removed, or reapplication for any new use shall be made to the Council before any such new use is made, if the tower does not provide or permanently ceases to provide cellular service following completion of construction.

11. This Decision and Order shall be void if all construction authorized herein is not completed within three years of the issuance of this decision, or within three years of the completion of any appeal if appeal of this decision is taken, unless otherwise approved by the Council.

Pursuant to CGS section 16-50p, we hereby direct that a copy of the Decision and Order shall be served on each person listed below. A notice of the issuance shall be published in the Hartford Courant and the Farmington Valley Herald.

The parties to the proceeding are:

Southern New England Telephone  
Company  
c/o Peter J. Tyrrell  
Senior Attorney  
Room 1021  
227 Church Street  
New Haven, Connecticut 06506  
(203) 771-7381

(Applicant)

The Hartford Cellular Company

represented by:

Howard L. Slater  
Byrne, Slater, Sandler,  
Shulman & Rouse, P.C.  
111 Pearl Street  
P.O. Box 3216  
Hartford, Connecticut 06103

Town of Simsbury

represented by:

Mr. Leonard D. Tolisano  
Town Planner  
Town of Simsbury  
P.O. Box 495  
Simsbury, Connecticut 06070

Town of Canton

represented by:

Mr. Marshall K. Berger, Jr.  
Attorney at Law  
Suite 308  
60 Washington Street  
Hartford, Connecticut 06106

Ms. Karen Berger

represented by:

Mr. Marshall K. Berger, Jr.  
Attorney at Law  
Suite 308  
60 Washington Street  
Hartford, Connecticut 06106  
(service waived)

Mr. Harvey Jassem  
243 East Hill Road  
Canton, Connecticut 06019

Ms. Judy Friedman  
101 Lawton Road  
Canton, Connecticut 06019

(service waived)

Mr. Gilbert Small  
315 East Hill Road  
Canton, Connecticut 06019

(service waived)

John G. Petrasch  
330 East Hill Road  
Canton, Connecticut 06019

(service waived)

C E R T I F I C A T I O N

The undersigned members of the Connecticut Siting Council hereby certify that they have heard this case or read the record thereof, and that we voted as follows:

Dated at New Britain, Connecticut, this 4th day of August, 1986.

Council Members

Vote Cast

Gloria Dibble Pond)

Yes

Gloria Dibble Pond  
Chairperson

Edward Moehring)

Yes

Commissioner John Downey

Designee: Edward Moehring

Brian Emerick)

Abstain

Commissioner Stanley Pac

Designee: Brian Emerick

Owen L. Clark)

Yes

Owen L. Clark

Absent

Mortimer A. Gelston)

Absent

James G. Horsfall

Pamela B. Katz)

No

William H. Smith)

Absent

Colin C. Tait)

Yes

Colin C. Tait

STATE OF CONNECTICUT  
COUNTY OF HARTFORD

)  
:  
)

ss. New Britain, August 4, 1986

I hereby certify that the foregoing is a true and correct copy of  
the decision and order issued by the Connecticut Siting Council, State of  
Connecticut.

ATTEST:

*Gloria Dibble Pond*  
Gloria Dibble Pond, Chairperson  
Connecticut Siting Council

# Town of Canton

## Geographic Information System (GIS)



Date Printed: 7/28/2020





### **MAP DISCLAIMER - NOTICE OF LIABILITY**

This map is for assessment purposes only. It is not for legal description or conveyances. All information is subject to verification by any user. The Town of Canton and its mapping contractors assume no legal responsibility for the information contained herein.

Approximate Scale: 1 inch = 150 feet

0 150 Feet



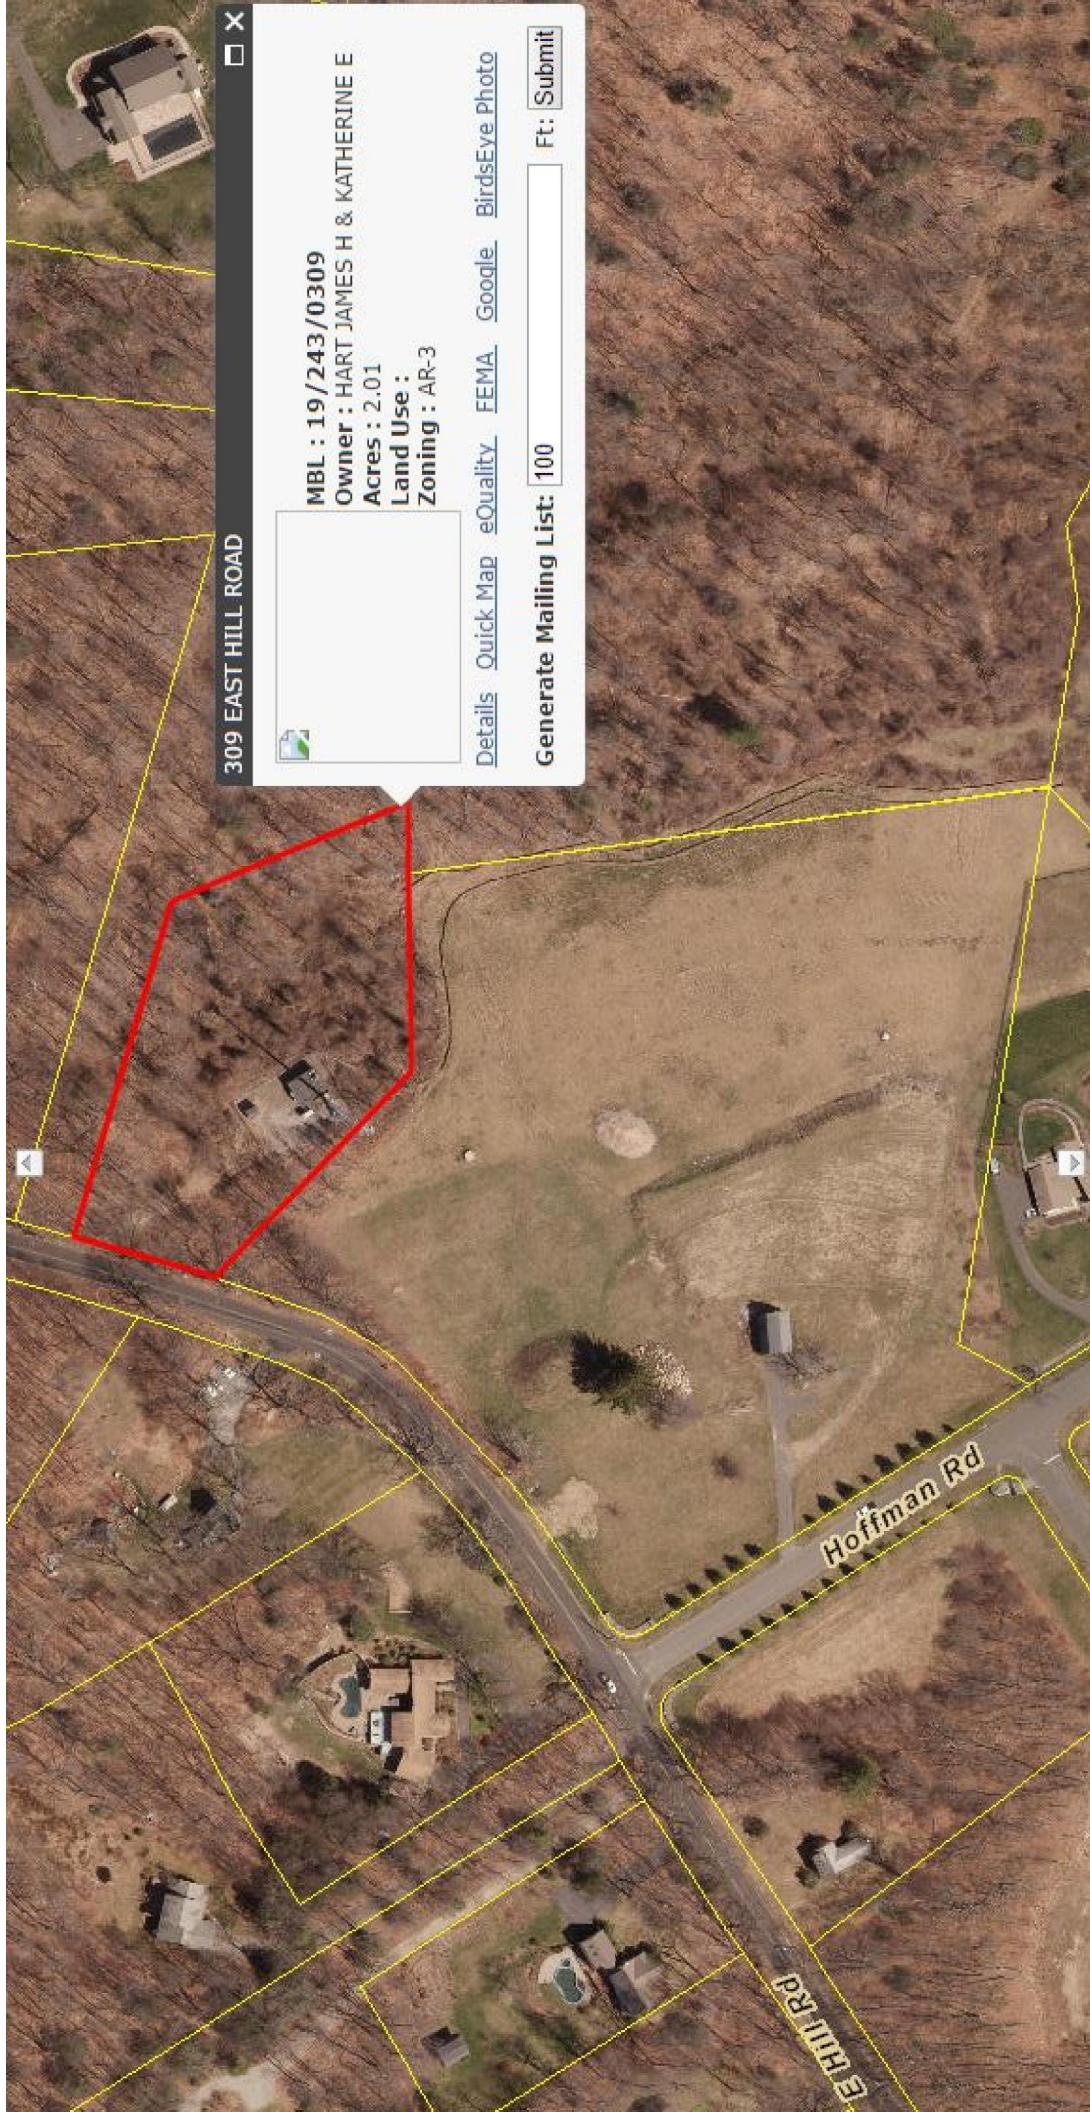

309 EAST HILL ROAD



MBL : 19/243/0309

Owner : HART JAMES H & KATHERINE E

Acres : 2.01

Land Use :

Zoning : AR-3

[Details](#)

[Quick Map](#)

[eQuality](#)

[FEMA](#)

[Google](#)


[BirdsEye Photo](#)

[Generate Mailing List: 100](#)

Ft:  Submit

# Town of Canton, Connecticut - Assessment Parcel Map

Unique ID: 2430309 Address: 309 EAST HILL ROAD

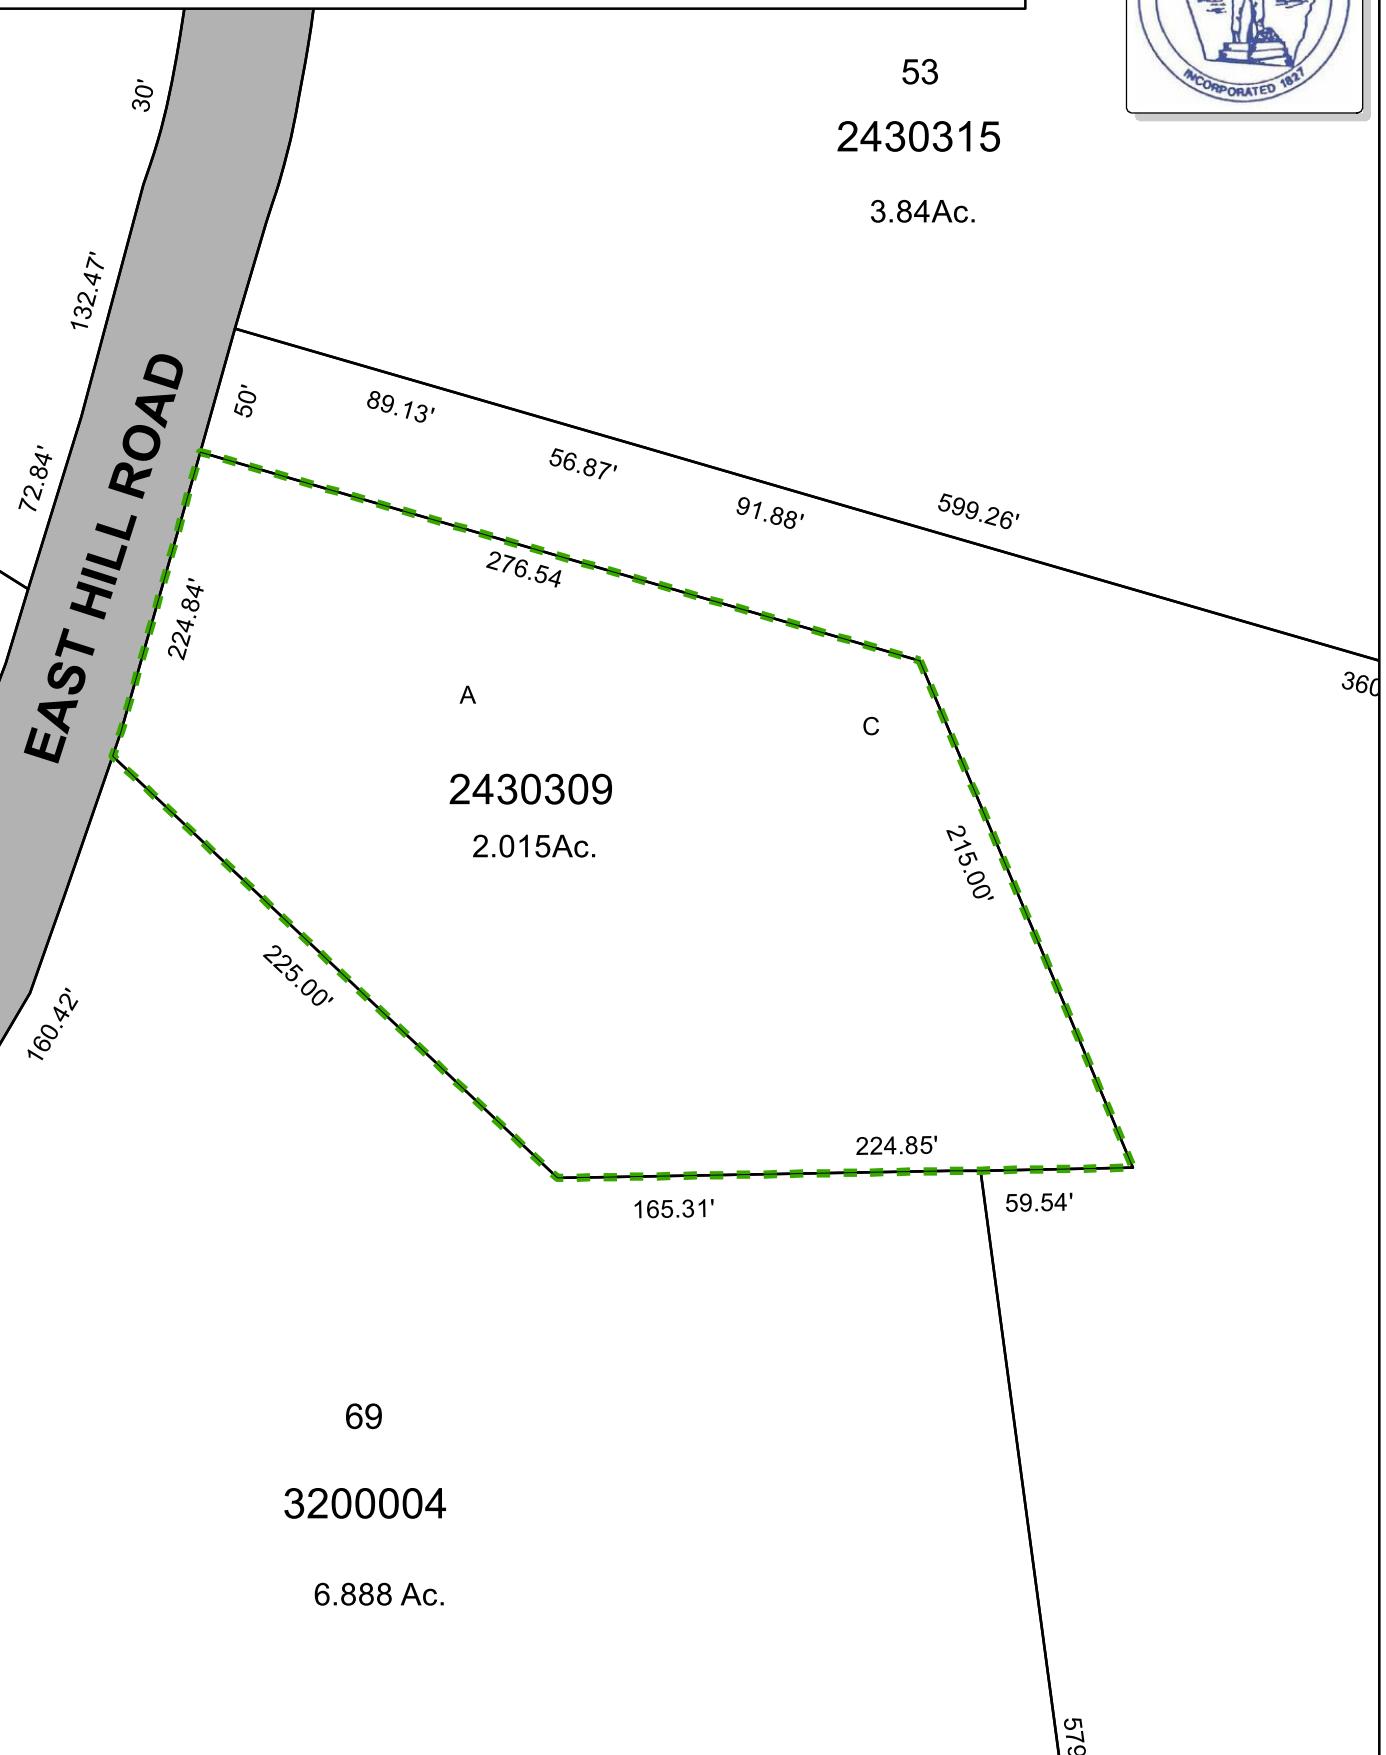

Approximate Scale:

1 inch = 75 feet

#### Disclaimer:

This map is for informational purposes only.  
All information is subject to verification by any user.

The Town of Canton and its mapping contractors  
assume no legal responsibility for the information contained herein.

Map Produced  
June 2020

Sublot  
Easement  
Parcel ID  
89' Dimension

# ATTACHMENT 3

ORIGIN ID:TKAA (318) 642-6190  
STEVEN VOLKERT ACTW/GT: 0.50 LB  
GENERAL DYNAMICS CAD: 105486753/NET4490  
145 PROSPECT STREET  
MERCHANTVILLE, NJ 08109  
UNITED STATES

SHIP DATE: 26JUL22  
ACTW/GT: 0.50 LB  
CAD: 105486753/NET4490

TO **JAMES H. & KATHERINE E HART**

90 PARK ROAD


**BARKHAMSTED CT 06063**

(308) 642-6190  
INV.  
PO:

REF:

DEPT:

581J20A92/FE4A

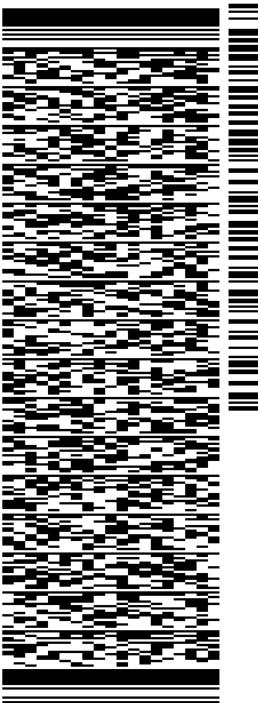

J222022041201uv

**WED - 27 JUL 10:30A**

TRK#


**7774 9355 5145**

0201

**PRIORITY OVERNIGHT**

**EB HFDA**

06063  
CT-US  
BDL

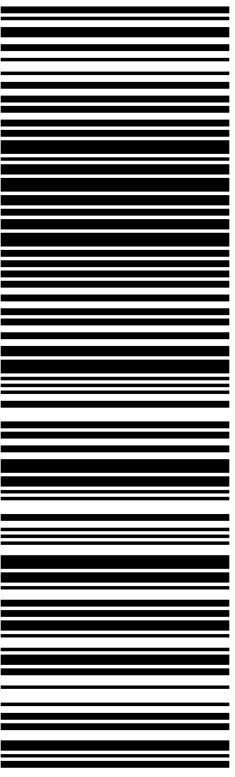

/templates/components/dotcom\_label\_contents/FoldInstr/en/Folding\_instructions.html loading...  
/templates/components/dotcom\_label\_contents/WarningsOriginalLabel/en/Folding\_warning.html loading...  
/templates/components/dotcom\_label\_contents/TnCDom/us/en/TC\_dom.html loading...



July 27, 2022

Dear Customer,

The following is the proof-of-delivery for tracking number: 777493555145

---

**Delivery Information:**

---

<b>Status:</b>	Delivered	<b>Delivered To:</b>	Residence
<b>Signed for by:</b>	Signature not required	<b>Delivery Location:</b>	
<b>Service type:</b>	FedEx Priority Overnight		
<b>Special Handling:</b>	Deliver Weekday; Residential Delivery		BARKHAMSTED, CT,
		<b>Delivery date:</b>	Jul 27, 2022 09:41

---

**Shipping Information:**

---

<b>Tracking number:</b>	777493555145	<b>Ship Date:</b>	Jul 26, 2022
		<b>Weight:</b>	0.5 LB/0.23 KG
<b>Recipient:</b>		<b>Shipper:</b>	
BARKHAMSTED, CT, US,		MERCHANTVILLE, NJ, US,	

Proof-of-delivery details appear below; however, no signature is available for this FedEx Express shipment  
because a signature was not required.

ORIGIN ID:TKAA (318) 642-6190  
STEVEN VOLKERT ACTW/GT: 0.50 LB  
GENERAL DYNAMICS CAD: 105486753/NET4490  
145 PROSPECT STREET  
MERCHANTVILLE, NJ 08109  
UNITED STATES

SHIP DATE: 25JUL22  
ACTW/GT: 0.50 LB  
CAD: 105486753/NET4490

BILL SENDER

TO ROBERT BESEL, FIRST SELECTMAN  
TOWN OF CANTON  
4 MARKET ST

COLLINSVILLE CT 06022

(860) 693-7847

REF:

INV:

PO:

DEPT:



581J20A92/FE4A


TUE - 26 JUL 10:30A

PRIORITY OVERNIGHT

TRK# 7774 7969 5549  
0201

EB EHTA

06022  
CT-US  
BDL

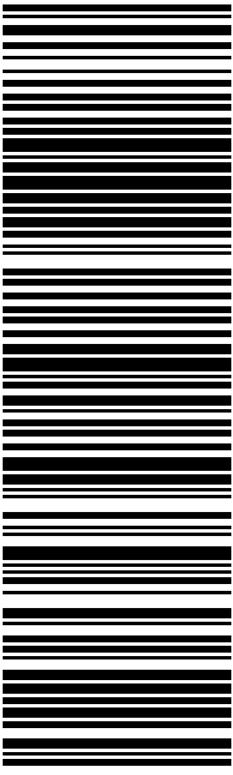

**After printing this label:**

1. Use the 'Print' button on this page to print your label to your laser or inkjet printer.
2. Fold the printed page along the horizontal line.
3. Place label in shipping pouch and affix it to your shipment so that the barcode portion of the label can be read and scanned.

**Warning:** Use only the printed original label for shipping. Using a photocopy of this label for shipping purposes is fraudulent and could result in additional billing charges, along with the cancellation of your FedEx account number.

Use of this system constitutes your agreement to the service conditions in the current FedEx Service Guide, available on [fedex.com](http://fedex.com). FedEx will not be responsible for any claim in excess of \$100 per package, whether the result of loss, damage, delay, non-delivery, misdelivery, or misinformation, unless you declare a higher value, pay an additional charge, document your actual loss and file a timely claim. Limitations found in the current FedEx Service Guide apply. Your right to recover from FedEx for any loss, including intrinsic value of the package, loss of sales, income interest, profit, attorney's fees, costs, and other forms of damage whether direct, incidental, consequential, or special is limited to the greater of \$100 or the authorized declared value. Recovery cannot exceed actual documented loss. Maximum for items of extraordinary value is \$1,000, e.g. jewelry, precious metals, negotiable instruments and other items listed in our Service Guide. Written claims must be filed within strict time limits, see current FedEx Service Guide.

Dear Customer,

The following is the proof-of-delivery for tracking number **777479695549**

---

**Delivery Information:**

---

<b>Status:</b>	Delivered	<b>Delivered To:</b>	Receptionist/Front Desk
<b>Signed for by:</b>	C.AROLE TAX	<b>Delivery Location:</b>	4 MARKET ST
<b>Service type:</b>	FedEx Priority Overnight		
<b>Special Handling:</b>	Deliver Weekday		COLLINSVILLE, CT, 06022
		<b>Delivery date:</b>	Jul 27, 2022 11:21

---

**Shipping Information:**

---


<b>Tracking number:</b>	777479695549	<b>Ship Date:</b>	Jul 26, 2022
		<b>Weight:</b>	0.5 LB/0.23 KG

**Recipient:**

Robert Bessel, First Selectman, Town of Canton  
4 Market St  
COLLINSVILLE, CT, US, 06022

**Shipper:**

Steven Volkert, General Dynamics  
145 Prospect Street  
MERCHANTVILLE, NJ, US, 08109

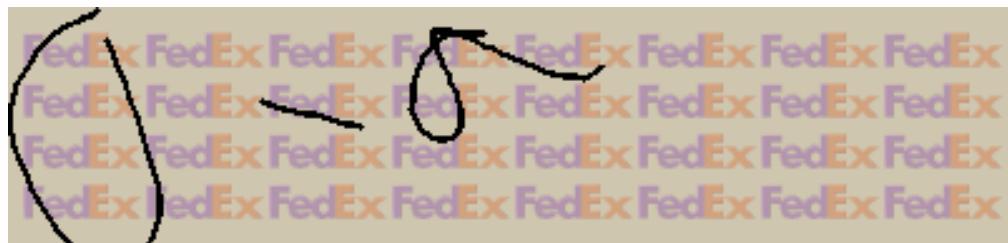

ORIGIN ID:TKAA (318) 642-6190  
STEVEN VOLKERT ACTW/GT: 0.50 LB  
GENERAL DYNAMICS CAD: 105486753/NET4490  
145 PROSPECT STREET  
MERCHANTVILLE, NJ 08109  
UNITED STATES

SHIP DATE: 26JUL22  
ACTW/GT: 0.50 LB  
CAD: 105486753/NET4490

TO NEIL PADE, AICP  
TOWN OF CANTON PLANNING  
4 MARKET STREET

BILL SENDER

**COLLINSVILLE CT 06022**



(860) 693-7891

REF:

INV:

PO:

DEPT:

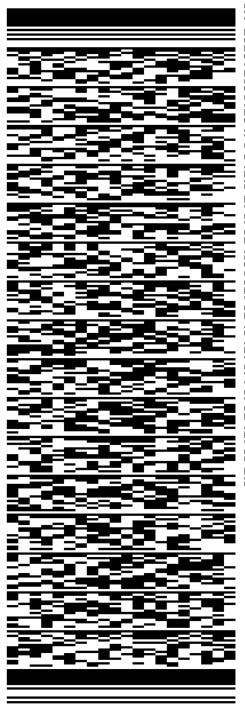

581J20A92/FE4A


WED - 27 JUL 4:30P

STANDARD OVERNIGHT

TRK# 7774 9211 3082  
0201

**EB EHTA**

06022  
CT-US  
BDL

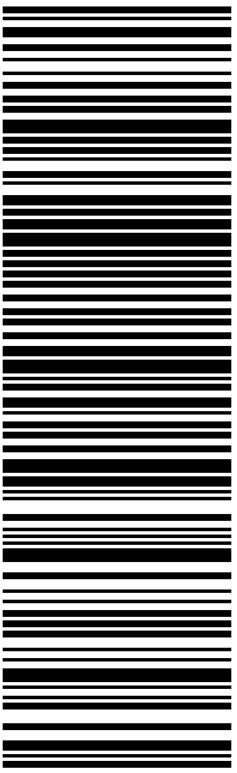

**After printing this label:**

1. Use the 'Print' button on this page to print your label to your laser or inkjet printer.
2. Fold the printed page along the horizontal line.
3. Place label in shipping pouch and affix it to your shipment so that the barcode portion of the label can be read and scanned.

/templates/components/dotcom\_label\_contents/WarningsOriginalLabel/en/Folding\_warning.html loading...  
/templates/components/dotcom\_label\_contents/TnCDom/us/en/TC\_dom.html loading...

Dear Customer,

The following is the proof-of-delivery for tracking number: 777492113082

---

**Delivery Information:**

---

<b>Status:</b>	Delivered	<b>Delivered To:</b>	Receptionist/Front Desk
<b>Signed for by:</b>	L.ISA	<b>Delivery Location:</b>	4 MARKET ST
<b>Service type:</b>	FedEx Standard Overnight		
<b>Special Handling:</b>	Deliver Weekday		COLLINSVILLE, CT, 06022
		<b>Delivery date:</b>	Jul 27, 2022 11:23

---

**Shipping Information:**

---

<b>Tracking number:</b>	777492113082	<b>Ship Date:</b>	Jul 26, 2022
		<b>Weight:</b>	0.5 LB/0.23 KG

---

**Recipient:**

Neil Pade, AICP, Town of Canton Planning  
4 Market Street  
COLLINSVILLE, CT, US, 06022

**Shipper:**

Steven Volkert, General Dynamics  
145 Prospect Street  
MERCHANTVILLE, NJ, US, 08109

