

STATE OF CONNECTICUT
CONNECTICUT SITING COUNCIL

Ten Franklin Square, New Britain, CT 06051

Phone: (860) 827-2935 Fax: (860) 827-2950

E-Mail: siting.council@ct.gov

www.ct.gov/csc

July 15, 2011

Mark Hulshart, Principal
Hulshart & Associates, LLC
3009 Federal Hill Drive
Falls Church, VA 22044

RE: **EM-SPRINT-086-110627** – Sprint Spectrum LP notice of intent to modify an existing telecommunications facility located at 71 Moxley Hill Road, Montville, Connecticut.

Dear Mr. Hulshart:

The Connecticut Siting Council (Council) hereby acknowledges your notice to modify this existing telecommunications facility, pursuant to Section 16-50j-73 of the Regulations of Connecticut State Agencies with the following conditions:

- Any deviation from the proposed modification as specified in this notice and supporting materials with Council shall render this acknowledgement invalid;
- Any material changes to this modification as proposed shall require the filing of a new notice with the Council;
- Not less than 45 days after completion of construction, the Council shall be notified in writing that construction has been completed;
- The validity of this action shall expire one year from the date of this letter; and
- The applicant may file a request for an extension of time beyond the one year deadline provided that such request is submitted to the Council not less than 60 days prior to the expiration;

The proposed modifications including the placement of all necessary equipment and shelters within the tower compound are to be implemented as specified here and in your notice dated June 22, 2011. The modifications are in compliance with the exception criteria in Section 16-50j-72 (b) of the Regulations of Connecticut State Agencies as changes to an existing facility site that would not increase tower height, extend the boundaries of the tower site, increase noise levels at the tower site boundary by six decibels, and increase the total radio frequencies electromagnetic radiation power density measured at the tower site boundary to or above the standard adopted by the State Department of Environmental Protection pursuant to General Statutes § 22a-162. This facility has also been carefully modeled to ensure that radio frequency emissions are conservatively below State and federal standards applicable to the frequencies now used on this tower.

This decision is under the exclusive jurisdiction of the Council. Please be advised that the validity of this action shall expire one year from the date of this letter. Any additional change to this facility will require explicit notice to this agency pursuant to Regulations of Connecticut State Agencies Section 16-50j-73. Such notice shall include all relevant information regarding the proposed change with cumulative worst-case modeling of radio frequency exposure at the closest point of uncontrolled access to the tower base, consistent with Federal Communications Commission, Office of Engineering and Technology, Bulletin 65. Thank you for your attention and cooperation.

Very truly yours,


Linda Roberts
Executive Director

LR/CDM/laf

c: The Honorable Joseph W. Jaskiewicz, Mayor, Town of Montville
Marcia Vlaun, Town Planner, Town of Montville
SBA Inc.



June 22, 2011

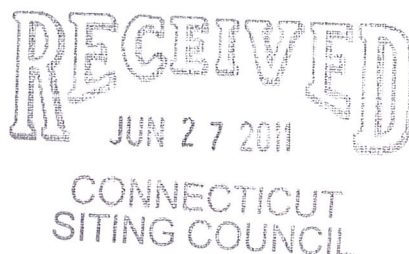

Chairman Robert Stein
Connecticut Siting Council
10 Franklin Square
New Britain, CT 06051

SUBJECT: Sprint Spectrum L.P.'s Notice of Intent to Make an Exempt Modification to an Existing Facility at 71 Moxley Hill Road, Montville, CT 06353 (Site # CT23XC400)

Dear Chairman Stein:

Pursuant to R.C.S.A. Sections 16-50j-73 and 16-50j-72(b), Sprint Spectrum L.P. (Sprint) hereby gives notice to the Connecticut Siting Council (Council) and the Town of Montville of its intent to make an exempt modification to an existing telecommunications facility located at 71 Moxley Hill Road, Montville, Connecticut.

Sprint plans to install a hydrogen fuel cell at its 71 Moxley Hill Road facility to provide emergency backup power in the event of an electric outage. This planned installation does not constitute a modification subject to the Council's review as it falls within those activities provided for in R.C.S.A. Section 16-50j-72(b)(2). Specifically, this installation will not change the height of the existing tower, will not extend the boundaries of the existing compound, will not increase noise levels at the site by six decibels or more, and will not increase the total radio frequency electromagnetic radiation power density at the site to levels above applicable standards.

PROPOSED INSTALLATION

Sprint plans to install a 5 kW Alteryg hydrogen fuel cell generator within the existing fenced equipment compound; the installation mounted to an existing concrete pad. The fuel cell will be inside a cabinet measuring 3'4" x 2'4" x 6'0". The hydrogen cylinder storage cabinet has overall dimensions of 4'8" x 4'8" x 6'0".

Please contact me at 703.533.1006 or Hulshart@earthlink.net should you have any questions about this planned modification.

Sincerely,

A handwritten signature in blue ink, appearing to read "Mark Hulshart". The signature is written in a cursive style with a long horizontal stroke extending to the right.

Mark Hulshart
Principal

cc: Mayor Joseph W. Jaskiewicz, Town of Montville
Ernest Wainwright & Walter Wainwright Jr. (property owner)

Specifications



Allergy Freedom Power™ 5 kW System installed in an FPS Power Cabinet		FPS-524-240	FPS-524-240-400	FPS-548-240	FPS-548-240-405
Physical	Dimensions (w x d x h)	26" x 42" x 72" [66 cm x 107 cm x 183 cm]			
	Weight	515 lb [234 kg]	706 lb [320 kg]	515 lb [234 kg]	706 lb [320 kg]
	Number of FPS Engines	1			
	Number of TPMs	0	1	0	1
Performance	Rated power	5 kW			
	Rated current	210 A		105 A	
	Operating voltage (nominal) ¹	24 VDC		48 VDC	
	Operating voltage (range) ¹	21 to 29 VDC		42 to 58 VDC	
	Standing Input Current (nominal)	1.92 A @ 24 VDC		0.96 A @ 48 VDC	
Operation	Ambient temperature ²	- 4 °F to 104 °F [- 20 °C to +40 °C]			
	Relative humidity, noncondensing	5 to 100%			
	Location	Outdoor only			
	Auxiliary AC in ²	120 V, 60 Hz, 10 A, single phase			
Storage	Ambient temperature	+ 40 °F to +113 °F [+4 °C to +45 °C]			
	Relative humidity, noncondensing	5 to 100%			
Fuel	Gaseous hydrogen purity	Hydrogen (H ₂) 99.95% certified Industrial Grade			
	Supply pressure range	40 to 150 PSIG [2.8 to 10.5 kg/cm ²]			
	Typical operating pressure	100 PSIG [7.03 kg/cm ²]			
	Consumption	300 g/hour @ 5 kW			
Monitoring / Control	Standard	Ethernet, USB, Serial, 4 Dry Contacts			
	Optional	Wireless Telemetry			
	Rectifier Supply Voltage	n/a	27.0 ± 0.6 VDC	n/a	54.0 ± 0.6 VDC

¹Polarity is determined by customer requirements and ground connections.

²For operation below +10 °C, the FPS must be connected to the grid and supplied with AC power until a grid failure, at which time the heat generated by the FPS will be sufficient to maintain operation of the FPS at temperatures between -20 °C and +10 °C.



SITE NAME: MONTVILLE S.
 SITE NUMBER: CT23XC400
 SITE ADDRESS: 71 MOXLEY HILL ROAD
 MONTVILLE, CT 06353
 SITE TYPE: EXISTING 190'-0" GUYED TOWER



6580 SPRINT PARKWAY
 OVERLAND PARK, KANSAS 66251



BLACK & VEATCH

10950 GRANDVIEW DRIVE
 OVERLAND PARK, KANSAS 66210
 (913) 458-2000

PROJECT NO: 168202
 DRAWN BY: AKJ
 CHECKED BY: BJH

SITE INFORMATION

SITE ADDRESS:
 71 MOXLEY HILL ROAD
 MONTVILLE, CT 06353

PROPERTY OWNER:
 SBA TOWERS II, LLC
 5900 BROKEN SOUND PARKWAY NW
 BOCA RATON, FL 33487

SEAN SHINNEN
 610-322-0059

EQUIPMENT SUPPLIER:
 Relion
 15913 EAST EUCLID AVENUE
 SPOKANE, WASHINGTON 99216

DARIN PAINTER
 DIRECTOR OF SALES
 OFFICE: 913-766-4256 MOBILE: 913-486-2550
 dpainter@relion-inc.com

POWER COMPANY:
 CONNECTICUT LIGHT & POWER
 PHONE: 800-286-5000

TELCO COMPANY:
 NA


COUNTY:
 NEW LONDON

LATITUDE (NAD83):
 41° 26' 7.555" N
 41.435432


LONGITUDE (NAD83):
 72° 7' 26.043" W
 -72.123901

CONTACT ENGINEER:
 BRYAN HANSEN
 WORK: 913-458-7343
 E-MAIL: hansenbj@bv.com

AREA MAP

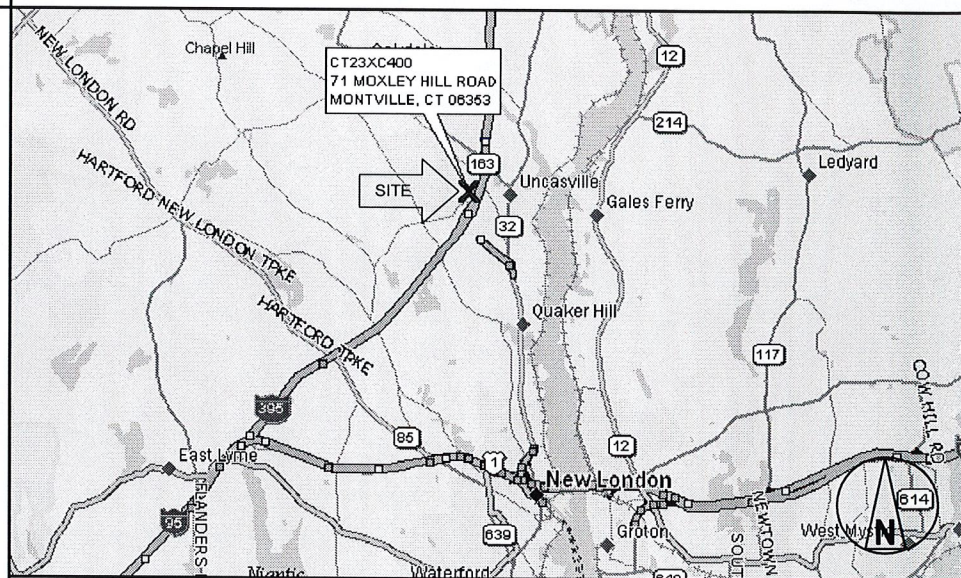

LOCATION MAP

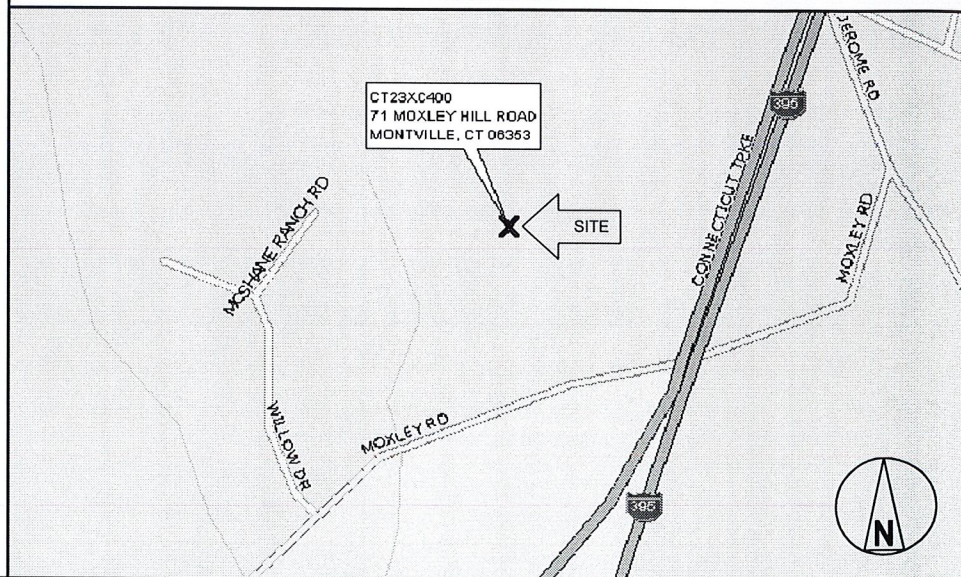

APPLICABLE CODES

ALL WORK SHALL COMPLY WITH THE FOLLOWING APPLICABLE CODES:

2003 INTERNATIONAL BUILDING CODE WITH 2005 STATE OF CONNECTICUT AMENDMENTS

2003 INTERNATIONAL MECHANICAL CODE WITH 2005 STATE OF CONNECTICUT AMENDMENTS

2003 INTERNATIONAL PLUMBING CODE WITH 2005 STATE OF CONNECTICUT AMENDMENTS

2005 NEC NATIONAL ELECTRICAL CODE

IN THE EVENT OF CONFLICT, THE MOST RESTRICTIVE CODE SHALL PREVAIL


PROJECT DESCRIPTION

INSTALL POWER BACK UP EQUIPMENT TO EXISTING SITE WITHIN EXISTING COMPOUND. INSTALL (1) NEW FUEL CELL WITH (1) FUEL STORAGE CABINET ON CONCRETE PAD AND CONNECT TO THE SITE'S DC POWER PLANT BUS.

DRAWING INDEX

T-1	TITLE SHEET & PROJECT DATA
C-1	OVERALL SITE PLAN
C-2	SITE PLAN
S-1	EQUIPMENT CABINET DETAILS
S-2	CONCRETE PAD DETAILS
M-1	HYDROGEN PIPING SCHEMATIC
E-1	ELECTRICAL ONE-LINE DIAGRAM
E-2	OVERALL CONDUIT DETAILS
E-3	ELECTRICAL WIRING DIAGRAM
E-4	FUEL CELL INSTALL DETAIL
G-1	GROUNDING PLAN AND DETAILS

REV	DATE	DESCRIPTION
0	6/7/2011	ISSUED FOR CONSTRUCTION

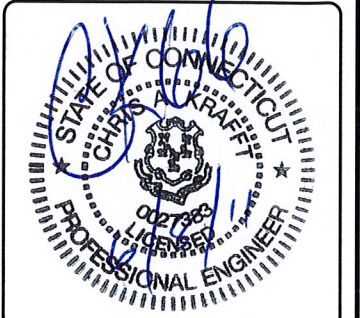

IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

ENGINEER OF RECORD

CHRISTOPHER ALAN KRAFFT
 PE # 0027383
 BLACK & VEATCH CORPORATION

MONTVILLE S.
CT23XC400
71 MOXLEY HILL ROAD
MONTVILLE, CT 06353
CO-LOCATION

DRIVING DIRECTIONS FROM NEAREST AIRPORT

GROTON-NEW LONDON AIRPORT: HEAD WEST ON S ROAD/RUNWAY LANE/TOWER AVENUE TOWARDS RHODE ISLAND LANE, TURN RIGHT AT HIGH ROCK ROAD, TURN LEFT AT POQUONNOCK ROAD, TURN RIGHT AT MITCHELL STREET, CONTINUE ONTO NORTH STREET, TAKE THE RAMP ONTO I-95 S, TAKE THE EXIT TOWARDS CT-32 N, TAKE EXIT 84 E TO MERGE ONTO CT-32 N TOWARDS NORWICH, TURN LEFT AT MAPLE ROAD, CONTINUE ONTO JEROME ROAD, TURN LEFT AT MOXLEY ROAD, DESTINATION WILL BE ON THE RIGHT.

SHEET TITLE
TITLE SHEET & PROJECT DATA

SHEET NUMBER
T-1



6580 SPRINT PARKWAY
OVERLAND PARK, KANSAS 66251



BLACK & VEATCH


10950 GRANDVIEW DRIVE
OVERLAND PARK, KANSAS 66210
(913) 458-2000

PROJECT NO: 168202

DRAWN BY: AKJ

CHECKED BY: MB

REV	DATE	DESCRIPTION
0	6/7/2011	ISSUED FOR CONSTRUCTION

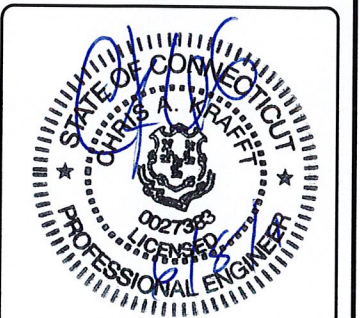

IT IS A VIOLATION OF LAW FOR ANY PERSON,
UNLESS THEY ARE ACTING UNDER THE
DIRECTION OF A LICENSED PROFESSIONAL
ENGINEER, TO ALTER THIS DOCUMENT.

MONTVILLE S.
CT23XC400
71 MOXLEY HILL ROAD
MONTVILLE, CT 06353
CO-LOCATION

SHEET TITLE

**OVERALL
SITE PLAN**


SHEET NUMBER

C-1




OVERALL SITE PLAN
NO SCALE



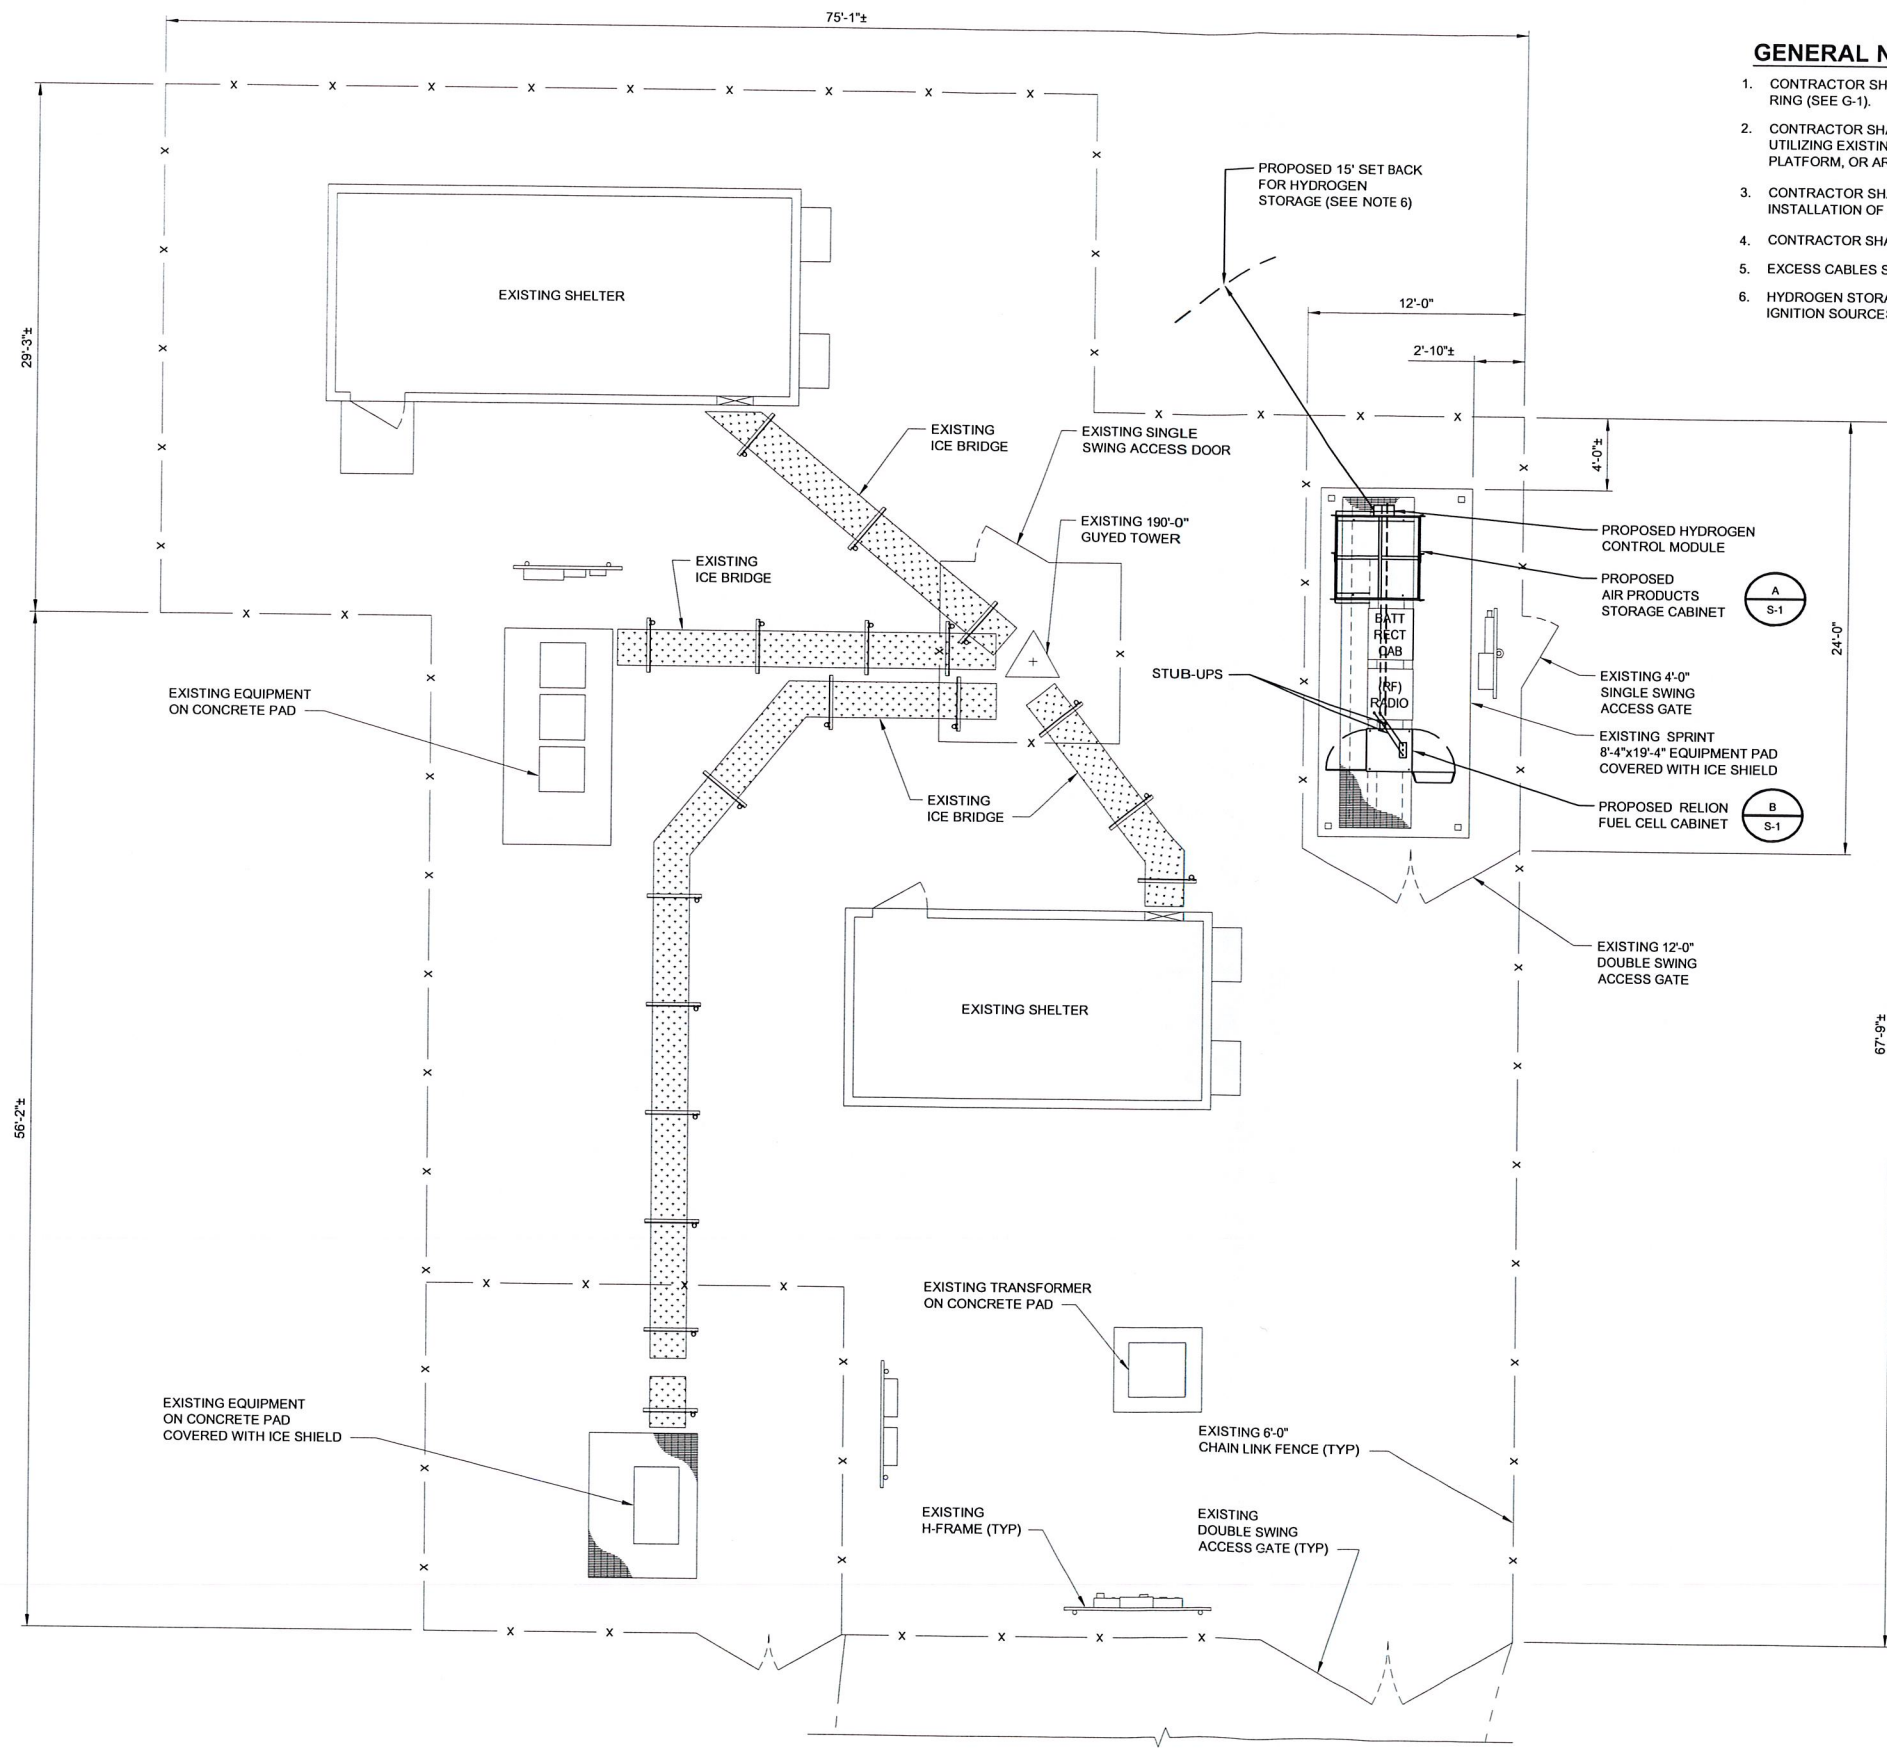

- GENERAL NOTES:**
1. CONTRACTOR SHALL GROUND ALL NEW EQUIPMENT TO THE NEAREST GROUND RING (SEE G-1).
 2. CONTRACTOR SHALL ROUTE CONDUIT TO AVOID TRIP HAZARDS BY EITHER UTILIZING EXISTING CABLE TRAY, OVERHEAD ICE BRIDGE, UNDERNEATH RAISED PLATFORM, OR AROUND EDGE OF CONCRETE PAD.
 3. CONTRACTOR SHALL FOLLOW ALL MANUFACTURER'S RECOMMENDATIONS FOR INSTALLATION OF ALL NEW EQUIPMENT.
 4. CONTRACTOR SHALL VERIFY THE ALARM CABLES ARE OF SUFFICIENT LENGTH.
 5. EXCESS CABLES SHALL BE LACED IN A NEAT AND ORGANIZED MANNER.
 6. HYDROGEN STORAGE CABINET HAS A REQUIRED SET BACK OF 15' FROM IGNITION SOURCES & AIR INTAKES.

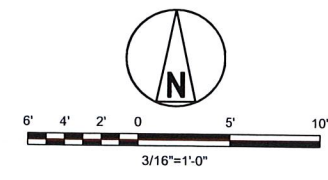


SITE PLAN

6580 SPRINT PARKWAY
OVERLAND PARK, KANSAS 66251

10950 GRANDVIEW DRIVE
OVERLAND PARK, KANSAS 66210
(913) 458-2000

PROJECT NO:	168202
DRAWN BY:	AKJ
CHECKED BY:	MB

REV	DATE	DESCRIPTION
0	6/7/2011	ISSUED FOR CONSTRUCTION

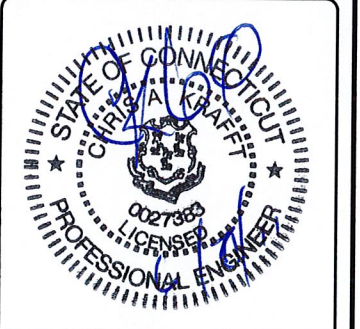


IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.


**MONTVILLE S.
CT23XC400
71 MOXLEY HILL ROAD
MONTVILLE, CT 06353
CO-LOCATION**

SHEET TITLE
SITE PLAN


SHEET NUMBER
C-2

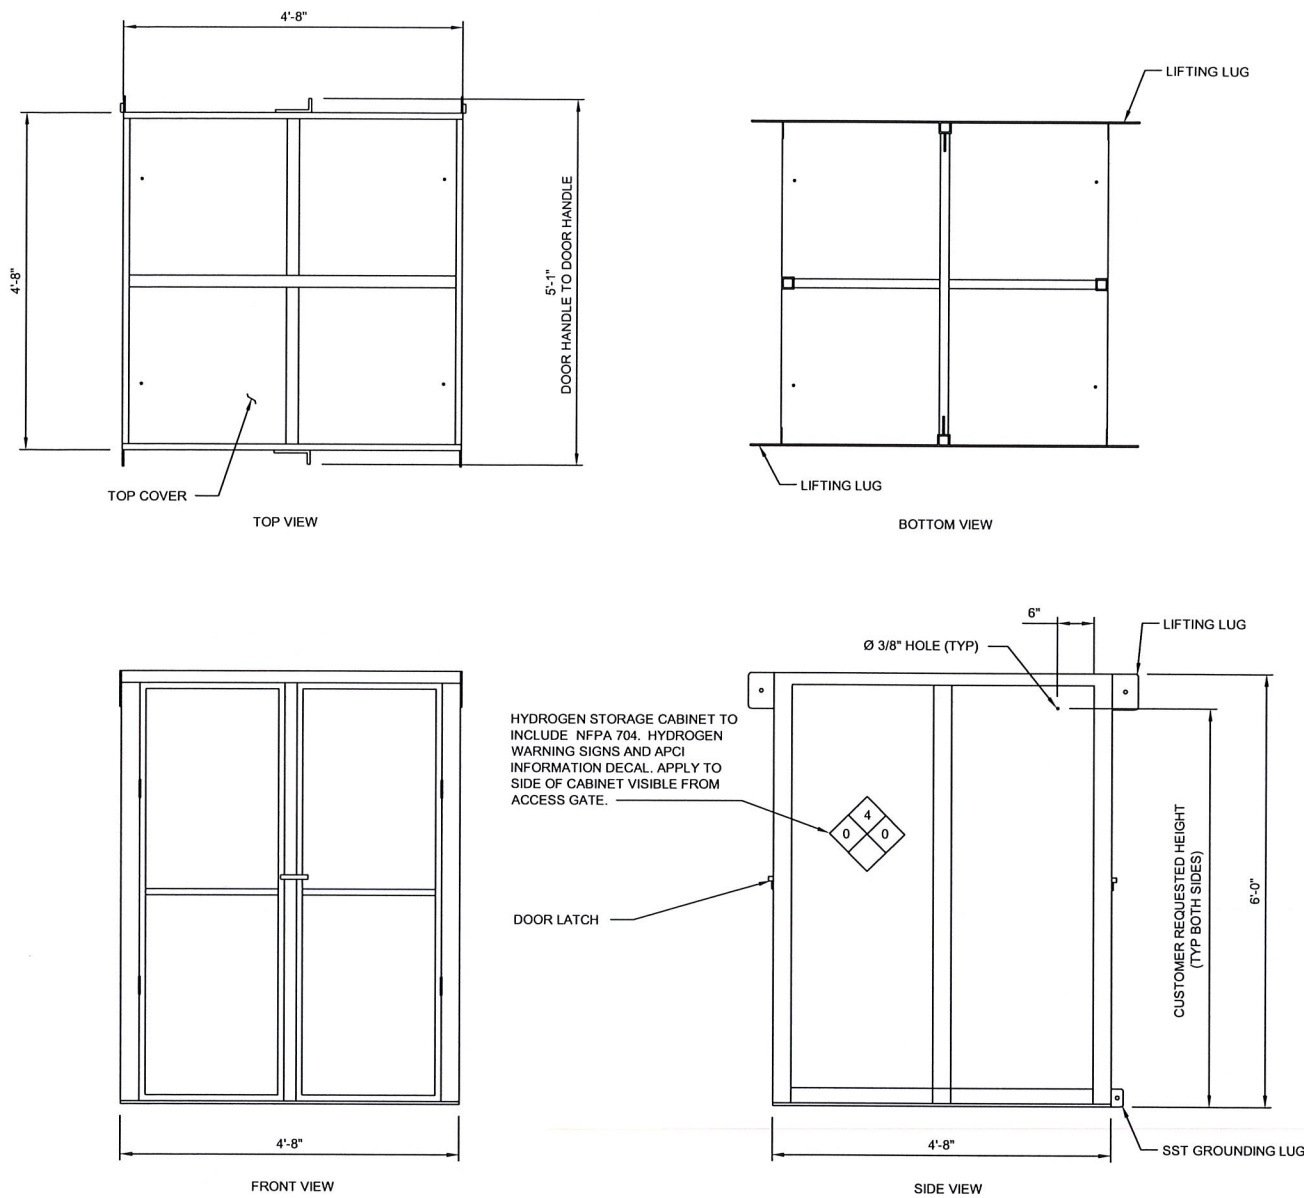

DETAIL A
HYDROGEN STORAGE CABINET
 SCALE: 3/4" = 1'-0"

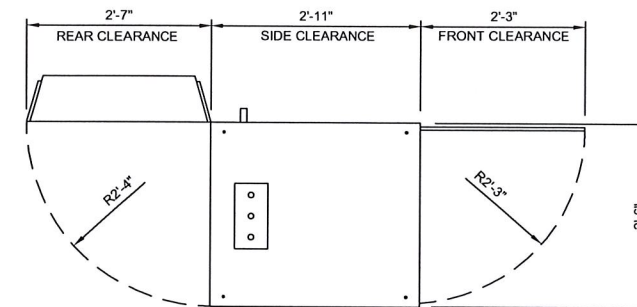

TOP VIEW CLEARANCE
 (DOOR OPEN)

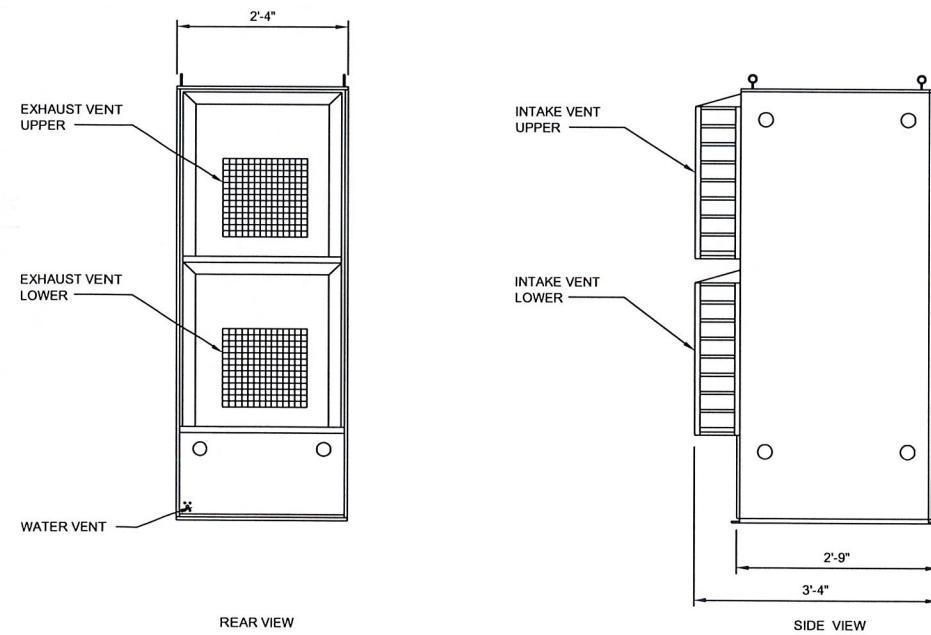

DETAIL B
FUEL CELL CABINET
 SCALE: 3/4" = 1'-0"



6580 SPRINT PARKWAY
 OVERLAND PARK, KANSAS 66251




BLACK & VEATCH

10950 GRANDVIEW DRIVE
 OVERLAND PARK, KANSAS 66210
 (913) 458-2000

PROJECT NO:	168202
DRAWN BY:	AKJ
CHECKED BY:	MB

REV	DATE	DESCRIPTION
0	6/7/2011	ISSUED FOR CONSTRUCTION

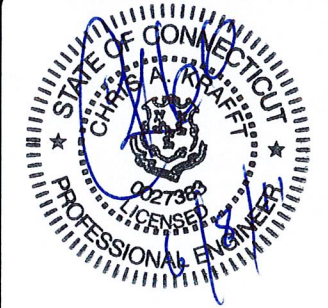


IT IS A VIOLATION OF LAW FOR ANY PERSON,
 UNLESS THEY ARE ACTING UNDER THE
 DIRECTION OF A LICENSED PROFESSIONAL
 ENGINEER, TO ALTER THIS DOCUMENT.

MONTVILLE S.
CT23XC400
71 MOXLEY HILL ROAD
MONTVILLE, CT 06353
CO-LOCATION


SHEET TITLE
**EQUIPMENT CABINET
 DETAILS**

SHEET NUMBER
S-1

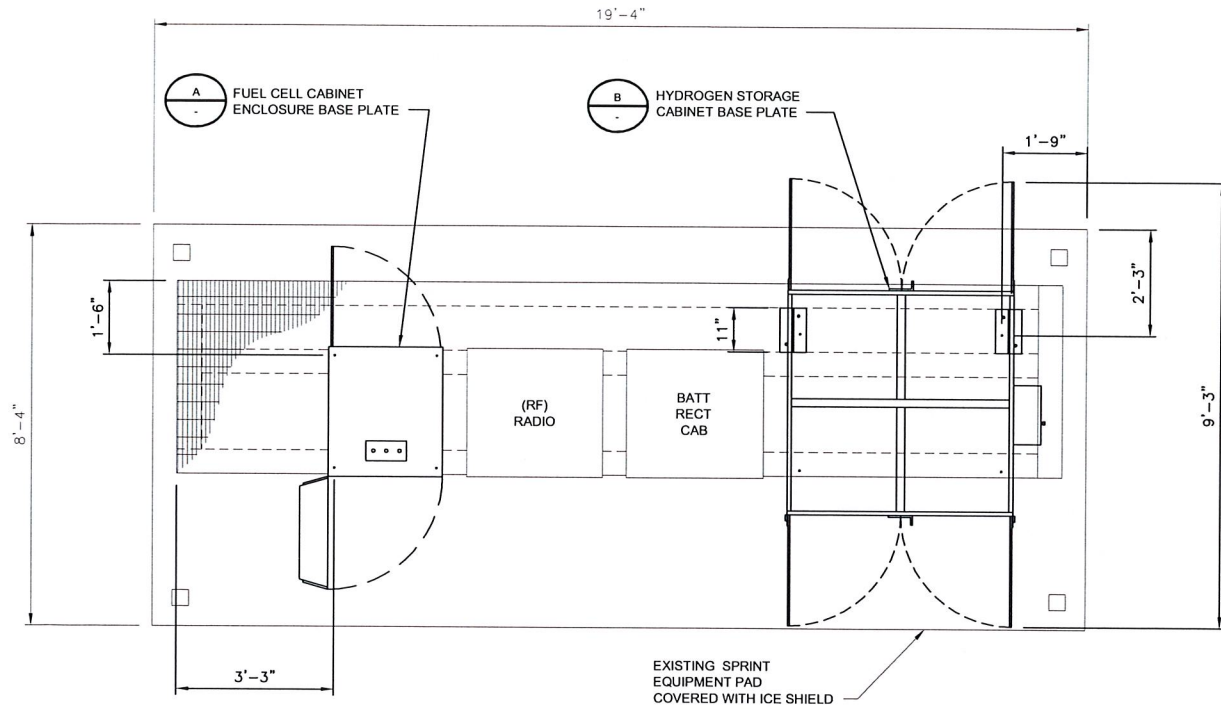


PLAN VIEW CONCRETE PAD

SCALE: 3/4" = 1'-0"

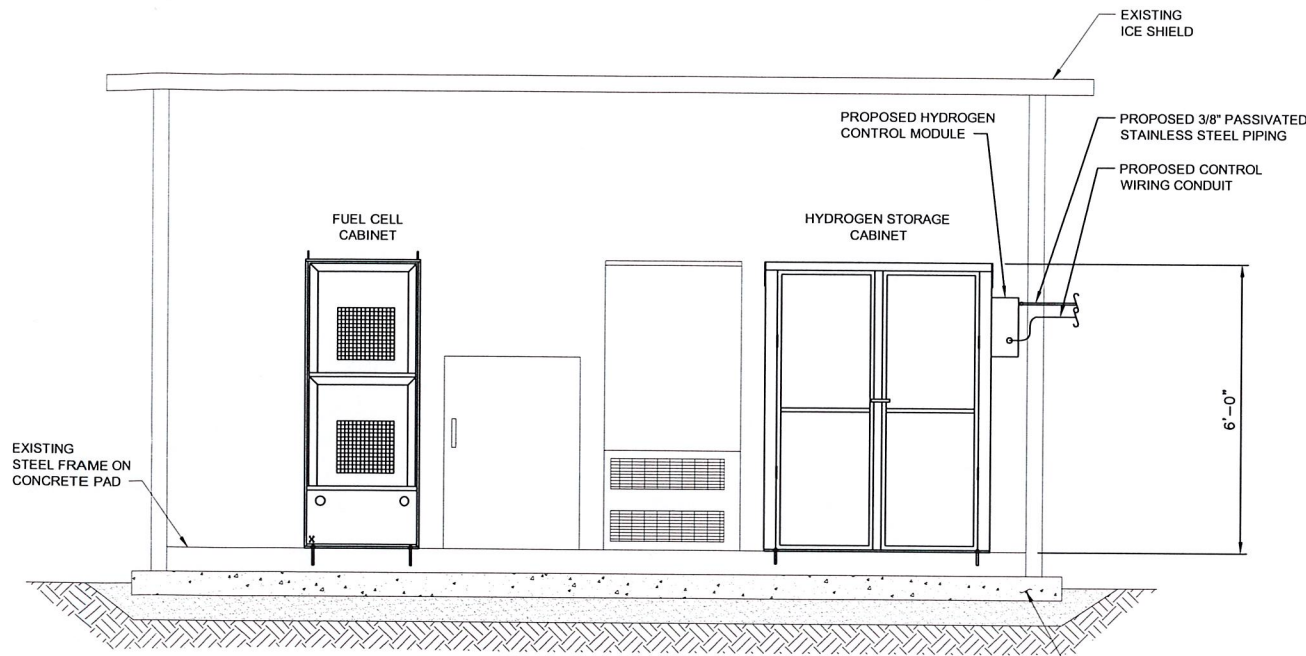


ELEVATION CONCRETE PAD

SCALE: 3/4" = 1'-0"

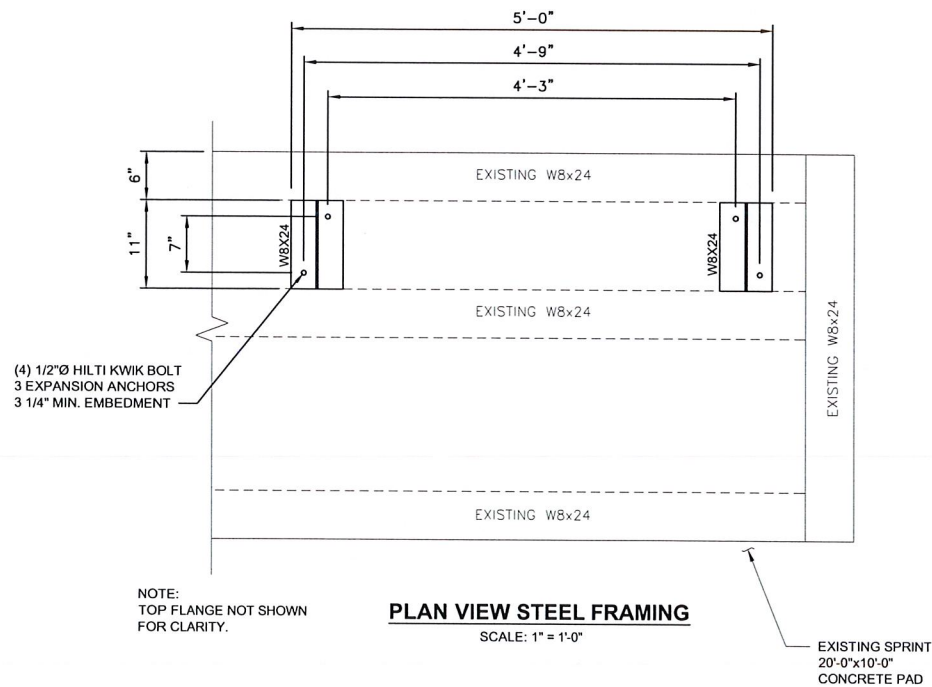


PLAN VIEW STEEL FRAMING

SCALE: 1" = 1'-0"

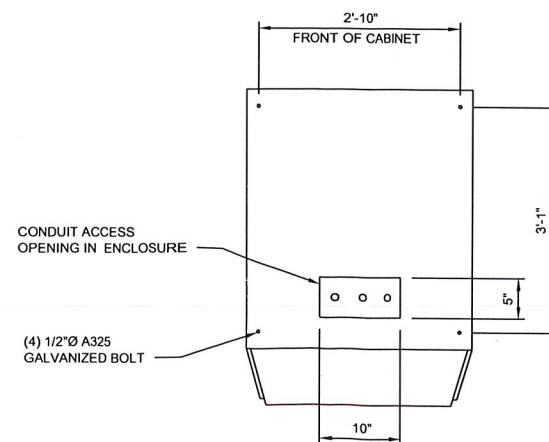

**DETAIL A
CABINET
BOLT PATTERN**

SCALE: 1" = 1'-0"

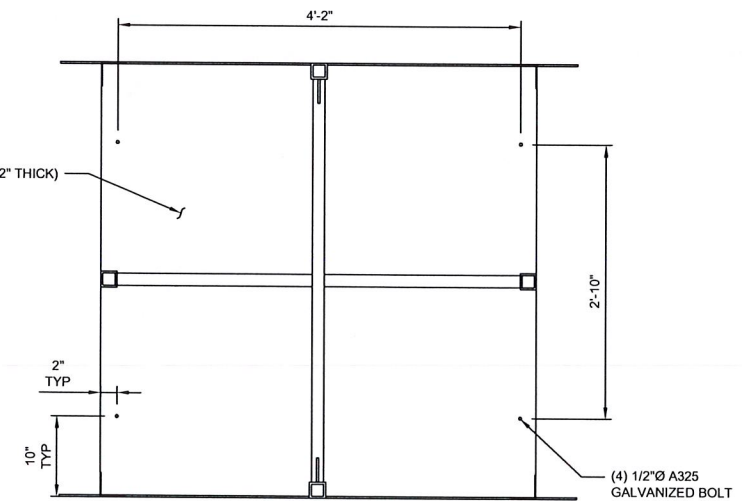

**DETAIL B
HYDROGEN STORAGE CABINET
BOLT PATTERN**

SCALE: 1" = 1'-0"



6580 SPRINT PARKWAY
OVERLAND PARK, KANSAS 66251



BLACK & VEATCH


10950 GRANDVIEW DRIVE
OVERLAND PARK, KANSAS 66210
(913) 458-2000

PROJECT NO: 168202

DRAWN BY: AKJ

CHECKED BY: MB

REV	DATE	DESCRIPTION
0	6/7/2011	ISSUED FOR CONSTRUCTION

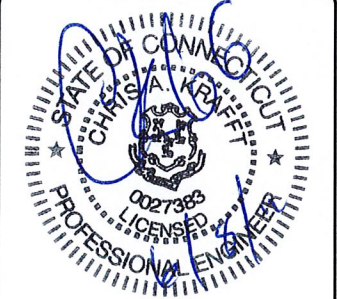

IT IS A VIOLATION OF LAW FOR ANY PERSON,
UNLESS THEY ARE ACTING UNDER THE
DIRECTION OF A LICENSED PROFESSIONAL
ENGINEER, TO ALTER THIS DOCUMENT.

**MONTVILLE S.
CT23XC400
71 MOXLEY HILL ROAD
MONTVILLE, CT 06353
CO-LOCATION**

SHEET TITLE
CONCRETE PAD DETAILS

SHEET NUMBER
S-2



6580 SPRINT PARKWAY
OVERLAND PARK, KANSAS 66251



BLACK & VEATCH



10950 GRANDVIEW DRIVE
OVERLAND PARK, KANSAS 66210
(913) 458-2000

PROJECT NO: 168202

DRAWN BY: AKJ

CHECKED BY: MB

REV	DATE	DESCRIPTION
0	6/7/2011	ISSUED FOR CONSTRUCTION

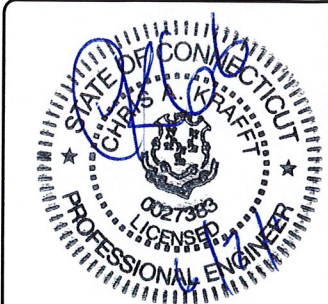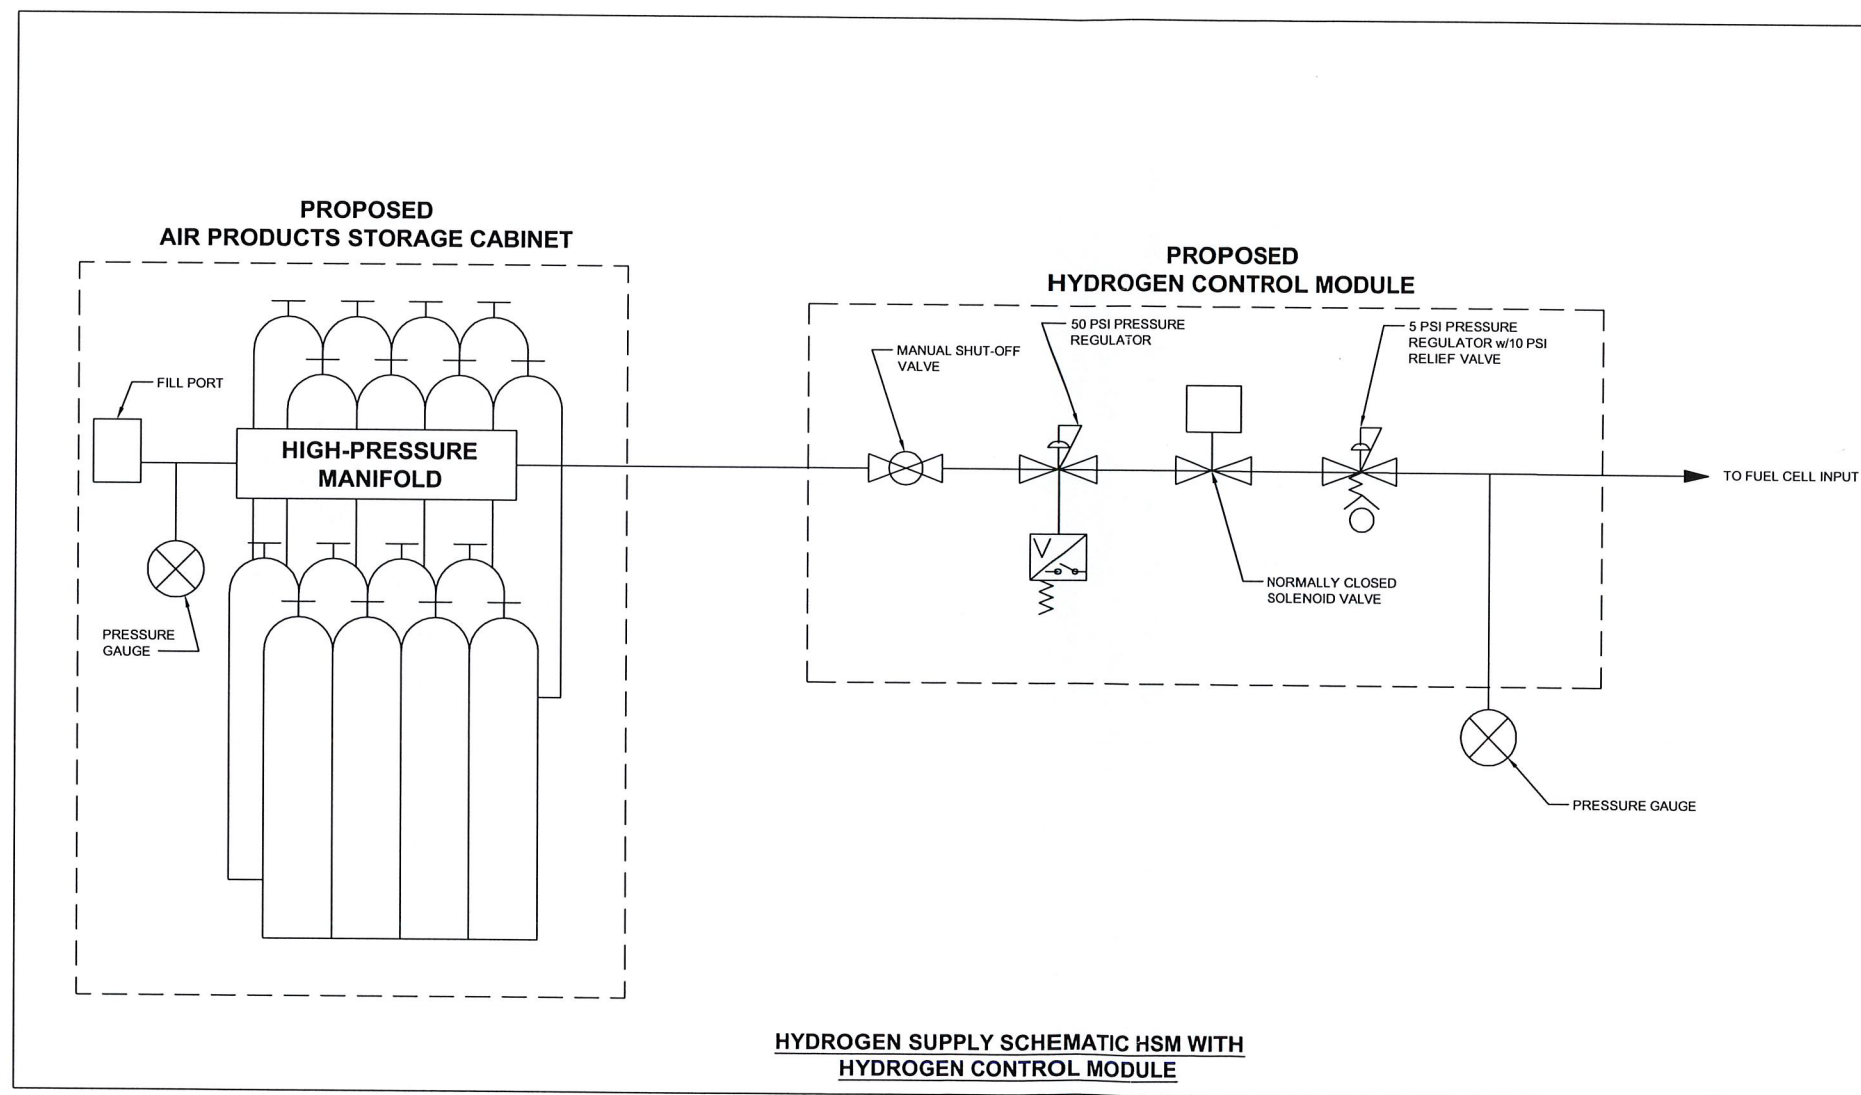


IT IS A VIOLATION OF LAW FOR ANY PERSON,
UNLESS THEY ARE ACTING UNDER THE
DIRECTION OF A LICENSED PROFESSIONAL
ENGINEER, TO ALTER THIS DOCUMENT.

**MONTVILLE S.
CT23XC400
71 MOXLEY HILL ROAD
MONTVILLE, CT 06353
CO-LOCATION**

SHEET TITLE
**HYDROGEN PIPING
SCHEMATIC**

SHEET NUMBER
M-1

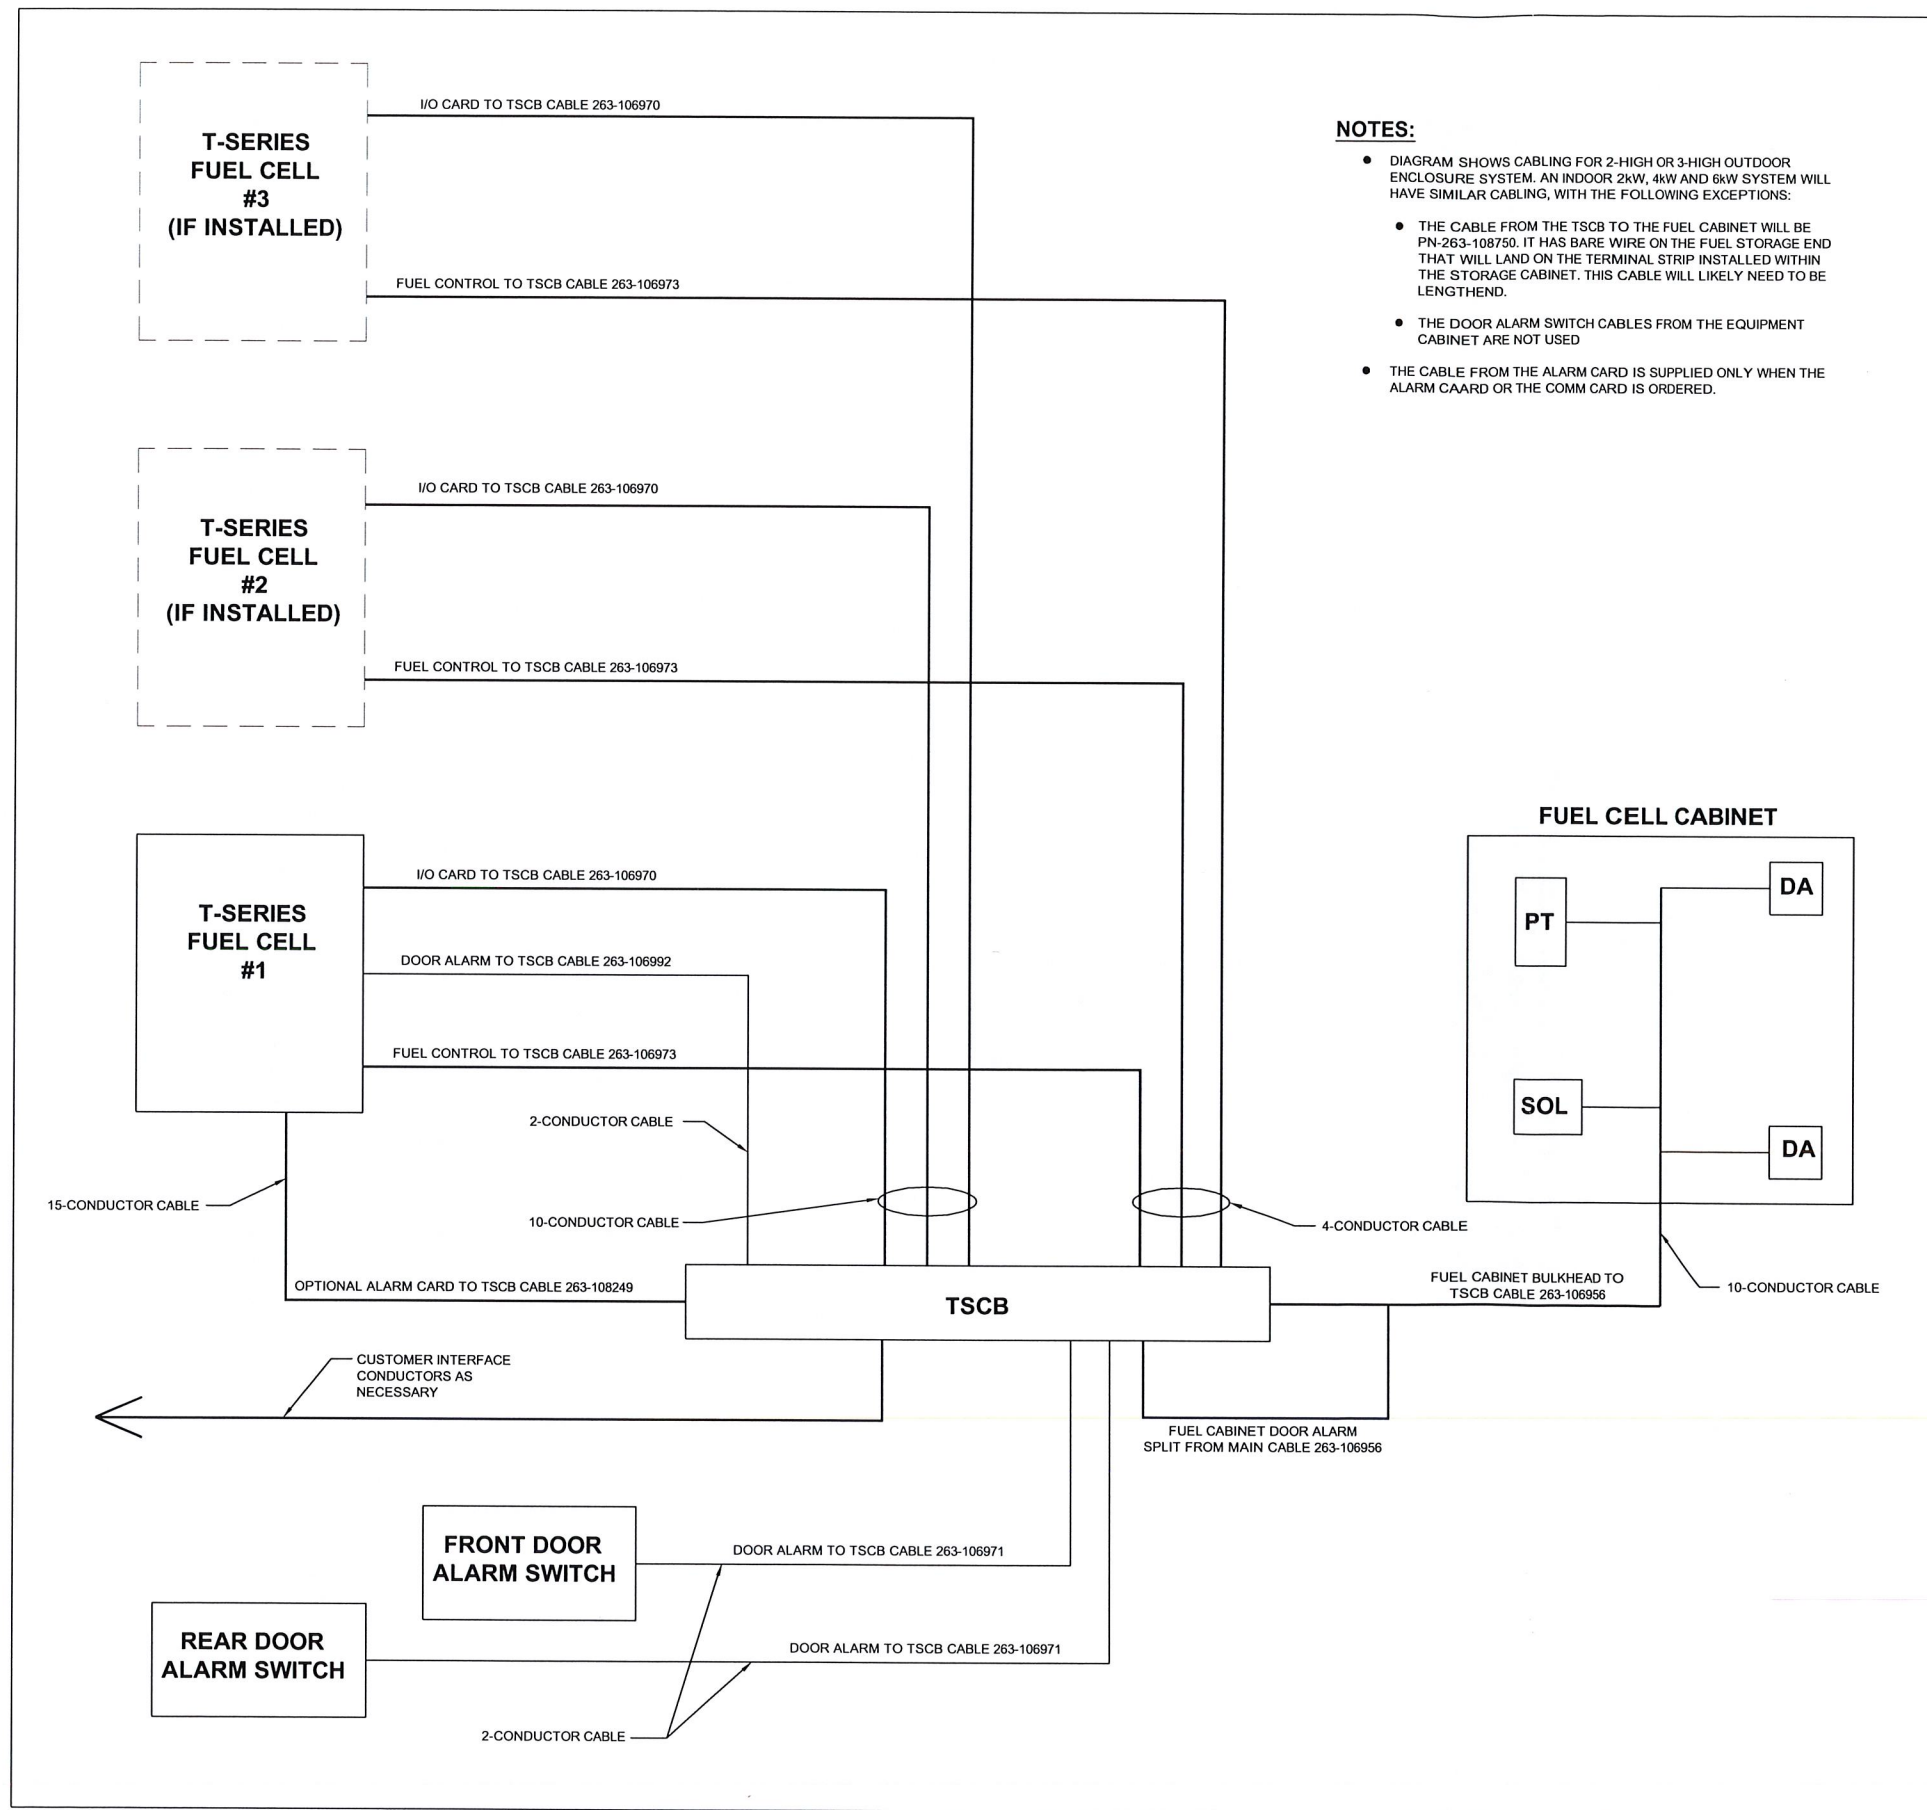

NOTES:

- DIAGRAM SHOWS CABLING FOR 2-HIGH OR 3-HIGH OUTDOOR ENCLOSURE SYSTEM. AN INDOOR 2kW, 4kW AND 6kW SYSTEM WILL HAVE SIMILAR CABLING, WITH THE FOLLOWING EXCEPTIONS:
- THE CABLE FROM THE TSCB TO THE FUEL CABINET WILL BE PN-263-108750. IT HAS BARE WIRE ON THE FUEL STORAGE END THAT WILL LAND ON THE TERMINAL STRIP INSTALLED WITHIN THE STORAGE CABINET. THIS CABLE WILL LIKELY NEED TO BE LENGTHEND.
- THE DOOR ALARM SWITCH CABLES FROM THE EQUIPMENT CABINET ARE NOT USED
- THE CABLE FROM THE ALARM CARD IS SUPPLIED ONLY WHEN THE ALARM CAARD OR THE COMM CARD IS ORDERED.

GENERAL ELECTRICAL NOTES:

1. ALL ELECTRICAL WORK SHALL CONFORM TO THE LATEST EDITION OF THE NATIONAL ELECTRICAL CODE (NEC), AND LOCAL CODES.
2. ALL ELECTRICAL MATERIALS, EQUIPMENT AND INSTALLATION PROCEDURES SHALL CONFORM WITH SPRINT'S STANDARD CONSTRUCTION SPECIFICATIONS.
3. ALL MATERIALS SHALL BE MANUFACTURED IN ACCORDANCE WITH APPLICABLE STANDARDS ESTABLISHED BY ANSI, NEMA NFPA, AND "UL" LISTED.
4. THE ELECTRICAL PLANS, DETAILS, AND DIAGRAMS SHOWN ON THESE DRAWINGS ARE DIAGRAMMATIC ONLY. ACTUAL FIELD CONDITIONS AND SITE REQUIREMENTS SHALL DICTATE THE AMOUNT AND LOCATION OF EQUIPMENT.
5. THE ENTIRE ELECTRICAL INSTALLATION SHALL BE GROUNDED AS REQUIRED BY THE NEC AND ALL APPLICABLE LOCAL CODES.
6. ALL CIRCUIT BREAKERS, FUSES AND ELECTRICAL EQUIPMENT SHALL HAVE A MINIMUM INTERRUPTING RATING OF 65,000 AIC (UNLESS NOTED OTHERWISE).
7. REFER TO THE VENDOR DRAWINGS OF THE PPC CABINET, BATTERY, AND BTS CABINETS FOR COMPLETE INTERNAL WIRING AND ARRANGEMENT.
8. PATCH, REPAIR AND PAINT ANY AREA THAT HAS BEEN DAMAGED IN THE COURSE OF THE ELECTRICAL INSTALLATION.
9. LABEL ALL ELECTRICAL EQUIPMENT PER SPRINT'S SPECIFICATIONS.
10. ALL SINGLE-PHASE SELF-CONTAINED METER CONNECTION DEVICES MUST INCLUDE HORN TYPE BYPASS PROVISIONS SO THAT SERVICE WILL NOT BE INTERRUPTED WHEN A METER IS REMOVED FROM THE SOCKET.
11. USE METER CONNECTION DEVICES LABELED BY THE MANUFACTURER WITH THE LETTERS "CECHA".
12. ALL INTERIOR CONDUITS AND BUSHINGS SHALL BE EMT. ALL EXTERIOR SHALL BE PVC UNLESS NOTED OTHERWISE (SEE SPRINT'S STANDARD CONSTRUCTION SPECIFICATIONS).
13. PROVIDE 2 PULL STRINGS SECURELY FASTENED AT EACH END OF ALL CONDUITS. THE PULL STRINGS ARE TO BE 200 LB. TEST POLYETHYLENE CORD. PROVIDE CAP ON THE END OF EACH CONDUIT AND MARK AS SHOWN ON THIS SITE PLAN.
14. THE CONTRACTOR SHALL LOCATE AND MARK ALL EXISTING UNDERGROUND POWER, TELCO, GROUNDING CONDUITS, AND ALL OTHER UTILITIES EASEMENTS AND/OR WIRES PRIOR TO TRENCHING. ANY DAMAGE CAUSED TO THE EXISTING UNDERGROUND SERVICES OR SYSTEMS SHALL BE REPAIRED AT THE CONTRACTOR'S EXPENSE. VERIFY WITH UTILITY NEW SERVICE HAS BEEN APPLIED FOR. THERE SHALL BE NO SPLICING OF GROUND CONDUCTORS BELOW GRADE.
15. UTILITY RACK AND CONDUIT SIZES TO BE FIELD DETERMINED BY CONTRACTOR IN ACCORDANCE WITH THE LOCAL JURISDICTION.
16. ALL WORK SHALL MEET OR EXCEED ALL APPLICABLE LOCAL AND NATIONAL ELECTRICAL CODE REQUIREMENTS.
17. ALL INSTALLATION AND EQUIPMENT SHALL MEET OR EXCEED SPRINT CONSTRUCTION SPECIFICATIONS.

ELECTRICAL NOTES:

1. LIGHT SHADED LINES INDICATE EXISTING CONSTRUCTION.
2. CONTRACTOR TO VERIFY POWERWAVE MODEL AND ASSOCIATED POWER REQUIREMENTS. IF LARGER CIRCUIT BREAKERS ARE REQUIRED, CONTRACTOR SHALL PROVIDE CORRECT ELECTRICAL CONDUCTOR SIZES.



6580 SPRINT PARKWAY
OVERLAND PARK, KANSAS 66251




BLACK & VEATCH

10950 GRANDVIEW DRIVE
OVERLAND PARK, KANSAS 66210
(913) 458-2000

PROJECT NO:	168202
DRAWN BY:	AKJ
CHECKED BY:	MB

REV	DATE	DESCRIPTION
0	6/7/2011	ISSUED FOR CONSTRUCTION

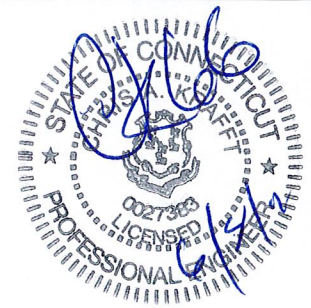


IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

**MONTVILLE S.
CT23XC400
71 MOXLEY HILL ROAD
MONTVILLE, CT 06353
CO-LOCATION**


SHEET TITLE
**ELECTRICAL ONE-LINE
DIAGRAM**

SHEET NUMBER
E-1

T-SERIES SIGNAL INTERCONNECT DIAGRAM

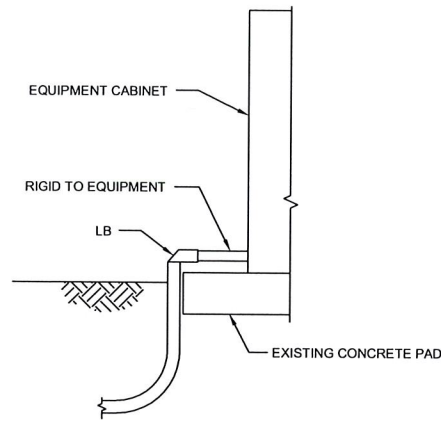

DETAIL A
STUB UP DETAIL
NO SCALE

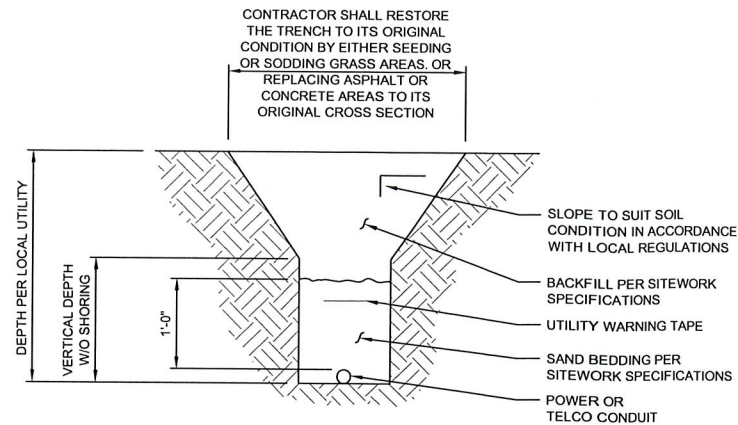

TYPICAL UTILITY
TRENCH DETAIL
NO SCALE

* ONE CALL*
SERVICE SHALL BE
CALLED PRIOR TO
EXCAVATION

GENERAL NOTES:

1. MATERIALS: ALL HANGERS, SUPPORTS, FASTENERS AND HARDWARE SHALL BE ZINC COATED OR OF EQUIVALENT CORROSION RESISTANCE BY TREATMENT OR INHERENT PROPERTY, AND SHALL BE MANUFACTURED PRODUCTS DESIGNED FOR THE APPLICATION. PRODUCTS FOR OUTDOOR USE SHALL BE HOT DIP GALVANIZED.
2. CONDUIT SEALS: INSTALL CONDUIT SEAL FOR EACH CONDUIT PENETRATING AN EXTERIOR BUILDING WALL BELOW GRADE (UNLESS PENETRATION IS BELOW LOWEST BUILDING FLOOR SLAB), AND ELSEWHERE AS INDICATED, AND SO AS TO ACHIEVE A SEALED WATERTIGHT INSTALLATION. MATCH EXISTING CONDITIONS AND MEET OR EXCEED INTEGRITY OF WALLS.
3. INSTALLATION: RIGIDLY SUPPORT AND SECURE ALL MATERIALS, RACEWAY AND EQUIPMENT TO BUILDING STRUCTURE USING HANGERS, SUPPORTS AND FASTENERS, SUITABLE FOR THE USE, MATERIALS AND LOADS ENCOUNTERED. PROVIDE ALL NECESSARY HARDWARE. PROVIDE CONDUIT SUPPORTS AT MAXIMUM 5 FT. O.C.
4. STRUCTURAL MEMBERS: DO NOT CUT, DRILL OR WELD ANY STRUCTURAL MEMBER EXCEPT AS SPECIFICALLY APPROVED BY THE ENGINEER.
5. INDEPENDENT SUPPORT: DO NOT SUPPORT MATERIALS OR EQUIPMENT FROM OTHER EQUIPMENT, PIPING, DUCTWORK OR SUPPORTS FOR SAME.
6. MISCELLANEOUS SUPPORTS: PROVIDE ANY ADDITIONAL STRUCTURAL SUPPORT STEEL BRACKETS ANGLES, FASTENERS AND HARDWARE AS REQUIRED TO ADEQUATELY SUPPORT ALL ELECTRICAL MATERIALS AND EQUIPMENT.
7. ONE HOLE STRAPS SHALL NOT BE USED FOR CONDUITS LARGER THAN 3/4"Ø.



6580 SPRINT PARKWAY
OVERLAND PARK, KANSAS 66251



BLACK & VEATCH


10950 GRANDVIEW DRIVE
OVERLAND PARK, KANSAS 66210
(913) 458-2000

PROJECT NO: 168202

DRAWN BY: AKJ

CHECKED BY: MB

REV	DATE	DESCRIPTION
0	6/7/2011	ISSUED FOR CONSTRUCTION

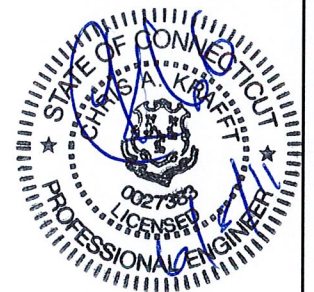


IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

MONTVILLE S.
CT23XC400
71 MOXLEY HILL ROAD
MONTVILLE, CT 06353
CO-LOCATION


SHEET TITLE
OVERALL CONDUIT
DETAILS

SHEET NUMBER

E-2

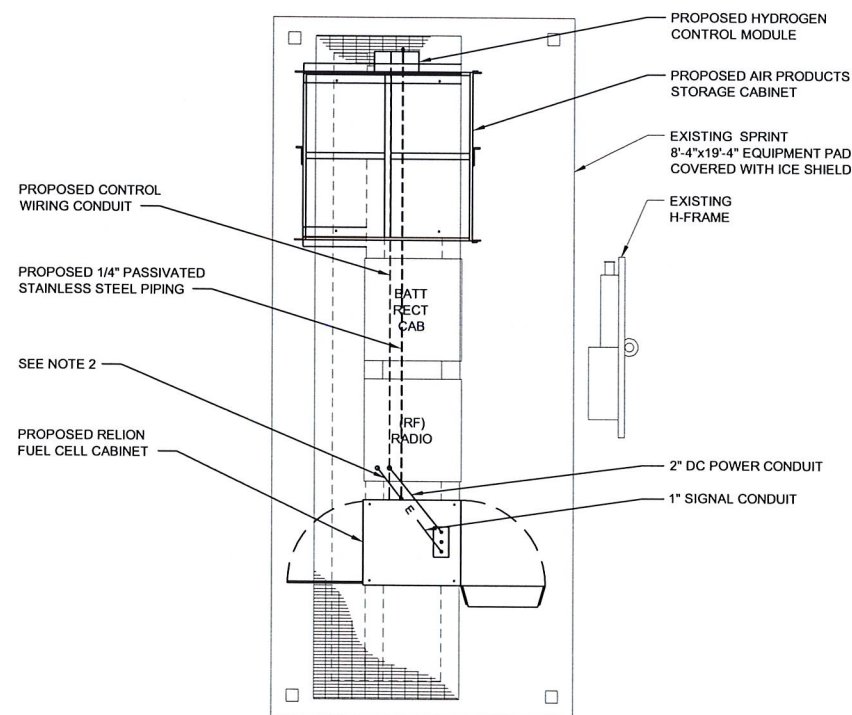


CONDUIT ROUTING

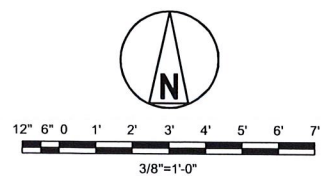

NOTES:

1. FOR CONDUIT STUB UP LOCATIONS AND DETAILS, REFER TO DETAIL A (THIS SHEET) AND SHEET S-2
2. CONDUIT MAY BE RUN ON TOP OF CONCRETE PAD.

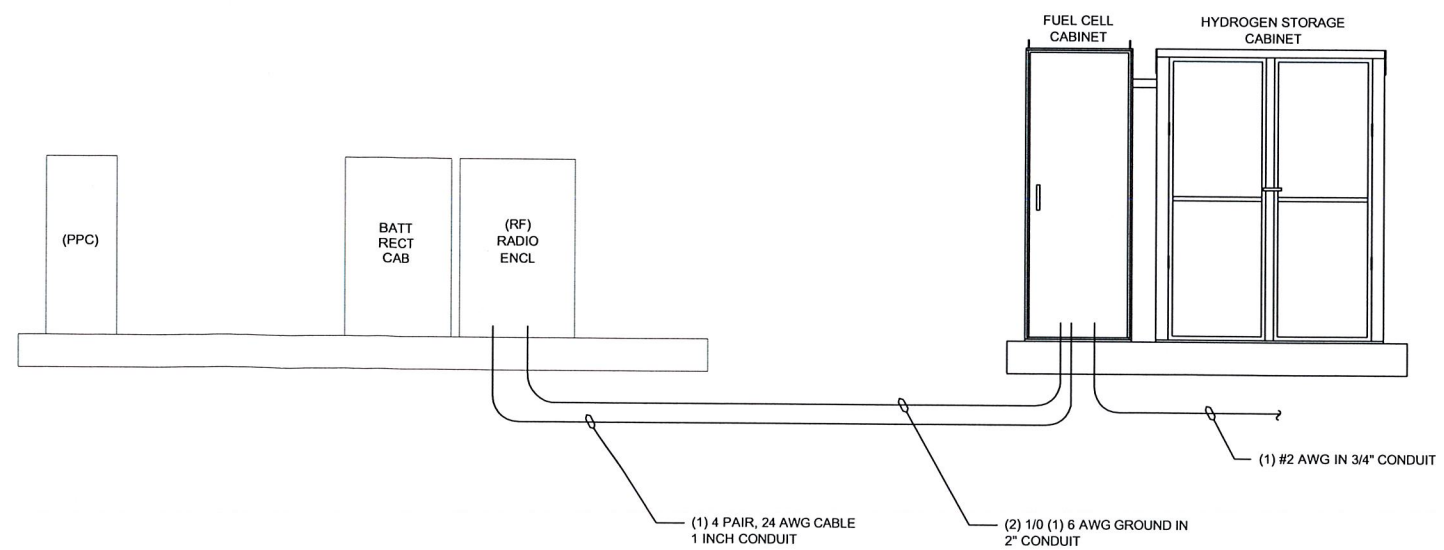

ELECTRICAL & SIGNAL RISER DIAGRAM



PROJECT NO: 168202

DRAWN BY: AKJ

CHECKED BY: MB

REV	DATE	DESCRIPTION
0	6/7/2011	ISSUED FOR CONSTRUCTION




IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

**MONTVILLE S.
CT23XC400
71 MOXLEY HILL ROAD
MONTVILLE, CT 06353
CO-LOCATION**

SHEET TITLE
**ELECTRICAL
WIRING DIAGRAM**

SHEET NUMBER
E-3

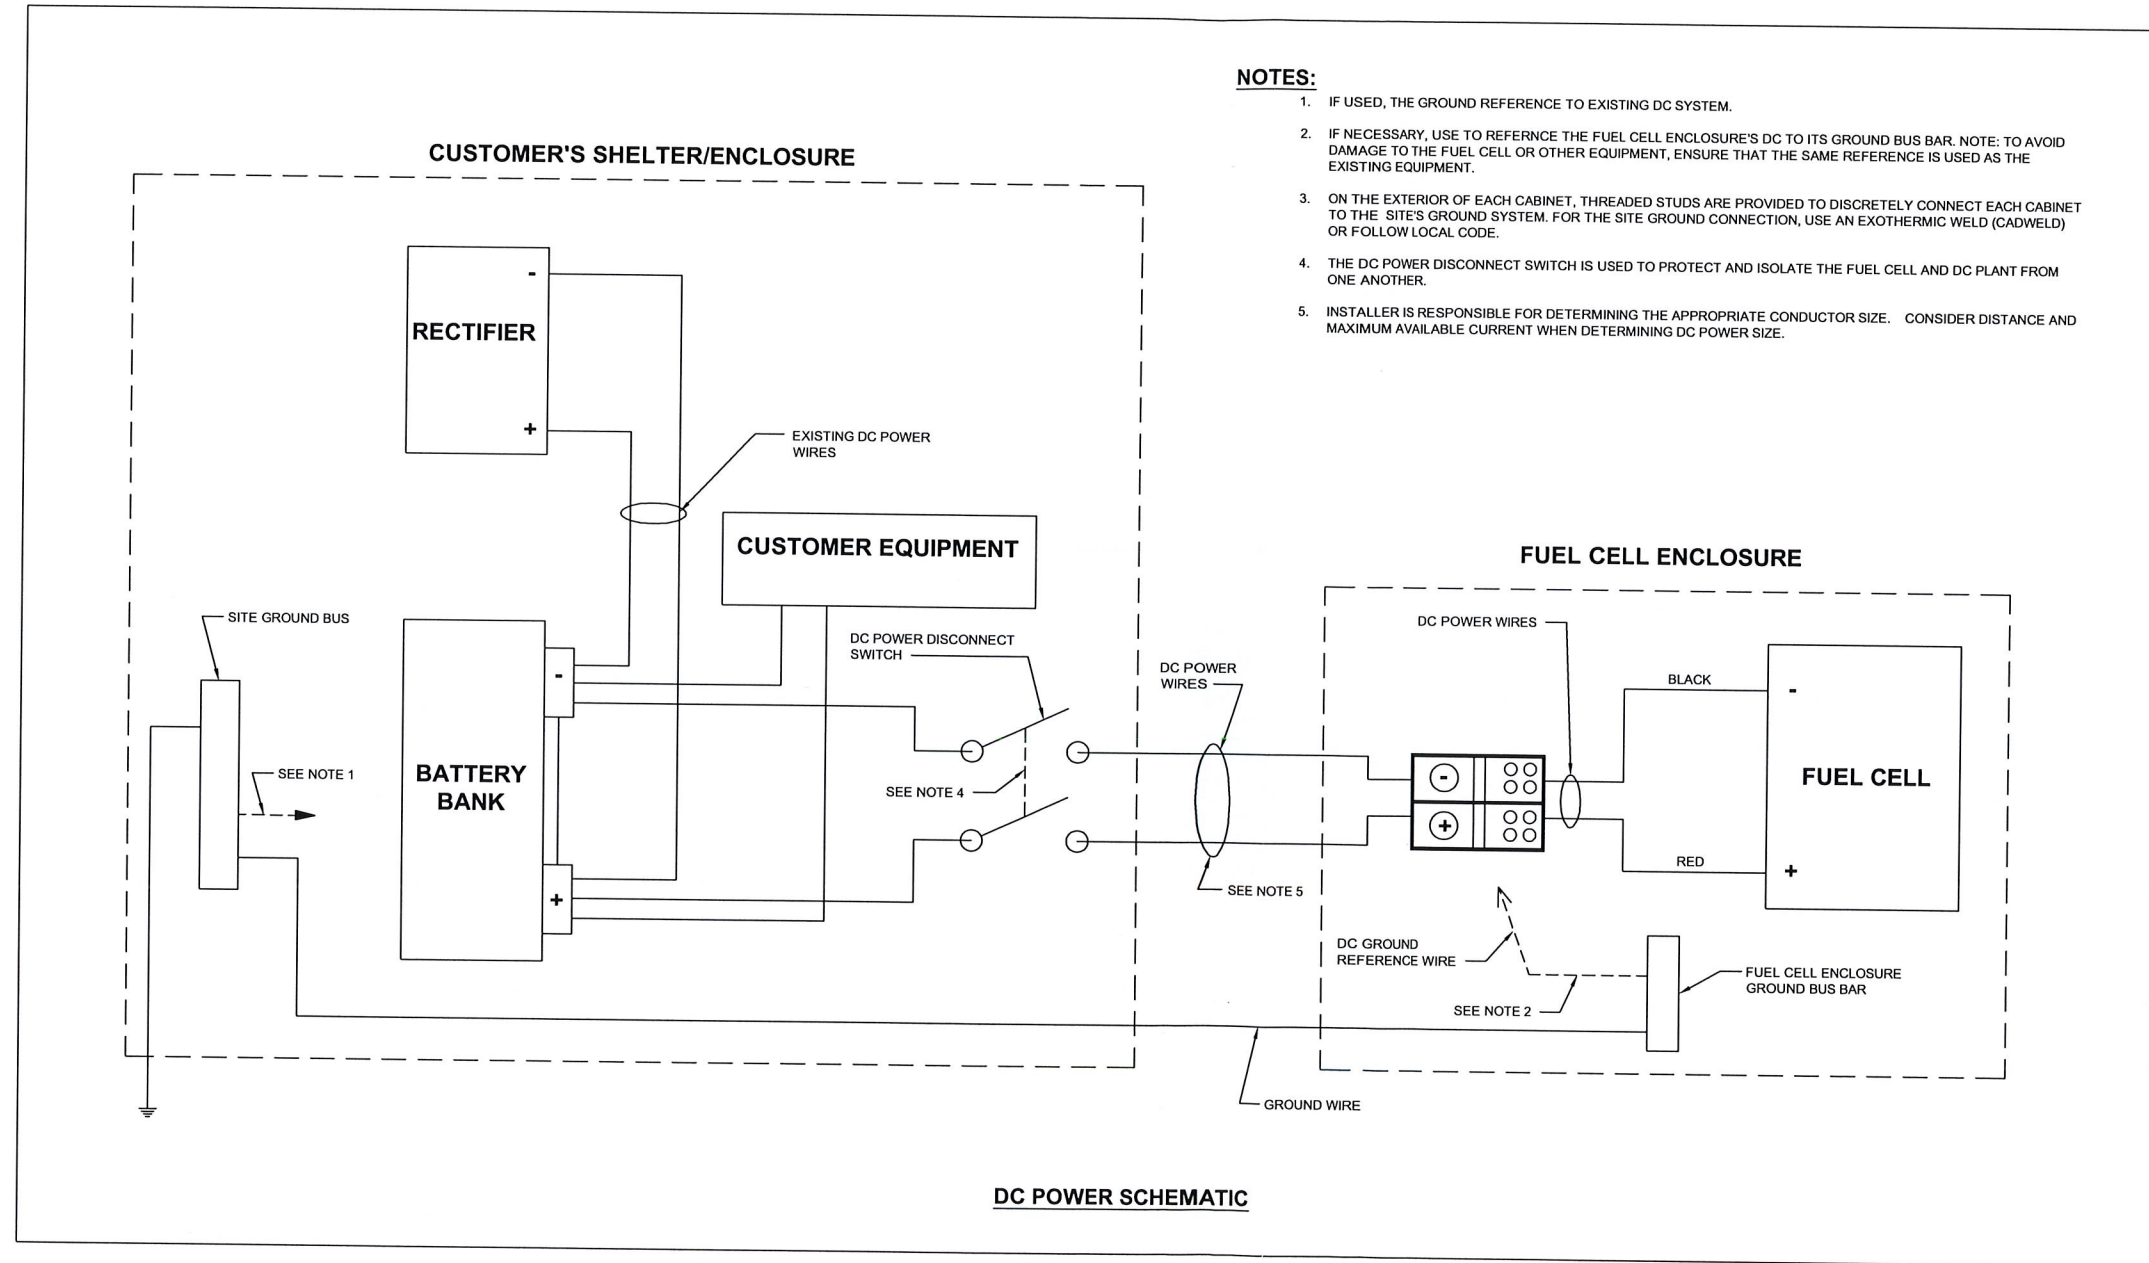




BLACK & VEATCH

10950 GRANDVIEW DRIVE
OVERLAND PARK, KANSAS 66210
(913) 458-2000

PROJECT NO: 168202
DRAWN BY: AKJ
CHECKED BY: MB

REV	DATE	DESCRIPTION
0	6/7/2011	ISSUED FOR CONSTRUCTION

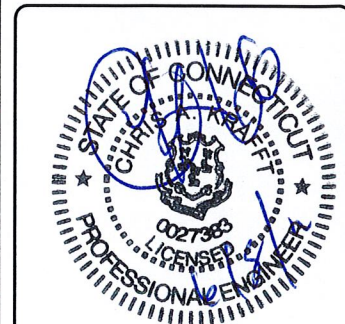

IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.


**MONTVILLE S.
CT23XC400
71 MOXLEY HILL ROAD
MONTVILLE, CT 06353
CO-LOCATION**

SHEET TITLE
**FUEL CELL INSTALL
DETAIL**

SHEET NUMBER
E-4



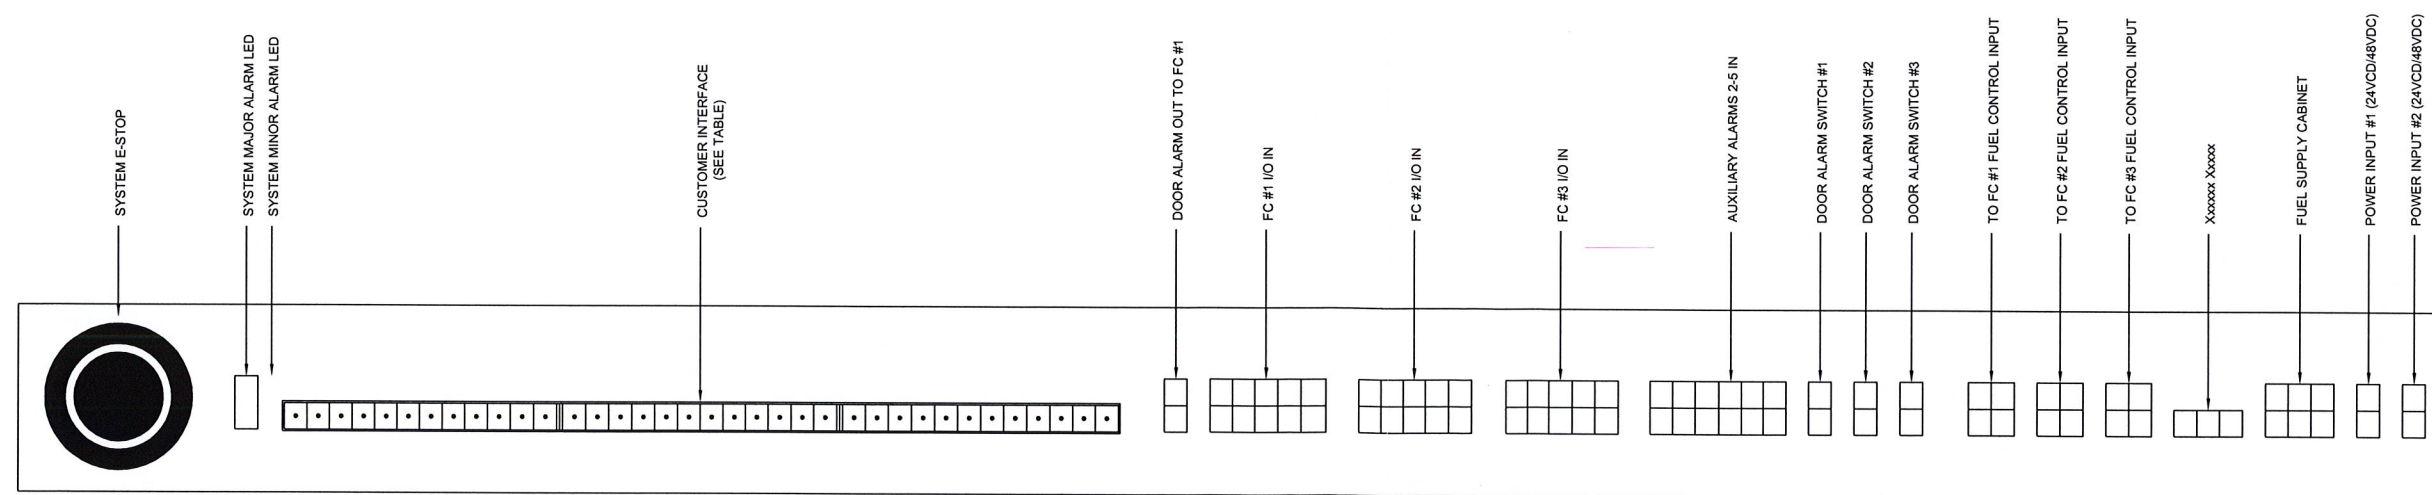



CUSTOMER CONNECTIONS


PIN	SIGNAL NAME	NOTES	PIN	SIGNAL NAME	NOTES	PIN	SIGNAL NAME	NOTES
1	DOOR SWITCH ALARM	THERE IS 1.1 k OHM SERIES RESISTANCE BETWEEN PINS 1 & 2	13	FC #1 AUX. ALARM RELAY (N.O.)	THERE IS 1.1 k OHM SERIES RESISTANCE BETWEEN PINS 1 & 2	25	AUX. 2 ALARM RELAY (N.O.)	AUXILIARY RELAYS 2 THROUGH 5 ARE AVAILABLE WITH THE ADDITION OF AN OPTIONAL ALARM CARD OR COMM CARD INSTALLED ONTO ONE OF THE FUEL CELLS
2	DOOR SWITCH ALARM RETURN		14	FC #1 AUX. ALARM RELAY (COMMON)		26	AUX. 2 ALARM RELAY (COMMON)	
3	NOT USED		15	FC #1 AUX. ALARM RELAY (N.C.)		27	AUX. 2 ALARM RELAY (N.C.)	
4	NOT USED		16	FC #2 AUX. ALARM RELAY (N.O.)		28	AUX. 2 ALARM RELAY (N.O.)	
5	SYSTEM MAJOR ALARM (N.O.)		17	FC #2 AUX. ALARM RELAY (COMMON)		29	AUX. 3 ALARM RELAY (COMMON)	
6	SYSTEM MAJOR ALARM (COMMON)		18	FC #2 AUX. ALARM RELAY (N.C.)		30	AUX. 3 ALARM RELAY (N.C.)	
7	SYSTEM MAJOR ALARM (N.C.)		19	FC #3 AUX. ALARM RELAY (N.O.)		31	AUX. 3 ALARM RELAY (N.O.)	
8	SYSTEM MINOR ALARM (N.O.)		20	FC #3 AUX. ALARM RELAY (COMMON)		32	AUX. 4 ALARM RELAY (COMMON)	
9	SYSTEM MINOR ALARM (COMMON)		21	FC #3 AUX. ALARM RELAY (N.C.)		33	AUX. 4 ALARM RELAY (N.C.)	
10	SYSTEM MINOR ALARM (N.C.)		22	PRESSURE SW ALARM RELAY (N.O.)		34	AUX. 5 ALARM RELAY (N.O.)	
11	CONTACT START	THESE ARE WETTED CONTACTS; USE A CLOSED SWITCH TO ACTIVATE.	23	PRESSURE SW ALARM RELAY (COMMON)		35	AUX. 5 ALARM RELAY (COMMON)	
12	CONTACT START RETURN		24	PRESSURE SW ALARM RELAY (N.C.)		36	AUX. 5 ALARM RELAY (N.C.)	



T-SERIES SIGNAL AND CONTROL CONNECTIONS

THE DETAILS ON THIS SHEET APPLY ONLY AS CALLED OUT ON SITE PLANS OR SITE SPECIFIC DRAWINGS.

CADWELD CONNECTIONS OR APPROVED EQUAL		BURNDY CONNECTIONS OR APPROVED EQUAL
 PARALLEL HORIZONTAL CONDUCTORS PARALLEL THROUGH CONNECTION OF HORIZONTAL CABLES TYPE PT	 HORIZONTAL STEEL SURFACE TO FLAT STEEL SURFACE OR HORIZONTAL PIPE TYPE HS	 BOND JUMPER FIELD FABRICATED GREEN STRANDED INSULATED TYPE 2-YA-2
 THROUGH CABLE TO GROUND ROD THROUGH CABLE TO TOP OF GROUND ROD TYPE GT	 VERTICAL STEEL SURFACE CABLE DOWN AT 45° TO VERTICAL STEEL SURFACE INCLUDING PIPE TYPE VS	 COPPER LUGS TWO HOLE - LONG BARREL LENGTH TYPE YA-2

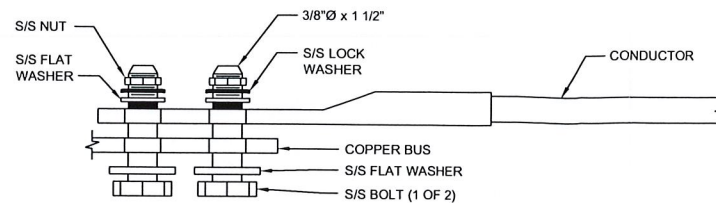


LUG DETAIL
NO SCALE

NOTES:

1. ALL HARDWARE 18-8 STAINLESS STEEL COAT ALL SURFACES WITH KOPR-SHIELD BEFORE MATING.
2. FOR GROUND BOND TO STEEL ONLY: INSERT A DRAGON TOOTH WASHER BETWEEN LUG AND STEEL. COAT ALL SURFACES WITH ANTI-OXIDATION COMPOUND (BURNDY PENETROX E, OR THOMAS & BETTS KOPR-SHIELD).

GROUNDING NOTES:


1. THE SUBCONTRACTOR IS RESPONSIBLE FOR PROPERLY SEQUENCING INSTALLATION AS TO PREVENT ANY LOSS OF CONTINUITY IN THE GROUNDING SYSTEM OR DAMAGE TO THE CONDUIT.
2. ALL GROUND CONNECTIONS ABOVE GRADE (INTERIOR & EXTERIOR) SHALL BE FORMED USING HIGH PRESS CRIMPS.
3. ALL EXTERIOR GROUNDING CONNECTIONS SHALL BE COATED WITH A CORROSION RESISTANT MATERIAL.
4. ALL EXTERIOR GROUNDING CONDUCTORS SHALL BE 2 AWG SOLID TINNED COPPER UNLESS OTHERWISE INDICATED.
5. CONNECTIONS TO THE GROUNDING BUS SHALL NOT BE DOUBLED UP OR STACKED. BACK TO BACK CONNECTIONS ON OPPOSITE SIDES OF THE GROUND BUS ARE PERMITTED.
6. USE OF 90° BENDS IN THE PROTECTION GROUNDING CONDUCTORS SHALL BE AVOIDED WHEN 45° BENDS CAN BE ADEQUATELY SUPPORTED.
7. MAXIMUM RESISTANCE OF THE COMPLETED GROUND SYSTEM SHALL NOT EXCEED 5 OHMS. TESTING SHALL BE PERFORMED IN ACCORDANCE WITH PROJECT SPECIFICATIONS FOR FACILITY GROUNDING, USING FALL OF POTENTIAL METHOD.

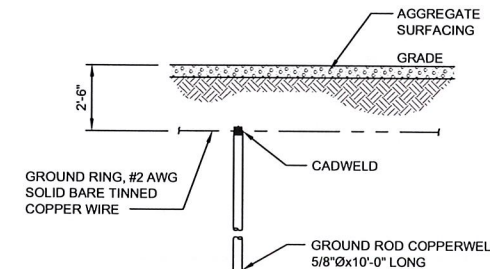


GROUND ROD DETAIL
NO SCALE

GROUNDING LEGEND

- EXISTING GROUND RING
- ⊗ NEW GROUND ROD
- CADWELD CONNECTION (EXOTHERMIC WELD)
- NEW GROUND RING

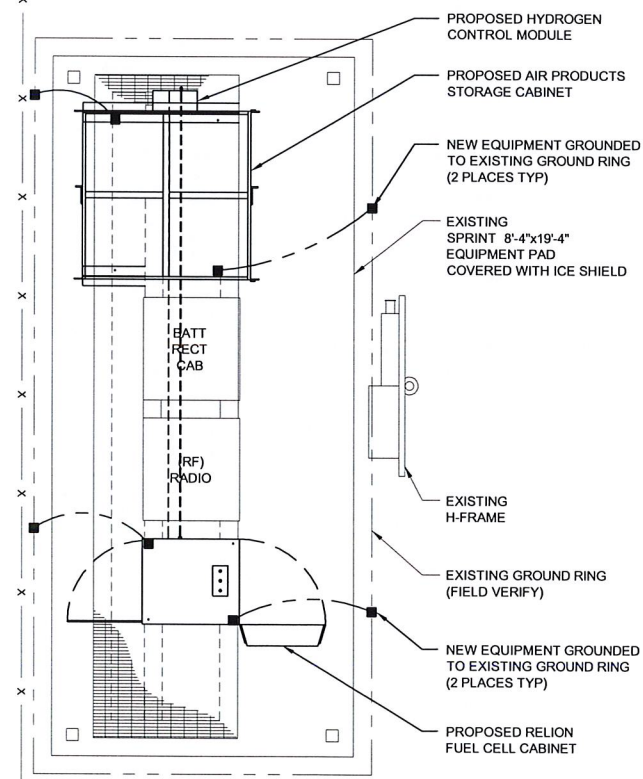


GROUNDING PLAN

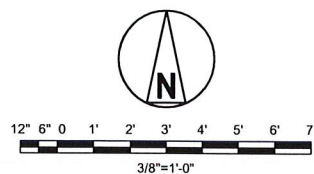

2 AWG BARE TINNED COPPER GROUND IN 3/4" FLEX CONDUIT (FROM EQUIPMENT TO 12" INTO EARTH) TO GROUND RING (TYP.) IF REQUIRED, USE 100% ACRYLIC LATEX CAULK ONLY. DO NOT USE SILICON CAULK OF ANY KIND

(ALTERNATE:) 2 AWG BARE TINNED COPPER GROUND TO AN EXISTING GROUND BAR. SEE GROUNDING NOTE 5 AND LUG DETAIL THIS SHEET

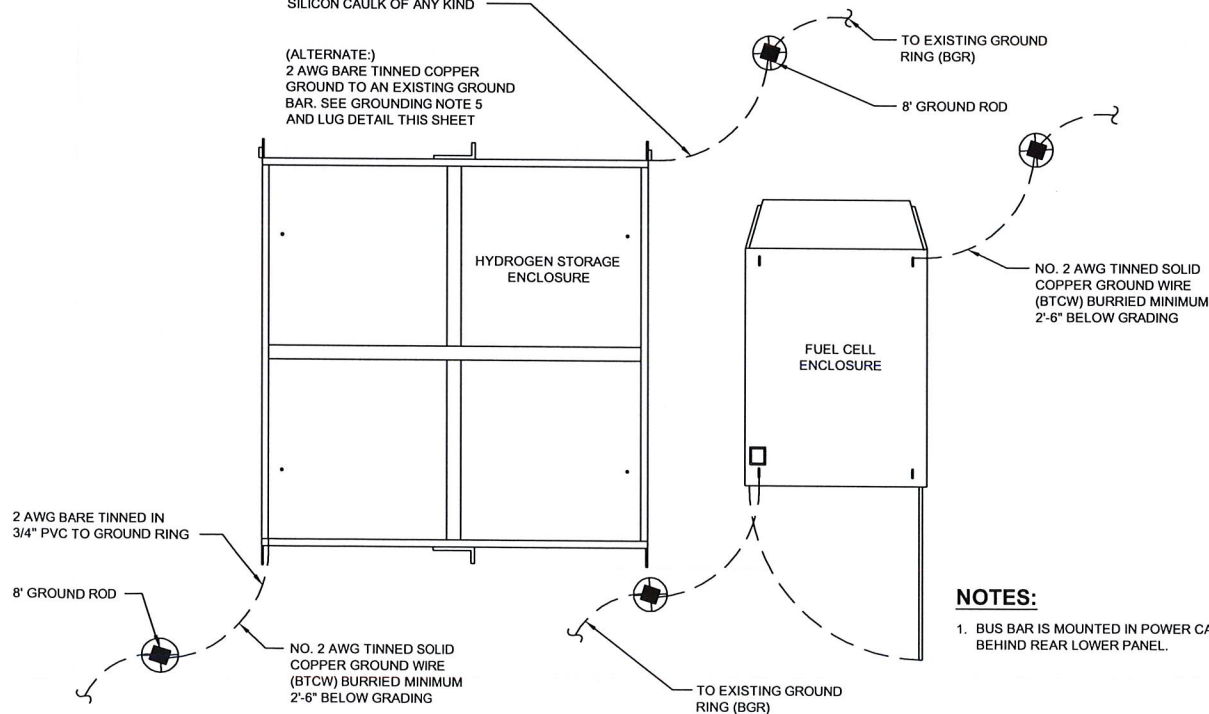

HYDROGEN TANKS AND ENGINE STAND ALONE GROUNDING DETAIL (IF APPLICABLE)

NOTES:

1. BUS BAR IS MOUNTED IN POWER CABINET BEHIND REAR LOWER PANEL.



6580 SPRINT PARKWAY
OVERLAND PARK, KANSAS 66251




BLACK & VEATCH

10950 GRANDVIEW DRIVE
OVERLAND PARK, KANSAS 66210
(913) 458-2000

PROJECT NO:	168202
DRAWN BY:	AKJ
CHECKED BY:	MB

REV	DATE	DESCRIPTION
0	6/7/2011	ISSUED FOR CONSTRUCTION

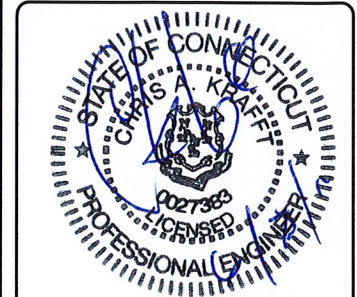

IT IS A VIOLATION OF LAW FOR ANY PERSON, UNLESS THEY ARE ACTING UNDER THE DIRECTION OF A LICENSED PROFESSIONAL ENGINEER, TO ALTER THIS DOCUMENT.

**MONTVILLE S.
CT23XC400
71 MOXLEY HILL ROAD
MONTVILLE, CT 06353
CO-LOCATION**

SHEET TITLE
**GROUNDING PLAN
AND DETAILS**

SHEET NUMBER
G-1