



10 INDUSTRIAL AVENUE,  
SUITE 3  
MAHWAH, NJ 07430  
  
PHONE: 201.684.0055  
FAX: 201.684.0066

---

July 20, 2021

Melanie A. Bachman  
Acting Executive Director  
Connecticut Siting Council  
10 Franklin Square  
New Britain, CT 06051

**Notice of Exempt Modification**  
**207 Garden Circle, Waterbury CT**  
**Latitude 41.57022222**  
**Longitude -73.0166**  
**T-Mobile site: CT11392B/Hardening**

Dear Ms. Bachman:

T-Mobile currently maintains (6) antennas at the 182-foot level of the existing 279-foot self-support lattice tower at 207 Garden Circle in Waterbury CT. The tower is owned SBA Towers V, LLC and the property is owned by SBA Properties Inc. T-Mobile now intends to add a 25Kw generator on a new 10'x4' concrete pad in a new lease area within the existing compound

**Planned Modifications:**

**Ground:**

Install New:

- (1) Generac RD025 25KW AC Diesel Generator - 240 gallon double walled self-contained tank with fuel sensor. Requires two 12-minute run cycles by-weekly.
- (1) to be located on new 10'x4' concrete pad in new lease area within existing compound

This facility was approved by the City of Waterbury, CT at a meeting of the Zoning Board of Appeals held March 18, 1985. The Board voted unanimously to grant the petition of EMAC Communications, Inc, requesting special exception under Section 5.13-12 of the Waterbury Ordinance to construct a radio communications tower and facility. EMAC Communications merged with and into SBA Properties, Inc. December 21, 2001. There were no post construction stipulations set. Please find documents from the Town, attached. Subsequent Exempt Modifications have been approved on this tower and there are no known conditions that would restrict exempt modifications

Please accept this letter as notification pursuant to Regulations of Connecticut State Agencies 16- 50j-73, for construction that constitutes an exempt modification pursuant to R.C.S.A. 16-50j 72(b)(2). In accordance with R.C.S.A. 16-50j-73, a copy of his letter is being sent to the City of Waterbury's Mayor, The Honorable Neil M. O'Leary, City Planner Robert Nerney, as well as the Tower owner.

The planned modifications to the facility fall squarely within those activities explicitly provided for in R.C.S.A. § 16-50j-72(b)(2).

1. The proposed modifications will not result in an increase in the height of the existing structure.
2. The proposed modifications will not require the extension of the site boundary.
3. The proposed modifications will not increase noise levels at the facility by six decibels or more, or to levels that exceed state and local criteria.
4. The operation of the replacement antennas will not increase radio frequency emissions at the facility to a level at or above the Federal Communications Commission safety standard.
5. The proposed modifications will not cause a change or alteration in the physical or environmental characteristics of the site.
6. The existing structure and its foundation can support the proposed loading.

For the foregoing reasons, T-Mobile respectfully submits that the proposed modifications to the above referenced telecommunications facility constitute an exempt modification under R.C.S.A. § 16-50j-72(b)(2).

Sincerely,

A handwritten signature in black ink, appearing to read "EJ Jamieson".

Elizabeth Jamieson  
Transcend Wireless  
10 Industrial Ave., Suite 3  
Mahwah, New Jersey 07430  
860-605-7808  
EJamieson@TranscendWireless.com

cc:

The Honorable Neil M. O'Leary, Mayor  
Robert Nerney, City Planner  
SBA, Tower Owner

25176

VOL 1757 PAGE 173



OFFICE OF THE CITY CLERK

**THE CITY OF WATERBURY**  
CONNECTICUT

March 20, 1985

TO WHOM IT MAY CONCERN:

THIS IS TO CERTIFY THAT at a meeting of the Zoning Board of Appeals held Monday, March 18, 1985, the Board voted unanimously to grant the petition of EMAC Communications, Inc., requesting a special exception under Section 5.13-12 of the Waterbury Ordinance to construct a radio communication tower and facility on the premises at Garden Circle, Garden Hill Circle and Farmdale Drive, an R.L. zone.

ATTEST:

*Ralph T. Phelan*  
Ralph T. Phelan  
Assistant City Clerk

RTP/cc


NOTE: Please have this recorded in the Town Clerk's Office as soon as possible.

RECEIVED FOR RECORD  
TOWN CLERK'S OFFICE

1985 MAR 22 P 3-22

*Linda H. Teller*  
TOWN CLERK  
WATERBURY, CT.

679374

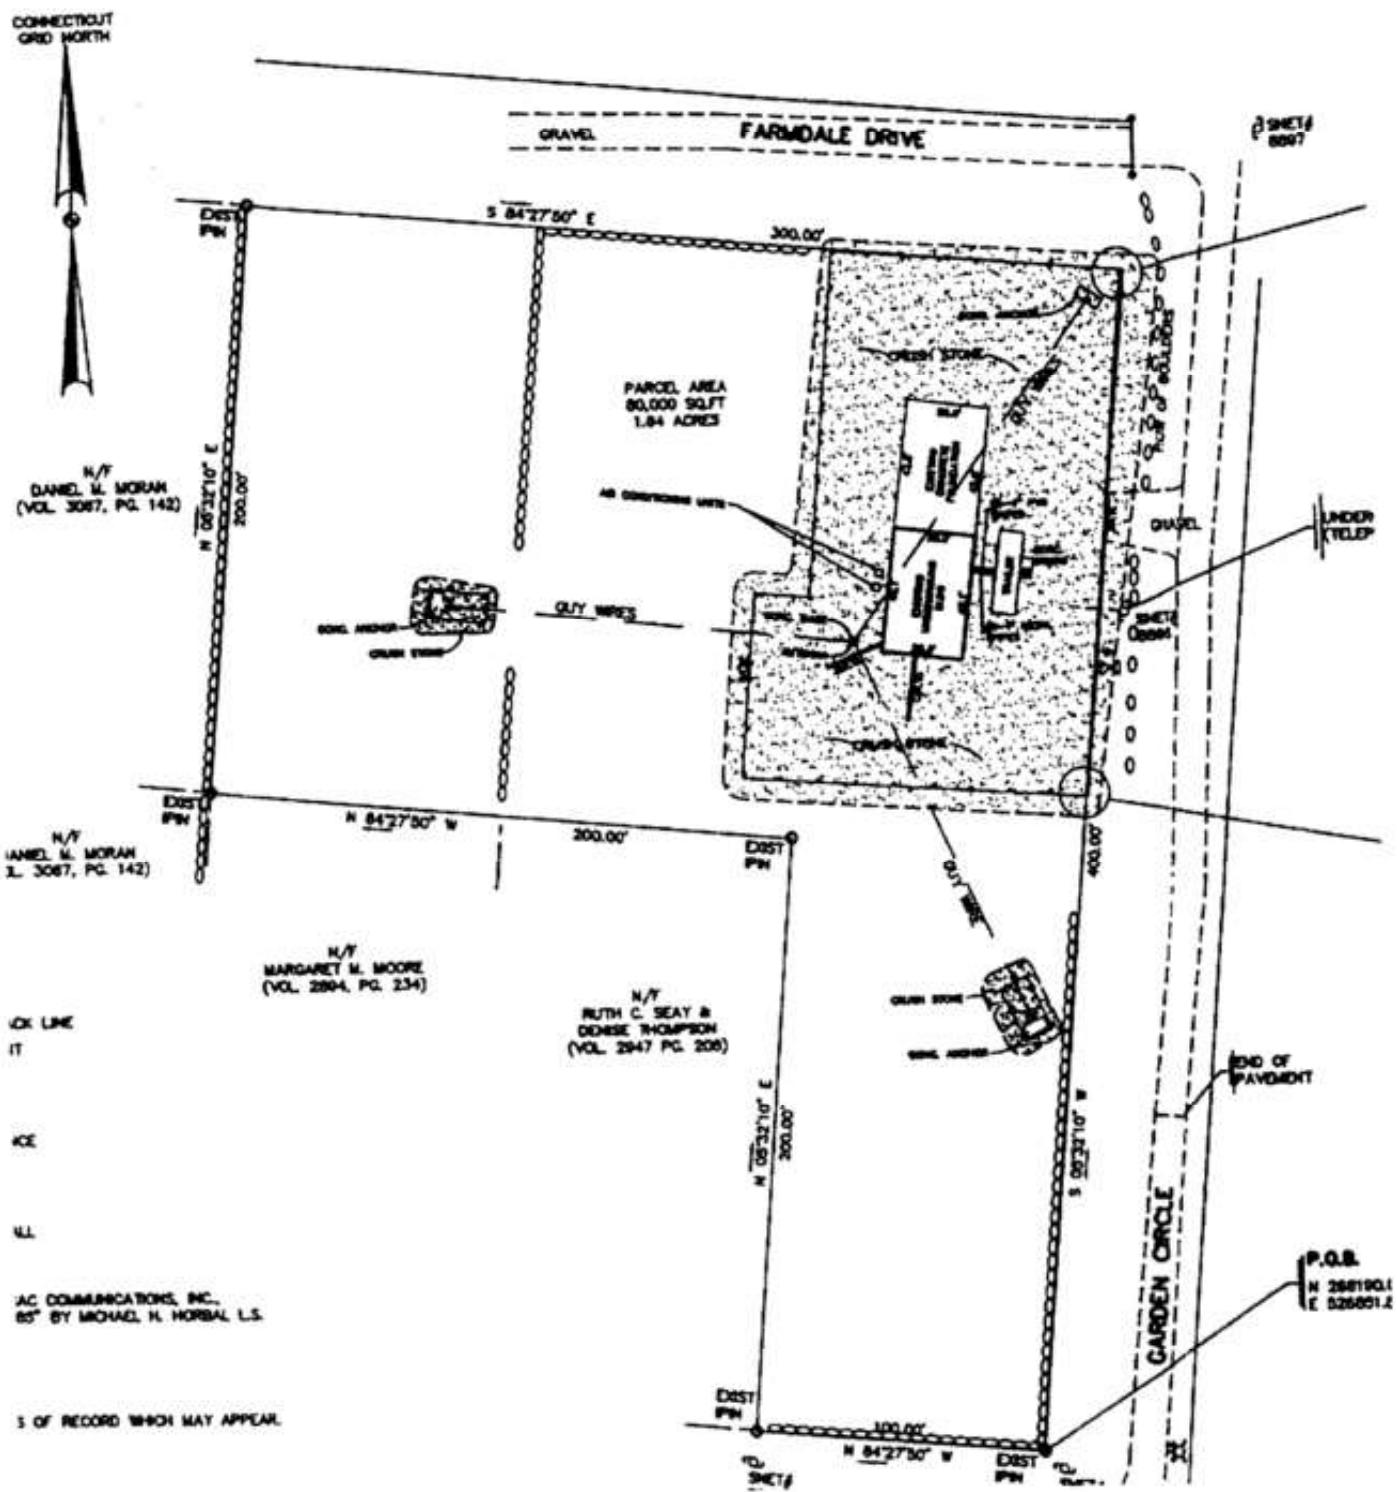

Hope this helps.

Thanks,

**Darcy Nelson**  
*Regional Site Manager - NE*

570.362 8355 + C  
561.322.2851 + F

The Assessor's office is responsible for the maintenance of records on the ownership of properties.

Assessments are computed at 70% of the estimated market value of real property at the time of the last revaluation which was 2017.

# CITY OF WATERBURY

Information on the Property Records for the Municipality of Waterbury was last updated on

## Parcel Information

Location:	207 GARDEN CIR	Property Use:	Residential	Primary Use:	Residential
Unique ID:	018408050050	Map Block Lot:	0184-0805-0050	Acres:	0.92
490 Acres:	0.00	Zone:	RL	Volume / Page:	4307/ 9
Developers Map / Lot:		Census:			

## Value Information

	Appraised Value	Assessed Value
Land	194,391	136,070
Buildings	0	0
Detached Outbuildings	0	0
Total	194,391	136,070

## Owner's Information

Owner's Data
SBA PROPERTIES INC 8051 CONGRESS AVE ATTN: CT.4877 BOCA RATON FL 33487-1307

## Owner History - Sales


Owner Name	Volume	Page	Sale Date	Deed Type	Valid Sale	Sale Price
SBA PROPERTIES INC	4307	9	01/28/2002	Other	No	\$0
EMAC COMUNICATIONS INC			06/04/1985		No	\$22,500

## Building Permits

Permit Number	Permit Type	Date Opened	Date Closed	Permit Status	Reason
2018.1575	Electrical	06/12/2018		Open Permit	INSTALL AND WIRE GENERATOR
2013.2794	Electrical	09/19/2016		Closed	ADD 3 ANTENNAS TO EXISTING CELL SITE
2016.2793	Electrical	09/19/2016		Closed	MODIFICATION TO EXISTING CELL SITE ADD CABINET WITH 100A BREAKER
2015.3458	Comm Renovations	11/17/2015		Closed	REPLACE 3 EXISTING ANTENNAS WITH 3 NEW ANTENNAS
2015.3459	Comm Renovations	11/17/2015		Closed	UPGRADE & REPLACEMENT OF EQUIPMENT IN EXISTING SHELTER. SEE SUBMITTED PLAN

Information Published With Permission From The Assessor

# FARMDALE DR

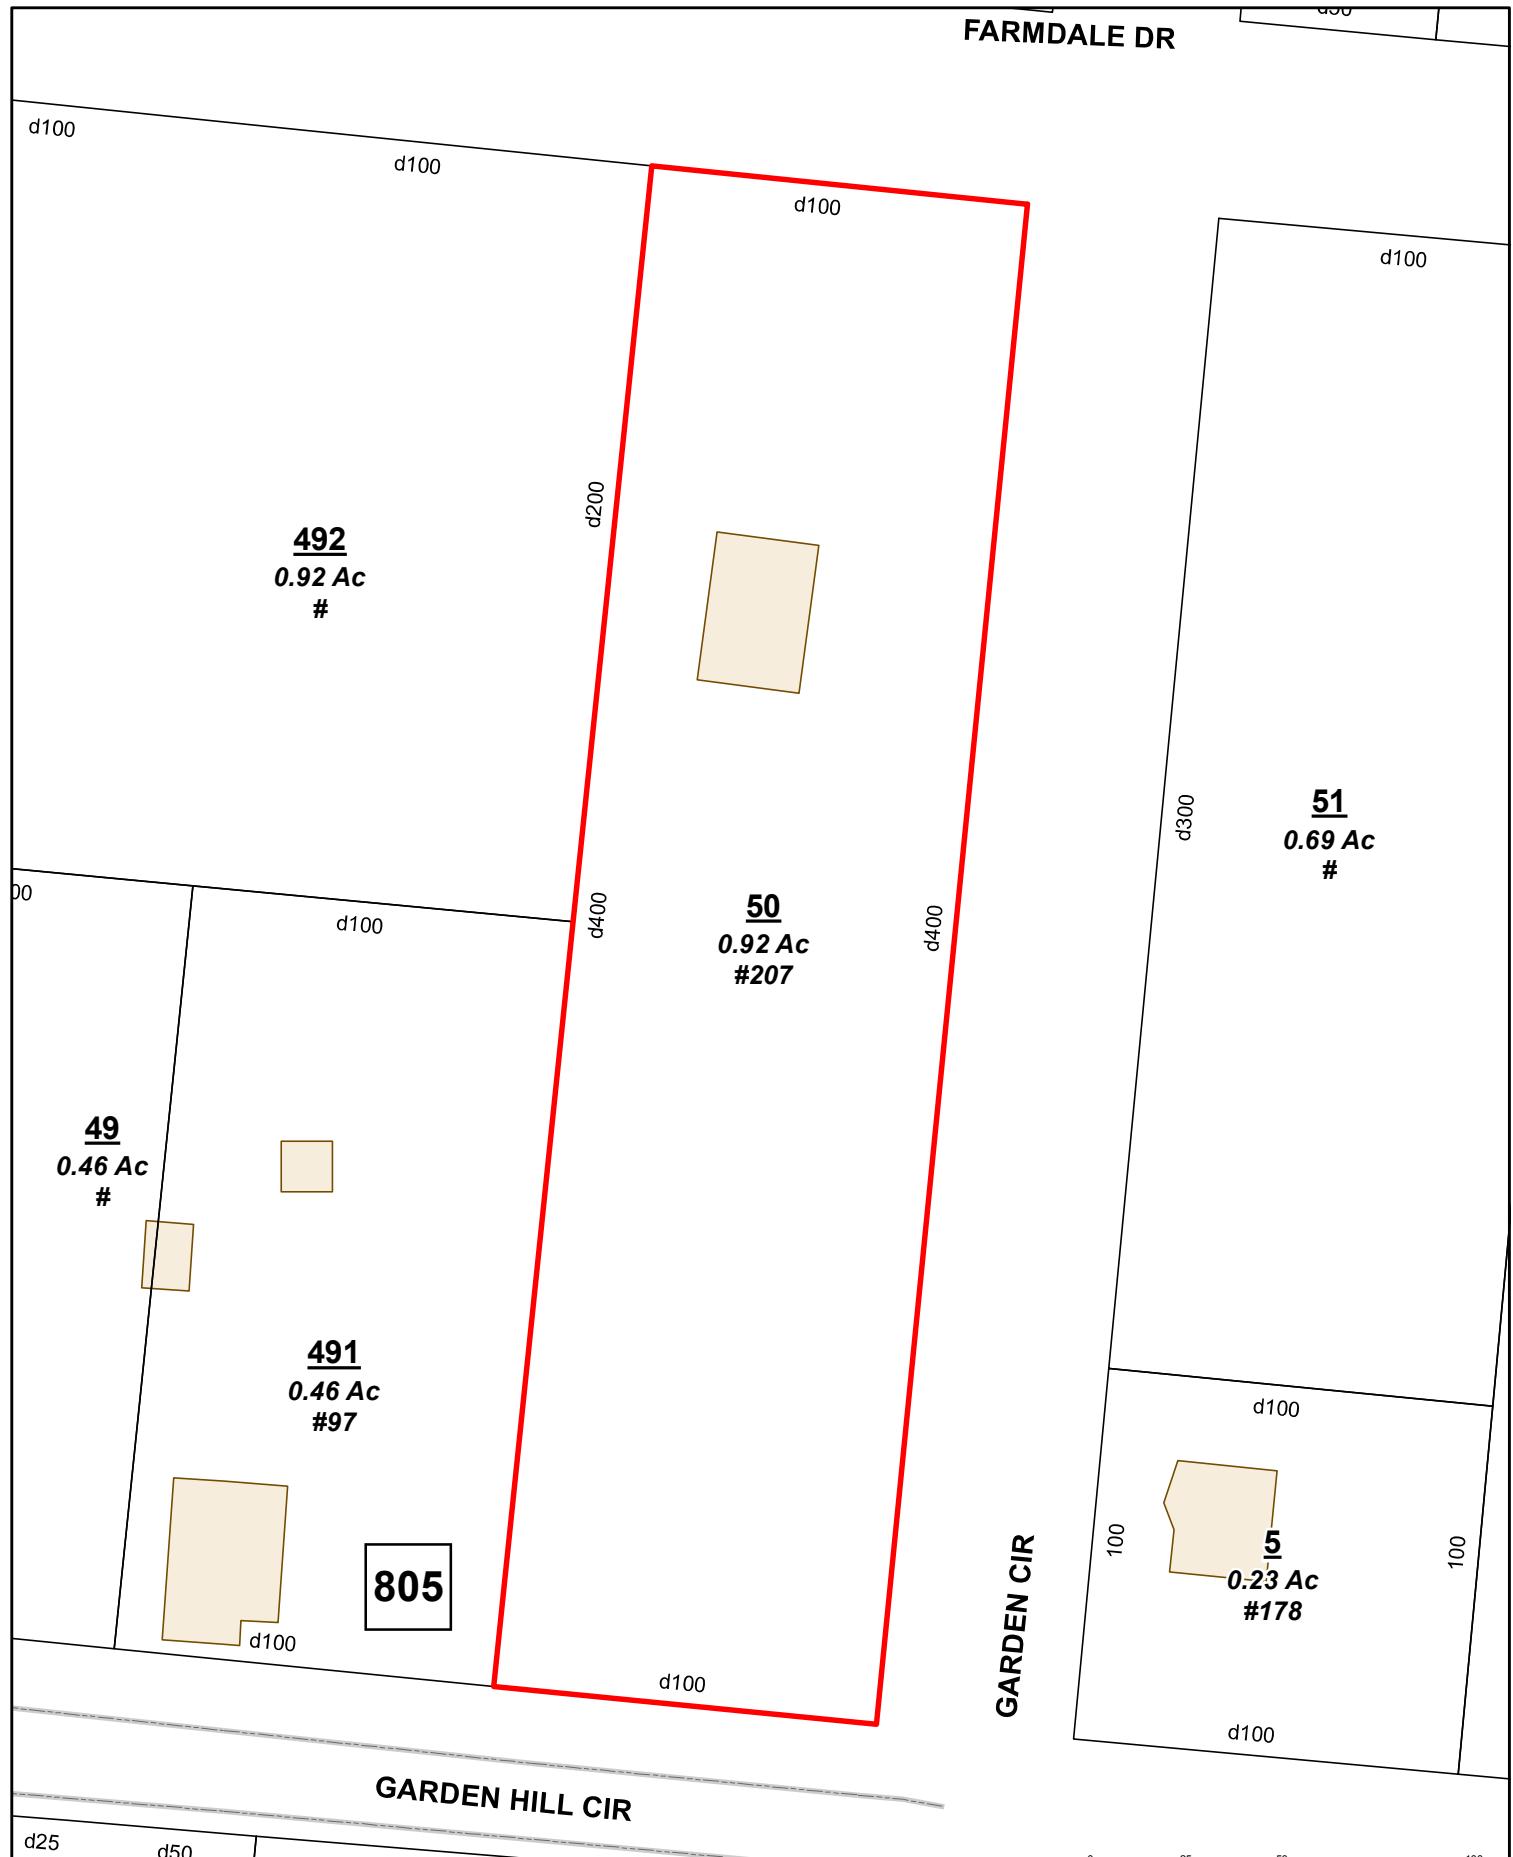

**City of Waterbury**  
Public Works Department

MBL: 0184-0805-0050  
ADDRESS: 207 GARDEN CIR

This map is for informational purposes only and has not been prepared for, or suitable for legal, engineering, or surveying purposes. Users of this information should review or consult the primary data and information sources to verify the usability of the information. The City of Waterbury makes no warranties, express or implied, as to the use of the information obtained herein.





Department of Public Works

## The City of Waterbury

November 29, 2012

### STREET NUMBERING

In compliance with the provisions of the ordinance quoted hereon, you are hereby ordered to place in a conspicuous place on your building or door the number designated below. The numbers must be plain and not less than 2½ inches in height.

Your New Number is 207

Extract from City Ordinance concerning Buildings:

#### AN ORDINANCE CONCERNING THE NUMBERING OF BUILDINGS:

1. Numbers of regular series shall be affixed to, or inscribed on all buildings or parts of buildings erected or fronting on any street, alley or public court in the City of Waterbury.
2. Such numbers shall be of a color, different from and in distinct contrast to their background; shall be of such size and material and in such location as to be at all times by daylight plainly legible from the middle of the street; and shall in no case be less than two and one half inches in height.
3. The Bureau of Engineering shall arrange the series and designate the number of numbers to be affixed to such buildings, or parts of buildings, and shall keep a record thereof.
4. In case the numbered building is so situated that the number upon it is not plainly visible from the middle of the street in daylight, an additional number or numbers shall be placed at the street entrance, upon a fence, or post, or adjacent building, in such a way as to be plainly visible from the middle of the street.
5. The Police Department shall cause this ordinance to be enforced and any owner or occupant of any building, who shall neglect or refuse for sixty (60) days after the passage of this ordinance, or after the numbers have been designated by the Bureau of Engineering, to affix to the same the number designated by the Bureau of Engineering, or who shall affix to the same, or retain thereon more than five (5) days any number contrary to the said designation and the direction of the Police Department, shall forfeit not less than one (1) no more than twenty (20) dollars for every such offense, and a like fine for every day thereafter until the directions of said Police Department are complied with.

#### SAVE THIS NOTICE

Until you attach the numbers to building in  
accordance with the regulations above

OWNER'S NAME : SBA Properties Inc

OWNER'S ADDRESS: 5900 Broken Sound Pkwy Nw

Boca Raton, Fl 33487

Assessor's: #0184-0805-0050 HOUSE #207 Garden Cir.

Per Owners request

Numbering Map 12-21-42

Property  
SearchResidential  
SalesCommercial  
SalesVacant Land  
Sales

City of Waterbury

Last Updated: 11/27/2012

## Summary

207 GARDEN CIR.

Address	X GARDEN HILL CTR X	Map/Block/Lot	0184-0805-0050
Primary Use	Residential	Acres	0.92
Unique ID	018408050050	Zone	RL
Volume	4307	Page	9

## Ownership Information



Current Owner	Appraised Value	70% Assessment
SBA PROPERTIES INC	251838	176290
% SBA NETWORK SERVICES	0	0
5900 BROKEN SOUND PKWY NW	0	0
BOCA RATON FL 33487	Total	251838
		176290

## Sales History

Previous Owner	EMAC COMUNICATIONS INC	Sale Date	1/28/2002
Sale Price	0	Deed Type	
Volume/Page	4307 / 9	Valid Sale	No
Previous Owner	V,1/31 Pg 40	Sale Date	6/4/1985
Sale Price	22500	Deed Type	
Volume/Page	/	Valid Sale	No

Disclaimer: This information is provided for your use. No claim that the file is complete or that the file is 100% accurate is made. It is a copy of the Property Record File of the town and as such is a constant work in progress. You may also view and copy data in the Town Hall.

Please feel free to [contact](#) us for further information.  
[Click here](#) to go back.

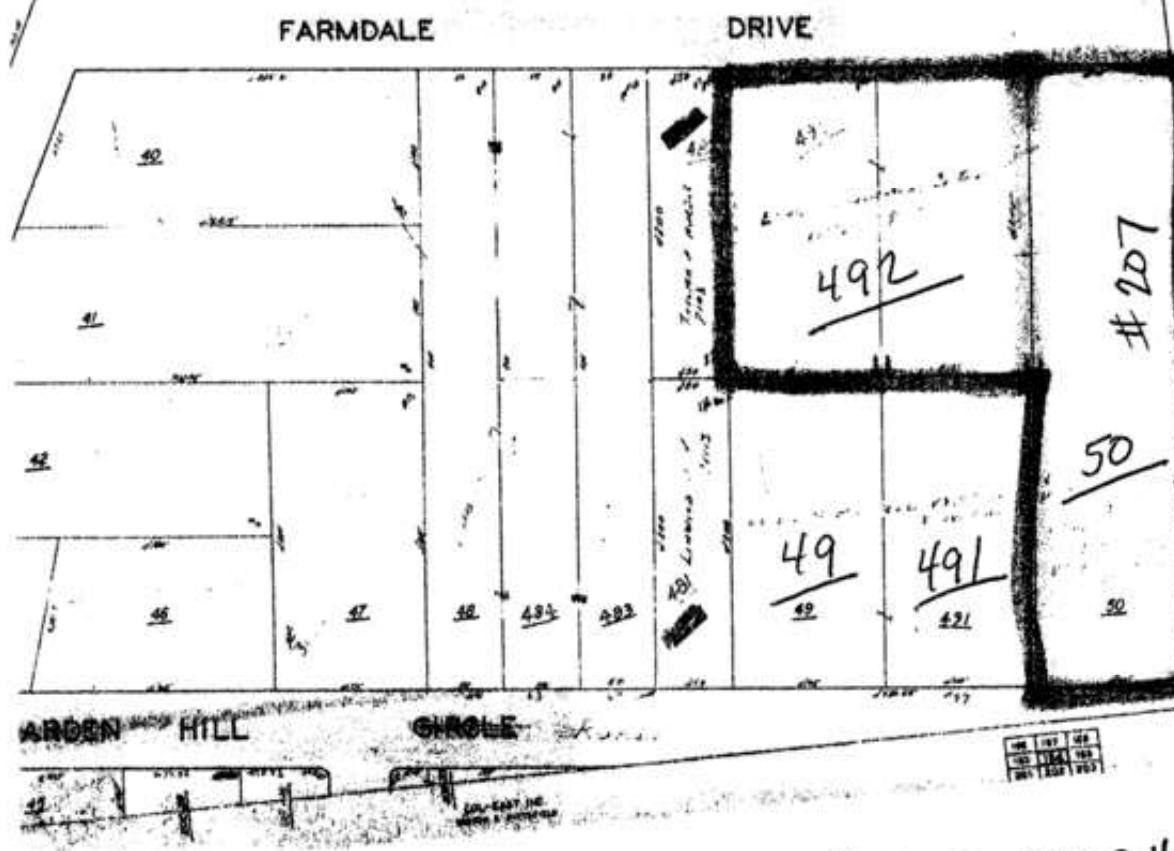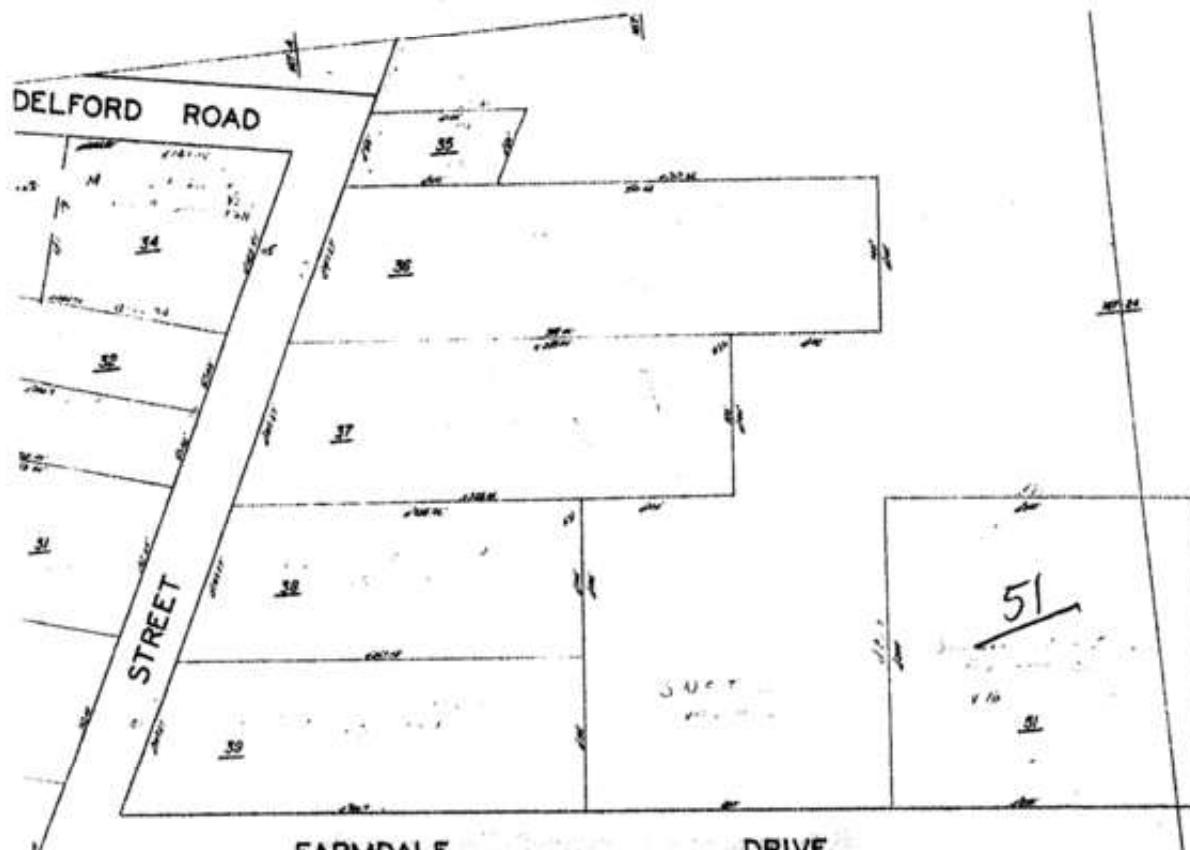

GARDEN CIRCLE

GARDEN


ASSES. MAP# 184-805-50

12-21-10


FARMDALE



DRIVE

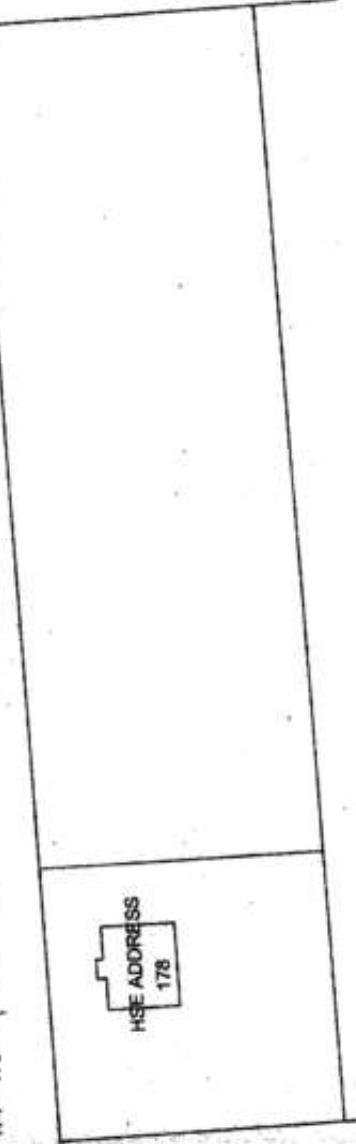

Garden hill Ci

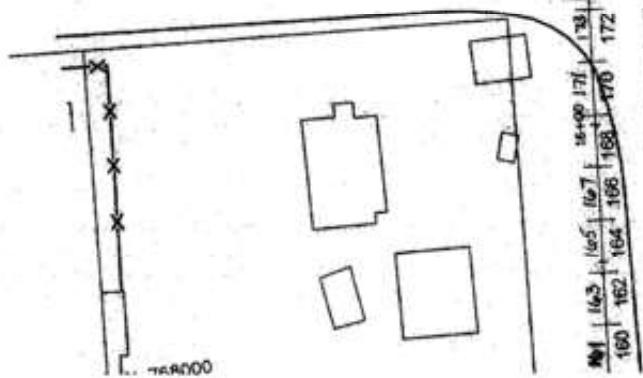

## HOUSE NUMBERS

Date Recieved Nov. 27, 2012

Date Numbered NOV. 29, 2012

Numbers Given 207

Side of street WEST

Number of Buildings N/A      Doors N/A

Remarks CELL TOWER

Kind of Buildings, Etc;  
Asses. MAP# 184-805-50

12-21-42

Per OWNERS REQUEST

By SR

## LOCATION OF BUILDING TO BE NUMBERED

GARDEN CIR.      AVE  
ST

Located


Asses. MAP# 184-805-50

Request by SBA PROPERTIES INC

5900 BROKEN SOUND PKWY #100  
BOCA RATON, FL 33487

# **Generac RD025 Design Document**

Diesel, AC, 25kW External Fill Tank Model#7192-0 SKU#33651

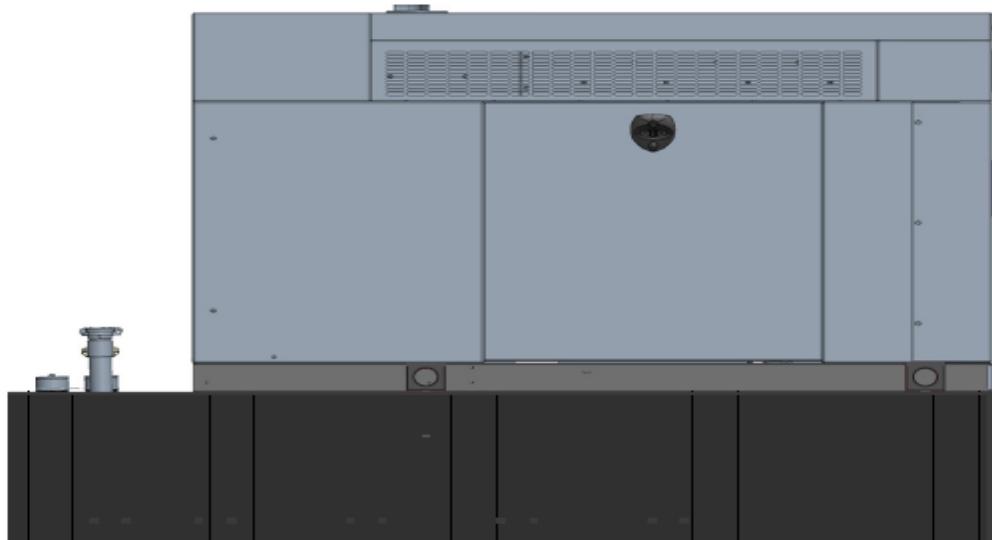

The following are responsible for this project document:

Kevin Smith

SR. Engineer (770) 256-3594

Project Design Spec Revision	1.0	Last Date:08/23/2018	5/14/2018
Final doc URL (~Dnnnnn):			
Location	Use the InfoRouter Search (Advanced) putting the Document ID (nnnnnn without the D) to find the location of the master document.		
Template URL:	<a href="http://docs.eng.t-mobile.com/InfoRouter/docs/~D423750">http://docs.eng.t-mobile.com/InfoRouter/docs/~D423750</a> Slightly updated 1/2011		

## Table of Contents

<b>1</b>	<b>Introduction / Project Summary .....</b>	<b>3</b>
1.1	Purpose of Project	3
1.2	Feature Description	3
1.3	Dimensions	3
<b>2</b>	<b>Fuel Tanks.....</b>	<b>4</b>
<b>3</b>	<b>RXSC200A3 ATS/ Controller .....</b>	<b>4</b>
3.1	Hardware	4
<b>4</b>	<b>Architecture/Alarms .....</b>	<b>7</b>
4.1	Interfaces and Alarming	7
<b>5</b>	<b>Regulatory Requirements .....</b>	<b>9</b>
<b>6</b>	<b>Configuration/Diagrams .....</b>	<b>9</b>
<b>7</b>	<b>Maintenance.....</b>	<b>14</b>

# 1 Introduction / Project Summary

## 1.1 Purpose of Project


T-Mobile's nationwide cell site hardening plan is providing a refuelable backup power system capable of powering a site for a minimum of 48 hours before refueling is required. The purpose of this project is to give T-Mobile customers reliable service during power outages and provide a sufficient layer of coverage. This design document is for Generac's RD025 model#7192-0, which is a Diesel AC generator with a capacity of 25kW.

## 1.2 Feature Description

The Generac RD025 is a 25kW AC, diesel generator is one of the generators selected as part of the T-Mobile RFP in support of the nationwide cell site hardening plan. The RD025 has a Level 2 acoustic enclosure, 3 phase sensing, and  $\pm 0.25\%$  digital voltage regulation. It is equipped with RS232, RS485 and canbus remote ports and Evolution control panel. It is also equipped with a automatic transfer switch, the RXSC200A3 (Automatic Transfer Switch) Controls the process of transferring commercial AC power and generator power. The RXSC200A3 is a 200Amp, switch that is programmed to perform engine test runs and also has adjustable engine run time capabilities. For RXSC200A3 Owners Manual and full feature descriptions [LINK](#)

## 1.3 Dimensions

The dimensions of a level 2 Acoustic Enclosure L x W x H in inches 103.4 x 35 x 91.7. T-Mobile requires a 36-inch radius around the generator that will cover the 18" door swing on the generator.

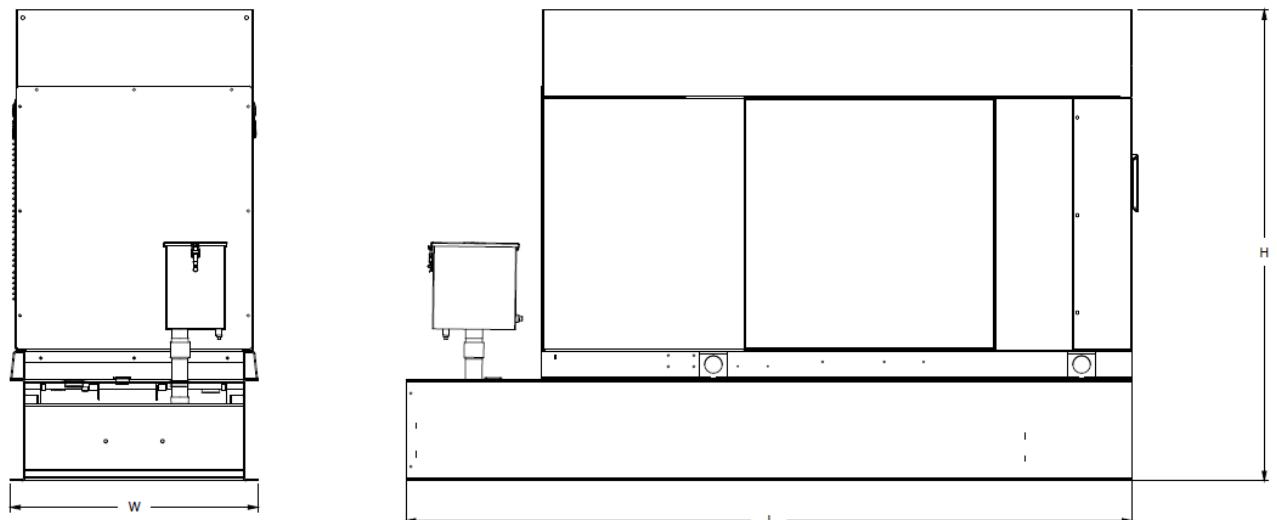


Weights and Dimensions

Unit Weight - lbs	Unit Weight with Skid - lbs	Dimensions (L x W x H) - in
2,123	2,161	103.4 x 35.0 x 73.8

## 2 Fuel Tanks


The RD025 has a 102.7" 240 Gallon Double-Wall UL142 Base tank to provide 98 hours of backup power at full load deployed on site. Below is the Install drawing for the 240-gallon tank for the RD025kW.

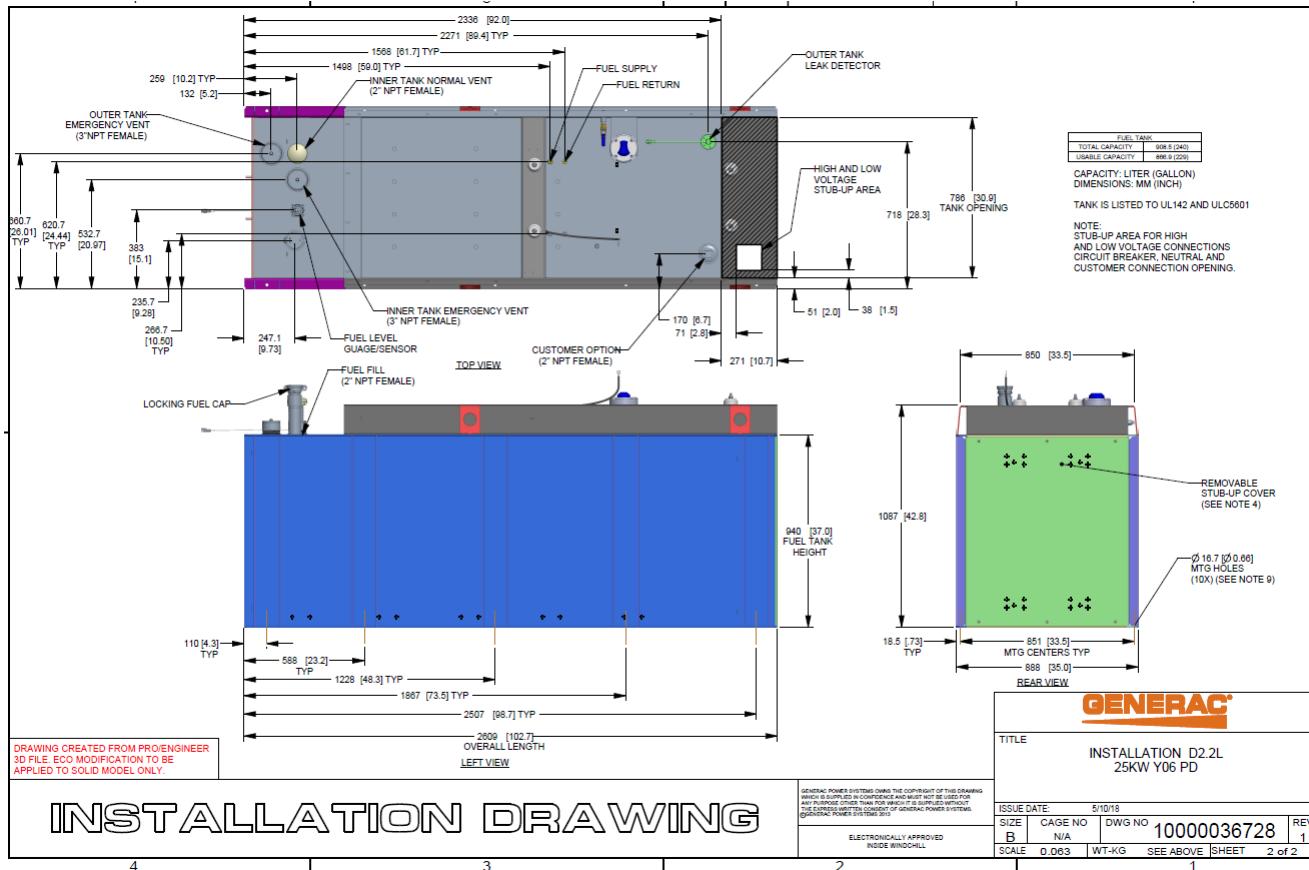

## 3 RXSC200A3 ATS/ Controller

### 3.1 Hardware

The RD025 will come with a RXSC200A3 and an Evolution controller. The sites considered for the RD025 should not have a DC power consumption above 20kW

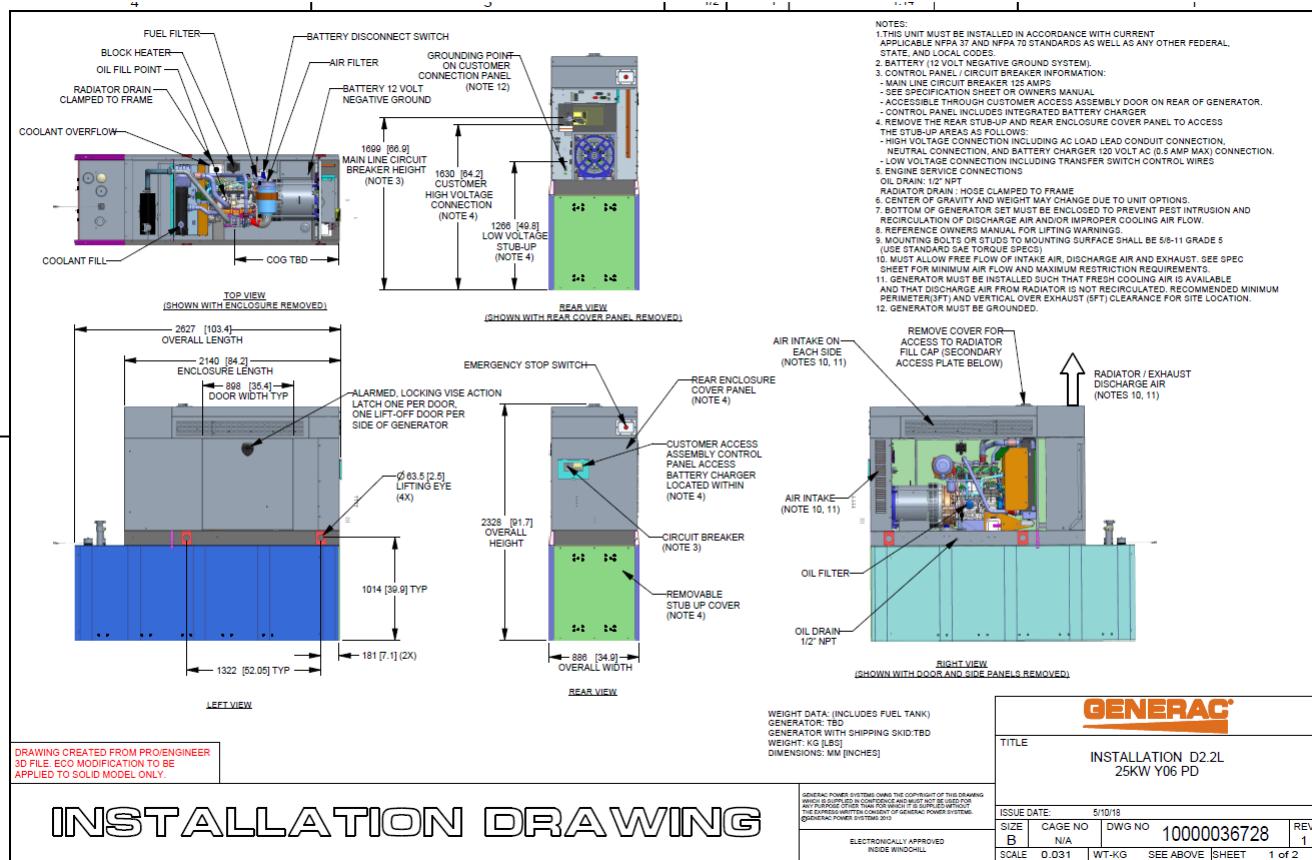
RXSC200A3 [Link](#)RXSC200A3 install drawing [Link](#)Evolution controller spec sheet [Link](#)RD025 installation drawings and supporting documentation [Link](#)

### 3.2 RXSC200A3 Automatic Transfer Switch

The RXSC200A3 (Automatic Transfer Switch) is equipped with the following functions. Utility voltage drop-out <65%. Timer to Generator start: 10 second factory set, adjustable between 2-1500 seconds. Engine Warm up delay: 5 seconds. Standby Voltage Sensor: 65% for 5 seconds. Utility Voltage Pickup >80%. Re-Transfer Time Delay: 15 seconds. Engine Cool-Down Timer: 60 seconds. Exerciser: 5 or 12 minute adjustable weekly/by-weekly/monthly. The transfer switch can also be operated manually without power applied.

**RXSC200A3 Dimensions**

Model		RXSC200A3
Height (in./mm)	H1	17.24/437.9
	H2	20/508
Width (in./mm)	W1	12.5/317.5
	W2	14.6/370.8
Depth (in./mm)		7.09/180.1
Weight (lbs./kilos)		20/9.07

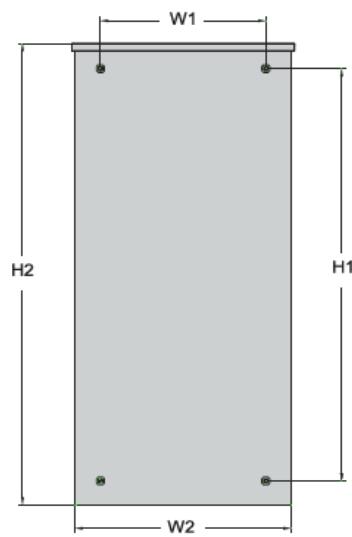

## 4 Architecture/Alarms

### 4.1 Interfaces and Alarming

The generator will be monitored by external alarms, conduit and cat five cables have to be installed from the Evolution Controllers Low Voltage Box located in the Generac generator to the appropriate cell site equipment. Nokia FSEB or FSEE and in Ericsson the SAU.


At a Nokia site, this connection is at the FSEB or an FSEE module. For the wiring diagram and instructions for the FSEB click the [Link](#) (The FSEE is the Nokia module that will be replacing the FSEB. For details on the FSEE contact: HQNokiaCellsiteDesigns@T-Moblie.com)

Ericsson sites will connect to the SAU module via OVP Expansion Kit for 8 External Alarms. Product number: UTOVP-ALM8EXP. For the wiring diagram and instructions for this click the [link](#)

The RXSC200A3 has auxiliary contacts that will facilitate the *ATS in Emergency position* alarm and will be a Normally Closed contact. Below is the wiring schematic for this contact and it can be found in the RXSC200A3 owners manual.

#### Auxiliary Contact

See [Figure 3-4](#). If desired, there is one normally-closed Auxiliary Contact (A) on the transfer switch to operate customer accessories, remote advisory lights, or remote annunciator devices. A suitable power source must be connected to the common terminal. If needed, an extra auxiliary contact can be added.

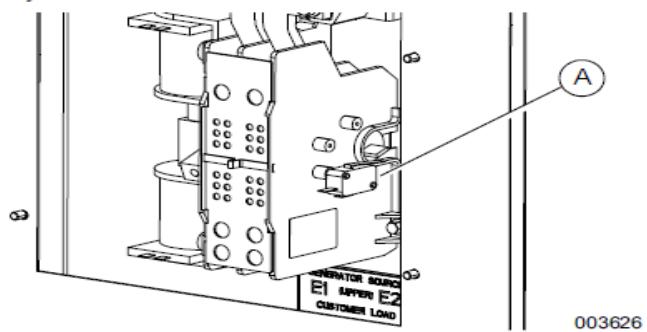

**Figure 3-4. Auxiliary Contact**

The auxiliary contact is normally closed when the transfer switch is in utility mode. The contacts will open when the transfer switch is in the standby power mode.

**NOTE:** Auxiliary Contact is rated 10 amps at 125 or 250 volts AC, and 0.6 amps at 125 volts DC.


#### CAUTION

Equipment damage. Exceeding rated voltage and current will damage the auxiliary contacts. Verify that voltage and current are within specification before energizing this equipment.

(000134a)

T-Mobile has four relays available from the Generac controller that are user-defined. T-Mobile can have four-alarm categories and a limitless number of subcategories. T-Mobile will utilize Normally Closed (NC) dry contacts for alarms in Low Voltage Connection box in the spare outputs section. Ericsson cabinets need to be equipped with the alarm expansion kit (UTOVP-ALM8EXP) to handle external alarms.

Customer Connections Inside the RD025

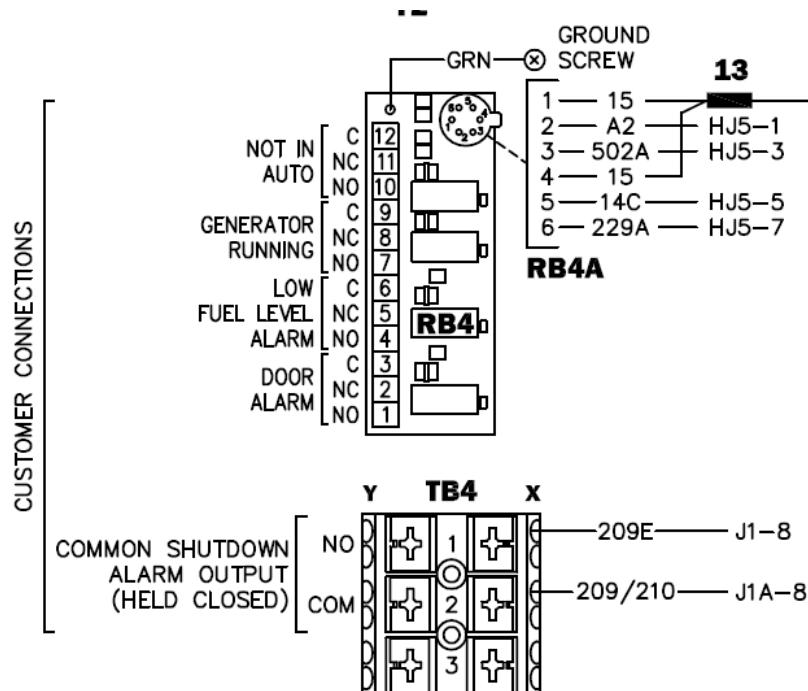

Ericsson UTOVP- ALM8EXP



UTOVP-ALM8EXP	OVP Expansion Kit for 8 External Alarms	Qty
<b>Product no</b>	<b>Denomination</b>	
UTOVP-ALM8EXP	OVP Expansion Kit for 8 External Alarms	1
NFD30234/08	OVERVOLTAGE ARRESTER/OVP-ALM 8	1
RPM777143/01200	CABLE WITH CONNECTOR/SIGNAL CABLE	2

Evolution Controller Customer Connections	Nokia FSEB Alarm Connections 13-24	T-Mobile Standard Alarms
NC#8-Gen Running	NC 4110 grd 4111 pin 13	Generator Running
NC#11-Not In Auto	NC 4110 grd 4111 pin 14	Generator Alarm Critical
NC#2-Door Alarm	NC 4110 grd 4111 pin 15	Generator Alarm NSI
NC#5-Low Fuel	NC 4110 grd 4111 pin 16	Low Fuel
RXSC200A3-Auxiliary Contacts	NC 4110 grd 4111 pin 17	ATS in Emergency Position

Evolution Controller Customer Connections	Ericsson Alarm 8expConnections	T-Mobile Standard Alarms
NC#8- Gen. Running	NC - A5	Generator Running
NC#11-Not In Auto	NC - A6	Generator Alarm Critical
NC#2-Door Alarm	NC - A7	Generator Alarm NSI
NC#5-Low Fuel	NC - A8	Low Fuel
RXSC200A3-Auxiliary Contacts	NC - A9	ATS in Emergency Position

## 5 Regulatory Requirements


Level 2 Acoustic Enclosure provides a noise level of 67.5dBA. It is EPA certified and meets NFPA 99 and 110 requirements(NFPA National Fire Protection Association). The RD025 generator engines is a tier 4 engine and meets the EPA final standards.


## 6 Configuration/Diagrams

The physical configuration of the Generator and the RXSC200A3 is, ATS before the PPC to ensure overcurrent protection when commercial power is restored. The RD025 and the RXSC200A3 has to be wired to Commercial AC power.

Commercial Power Connection Points  
On The RXSC200A3

**Interconnection Drawings**  
**No. 10000009574 (Part 1 of 2)—Liquid-Cooled Generator**

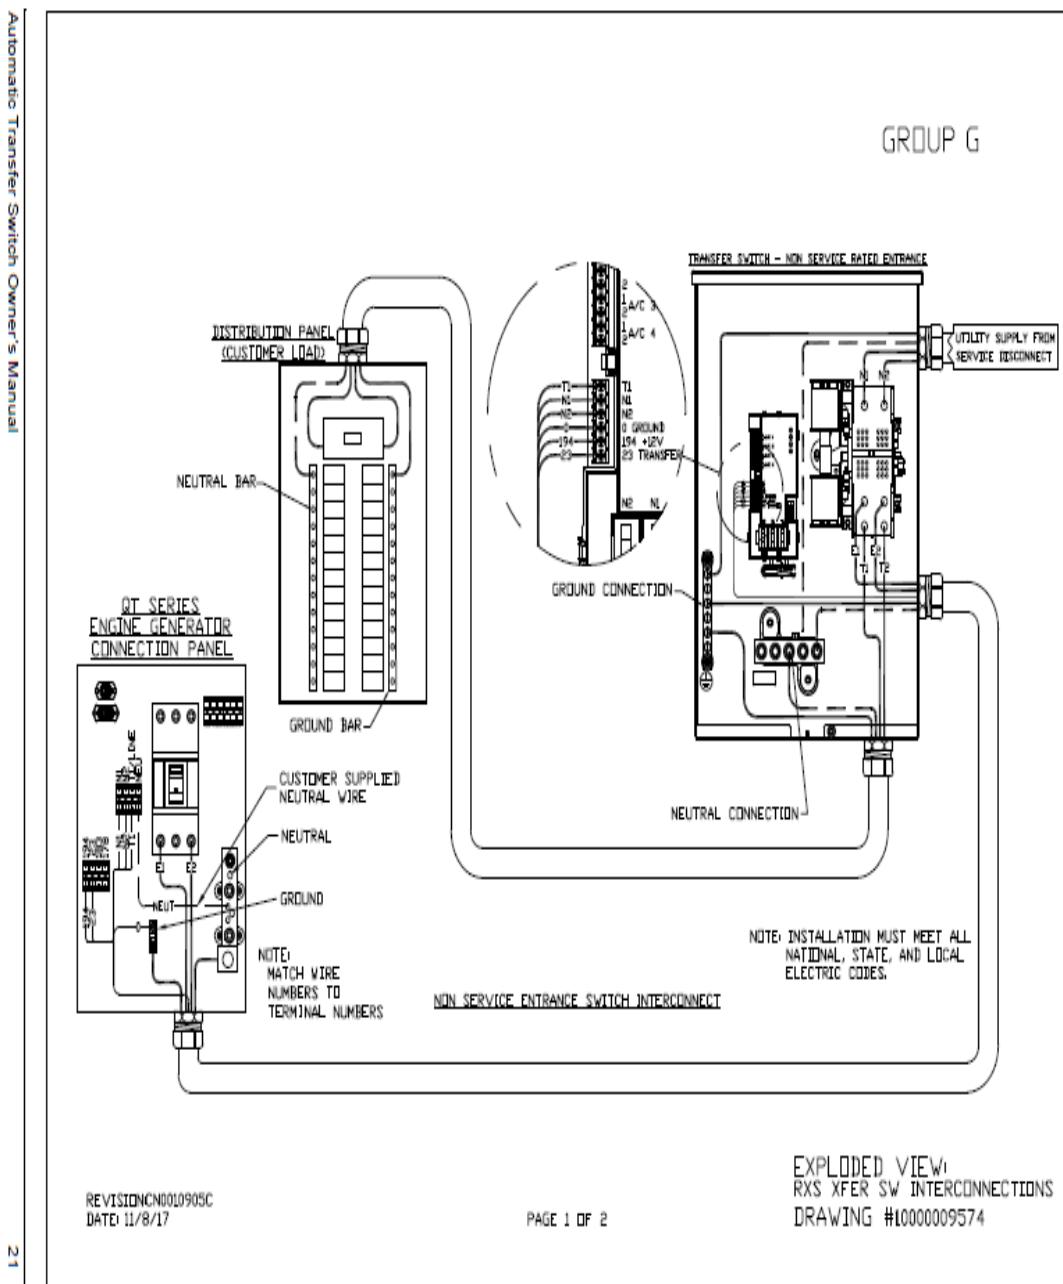

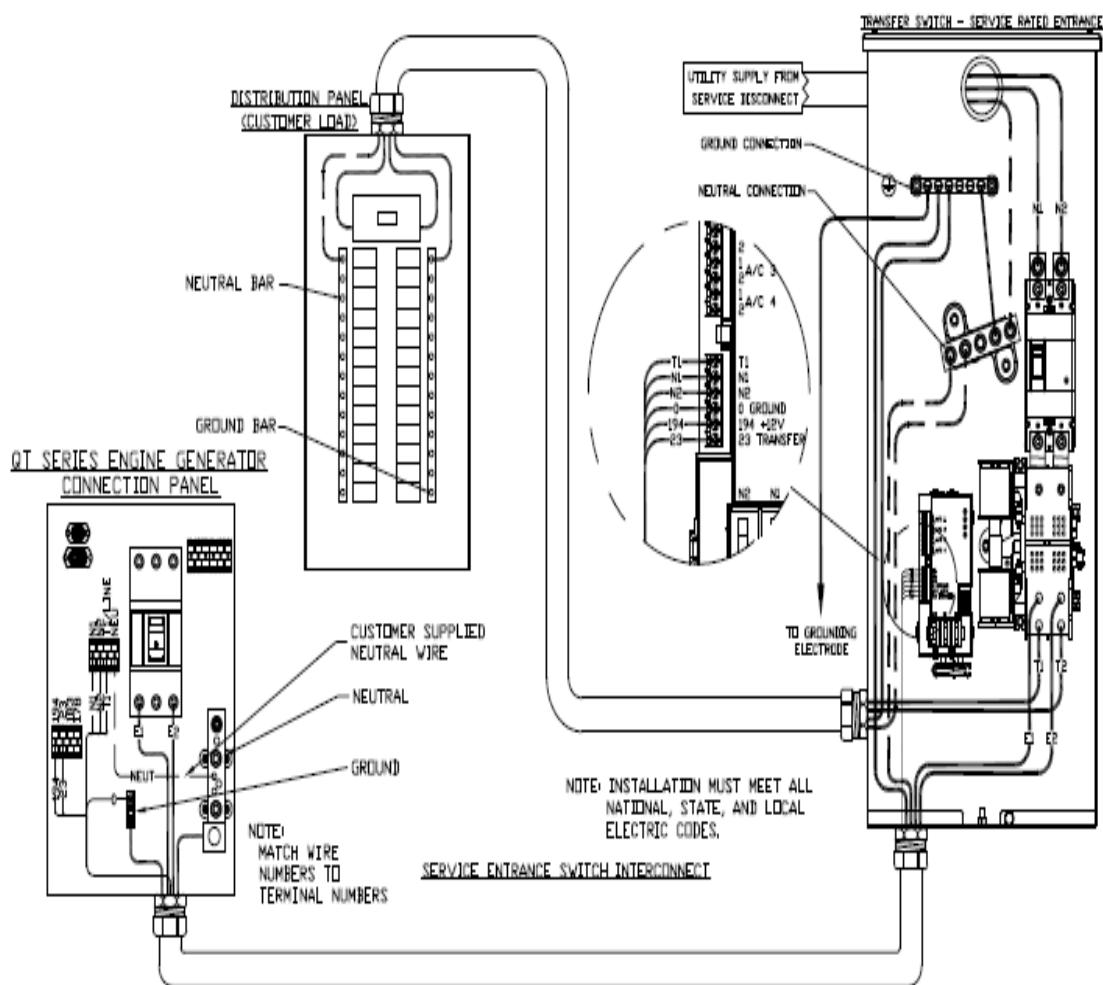


REVISION CN0010905C  
DATE: 11/8/17

PAGE 2 OF 2

EXPLODED VIEW:  
RXS XFER SW INTERCONNECTIONS  
DRAWING #10000009574

## Compound Diagram:

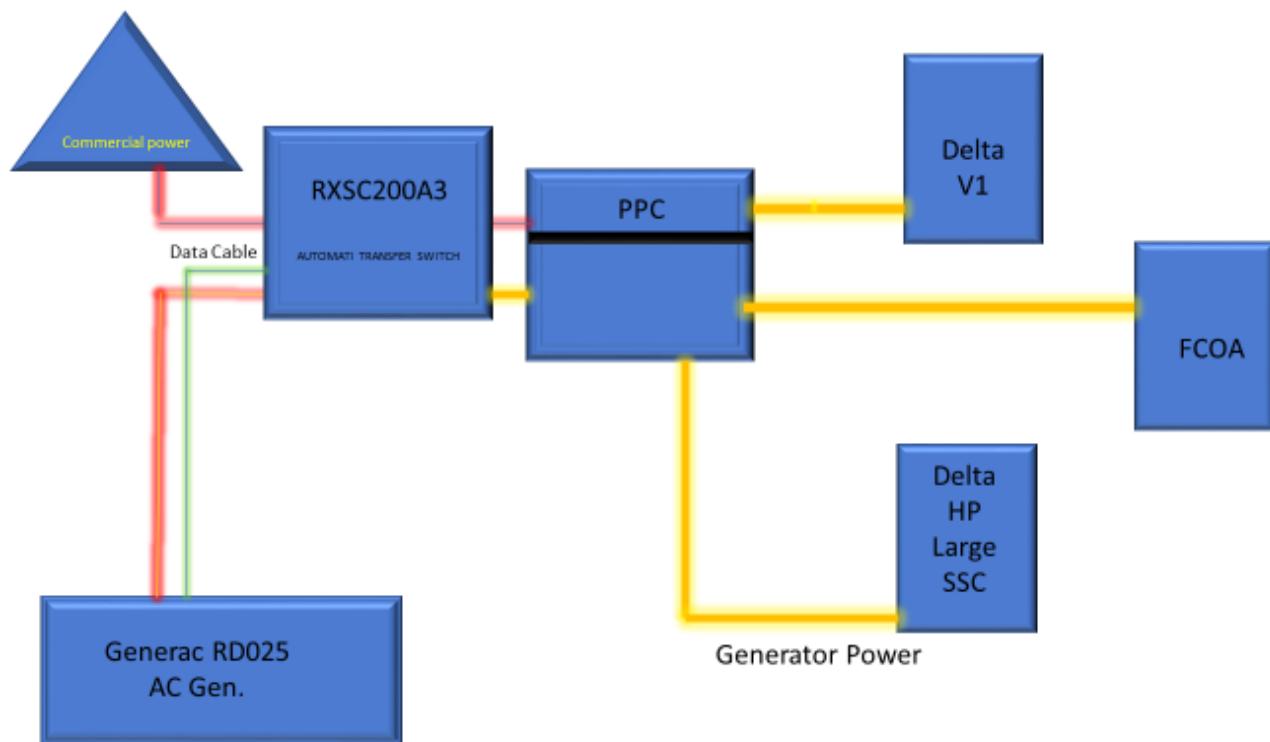

## 7 Maintenance

---


T-Mobile is recommending preventive maintenance to be performed every 250 hours of run-time or every 12 months, whichever comes first.

T-Mobile requires this minimum service checklist for the generator engine:

- Check engine mounts and support. Tighten fasteners.
- Check all the engine hoses and clamps for proper fit, and any signs of cracking and fatigue from wear.
- Inspect all belts for signs of cracking and fatigue from wear and adjust for proper tension.
- Inspect the exhaust system for leaks, burns and wet stacking. Drain exhaust line and tighten any clamps and flange bolts.
- Inspect silencer and plumbing for leaks, cracks or any other signs of wear.
- Inspect the system for fuel, oil and coolant leaks and signs of corrosion.
- Replace water separator.
- Replace water filter/ conditioner.
- Check Anti-Freeze (Spector-Analysis).
- Check coolant level and add, if needed.
- Inspect radiator mounting for signs or wear and cracking.
- Inspect/ clean air filter and change per manufacturer specifications.
- Inspect air intakes and outlets and tighten clamps and brackets, if applicable.
- Replace fuel filter.
- Inspect the carburetor fuel injection system, fuel injection pump and choke, if equipped. Adjust to manufacturers specifications.
- Change engine oil, oil filter and record the date on the filter casing.
- Check engine heater operation, if equipped.
- Check and adjust the battery charger operations, and charge rate within the manufacturer's recommended operating specifications.

- Inspect the battery housing, hardware connections, and cables for corrosion and wear.
- Check the battery electrolyte levels and specific gravity levels.
- Load test generator battery.
- Check, adjust and record generator output voltage, as necessary.
- Check and record the alternator charge rate.
- During inspection run the generator for 30 minutes under load. During this time, and after the engine is at full operational speed and has reached engine operating temperature; determine and record the condition of all inspection points: oil pressure, water/ coolant temperature, Fuel pressure, generator gauge, indicator operations, generator battery.
- Check the engine timing and adjust to manufacturers specifications, if necessary.
- Inspect, adjust and record governor and frequency, if necessary.
- Verify that the low fuel alarm is operational and configured correctly to trigger when the fuel tank reaches 50% of fuel tank capacity.

Check fuel level and refuel the generator during the preventive/ corrective maintenance visit.

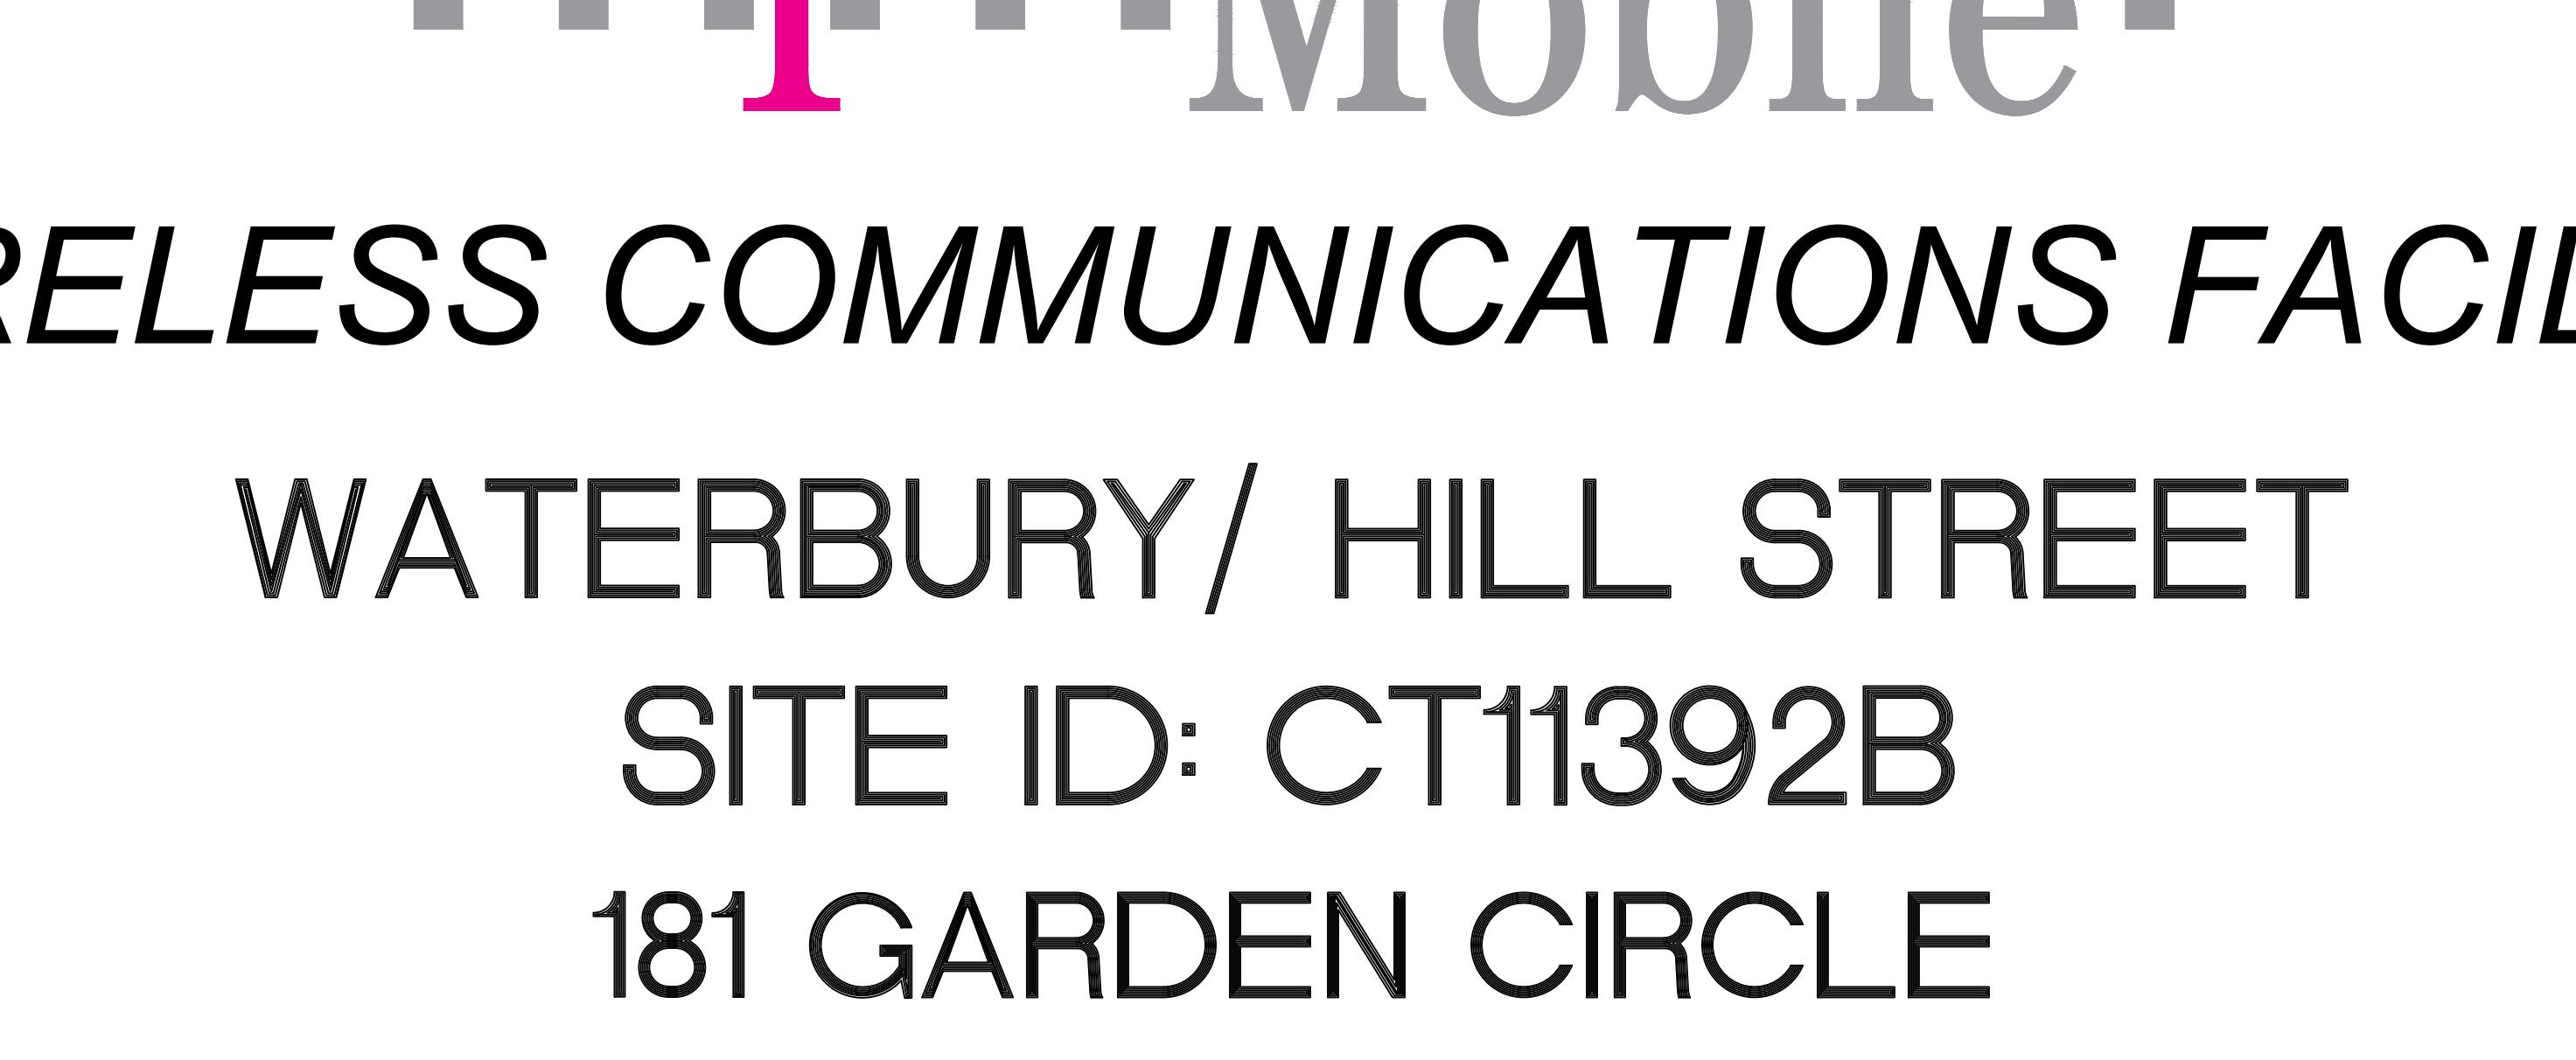

**WIRELESS COMMUNICATIONS FACILITY**  
**WATERBURY/ HILL STREET**  
**SITE ID: CT11392B**  
**181 GARDEN CIRCLE**  
**WATERBURY, CT 06704**

## GENERAL NOTES

1. ALL WORK SHALL BE IN ACCORDANCE WITH THE 2015 INTERNATIONAL BUILDING CODE AS MODIFIED BY THE 2018 CONNECTICUT SUPPLEMENT, INCLUDING THE TIA/EIA-222 REVISION "G" "STRUCTURAL STANDARDS FOR STEEL ANTENNA TOWERS AND SUPPORTING STRUCTURES." 2017 CONNECTICUT FIRE SAFETY CODE, NATIONAL ELECTRICAL CODE AND LOCAL CODES.
2. CONTRACTOR SHALL REVIEW ALL DRAWINGS AND SPECIFICATIONS IN THE CONTRACT DOCUMENT SET. CONTRACTOR SHALL COORDINATE ALL WORK SHOWN IN THE SET OF DRAWINGS. THE CONTRACTOR SHALL PROVIDE A COMPLETE SET OF DRAWINGS TO ALL SUBCONTRACTORS AND ALL RELATED PARTIES. THE SUBCONTRACTORS SHALL EXAMINE ALL THE DRAWINGS AND SPECIFICATIONS FOR THE INFORMATION THAT AFFECTS THEIR WORK.
3. CONTRACTOR SHALL PROVIDE A COMPLETE BUILD-OUT WITH ALL FINISHES, STRUCTURAL, MECHANICAL, AND ELECTRICAL COMPONENTS AND PROVIDE ALL ITEMS AS SHOWN OR INDICATED ON THE DRAWINGS OR IN THE WRITTEN SPECIFICATIONS.
4. CONTRACTOR SHALL FURNISH ALL MATERIAL, LABOR AND EQUIPMENT TO COMPLETE THE WORK AND FURNISH A COMPLETED JOB ALL IN ACCORDANCE WITH LOCAL AND STATE GOVERNING AUTHORITIES AND OTHER AUTHORITIES HAVING LAWFUL JURISDICTION OVER THE WORK.
5. CONTRACTOR SHALL SECURE AND PAY FOR ALL PERMITS AND ALL INSPECTIONS REQUIRED AND SHALL ALSO PAY FEES REQUIRED FOR THE GENERAL CONSTRUCTION, PLUMBING, ELECTRICAL AND HVAC. PERMITS SHALL BE PAID FOR BY THE RESPECTIVE SUBCONTRACTORS.
6. CONTRACTOR SHALL MAINTAIN A CURRENT SET OF DRAWINGS AND SPECIFICATIONS ON SITE AT ALL TIMES AND INSURE DISTRIBUTION OF NEW DRAWINGS TO SUBCONTRACTORS AND OTHER RELEVANT PARTIES AS SOON AS THEY ARE MADE AVAILABLE. ALL OLD DRAWINGS SHALL BE MARKED VOID AND REMOVED FROM THE CONTRACT AREA. THE CONTRACTOR SHALL FURNISH AN 'AS-BUILT' SET OF DRAWINGS TO OWNER UPON COMPLETION OF PROJECT.
7. LOCATION OF EQUIPMENT, AND WORK SUPPLIED BY OTHERS THAT IS DIAGRAMMATICALLY INDICATED ON THE DRAWINGS SHALL BE DETERMINED BY THE CONTRACTOR. THE CONTRACTOR SHALL DETERMINE LOCATIONS AND DIMENSIONS SUBJECT TO STRUCTURAL CONDITIONS AND WORK OF THE SUBCONTRACTORS.
8. THE CONTRACTOR IS SOLELY RESPONSIBLE TO DETERMINE CONSTRUCTION PROCEDURE AND SEQUENCE, AND TO ENSURE THE SAFETY OF THE EXISTING STRUCTURES AND ITS COMPONENT PARTS DURING CONSTRUCTION. THIS INCLUDES THE ADDITION OF WHATEVER SHORING, BRACING, UNDERPINNING, ETC. THAT MAY BE NECESSARY.
9. DRAWINGS INDICATE THE MINIMUM STANDARDS, BUT IF ANY WORK SHOULD BE INDICATED TO BE SUBSTANDARD TO ANY ORDINANCES, LAWS, CODES, RULES, OR REGULATIONS BEARING ON THE WORK, THE CONTRACTOR SHALL INCLUDE IN HIS WORK AND SHALL EXECUTE THE WORK CORRECTLY IN ACCORDANCE WITH SUCH ORDINANCES, LAWS, CODES, RULES OR REGULATIONS WITH NO INCREASE IN COSTS.
10. ALL UTILITY WORK SHALL BE IN ACCORDANCE WITH LOCAL UTILITY COMPANY REQUIREMENTS AND SPECIFICATIONS.

11. ALL EQUIPMENT AND PRODUCTS PURCHASED ARE TO BE REVIEWED BY CONTRACTOR AND ALL APPLICABLE SUBCONTRACTORS FOR ANY CONDITION PER MFR.'S RECOMMENDATIONS. CONTRACTOR TO SUPPLY THESE ITEMS AT NO COST TO OWNER OR CONSTRUCTION MANAGER.
12. ANY AND ALL ERRORS, DISCREPANCIES, AND 'MISSSED" ITEMS ARE TO BE BROUGHT TO THE ATTENTION OF THE T-MOBILE CONSTRUCTION MANAGER DURING THE BIDDING PROCESS BY THE CONTRACTOR. ALL THESE ITEMS ARE TO BE INCLUDED IN THE BID. NO 'EXTRA' WILL BE ALLOWED FOR MISSED ITEMS.
13. CONTRACTOR SHALL BE RESPONSIBLE FOR ALL ON-SITE SAFETY FROM THE TIME THE JOB IS AWARDED UNTIL ALL WORK IS COMPLETE AND ACCEPTED BY THE OWNER.
14. CONTRACTOR TO REVIEW ALL SHOP DRAWINGS AND SUBMIT COPY TO ENGINEER FOR APPROVAL. DRAWINGS MUST BEAR THE CHECKER'S INITIALS BEFORE SUBMITTING TO THE CONSTRUCTION MANAGER FOR REVIEW.
15. THE CONTRACTOR SHALL FIELD VERIFY ALL DIMENSIONS, ELEVATIONS, ANGLES, AND EXISTING CONDITIONS AT THE SITE, PRIOR TO FABRICATION AND/OR INSTALLATION OF ANY WORK IN THE CONTRACT AREA.
16. COORDINATION, LAYOUT, FURNISHING AND INSTALLATION OF CONDUIT AND ALL APPURTENANCES REQUIRED FOR PROPER INSTALLATION OF ELECTRICAL AND TELECOMMUNICATION SERVICE SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR.
17. ALL DAMAGE CAUSED TO ANY EXISTING STRUCTURE SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR. THE CONTRACTOR WILL BE HELD LIABLE FOR ALL REPAIRS REQUIRED FOR EXISTING STRUCTURES IF DAMAGED DURING CONSTRUCTION ACTIVITIES.
18. THE CONTRACTOR SHALL CONTACT "CALL BEFORE YOU DIG" AT LEAST 48 HOURS PRIOR TO ANY EXCAVATIONS AT 1-800-922-4455. ALL UTILITIES SHALL BE IDENTIFIED AND CLEARLY MARKED. CONTRACTOR SHALL MAINTAIN AND PROTECT MARKED UTILITIES THROUGHOUT PROJECT COMPLETION.
19. CONTRACTOR SHALL COMPLY WITH OWNERS ENVIRONMENTAL ENGINEER ON ALL METHODS AND PROVISIONS FOR ALL EXCAVATION ACTIVITIES INCLUDING SOIL DISPOSAL. ALL BACKFILL MATERIALS TO BE PROVIDED BY THE CONTRACTOR.

# SITE DIRECTIONS

**FROM:** 35 GRIFFIN ROAD SOUTH  
BLOOMFIELD, CT 06002

**TO:** 181 GARDEN CIRCLE  
WATERBURY, CT 06704

1. HEAD NORTH ON GRIFFIN ROAD S. TOWARD HARTMAN RD,	0.21 MI.
2. TAKE THE 2ND RIGHT ONTO DAY HILL RD,	0.14 MI.
3. TAKE THE 1ST RIGHT ONTO BLUE HILLS AVENUE EXT/CT-187,	1.89 MI.
4. TURN LEFT ONTO CT-305/OLD WINDSOR RD,	2.32 MI.
5. STAY STRAIGHT TO GO ONTO BLOOMFIELD AVE/CT-305,	0.01 MI.
6. MERGE ONTO I-91 S TOWARD HARTFORD,	5.66 MI.
7. MERGE ONTO I-84 W VIA EXIT 32A TOWARD WATERBURY,	13.29 MI.
8. KEEP LEFT TO TAKE I-84 TOWARD WATERBURY,	15.98 MI.
9. TAKE THE UNION ST EXIT, EXIT 22, TOWARD DOWNTOWN WATERBURY,	0.30 MI.
10. KEEP LEFT AT THE FORK IN THE RAMP,	0.03 MI.
11. TURN SLIGHT RIGHT ONTO BRASS MILL DR,	0.16 MI.
12. BRASS MILL DR BECOMES WELTON ST,	0.13 MI.
13. TURN RIGHT ONTO WALNUT ST,	0.50 MI.
14. TURN LEFT ONTO N WALNUT ST,	0.10 MI.
15. TAKE THE 1ST RIGHT ONTO DIVISION ST,	0.11 MI.
16. DIVISION ST BECOMES LONG HILL RD,	0.23 MI.
17. TURN LEFT ONTO WARNER ST,	0.18 MI.
18. TAKE THE 1ST RIGHT ONTO GARDEN CIR,	0.32 MI.
19. 181 GARDEN CIR IS ON THE LEFT.	

## PROJECT SUMMARY

1. THE PROPOSED SCOPE OF WORK CONSISTS OF A MODIFICATION TO THE EXISTING UNMANNED TELECOMMUNICATIONS FACILITY INCLUDING THE FOLLOWING:
  - A. INSTALL (1) NEW 25 KW DIESEL FUELED BACK-UP GENERATOR ON A NEW 10' x 4' CONCRETE PAD.
  - B. INSTALL (1) AUTOMATIC TRANSFER SWITCH

## PROJECT INFORMATION

SITE NAME: WATERBURY/ HILL STREET

SITE ID: CT11392B

SITE ADDRESS: 181 GARDEN CIRCLE  
WATERBURY, CT 06704


APPLICANT: T-MOBILE NORTHEAST, LLC  
75 GRIFFIN ROAD, SOUTH

35 CRIPPIN ROAD SOUTH  
BLOOMFIELD, CT 06002

CONTACT PERSON: DAN REID (PROJECT MANAGER)  
TRANSCEND WIRELESS, LLC  
(203) 592-8291

ENGINEER: CENTEK ENGINEERING, INC.  
63-2 NORTH BRANFORD RD.  
BRANFORD, CT 06405

PROJECT COORDINATES: LATITUDE: 41°-34'-11.04" N  
LONGITUDE: 72°-01'-01.55" W

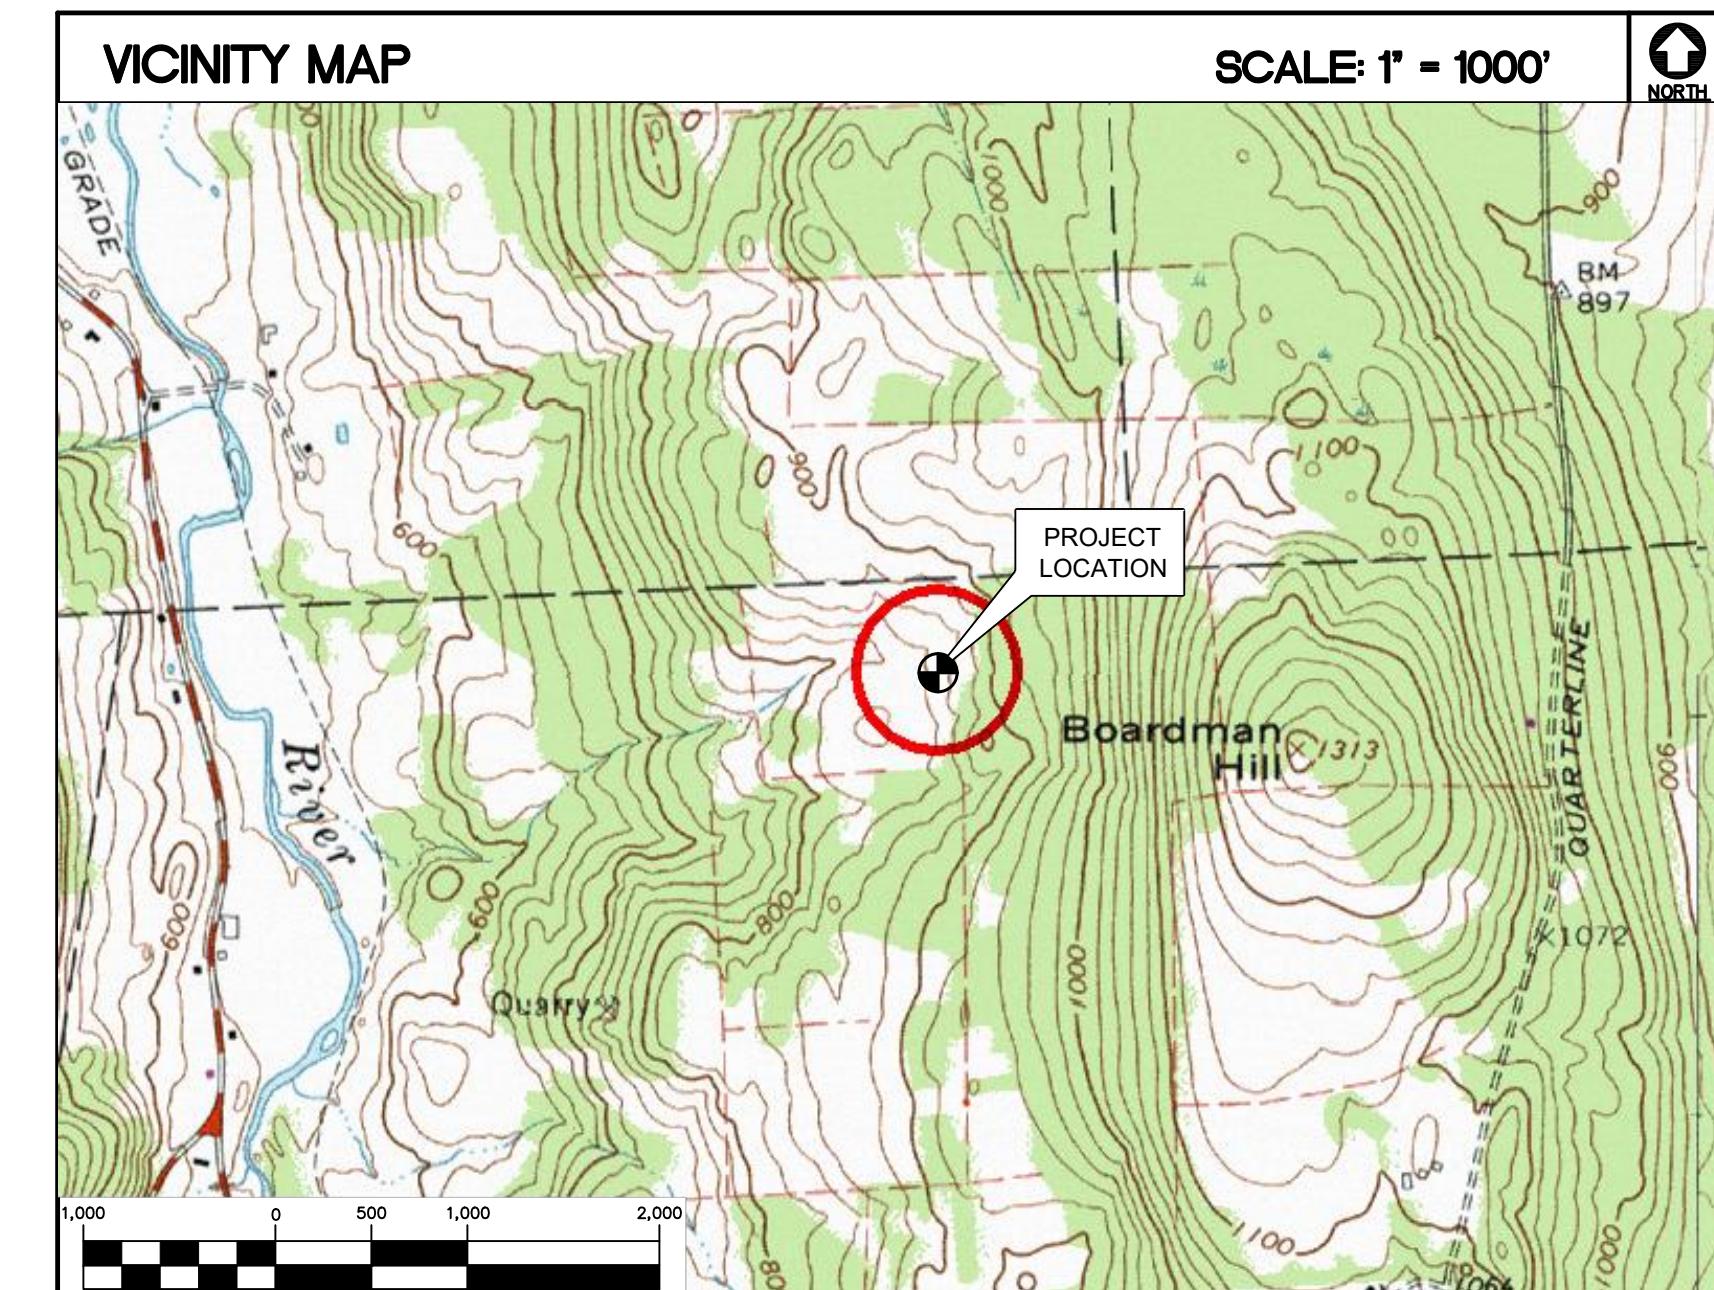

## **SHEET INDEX**

SHEET INDEX		
SHT. NO.	DESCRIPTION	REV.
T-1	TITLE SHEET	1
N-1	GENERAL NOTES AND SPECIFICATIONS	1
C-1	COMPOUND AND EQUIPMENT PLAN	1
C-2	TYPICAL DETAILS	1
E-1	ELECTRICAL DETAILS	1

PROFESSIONAL ENGINEER SEAL

**Centek** engineering

1000 10th Street, Suite 1000, Denver, CO 80203

800.333.3333 • 303.296.3333 • [www.CentekEng.com](http://www.CentekEng.com)

Engineering • Architecture • Construction Management

**-MOBILE NORTHEAST LLC**  
WIRELESS COMMUNICATIONS FACILITY  
**GARDEN CIRCLE**  
**SITE ID: CT11392B**  
**181 GARDEN CIRCLE**  
**WATERBURY, CT 06704**

DATE:	05/10/18
SCALE:	AS NOTED
JOB NO.	18079.23

# TITLE SHEET

---

## NOTES AND SPECIFICATIONS

### DESIGN BASIS:

GOVERNING CODE: 2015 INTERNATIONAL BUILDING (IBC) AS MODIFIED BY THE 2018 CONNECTICUT STATE BUILDING CODE.

#### 1. DESIGN CRITERIA:

- RISK CATEGORY II (BASED ON IBC TABLE 1604.5)
- NOMINAL DESIGN SPEED (OTHER STRUCTURE): 97 MPH (V<sub>asd</sub>) (EXPOSURE B/ IMPORTANCE FACTOR 1.0 BASED ON ASCE 7-10).

### SITE NOTES

1. THE CONTRACTOR SHALL CALL UTILITIES PRIOR TO THE START OF CONSTRUCTION.
2. ACTIVE EXISTING UTILITIES, WHERE ENCOUNTERED IN THE WORK, SHALL BE PROTECTED AT ALL TIMES. THE ENGINEER SHALL BE NOTIFIED IMMEDIATELY, PRIOR TO PROCEEDING SHOULD ANY UNCOVERED EXISTING UTILITY PRECLUDE COMPLETION OF THE WORK IN ACCORDANCE WITH THE CONTRACT DOCUMENTS.
3. THE AREAS OF THE COMPOUND DISTURBED BY THE WORK SHALL BE RETURNED TO THEIR ORIGINAL CONDITION.
4. CONTRACTOR SHALL MINIMIZE DISTURBANCE TO EXISTING SITE DURING CONSTRUCTION. EROSION CONTROL MEASURES, SHALL BE IN CONFORMANCE WITH THE LOCAL GUIDELINES FOR EROSION AND SEDIMENT CONTROL.
5. IF ANY FIELD CONDITIONS EXIST WHICH PRECLUDE COMPLIANCE WITH THE DRAWINGS, THE CONTRACTOR SHALL IMMEDIATELY NOTIFY THE ENGINEER AND SHALL PROCEED WITH AFFECTED WORK AFTER CONFLICT IS SATISFACTORILY RESOLVED.

6. CONTRACTOR SHALL MAINTAIN A CURRENT SET OF DRAWINGS AND SPECIFICATIONS ON SITE AT ALL TIMES AND INSURE DISTRIBUTION OF NEW DRAWINGS TO SUBCONTRACTORS AND OTHER RELEVANT PARTIES AS SOON AS THEY ARE MADE AVAILABLE. ALL OLD DRAWINGS SHALL BE MARKED VOID AND REMOVED FROM THE CONTRACT AREA. THE CONTRACTOR SHALL FURNISH AN 'AS-BUILT' SET OF DRAWINGS TO OWNER UPON COMPLETION OF PROJECT.
7. LOCATION OF EQUIPMENT AND WORK SUPPLIED BY OTHERS THAT IS DIAGRAMMATICALLY INDICATED ON THE DRAWINGS, SHALL BE DETERMINED BY THE CONTRACTOR. THE CONTRACTOR SHALL DETERMINE LOCATIONS AND DIMENSIONS SUBJECT TO STRUCTURAL CONDITIONS AND WORK OF THE SUBCONTRACTORS.
8. THE CONTRACTOR IS SOLELY RESPONSIBLE TO DETERMINE CONSTRUCTION PROCEDURE AND SEQUENCE, AND TO ENSURE THE SAFETY OF THE EXISTING STRUCTURES AND ITS COMPONENT PARTS DURING CONSTRUCTION. THIS INCLUDES THE ADDITION OF WHATEVER SHORING, BRACING, UNDERPINNING, ETC. THAT MAY BE NECESSARY.
9. DRAWINGS INDICATE THE MINIMUM STANDARDS, BUT IF ANY WORK SHOULD BE INDICATED TO BE SUBSTANDARD TO ANY ORDINANCES, LAWS, CODES, RULES, OR REGULATIONS BEARING ON THE WORK, THE CONTRACTOR SHALL INCLUDE IN HIS WORK AND SHALL EXECUTE THE WORK CORRECTLY IN ACCORDANCE WITH SUCH ORDINANCES, LAWS, CODES, RULES OR REGULATIONS WITH NO INCREASE IN COSTS.
10. ALL UTILITY WORK SHALL BE IN ACCORDANCE WITH LOCAL UTILITY COMPANY REQUIREMENTS AND SPECIFICATIONS.
11. ALL EQUIPMENT AND PRODUCTS PURCHASED ARE TO BE REVIEWED BY CONTRACTOR AND ALL APPLICABLE SUBCONTRACTORS FOR ANY CONDITION PER MFR'S RECOMMENDATIONS. CONTRACTOR TO SUPPLY THESE ITEMS AT NO COST TO OWNER OR CONSTRUCTION MANAGER.
12. ANY AND ALL ERRORS, DISCREPANCIES, AND "MISSED" ITEMS, ARE TO BE BROUGHT TO THE ATTENTION OF THE SITE OWNER'S CONSTRUCTION MANAGER DURING THE BIDDING PROCESS BY THE CONTRACTOR. ALL THESE ITEMS ARE TO BE INCLUDED IN THE BID. NO "EXTRA" WILL BE ALLOWED FOR MISSED ITEMS.
13. CONTRACTOR SHALL BE RESPONSIBLE FOR ALL ON-SITE SAFETY FROM THE TIME THE JOB IS AWARDED UNTIL ALL WORK IS COMPLETE AND ACCEPTED BY THE OWNER.
14. CONTRACTOR TO REVIEW ALL SHOP DRAWINGS AND SUBMIT COPY TO ENGINEER FOR APPROVAL. DRAWINGS MUST BEAR THE CHECKER'S INITIALS BEFORE SUBMITTING TO THE CONSTRUCTION MANAGER FOR REVIEW.
15. THE CONTRACTOR SHALL FIELD VERIFY ALL DIMENSIONS, ELEVATIONS, ANGLES, AND EXISTING CONDITIONS AT THE SITE, PRIOR TO FABRICATION AND/OR INSTALLATION OF ANY WORK IN THE CONTRACT AREA.
16. COORDINATION, LAYOUT, FURNISHING AND INSTALLATION OF CONDUIT AND ALL APPURTENANCES REQUIRED FOR PROPER INSTALLATION OF ELECTRICAL AND TELECOMMUNICATION SERVICE SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR.
17. ALL DAMAGE CAUSED TO ANY EXISTING STRUCTURE SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR. THE CONTRACTOR WILL BE HELD LIABLE FOR ALL REPAIRS REQUIRED FOR EXISTING STRUCTURES IF DAMAGED DURING CONSTRUCTION ACTIVITIES.
18. THE CONTRACTOR SHALL CONTACT 'CALL BEFORE YOU DIG' AT LEAST 48 HOURS PRIOR TO ANY EXCAVATIONS AT 1-800-922-4455. ALL UTILITIES SHALL BE IDENTIFIED AND CLEARLY MARKED. CONTRACTOR SHALL MAINTAIN AND PROTECT MARKED UTILITIES THROUGHOUT PROJECT COMPLETION.
19. CONTRACTOR SHALL COMPLY WITH OWNER'S ENVIRONMENTAL ENGINEER ON ALL METHODS AND PROVISIONS FOR ALL EXCAVATION ACTIVITIES INCLUDING SOIL DISPOSAL. ALL BACKFILL MATERIALS TO BE PROVIDED BY THE CONTRACTOR.
20. THE COUNTY/CITY/TOWN WILL MAKE PERIODIC FIELD OBSERVATION AND INSPECTIONS TO MONITOR THE INSTALLATION, MATERIALS, WORKMANSHIP AND EQUIPMENT INCORPORATED INTO THE PROJECT TO ENSURE COMPLIANCE WITH THE DESIGN PLANS, SPECIFICATIONS, CONTRACT DOCUMENTS AND APPROVED SHOP DRAWINGS.

### GENERAL NOTES

1. ALL WORK SHALL BE IN ACCORDANCE WITH THE 2015 INTERNATIONAL BUILDING CODE AS MODIFIED BY THE 2018 CONNECTICUT SUPPLEMENT, INCLUDING THE TIA/EIA-222 REVISION "G" "STRUCTURAL STANDARDS FOR STEEL ANTENNA TOWERS AND SUPPORTING STRUCTURES." 2017 CONNECTICUT FIRE SAFETY CODE, NATIONAL ELECTRICAL CODE AND LOCAL CODES.
2. CONTRACTOR SHALL REVIEW ALL DRAWINGS AND SPECIFICATIONS IN THE CONTRACT DOCUMENT SET. CONTRACTOR SHALL COORDINATE ALL WORK SHOWN IN THE SET OF DRAWINGS. THE CONTRACTOR SHALL PROVIDE A COMPLETE SET OF DRAWINGS TO ALL SUBCONTRACTORS AND ALL RELATED PARTIES. THE SUBCONTRACTORS SHALL EXAMINE ALL THE DRAWINGS AND SPECIFICATIONS FOR THE INFORMATION THAT AFFECTS THEIR WORK.
3. CONTRACTOR SHALL PROVIDE A COMPLETE BUILD-OUT WITH ALL FINISHES, STRUCTURAL, MECHANICAL, AND ELECTRICAL COMPONENTS AND PROVIDE ALL ITEMS AS SHOWN OR INDICATED ON THE DRAWINGS OR IN THE WRITTEN SPECIFICATIONS.
4. CONTRACTOR SHALL FURNISH ALL MATERIAL, LABOR AND EQUIPMENT TO COMPLETE THE WORK AND FURNISH A COMPLETED JOB ALL IN ACCORDANCE WITH LOCAL AND STATE GOVERNING AUTHORITIES AND OTHER AUTHORITIES HAVING LAWFUL JURISDICTION OVER THE WORK.
5. CONTRACTOR SHALL SECURE AND PAY FOR ALL PERMITS AND ALL INSPECTIONS REQUIRED AND SHALL ALSO PAY FEES REQUIRED FOR THE GENERAL CONSTRUCTION, PLUMBING, ELECTRICAL AND HVAC. PERMITS SHALL BE PAID FOR BY THE RESPECTIVE SUBCONTRACTORS.
6. CONTRACTOR SHALL MAINTAIN A CURRENT SET OF DRAWINGS AND SPECIFICATIONS ON SITE AT ALL TIMES AND INSURE DISTRIBUTION OF NEW DRAWINGS TO SUBCONTRACTORS AND OTHER RELEVANT PARTIES AS SOON AS THEY ARE MADE AVAILABLE. ALL OLD DRAWINGS SHALL BE MARKED VOID AND REMOVED FROM THE CONTRACT AREA. THE CONTRACTOR SHALL FURNISH AN 'AS-BUILT' SET OF DRAWINGS TO OWNER UPON COMPLETION OF PROJECT.
7. LOCATION OF EQUIPMENT AND WORK SUPPLIED BY OTHERS THAT IS DIAGRAMMATICALLY INDICATED ON THE DRAWINGS, SHALL BE DETERMINED BY THE CONTRACTOR. THE CONTRACTOR SHALL DETERMINE LOCATIONS AND DIMENSIONS SUBJECT TO STRUCTURAL CONDITIONS AND WORK OF THE SUBCONTRACTORS.
8. THE CONTRACTOR IS SOLELY RESPONSIBLE TO DETERMINE CONSTRUCTION PROCEDURE AND SEQUENCE, AND TO ENSURE THE SAFETY OF THE EXISTING STRUCTURES AND ITS COMPONENT PARTS DURING CONSTRUCTION. THIS INCLUDES THE ADDITION OF WHATEVER SHORING, BRACING, UNDERPINNING, ETC. THAT MAY BE NECESSARY.
9. DRAWINGS INDICATE THE MINIMUM STANDARDS, BUT IF ANY WORK SHOULD BE INDICATED TO BE SUBSTANDARD TO ANY ORDINANCES, LAWS, CODES, RULES, OR REGULATIONS BEARING ON THE WORK, THE CONTRACTOR SHALL INCLUDE IN HIS WORK AND SHALL EXECUTE THE WORK CORRECTLY IN ACCORDANCE WITH SUCH ORDINANCES, LAWS, CODES, RULES OR REGULATIONS WITH NO INCREASE IN COSTS.
10. ALL UTILITY WORK SHALL BE IN ACCORDANCE WITH LOCAL UTILITY COMPANY REQUIREMENTS AND SPECIFICATIONS.
11. ALL EQUIPMENT AND PRODUCTS PURCHASED ARE TO BE REVIEWED BY CONTRACTOR AND ALL APPLICABLE SUBCONTRACTORS FOR ANY CONDITION PER MFR'S RECOMMENDATIONS. CONTRACTOR TO SUPPLY THESE ITEMS AT NO COST TO OWNER OR CONSTRUCTION MANAGER.
12. ANY AND ALL ERRORS, DISCREPANCIES, AND "MISSED" ITEMS, ARE TO BE BROUGHT TO THE ATTENTION OF THE SITE OWNER'S CONSTRUCTION MANAGER DURING THE BIDDING PROCESS BY THE CONTRACTOR. ALL THESE ITEMS ARE TO BE INCLUDED IN THE BID. NO "EXTRA" WILL BE ALLOWED FOR MISSED ITEMS.
13. CONTRACTOR SHALL BE RESPONSIBLE FOR ALL ON-SITE SAFETY FROM THE TIME THE JOB IS AWARDED UNTIL ALL WORK IS COMPLETE AND ACCEPTED BY THE OWNER.
14. CONTRACTOR TO REVIEW ALL SHOP DRAWINGS AND SUBMIT COPY TO ENGINEER FOR APPROVAL. DRAWINGS MUST BEAR THE CHECKER'S INITIALS BEFORE SUBMITTING TO THE CONSTRUCTION MANAGER FOR REVIEW.
15. THE CONTRACTOR SHALL FIELD VERIFY ALL DIMENSIONS, ELEVATIONS, ANGLES, AND EXISTING CONDITIONS AT THE SITE, PRIOR TO FABRICATION AND/OR INSTALLATION OF ANY WORK IN THE CONTRACT AREA.
16. COORDINATION, LAYOUT, FURNISHING AND INSTALLATION OF CONDUIT AND ALL APPURTENANCES REQUIRED FOR PROPER INSTALLATION OF ELECTRICAL AND TELECOMMUNICATION SERVICE SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR.
17. ALL DAMAGE CAUSED TO ANY EXISTING STRUCTURE SHALL BE THE SOLE RESPONSIBILITY OF THE CONTRACTOR. THE CONTRACTOR WILL BE HELD LIABLE FOR ALL REPAIRS REQUIRED FOR EXISTING STRUCTURES IF DAMAGED DURING CONSTRUCTION ACTIVITIES.
18. THE CONTRACTOR SHALL CONTACT 'CALL BEFORE YOU DIG' AT LEAST 48 HOURS PRIOR TO ANY EXCAVATIONS AT 1-800-922-4455. ALL UTILITIES SHALL BE IDENTIFIED AND CLEARLY MARKED. CONTRACTOR SHALL MAINTAIN AND PROTECT MARKED UTILITIES THROUGHOUT PROJECT COMPLETION.
19. CONTRACTOR SHALL COMPLY WITH OWNER'S ENVIRONMENTAL ENGINEER ON ALL METHODS AND PROVISIONS FOR ALL EXCAVATION ACTIVITIES INCLUDING SOIL DISPOSAL. ALL BACKFILL MATERIALS TO BE PROVIDED BY THE CONTRACTOR.
20. THE COUNTY/CITY/TOWN MUST BE NOTIFIED (2) WORKING DAYS PRIOR TO CONCEALMENT/BURIAL OF ANY SYSTEM OR MATERIAL THAT WILL PREVENT THE DIRECT INSPECTION OF MATERIALS, METHODS OR WORKMANSHIP. EXAMPLES OF THESE PROCESSES ARE BACKFILLING A GROUND RING OR TOWER FOUNDATION, POURING TOWER FOUNDATIONS, BURYING GROUND RODS, PLATES OR GRIDS, ETC. THE CONTRACTOR MAY PROCEED WITH THE SCHEDULED PROCESS (2) WORKING DAYS AFTER PROVIDING NOTICE UNLESS NOTIFIED OTHERWISE BY THE COUNTY/CITY/TOWN.

**T-MOBILE NORTHEAST LLC**  
WIRELESS COMMUNICATIONS FACILITY  
**GARDEN CIRCLE**  
**SITE ID: CT1392B**  
181 GARDEN CIRCLE  
WATERBURY, CT 06704




DATE: 05/10/18  
SCALE: AS NOTED  
JOB NO. 18079.23

DESIGN BASIS  
AND SITE NOTES

**N-1**  
Sheet No. 2 of 5

**CENTEK** engineering  
Centek on Solutions  
(203) 484-1580  
(203) 484-5850  
632 North Bedford Road  
Branford, CT 06405  
www.CentekEng.com

PROFESSIONAL ENGINEER SEAL  
STATE OF CONNECTICUT  
PROFESSIONAL ENGINEER  
01/15/21  
05/11/18  
DRAWN BY CHKD BY  
REV. DATE  
TUR CAC ISSUED FOR CONSTRUCTION  
ISSUED FOR CLIENT REVIEW  
BY DESCRIPTION

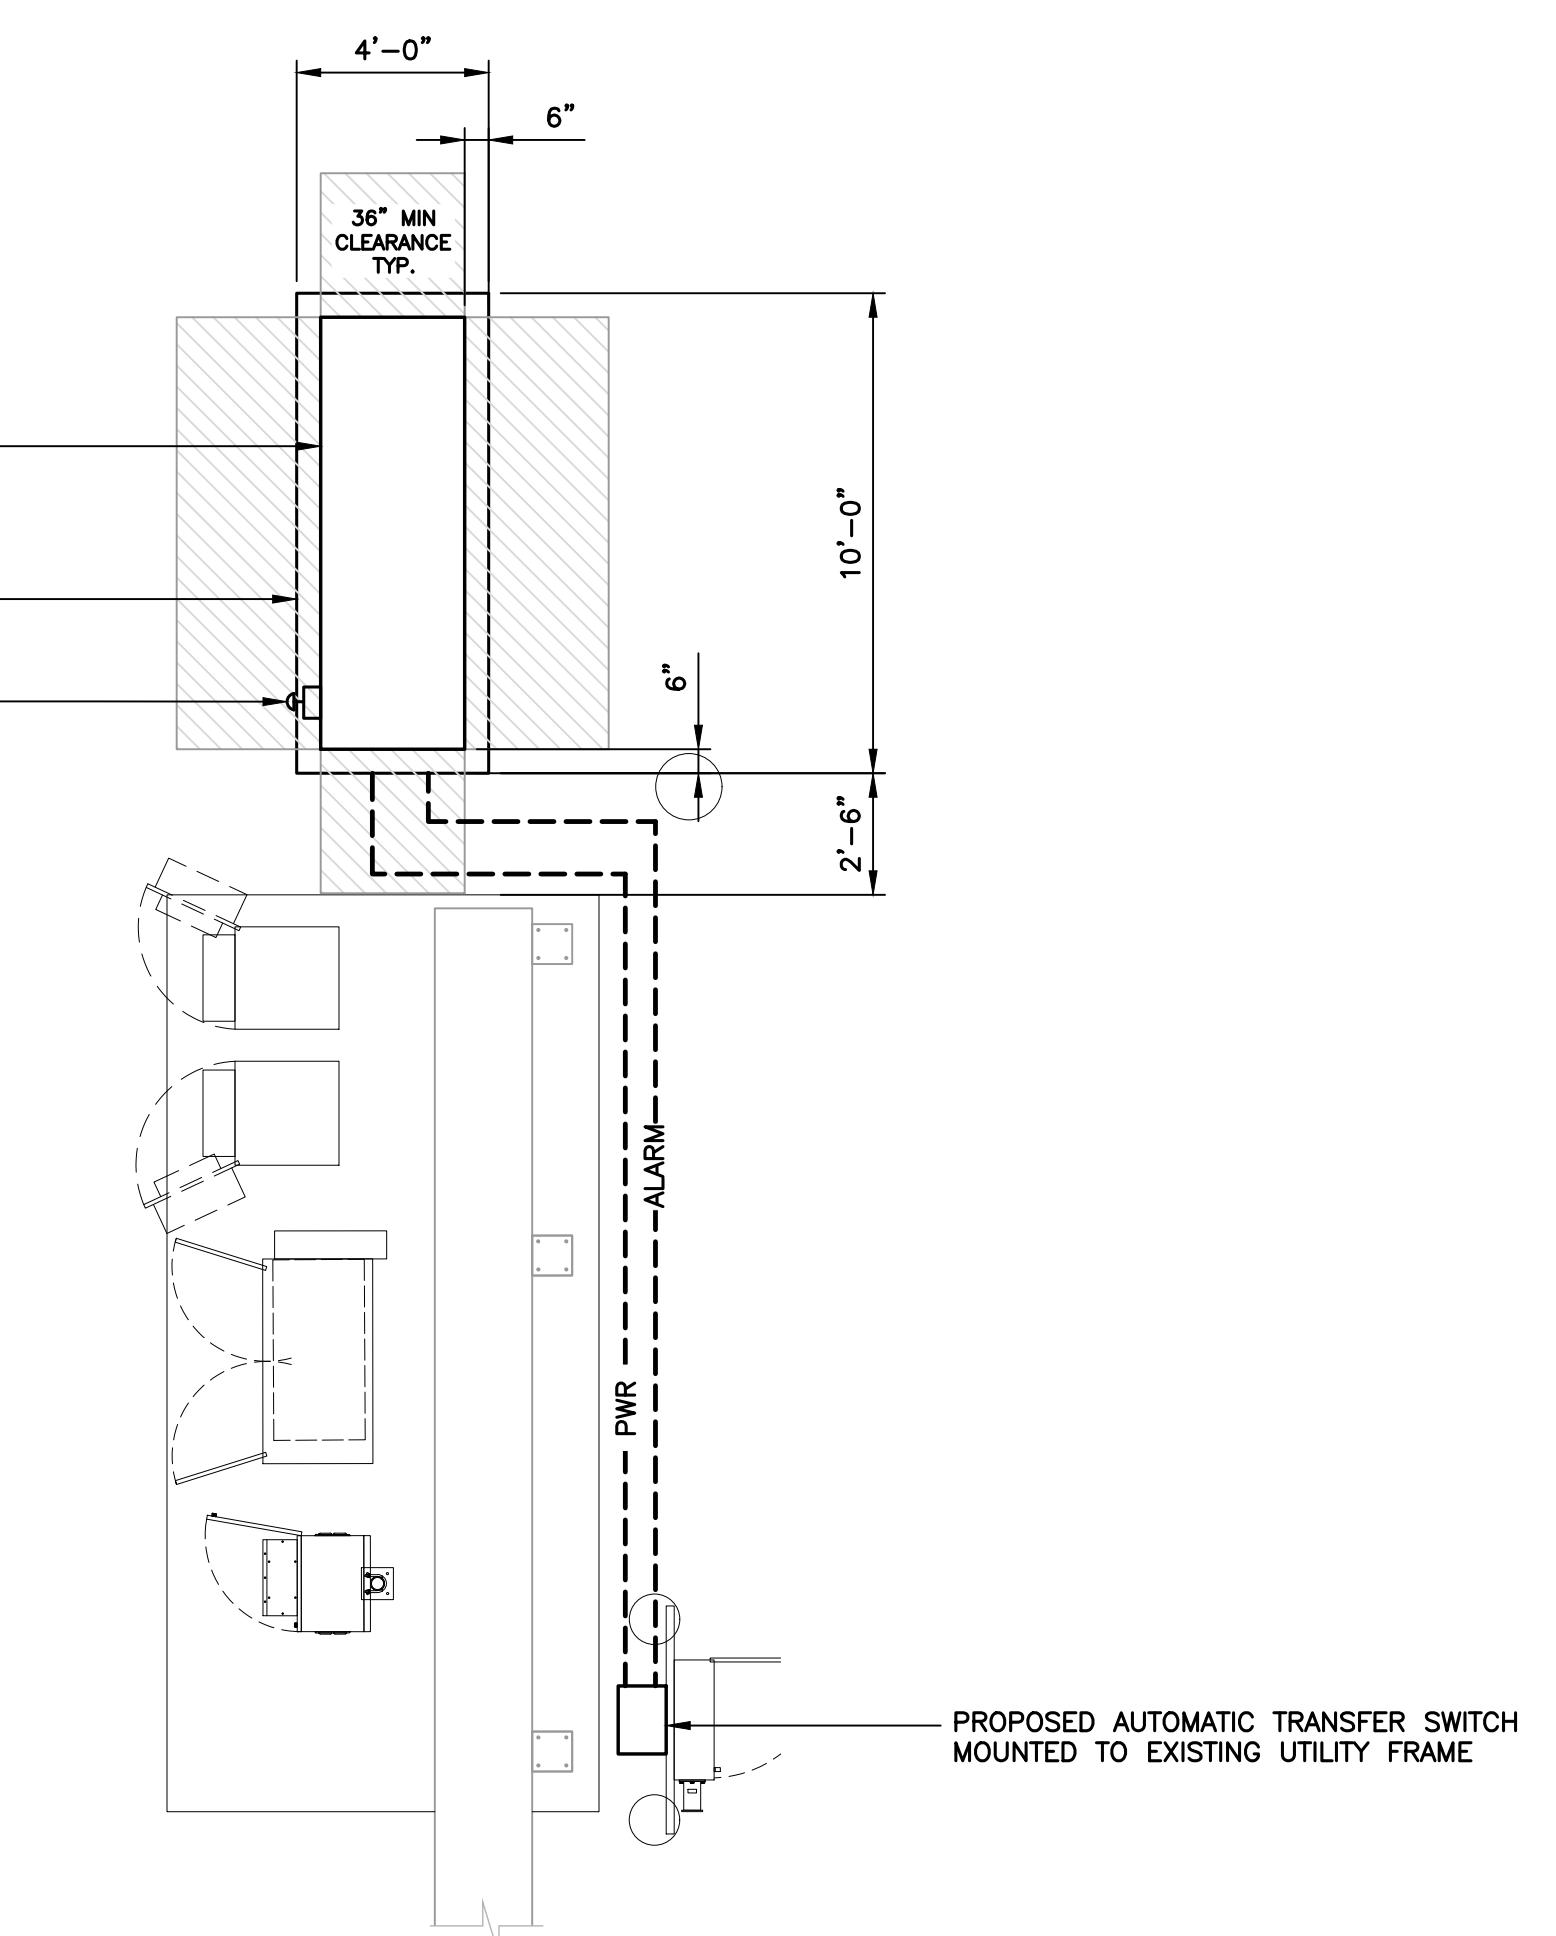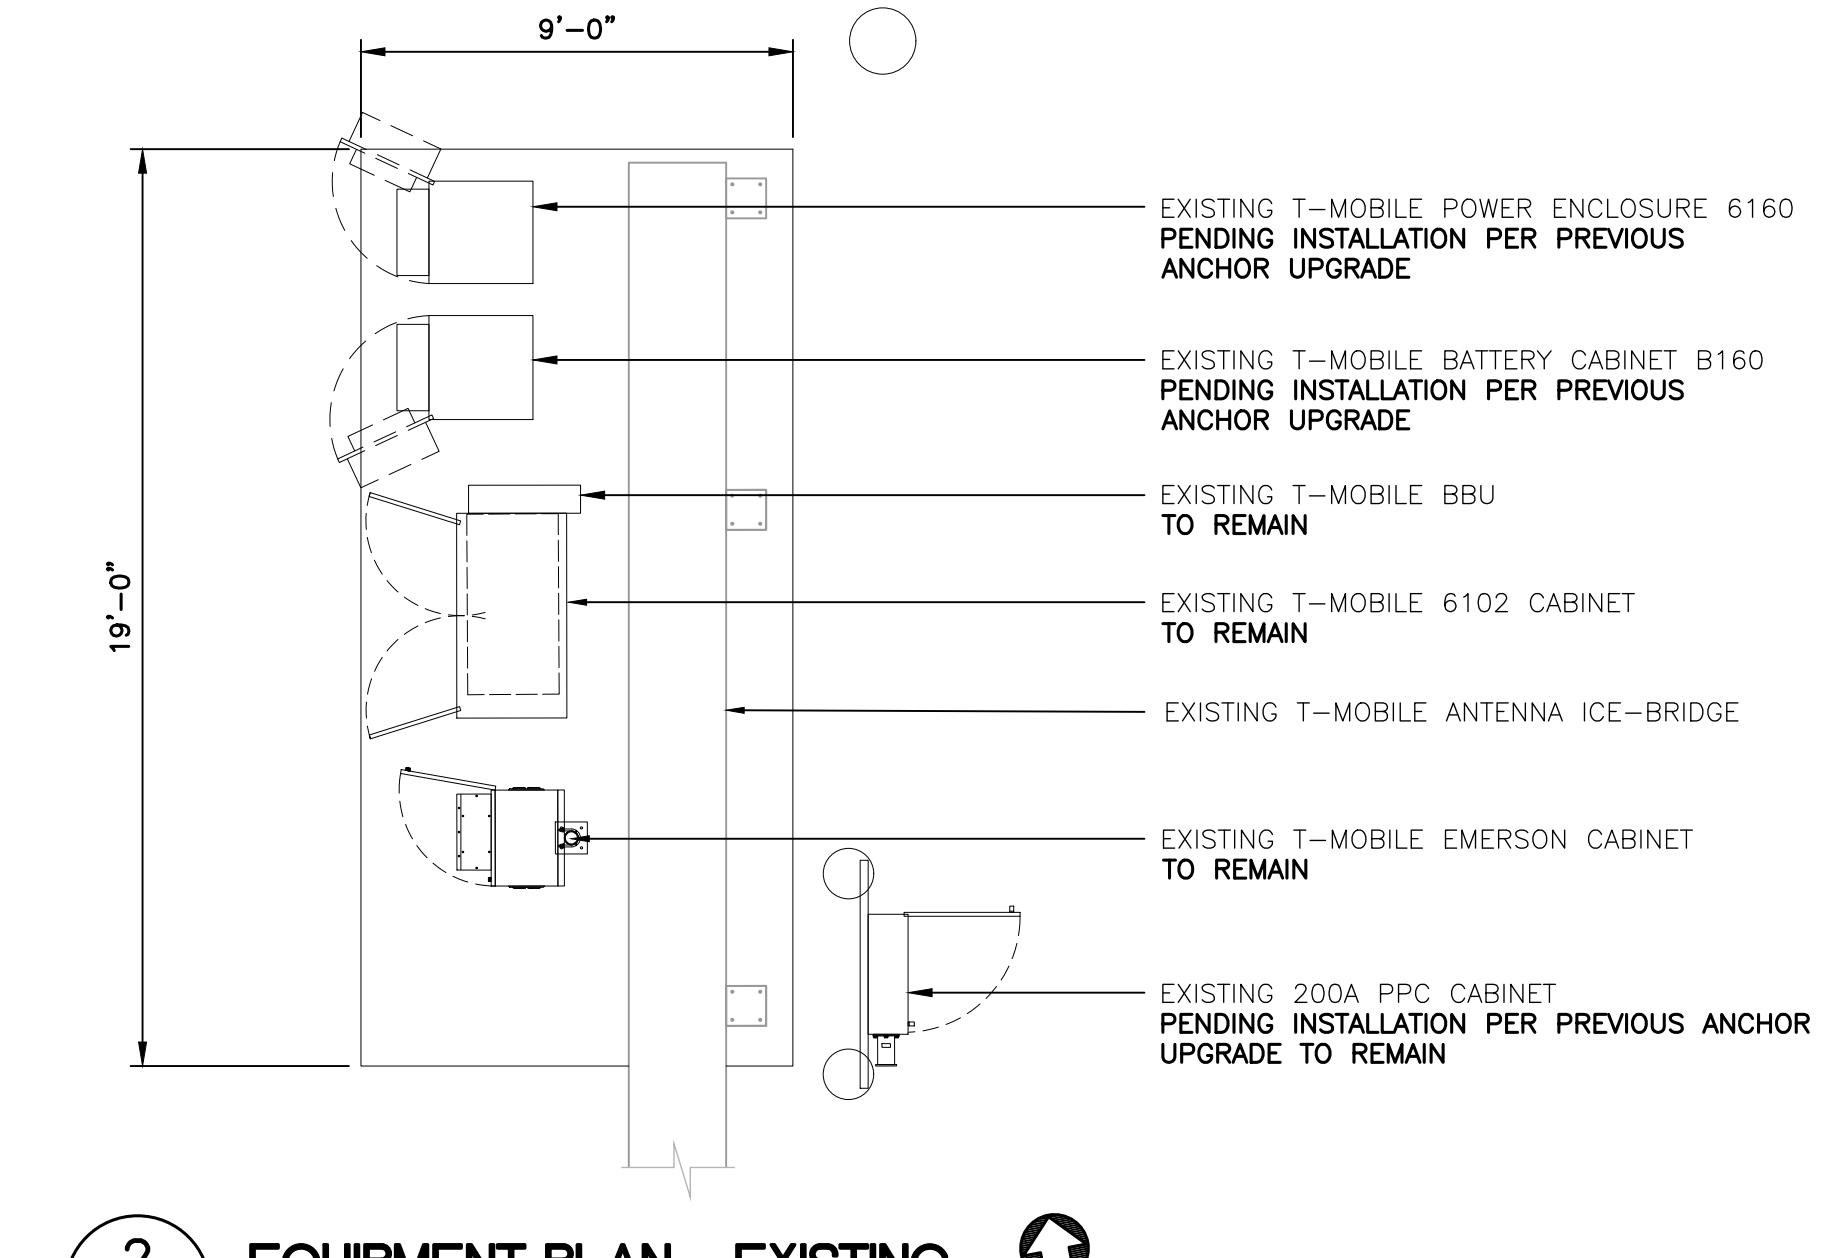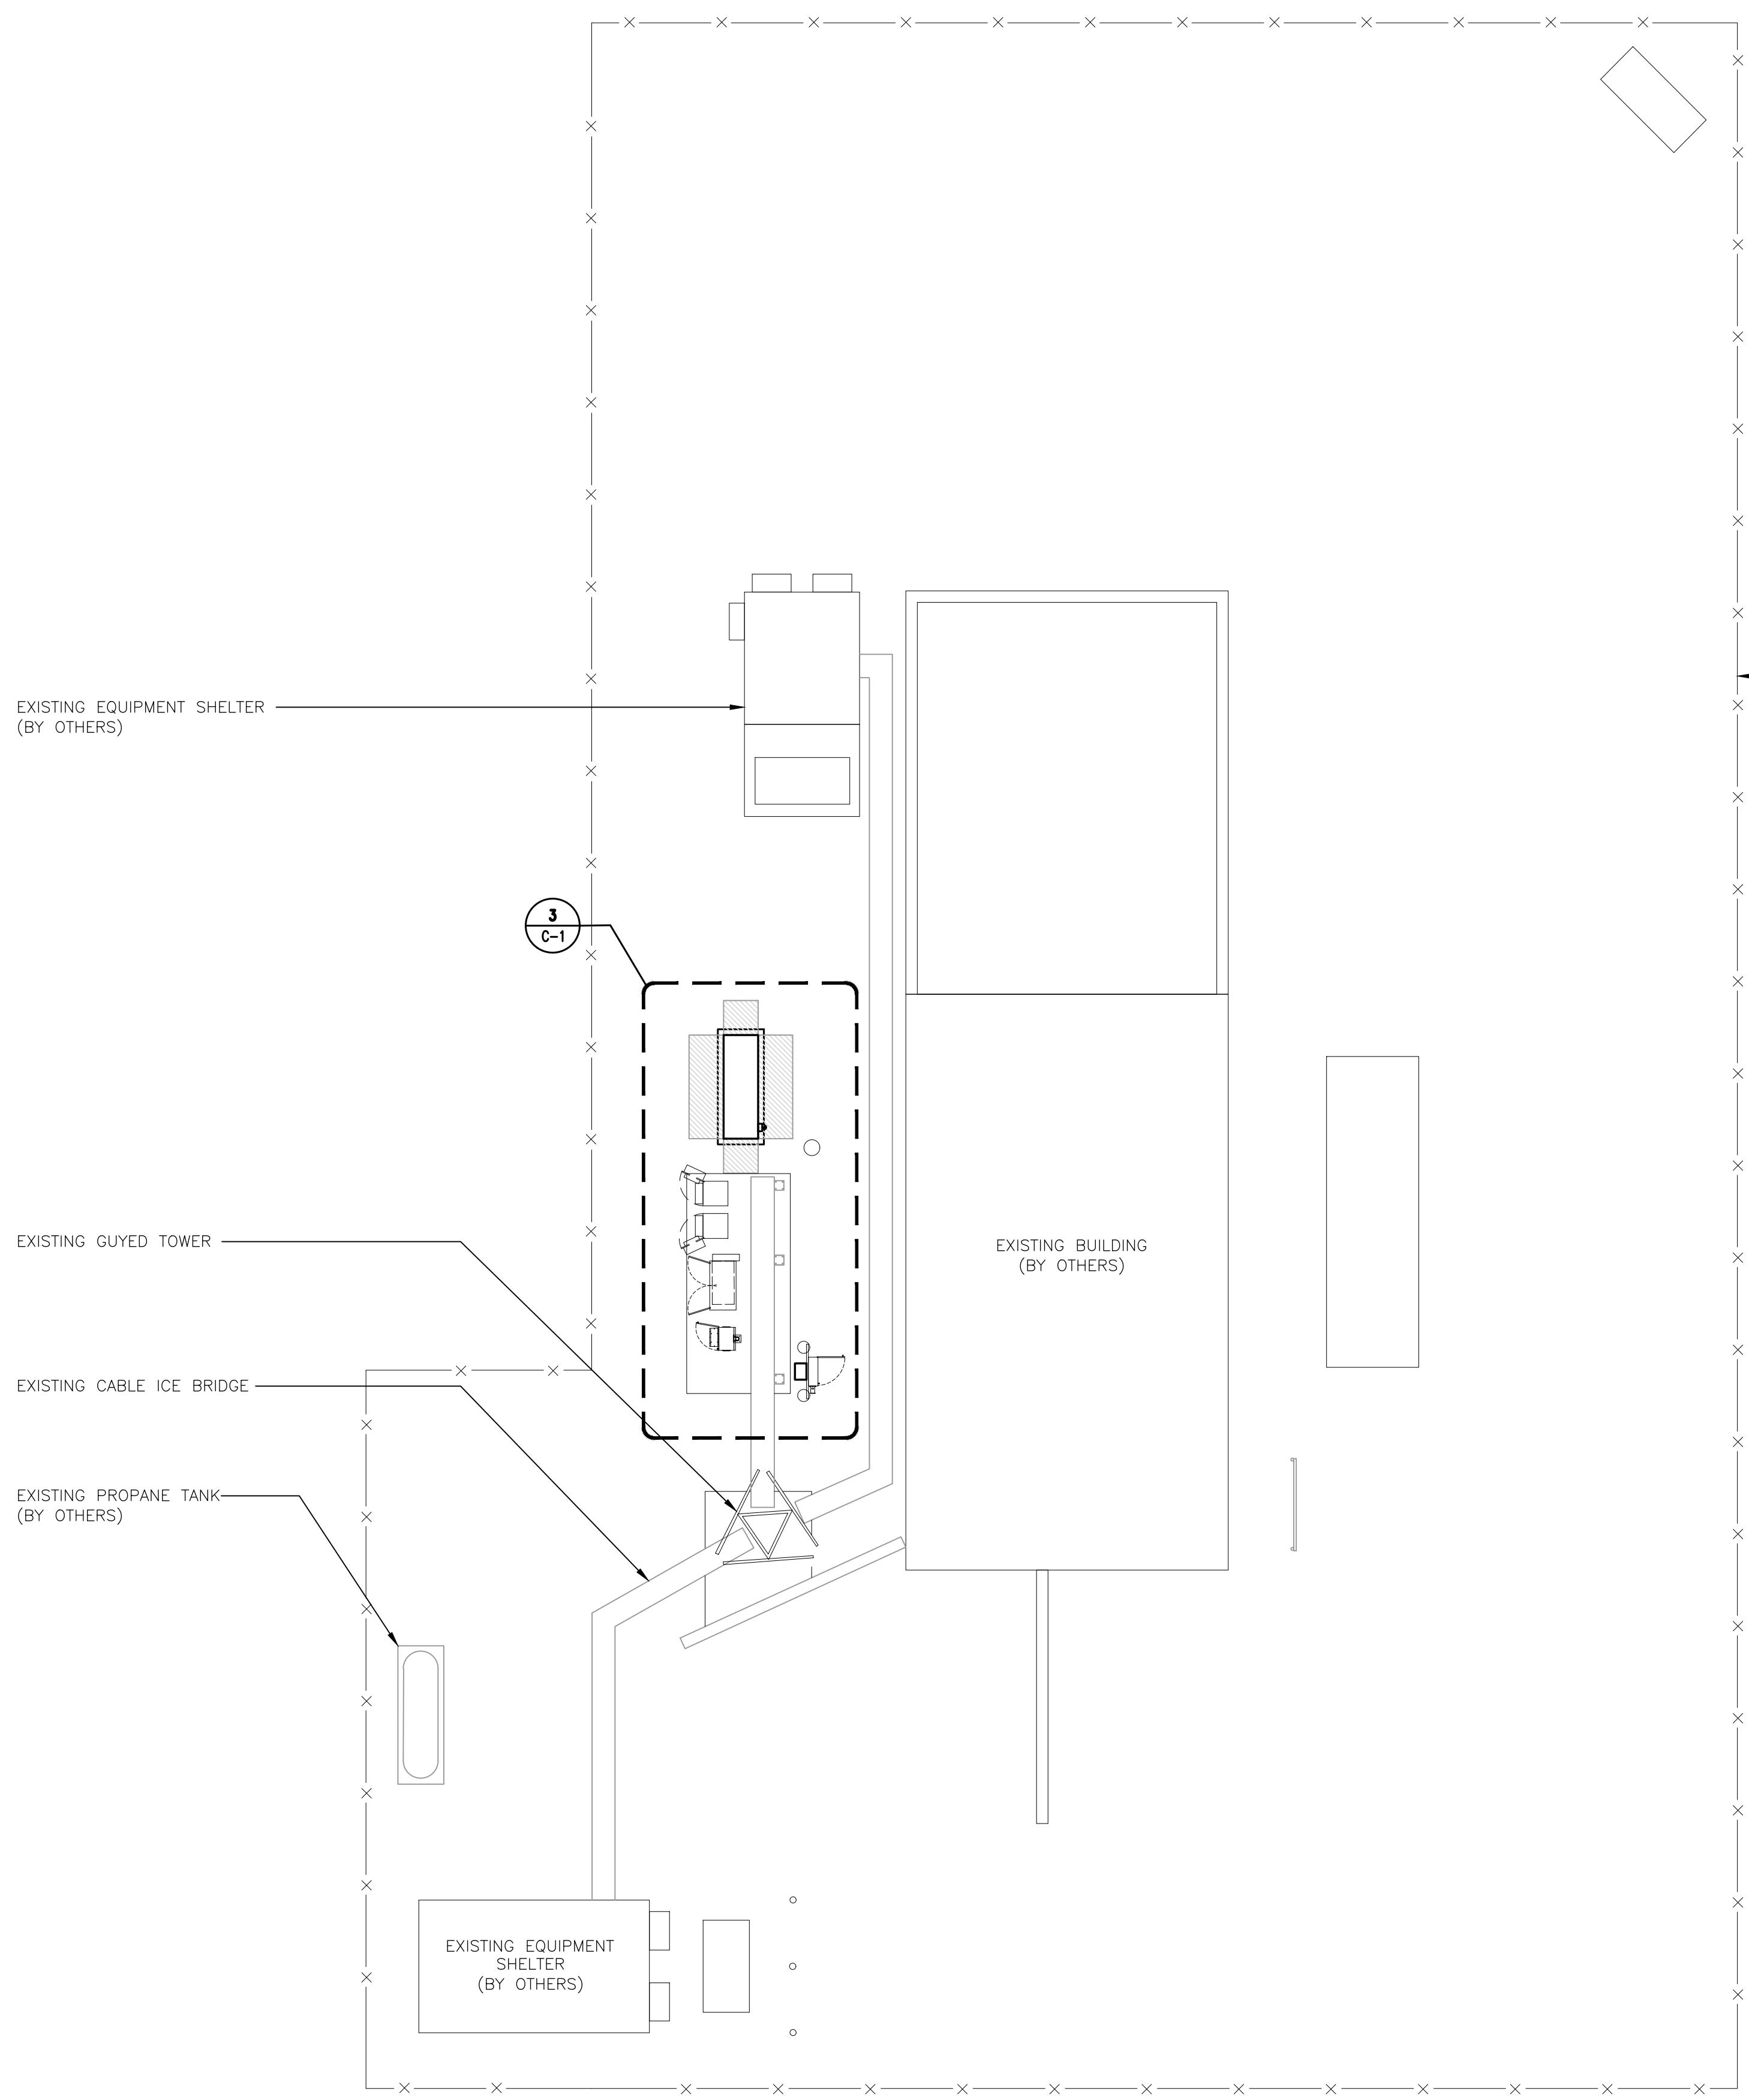

PROFESSIONAL ENGINEER SEAL	STATE OF CONNECTICUT	RECEIVED	ISSUED FOR CLIENT REVIEW
01/15/21	RTS	TUR	ISSUED FOR CONSTRUCTION
05/11/18	CCR	CAC	DRAWN BY CHKD BY DESCRIPTION
REV. DATE	DATE	DRAWN BY	CHKD BY

**T-MOBILE NORTHEAST LLC**  
WIRELESS COMMUNICATIONS FACILITY  
**GARDEN CIRCLE**  
**SITE ID: CT1392B**  
181 GARDEN CIRCLE  
WATERBURY, CT 06704


**CENTEK engineering**  
Centek on Solutions  
(203) 484-1580  
(203) 484-8489 Fax  
632 North Bedford Road  
Bentford, CT 06405  
www.CentekEng.com

DATE: 05/10/18  
SCALE: AS NOTED  
JOB NO. 18079.23

COMPOND AND EQUIPMENT PLAN

**C-1**


Sheet No. 3 of 5

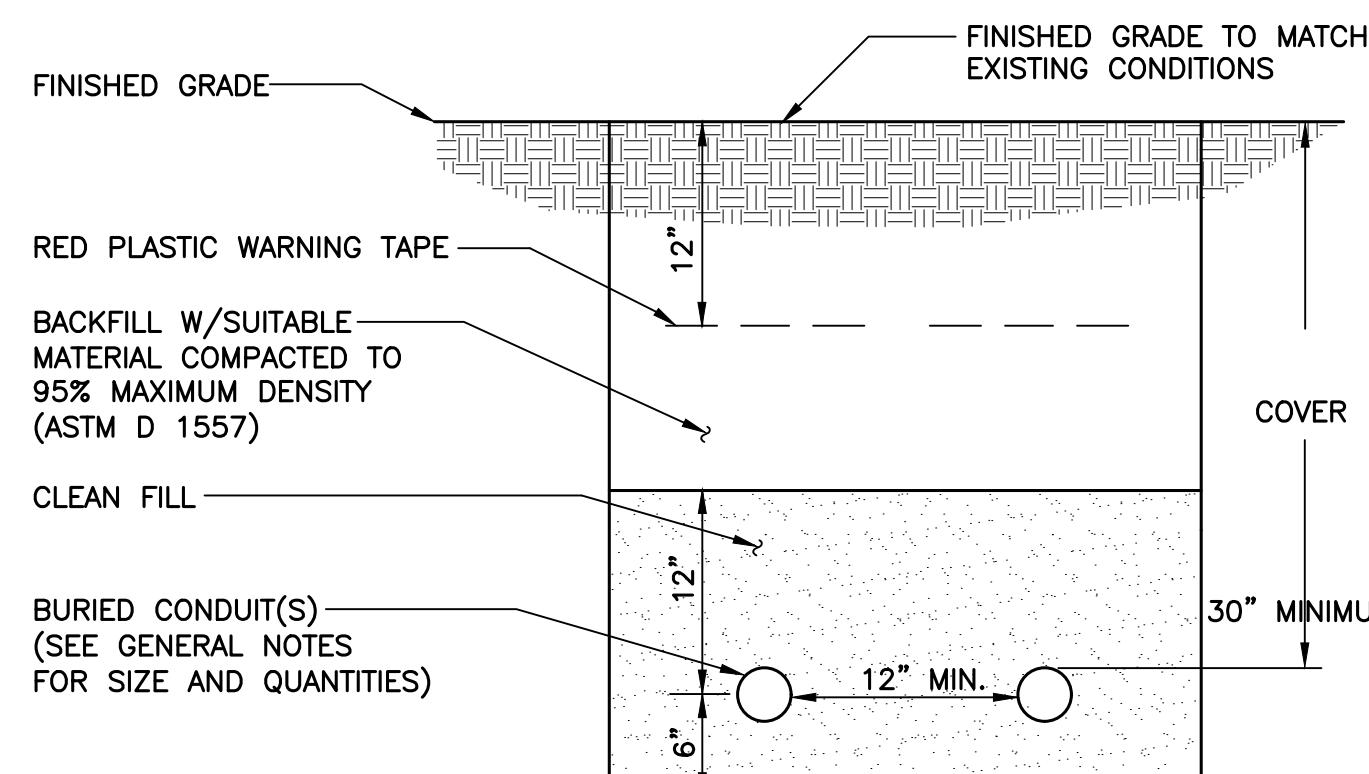


**NOTES:**

1. THE CLEAN FILL SHALL PASS THROUGH A 3/8" MESH SCREEN AND SHALL NOT CONTAIN SHARP STONES. OTHER BACKFILL SHALL NOT CONTAIN ASHES, CINDERS, SHELLS, FROZEN MATERIAL, LOOSE DEBRIS OR STONES LARGER THAN 2" IN MAXIMUM DIMENSION.
2. WHERE EXISTING UTILITIES ARE LIKELY TO BE ENCOUNTERED, CONTRACTOR SHALL HAND DIG AND PROTECT EXISTING UTILITIES.

**1 TYPICAL ELECTRICAL/TEL TRENCH DETAIL**  
C-2 SCALE: NOT TO SCALE

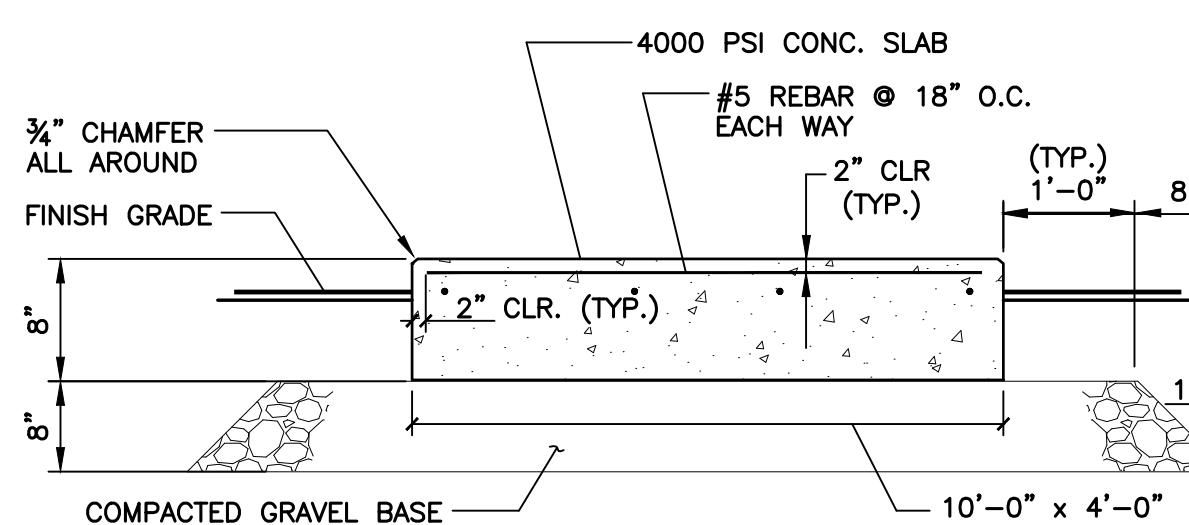


**2 TYPICAL CONCRETE PAD DETAIL**  
C-2 SCALE: NOT TO SCALE

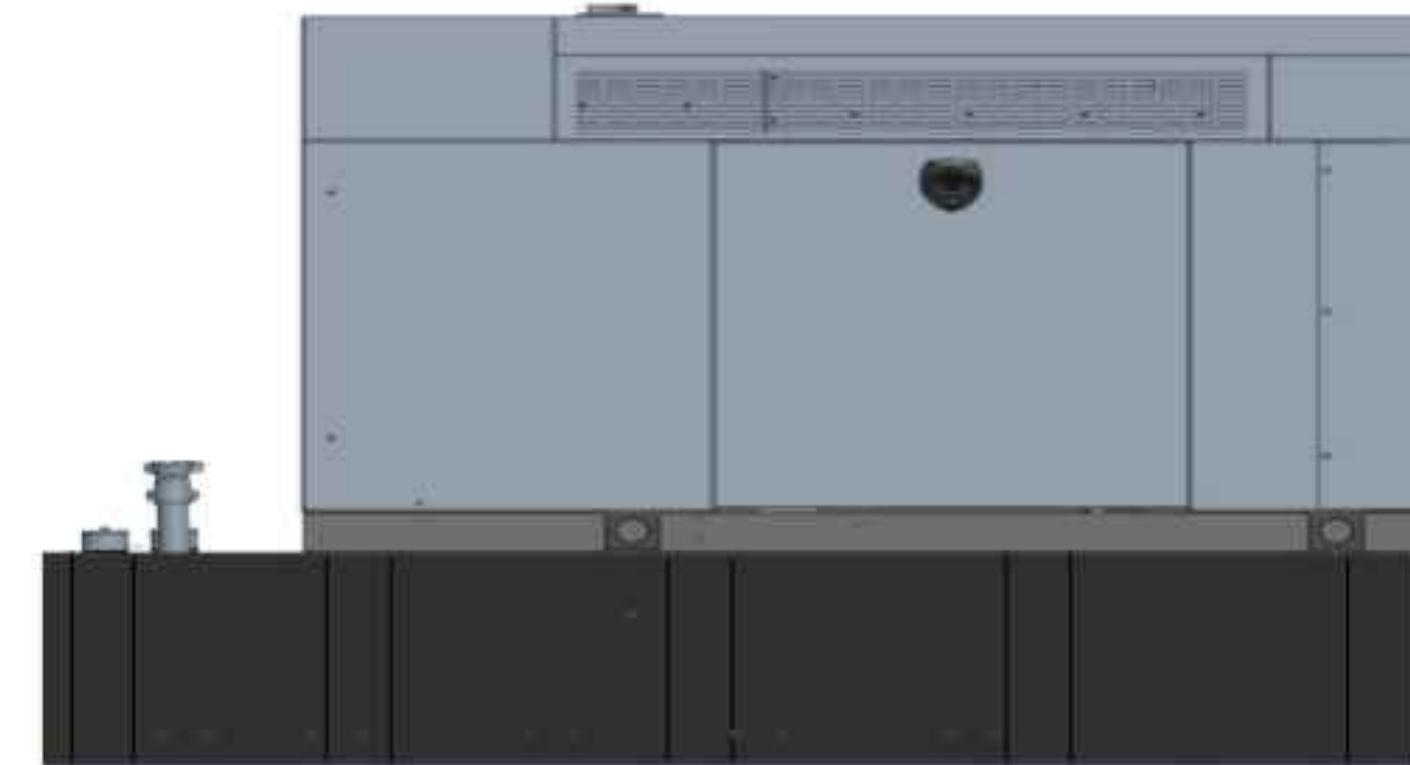

BACKUP POWER GENERATOR						
EQUIPMENT	POWER GENERATED	FUEL	MODEL NUMBER	FUEL TANK SIZE (GAL)	DIMENSIONS	WEIGHT
MAKE: GENERAC MODEL: RD025	25 KW, AC	DIESEL	7192-0	240	103.4" L x 35.0" W x 91.7" H	2123 LBS.
<b>NOTES:</b>						
<ol style="list-style-type: none"> <li>1. FUEL LEVEL/SECONDARY CONTAINMENT SHALL BE ALARMED AND IN COMMUNICATION WITH T-MOBILE'S NCC.</li> <li>2. CONTRACTOR TO COORDINATE FINAL EQUIPMENT MODEL SELECTION AND ALL OPTIONAL FEATURES WITH T-MOBILE'S CONSTRUCTION MANAGER PRIOR TO ORDERING.</li> </ol>						

**3 PROPOSED GENERATOR DETAIL**  
C-2 SCALE: NOT TO SCALE

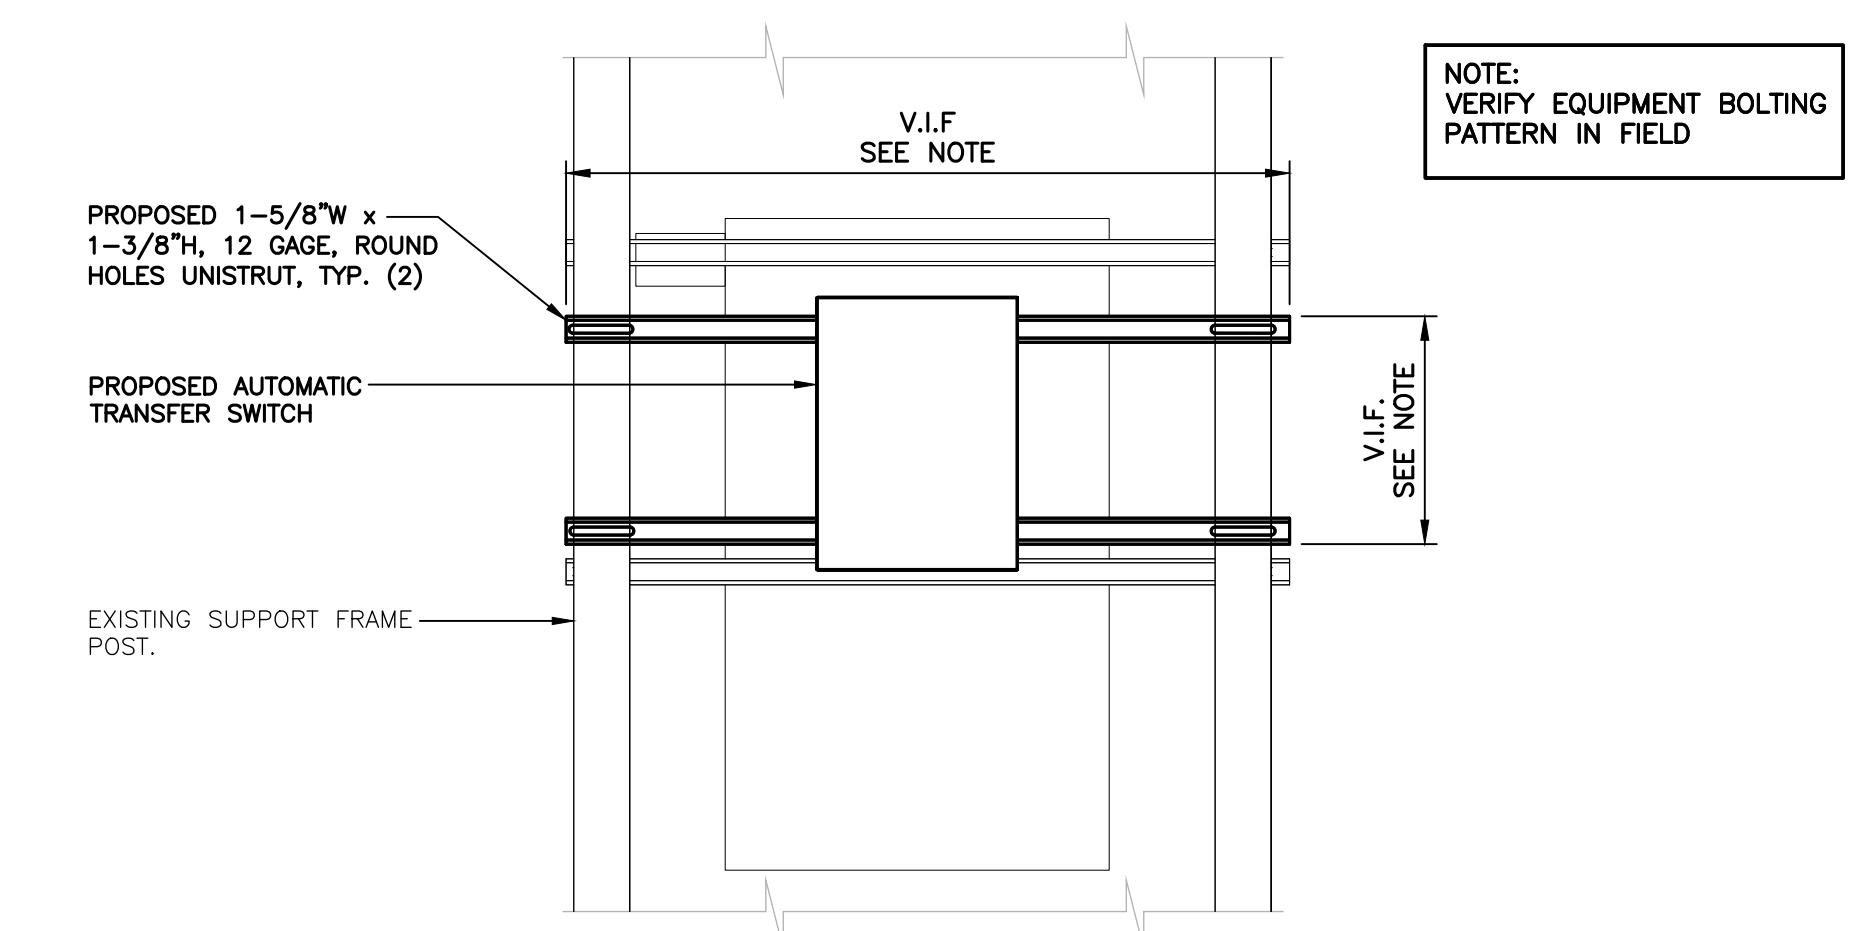

**4 TYPICAL TRANSFER SWITCH MOUNTING DETAIL**  
C-2 SCALE: NOT TO SCALE

**CENTEK** engineering  
Centek on Solutions  
(203) 484-1580  
(203) 484-5850 Fax  
632 North Bedford Road  
Branford, CT 06405  
www.CentekEng.com

**T-MOBILE NORTHEAST LLC**  
WIRELESS COMMUNICATIONS FACILITY  
**GARDEN CIRCLE**  
**SITE ID: CT1392B**  
181 GARDEN CIRCLE  
WATERBURY, CT 06704

DATE: 05/10/18  
SCALE: AS NOTED  
JOB NO. 18079.23

TYPICAL DETAILS

**C-2**

Sheet No. 4 of 5

ISSUED FOR CLIENT REVIEW  
ISSUED FOR CONSTRUCTION  
DRAWN BY CHD BY DESCRIPTION  
Rev. DATE 01/15/21 05/11/18 CRR  
CAG TUR

<div style="border: 1px solid black; padding: 10px; margin-bottom: 10px;"> <p><b>RISER DIAGRAM NOTES</b></p> <p>(1) EXISTING PPC CABINET TO REMAIN.      (2) EXISTING POWER CONDUIT AND CONDUCTORS PREVIOUSLY SERVING EXISTING PANEL.      (3) SECTION OF CONDUIT AND CONDUCTORS TO BE REMOVED.      (4) JUNCTION BOX SIZED PER NEC.      (5) EXTEND EXISTING CONDUITS AND CONDUCTORS TO NEW ATS.      (6) NEW 200A, 2 SOURCE AUTOMATIC TRANSFER SWITCH.      (7) (3) #3/0 AWG, (1) #6 AWG GROUND, 2-1/2" CONDUIT.      (8) EXISTING CONDUITS AND CONDUCTORS TO REMAIN.      (9) EXISTING EQUIPMENT CABINETS TO REMAIN.      (10) EXPANSION COUPLING TYPICAL.</p> </div> <div style="border: 1px solid black; padding: 10px; margin-bottom: 10px;"> <p><b>RISER DIAGRAM NOTES</b></p> <p>(11) REMOTE GENERATOR SHUT OFF SWITCH IN BREAK GLASS ENCLOSURE MOUNTED TO EXTERIOR OF GENERATOR ENCLOSURE PER 2019 NFPA 110 5.6.5.6.1.      (12) 3/4" CONDUIT AND CONDUCTORS REQUIRED FOR PROPER OPERATION OF EMERGENCY GENERATOR SHUT OFF SWITCH.      (13) GENERATOR BATTERY CHARGER AND CONVENIENCE GFCI OUTLET WIRED TO EXISTING PANEL OUTLET TO BE MOUNTED IN WEATHERPROOF ENCLOSURE.      (14) GENERATOR BLOCK HEATER WIRED TO EXISTING PANEL SERVING.      (15) EMERGENCY BACK UP GENERATOR.      (16) GENERATOR GROUNDING PER NEC AND MANUFACTURER'S REQUIREMENTS. BOND TO EXISTING GROUNDING SYSTEM. (MINIMUM OF (1) #2 AWG GROUND)      (17) GENERATOR OUTPUT CIRCUIT BREAKER.      (18) 1" CONDUIT FOR GENERATOR CONTROL AND SIGNAL WIRING.</p> </div> <div style="border: 1px solid black; padding: 10px; margin-bottom: 10px;"> <p><b>NFPA 704 HAZARD ID</b></p> <p>SIGN NAME: REGULATORY, NFPA 704 HAZARD ID      DESCRIPTION: MOUNT ON GENERATOR ACCESS DOOR.      CONSULT WITH GENERATOR MANUFACTURER MSDS SHEET FOR BLUE AND RES POSITIONS      NOTES: 1) SIGNS EXPOSED TO WEATHER SHOULD BE CHECKED ANNUALLY FOR READABILITY.      2) SIGNS MUST BE UPDATED IF CHEMICAL STORAGE OR HAZARD INFORMATION FOR THE LOCATION CHANGES.      3) THE CC MUST REVIEW WITH LOCAL JURISDICTION WHEN FILLING FOR PERMITS, AS EACH JURISDICTION MAY HAVE DIFFERENT REQUIREMENTS AND COMPLY WITH POSTING REQUIREMENTS OR DIRECTIVES FROM THE LOCAL JURISDICTION.</p> </div> <div style="border: 1px solid black; padding: 10px; margin-bottom: 10px;"> <p><b>ELECTRICAL RISER DIAGRAM</b></p> <p>NOT TO SCALE</p> </div> <div style="border: 1px solid black; padding: 10px; margin-bottom: 10px;"> <p><b>AUTOMATIC TRANSFER SWITCH</b></p> <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>EQUIPMENT</th> <th>PHASE</th> <th>VOLTAGE</th> <th>ENCLOSURE</th> <th>AMP</th> <th>DIMENSIONS</th> </tr> </thead> <tbody> <tr> <td>MAKE: GENERAC MODEL: RXSC200A3</td> <td>1-PHASE</td> <td>120/240</td> <td>NEMA-3R</td> <td>200</td> <td>17.3" L x 12.5" W</td> </tr> </tbody> </table> </div> <div style="border: 1px solid black; padding: 10px; margin-bottom: 10px;"> <p><b>WIRELESS COMMUNICATIONS FACILITY</b></p> <p><b>GARDEN CIRCLE</b>  <b>SITE ID: CT1392B</b>  <b>181 GARDEN CIRCLE</b>  <b>WATERBURY, CT 06704</b></p> </div> <div style="border: 1px solid black; padding: 10px; margin-bottom: 10px;"> <p><b>ELECTRICAL DETAILS</b></p> <p>DATE: 05/10/18      SCALE: AS NOTED      JOB NO. 18079.23</p> </div> <div style="border: 1px solid black; padding: 10px; margin-bottom: 10px;"> <p><b>E-1</b></p> <p>Sheet No. 5 of 5</p> </div> <tr> <td style="width: 10%; vertical-align: top;"> <p>PROFESSIONAL ENGINEER SEAL</p> <p>STATE OF CONNECTICUT PROFESSIONAL ENGINEER REGISTRATION BOARD REGISTRATION NO. 18840 EXPIRATION DATE 05/15/21 ISSUED FOR CLIENT REVIEW DRAWN BY CHD BY DESCRIPTION</p> </td> <td style="width: 10%; vertical-align: top;"> <p>REV. DATE 05/11/18 CRR DRAWN BY CHD BY DESCRIPTION</p> </td> <td style="width: 10%; vertical-align: top;"> <p>01/15/21 RTS TUR CAG ISSUED FOR CONSTRUCTION</p> </td> <td style="width: 10%; vertical-align: top;"> <p>Mobile Transcend Wireless</p> </td> <td style="width: 10%; vertical-align: top;"> <p>CELESTEK engineering Centeneon Solutions (203) 484-1580 (203) 484-8382 Fax 632 North Bedford Road Branford, CT 06405 www.CenteEng.com</p> </td> </tr>	EQUIPMENT	PHASE	VOLTAGE	ENCLOSURE	AMP	DIMENSIONS	MAKE: GENERAC MODEL: RXSC200A3	1-PHASE	120/240	NEMA-3R	200	17.3" L x 12.5" W	<p>PROFESSIONAL ENGINEER SEAL</p> <p>STATE OF CONNECTICUT PROFESSIONAL ENGINEER REGISTRATION BOARD REGISTRATION NO. 18840 EXPIRATION DATE 05/15/21 ISSUED FOR CLIENT REVIEW DRAWN BY CHD BY DESCRIPTION</p>	<p>REV. DATE 05/11/18 CRR DRAWN BY CHD BY DESCRIPTION</p>	<p>01/15/21 RTS TUR CAG ISSUED FOR CONSTRUCTION</p>	<p>Mobile Transcend Wireless</p>	<p>CELESTEK engineering Centeneon Solutions (203) 484-1580 (203) 484-8382 Fax 632 North Bedford Road Branford, CT 06405 www.CenteEng.com</p>
EQUIPMENT	PHASE	VOLTAGE	ENCLOSURE	AMP	DIMENSIONS												
MAKE: GENERAC MODEL: RXSC200A3	1-PHASE	120/240	NEMA-3R	200	17.3" L x 12.5" W												
<p>PROFESSIONAL ENGINEER SEAL</p> <p>STATE OF CONNECTICUT PROFESSIONAL ENGINEER REGISTRATION BOARD REGISTRATION NO. 18840 EXPIRATION DATE 05/15/21 ISSUED FOR CLIENT REVIEW DRAWN BY CHD BY DESCRIPTION</p>	<p>REV. DATE 05/11/18 CRR DRAWN BY CHD BY DESCRIPTION</p>	<p>01/15/21 RTS TUR CAG ISSUED FOR CONSTRUCTION</p>	<p>Mobile Transcend Wireless</p>	<p>CELESTEK engineering Centeneon Solutions (203) 484-1580 (203) 484-8382 Fax 632 North Bedford Road Branford, CT 06405 www.CenteEng.com</p>													

## View/Print Label

1. **Ensure there are no other shipping or tracking labels attached to your package.** Select the Print button on the print dialogue box that appears. Note: If your browser does not support this function, select Print from the File menu to print the label.

2. **Fold the printed label at the solid line below.** Place the label in a UPS Shipping Pouch. If you do not have a pouch, affix the folded label using clear plastic shipping tape over the entire label.

### 3. GETTING YOUR SHIPMENT TO UPS

#### Customers with a scheduled Pickup

- Your driver will pickup your shipment(s) as usual.

#### Customers without a scheduled Pickup


- Schedule a Pickup on ups.com to have a UPS driver pickup all of your packages.
- Take your package to any location of The UPS Store®, UPS Access Point(TM) location, UPS Drop Box, UPS Customer Center, Staples® or Authorized Shipping Outlet near you. To find the location nearest you, please visit the 'Locations' Quick link at ups.com.

UPS Access Point™  
MICHAELS STORE # 7773  
75 INTERSTATE SHOP CTR  
RAMSEY NJ 07446-1130

UPS Access Point™  
THE UPS STORE  
115 FRANKLIN TPKE  
MAHWAH NJ 07430-1325

UPS Access Point™  
THE UPS STORE  
120 E MAIN ST  
RAMSEY NJ 07446-1925

FOLD HERE

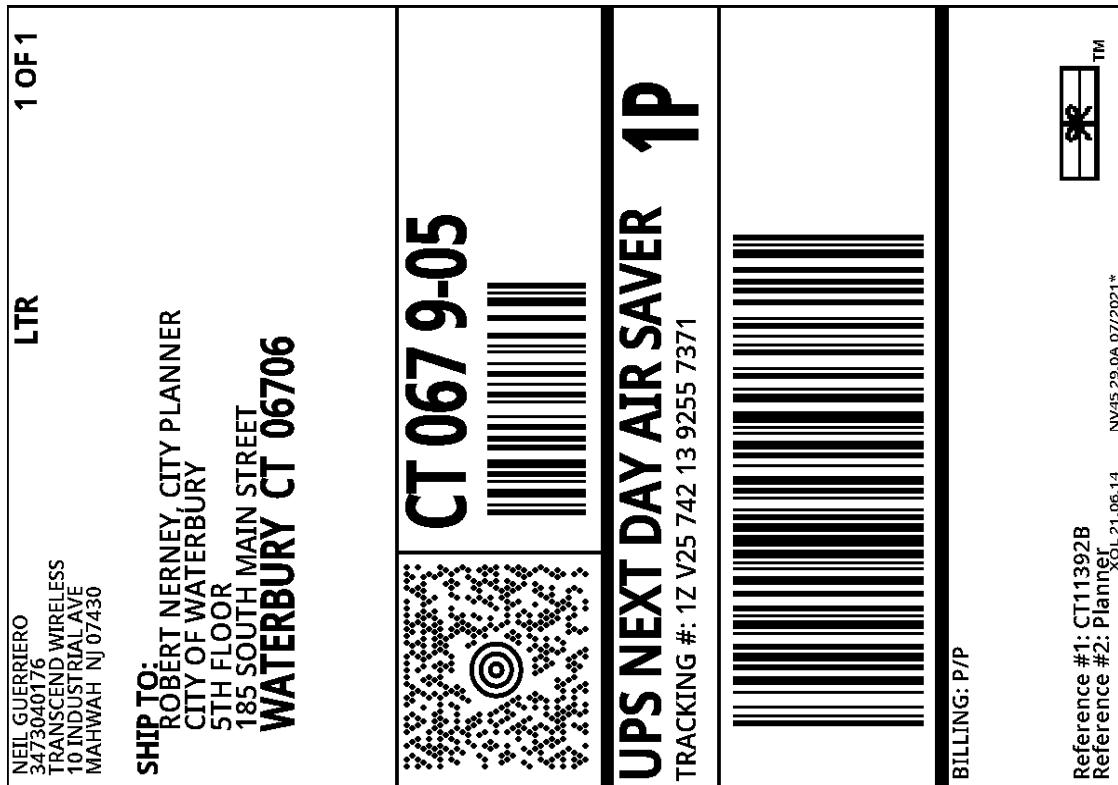

# Proof of Delivery

Dear Customer,

This notice serves as proof of delivery for the shipment listed below.

**Tracking Number**

1ZV257421392557371

**Service**

UPS Next Day Air Saver®

**Shipped / Billed On**

07/20/2021

**Delivered On**

07/23/2021 11:26 A.M.

**Delivered To**

185 S MAIN ST  
WATERBURY, CT, 06706, US

**Received By**

DAN

**Left At**

Reception

**Reference Number(s)**

PLANNER, CT11392B

Thank you for giving us this opportunity to serve you. Details are only available for shipments delivered within the last 120 days. Please print for your records if you require this information after 120 days.

Sincerely,

UPS

Tracking results provided by UPS: 07/26/2021 8:25 A.M. EST

## View/Print Label

1. **Ensure there are no other shipping or tracking labels attached to your package.** Select the Print button on the print dialogue box that appears. Note: If your browser does not support this function, select Print from the File menu to print the label.

2. **Fold the printed label at the solid line below.** Place the label in a UPS Shipping Pouch. If you do not have a pouch, affix the folded label using clear plastic shipping tape over the entire label.

### 3. GETTING YOUR SHIPMENT TO UPS

#### Customers with a scheduled Pickup

- Your driver will pickup your shipment(s) as usual.

#### Customers without a scheduled Pickup



- Schedule a Pickup on ups.com to have a UPS driver pickup all of your packages.
- Take your package to any location of The UPS Store®, UPS Access Point(TM) location, UPS Drop Box, UPS Customer Center, Staples® or Authorized Shipping Outlet near you. To find the location nearest you, please visit the 'Locations' Quick link at ups.com.

UPS Access Point™  
MICHAELS STORE # 7773  
75 INTERSTATE SHOP CTR  
RAMSEY NJ 07446-1130

UPS Access Point™  
THE UPS STORE  
115 FRANKLIN TPKE  
MAHWAH NJ 07430-1325

UPS Access Point™  
THE UPS STORE  
120 E MAIN ST  
RAMSEY NJ 07446-1925

FOLD HERE

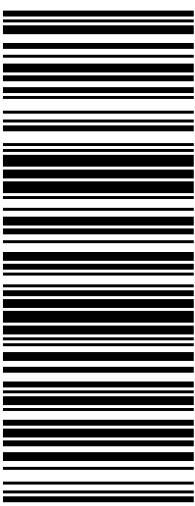NEIL GUERRIERO 3473040176 TRANSSEND WIRELESS 10 INDUSTRIAL AVE MAHWAH NJ 07430	LTR 1 OF 1
<b>SHIP TO:</b> THE HONORABLE NEIL M. O'LEARY CITY OF WATERBURY 2ND FLOOR 235 GRAND STREET <b>WATERBURY CT 06702</b>	 <b>CT 067 9-05</b>  <b>UPS NEXT DAY AIR SAVER 1P</b> TRACKING #: 1Z V25 742 13 9460 7367
	  BILLING: P/P
	 Reference #1: CT11392B Reference #2: MayorOL21-06-14 NV45 29.0A 07/2021* TM

# Proof of Delivery

Dear Customer,

This notice serves as proof of delivery for the shipment listed below.

**Tracking Number**

1ZV257421394607367

**Service**

UPS Next Day Air Saver®

**Shipped / Billed On**

07/20/2021

**Delivered On**

07/23/2021 10:11 A.M.

**Delivered To**

235 GRAND ST  
WATERBURY, CT, 06702, US

**Received By**

JAY

**Left At**

Dock

**Reference Number(s)**

MAYOR, CT11392B

Thank you for giving us this opportunity to serve you. Details are only available for shipments delivered within the last 120 days. Please print for your records if you require this information after 120 days.

Sincerely,

UPS

Tracking results provided by UPS: 07/26/2021 8:27 A.M. EST

## View/Print Label

1. **Ensure there are no other shipping or tracking labels attached to your package.** Select the Print button on the print dialogue box that appears. Note: If your browser does not support this function, select Print from the File menu to print the label.

2. **Fold the printed label at the solid line below.** Place the label in a UPS Shipping Pouch. If you do not have a pouch, affix the folded label using clear plastic shipping tape over the entire label.

### 3. GETTING YOUR SHIPMENT TO UPS

#### Customers with a scheduled Pickup

- Your driver will pickup your shipment(s) as usual.

#### Customers without a scheduled Pickup

- Schedule a Pickup on ups.com to have a UPS driver pickup all of your packages.
- Take your package to any location of The UPS Store®, UPS Access Point(TM) location, UPS Drop Box, UPS Customer Center, Staples® or Authorized Shipping Outlet near you. To find the location nearest you, please visit the 'Locations' Quick link at ups.com.

UPS Access Point™  
MICHAELS STORE # 7773  
75 INTERSTATE SHOP CTR  
RAMSEY NJ 07446-1130

UPS Access Point™  
THE UPS STORE  
115 FRANKLIN TPKE  
MAHWAH NJ 07430-1325

UPS Access Point™  
THE UPS STORE  
120 E MAIN ST  
RAMSEY NJ 07446-1925

FOLD HERE



# Proof of Delivery

Dear Customer,

This notice serves as proof of delivery for the shipment listed below.

**Tracking Number**

1ZV257421390511388

**Service**

UPS Next Day Air Saver®

**Shipped / Billed On**

07/20/2021

**Delivered On**

07/23/2021 11:56 A.M.

**Delivered To**

8051 CONGRESS AVE  
BOCA RATON, FL, 33487, US

**Received By**

MILLER

**Left At**

Dock

**Reference Number(s)**

SBA, CT11392B

Thank you for giving us this opportunity to serve you. Details are only available for shipments delivered within the last 120 days. Please print for your records if you require this information after 120 days.

Sincerely,

UPS

Tracking results provided by UPS: 07/26/2021 8:28 A.M. EST