

Deborah Denfeld

Team Lead - Transmission Siting

Tel: (860) 728-4654

Tel: (860) 205-9368

July 18, 2023

Melanie Bachman, Esq.
Executive Director
Connecticut Siting Council
Ten Franklin Square
New Britain, CT 06051

Re: Sub-Petition NO. 1293-BR-03 (Bethel-Redding) – Eversource Energy declaratory ruling that no Certificate of Environmental Compatibility and Public Need is required for all the transmission facility asset conditions maintenance improvements statewide to comply with National Electric Safety Code clearance requirements.

Dear Attorney Bachman:

On October 17, 2022, Eversource Energy (“Eversource”) received an acknowledgement from the Connecticut Siting Council (“Council”) of Eversource’s notice of intent to modify replace twelve transmission structures in Bethel and Redding, Connecticut on the 3403 Line. Among other conditions of the acknowledgement, the Council required that Eversource submit the following item:

- Not less than 45 days after completion of the transmission line maintenance activity, the Council shall be notified in writing that construction has been completed.

Construction was completed on July 5, 2023.

Additionally, a representative photograph of the completed modification(s) to the existing energy facility, is included as *Attachment A*.

Eversource will be providing one original and two hard copies of this notice in the mail for the Council’s records.

Sincerely,




Deborah Denfeld
Team Lead – Transmission Siting

Attachment A – Photograph

Attachment A
Representative Photograph
Completed Modifications to Existing Energy Facility

Site: Eversource Energy's Structure 11028
Redding, Connecticut

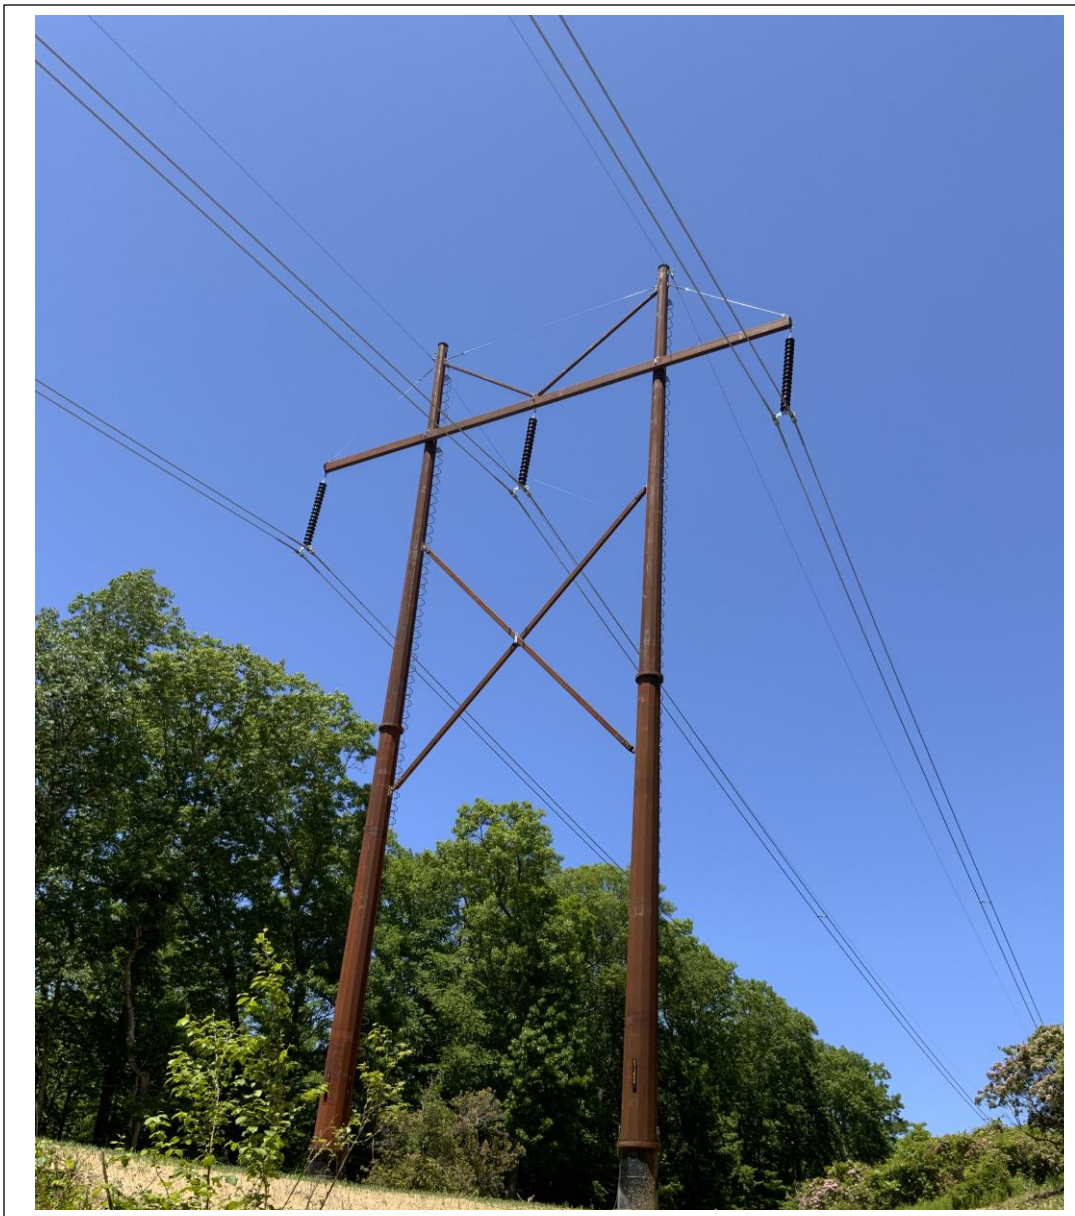

April 28, 2023