



December 14, 2020

Melanie Bachman, Esq.
Executive Director
Connecticut Siting Council
10 Franklin Square
New Britain, CT 06051

RE: Petition of Bloom Energy Corporation for a Declaratory Ruling for the Location and Construction of a 1000-Kilowatt Fuel Cell Customer-Side Distributed Resource at the Dyno Nobel campus, Simsbury, Connecticut

Dear Attorney Bachman:

We are submitting an original and fifteen (15) copies of the above-captioned Petition, together with the filing fee of \$625.

In the Petition, Bloom Energy Corporation ("Bloom") requests the Connecticut Siting Council approve the construction and operation of two fuel cells and associated equipment totalling 1000 kilowatts at the Dyno Nobel campus in Simsbury, Connecticut (the "Facility"). The Facility components will be installed at 69 (aka 65 Woodland Street) and off of Drake Hill Road in Simsbury, CT (the "Site"). Electricity generated by the Facility will benefit Dyno Nobel, and any excess electricity will be exported to the electric grid. The Facility will be fueled by natural gas.

Should you have any questions, concerns, or require additional information, please contact me at (860) 839-8373.

Sincerely,
Bloom Energy

A handwritten signature in blue ink, appearing to read "Justin Adams".

Justin Adams
justin.adams@bloomenergy.com
(860) 839-8373

**STATE OF CONNECTICUT
CONNECTICUT SITING COUNCIL**

PETITION OF BLOOM ENERGY	:	PETITION NO. ____
CORPORATION FOR A DECLARATORY	:	
RULING FOR THE LOCATION AND	:	
CONSTRUCTION OF A 1000-KILOWATT FUEL	:	
CELL CUSTOMER-SIDE DISTRIBUTED	:	
RESOURCE AT THE DYNO NOBEL CAMPUS,	:	
SIMSBURY, CT	:	DECEMBER 14, 2020

PETITION OF BLOOM ENERGY CORPORATION
FOR A DECLARATORY RULING

I. INTRODUCTION

Pursuant to Conn. Gen. Stat. §§ 4-176 and 16-50k(a) and Conn. Agencies Regs. § 16-50j-38 et seq., Bloom Energy Corporation (“Bloom”) requests that the Connecticut Siting Council (“Council”) approve by declaratory ruling the location and construction of a customer-side distributed resources project at the Dyno Nobel (Ensign-Bickford) campus in Simsbury, Connecticut (the “Dyno Nobel Site”). Bloom will install two fuel cells, each consisting of two (2) ES-5 Bloom Energy Server solid oxide fuel cells and associated equipment (the “Facility”), that will provide a total of 1000 kilowatts (“kW”) (net) of power to the Dyno Nobel Site. *See* Exhibits 1 and 3. The Facility will be installed, maintained and operated by Bloom under a 15-year power purchase agreement owned by a third-party financing source. Both fuel cells have been selected as part of the LREC program.

Conn. Gen. Stat. § 16-50k(a) provides that:

Notwithstanding the provisions of this chapter or title 16a, the council shall, in the exercise of its jurisdiction over the siting of generating facilities, approve by declaratory ruling ... (B) the construction or location of any fuel cell, unless the

council finds a substantial adverse environmental effect, or of any customer-side distributed resources project or facility ... with a capacity of not more than sixty-five megawatts, as long as such project meets air and water quality standards of the Department of Energy and Environmental Protection....

The proposed fuel cells will be a customer-side distributed resources facility under 65 MW that complies with the air and water quality standards of the State of Connecticut Department of Energy and Environmental Protection (“DEEP”). Bloom submits that no Certificate is required for the proposed Facility, as the installation would not have a substantial adverse environmental effect in the immediate vicinity of the Site or in the State of Connecticut.

II. COMMUNICATIONS

Correspondence and other communication regarding this petition should be directed to the following parties:

Justin Adams
Bloom Energy Corporation
4353 North First Street
San Jose, CA 95134
Telephone: (408) 543-1500
Fax: (408) 543-1501
Email: Justin.Adams@bloomenergy.com

Erik Amrine
Bloom Energy Corporation
4353 North First Street
San Jose, CA 95134
Telephone: (408) 543-1500
Fax: (408) 543-1501
Email: Erik.Amrine@bloomenergy.com

III. DISCUSSION

A. The Facility

Bloom is proposing to install two new 500-kW fuel cells at the Dyno Nobel Site. Each will consist of two (2) Bloom solid oxide fuel cell Energy Servers, model ES5-AA2AAC, and associated equipment (utility cabinets, water deionizers, telemetry cabinets, and disconnect switches), and will be fueled by natural gas supplied by Eversource. The term “Facility” is used hereinafter to describe the combined fuel cell installations. Exhibits 1 and 2 depict the Facility

locations within the Dyno Nobel Site; Exhibit 3 contains plans; Exhibit 4 contains photographs and equipment specifications.

The first fuel cell (referred to as “Site 1”) will be installed at 65 Woodland Street, Building 200, in the northern part of the property identified in the Town of Simsbury (“Town”) Assessor records as 69 Woodland Street, Map E12, Block 103, Lot 005-C. The installation will be within a cleared, grassy area adjacent to the building’s parking lot and an existing fenced area for electrical infrastructure, and will be interconnected to the existing electrical switchgear within the fenced area and the building. Site 1 will interconnect to the Dyno Nobel Site’s distribution system and operate as a microgrid capable of providing up to 500 kW of uninterruptible critical power load. It has been designed to provide 39% of the average base load demand with critical loads covered during grid interruption. Critical loads include key manufacturing process that cannot afford downtime during grid interruptions. Any electricity generated in excess of the Dyno Nobel Site’s requirement will be exported to the grid in accordance with the Eversource interconnection technical requirements. Site 1 will not be capable of outputting power in a grid-independent capacity.

The second fuel cell (referred to as “Site 2”) will be located south of Drake Hill Road in the northern part of the property identified in the Town Assessor records as Map G11, Block 144, Lot 005. The installation will be within a clearing at the end of an access drive; new water and natural gas service lines will extend from the installation to Drake Hill Road. Site 2 will interconnect to the Dyno Nobel Site’s distribution system at an existing utility pole southeast of the electrical connection and operate in parallel with the grid, capable of providing up to 500kW of base load power to assist in meeting a portion of Dyno Nobel’s electrical requirements. Although it is not anticipated based on current and anticipated Dyno Nobel operational demand,

any electricity generated in excess of the Dyno Nobel Site's requirement will be exported to the grid in accordance with the Eversource interconnection technical requirements. Site 2 will not be capable of outputting power in a grid-independent capacity.

Bloom has sized the system at 500 KW at each location, based on consultation with Dyno Nobel representatives and analysis of their operational needs. Electricity generated by the Facility will be consumed primarily at the Site, and any excess electricity will be exported to the grid. Any electricity exported to the grid would be under the Net Metering tariff and is reflected in the Interconnection Application for the Site.

The operational life of the Facility is for the life of the 15-year contract with Dyno Nobel. At the conclusion of the 15-year contract, Dyno Nobel may renew the contract, return the Facility at no cost, or buy the Facility at a fair market value.

The interconnection applications for the Facility were submitted to Eversource in November 2020. Bloom anticipates initial feedback, including an impact analysis and cost determination, in early January 2021. Final approvals are anticipated in January 2021.

B. Public Health and Safety

The Facility will be installed in compliance with applicable building, plumbing, electrical, and fire codes. The Facility is enclosed, factory-assembled and tested prior to installation on the Site. Solid oxide media in the fuel cells are exchanged at roughly five-year intervals. Extensive hardware, software and operator safety control systems are utilized, and will be controlled from a Bloom Energy Remote Monitoring Control Center ("RMCC"). Internal sensors continuously monitor system operation and provide for system components to shut down if safety circuits detect a condition outside normal operating parameters; the RMCC operator can

initiate an emergency shutdown if warranted. Town of Simsbury Fire Department personnel are provided with an Emergency Response Plan. Exhibit 6.

The Facility will be installed in accordance with NFPA 853¹. The Facility does not burn natural gas; it is used in a chemical reaction to generate electricity, and is digested almost immediately upon entering the unit and is no longer combustible. Before commissioning, the fuel lines (pipes) are cleaned in accordance with Conn. Gen. Stat. Section 16-50ii².

C. Existing Environment

i. The Site

The Site is located along the Route 202/Hopmeadow Street corridor in the central area of the Town south of Simsbury center. It consists of several properties that historically formed the Ensign-Bickford manufacturing complex. Additional properties, including most abutting properties, were historically associated with the Ensign-Bickford operations. Industrial and commercial/retail development exists along Route 202. The surrounding area includes a mix of commercial and residential uses, including several residential condominium developments. The nearest property to the proposed Site 1 equipment is a residential property approximately 435 feet to the southeast; the nearest property line to the proposed Site 2 equipment is with a State of Connecticut ROW and subsequently a commercial property, approximately 30 feet to the west.

The Facility would be located on the eastern and western parcels of the Dyno Nobel Site, which is zoned I2, General Industrial. The eastern parcel is an approximately 223-acre parcel with manufacturing buildings, roadways and cleared, disturbed areas interspersed with wooded areas. The western parcel is an approximately 109-acre parcel with a mix of cleared and wooded

¹ Standard for the Installation of Stationary Fuel Cell Power Systems, 2015 Edition

² Public Act 11-101, An Act Adopting Certain Safety Recommendations of the Thomas Commission

areas with paved roadways and occasional structures. The Facility is designed to take advantage of utility infrastructure while minimizing impact on existing operations, uses and traffic flow within the Site.

ii. Wildlife and Habitat

Based on a review of the publicly available Connecticut Department of Energy and Environmental Protection (DEEP) Natural Diversity Database (NDDDB) June 2020 data, the proposed Facility (all of Site 1 and portions of Site 2) is within an NDDDB area, an identified location of endangered, threatened and special concern species or significant natural community. Exhibit 5. Therefore, a DEEP NDDDB request for review has been submitted. The response from DEEP will be made available upon receipt.

iii. Wetlands and Watercourses

There are no identified wetland or watercourse resources within the proposed location of Site 1, which consists of a fenced, developed and maintained lawn area associated with the adjacent building. According to the Town Inland Wetlands Map, the southern portion of Site 2 is within an identified wetland area. Exhibit 5. However, Site 2 is located within an existing developed area consisting of a gravel surface surrounded by a gravel access drive and maintained lawn. Wetlands appear to be located further to the south beyond the project area, associated with Hop Brook, and it is not anticipated that the Facility will have any adverse effect on proximate wetland resources. As described herein, appropriate erosion and sedimentation control measures will be employed during construction to avoid any incidental or secondary impacts to nearby wetlands.

iv. Flood Zones and Aquifer Protection Area

A review of the flood hazard mapping data from Federal Emergency Management Agency's ("FEMA") National Flood Insurance Program ("NFIP") shows the Facility would not be located in either a 100-year or 500-year flood zone. *See Exhibit 5.*

The Site was also reviewed for proximity to Aquifer Protection Areas. According to GIS data provided by DEEP, the nearest Aquifer Protection Areas are approximately 1.2 mile to the west of Site 1 and approximately 1.5 mile to the northeast of Site 2.

i. Cultural Resources

Both Site 1 and Site 2 are proposed in previously developed and disturbed areas. The construction and operation of the Facility will therefore not have a substantial adverse effect on cultural (archaeological and historical) resources.

D. Environmental Effects and Mitigation

i. Natural Gas Desulfurization Process

Sulfur compounds that are added to natural gas as an odorant are removed in the first step of electricity production in a Bloom Energy Server. Sulfur is separated from the natural gas by filtering in a specialized canister within the Energy Server (the "Desulf Unit") that uses a copper catalyst to remove the sulfur. The Desulf Units are periodically removed and replaced. The spent units are transported to ShoreMet, L.L.C. (ShoreMet) in Indiana, where they are opened, the contents are removed and copper is used as an ingredient in various products. The Desulf Units are then cleaned, refilled, and sent back to the field for reuse. Handling and transportation are performed in accordance with hazardous waste restrictions.

ii. Water, Heat and Air Emissions

The construction and operation of the Facility will comply with DEEP's air and water quality standards and will not have a substantial adverse environmental effect.

The Facility is designed to operate without water discharge under normal operating conditions. There are no connections or discharge points to the proposed Facility. The Facility uses no water after start-up, which requires a 192-gallon injection for each fuel cell, for a total of 384 gallons.

Heat generated by the proposed Facility is used internally to increase the electrical efficiency of the fuel cell system. As a result, there is no useful waste heat generated by the fuel cell. The minimal amount of thermal load present at the Site would preclude the efficient deployment of a combined heat and power application.

Conn. Agencies Regs. § 22a-174-42 exempts fuel cells from air permitting requirements. Accordingly, no permits, registrations, or applications are required based on the actual emissions from the Facility.³ It should be noted, however, that Bloom Energy fuel cells do meet the emissions standards of Section 22a-174-42.

The Facility will also meet state criteria thresholds for all greenhouse gases defined in Section 22a-174-1(49). Table 1 lists thresholds set by the Low and Zero Emissions Renewable Energy Credit (LREC/ZREC) program⁴, and compares them to emissions generated from the proposed Facility. By virtue of the non-combustion process the Bloom Energy fuel cells virtually eliminate NO_x, SO_x, CO, VOCs and particulate matter emissions from the energy production process. Similarly, there are no CH₄, SF₆, HFC or PFC emissions.

³ See Conn. Agencies Regs. §§ 22a-174-42(b) and (e).

⁴ Sec. 16-244t

Table 1: Connecticut Thresholds for Greenhouse Gases

Emission Type	Bloom Output	LREC allowance
Nitrous Oxides (NO _x)	<0.01 lbs/MWh	0.07 lbs/MWh
Carbon Monoxide (CO)	<0.05 lbs/MWh	0.10 lbs/MWh
Sulfur Oxides (SO _x)	Negligible	Not Listed
Volatile Organic Compounds (VOCs)	<0.02 lbs/MWh	0.02 lbs/MWh
Carbon Dioxide (CO ₂) ⁵	679-833 lbs/MWh	Not Listed

The proposed Facility will ultimately displace less efficient fossil fueled marginal generation on the ISO New England system. Based upon US Environmental Protection Agency (EPA) “eGrid” data, the proposed Facility is expected to reduce carbon emissions by more than 25% while essentially eliminating local air pollutants like NO_x, SO_x, and particulate matter.

The Town’s Plan of Conservation and Development promotes energy conservation and sustainability, including the “use of fuel cells and micro-grids to provide to provide for emergency energy availability and for energy security.” 2017 Plan of Conservation and Development, Section 11, p. 94.

iii. Sound Levels

The Facility will comply with State of Connecticut regulations for the Control of Noise. The host parcel for Site 1 is classified as a Class C emitter (3. Manufacturing). The nearest receptor is a residentially developed property, which is classified as a Class A receptor (1. Residential).⁶ As such, limits of 61 dBA (day) and 51 dBA (night) apply. The results of the sound model predicting noise levels at that property boundary, located at a distance of approximately 435 feet, are provided as Exhibit 7. The proposed Facility would be defined as

⁵ Carbon dioxide is measured at Bloom’s stated lifetime efficiency level of 53-60%

⁶ Section 22a-69-2 of the DEEP Noise Regulations provides guidance in classifying both emitter and receptor Noise Zones. Classifications are based on the actual use of a parcel or tract under single ownership, as detailed by the Standard Land Use Classification Manual of Connecticut (SLUCONN).

“Scenario 2” in the model. Scenario 2 models noise for a Bloom Energy Server installed with no structures taller than the proposed source of the noise to reflect sound from either side. The results of the Scenario 2 sound model at 435 feet are 33 dBA.

The host parcel for Site 2 is classified as a Class C emitter (3. Manufacturing). The nearest receptor is a residentially developed property, which is classified as a Class B receptor (65. Professional Services). As such, limits of 66 dBA (day/night) apply. The results of the sound model predicting noise levels at that property boundary, located at a distance of approximately 30 feet, are provided as Exhibit 7. The proposed Facility would be defined as “Scenario 2” in the model. Scenario 2 models noise for a Bloom Energy Server installed with no structures taller than the proposed source of the noise to reflect sound from either side. The results of the Scenario 2 sound model at 30 feet are 56.2 dBA.

The Town has no noise ordinance.

ix. Visual Effects

The visual effect of the Facility will be minimal. Site 1 is located behind a large building and surrounded by woodland. Access to much of the property is restricted. Limited visibility to Site 2 may be experienced from the commercial property to the west and a residential property to the east, as well as approximately 150 feet along Drake Hill Road and the Farmington Canal Trail near the entrance to Site 2. Visibility of both fuel cells from the south will be obscured by distance and vegetation. The addition of the Facility is minor relative to the existing development within the Site, and is consistent with the existing surrounding development.

E. Project Construction and Maintenance

Bloom anticipates construction to start in the second quarter of 2021 with approximately four months of total construction time (4 - 6 weeks of site prep, 4 - 6 weeks of installation, and 4 – 6 weeks of commissioning).

Construction of the Facility would conform to best management practices for erosion and sedimentation (“E&S”) controls, including those provided for in the 2002 Connecticut Guidelines for Soil Erosion and Sediment Control. During construction, appropriate erosion and sedimentation (E&S) controls will be installed and areas of disturbance will be promptly stabilized in order to minimize the potential for soil erosion and the flow of sediments off site. Temporary E&S control measures will be maintained and inspected throughout construction to ensure their integrity and effectiveness. The temporary E&S control measures will remain in place until the work is complete and all disturbed areas have been stabilized. No effects to drainage patterns or stormwater discharges are anticipated. Due to the limited disturbance required for the Facility’s installation, no construction-related storm water permits will be required.

Soils that are generated during construction activities would not be stored or stockpiled inside of wetlands or adjacent to a watercourse, and appropriate E&S control measures would be employed and maintained for any temporary soil stockpiles. Any excavated soils compatible for reuse will be used as backfill in proximity to the same excavation area from where it originated. Any excess excavated soils not suitable for reuse would be trucked off-site and managed in accordance with applicable regulations. Rock, concrete and other debris would be removed and trucked off-site.

Areas affected by construction would be re-graded as practical and stabilized using revegetation or other measures before removing temporary E&S controls. Construction-related impacts will therefore be minimal.

If there is a default in the contract or the Facility is to be removed at the end of the contract, the Energy Servers, associated equipment and components will be dismantled and removed and the site will be restored as nearly as practicable to its effective original condition.

IV. NOTICE AND CONSULTATION

Bloom has provided notice of this petition via certificate of mailing to abutting property owners and appropriate municipal officials and governmental agencies to whom notice is required to be given pursuant to Conn. Agencies Regs. § 16-50j-40(a). Lists of officials and abutting property owners, a copy of the notice letter and documentation of mailing are provided in Exhibit 8.

A representative of Bloom contacted Mr. Michael Glidden, Director of Planning and Community Development for the Town, by email and provided plans for review. No response has been received to date. *See* Exhibit 9.

V. CONCLUSION


Under Conn. Gen. Stat. § 16-50k(a), the Council is required to approve by declaratory ruling the construction or location of a customer-side distributed resources project or facility with a capacity of not more than 65 MW, as long as the facility meets DEEP air and water quality standards. The proposed Facility meets each of these criteria.



The proposed project will replace a portion of the Site's baseload with a Class I renewable energy source, assist in achieving the State's and Town's sustainability goals, and improve reliability of electrical systems and equipment.


Bloom submits that no Certificate is required for the proposed Facility, as the installation would not have a substantial adverse environmental effect in the immediate vicinity of the Site or in the State of Connecticut. Accordingly, Bloom respectfully requests that the Council approve the proposed Facility by declaratory ruling.

Respectfully submitted,
Bloom Energy Corporation

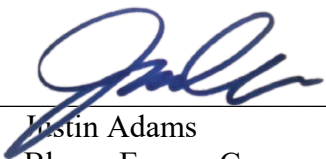By: _____

Justin Adams
Bloom Energy Corporation
4353 North First Street
San Jose, CA 95134
Telephone: (408) 543-1500
Email: justin.adams@bloomenergy.com

Exhibit 1

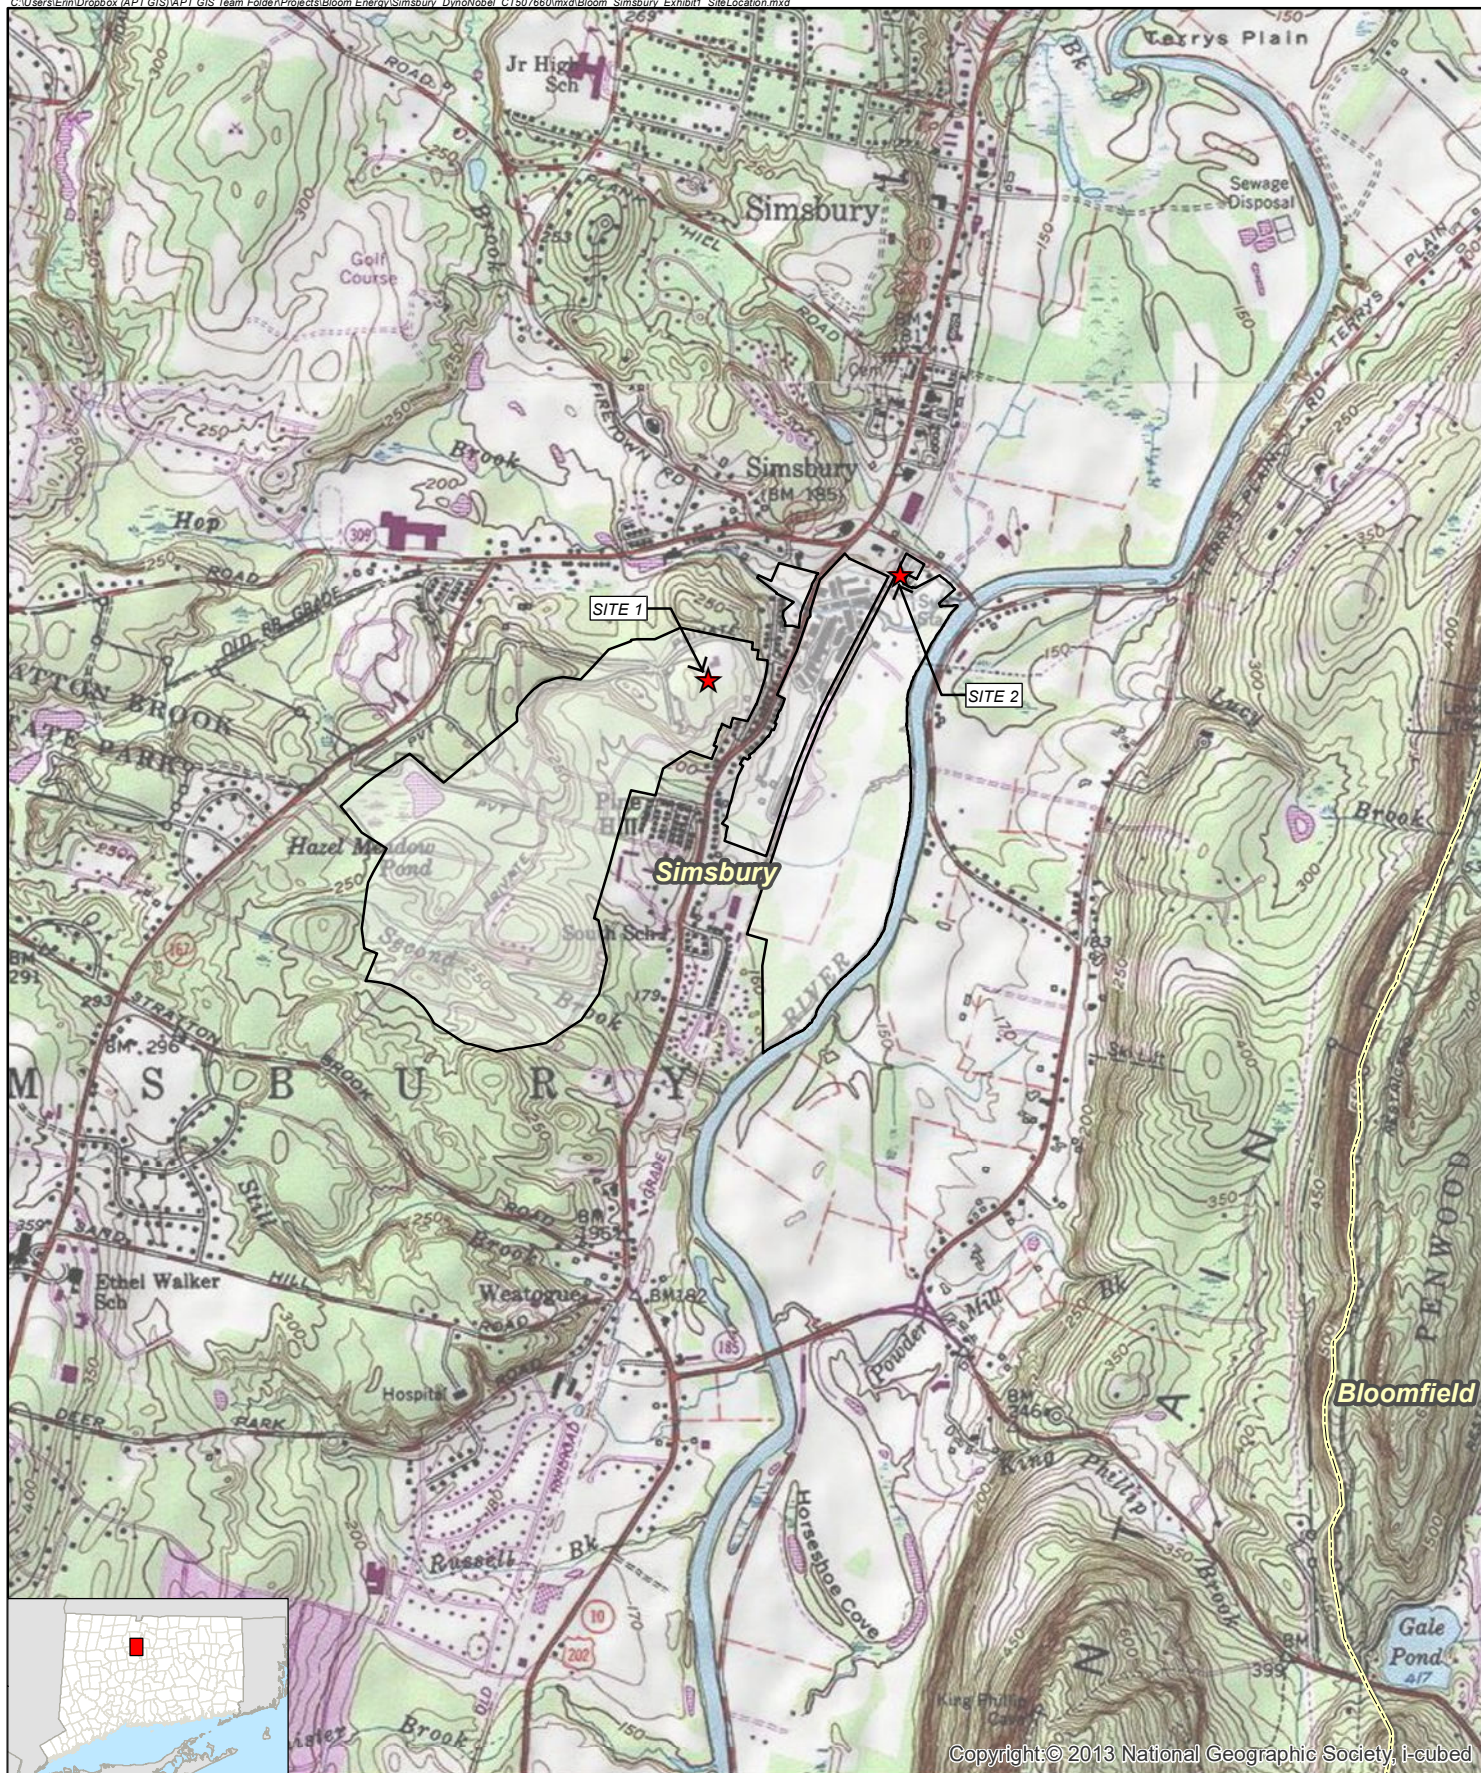

Copyright © 2013 National Geographic Society, i-cubed

Legend

- ★ Project Area
- Site
- Municipal Boundary

Map Notes:
 Base Map Source: USGS 7.5 Minute
 Topographic Quadrangle Map: Avon, CT (19xx)
 Map Scale: 1 inch = 2,000 feet
 Map Date: December 2020


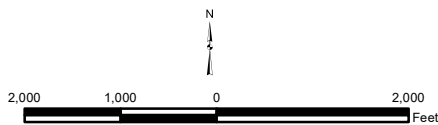


Exhibit 1 Site Location Map

Proposed Bloom Energy Facility
 65 Woodland Street & Drake Hill Road
 Simsbury, Connecticut

Bloomenergy



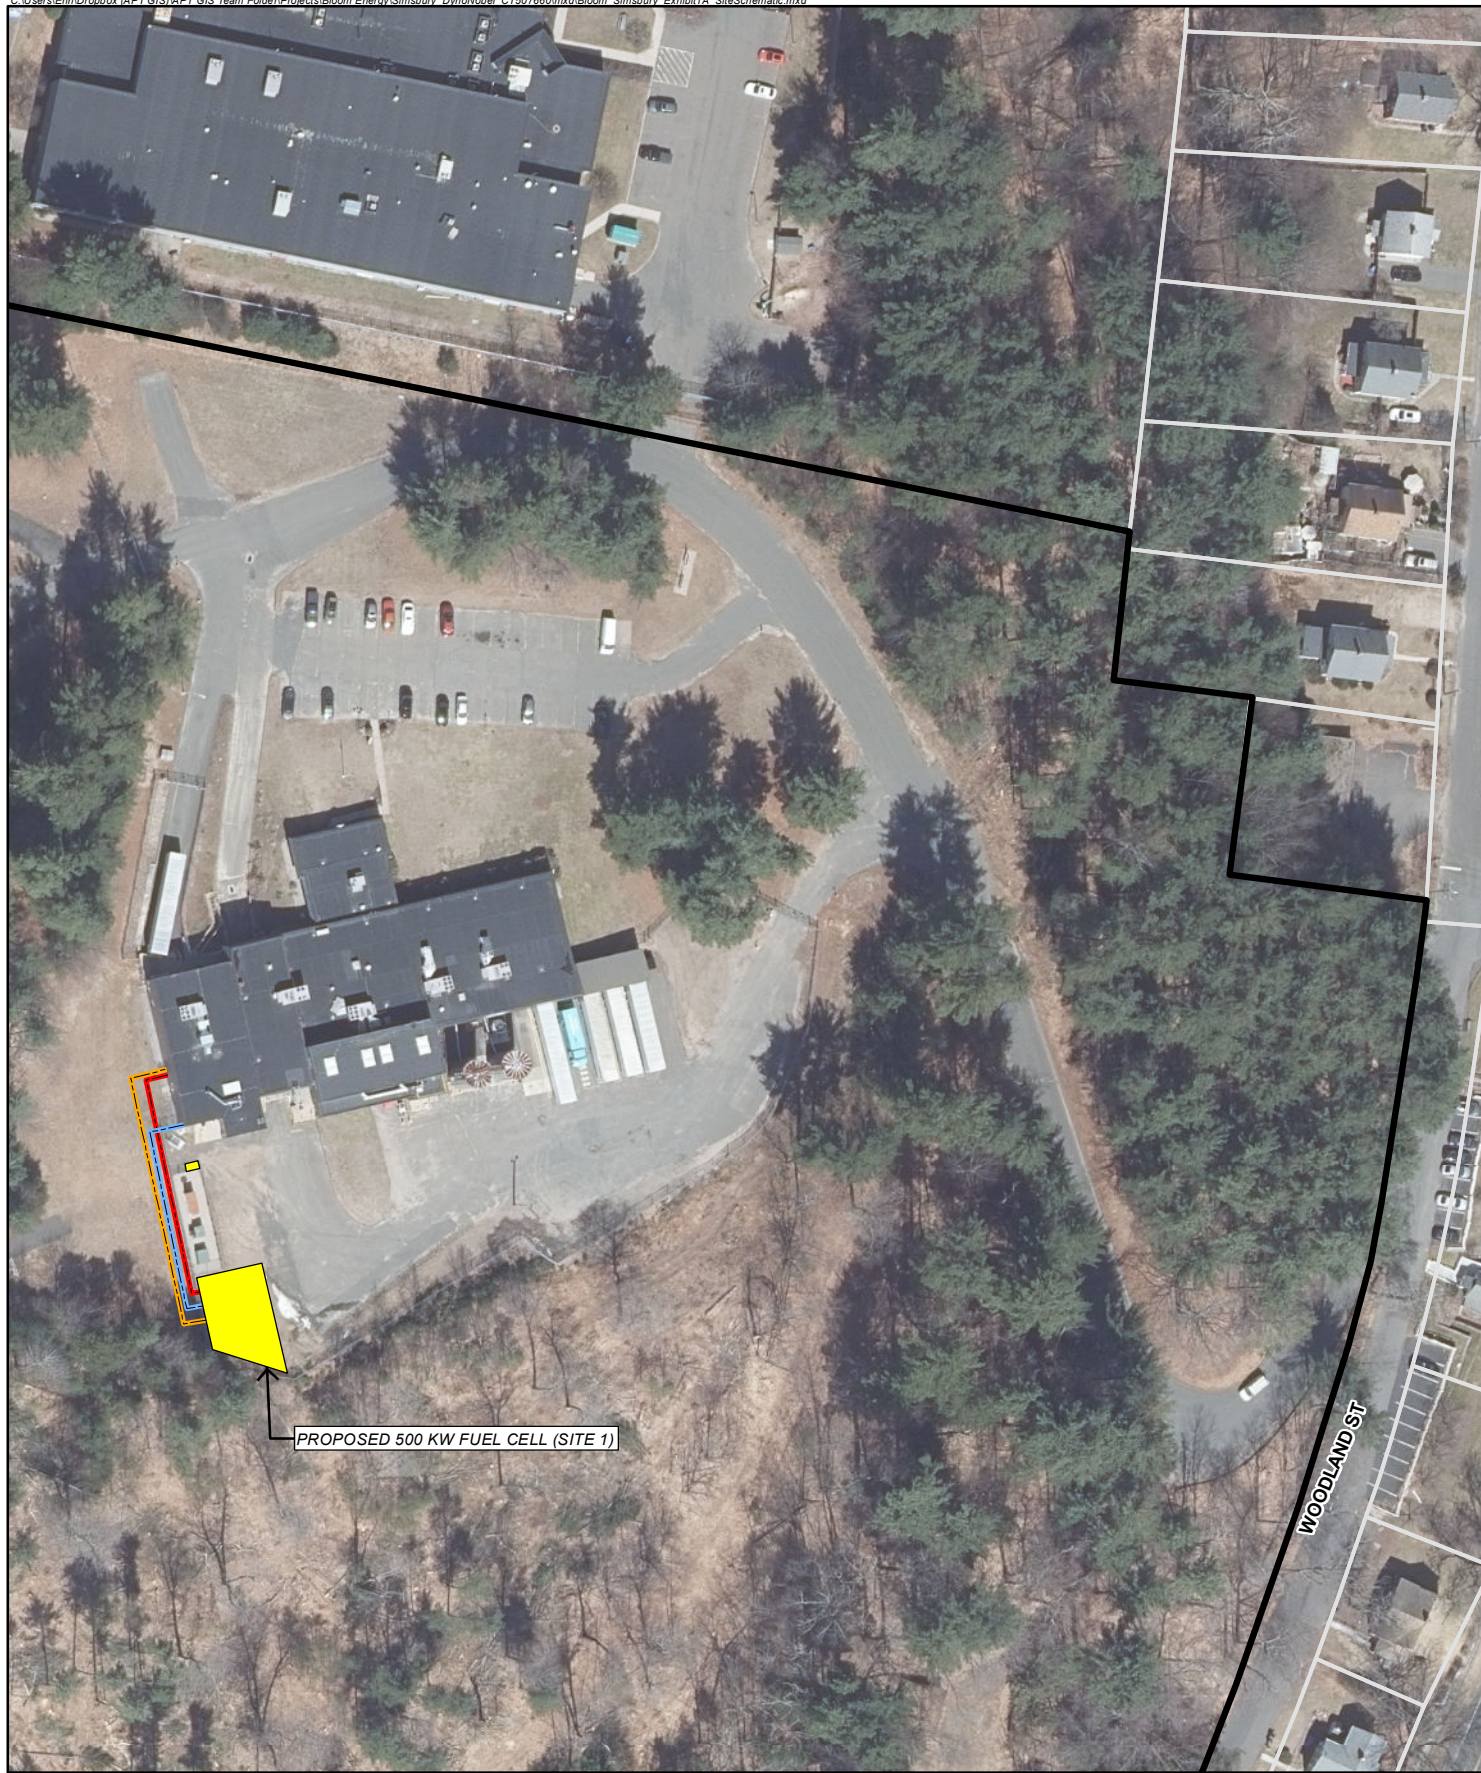

Legend

- Site
- Approx. Assessor Parcel Boundary
- Project Area
- Utility Trench ELECTRIC
- GAS
- WATER

Map Notes:
Base Map Source: 2019 Aerial Photograph (CTECO)
Map Scale: 1 inch = 100 feet
Map Date: December 2020

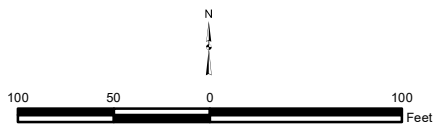


Exhibit 1A Site Schematic

Proposed Bloom Energy Facility
65 Woodland Street
Simsbury, Connecticut





Legend

- | | |
|----------------------------------|----------------|
| Site | Utility Trench |
| Approx. Assessor Parcel Boundary | ELECTRIC |
| Project Area | GAS |
| | WATER |

Map Notes:
Base Map Source: 2019 Aerial Photograph (CTECO)
Map Scale: 1 inch = 60 feet
Map Date: December 2020

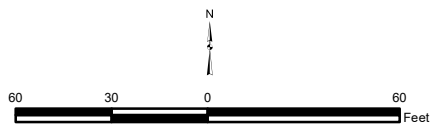


Exhibit 1B Site Schematic

Proposed Bloom Energy Facility
Drake Hill Road
Simsbury, Connecticut



Exhibit 2



Legend

- ★ Project Area
- Watercourse
- Site
- Abutters
- Approx. Assessor Parcel Boundary
- Open Water

Map Notes:
 Base Map Source: 2019 Aerial Photograph (CTECO)
 Parcel Boundaries Source: Simsbury GIS Data & Property Survey
 Map Scale: 1 inch = 1,300 feet
 Map Date: December 2020

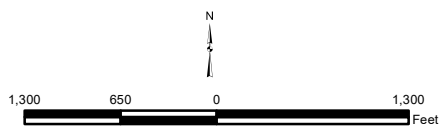


Exhibit 2 Site Vicinity Map

Proposed Bloom Energy Facility
 65 Woodland Street & Drake Hill Road
 Simsbury, Connecticut

Bloomenergy



Exhibit 3

DYNO[®]

Dyno Nobel

STORE NUMBER: BLDG 200/WEST
65 WOODLAND STREET
BLDG 200, SIMSBURY,
CT 06070

Bloomenergy[®]



Know what's below.
Call before you dig.



PRIOR TO COMMENCING ANY EXCAVATION OR DEMOLITION, THE CONTRACTOR SHALL CONTACT LOCAL UTILITIES, INCLUDING BUT NOT LIMITED TO ELECTRICAL, GAS, WATER, CABLE, AND TELEPHONE, REQUESTING A UTILITY MARK OUT AND AS NECESSARY RETAIN THE SERVICES OF A PRIVATE UTILITY MARK OUT COMPANY TO PERFORM SUCH MARK OUT. IT IS THE CONTRACTOR'S RESPONSIBILITY TO LOCATE AND VERIFY THE LOCATION OF UTILITIES, IRRIGATION, SITE LIGHTING, AND ELECTRICAL LINES IN THE VICINITY OF THE CONSTRUCTION. CONTRACTOR SHALL BE RESPONSIBLE FOR THE REPAIR ANY AND ALL UTILITIES DAMAGED BY THE CONTRACTOR'S OPERATION AT NO ADDITIONAL EXPENSE.

Bloomenergy[®]

4353 N. FIRST STREET
SAN JOSE, CA 95134

PROPRIETARY AND CONFIDENTIAL

BLOOM ENERGY CORPORATION ALL RIGHTS RESERVED. THIS DOCUMENT IS FOR REFERENCE ONLY AND MAY NOT BE USED WITHOUT THE WRITTEN PERMISSION OF BLOOM ENERGY. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT PERMISSION OF BLOOM ENERGY IS PROHIBITED.

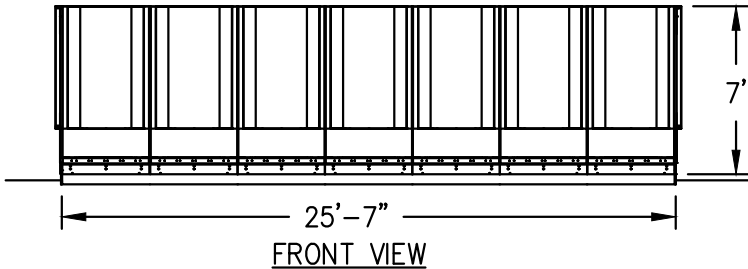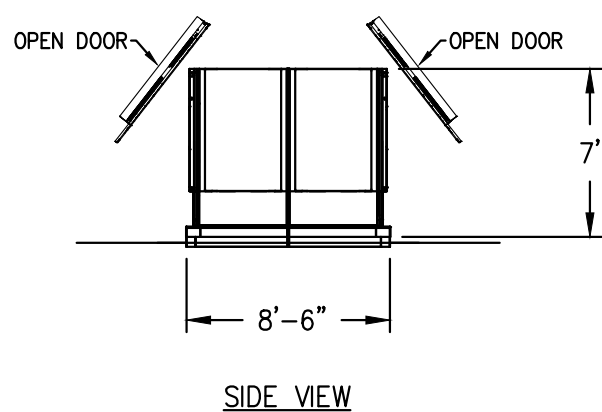SITE INFORMATION		PERMITTING INFORMATION		CODES	PROJECT DESCRIPTION	BLOOM ENERGY FAQ's
PARCEL INFORMATION PROPERTY OWNER DYNO NOBEL INCCT COUNTY HARTFORD TAX MAP # E12 103 005-C PROPERTY DESCRIPTION PROPERTY TYPE LIGHT INDUSTRIAL PROPERTY AREA 97,382.74 SF DISTURBED AREA 2265 SF PARKING INFORMATION EXISTING PARKING* XXX REQUIRED PARKING* XXX REMOVED PARKING XXX ADDED PARKING XXX FINAL PARKING COUNT XXX		MUNICIPAL AGENCY DEPARTMENT CONTACT INFO PLANNING SIMSBURY TOWN PLANNING DEPARTMENT (860) 658-3245 BUILDING SIMSBURY TOWN BUILDING DEPARTMENT (860) 658-3234 FIRE SIMSBURY FIRE MARSHAL (860) 658-1973 UTILITY TYPE COMPANY CONTACT INFO NATURAL GAS CONNECTICUT NATURAL GAS (ONG) (860) 456-8745 ELECTRICAL EVERSOURCE (CT) (877) 944-5325 WATER HARTFORD WATER DEPARTMENT (860) 278-7850		BUILDING 2015 INTERNATIONAL BUILDING CODE BUILDING 2018 CONNECTICUT STATE BUILDING CODE ENERGY 2015 INTERNATIONAL ENERGY CONSERVATION CODE PLUMBING 2015 INTERNATIONAL PLUMBING CODE FUEL GAS 2015 INTERNATIONAL FUEL GAS CODE ELECTRICAL 2017 NFPA 70, NATIONAL ELECTRICAL CODE FIRE 2018 CONNECTICUT STATE FIRE SAFETY CODE MECHANICAL 2015 INTERNATIONAL MECHANICAL CODE	THIS PROJECT CONSISTS OF THE INSTALLATION OF TWO (2) BLOOM ENERGY ES5 OUTDOOR NATURAL GAS CLEAN ENERGY SERVERS ARE THE CLEAN ENERGY SERVERS ARE SUPPORTED ON A CONCRETE PAD. THE WORK INCLUDES ALL ITEMS LISTED IN THE SCOPE OF WORK.  	Q: WHAT IS A BLOOM ENERGY SERVER? A: THE BLOOM ENERGY SERVER IS A STATIONARY FUEL CELL POWER SYSTEM. Q: IS THE BLOOM ENERGY SERVER PRODUCT LISTED OR CERTIFIED? A: YES. ES-5XXX SERIES: • THE FUEL CELL IS UL LISTED AS A "STATIONARY FUEL CELL POWER SYSTEM" TO ANSI/CSA AMERICA FC 1-2004. • IT IS UL LISTED UNDER UL CATEGORY IRGZ AND UL FILE NUMBER MH45102. ESS SERIES: • THE FUEL CELL IS UL LISTED AS A "STATIONARY FUEL CELL POWER SYSTEM" TO ANSI/CSA FC 1-2014. • IT IS UL LISTED UNDER UL CATEGORY IRGZ AND UL FILE NUMBER MH45102. Q: WHERE ARE FUEL CELLS COVERED IN THE NATIONAL ELECTRICAL CODE (NEC)? A: FUEL CELLS ARE COVERED IN ARTICLE 692 OF THE NEC (NFPA 70). FUEL CELLS HAVE BEEN INCORPORATED INTO THE NEC SINCE 2002. Q: WHAT IS THE MODEL NUMBER OF THIS PRODUCT? A: PLEASE SEE THE DATA SHEET PROVIDED WITH THIS FAQ. Q: WHAT IS THE NOISE LEVEL OF THE FUEL CELL SYSTEM? A: FOR SPECIFIC DB RANGES, PLEASE REFER TO THE DATA SHEET PROVIDED WITH THIS FAQ. Q: DO BLOOM ENERGY FUEL CELL SYSTEMS PROVIDE LIFE SAFETY POWER? A: NO. WE ARE NOT LIFE SAFETY AND DO NOT PROVIDE LIFE SAFETY POWER, EVEN WHEN A UPM IS INSTALLED. WE ARE NOT ALTERING WHATEVER LIFE SAFETY IS CURRENTLY PRESENT AT THE FACILITY. Q: IS THE BLOOM ENERGY FUEL CELL SYSTEM TAMPER-PROOF? A: YES. THE FUEL CELLS ARE SECURED IN PLACE AND DOORS ARE SECURED AND LOCKED. ONLY BLOOM SERVICE PERSONNEL HAVE THE KEYS AND CAN BE ON-SITE WITHIN 24 HOURS. Q: WHAT HAPPENS TO THE CUSTOMER FACILITY POWER IF THE FUEL CELLS SHUT DOWN? A: THE FUEL CELL SYSTEM IS OPERATED IN GRID-PARALLEL MODE. IF THE UTILITY GRID IS OPERATIONAL, THE CUSTOMER FACILITY WILL RECEIVE POWER FROM THE GRID AND NOTICE NO DIFFERENCE. Q: WHAT HAPPENS TO THE FUEL CELL SYSTEM WHEN THE UTILITY POWER SHUTS DOWN? A: IF UTILITY PROVIDED POWER IS LOST FOR ANY REASON, THE FUEL CELL SYSTEM WILL ALSO STOP PRODUCING POWER. THE FUEL CELL SYSTEM WILL REMAIN IN STAND-BY MODE UNTIL IT AUTOMATICALLY SENSES THE UTILITY GRID HAS BEEN RESTORED. Q: WHAT HAPPENS TO THE FUEL CELL SYSTEM WHEN THE UTILITY GAS SHUTS DOWN? A: IF THE UTILITY GAS IS INTERRUPTED, THE FUEL CELL SYSTEM WILL AUTOMATICALLY SHUT DOWN AS WELL. Q: CAN THE FUEL CELL SYSTEM BE SHUT DOWN LOCALLY IN CASE OF AN EMERGENCY? A: YES. IF THE FUEL CELL MUST BE SHUT DOWN RIGHT AWAY--FOR EXAMPLE, IN CASE OF A BUILDING FIRE OR ELECTRICAL HAZARD--TWO SHUTOFF CONTROLS ARE INSTALLED AT THE FACILITY EXTERNAL TO THE SYSTEM. THE LOCATIONS OF THESE TWO CONTROLS SHOULD BE KNOWN TO THE FACILITIES MANAGER BEFORE OPERATION AND SHOULD BE NOTED ON THE SITE DIAGRAM THAT IS CREATED FOR EACH SITE DURING INSTALLATION. THE TWO SHUTOFFS ARE: (1) THE ELECTRICAL DISCONNECT SWITCH AND (2) THE MANUAL NATURAL GAS SHUTOFF VALVE. A THIRD SHUTOFF, AN EMERGENCY POWER OFF (EPO) BUTTON, MAY BE PROVIDED ON-SITE. Q: DOES THE BLOOM ENERGY FUEL CELL SYSTEM OPERATE 24/7? A: YES. Q: ARE THE BLOOM ENERGY FUEL CELL SYSTEMS MONITORED? A: YES. BLOOM ENERGY FUEL CELL SYSTEMS ARE CONTROLLED REMOTELY AND HAVE INTERNAL SENSORS THAT CONTINUOUSLY MONITOR SYSTEM OPERATION. IF SAFETY CIRCUITS DETECT A CONDITION OUTSIDE NORMAL OPERATING PARAMETERS, THE FUEL SUPPLY IS STOPPED AND INDIVIDUAL SYSTEM COMPONENTS ARE AUTOMATICALLY SHUT DOWN. A BLOOM ENERGY REMOTE OPERATOR CAN ALSO REMOTELY INITIATE ANY EMERGENCY SEQUENCE. AN EMERGENCY STOP ALARM INITIATES AN AUTOMATIC SHUTDOWN SEQUENCE THAT PUTS THE SYSTEM INTO "SAFE MODE" AND CAUSES IT TO STOP EXPORTING POWER. IF YOU HAVE QUESTIONS ABOUT ANY OF THESE SAFETY FEATURES, PLEASE CONTACT BLOOM ENERGY AT CUSTOMERCARE@BLOOMENERGY.COM. Q: WHAT ARE THE EMISSIONS GENERATED BY BLOOM ENERGY FUEL CELL SYSTEMS? A: THE SPECIFIC PERCENTAGE OF CARBON EMISSION REDUCTIONS ARE DEPENDENT ON YOUR STATE'S GENERATION MIX, BUT BLOOM ENERGY FUEL CELL SYSTEMS VIRTUALLY ELIMINATE NOX, SOX, AND OTHER CRITICAL AIR POLLUTANTS THAT ARE FOUND IN TRADITIONAL ELECTRICITY GENERATION METHODS. FOR SPECIFIC EMISSIONS RANGES, PLEASE REFER TO THE DATA SHEET PROVIDED WITH THIS FAQ. Q: WHAT IS THE SUSTAINABILITY IMPACT OF BLOOM ENERGY FUEL CELL SYSTEMS? A: BLOOM ENERGY FUEL CELL SYSTEMS GENERATE ELECTRICITY ON-SITE THROUGH AN EFFICIENT ELECTROCHEMICAL REACTION WITHOUT COMBUSTION. DUE TO THE HIGH EFFICIENCY (60%-53% COMPARED TO A COMBINED CYCLE NATURAL GAS PLANT WITH EFFICIENCY OF 40-45% OR COAL PLANTS AT 35%) BLOOM ENERGY SERVERS REDUCE CARBON EMISSIONS BY 20-50% COMPARED TO THE US GRID EMISSION RATES. THE VARIATION IN EMISSIONS REDUCTION IS DUE TO THE VARIATION IN HOW DIFFERENT STATES GENERATE ELECTRICITY. IN ADDITION, BLOOM ENERGY FUEL CELL SYSTEMS USE NO WATER DURING NORMAL OPERATION
VICINITY MAP (NTS)						
						

CUSTOMER SITE

DYNO NOBEL INC.
65 WOODLAND STREET
BLDG 200, SIMSBURY,
CT 06070

DYNO[®]

Dyno Nobel

REVISION HISTORY

REV	REVISION ISSUE	DATE

DESIGNED BY	REVIEWED BY
DRAWN BY THARA SRINIVASACHARI	APPROVED BY

SHEET TITLE

COVER SHEET

DRAWING NUMBER

G0.1



BLOOM DOCUMENT

DOC-1012744

THIS DRAWING IS 24" x 36" AT FULL SIZE

SITE ID: DYN000.0

SHEET 01 OF 07

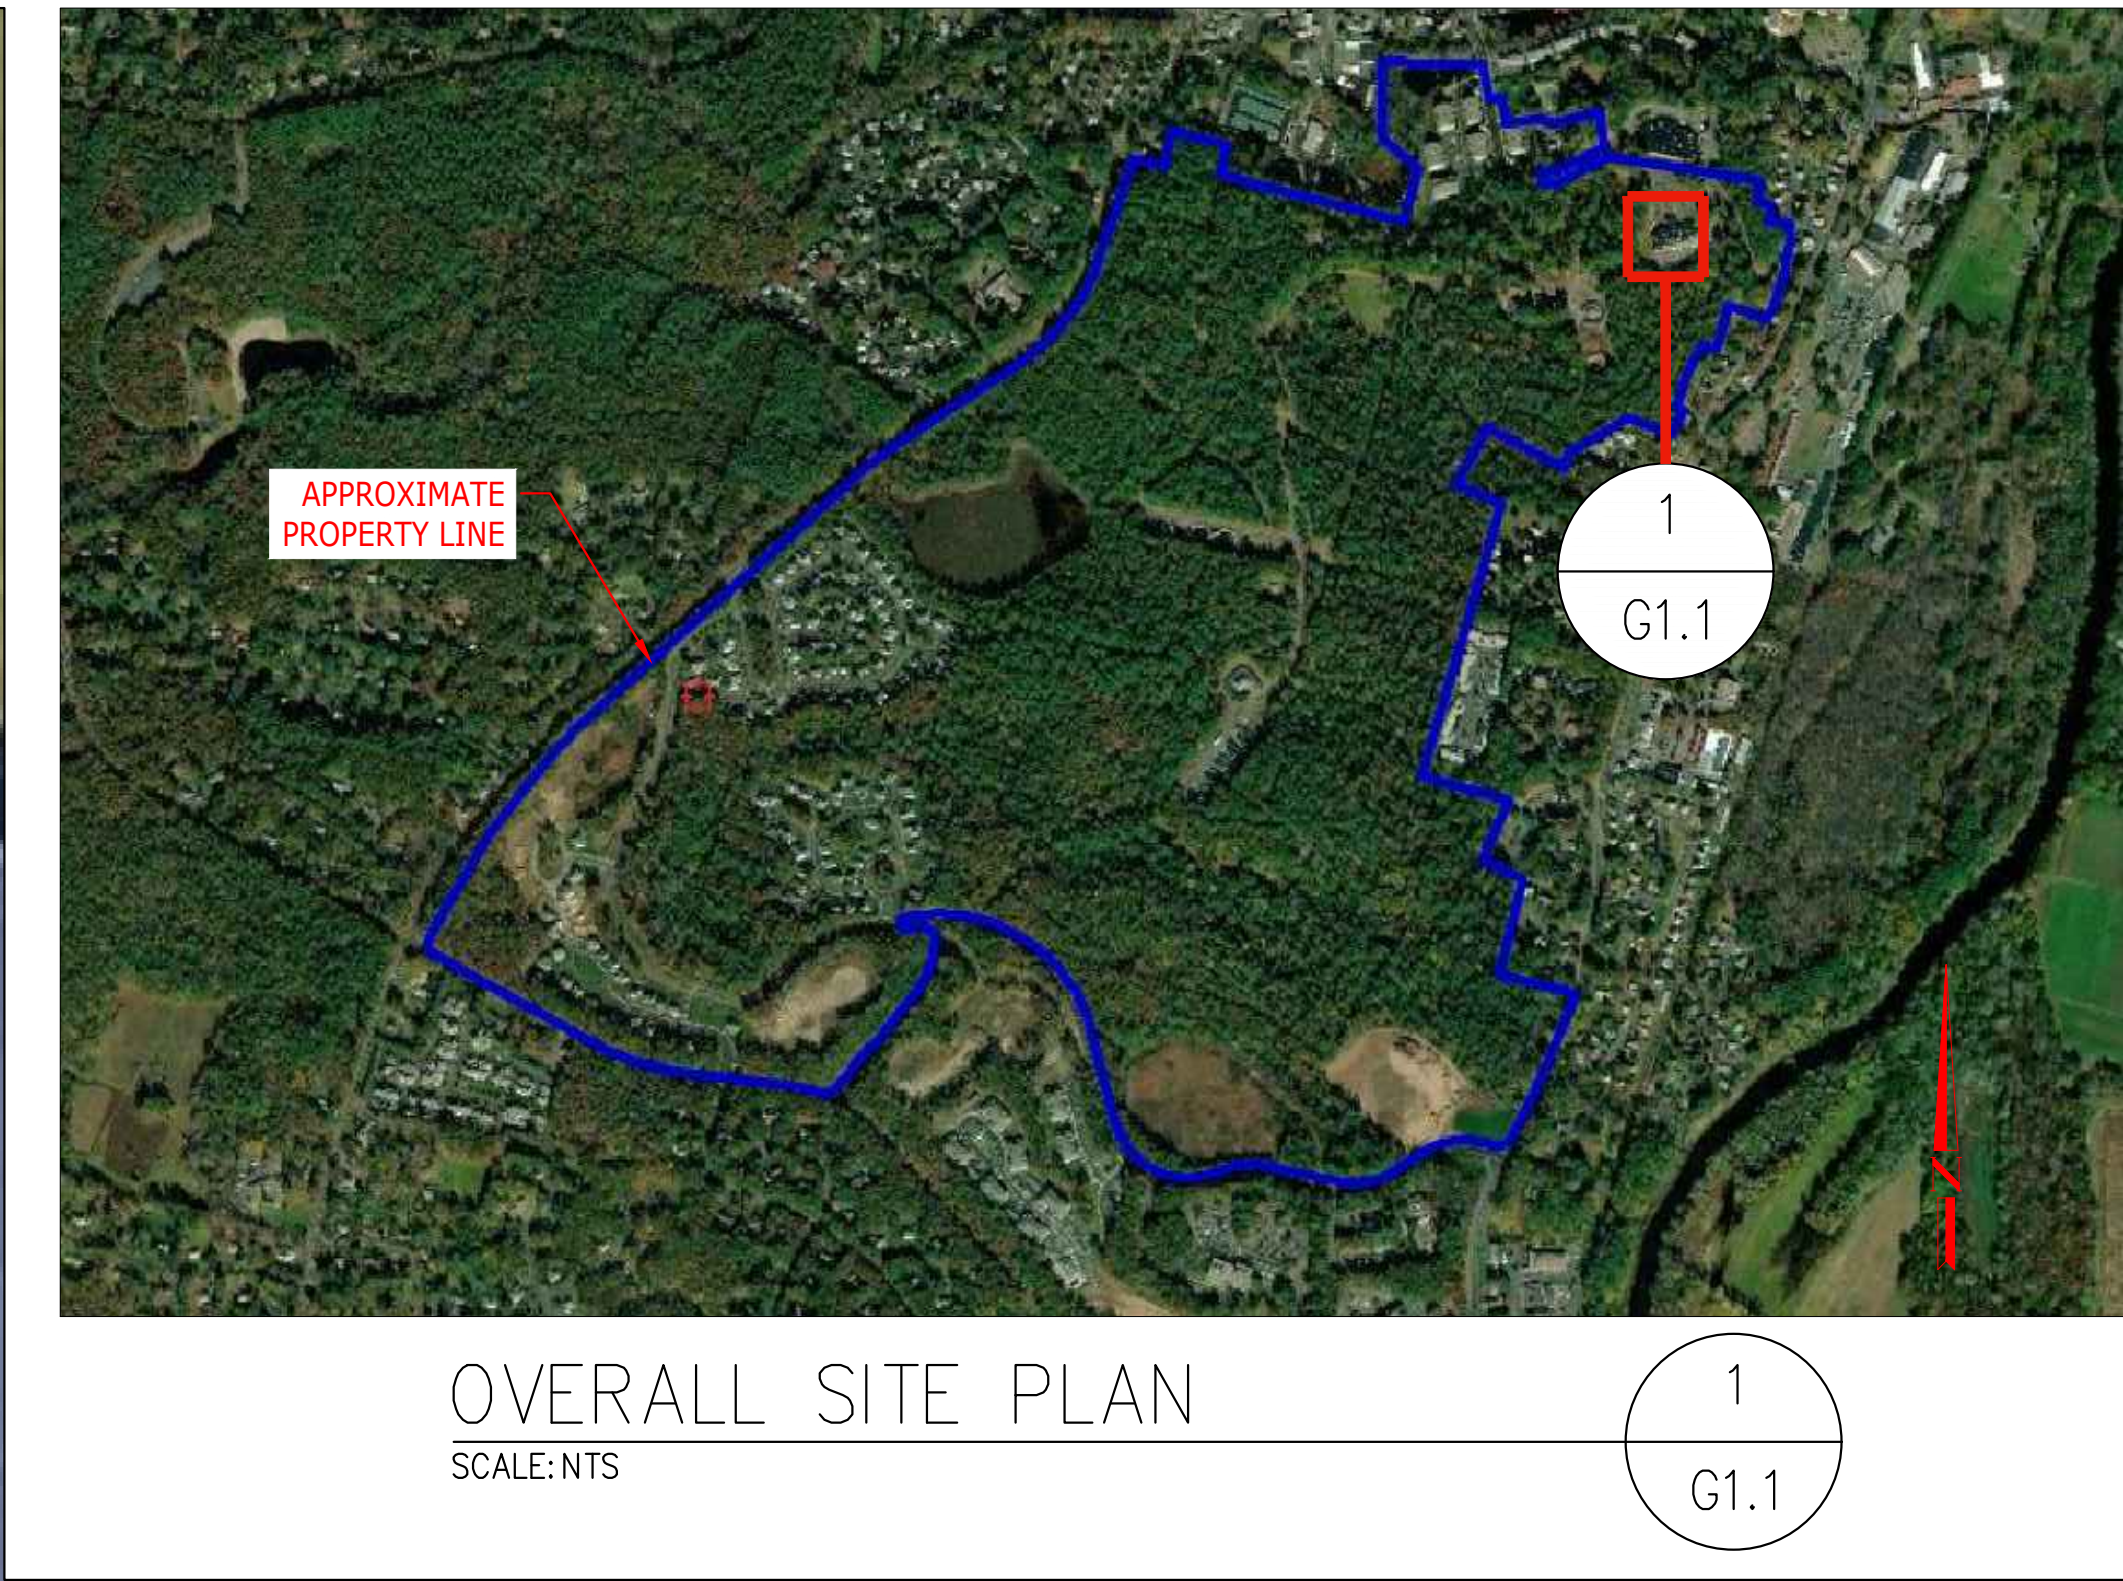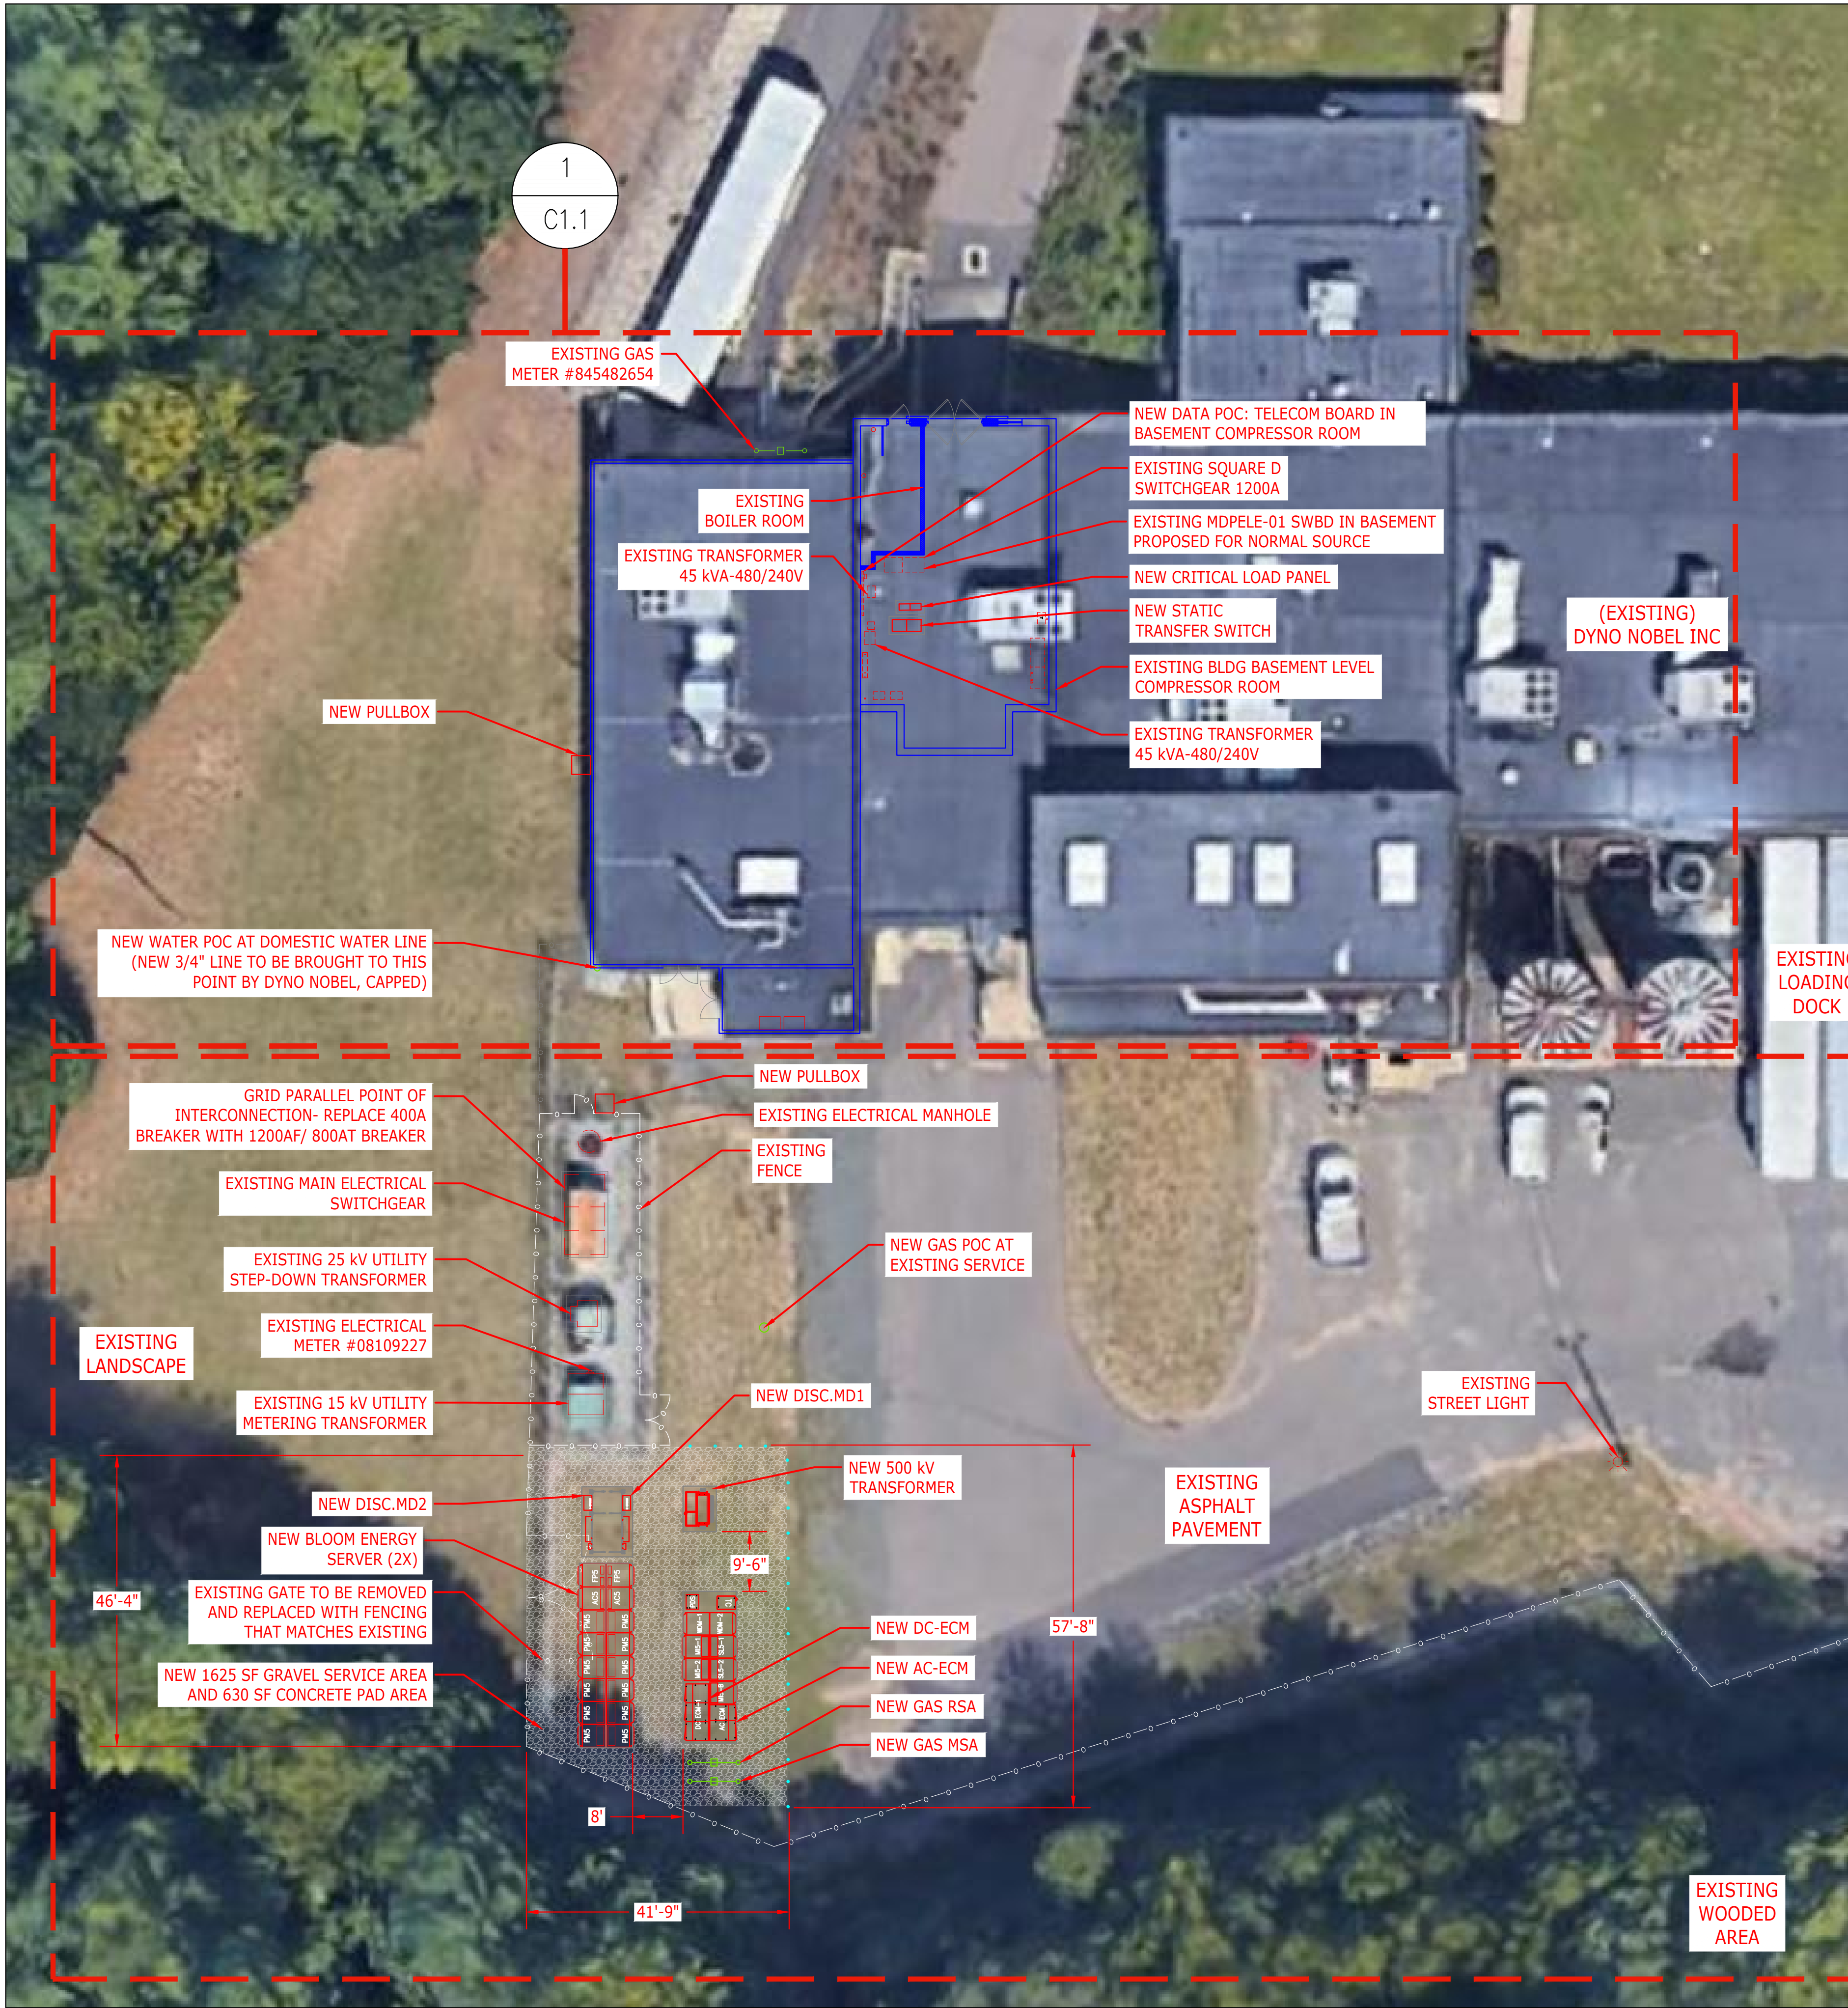

OVERALL SITE PLAN
SCALE: 1" = 30'

2
G1.1

Bloomenergy®

4353 N. FIRST STREET
SAN JOSE, CA 95134
PROPRIETARY AND CONFIDENTIAL

BLOOM ENERGY CORPORATION ALL RIGHTS RESERVED. THIS DOCUMENT IS FOR REFERENCE ONLY AND MAY NOT BE USED WITHOUT THE WRITTEN PERMISSION OF BLOOM ENERGY. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT PERMISSION OF BLOOM ENERGY IS PROHIBITED.

CUSTOMER SITE

DYNO NOBEL INC.
65 WOODLAND STREET
BLDG 200, SIMSBURY,
CT 06070

DYNO®
Dyno Nobel

REVISION HISTORY		
REV	REVISION ISSUE	DATE


DESIGNED BY THARA SRINIVASACHARI	REVIEWED BY APPROVED BY
-------------------------------------	----------------------------

SHEET TITLE
OVERALL
SITE PLAN

DRAWING NUMBER
G1.1


BLOOM DOCUMENT
DOC-1012744

THIS DRAWING IS 24" X 36" AT FULL SIZE
SITE ID: DYN000.0 SHEET 03 OF 07

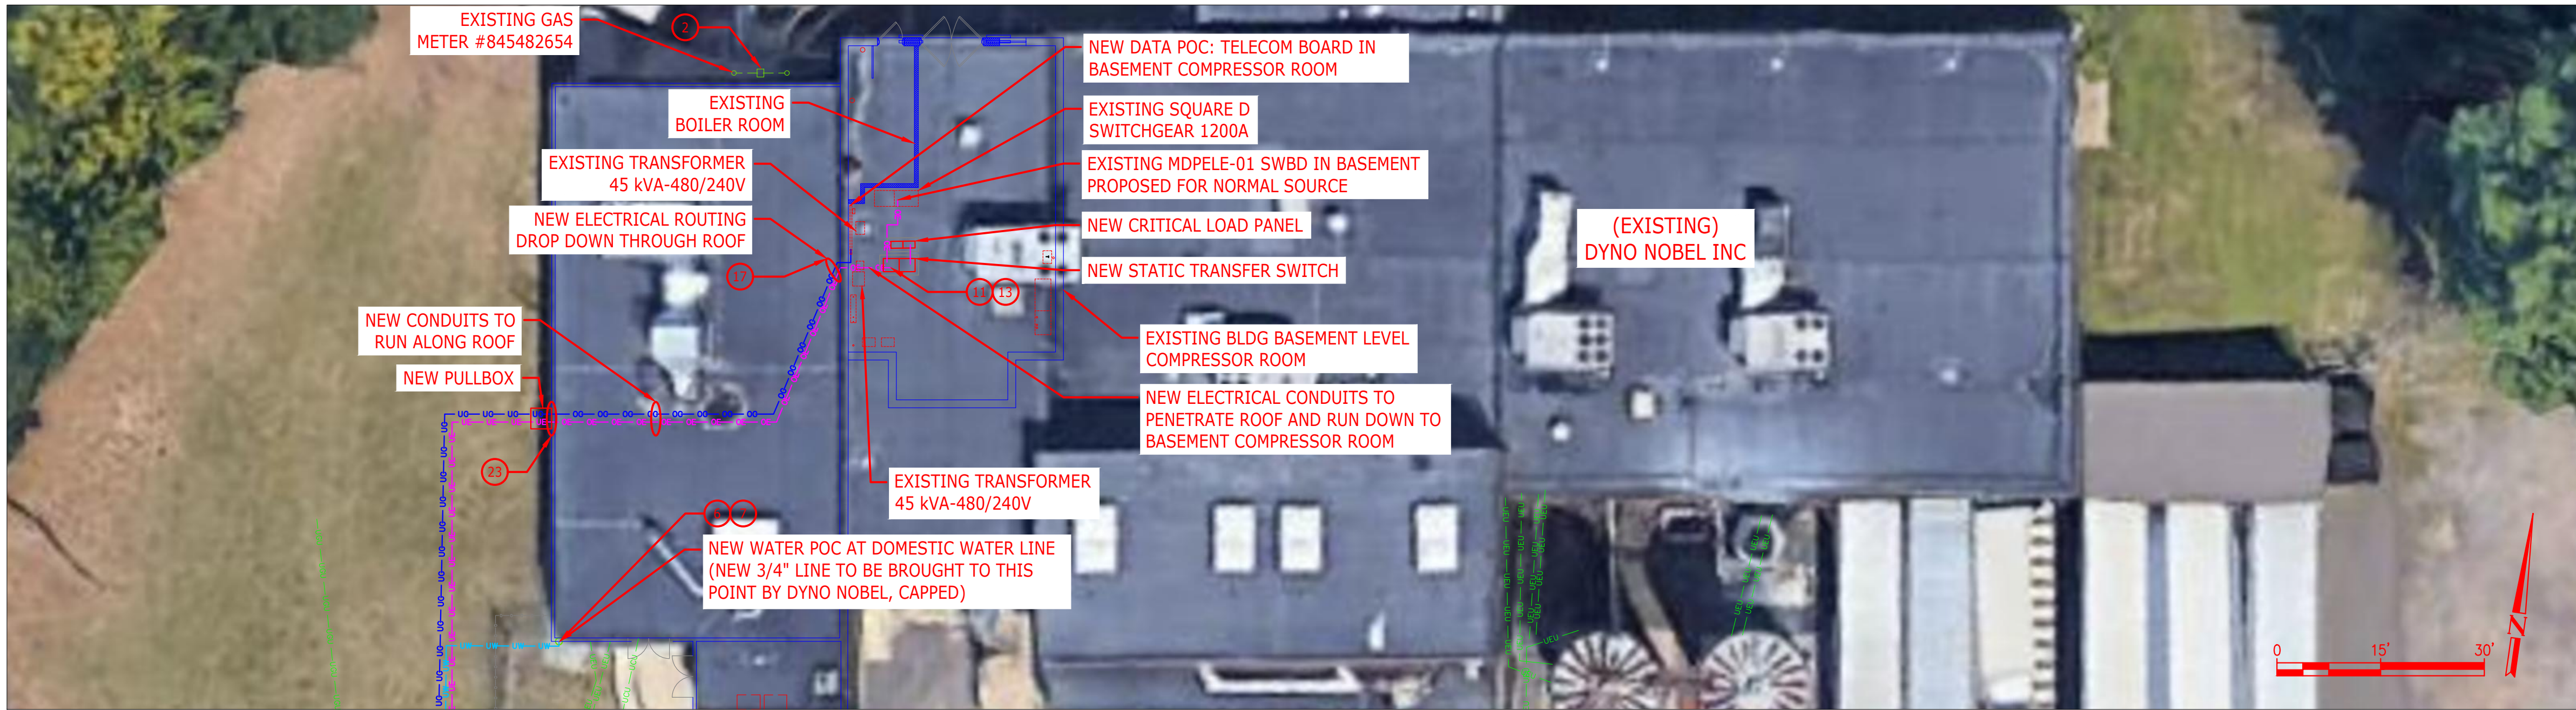

ASR SITE PLAN
SCALE: 1" = 15'

1
C1.1

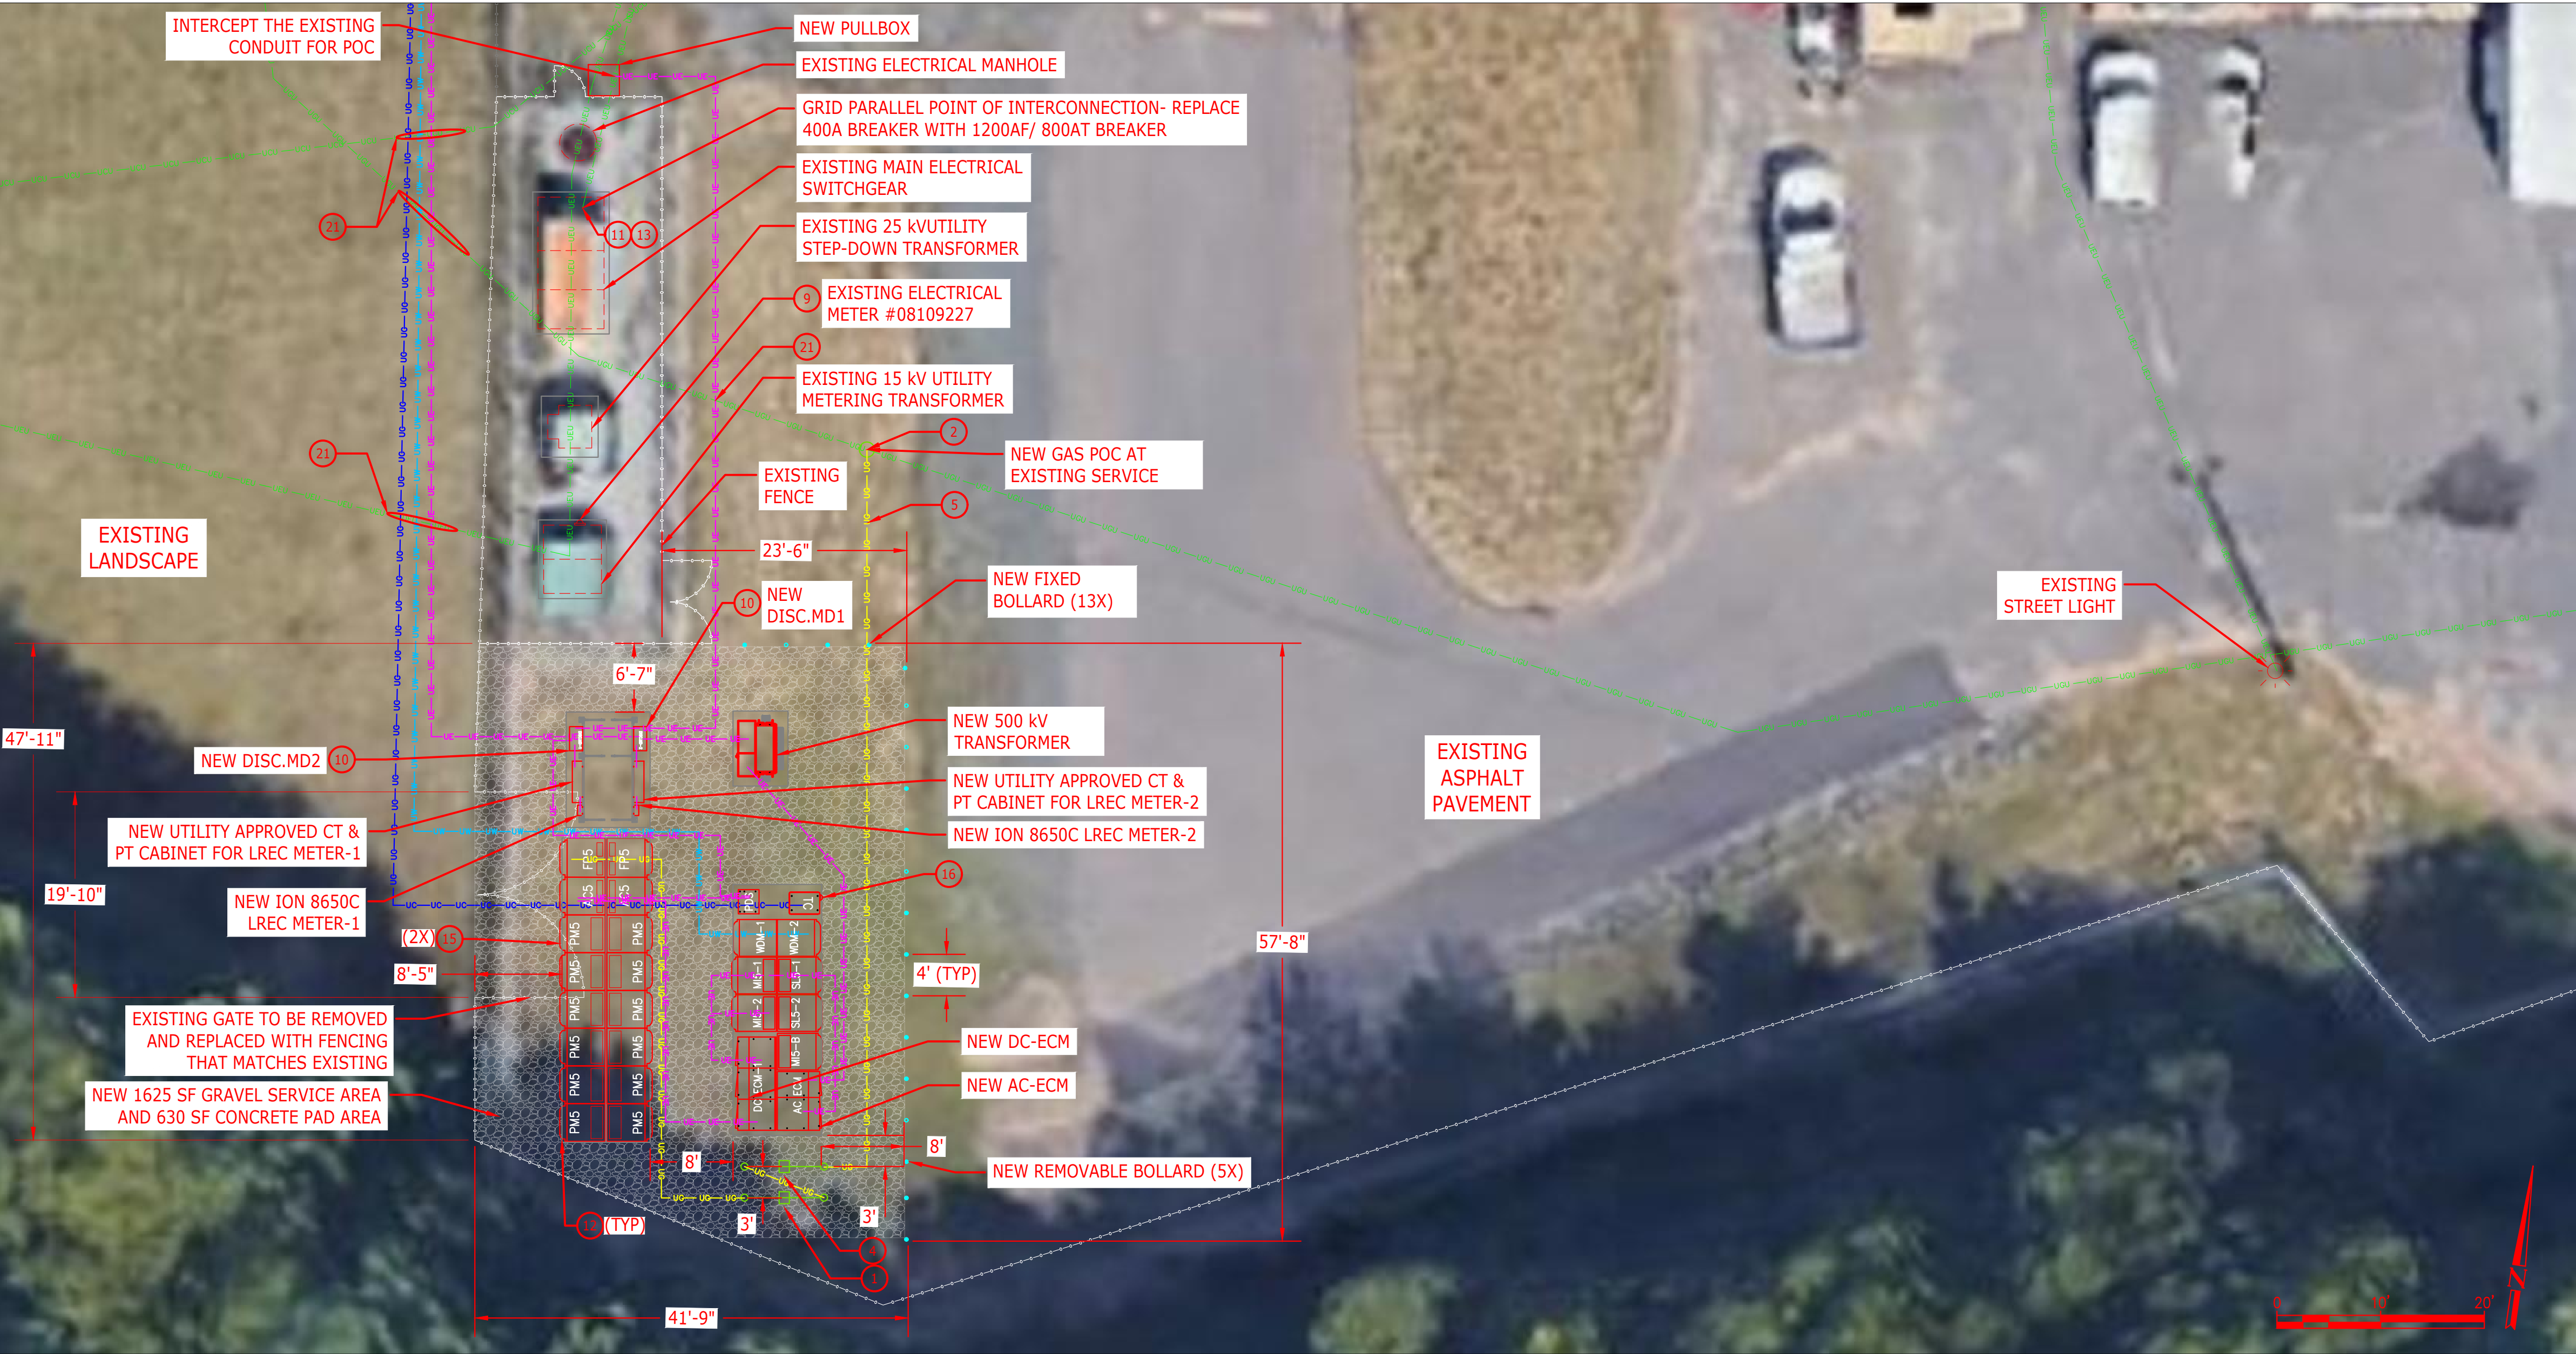

DETAILED SITE PLAN
SCALE: 1" = 10'

2
C1.1

GENERAL NOTES

1. CLEAN AND PRIME ALL NEW WALL MOUNTED PIPING AND CONDUIT. PIPING AND CONDUIT SHALL BE PAINTED WITH EXTERIOR GRADE PAINT TO MATCH EXISTING.
2. CONDUITS AND PIPES MOUNTED TO BUILDING WALL SHALL BE SUPPORTED AS PER LOCAL CODE, RUN AT HEIGHT ABOVE DOORWAYS, AND STAND OFF WALL TO AVOID EXISTING CONDUITS AND PIPES.
3. SLOPE LINES SHOWN ARE APPROXIMATE AND INTENDED TO SHOW THE GENERAL DIRECTION OF WATER RUN OFF; SLOPE LINES ARE DRAWN PER VISUAL SURVEY OF SURROUNDING AREA.
4. SEE BLOOM ENERGY PRODUCT INSTALLATION DRAWINGS FOR UTILITY CONNECTIONS TO ANCILLARY EQUIPMENT AND ENERGY SERVER.

REFERENCE SHEET NOTES

- ① NEW UTILITY PROVIDED AND INSTALLED GAS METER & REGULATOR ASSEMBLY WITH SHUT-OFF VALVE. CONTRACTOR SHALL PROVIDE PAD PER DETAILS IF REQUIRED BY UTILITY COMPANY. COORDINATE ALL CONNECTIONS WITH GAS UTILITY.
- ② NEW UNDERGROUND GAS SERVICE TAP BY UTILITY COMPANY. COORDINATE WITH GAS UTILITY. CONTRACTOR SHALL PERFORM COMPACTION AND MATCH EXISTING SURFACE AND GRADE. CONTRACTOR SHALL COORDINATE GAS PIPE SIZING AND INSTALLATION REQUIREMENTS WITH UTILITY.
- ④ NEW PRIVATE GAS REGULATOR SET ASSEMBLY FOR BLOOM ENERGY SERVER WITH SHUT-OFF VALVE. REFER TO GAS RISER DETAIL FOR ADDITIONAL REQUIREMENTS.
- ⑤ NEW GAS PIPE SHALL BE FURNISHED AND INSTALLED BY THE CONTRACTOR. REFER TO GAS RISER DETAIL FOR ADDITIONAL REQUIREMENTS.
- ⑥ TAP EXISTING WATER LINE AT NEAREST ACCESSIBLE LOCATION IN BUILDING AS SHOWN WITH A LOCAL SHUT-OFF VALVE. REFER TO DOMESTIC WATER CONNECTION DETAIL FOR ADDITIONAL REQUIREMENTS.
- ⑦ NEW WATER PIPE SHALL BE FURNISHED AND INSTALLED BY THE CONTRACTOR. REFER TO WATER RISER DETAIL FOR ADDITIONAL REQUIREMENTS.
- ⑨ EXISTING UTILITY ELECTRIC METER. REFER TO ELECTRICAL SINGLE LINE DIAGRAM FOR ADDITIONAL REQUIREMENTS.
- ⑩ NEW BLOOM ENERGY FURNISHED, CONTRACTOR INSTALLED, DISCONNECT SWITCH. STRUCT MOUNT PER MANUFACTURER AND UTILITY SPECIFICATIONS.
- ⑪ CONTRACTOR SHALL TERMINATE ELECTRIC FEEDER AS SHOWN. REFER TO ELECTRICAL SINGLE LINE DIAGRAM FOR ADDITIONAL REQUIREMENTS.
- ⑫ CONTRACTOR SHALL PROVIDE TWO GROUNDING RODS TO BE PLACED 6' APART MINIMUM. REFER TO ELECTRICAL SINGLE LINE DIAGRAM FOR ADDITIONAL REQUIREMENTS.
- ⑬ NEW ELECTRICAL FEEDER SHALL BE FURNISHED AND INSTALLED BY THE CONTRACTOR. REFER TO ELECTRICAL SINGLE LINE DIAGRAM FOR ADDITIONAL REQUIREMENTS.
- ⑮ NEW BLOOM ENERGY SERVER. REFER TO BLOOM ENERGY STANDARD INSTALLATION DRAWING SET FOR ADDITIONAL BLOOM ENERGY SERVER DETAILS.
- ⑯ FACTORY WIRED BLOOM ENERGY SERVER EMERGENCY POWER-OFF SWITCH (EPO).
- ⑰ CONTRACTOR SHALL CORE CONDUIT AND/OR PIPE THROUGH WALL. SCAN WALL PRIOR TO CORING TO AVOID COLLATERAL DAMAGE TO EXISTING PLUMBING AND WIRING. REFER TO WALL PENETRATION DETAIL FOR ADDITIONAL REQUIREMENTS.
- ⑳ PROTECT EXISTING UNDERGROUND UTILITY LINES FROM DAMAGE WHEN CROSSING WITH NEW UNDERGROUND UTILITIES. CONTRACTOR SHALL BE RESPONSIBLE FOR REPAIR OR REPLACEMENT OF ANY DAMAGED LINES.
- ㉓ CONTRACTOR SHALL TRANSITION ALL ABOVEGROUND NEW LINES TO UNDERGROUND TOWARD ANCILLARY EQUIPMENT. ABOVE GROUND UTILITIES SHALL BE PROTECTED AS NECESSARY, THEN ROUTED UNDERGROUND TO EQUIPMENT STUB-UP LOCATIONS PER MECHANICAL DETAIL.

EXISTING UTILITY NOTE:
THE LOCATION OF EXISTING UTILITIES IS SHOWN FOR THE CONTRACTOR'S REFERENCE. EXACT LOCATION, DEPTH AND SIZE OF ALL EXISTING UTILITIES IS NOT KNOWN. CONTRACTOR SHALL ASSUME RESPONSIBILITY FOR ALL EXISTING UTILITIES NOT SHOWN ON THESE DRAWINGS. CONTRACTOR TO FIELD VERIFY LOCATION OF EXISTING UNDERGROUND UTILITIES AND PROTECT THE EXISTING UNDERGROUND UTILITY LINES FROM DAMAGE WHEN CROSSING WITH NEW UNDERGROUND UTILITIES. THE CONTRACTOR SHALL BE RESPONSIBLE FOR REPAIR OR REPLACEMENT OF ANY DAMAGED LINES. THE CONTRACTOR SHALL NOTIFY THE ENGINEER IMMEDIATELY IF ANY FIELD CONDITIONS ENCOUNTERED DIFFER FROM THOSE REPRESENTED HEREON. SUCH CONDITIONS COULD RENDER THE DESIGNS HEREON INAPPROPRIATE AND MAY REQUIRE ADJUSTMENTS TO AVOID CONFLICTS.

Bloomenergy®

4353 N. FIRST STREET
SAN JOSE, CA 95134
PROPRIETARY AND CONFIDENTIAL

BLOOM ENERGY CORPORATION ALL RIGHTS RESERVED. THIS DOCUMENT IS FOR REFERENCE ONLY AND MAY NOT BE USED WITHOUT THE WRITTEN PERMISSION OF BLOOM ENERGY. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT PERMISSION OF BLOOM ENERGY IS PROHIBITED.

CUSTOMER SITE

DYNO NOBEL INC.
65 WOODLAND STREET
BLDG 200, SIMSBURY,
CT 06070

DYNO®
Dyno Nobel

REVISION HISTORY

REV	REVISION ISSUE	DATE

DESIGNED BY	REVIEWED BY
DRAWN BY THARA SRINIVASACHARI	APPROVED BY

SHEET TITLE

DETAILED
SITE PLAN

DRAWING NUMBER
C1.1

BLOOM DOCUMENT
DOC-1012744

THIS DRAWING IS 24" x 36" AT FULL SIZE
SITE ID: DYN000.0 SHEET 04 OF 07



660 HOPMEADOW ST
SIMSBURY,CONNECTICUT 06070



Know what's below.
Call before you dig.

PRIOR TO COMMENCING ANY EXCAVATION OR DEMOLITION, THE CONTRACTOR SHALL CONTACT LOCAL UTILITIES, INCLUDING BUT NOT LIMITED TO ELECTRICAL, GAS, WATER, CABLE, AND TELEPHONE, REQUESTING A UTILITY MARK OUT AND AS NECESSARY RETAIN THE SERVICES OF A PRIVATE UTILITY MARK OUT COMPANY TO PERFORM SUCH MARK OUT. IT IS THE CONTRACTOR'S RESPONSIBILITY TO LOCATE AND VERIFY THE LOCATION OF UTILITIES, IRRIGATION, SITE LIGHTING, AND ELECTRICAL LINES IN THE VICINITY OF THE CONSTRUCTION. CONTRACTOR SHALL BE RESPONSIBLE FOR THE REPAIR ANY AND ALL UTILITIES DAMAGED BY THE CONTRACTOR'S OPERATION AT NO ADDITIONAL EXPENSE.



4353 N. FIRST STREET
SAN JOSE, CA 95134
PROPRIETARY AND CONFIDENTIAL

BLOOM ENERGY CORPORATION ALL RIGHTS RESERVED. THIS DOCUMENT IS FOR REFERENCE ONLY AND MAY NOT BE USED WITHOUT THE WRITTEN PERMISSION OF BLOOM ENERGY. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT PERMISSION OF BLOOM ENERGY IS PROHIBITED.

SITE INFORMATION	PERMITTING INFORMATION	CODES	PROJECT DESCRIPTION	BLOOM ENERGY FAQ's																																								
PARCEL INFORMATION PROPERTY OWNER DYNØ NOBEL INC. COUNTY HARTFORD COUNTY TAX MAP # G11-144-005 PROPERTY DESCRIPTION PROPERTY TYPE COMMERCIAL PROPERTY AREA 4,748,040 S.F DISTURBED AREA 2,430 S.F PARKING INFORMATION EXISTING PARKING* XXX REQUIRED PARKING* XXX REMOVED PARKING XXX ADDED PARKING XXX FINAL PARKING COUNT XXX	MUNICIPAL AGENCY PLANNING DEPARTMENT THE PLANNING AND LAND USE DEPARTMENT CONTACT INFO (860) 658-3245 BUILDING THE BUILDING DEPARTMENT (860) 658-3234 FIRE THE FIRE DEPARTMENT (860) 658-3243 UTILITY TYPE NATURAL GAS COMPANY CONNECTICUT NATURAL GAS CONTACT INFO (860) 524-8361 ELECTRICAL EVERSOURCE (CT) (888) 955-8824 WATER THE WATER DEPARTMENT (860) 658-3258	BUILDING 2015 INTERNATIONAL BUILDING CODE BUILDING ENERGY 2018 CONNECTICUT STATE BUILDING CODE PLUMBING 2015 INTERNATIONAL PLUMBING CODE FUEL GAS 2015 INTERNATIONAL FUEL GAS CODE ELECTRICAL 2017 NATIONAL ELECTRICAL CODE FIRE 2018 CONNECTICUT STATE FIRE SAFETY CODE MECHANICAL 2015 INTERNATIONAL MECHANICAL CODE	THIS PROJECT CONSISTS OF THE INSTALLATION OF TWO (2) BLOOM ENERGY ESS OUTDOOR NATURAL GAS CLEAN ENERGY SERVER. THE CLEAN ENERGY SERVER IS SUPPORTED ON A CONCRETE PAD. THE WORK INCLUDES ALL ITEMS LISTED IN THE SCOPE OF WORK. FRONT VIEW OPEN DOOR CLOSED DOOR SIDE VIEW	Q: WHAT IS A BLOOM ENERGY SERVER? A: THE BLOOM ENERGY SERVER IS A STATIONARY FUEL CELL POWER SYSTEM. Q: IS THE BLOOM ENERGY SERVER PRODUCT LISTED OR CERTIFIED? A: YES. ES-5XXX SERIES: • THE FUEL CELL IS UL LISTED AS A "STATIONARY FUEL CELL POWER SYSTEM" TO ANSI/CSA AMERICA FC 1-2004. • IT IS UL LISTED UNDER UL CATEGORY IRGZ AND UL FILE NUMBER MH45102. ESS SERIES: • THE FUEL CELL IS UL LISTED AS A "STATIONARY FUEL CELL POWER SYSTEM" TO ANSI/CSA FC 1-2014. • IT IS UL LISTED UNDER UL CATEGORY IRGZ AND UL FILE NUMBER MH45102. Q: WHERE ARE FUEL CELLS COVERED IN THE NATIONAL ELECTRICAL CODE (NEC)? A: FUEL CELLS ARE COVERED IN ARTICLE 692 OF THE NEC (NFPA 70). FUEL CELLS HAVE BEEN INCORPORATED INTO THE NEC SINCE 2002. Q: WHAT IS THE MODEL NUMBER OF THIS PRODUCT? A: PLEASE SEE THE DATA SHEET PROVIDED WITH THIS FAQ. Q: WHAT IS THE NOISE LEVEL OF THE FUEL CELL SYSTEM? A: FOR SPECIFIC DB RANGES, PLEASE REFER TO THE DATA SHEET PROVIDED WITH THIS FAQ. Q: DO BLOOM ENERGY FUEL CELL SYSTEMS PROVIDE LIFE SAFETY POWER? A: NO. WE ARE NOT LIFE SAFETY AND DO NOT PROVIDE LIFE SAFETY POWER, EVEN WHEN A UPM IS INSTALLED. WE ARE NOT ALTERING WHATEVER LIFE SAFETY IS CURRENTLY PRESENT AT THE FACILITY. Q: IS THE BLOOM ENERGY FUEL CELL SYSTEM TAMPER-PROOF? A: YES. THE FUEL CELLS ARE SECURED IN PLACE AND DOORS ARE SECURED AND LOCKED. ONLY BLOOM SERVICE PERSONNEL HAVE THE KEYS AND CAN BE ON-SITE WITHIN 24 HOURS. Q: WHAT HAPPENS TO THE CUSTOMER FACILITY POWER IF THE FUEL CELLS SHUT DOWN? A: THE FUEL CELL SYSTEM IS OPERATED IN GRID-PARALLEL MODE. IF THE UTILITY GRID IS OPERATIONAL, THE CUSTOMER FACILITY WILL RECEIVE POWER FROM THE GRID AND NOTICE NO DIFFERENCE. Q: WHAT HAPPENS TO THE FUEL CELL SYSTEM WHEN THE UTILITY POWER SHUTS DOWN? A: IF UTILITY PROVIDED POWER IS LOST FOR ANY REASON, THE FUEL CELL SYSTEM WILL ALSO STOP PRODUCING POWER. THE FUEL CELL SYSTEM WILL REMAIN IN STAND-BY MODE UNTIL IT AUTOMATICALLY SENSES THE UTILITY GRID HAS BEEN RESTORED. Q: WHAT HAPPENS TO THE FUEL CELL SYSTEM WHEN THE UTILITY GAS SHUTS DOWN? A: IF THE UTILITY GAS IS INTERRUPTED, THE FUEL CELL SYSTEM WILL AUTOMATICALLY SHUT DOWN AS WELL. Q: CAN THE FUEL CELL SYSTEM BE SHUT DOWN LOCALLY IN CASE OF AN EMERGENCY? A: YES. IF THE FUEL CELL MUST BE SHUT DOWN RIGHT AWAY--FOR EXAMPLE, IN CASE OF A BUILDING FIRE OR ELECTRICAL HAZARD--TWO SHUTOFF CONTROLS ARE INSTALLED AT THE FACILITY EXTERNAL TO THE SYSTEM. THE LOCATIONS OF THESE TWO CONTROLS SHOULD BE KNOWN TO THE FACILITIES MANAGER BEFORE OPERATION AND SHOULD BE NOTED ON THE SITE DIAGRAM THAT IS CREATED FOR EACH SITE DURING INSTALLATION. THE TWO SHUTOFFS ARE: (1) THE ELECTRICAL DISCONNECT SWITCH AND (2) THE MANUAL NATURAL GAS SHUTOFF VALVE. A THIRD SHUTOFF, AN EMERGENCY POWER OFF (EPO) BUTTON, MAY BE PROVIDED ON-SITE. Q: DOES THE BLOOM ENERGY FUEL CELL SYSTEM OPERATE 24/7? A: YES. Q: ARE THE BLOOM ENERGY FUEL CELL SYSTEMS MONITORED? A: YES. BLOOM ENERGY FUEL CELL SYSTEMS ARE CONTROLLED REMOTELY AND HAVE INTERNAL SENSORS THAT CONTINUOUSLY MONITOR SYSTEM OPERATION. IF SAFETY CIRCUITS DETECT A CONDITION OUTSIDE NORMAL OPERATING PARAMETERS, THE FUEL SUPPLY IS STOPPED AND INDIVIDUAL SYSTEM COMPONENTS ARE AUTOMATICALLY SHUT DOWN. A BLOOM ENERGY REMOTE OPERATOR CAN ALSO REMOTELY INITIATE ANY EMERGENCY SEQUENCE. AN EMERGENCY STOP ALARM INITIATES AN AUTOMATIC SHUTDOWN SEQUENCE THAT PUTS THE SYSTEM INTO "SAFE MODE" AND CAUSES IT TO STOP EXPORTING POWER. IF YOU HAVE QUESTIONS ABOUT ANY OF THESE SAFETY FEATURES, PLEASE CONTACT BLOOM ENERGY AT CUSTOMERCARE@BLOOMENERGY.COM. Q: WHAT ARE THE EMISSIONS GENERATED BY BLOOM ENERGY FUEL CELL SYSTEMS? A: THE SPECIFIC PERCENTAGE OF CARBON EMISSION REDUCTIONS ARE DEPENDENT ON YOUR STATE'S GENERATION MIX, BUT BLOOM ENERGY FUEL CELL SYSTEMS VIRTUALLY ELIMINATE NOX, SOX, AND OTHER CRITICAL AIR POLLUTANTS THAT ARE FOUND IN TRADITIONAL ELECTRICITY GENERATION METHODS. FOR SPECIFIC EMISSIONS RANGES, PLEASE REFER TO THE DATA SHEET PROVIDED WITH THIS FAQ. Q: WHAT IS THE SUSTAINABILITY IMPACT OF BLOOM ENERGY FUEL CELL SYSTEMS? A: BLOOM ENERGY FUEL CELL SYSTEMS GENERATE ELECTRICITY ON-SITE THROUGH AN EFFICIENT ELECTROCHEMICAL REACTION WITHOUT COMBUSTION. DUE TO THE HIGH EFFICIENCY (60%-53% COMPARED TO A COMBINED CYCLE NATURAL GAS PLANT WITH EFFICIENCY OF 40-45% OR COAL PLANTS AT 35%) BLOOM ENERGY SERVERS REDUCE CARBON EMISSIONS BY 20-50% COMPARED TO THE US GRID EMISSION RATES. THE VARIATION IN EMISSIONS REDUCTION IS DUE TO THE VARIATION IN HOW DIFFERENT STATES GENERATE ELECTRICITY. IN ADDITION, BLOOM ENERGY FUEL CELL SYSTEMS USE NO WATER DURING NORMAL OPERATION																																								
VICINITY MAP (NTS)		PROJECT TEAM CONTACTS																																										
▼ PROJECT SITE		FIRM ADDRESS CONTACT INFO MANUFACTURER BLOOM ENERGY 4353 N. FIRST STREET SAN JOSE, CA 95134 (408) 543-1500 CUSTOMER DYNØ NOBEL INC, 660 HOPMEADOW ST SIMSBURY,CT-06070 (860) 408-1800 BLOOM ENERGY (ELECTRICAL) JOSEPH A. TEMOWO, PE 4353 N. FIRST STREET SAN JOSE, CA 95134 (408) 543-1500																																										
DRAWING INDEX		SCOPE OF WORK																																										
<table><thead><tr><th>SHI#</th><th>DWG#</th><th>SHEET TITLE</th><th>REV#</th><th>DATE</th></tr></thead><tbody><tr><td>01</td><td>G0.1</td><td>COVER SHEET</td><td></td><td></td></tr><tr><td>02</td><td>G0.2</td><td>GENERAL CONSTRUCTION NOTES</td><td></td><td></td></tr><tr><td>03</td><td>G1.1</td><td>OVERALL SITE PLAN</td><td></td><td></td></tr><tr><td>04</td><td>C1.1</td><td>DETAILED SITE PLAN</td><td></td><td></td></tr><tr><td>05</td><td>E3.1</td><td>ELECTRICAL SINGLE LINE DIAGRAM</td><td></td><td></td></tr><tr><td>06</td><td>E3.2</td><td>ELECTRICAL THREE LINE DIAGRAM</td><td></td><td></td></tr><tr><td>07</td><td>R0.1</td><td>BLOOM PRODUCT DATA SHEET</td><td></td><td></td></tr></tbody></table>		SHI#	DWG#	SHEET TITLE	REV#	DATE	01	G0.1	COVER SHEET			02	G0.2	GENERAL CONSTRUCTION NOTES			03	G1.1	OVERALL SITE PLAN			04	C1.1	DETAILED SITE PLAN			05	E3.1	ELECTRICAL SINGLE LINE DIAGRAM			06	E3.2	ELECTRICAL THREE LINE DIAGRAM			07	R0.1	BLOOM PRODUCT DATA SHEET			THE SCOPE OF THIS PROJECT WILL CONSIST OF THE FOLLOWING: - CIVIL WORK - EXISTING LANDSCAPE SHALL BE REMOVED FOR NEW EQUIPMENT PAD FOR BLOOM ENERGY SERVER. - EXISTING SUBGRADE AT LANDSCAPE REMOVAL WILL BE PREPARED FOR THE NEW EQUIPMENT WEIGHT. - NEW TRENCH FROM BLOOM ENERGY SERVER TO BUILDING FOR GAS, WATER AND ELECTRICAL CONNECTIONS BETWEEN BLOOM ENERGY SERVER AND BUILDING. TRENCH TO BE BACKFILLED AND NEW LANDSCAPE COVER TO BE PROVIDED. - NEW ENERGY SERVER CONCRETE PAD AND ANCILLARY CONCRETE PAD TO BE PLACED AT PREPARED SURFACE AT LANDSCAPE REMOVAL. - NEW BOLLARDS TO BE INSTALLED TO PROTECT BLOOM ENERGY SERVER. - ELECTRICAL WORK - NEW ELECTRICAL FEEDERS BETWEEN BLOOM ENERGY SERVER AND EXISTING MAIN SERVICE SWITCHBOARD. - NEW XFMR, LREC METER WITH CT-PT CABINET, DISCONNECT TO BE INSTALLED. - PLUMBING WORK - NEW WATER CONNECTION FROM POTABLE WATER SOURCE IN FACILITY TO BLOOM ENERGY SERVER. - NEW NATURAL GAS CONNECTION. NEW METER AND REGULATOR REQUIRED.		
SHI#	DWG#	SHEET TITLE	REV#	DATE																																								
01	G0.1	COVER SHEET																																										
02	G0.2	GENERAL CONSTRUCTION NOTES																																										
03	G1.1	OVERALL SITE PLAN																																										
04	C1.1	DETAILED SITE PLAN																																										
05	E3.1	ELECTRICAL SINGLE LINE DIAGRAM																																										
06	E3.2	ELECTRICAL THREE LINE DIAGRAM																																										
07	R0.1	BLOOM PRODUCT DATA SHEET																																										

CUSTOMER SITE

DYNØ NOBEL INC.
660 HOPMEADOW STREET
SIMSBURY, CT 06070



REVISION HISTORY		
REV	REVISION ISSUE	DATE


DESIGNED BY	REVIEWED BY
DRAWN BY SAHANA S GOWDA	APPROVED BY

SHEET TITLE	
COVER SHEET	
DRAWING NUMBER	G0.1
BLOOM DOCUMENT	DOC-1012745
THIS DRAWING IS 24" x 36" AT FULL SIZE	
SITE ID: DYNØ01.0	SHEET 01 OF 07



SITE REFERENCE NOTE:
EXISTING SITE CONDITIONS TAKEN FROM BING MAPS

OVERALL SITE PLAN
SCALE: 1" = 15'

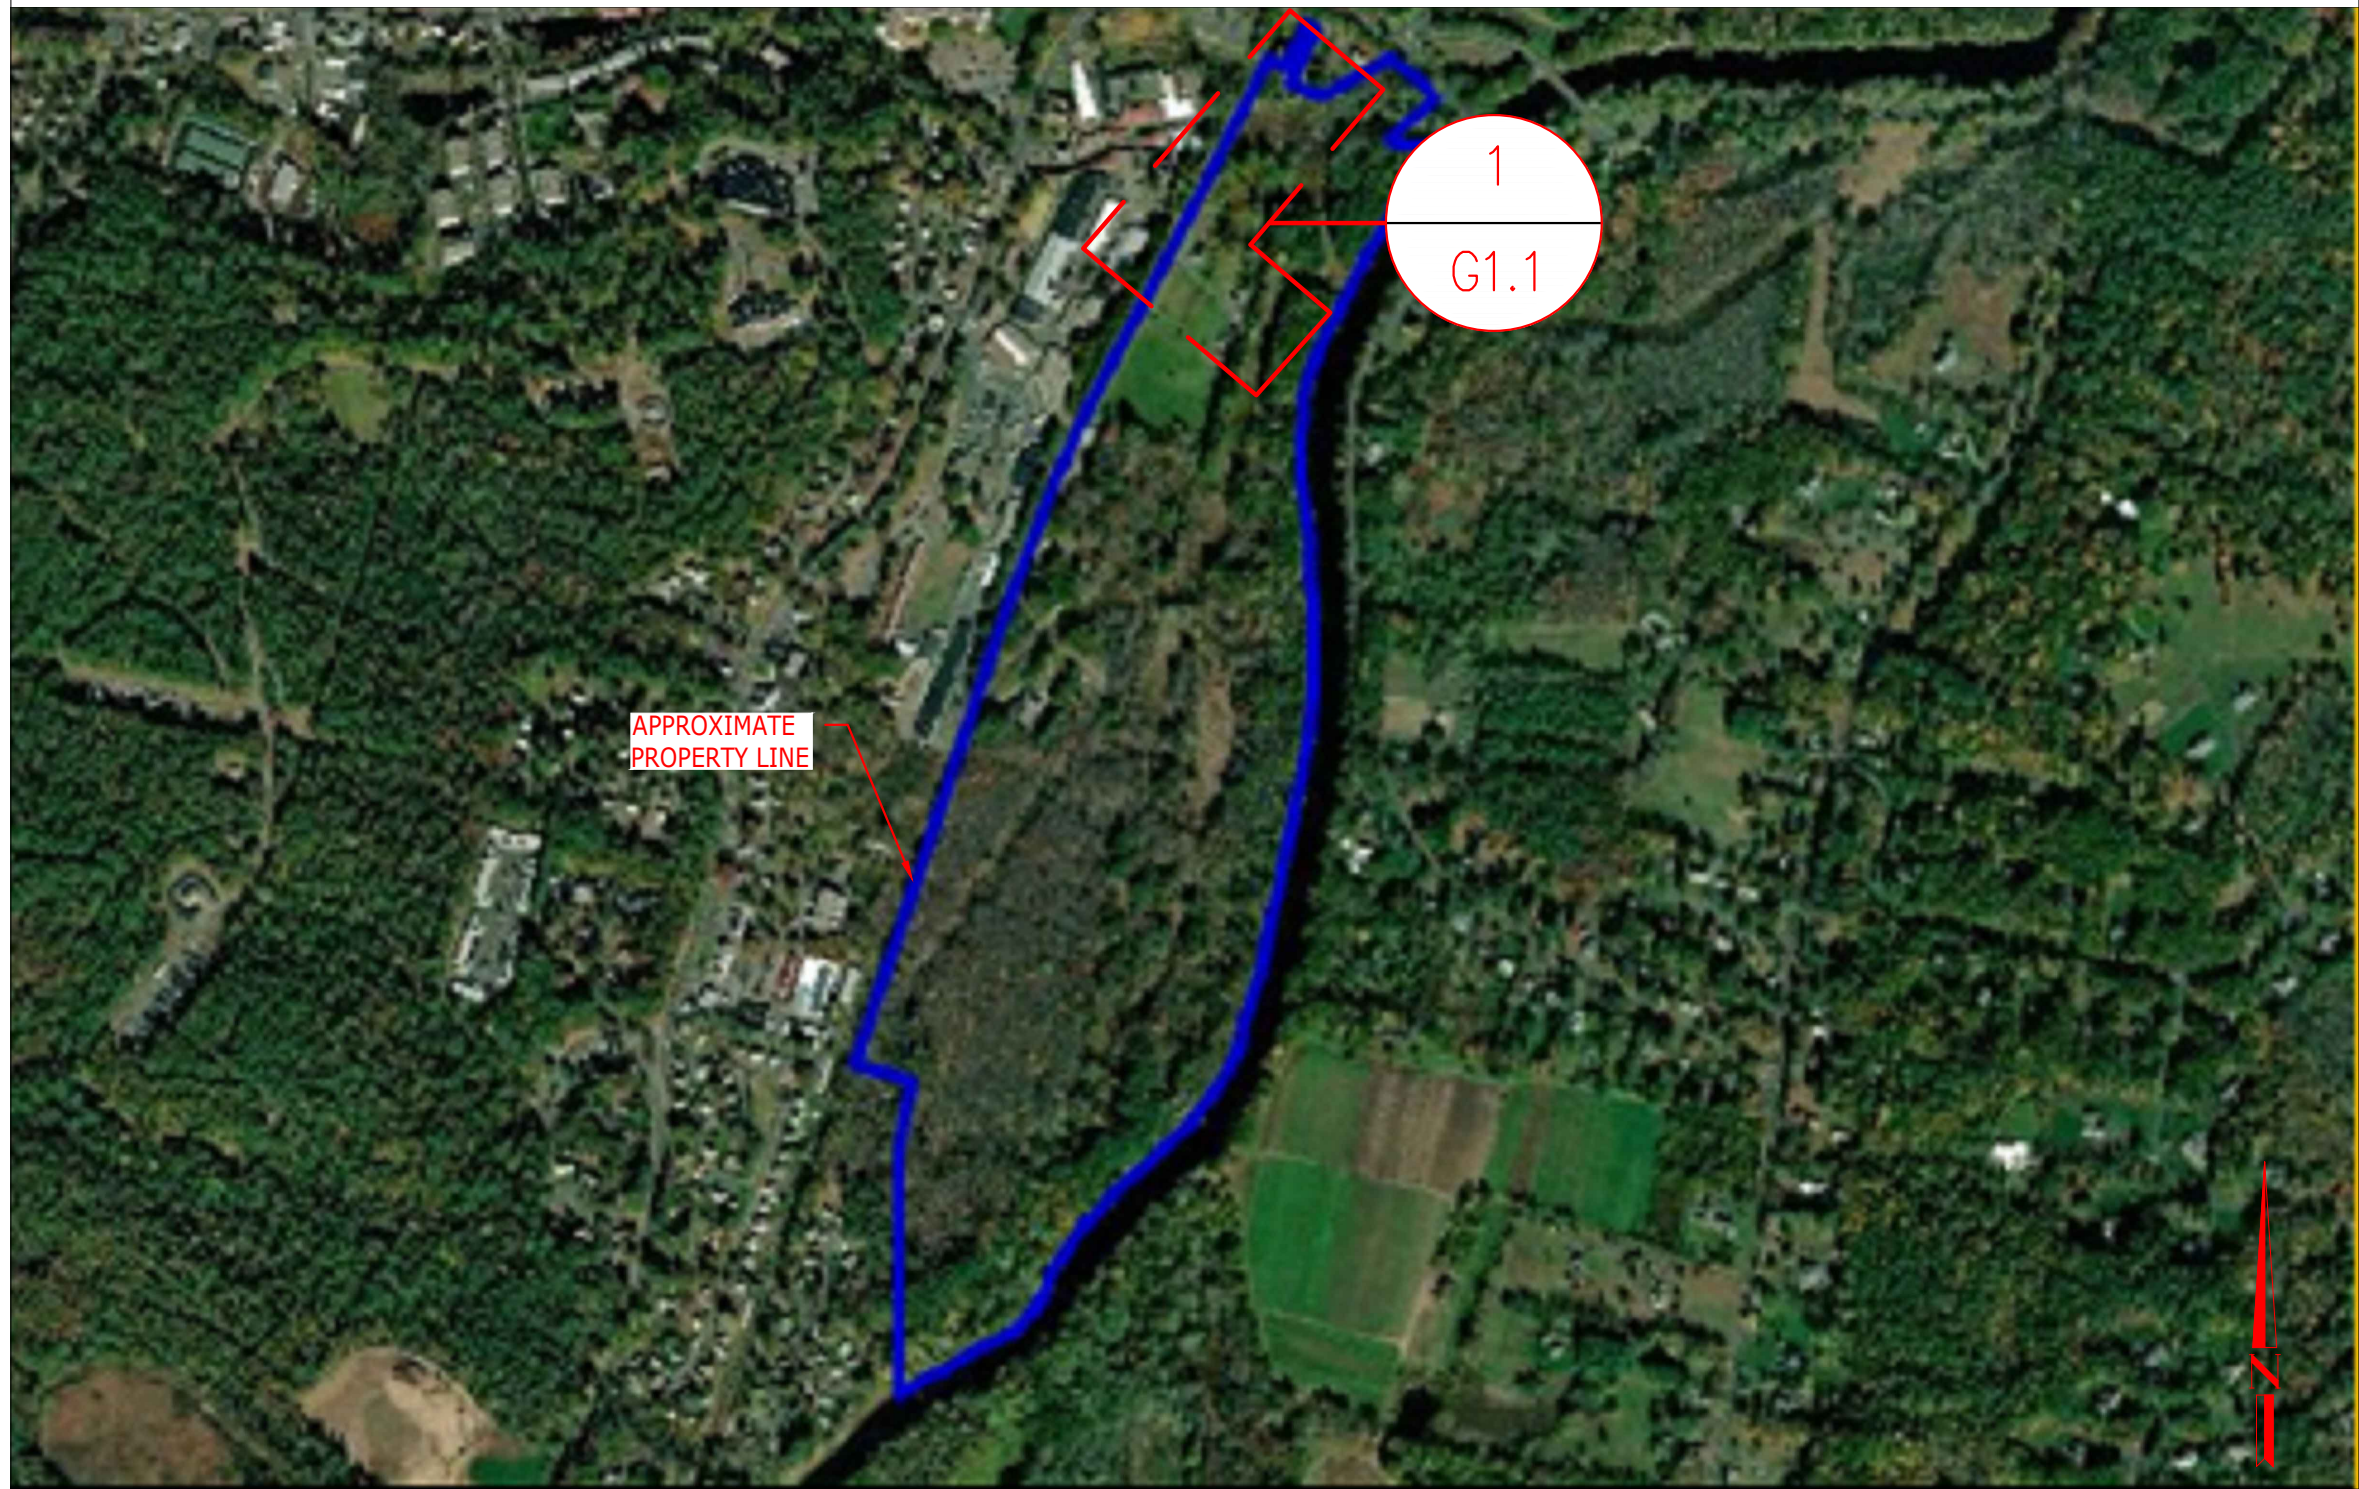

OVERALL SITE PLAN
SCALE: 1" = NTS


Bloomenergy®
4353 N. FIRST STREET
SAN JOSE, CA 95134
PROPRIETARY AND CONFIDENTIAL
BLOOM ENERGY CORPORATION ALL RIGHTS RESERVED. THIS DOCUMENT IS FOR REFERENCE ONLY AND MAY NOT BE USED WITHOUT THE WRITTEN PERMISSION OF BLOOM ENERGY. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT PERMISSION OF BLOOM ENERGY IS PROHIBITED.

CUSTOMER SITE
DYNO NOBEL INC.
660 HOPMEADOW STREET
SIMSBURY, CT 06070
DYNO
Dyno Nobel

REVISION HISTORY		
REV	REVISION ISSUE	DATE

DESIGNED BY	REVIEWED BY
DRAWN BY SAHANA S GOWDA	APPROVED BY

SHEET TITLE OVERALL SITE PLAN	
DRAWING NUMBER G1.1	
BLOOM DOCUMENT DOC-1012745	
THIS DRAWING IS 24" X 36" AT FULL SIZE	
SITE ID: DYN001.0	SHEET 03 OF 07

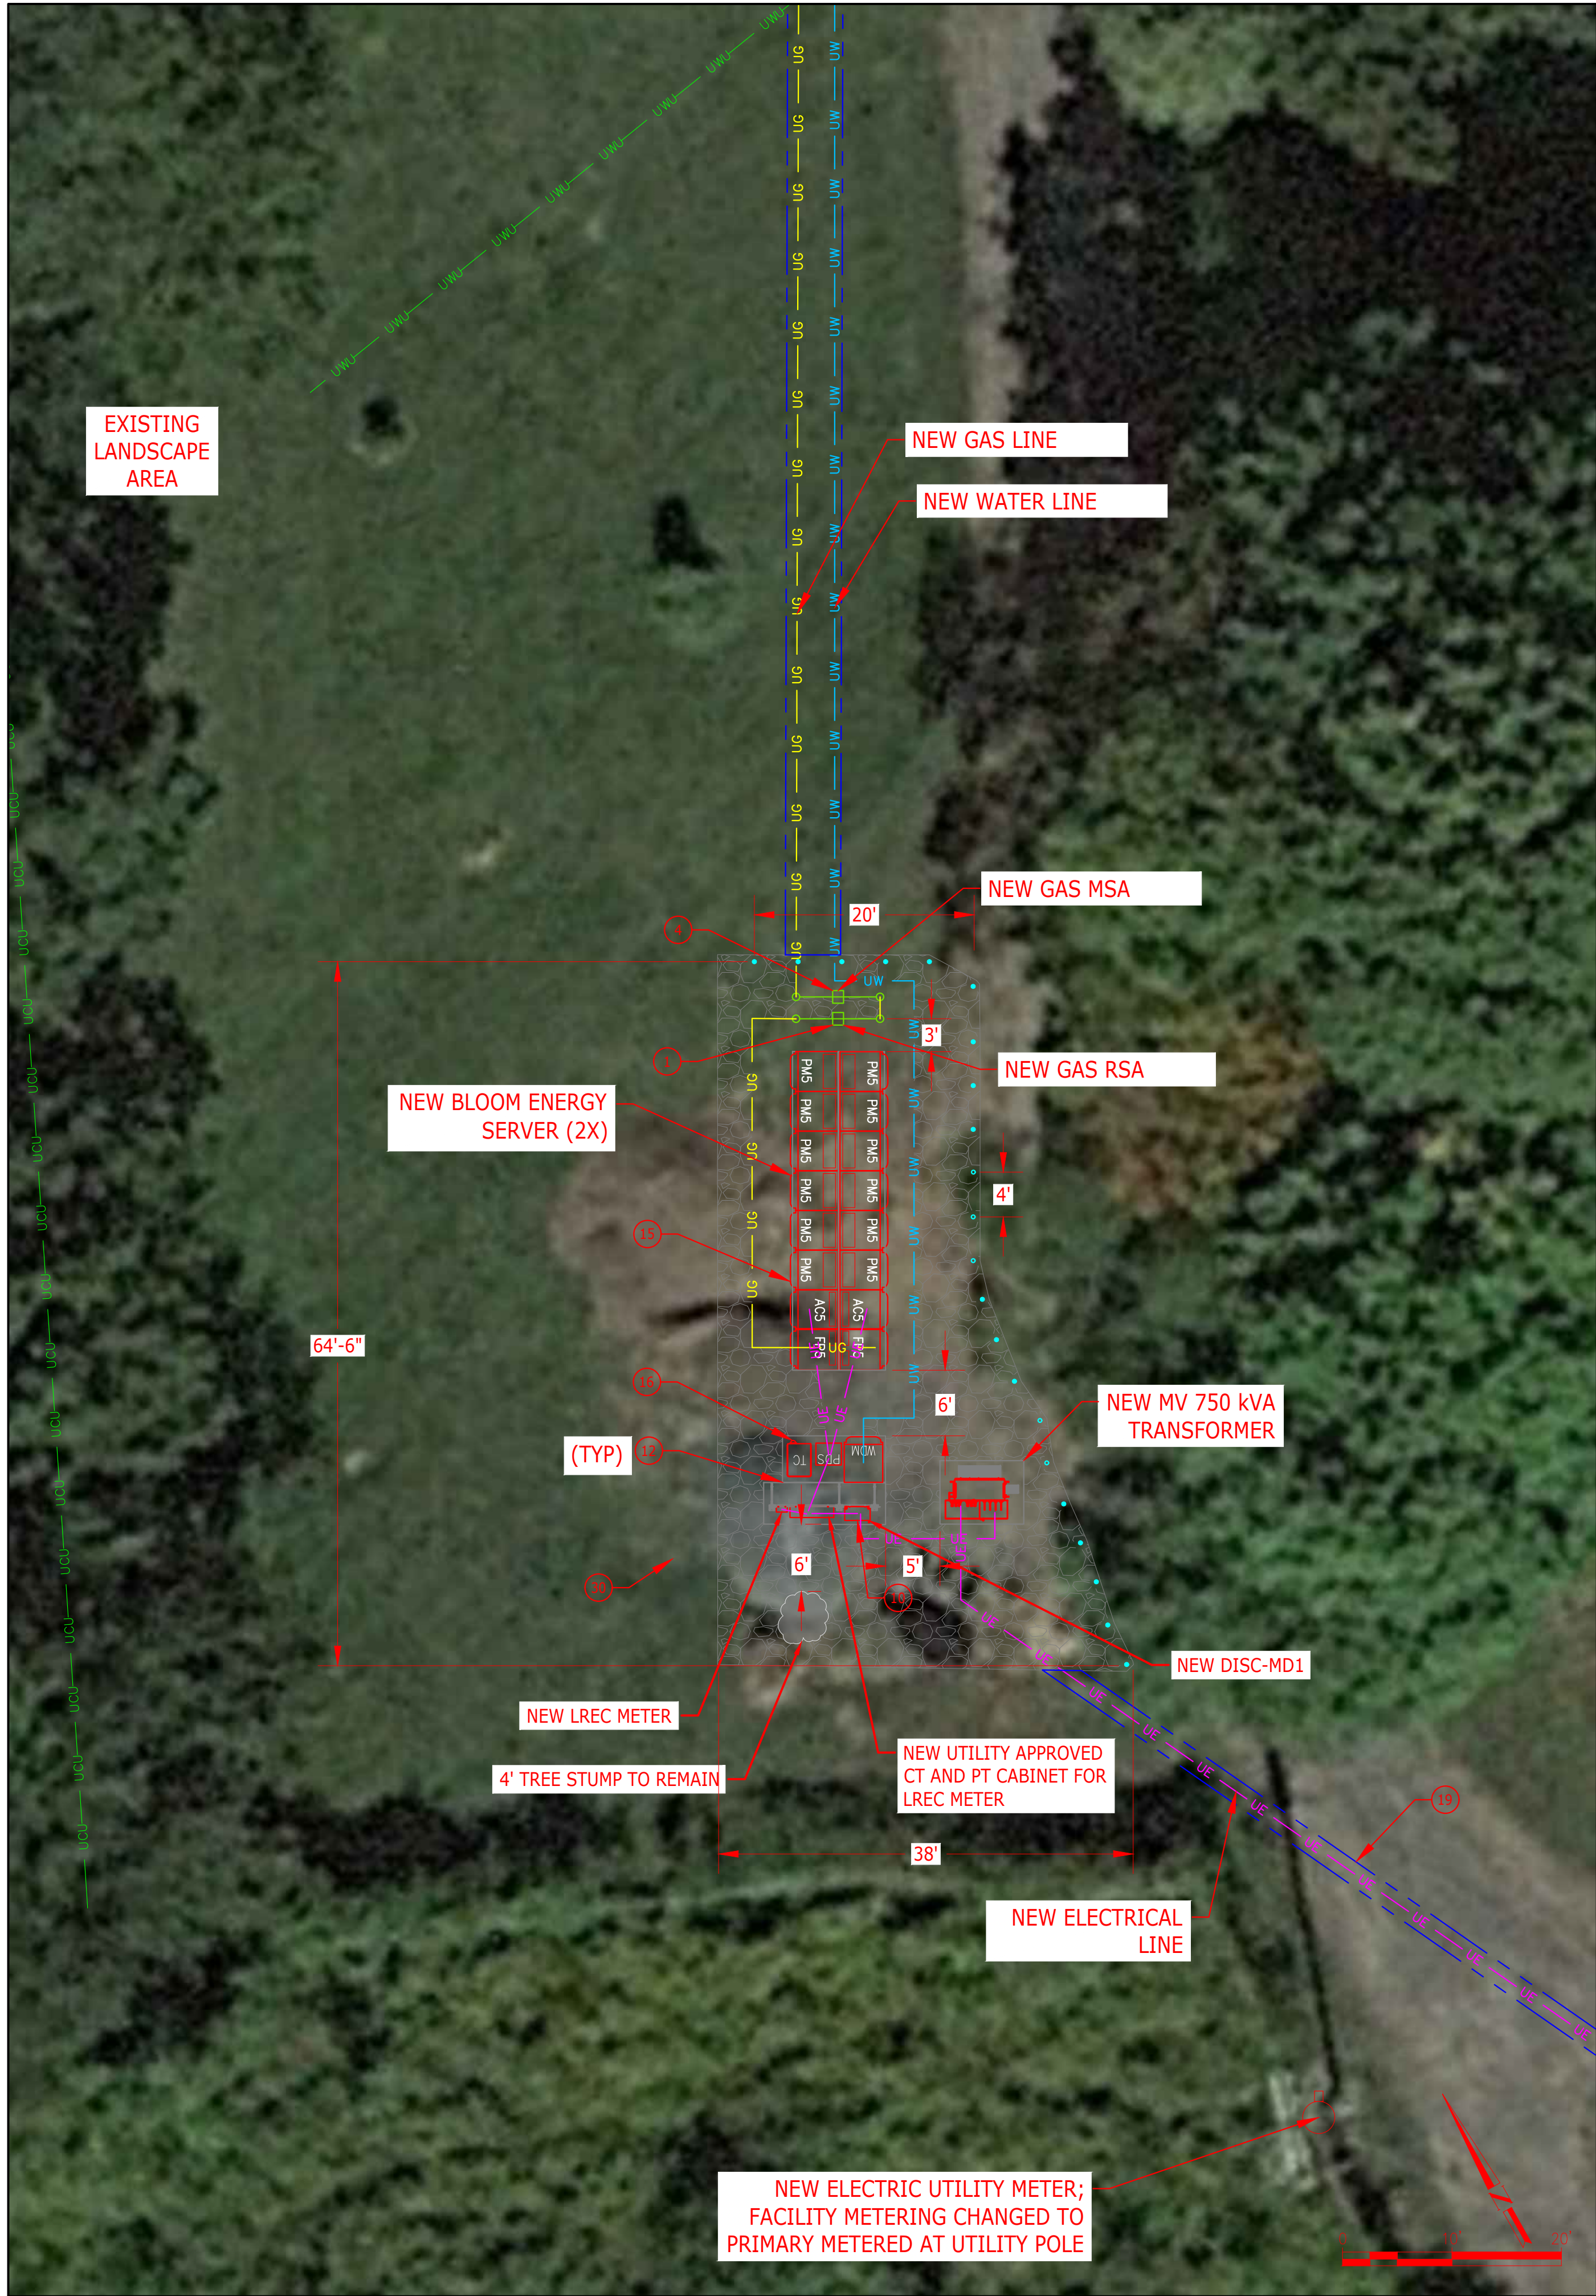

DETAILED SITE PLAN

SCALE: 1" = 10'

1
C1.1



DETAILED SITE PLAN

SCALE: 1" = 20'

2
C1.1



DETAILED SITE PLAN

SCALE: 1" = 10'

3
C1.1

GENERAL NOTES

1. CLEAN AND PRIME ALL NEW WIRE MOUNTED PIPING AND CONDUIT. PIPING AND CONDUIT SHALL BE PAINTED WITH EXTERIOR GRADE PAINT TO MATCH EXISTING.
2. CONDUITS AND PIPES MOUNTED TO BUILDING WALL SHALL BE SUPPORTED AS PER LOCAL CODE, RUN AT HEIGHT ABOVE DOORWAYS, AND STAND OFF WALL TO AVOID EXISTING CONDUITS AND PIPES.
3. SLOPE LINES SHOWN ARE APPROXIMATE AND INTENDED TO SHOW THE GENERAL DIRECTION OF WATER RUN OFF; SLOPE LINES ARE DRAWN PER VISUAL SURVEY OF SURROUNDING AREA.
4. SEE BLOOM ENERGY PRODUCT INSTALLATION DRAWINGS FOR UTILITY CONNECTIONS TO ANCILLARY EQUIPMENT AND ENERGY SERVER.

REFERENCE SHEET NOTES

- 1 NEW UTILITY PROVIDED AND INSTALLED GAS METER & REGULATOR ASSEMBLY WITH SHUT-OFF VALVE. CONTRACTOR SHALL PROVIDE PAD PER DETAILS IF REQUIRED BY UTILITY COMPANY. COORDINATE ALL CONNECTIONS WITH GAS UTILITY.
- 2 NEW UNDERGROUND GAS SERVICE TAP BY UTILITY COMPANY. COORDINATE WITH GAS UTILITY. CONTRACTOR SHALL PERFORM COMPACTION AND MATCH EXISTING SURFACE AND GRADE. CONTRACTOR SHALL COORDINATE GAS PIPE SIZING AND INSTALLATION REQUIREMENTS WITH UTILITY.
- 4 NEW PRIVATE RSA VALVE FOR ENERGY SERVER. REFER TO GAS RISER DETAIL FOR ADDITIONAL REQUIREMENTS.
- 5 NEW GAS PIPE SHALL BE FURNISHED AND INSTALLED BY THE CONTRACTOR. REFER TO GAS RISER DETAIL FOR ADDITIONAL REQUIREMENTS.
- 6 TAP EXISTING WATER LINE AT NEAREST ACCESSIBLE LOCATION IN BUILDING AS SHOWN WITH A LOCAL SHUT-OFF VALVE. IF INSTALLING A LOCAL BACK FLOW PREVENTION DEVISE PLEASE ENSURE THAT A CHECK VALVE IS ALSO INSTALLED. REFER TO DOMESTIC WATER CONNECTION DETAIL FOR ADDITIONAL REQUIREMENTS.
- 7 NEW WATER PIPE SHALL BE FURNISHED AND INSTALLED BY THE CONTRACTOR. REFER TO WATER RISER DETAIL FOR ADDITIONAL REQUIREMENTS.
- 10 NEW BLOOM FURNISHED, CONTRACTOR INSTALLED, DISCONNECT SWITCH. TO UNI-STRUT MOUNT PER MANUFACTURER AND UTILITY SPECIFICATIONS.
- 11 CONTRACTOR SHALL TERMINATE ELECTRIC FEEDER AS SHOWN. REFER TO ELECTRICAL SINGLE LINE DIAGRAM FOR ADDITIONAL REQUIREMENTS.
- 12 CONTRACTOR SHALL PROVIDE TWO GROUNDING RODS TO BE PLACED 6' APART MINIMUM. REFER TO ELECTRICAL SINGLE LINE DIAGRAM FOR ADDITIONAL REQUIREMENTS.
- 13 NEW ELECTRICAL FEEDER SHALL BE FURNISHED AND INSTALLED BY THE CONTRACTOR. REFER TO ELECTRICAL SINGLE LINE DIAGRAM FOR ADDITIONAL REQUIREMENTS.
- 15 NEW BLOOM ENERGY SERVER. REFER TO BLOOM STANDARD INSTALLATION DRAWING SET FOR ADDITIONAL ENERGY SERVER DETAILS.
- 16 FACTORY WIRED ENERGY SERVER EMERGENCY POWER-OFF SWITCH (EPO).
- 19 CONTRACTOR SHALL PROVIDE SAWCUT TRENCH FOR UNDERGROUND UTILITIES IN THIS LOCATION AND HAND DIG TRENCHES WHERE THEY CROSS EXISTING UTILITIES. REFER TO UNDERGROUND/TRENCH CONDUIT AND PIPING DETAIL FOR ADDITIONAL REQUIREMENTS.
- 21 PROTECT EXISTING UNDERGROUND UTILITY LINES FROM DAMAGE WHEN CROSSING WITH NEW UNDERGROUND UTILITIES. CONTRACTOR SHALL BE RESPONSIBLE FOR REPAIR OR REPLACEMENT OF ANY DAMAGED LINES.
- 30 CONTRACTOR SHALL PROVIDE LANDSCAPE/TURF RESTORATION. REFER TO LANDSCAPE/TURF RESTORATION DETAIL FOR ADDITIONAL REQUIREMENTS. IRRIGATION SHALL BE PROTECTED AND REMAIN OPERATIONAL DURING CONSTRUCTION. THE CONTRACTOR IS RESPONSIBLE FOR EXTENDING AND/OR REROUTING IRRIGATION LINES AS NECESSARY AND THE REPAIR/REPLACEMENT IF ANY DAMAGE OCCURS.

EXISTING UTILITY NOTE:
THE LOCATION OF EXISTING UTILITIES IS SHOWN FOR THE CONTRACTOR'S REFERENCE. EXACT LOCATION, DEPTH AND SIZE OF ALL EXISTING UTILITIES IS NOT KNOWN. CONTRACTOR SHALL ASSUME RESPONSIBILITY FOR ALL EXISTING UTILITIES NOT SHOWN ON THESE DRAWINGS. CONTRACTOR TO FIELD VERIFY LOCATION OF EXISTING UNDERGROUND UTILITIES AND PROTECT THE EXISTING UNDERGROUND UTILITIES FROM DAMAGE WHEN CROSSING WITH NEW UNDERGROUND UTILITIES. CONTRACTOR SHALL BE RESPONSIBLE FOR REPAIR OR REPLACEMENT OF ANY DAMAGED LINES. THE CONTRACTOR SHALL NOTIFY THE ENGINEER IMMEDIATELY IF ANY FIELD CONDITIONS ENCOUNTERED DIFFER FROM THOSE REPRESENTED HEREON. SUCH CONDITIONS COULD RENDER THE DESIGN HEREON INAPPROPRIATE AND MAY REQUIRE ADJUSTMENTS TO AVOID CONFLICTS.

Bloomenergy®

4353 N. FIRST STREET
SAN JOSE, CA 95134

PROPRIETARY AND CONFIDENTIAL

BLOOM ENERGY CORPORATION ALL RIGHTS RESERVED. THIS DOCUMENT IS FOR REFERENCE ONLY AND MAY NOT BE USED WITHOUT THE WRITTEN PERMISSION OF BLOOM ENERGY. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT PERMISSION OF BLOOM ENERGY IS PROHIBITED.

CUSTOMER SITE

DYNO NOBEL INC.
660 HOPMEADOW STREET
SIMSBURY, CT 06070

DYNO
Dyno Nobel

REVISION HISTORY

REV	REVISION ISSUE	DATE

DESIGNED BY	REVIEWED BY
DRAWN BY SAHANA S GOWDA	APPROVED BY

SHEET TITLE

DETAILED
SITE PLAN

DRAWING NUMBER
C1.1

BLOOM DOCUMENT
DOC-1012745

THIS DRAWING IS 24" X 36" AT FULL SIZE
SITE ID: DYN001.0 SHEET 04 OF 07

Exhibit 4

SITE 1 – Woodland Street





SITE 2 – Drake Hill Road





Energy Server™ 5

Always On, Clean Energy
Using Patented Solid Oxide
Fuel Cell Technology



The Energy Server 5 provides combustion-free electric power with these benefits



Clean

Our systems produce near zero criteria pollutants (NO_x, SO_x, and particulate matter) and far fewer carbon emissions than legacy technologies.




Reliable

Bloom Energy Servers are designed around a modular architecture of simple repeating elements. This enables us to generate power 24 x 7 x 365 and can be configured to eliminate the need for traditional backup power equipment.



Resilient

Our system operates at very high availability due to its fault-tolerant design and use of the robust natural gas pipeline system. Bloom Energy Servers have survived extreme weather events and other incidences and have continued providing power to our customers.



Simple Installation and Maintenance


Our Energy Servers are 'plug and play' and have been designed in compliance with a variety of safety standards. Bloom Energy manages all aspects of installation, operation and maintenance of the systems.

Energy Server 5		Technical Highlights (ES5-AA2AAC)
Outputs		
Nameplate power output (net AC)		262.5 kW
Load output (net AC)		250 kW
Electrical connection		480V, 3-phase, 60 Hz
Inputs		
Fuels		Natural gas, directed biogas
Input fuel pressure		10-18 psig (15 psig nominal)
Water		None during normal operation
Efficiency		
Cumulative electrical efficiency (LHV net AC) ¹		65-53%
Heat rate (HHV)		5,811-7,127 Btu/kWh
Emissions²		
NOx		0.0017 lbs/MWh
SOx		Negligible
CO		0.034 lbs/MWh
VOCs		0.0159 lbs/MWh
CO ₂ @ stated efficiency		679-833 lbs/MWh on natural gas; carbon neutral on directed biogas
Physical Attributes and Environment		
Weight		13.6 tons
Dimensions (variable layouts)		14'4" x 8'8" x 6'9" or 28'8" x 4'4" x 7'2"
Temperature range		-20° to 45° C
Humidity		0% - 100%
Seismic vibration		IBC site class D
Location		Outdoor
Noise		< 70 dBA @ 6 feet
Codes and Standards		
Complies with Rule 21 interconnection and IEEE1547 standards		
Exempt from CA Air District permitting; meets stringent CARB 2007 emissions standards		
An Energy Server is a Stationary Fuel Cell Power System. It is Listed by Underwriters Laboratories, Inc. (UL) as a 'Stationary Fuel Cell Power System' to ANSI/CSA FC1-2014 under UL Category IRGZ and UL File Number MH45102.		
Additional Notes		
Access to a secure website to monitor system performance & environmental benefits		
Remotely managed and monitored by Bloom Energy		
Capable of emergency stop based on input from the site		
¹ 65% LHV efficiency verified by ASME PTC 50 Fuel Cell Power Systems Performance Test		
² NOx and CO measured per CARB Method 100, VOCs measured as hexane by SCAQMD Method 25.3		

About Bloom Energy

Bloom Energy's mission is to make reliable, clean energy affordable for everyone in the world. The company's product, the Bloom Energy Server, delivers highly reliable and resilient, Always On electric power that is clean and sustainable. Bloom's customers include twenty-five of the Fortune 100 companies and leaders in cloud services and data centers, healthcare, retail, financial services, utilities and many other industries.

Exhibit 5

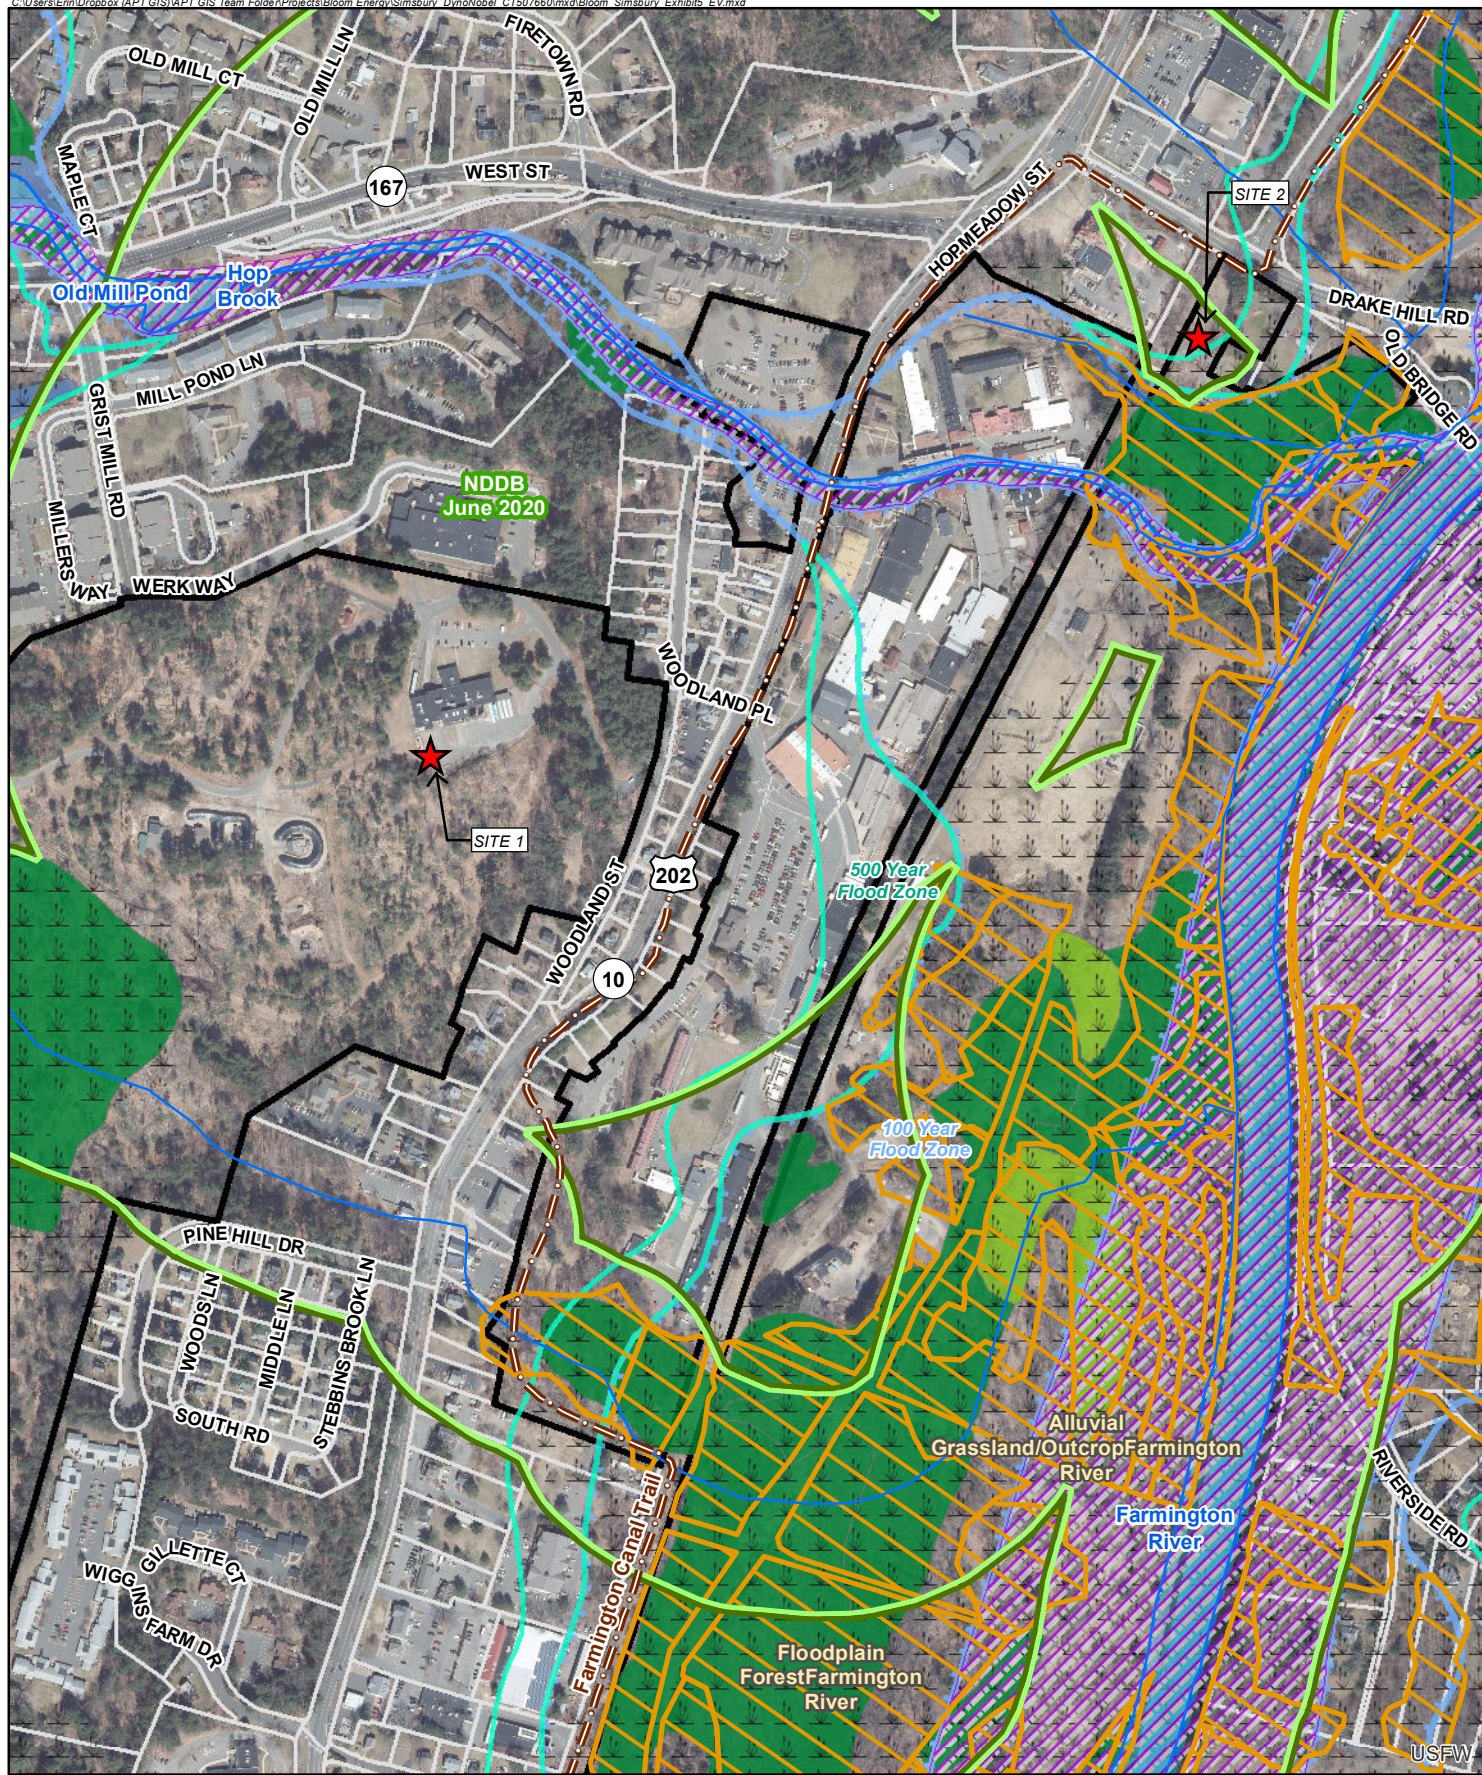

Legend

 Project_Area

Site



 Approx. Assessor Parcel Boundary



○=○ Hiking/Bike Trail



 Natural Diversity Database Area (June 2020)



 Open Water



 Watercourse
 CTDEEP Wetlands



CT NWI Wetland 2010



 Freshwater Forested/Shrub Wetland

 Critical Habitat (July 2009) FEMA 100-Year Flood Zone

 FEMA 500-Year Flood Zone

 Floodway

Map Notes:
Base Map Source: 2019 Aerial Photograph (CTECO)
Map Scale: 1 inch = 500 feet
Map Date: December 2020

A horizontal number line with arrows at both ends. It has major tick marks at 500, 250, 0, and 500. The word "Feet" is written at the far right end. A point is marked with a vertical line segment at the position corresponding to -250.

Exhibit 5

Environmental Resources

Proposed Bloom Energy Facility
65 Woodland Street & Drake Hill Road
Simsbury, Connecticut

Bloomenergy®





Legend

- Project Area
- Site
- Approx. Assessor Parcel Boundary
- Hiking Trail
- Natural Diversity Database Area (June 2020)
- FEMA 500-Year Flood Zone
- Wetlands
- CT NWI Wetland 2010
- Freshwater Forested/Shrub Wetland

Map Notes:
 Base Map Source: 2019 Aerial Photograph (CTECO)
 Map Scale: 1 inch = 200 feet
 Map Date: December 2020


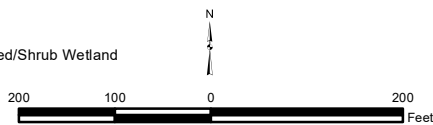


Exhibit 5A Environmental Resources

Proposed Bloom Energy Facility
 65 Woodland Street
 Simsbury, Connecticut



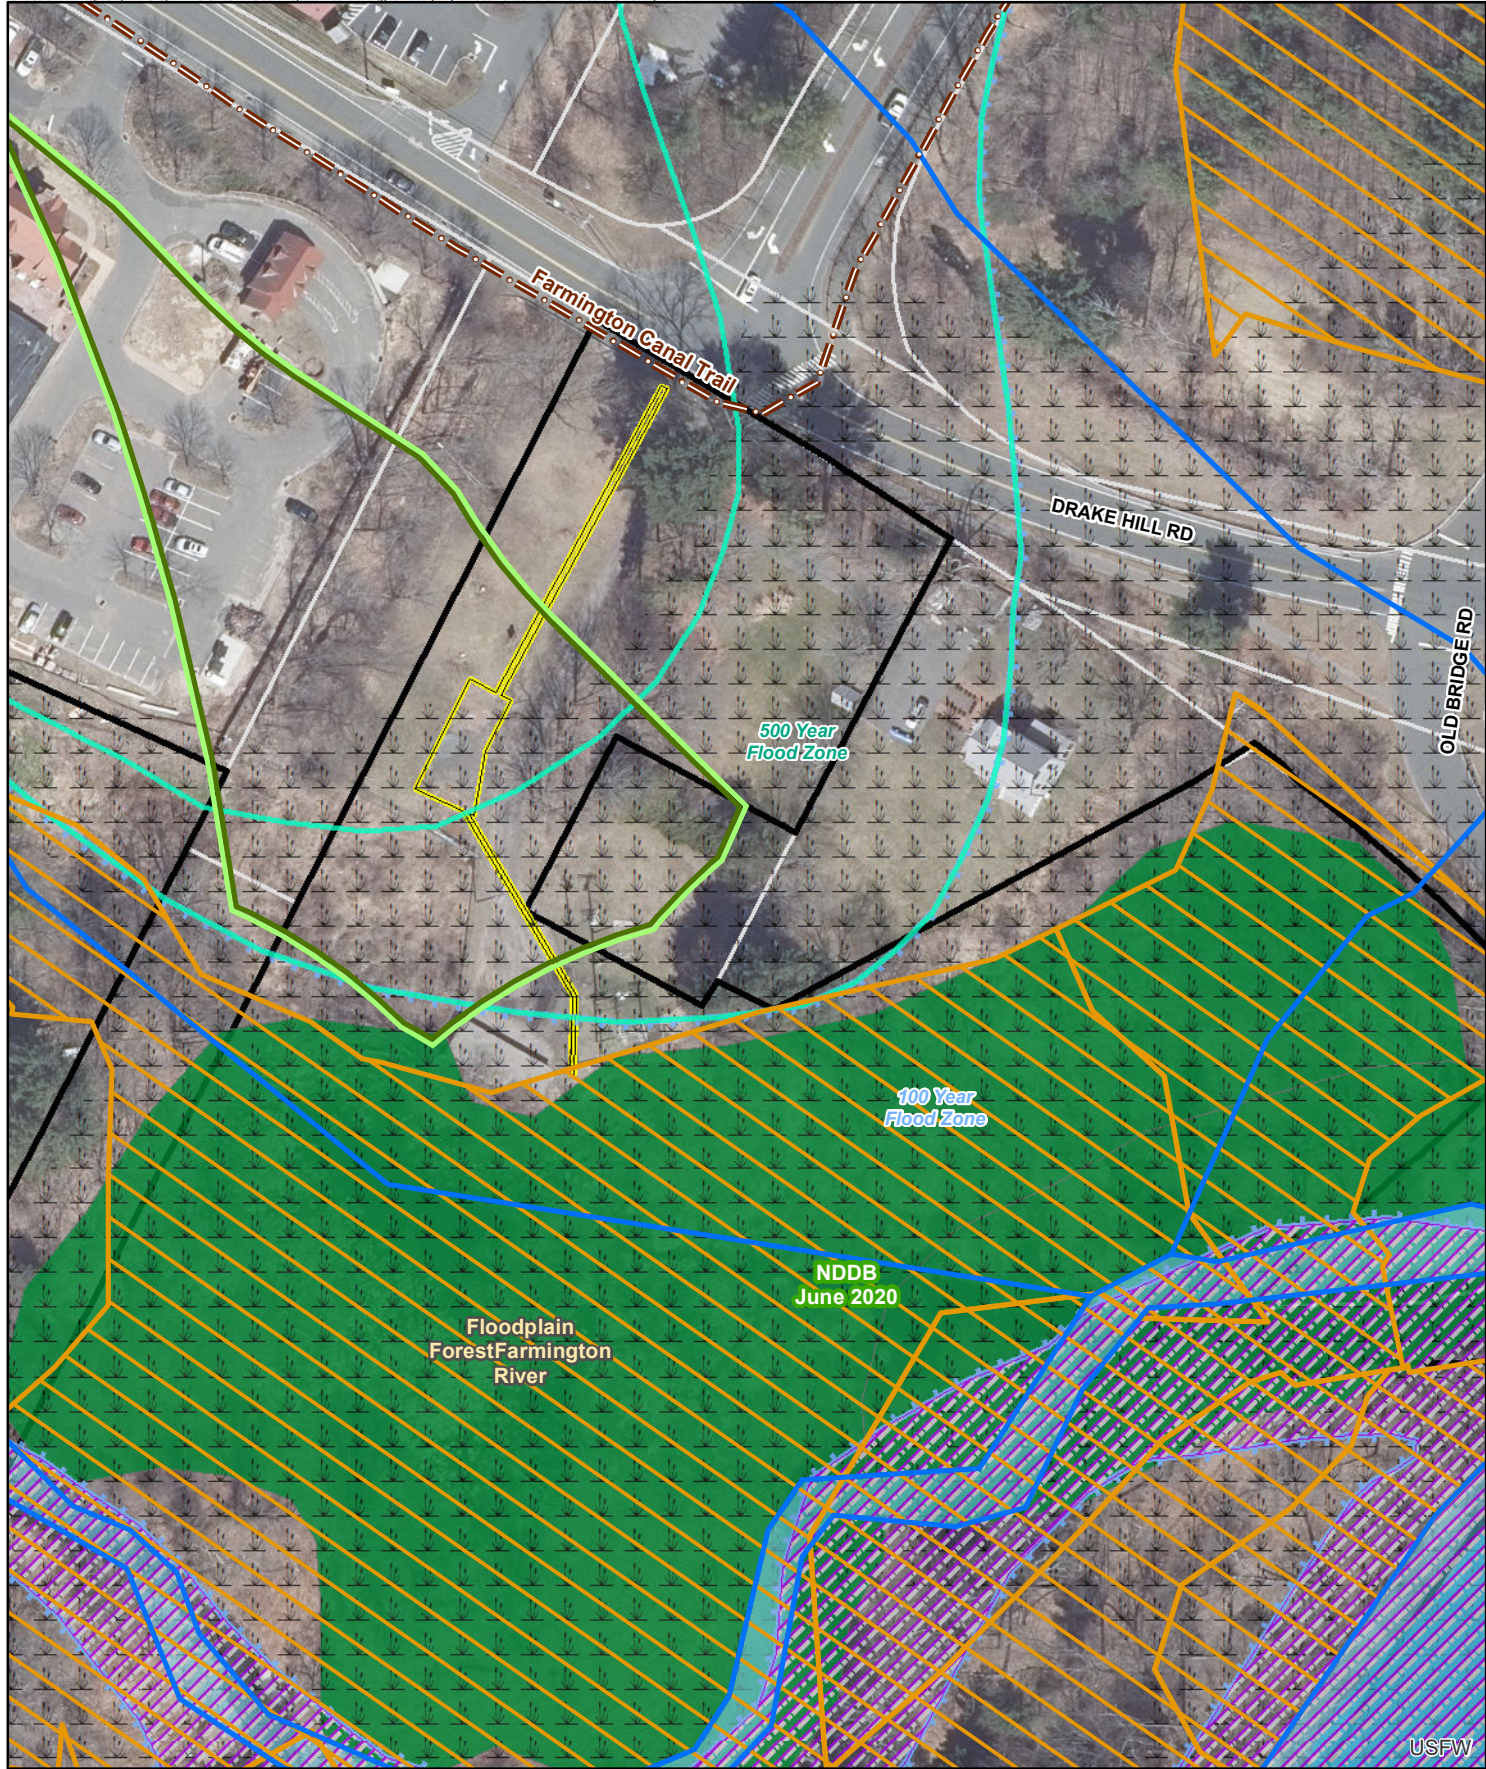

Legend

- | | | |
|----------------------------------|---|------------------------------|
| Project Area | Natural Diversity Database Area (June 2020) | Critical Habitat (July 2009) |
| Approx. Assessor Parcel Boundary | Open Water | FEMA 100-Year Flood Zone |
| Hiking/Biking Trail | Watercourse | FEMA 500-Year Flood Zone |
| | Wetlands | Floodway |
| | Bioscience/CT NWI Wetland Functions 2010 | |
| | Freshwater Forested/Shrub Wetland | |

Map Notes:
Base Map Source: 2019 Aerial Photograph (CTECO)
Map Scale: 1 inch = 100 feet
Map Date: December 2020




Exhibit 5B
Environmental Resources
Proposed Bloom Energy Facility
Drake Hill Road
Simsbury, Connecticut

Exhibit 6



Fire Prevention and Emergency Planning – Grid Parallel

Copyright © 2011. Unpublished Work of Bloom Energy. All Rights Reserved. This work is an unpublished work and contains confidential, proprietary, and trade secret information of Bloom Energy. No part of this work may be practiced, performed, copied, distributed, revised, modified, translated, abridged, condensed, expanded, collected, or adapted without the prior written consent of Bloom Energy. Any use or exploitation of this work without authorization could subject the perpetrator to criminal and civil liability.

Bloom Energy Corporation, 1299 Orleans Drive, Sunnyvale, CA 94089 USA

Table of Contents

1. Fire Prevention and Emergency Planning Overview
2. Fuel Cell Installation Safety Features
3. Emergency Notification Procedures
4. Fire and Smoke Procedures
5. Medical Emergency Procedures
6. Materials Release Procedures
7. Natural Disasters and Severe Weather
 - 7.1 Earthquake
 - 7.2 Flood
8. Utility Outage
9. Good Housekeeping and Maintenance
 - 9.1 Good Housekeeping
 - 9.2 Maintenance
10. Training

1. FIRE PREVENTION AND EMERGENCY PLANNING OVERVIEW

The following document is provided only as a guide to assist you in complying with national and local codes and requirements, as well as to provide other helpful information. It is not intended to supersede the requirements of any standard. You should review the standards for particular requirements that are applicable to your individual situation, and make adjustments to this program that are specific to your company. You will need to add information relevant to your facility in order to develop an effective, comprehensive program.

2. FUEL CELL SYSTEM INSTALLATION SAFETY FEATURES

The fuel cell system has redundant safety features and in-system checks to ensure that the system will not harm certified technicians or bystanders near the unit. While the actual fuel cells operate at high temperatures, these components do not move, and are contained within many layers of insulation. During normal operation, the unit is cool to the touch and operates quietly.

The fuel cell system is controlled electronically and has internal sensors that continuously measure system operation. If safety circuits detect a condition outside normal operating parameters, the fuel supply is stopped and individual system components are automatically shut down. A Bloom Energy Remote Monitoring and Control Center (RMCC) operator can also remotely initiate any emergency sequence. An Emergency Stop alarm condition initiates an automatic shutdown sequence that puts the fuel cell system into —safe mode and causes it to stop exporting power. If you have questions about any of these safety features, please contact Bloom Energy.

If you have to shut down your fuel cell system right away—for example, in case of a building fire or electrical hazard—three shutoff controls are installed at your facility external to the system. The locations of these three controls should be known to your facilities manager before operation, and should be noted on your facility diagram that you created with your Bloom Energy account manager. The three shutoffs are the **EPO button**, the **electrical disconnect**, and the **natural gas shutoff valve**.

- An **Emergency Power Off (EPO) Button** cuts all power to all systems and stops them from exporting power to your building. All natural gas flow is also stopped within the systems. (The EPO button is on the front/side of the EDM, if an EDM is installed.) Lift the protective cover and break the glass seal that covers the button with the attached hammer. After the glass seal is broken, the shutdown sequence will automatically begin.



Figure 1: Emergency Power Off Button

- An **electrical disconnect** manually disconnects systems from the grid if needed. Pressing the EPO button should already stop any power transmission, but it does not hurt the systems to also open this disconnect if you believe it is needed. The location of this disconnect will vary, however it is typically located near the point of interconnection where the wires from the fuel cell installation meet the facility's electrical framework. This may be inside your facility's electrical room, or if the fuel cell installation is near the electrical room, it may be found within the switchgear that Bloom Energy installs. This location of this disconnect is shown on the Site Map (see below) and is labeled "(name of electrical utility) Lockable Visible Generator Disconnect Switch".



Figure 2: Electrical Disconnect

- A **manual natural gas valve** shuts down all natural gas to the system. If the valve operator is perpendicular to the pipe, the valve is shut. If it is parallel with the pipe, the valve is open.



Figure 3: Manual Natural Gas Valve

Site map:

- An overhead site map showing the location of all safety features will be posted throughout the fuel cell installation
- Electronic copies are available to you for use in your site planning

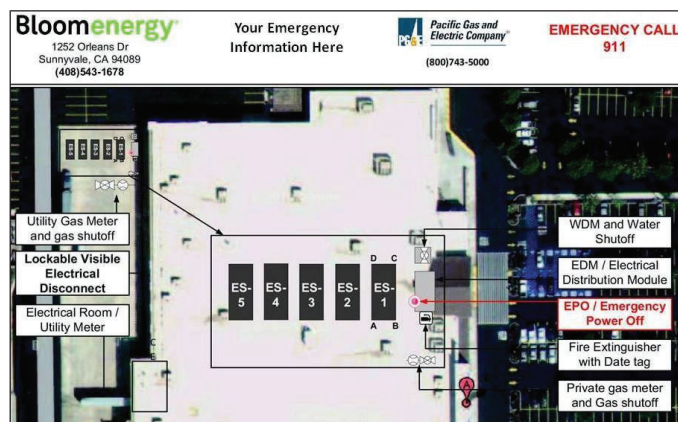


Figure 4: Sample Site Map

Manual controls:

- Clearly marked emergency stop button labeled —Fuel Cell Emergency Shut Down located at site
- Two manual fuel shutoff valves outside the system, and two isolation valves inside the system

Fire hazard mitigation:

- System is plumbed directly to utility-provided natural gas
- If system input gas pressure is compromised, a pressure switch triggers an emergency system shutdown and fuel input is isolated
- System does not use fuel compressors or pumps
- System has virtually no stored fuel (internal capacity is < 5 scf)

Electrical hazard and mitigation:

- System operates at 480V
- Signs inside the system warn of the risk of electric shock
- System has backfeed protection
- System inverter prevents grid backfeed during a power outage

Mechanical hazard and mitigation:

- Finger/hand guard protection is provided on all fans
- All moving parts are located behind secured doors

Material hazard mitigation:

- Desulfurizer bed (to remove fuel impurities) are fully enclosed
- Maintained and serviced by licensed vendors

3. EMERGENCY NOTIFICATION PROCEDURES

Life-Threatening Emergencies

To report life-threatening emergencies, immediately call:

Fire:	911
Ambulance:	911
Police:	911

Conditions that require automatic emergency notification include:

- Unconscious Victim
- Seizure
- Major Trauma
- Chest Pains
- Difficulty Breathing
- Flames

Non-Life-Threatening Emergencies

For non-life-threatening emergencies, report the incident to the local safety control center.

When you report an emergency, give the following information:

- Exact nature of the emergency (describe as clearly and accurately as possible).
- Exact location (i.e., address, building, floor, area, department, etc.).
- Telephone number from which you are calling.
- Your full name.
- ***Do not hang up***, as additional information may be needed.

To assist in any subsequent investigation or determination of corrective actions, it is recommended to record the following items as close to the incident time as possible:

- Summary of any violation

- Identification of responsible parties
- Identification of victims and witnesses
- Description of evidence
- Description of general conditions
- Description of any vehicles involved
- Narratives from witnesses
- Any photographs

4. FIRE OR SMOKE PROCEDURES

This section describes the procedures involving a fire or smoke. A major fire is one that requires the use of more than one fire extinguisher or takes more than one minute to extinguish.

If you discover a fire or smoke:

1. Activate the nearest fire alarm if not activated already.
2. Activate the fuel cell Emergency Stop if possible.
3. Shut off the fuel cell installation natural gas line if possible.
4. If the fire is small and does not pose an immediate risk to personal safety, you may attempt to extinguish it with a portable fire extinguisher **only if trained to do so**.
5. Avoid using water on electrical fires.
6. Report every fire, regardless of size, immediately. Smoke or the smell of smoke should be reported.
 - From a safe location dial **911**.
 - Report the incident to the local security safety center.

5. MEDICAL EMERGENCY PROCEDURES

This section describes the necessary procedures for injuries or illnesses that may occur under extreme conditions.

A serious injury can be life-threatening and will require immediate medical attention. Injuries can include head injuries, spine injuries, broken bones, heart attack, stroke, loss of consciousness, excessive bleeding, chemical exposure, etc.

A non-serious injury is not immediately life-threatening but may still require the attention of a medical doctor. These can include headaches, nausea, itching, cuts, burns, etc.

Life-Threatening Medical Emergency

1. Remain calm.
2. Immediately dial 911.
3. Report the incident to local security safety center.
4. Do not move the victim unless it is absolutely necessary.
5. Call out for personnel trained in first aid and/or CPR which may include Building Evacuation or Emergency Response team members.

6. Ask someone to bring the area first aid kit and Automated External Defibrillator.
7. Assist if capable or asked to do so.

Non-Life-Threatening Medical Emergency

1. Remain calm.
2. Report the incident to the local security safety center.
3. Do not move the victim unless it is absolutely necessary.
4. Call out for personnel trained in first aid.
5. Ask someone to bring the area first aid kit.
6. If the victim requires further medical attention, then direct them to the nearest approved medical clinic or hospital – Contact Security or Human Resources for assistance if needed.
7. The injured employee's supervisor/manager is responsible for ensuring injury forms are properly filled out. Complete the forms within 24 hours of incident and submit to the injury reporting system for follow-up. Follow company protocols.

6. MATERIALS RELEASE PROCEDURES

The fuel cell system does not pose a hazard to health or environment. However, some internal materials when released, may pose a irritation risk to people and a possible risk of fire if not properly handled. This section was designed to address potential material release events:

In case of a material release that poses a direct threat to health, safety, or the environment:

1. Report the incident to local safety/security office.
2. If extremely life-threatening immediately dial **911** followed with a call to Security.
3. Contain the spill.
4. Evacuate the area or building if the material release is determined to be life-threatening.

In the event of an unknown indoor smell or odor, report the incident to authorities responsible for HAZMAT and spills.

7. NATURAL DISASTERS AND SEVERE WEATHER

7.1 Earthquake

This section provides information and procedures for earthquake emergencies.

The fuel cell system is designed to automatically shut off if the natural gas supply is compromised.

The natural gas supply line has an external, manual shut-off valve that should be activated if it is safe to do so. This valve will be labeled, "Notice – Fuel Cell Gas Shut

Off". The natural gas line will be labeled with the word "gas" on a yellow background with an arrow pointing in the direction of flow.

The nearby Emergency Stop can be activated to stop the flow of fuel and power to/from the fuel cell system.

A Bloom Energy Field Engineer will validate site safety and system operation during/after severe weather as necessary.

7.2 Flood

The fuel cell system support pad is designed to divert water flow. However, if flooding conditions exist, or threaten to exist due to heavy rainfall, creek bank overflows, or pipe breakage, then immediately report the incident to the local safety/security office.

Do not use the fuel cell power system if any part has been under water. If it is safe to reach the Emergency Power Off button for the site without entering the water, stop all systems until a Bloom Energy representative can assess the site.

Precautions to follow after a flood:

- Stay out of flooded areas. Flooded areas remain unsafe. Entering a flooded area places you at risk.
- Notify Bloom Energy. A Bloom Energy Field Engineer will validate site safety and system operation during/after severe weather as necessary

8. UTILITY OUTAGE

The fuel cell system is operated in "Grid-Parallel" mode. If utility provided power is lost for any reason, the fuel cell system will go "off-line". The fuel cell system will remain in stand-by mode until it automatically senses the utility grid has been restored. If utility gas is shut down, the fuel cell system will begin to shut down completely.

The Bloom Energy Remote Monitoring Control Centers monitor the fuel cells 24 hours per day and will be alerted to utility grid interruptions via its controls software. A Field Service Engineer will be dispatched to restart the fuel cell system if necessary. Customer personnel should NOT attempt to start up or operate the fuel cell system.

Before a Planned Outage

- Notify the Bloom Energy Remote Monitoring Control Center at 1-408-543-1678 at least 24 hours before planned outage.
- Bloom Energy Remote Monitoring Engineers will reduce power generated by the fuel cell system and take the fuel cell off-line.
- Abrupt fuel cell system shutdowns may cause significant system damage.

During a Utility Power Loss

- The fuel cell system will automatically go off-line.
- The Bloom Energy Remote Monitoring Control Centers will monitor the fuel cell system.
- Bloom Energy Field Service will be dispatched to start up the fuel cell system as necessary.
- If the fuel cell system has been automatically shut down and utility power is restored, there will be no impact to building power delivery: primary power will come from the utility rather than the fuel cells.

9. GOOD HOUSEKEEPING AND MAINTENANCE

9.1 Good Housekeeping

Although extremely unlikely, to minimize the risk of fire and any incidents, Facility Managers should take the following precautions around the fuel cell installation:

- What to do if you smell gas:
 - Do not try to light any appliance
 - Do not touch any electrical switch; do not use any phone in the area
 - Leave the area immediately
 - Immediately call your gas supplier. Follow the gas supplier's instructions.
 - If you cannot reach your gas supplier, call the fire department
- Notify Bloom Energy Remote Monitoring Control Center at 1-408-543-1678 of any condition that would impair the safety of the fuel cell installation so that mitigation measures could be determined and placed into effect.
- Prohibit smoking within the area of the fuel cell installation. Bloom Energy will furnish No Smoking signs for the area.
- Ensure only Bloom Energy Service Providers are permitted access inside the system.
- Keep the area around the fuel cell installation clear for ten feet in all directions, for safety and ease of maintenance.
- Keep the area around the fuel cell power system clear and free of combustible materials, gasoline, and other flammable vapors and liquids.
- Shut the system down and call Bloom Energy immediately if you suspect a fuel line rupture.
- **Never enclose an operating system** in a tarp, tent, shed, or other structure that would allow air to become trapped. This system runs on natural gas, and produces trace amounts of CO and CO₂. The amounts of these gases are safe for normal outdoor operation but could gather in an enclosed place.
- Do not block or obstruct air openings on the fuel cell power system. This system requires air flow in order to operate.

- Do not use this fuel cell power system if any part has been under water. Immediately call qualified service personnel to inspect the fuel cell power system and to replace any functional part which has been under water.
- Please contact Bloom Energy at 408-543-1678 with as much advance notice as possible if you plan, detect, or suspect a prolonged Internet outage.
- The Bloom Energy Field Service team will periodically clean the equipment; do not spray with pressurized hoses.

9.2 Maintenance

Your site has specific Field Service personnel assigned to it for both routine maintenance and troubleshooting. Your site project manager will introduce you to the designated Bloom Energy Field Service team assigned to your site prior to operation.

Bloom Energy Field Service personnel are trained in state Safety Law. They are trained in all the procedures required for the fuel cell installation, and their toolkit includes all the safety equipment required to work around the fuel components and high voltage in our system (480VAC).

Bloom Energy also requires its employees to follow all necessary safety precautions, including:

- Every time a Field Service technician arrives at a site for the first time and opens a service panel, the technician will use a leak detector to determine whether there is any gas buildup in the system and determine that it is safe to work on it.
- Whenever a Field Service technician is removing and replacing a component on a fuel or exhaust line, the technician must keep a CO detector nearby to make sure that no CO is present in the line even after the system has been shut down.

The Field Service team expects to conduct quarterly and yearly preventative maintenance for certain types of consumable or cleanable components such as replacement of air filters, water filters, and desulfurizer beds. Other maintenance will be performed as required. During such times, inspections for any hazards will be conducted including quarterly fire extinguisher inspection (if applicable).

10. TRAINING

Prior to system startup, a Bloom Energy representative will provide training on the fuel cell installation to include the location and operation of safety features as well as actions to take during emergencies. We desire this training to provide lasting value and are more than happy to work with you to customize the experience to suit your needs.

Exhibit 7

Calculation of Yuma Sound Pressure Based On Distance

By Bob Hintz 1/16

All calculations are based on the following formula for sound pressure level (L_p):

$$L_p = L_w - 10 \cdot \log \left(\frac{Q}{4\pi \cdot r^2} \right) |$$

Sound power value (L_w) attained from V1 Yuma linear in DE reported on Feb. 4, 2015 by Mei Wu.

Scenario 1

ES is installed close to a building or tall wall so noise from the ES is reflected off of the structure and added to the noise from the other side of the ES making it sound louder than normal. This is represented by a directivity factor Q = 4

L_p = 36.0 dB

Where:


L _w =	86.4 dB
Q =	4
r =	435 Feet

ES sound power (Calc. from measurements)

Directivity factor

Enter value here for both Scenarios

Input various values for r to approximate the perceived sound pressure at that distance from the ES door

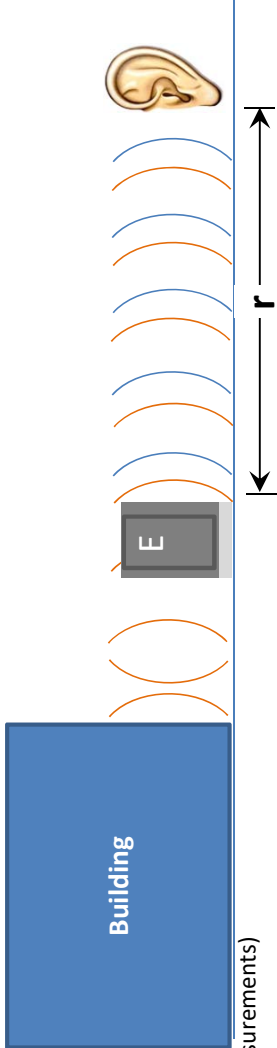

Scenario 2

ES is installed with no structures behind it to reflect sound from either side. This is represented by a directivity factor Q = 2

L_p = 33.0 dB


Where:

L _w =	86.4 dB
Q =	2
r =	435 Feet

ES sound power (Calc.)

Directivity factor

Input various values for r to approximate the perceived sound pressure at that distance from the ES door

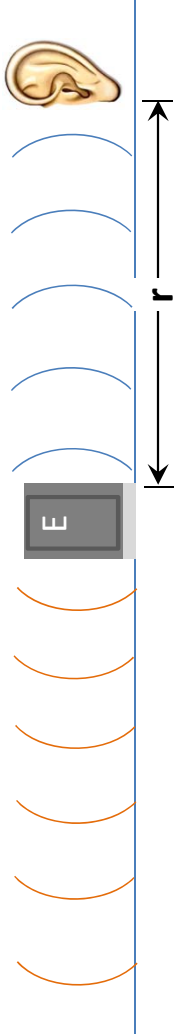

Calculation of Yuma Sound Pressure Based On Distance

By Bob Hintz 1/16

All calculations are based on the following formula for sound pressure level (L_p):

$$L_p = L_w - 10 \cdot \log \left(\frac{Q}{4\pi \cdot r^2} \right) |$$

Sound power value (L_w) attained from V1 Yuma linear in DE reported on Feb. 4, 2015 by Mei Wu.

Scenario 1

ES is installed close to a building or tall wall so noise from the ES is reflected off of the structure and added to the noise from the other side of the ES making it sound louder than normal. This is represented by a directivity factor Q = 4

L_p = 59.2 dB

Where:


L_w = 86.4 dB
Q = 4
r = 30 Feet

ES sound power (Calc. from measurements)

Directivity factor

Enter value here for both Scenarios

Input various values for r to approximate the perceived sound pressure at that distance from the ES door

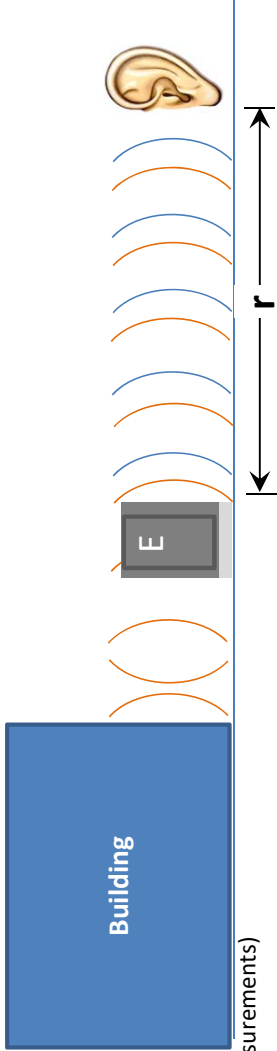

Scenario 2

ES is installed with no structures behind it to reflect sound from either side. This is represented by a directivity factor Q = 2

L_p = 56.2 dB

Where:

L_w = 86.4 dB
Q = 2
r = 30 Feet

ES sound power (Calc.)

Directivity factor

Input various values for r to approximate the perceived sound pressure at that distance from the ES door

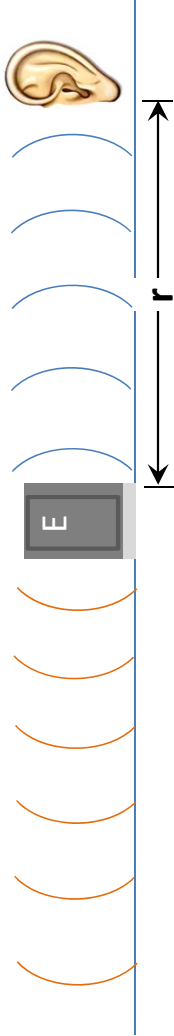


Exhibit 8



VIA CERTIFICATE OF MAILING

December 9, 2020

RE: Application of Bloom Energy for the location and construction of two solid oxide fuel cells to provide 1000 Kilowatts of Customer-Side Distributed Resource at the Dyno Nobel (Ensign-Bickford) complex, Simsbury, Connecticut

Dear Ladies and Gentlemen:

Pursuant to Section §16-50j-40 of the Connecticut Siting Council's (the "Council") regulations, we are notifying you that Bloom Energy intends to file, on or about December 14, 2020, a petition for declaratory ruling with the Council. The petition will request the Council's approval of the location and construction of two fuel cell installations and associated equipment. The Facility will consist of two locations on the Dyno Nobel (Ensign-Bickford) campus in Simsbury, Connecticut: 65 Woodland Street, Building 200 (aka 69 Woodland Street) and off of Drake Hill Road (the "Site").

The purpose of the proposed Facility is to replace a portion of Dyno Nobel's energy requirements with a renewable energy source¹ and improve reliability of electrical systems and equipment. Electricity generated by the Facility will be consumed primarily at the Site, and any excess electricity will be exported to the electric grid. The Facility will be fueled by natural gas.

Keeping the lines of communication open is an important part of our work in your community. If you have questions about this work, please contact the undersigned or the Council.

Respectfully,

A handwritten signature in black ink, appearing to read "Justin Adams".

Justin Adams

justin.adams@bloomenergy.com

The "Be" logo, with "B" in dark blue and "e" in green.

¹Connecticut General Statutes §16-1(a)(26)(A) identifies fuel cells as a "Class I renewable energy source".

ABUTTING PROPERTY OWNERS

highlight = Dyno Nobel campus properties

Parcel ID	Property Address	Owner Name	Mailing Address	Town	State	Zip
E12-103-005	45 Ashton Circle	Powder Forest Homes Association Inc	111 Roberts St, Suite G-1	East Hartford	CT	06108
E12-103-005-C	69 Woodland Street	Simsbury Hopmeadow Street LLC	2795 E Cottonwood PV#500	Salt Lake City	UT	84121-5695
E12-103-005F	Bushy Hill Road	Ensign-Bickford Realty Corporation	P O Box 711	Simsbury	CT	06070
E13-619-005	Carson Way	Carson Way LLC	76 West St.	Simsbury	CT	06070
F11-103-005-19	5 Grist Mill Road	BW Mill Commons LLC & Beachwold Residential LLC	314 Flanders Rd., Suite 2D	East Lyme	CT	06333
F11-103-005-24	Grist Mill Road	BW Mill Commons LLC & Beachwold Residential LLC	314 Flanders Rd., Suite 2D	East Lyme	CT	06333
F12-103-005A	15F Wiggins Farm Drive	Albert Monet	15F Wiggins Farm Dr.	Simsbury	CT	06070
F12-103-005A	10G Wiggins Farm Drive	Andres and Diane Child	10G Wiggins Farm Dr.	Simsbury	CT	06070
F12-103-005A	12D Wiggins Farm Drive	Angel Wu	12D Wiggins Farm Dr.	Simsbury	CT	06070
F12-103-005A	15A Wiggins Farm Drive	Ann D Prowda	15A Wiggins Farm Dr.	Simsbury	CT	06070
F12-103-005A	10H Wiggins Farm Drive	Anna Grupp	10H Wiggins Farm Dr.	Simsbury	CT	06070
F12-103-005A	14C Wiggins Farm Drive	Ayesha Dewan	14C Wiggins Farm Dr.	Simsbury	CT	06070
F12-103-005A	14J Wiggins Farm Drive	Beverley H Inman	14J Wiggins Farm Dr.	Simsbury	CT	06070
F12-103-005A	19A Wiggins Farm Drive	Carmelle Dwyer	19A Wiggins Farm Dr.	Simsbury	CT	06070
F12-103-005A	10C Wiggins Farm Drive	Daniel S Fabricant	10C Wiggins Farm Dr.	Simsbury	CT	06070
F12-103-005A	14B Wiggins Farm Drive	David G. Shtromberg & Marina Lumelsky	14B Wiggig Farm Dr.	Simsbury	CT	06070
F12-103-005A	19D Wiggins Farm Drive	David Pettyjohn	19D Wiggins Farm Dr.	Simsbury	CT	06070
F12-103-005A	15C Wiggins Farm Drive	Dennis M Farrell	15C Wiggins Farm Dr.	Simsbury	CT	06070
F12-103-005A	12G Wiggins Farm Drive	Eleanor L Calabretta	12G Wiggins Farm Dr.	Simsbury	CT	06070
F12-103-005A	14D Wiggins Farm Drive	Elizabeth G Dalnegro	14D Wiggins Farm Dr.	Simsbury	CT	06070
F12-103-005A	14H Wiggins Farm Drive	Emily and Eliza Breno	14H Wiggins Farm Dr.	Simsbury	CT	06070
F12-103-005A		Frances J Gauthier (LU) & Debra A Grasfield et al Trustees		Simsbury	CT	06070
F12-103-005A	19J Wiggins Farm Drive	Incy S Muir	19J Wiggins Farm Dr.	Simsbury	CT	06060
F12-103-005A	14F Wiggins Farm Drive	Incy S Muir	33 Loveland Rd.	North Granby	CT	06060
F12-103-005A	15G Wiggins Farm Drive	James A Rutt, Trustee, c/o Daniel J Rutt	33 Loveland Rd.	North Granby	CT	06060
F12-103-005A	19F Wiggins Farm Drive	Jean M Sorich	15G Wiggins Farm Dr.	Simsbury	CT	06070
F12-103-005A	19B Wiggins Farm Drive	John T and Kenneth Letson	19F Wiggins Farm Dr.	Simsbury	CT	06070
F12-103-005A	19G Wiggins Farm Drive	Joshua and Sarah E Thayer	49 Longview Dr.	Simsbury	CT	06070
F12-103-005A	10B Wiggins Farm Drive	Joshua Orbach	19G Wiggins Farm Dr.	Simsbury	CT	06070
F12-103-005A	15D Wiggins Farm Drive	Judith Kaufman	10B Wiggins Farm Dr.	Simsbury	CT	06070
F12-103-005A	19H Wiggins Farm Drive	Leslie Mazur	15D Wiggins Farm Dr.	Simsbury	CT	06070
F12-103-005A	17A Wiggins Farm Drive	Lubor and Andrea Stonawski	19H Wiggins Farm Dr.	Simsbury	CT	06070
F12-103-005A	14A Wiggins Farm Drive	Marion Christopoulos	17A Wiggins Farm Dr.	Simsbury	CT	06070
F12-103-005A	15B Wiggins Farm Drive	Mary J Clark	14A Wiggins Farm Dr.	Simsbury	CT	06070
F12-103-005A	12H Wiggins Farm Drive	Michael C and Catherine N Bruno	15B Wiggins Farm Dr.	Simsbury	CT	06070
F12-103-005A	12E Wiggins Farm Drive	Michael R Jennings	12H Wiggins Farm Dr.	Simsbury	CT	06070
F12-103-005A	12C Wiggins Farm Drive	Michelle L Perrault	12E Wiggins Farm Dr.	Simsbury	CT	06070
			12C Wiggins Farm Dr.	Simsbury	CT	06070

F12-103-005A	15E Wiggins Farm Drive	Nancy B. Delucia	15E Wiggins Farm Dr.	Simsbury	CT	06070
F12-103-005A	12F Wiggins Farm Drive	Pradyumn Anirudha	12F Wiggins Farm Dr.	Simsbury	CT	06070
F12-103-005A	14E Wiggins Farm Drive	Rajasekhar Balakrishnan	14E Wiggins Farm Dr.	Simsbury	CT	06070
F12-103-005A	10A Wiggins Farm Drive	Renette Taylor-Enslie	10A Wiggins Farm Dr.	Simsbury	CT	06070
F12-103-005A	14G Wiggins Farm Drive	Robert A Duccini	14G Wiggins Farm Dr.	Simsbury	CT	06070
F12-103-005A	17C Wiggins Farm Drive	Robert K Gran	17C Wiggins Farm Dr.	Simsbury	CT	06070
F12-103-005A	10E Wiggins Farm Drive	Ruth S. Edwards	10E Wiggins Farm Dr.	Simsbury	CT	06070
F12-103-005A	15H Wiggins Farm Drive	Sheila S and Robert Mooney	15H Wiggins Farm Dr.	Simsbury	CT	06070
F12-103-005A	10D Wiggins Farm Drive	Stacey Brooks	10D Wiggins Farm Dr.	Simsbury	CT	06070
F12-103-005A	19E Wiggins Farm Drive	Stephen P and Frances A Mason	80 Highwood Dr.	Avon	CT	06001
F12-103-005A	10F Wiggins Farm Drive	Susan D Quirk	10F Wiggins Farm Dr.	Simsbury	CT	06070
F12-103-005A	15J Wiggins Farm Drive	The John Hughes Trust c/o Midwest Trust Company Trustee	5901 College Blvd, Site 100	Overland Park	KS	66211
F12-103-005A	12A Wiggins Farm Drive	Timothy M and Doreen K Gasaatura	7 Cody St.	West Hartford	CT	06110
F12-103-005A	12B Wiggins Farm Drive	Wilfred J Reil III	12B Wiggins Farm Dr.	Simsbury	CT	06070
F12-103-037	33 Pine Hill Drive	Jon J Fearnley and Brigitte Boltz	33 Pine Hill Dr.	Simsbury	CT	06070
F12-103-038	35 Pine Hill Drive	Katherine G Creedon	35 Pine Hill Dr.	Simsbury	CT	06070
F12-103-039	37 Pine Hill Drive	Dennis and Mauren Williams	37 Pine Hill Dr.	Simsbury	CT	06070
F12-103-040	39 Pine Hill Drive	David D and Maryellen Bailey	39 Pine Hill Dr.	Simsbury	CT	06070
F12-103-043	Pine Hill Drive	Pine Hill Home Owners Assoc Inc.	P O Box 111	Weatogue	CT	06089
F13-103-005-3	437 Hopmeadow Street	Ensign-Bickford Realty Corporation	P O Box 711	Simsbury	CT	06070-0711
F13-103-005-6	1-4 Morningside Drive	275 Powder Forest LLC	75 West St.	Simsbury	CT	06070
F13-103-005-6	5-8 Morningside Drive	275 Powder Forest LLC	75 West St.	Simsbury	CT	06070
F13-103-005-6	9-12 Morningside Drive	275 Powder Forest LLC	75 West St.	Simsbury	CT	06070
F13-103-005-6	13-16 Morningside Drive	275 Powder Forest LLC	75 West St.	Simsbury	CT	06070
F13-103-005-6	17-20 Morningside Drive	275 Powder Forest LLC	75 West St.	Simsbury	CT	06070
F13-103-005-6	21-24 Morningside Drive	275 Powder Forest LLC	75 West St.	Simsbury	CT	06070
F13-103-005-6	25-28 Morningside Drive	275 Powder Forest LLC	75 West St.	Simsbury	CT	06070
F13-103-005-6	29-32 Morningside Drive	275 Powder Forest LLC	75 West St.	Simsbury	CT	06070
F13-103-005-6	33-36 Morningside Drive	275 Powder Forest LLC	75 West St.	Simsbury	CT	06070
F13-103-005-6	37-40 Morningside Drive	275 Powder Forest LLC	75 West St.	Simsbury	CT	06070
F13-103-005-6	41-44 Morningside Drive	275 Powder Forest LLC	75 West St.	Simsbury	CT	06070
F13-103-005-6	45-48 Morningside Drive	275 Powder Forest LLC	75 West St.	Simsbury	CT	06070
F14-103-005-4	200 Powder Forest Drive	Seabury at Powder Forest LLC	200 Seabury Dr.	Bloomfield	CT	06002
G10-203-002	689 Hopmeadow Street	First Church of Christ and The Ecclesiastical Society of Simsbury Inc.	689 Hopmeadow St.	Simsbury	CT	06070-2281
G11-103-000B	36 Woodland Street	Eric W and Michelle M Chase	637 Hopmeadow St.	Simsbury	CT	06070
G11-103-000B	36 Woodland Street	John P Moynihan Jr	643 Hopmeadow St.	Simsbury	CT	06070
G11-103-000B	36 Woodland Street	Kevin McKenna	639 Hopmeadow St.	Simsbury	CT	06070
G11-103-000B	36 Woodland Street	Lisa K Kozlowski	40 Woodland St.	Simsbury	CT	06070
G11-103-000B	36 Woodland Street	Sandra F Garcia	641 Hopmeadow St.	Simsbury	CT	06070
G11-103-000B	36 Woodland Street	Shelly Norriatko	26 Bushy Hill Rd.	Simsbury	CT	06070
G11-103-000C	41 Woodland Street	Jeffrey T and Mary C Lent	36 Woodland St.	Simsbury	CT	06070

G11-103-000C	41 Woodland Street	Karl H and Sarah H Warner	31 Woodland St.	Simsbury	CT	06070
G11-103-000C	41 Woodland Street	Seung Jae and Ivory Julianne Baek	37 Woodland St.	Simsbury	CT	06070
G11-103-000C	41 Woodland Street	Yevgeny and Galina Kozhenevsky	39 Woodland St.	Simsbury	CT	06070
G11-103-001	22 Woodland Street	Acorn Rentals	40 Pilfershire Rd.	West Simsbury	CT	06092
G11-103-001	643 Hopmeadow Street	John P Moynihan Jr	643 Hopmeadow St.	Simsbury	CT	06070
G11-103-001-2	1 West Street	Albee M Korn Trustee, Albee M Korn Rev Tr	1 West St. Unit 111	Simsbury	CT	06070
G11-103-001-2	1 West Street	Alfonso Rizo- Patron	1 West St. Unit 121	Simsbury	CT	06070
G11-103-001-2	1 West Street	Andrea Dennis-Lavigne	1 West St. Unit 221	Simsbury	CT	06070
G11-103-001-2	1 West Street	Anita L Mielert Trustee	1 West St. Unit 216	Simsbury	CT	06070
G11-103-001-2	1 West Street	Ann W and Anton H Brockelman Trustees	1802 Pine Glade Cir	Ft Myers	FL	33907
G11-103-001-2	1 West Street	Beverly Longo	1 West St. Unit 119	Simsbury	CT	06070
G11-103-001-2	1 West Street	David E and Mina M Bullock	1 West St. Unit 314	Simsbury	CT	06070
G11-103-001-2	1 West Street	David N and Judith R Wiley	1 West St. Unit 104	Simsbury	CT	06070
G11-103-001-2	1 West Street	Donald T Zaylor	1 West St. Unit 313	Simsbury	CT	06070
G11-103-001-2	1 West Street	Eileen P Twigg	1 West St. Unit 220	Simsbury	CT	06070
G11-103-001-2	1 West Street	Est of Frank E Walton and Betty S Walton (TC)	1 West St. Unit 204	Simsbury	CT	06070
G11-103-001-2	1 West Street	Francis J Kelly Jr	1 West St. Unit 311	Simsbury	CT	06070
G11-103-001-2	1 West Street	George D and Jeannette M VanWormer	1 West St. Unit 307	Simsbury	CT	06070
G11-103-001-2	1 West Street	Gertrude Conroy	1 West St. #304	Simsbury	CT	06070
G11-103-001-2	1 West Street	Gilbert Parmele	1 West St. Unit 108	Simsbury	CT	06070
G11-103-001-2	1 West Street	Gloria M Carbillo	1 West St. Unit 107	Simsbury	CT	06070
G11-103-001-2	1 West Street	Helen Bernadine Becker Trustee	1 West St. Unit 209	Simsbury	CT	06070
G11-103-001-2	1 West Street	James N and Rita M Bagnall	1 West St. #315	Simsbury	CT	06070
G11-103-001-2	1 West Street	Jane E and Richard H Bason Trustees	1 West St. Unit 212	Simsbury	CT	06070
G11-103-001-2	1 West Street	Janice A Hughes	1 West St. #308	Simsbury	CT	06070
G11-103-001-2	1 West Street	Jean D Laskey	1 West St. #205	Simsbury	CT	06070
G11-103-001-2	1 West Street	Joann S Carvlin (LU), Stephanie M and Mark J Carvlin (TC)	1 West St. Unit 214	Simsbury	CT	06070
G11-103-001-2	1 West Street	Joanne Dombrosky	4 Glen Hollow	West Simsbury	CT	06092
G11-103-001-2	1 West Street	John J Kliska	1 West St. Unit 210	Simsbury	CT	06070
G11-103-001-2	1 West Street	Joseph & Karen R Hewes	1 West St. Unit 101	Simsbury	CT	06070
G11-103-001-2	1 West Street	Joseph D Bronzino and Charles E Drummey Trustees	75 Isham Rd Suite 300 Blue Back	West Hartford	CT	06107
G11-103-001-2	1 West Street	Joyce K & Stephen H Weinberg	4207 Warrens Way	Wanaque	NJ	07465
G11-103-001-2	1 West Street	Judith Rubinstein	1 West St. Unit 105	Simsbury	CT	06070
G11-103-001-2	1 West Street	Ken D and Sharon L Lawson Trustees	1 West St. Unit 109	Simsbury	CT	06070
G11-103-001-2	1 West Street	Larry Atherton	1 West St. Unit 122	Simsbury	CT	06070
G11-103-001-2	1 West Street	Lauren D Pollack Trustee	7 Saddle Xing	Avon	CT	06001
G11-103-001-2	1 West Street	Lauren D Pollack Trustee	7 Saddle Xing	Avon	CT	06001
G11-103-001-2	1 West Street	Linda J Hughes	1 West St. #211	Simsbury	CT	06070
G11-103-001-2	1 West Street	Lisa Schweidt	1 West St. Unit 201	Simsbury	CT	06070
G11-103-001-2	1 West Street	Louise R Devanna	1 West St. Unit 303	Simsbury	CT	06070
G11-103-001-2	1 West Street	Lucinda C Ash	96 Wright Rd	Canton	CT	06019

G11-103-001-2	1 West Street	Lynn Ferris Pollack Trustee	7 Saddle Xing	Avon	CT	06001
G11-103-001-2	1 West Street	Maria Giesey	PO Box 905	Avon	CT	06001
G11-103-001-2	1 West Street	Marie A Thompson - LU and Bradley A and Brian A Thompson	1 West St. Unit 120	Simsbury	CT	06070
G11-103-001-2	1 West Street	Marion T and Addison G Ricker	6 Ascot Ln	Old Lyme	CT	06371
G11-103-001-2	1 West Street	Marilyn G King	1 West St. Unit 208	Simsbury	CT	06070
G11-103-001-2	1 West Street	Odetta M Conley	1 West St. Unit 123	Simsbury	CT	06070
G11-103-001-2	1 West Street	Ora Weiner Trustee	1 West St. Unit 112	Simsbury	CT	06070
G11-103-001-2	1 West Street	Patricia A Clifford	1 West St. Unit 215	Simsbury	CT	06070
G11-103-001-2	1 West Street	Patricia A Hogard c/o Tricia Spence, Fiduciary	32 Heather Ln	North Granby	CT	06060
G11-103-001-2	1 West Street	Patricia A Scanlon	1 West St. Unit 322	Simsbury	CT	06070
G11-103-001-2	1 West Street	Patricia L Eden (LU), Richard A Eden and Laura J Eden Kimble Trustees	1 West St. #124	Simsbury	CT	06070
G11-103-001-2	1 West Street	Regina K Nelson Trustee	1 West St. #118	Simsbury	CT	06070
G11-103-001-2	1 West Street	Reginald E & Jane M Zurinkas	1 West St. Unit 102	Simsbury	CT	06070
G11-103-001-2	1 West Street	Renata and Gregory Hayes	1 West St. Unit 110	Simsbury	CT	06070
G11-103-001-2	1 West Street	Renee D Millas and Suzanne C Brannack and Marlene M Ruel	4 Great Meadow	West Simsbury	CT	06092
G11-103-001-2	1 West Street	Richard F Ahles	1 West St. Unit 222	Simsbury	CT	06070
G11-103-001-2	1 West Street	Richard J and Judy L Kaiser	1 West St. Unit 202	Simsbury	CT	06070
G11-103-001-2	1 West Street	Robert K and Barbara M Griffin Trustees	1 West St. Unit 319	Simsbury	CT	06070
G11-103-001-2	1 West Street	Robert W and Margaret Ann H Bamberg Co-Trustees	1 West St. Unit 219	Simsbury	CT	06070
G11-103-001-2	1 West Street	Rodger Coyne Trustee	5 Highview Rd	Simsbury	CT	06070
G11-103-001-2	1 West Street	Ronald B and Dolores P Gutfran	6 Chestnut Hill Rd.	West Simsbury	CT	06092
G11-103-001-2	1 West Street	Rosemary E Lemke Co-Trustee and Joseph M Lemke Co-Trustee	1 West St. Unit 213	Simsbury	CT	06070
G11-103-001-2	1 West Street	Roy A and Lisa M Blixt	1 West St. Unit 106	Simsbury	CT	06070
G11-103-001-2	1 West Street	Sandra Orluk	1 West St. Unit 103	Simsbury	CT	06070
G11-103-001-2	1 West Street	SBMeadow LLC	1 West St. Unit 317	Simsbury	CT	06070
G11-103-001-2	1 West Street	Suzanne R Walczar	PO Box 865	Rockport	ME	04856
G11-103-001-2	1 West Street	Suzanne V Sabia Trustee	1 West St. Unit 207	Simsbury	CT	06070
G11-103-001-2	1 West Street	Wanda G Kelly Trustee	88 Pepperidge Rd	Portland	CT	06480
G11-103-001-2	1 West Street	William H Cross Trustee, William H Cross 2000 Trust	1 West St. Unit 306	Simsbury	CT	06070
G11-103-001-2	1 West Street	William J and Maureen A Kennedy	1 West St. Unit 206	Simsbury	CT	06070
G11-103-002	26 Woodland Street	Debra A McDermott	26 Woodland St.	Simsbury	CT	06070
G11-103-002	641 Hopmeadow Street	Sandra F Garcia	641 Hopmeadow St.	Simsbury	CT	06070
G11-103-003	639 Hopmeadow Street	Kevin McKenna	639 Hopmeadow St.	Simsbury	CT	06070
G11-103-004	637 Hopmeadow Street	Eric W and Michelle M Chase	637 Hopmeadow St.	Simsbury	CT	06070
G11-103-005	635 Hopmeadow Street	Margaret J Swanson	635 Hopmeadow St.	Simsbury	CT	06070
G11-103-005-25	100 Grist Mill Road	Grist Mill Partners LLC	28 Tower Ln., Suite 100	Avon	CT	06001
G11-103-006	631 Hopmeadow Street	Keith & Brianna Appleton	631 Hopmeadow St.	Simsbury	CT	06070

G11-103-00A	Woodland Place	Margaret J Swanson	635 Hopmeadow St.	Simsbury	CT	06070
G11-103-010	32 Woodland Street	Jeanine L and Nord E Christensen	35 West Mountain Rd.	West Simsbury	CT	06092
G11-103-011	30 Woodland Street	Kara L Mealey	30 Woodland St.	Simsbury	CT	06070
G11-103-012	28 Woodland Street	Paul E Roberts	28 Woodland St.	Simsbury	CT	06070
G11-103-016	Hopmeadow Street	Simsbury Hopmeadow Street LLC	2795 E Cottonwood PY#500	Salt Lake City	UT	84121-5696
G11-103-016	39 Woodland Street	Yevgeny and Galina Kozhenevsky	39 Woodland St.	Simsbury	CT	06070
G11-103-017	43 Woodland Street	Est of Veronica A Tarca, c/o Caroline M Tarca - Fiduciary	236 Westford Rd.	Eastford	CT	06242
G11-103-054	23 Woodland Street	Robert G Gaucher and Gary Palatnick	14 White Oak Ln.	Simsbury	CT	06070
G11-103-007	44 Woodland Street	Peter J and Catherine Decoteau	44 Woodland St.	Simsbury	CT	06070
G11-107-001	619 Hopmeadow Street	P R Properties	625 Hopmeadow St.	Simsbury	CT	06070
G11-107-002	615 Hopmeadow Street	P R Properties	625 Hopmeadow St.	Simsbury	CT	06070
G11-107-003	611 Hopmeadow Street	Matthew F and Josephine Schoenhardt	61 Westledge Rd.	Simsbury	CT	06070
G11-107-004	609 Hopmeadow Street	Teresa Rodriguez	609 Hopmeadow St.	Simsbury	CT	06070
G11-107-005	605 Hopmeadow Street	Matthew T Grande and Elizabeth Shine	605 Hopmeadow St.	Simsbury	CT	06070
G11-107-006	603 Hopmeadow Street	Benjamin Woodhouse and Olivia McDonald	603 Hopmeadow St.	Simsbury	CT	06070
G11-107-006	603 Hopmeadow Street	Benjamin Woodhouse and Olivia McDonald	603 Hopmeadow St.	Simsbury	CT	06070
G11-132-052	632 Hopmeadow Street	Simsbury Hopmeadow Street LLC	2795 E Cottonwood PY#500	Salt Lake City	UT	84121
G11-132-053	690 Hopmeadow Street	Solctran LLC	29 Notch Rd.	West Simsbury	CT	06092
G11-144-005	Drake Hill Road	Simsbury Hopmeadow Street LLC	2795 E Cottonwood PY#500	Salt Lake City	UT	84121-5695
G11-144-005A	Drake Hill Place	Connecticut Light and Power	P O Box 270	Hartford	CT	06141-0270
G11-144-006	29 Drake Hill Road	Deborah R Mason	29 Drake Hill Rd.	Simsbury	CT	06070
G12-103-009	75 Woodland Street	Tyrell Doyle Alan Watkins	75 Woodland St.	Simsbury	CT	06070
G12-103-010	77 Woodland Street	David Litchfield	PO Box 553	Simsbury	CT	06070
G12-103-011	81 Woodland Street	Sarah E Jones	81 Woodland St.	Simsbury	CT	06070
G12-103-012	85 Woodland Street	Streinz Family LLC	346 Town Hill Rd.	New Hartford	CT	06057
G12-103-013	581 Hopmeadow Street	Jonathan I Dahlistrom and Jane J Paddock	581 Hopmeadow St.	Simsbury	CT	06070
G12-103-037	563 Hopmeadow Street	BMS Holdings LLC	583 Hopmeadow St.	Simsbury	CT	06070
G12-103-038A	573A Hopmeadow Street	Casamira LLC	573A Hopmeadow St.	Simsbury	CT	06070
G12-103-038A	573A Hopmeadow Street	Casamira LLC	573A Hopmeadow St.	Simsbury	CT	06070
G12-103-038A	573B Hopmeadow Street	ECAC Associates LLC	P O Box 95	Simsbury	CT	06070
G12-103-038A	573B Hopmeadow Street	ECAC Associates LLC	P O Box 95	Simsbury	CT	06070
G12-103-038A	573B Hopmeadow Street	JGH Associates LLC and 573B Hopmeadow Street	P O Box 95	Simsbury	CT	06070
G12-103-038A	573B Hopmeadow Street	JGH Associates LLC and 573B Hopmeadow Street	P O Box 95	Simsbury	CT	06070
G12-103-038A	573A Hopmeadow Street	Weatogue Court LLC	21 Musket Trail	Simsbury	CT	06070
G12-103-038A	573A Hopmeadow Street	Weatogue Court LLC	21 Musket Trail	Simsbury	CT	06070
G12-103-040	577 Hopmeadow Street	John R Cronin	577 Hopmeadow St.	Simsbury	CT	06070
G12-107-007	599 Hopmeadow Street	Deborah L Martin	284 Main St., Suite 490	Wilton	ME	04294
G12-107-007	599 Hopmeadow Street	Deborah L Martin	284 Main St., Suite 490	Wilton	ME	04294
G12-107-008	595 Hopmeadow Street	Howard R Ebert Jr and Michelle M Kapanka	595 Hopmeadow St.	Simsbury	CT	06070
G12-108-017	29 Riverside Road	Robert A Poutasse and Nancy Myerson	29 Riverside Rd.	Simsbury	CT	06070
G12-108-018	31 Riverside Road	Brookside Residence LLC	33 Riverside Rd.	Simsbury	CT	06070
G12-108-018A	33 Riverside Road	Richard P Brainerd Trustee	33 Riverside Rd.	Simsbury	CT	06070

G12-108-019	35 Riverside Road	David W and Pamela S Carter	35 Riverside Rd.	Simsbury	CT	06070
G12-108-020	Riverside Road	William J Selig Jr and Sandra J Selig	40 Riverside Rd.	Simsbury	CT	06070
G12-108-030	2 Woods Lane	Thomas B and Emily H Vincent	2 Woods Ln	Simsbury	CT	06070
G12-110-001	553 Hopmeadow Street	Thomas A and Laura Nigro	4 Kilbourn Farms Ln.	Simsbury	CT	06070
G12-132-026	530 Hopmeadow Street	Simsmore Square Enterprises LLC	540 Hopmeadow St.	Simsbury	CT	06070
G12-132-029A	540 Hopmeadow Street	Simsmore Square 540 LLC	540 Hopmeadow St.	Simsbury	CT	06070
G12-132-031	548 Hopmeadow Street	Simsmore Square Enterprises LLC	540 Hopmeadow St.	Simsbury	CT	06070
G12-132-032	552 Hopmeadow Street	Kaylor Real Estate LLC	29 Holcomb St.	Simsbury	CT	06070
G12-132-035	558 Hopmeadow Street	Jaymac LLC	542 Hopmeadow St., PMB138	Simsbury	CT	06070
G12-132-036	560 Hopmeadow Street	BMG Properties LLC	857 New Britain Ave.	Farmington	CT	06032
G12-132-037	568 Hopmeadow Street	Chen and Gao Realty LLC	19 Vining Dr.	Simsbury	CT	06070
G12-132-038	570 Hopmeadow Street	Asian Relish LLC	570 Hopmeadow St.	Simsbury	CT	06070
G12-132-039	576 Hopmeadow Street	Donald R and Gail-Gene Mercey	576 Hopmeadow St.	Simsbury	CT	06070
G13-108-002	East Weatogue Street	Robert J Bonetti	30 Ridge Rd.	Granby	CT	06035
G13-108-005	East Weatogue Street	Town of Simsbury	P O Box 495	Simsbury	CT	06070
G13-132-000C	12 Hazelmeadow Place	Corey Somerville	8 Gargan Pl.	Simsbury	CT	06070
G13-132-000C	12 Hazelmeadow Place	Emily Dahmer Walsh	5 Hazelmeadow Pl.	Simsbury	CT	06070
G13-132-000C	12 Hazelmeadow Place	Francis J Salls	20 Hazelmeadow Pl.	Simsbury	CT	06002
G13-132-000C	12 Hazelmeadow Place	Gary A Bohner Jr and Hazelmeadow LLC	PO Box 491	Simsbury	CT	06070
G13-132-000C	12 Hazelmeadow Place	Gary S and Elizabeth J T Berman	6 Gargan Pl.	Simsbury	CT	06070
G13-132-000C	12 Hazelmeadow Place	Harolyn J Erickson	3 Hazelmeadow Pl.	Simsbury	CT	06070
G13-132-000C	12 Hazelmeadow Place	Hazelmeadow LLC	PO Box 491	Simsbury	CT	06070
G13-132-000C	12 Hazelmeadow Place	Heather Parker	14 Cedar Hill Rd.	West Simsbury	CT	06092
G13-132-000C	12 Hazelmeadow Place	Jamie and Adam Cohen	2 Hazelmeadow Pl.	Simsbury	CT	06070
G13-132-000C	12 Hazelmeadow Place	Margaret B and Raymond J Higgs	2 Gargan Pl.	Simsbury	CT	06070
G13-132-000C	12 Hazelmeadow Place	Thomas and Laura Nigro	4 Kilbourn Farms Ln.	Simsbury	CT	06070
G13-132-000C	12 Hazelmeadow Place	Walter E and Dianna S Anderson	10 Hazelmeadow Pl.	Simsbury	CT	06070
G13-132-000C	12 Hazelmeadow Place	Walter Edwin and Dianna S Anderson	10 Hazelmeadow Pl.	Simsbury	CT	06070
G13-132-023A	520 Hopmeadow Street	Nancy C Ford	4 Billingsgate Dr.	Simsbury	CT	06070
G13-144-005A	3 Tamarack Lane	Ann C McDonald	3 Tamarack Ln.	Simsbury	CT	06070
G13-144-005A	1 Tamarack Lane	Bruce R Jachym	1 Tamarack Ln.	Simsbury	CT	06070
G13-144-005A	1 Mathers Crossing	Carol A McKenzie	1 Mathers Crossing	Simsbury	CT	06070
G13-144-005A	2 Mathers Crossing	Carol E Hurlbut	2 Mathers Crossing	Simsbury	CT	06070
G13-144-005A	5 Mathers Crossing	Charles F and Patricia A Scanlon	5 Mathers Crossing	Simsbury	CT	06070
G13-144-005A	1 Riverview Circle	David Pariseault	1 Riverview Cir.	Simsbury	CT	06070
G13-144-005A	9 Mathers Crossing	Deborah H Spillane	9 Mathers Crossing	Simsbury	CT	06070
G13-144-005A	3 Riverview Circle	Deborah L McDonald	3 Riverview Cir.	Simsbury	CT	06070
G13-144-005A	5 Riverview Circle	Deborah McDonald	5 Riverview Cir.	Simsbury	CT	06070
G13-144-005A	7 Tamarack Lane	Edna M Forbes	7 Tamarack Ln.	Simsbury	CT	06070
G13-144-005A	6 Mathers Crossing	Edward J Sansone	193 West Granby Rd.	Granby	CT	06035
G13-144-005A	4 Riverview Circle	Janis Burnham	4 Riverview Cir.	Simsbury	CT	06070
G13-144-005A	4 Mathers Crossing	Jessica Vastano	4 Mathers Crossing	Simsbury	CT	06070
G13-144-005A	2 Tamarack Lane	John K Miller	2 Tamarack Ln.	Simsbury	CT	06070

G13-144-005A	4 Tamarack Lane	John S Disbrow	4 Tamarack Ln.	Simsbury	CT	06070
G13-144-005A	5 Tamarack Lane	Lee J Wilder	5 Tamarack Ln.	Simsbury	CT	06070
G13-144-005A	8 Mathers Crossing	Mark A and Carrie A Greene	8 Mathers Crossing	Simsbury	CT	06070
G13-144-005A	7 Mathers Crossing	Martha J Hickey	7 Mathers Crossing	Simsbury	CT	06070
G13-144-005A	12 Mathers Crossing	Michael A Pompa	12 Mathers Crossing	Simsbury	CT	06070
G13-144-005A	3 Mathers Crossing	Michael and Richard Kahn (TC)	3 Mathers Crossing	Simsbury	CT	06070
G13-144-005A	11 Mathers Crossing	Nicole C Cloutier and Christopher W Collins	11 Mathers Crossing	Simsbury	CT	06070
G13-144-005A	2 Riverview Circle	Pamela J Simmons	2 Riverview Cir.	Simsbury	CT	06070
G13-144-005A	6 Riverview Circle	Peter J Jenkelunas Sr	6 Riverview Cir.	Simsbury	CT	06070
G13-144-005A	10 Mathers Crossing	Sara Jackson Batchelder Trustee	10 Mathers Crossing	Simsbury	CT	06070
G13-144-005A	8 Tamarack Lane	Teresa M Carr	8 Tamarack Ln.	Simsbury	CT	06070
G13-144-005A	6 Tamarack Lane	Yunfei Zhou	6 Tamarack Ln.	Simsbury	CT	06070
H11-104-001	87 Riverside Road	Susan D Andrus	109 Hopmeadow St.	Weatogue	CT	06089
H11-144-007	1 Old Bridge Road	Town of Simsbury	933 Hopmeadow St.	Simsbury	CT	06070
H11-226-001-1A	36 Drake Hill Road	Town of Simsbury (Sewer Treatment Plant)	36 Drake Hill Rd.	Simsbury	CT	06070
H11-226-002	Old Bridge Road	Town of Simsbury	933 Hopmeadow St.	Simsbury	CT	06070
H13-108-013	East Weatogue Street	Sandra Bourke and Marshall Epstein (TC)	26 East Weatogue St.	Simsbury	CT	06070

Type text here

OFFICIALS

Name	Title	Mailing Address	Town	State	Zip
William Tong	Attorney General	55 Elm St.	Hartford	CT	06106
Katie Dykes	Commissioner, Dept. of Energy and Environmental Protection	79 Elm St.	Hartford	CT	06106-5127
Marissa Paslick Gillett	Chairman, Public Utilities Regulatory Authority	10 Franklin Square	New Britain	CT	06051
Deidre S. Gifford, MD, MPH	Acting Commissioner, Dept. of Public Health	410 Capitol Ave.	Hartford	CT	06134
Susan D. Merrow	Chair, Council on Environmental Quality	79 Elm St.	Hartford	CT	06106
Bryan P. Hurlburt	Commissioner, Dept. of Agriculture	450 Columbus Blvd., Suite 701	Hartford	CT	06103
Melissa McCaw	Secretary, Office of Policy and Management	450 Capitol Ave.	Hartford	CT	06106
Joseph Giulietti	Commissioner, Dept. of Transportation	2800 Berlin Turnpike	Newington	CT	06111
David Lehman	Commissioner, Dept. of Economic and Community Development	450 Columbus Blvd.	Hartford	CT	06103
Regina Rush-Kittle	Deputy Commissioner, Dept. of Emergency Management and Homeland Security	1111 Country Club Rd.	Middletown	CT	06457
Michelle H. Seagull	Commissioner, Dept. of Consumer Protection	450 Columbus Blvd., Suite 901	Hartford	CT	06103
Josh Geballe	Commissioner, Dept. of Administrative Services	450 Columbus Blvd.	Hartford	CT	06103
Kurt Westby	Commissioner, Dept. of Labor	200 Folly Brook Blvd.	Wethersfield	CT	06109
Richard Blumenthal	Senator	702 Hart Senate Office Building	Washington	DC	20510
Chris Murphy	Senator	840A Dirksen Senate Office Building	Washington	DC	20510
Jahana Hayes	U.S. Representative	1415 Longworth House Office Building	Washington	DC	20515
Kevin D. Witkos	State Senator, 8th District	Legislative Office Building, Room 3400	Hartford	CT	06106
John K. Hampton	Representative, 16th District	Legislative Office Building, Room 5007	Hartford	CT	06106-1591
	Capitol Regional Council of Governments	241 Main St., #4	Hartford	CT	06106-5310
Eric Wellman	First Selectman, Town of Simsbury	933 Hopmeadow St.	Simsbury	CT	06070
Maria Capriola	Town Manager	933 Hopmeadow St.	Simsbury	CT	06070
Michael Glidden	Director of Planning and Community Development	933 Hopmeadow St.	Simsbury	CT	06070
William R. Rice	Chair, Planning Commission	933 Hopmeadow St.	Simsbury	CT	06070
Margery C.B. Winters	Chair, Conservation Commission/Inland Wetlands & Water Courses Agency	933 Hopmeadow St.	Simsbury	CT	06070
David Rogers Ryan	Chair, Zoning Commission	933 Hopmeadow St.	Simsbury	CT	06070



Certificate of Mailing — Firm

Name and Address of Sender Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		TOTAL NO. of Pieces Listed by Sender 5	TOTAL NO. of Pieces Received at Post Office™ 5	Affix Stamp Here  U.S. POSTAGE PAID WESTERLY, RI 02891 DEC 09 20 AMOUNT \$2.15 R2305K132237-06 0000			
USPS® Tracking Number Firm-Specific Identifier		Address (Name, Street, City, State, and ZIP Code™)		Postage	Fee	Special Handling	Parcel Airlift
1.		William H Cross Trustee, William H Cross 2000 Trust 1 West St. Unit 306 Simsbury, CT 06070					
2.		William J and Maureen A Kennedy 1 West St. Unit 206 Simsbury, CT 06070					
3.		William J Selig Jr and Sandra J Selig 40 Riverside Rd. Simsbury, CT 06070					
4.		Yevgeny and Galina Kozhenevsky 39 Woodland St. Simsbury, CT 06070					
5.		Yunfei Zhou 6 Tamarack Ln. Simsbury, CT 06070					
6.							



Certificate of Mailing — Firm

Name and Address of Sender Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		TOTAL NO. of Pieces Listed by Sender 6	TOTAL NO. of Pieces Received at Post Office™ 6	Affix Stamp Here <i>Postmark with Date of Receipt.</i> U.S. POSTAGE PAID WESTERLY, RI 02891 DEC 09, 20 AMOUNT \$2.58 R2305K132237-06 UNITED STATES POSTAL SERVICE 0000			
USPS® Tracking Number Firm-Specific Identifier		Address (Name, Street, City, State, and ZIP Code™)		Postage	Fee	Special Handling	Parcel Airlift
1.		Tyrell Doyle Alan Watkins 75 Woodland St. Simsbury, CT 06070					
2.		Walter E and Dianna S Anderson 10 Hazelmeadow Pl. Simsbury, CT 06070					
3.		Walter Edwin and Dianna S Anderson 10 Hazelmeadow Pl. Simsbury, CT 06070					
4.		Wanda G Kelly Trustee 88 Pepperidge Rd Portland, CT 06480					
5.		Weatogue Court LLC 21 Musket Trail Simsbury, CT 06070					
6.		Wilfred J Reil III 128 Wiggins Farm Dr. Simsbury, CT 06070					



Certificate of Mailing — Firm

Name and Address of Sender		TOTAL NO. of Pieces Listed by Sender	TOTAL NO. of Pieces Received at Post Office™	U.S. POSTAGE PAID WESTERLY, RI 02891 DEC 09, 20 AMOUNT \$2.58 R2305K132237-06		
Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		6	6	0000		
Postmaster, per (name of receiving employee)		BOW				
USPS® Tracking Number Firm-Specific Identifier	Address (Name, Street, City, State, and ZIP Code™)	Postage	Fee	Special Handling	Parcel Airlift	
1.	Thomas and Laura Nigro 4 Kilbourn Farms Ln. Simsbury, CT 06070					
2.	Thomas B and Emily H Vincent 2 Woods Ln Simsbury, CT 06070					
3.	Timothy M and Doreen K Gasaatura 7 Cody St. West Hartford, CT 06110					
4.	Town of Simsbury P O Box 495 Simsbury, CT 06070					
5.	Town of Simsbury 933 Hopmeadow St. Simsbury, CT 06070					
6.	Town of Simsbury (Sewer Treatment Plant) 36 Drake Hill Rd. Simsbury, CT 06070					



Certificate of Mailing — Firm

Name and Address of Sender		TOTAL NO. of Pieces Listed by Sender	TOTAL NO. of Pieces Received at Post Office™	Affix Stamp Here Postmark with Date of Receipt.	
Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		6	6	 U.S. POSTAGE PAID WESTERLY, RI 02881 DEC 08 20 AMOUNT \$2.58 R2305K132237-06	0000
USPS® Tracking Number Firm-specific Identifier		Address (Name, Street, City, State, and ZIP Code™)			
1.		Suzanne R Walczar PO Box 865 Rockport, ME 04856			
2.		Suzanne V Sabia Trustee 1 West St. Unit 207 Simsbury, CT 06070			
3.		Teresa M Carr 8 Tamarack Ln. Simsbury, CT 06070			
4.		Teresa Rodriguez 609 Hopmeadow St. Simsbury, CT 06070			
5.		The John Hughes Trust c/o Midwest Trust Company Trustee 5901 College Blvd, Site 100 Overland Park, KS 66211			
6.		Thomas A and Laura Nigro 4 Kilbourn Farms Ln. Simsbury, CT 06070			



Certificate of Mailing — Firm

Name and Address of Sender		TOTAL NO. of Pieces Listed by Sender		TOTAL NO. of Pieces Received at Post Office™		Affix Stamp Here Postmark with Date of Receipt	
Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		6		6		U.S. POSTAGE PAID WESTERLY, RI 02891 DEC 09, 20 AMOUNT \$2.58 R2305K132237-06	
Postmaster, per (name of receiving employee)		Bev				0000	
USPS® Tracking Number	Firm-specific Identifier	Address (Name, Street, City, State, and ZIP Code™)		Postage	Fee	Special Handling	Parcel Airlift
1.		Solctran LLC 29 Notch Rd. West Simsbury, CT 06092					
2.		Stacey Brooks 10D Wiggins Farm Dr. Simsbury, CT 06070					
3.		Stephen P and Frances A Mason 80 Highwood Dr. Avon, CT 06001					
4.		Streinz Family LLC 346 Town Hill Rd. New Hartford, CT 06057					
5.		Susan D Andrus 109 Hopmeadow St. Weatogue, CT 06089					
6.		Susan D Quirk 10F Wiggins Farm Dr. Simsbury, CT 06070					



Certificate of Mailing — Firm

Name and Address of Sender Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		TOTAL NO. of Pieces Listed by Sender 6		TOTAL NO. of Pieces Received at Post Office™ 6		Affix Stamp Here U.S. POSTAGE PAID WESTERLY, RI 02891 DEC 08 20 AMOUNT \$2.58 R2305K132237-06 UNITED STATES POSTAL SERVICE® 0000					
USPS® Tracking Number Firm-specific Identifier		Address (Name, Street, City, State, and ZIP Code™)		Postage		Fee		Special Handling		Parcel Airlift	
1.		Shella S and Robert Mooney 15H Wiggins Farm Dr. Simsbury, CT 06070									
2.		Shelly Norriatko 26 Bushy Hill Rd. Simsbury, CT 06070									
3.		Simsbury Hopmeadow Street LLC 2795 E Cottonwood PY#500 Salt Lake City, UT 84121									
4.		Simsbury Hopmeadow Street LLC 2795 E Cottonwood PY#500 Salt Lake City, UT 84121-5695									
5.		Simsmore Square 540 LLC 540 Hopmeadow St. Simsbury, CT 06070									
6.		Simsmore Square Enterprises LLC 540 Hopmeadow St. Simsbury, CT 06070									



Certificate of Mailing — Firm

Name and Address of Sender		TOTAL NO. of Pieces Listed by Sender		TOTAL NO. of Pieces Received at Post Office™		Affix Stamp Here Postmark with Date of Receipt					
Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		6		6		U.S. POSTAGE PAID WESTERLY, RI 02891 DEC 09 20 AMOUNT \$2.58 R2305K132237-06 0000					
USPS® Tracking Number Firm-specific Identifier		Address (Name, Street, City, State, and ZIP Code™)		Postage		Fee		Special Handling		Parcel Airlift	
1.		Sandra Orluk 1 West St. Unit 103 Simsbury, CT 06070									
2.		Sara Jackson Batchelder Trustee 10 Mathers Crossing Simsbury, CT 06070									
3.		Sarah E Jones 81 Woodland St. Simsbury, CT 06070									
4.		SB Meadow LLC 1 West St. Unit 317 Simsbury, CT 06070									
5.		Seabury at Powder Forest LLC 200 Seabury Dr. Bloomfield, CT 06002									
6.		Seung Jae and Ivory Julianne Baek 37 Woodland St. Simsbury, CT 06070									



Certificate of Mailing — Firm

Name and Address of Sender Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		TOTAL NO. of Pieces Listed by Sender 6	TOTAL NO. of Pieces Received at Post Office™ 6	Affix Stamp Here <i>Postmark with Date of Receipt</i>			
Postmaster, per (name of receiving employee) BAV		U.S. POSTAGE PAID WESTERLY, RI 02891 DEC 09, 20 AMOUNT \$2.58 R2305K132237-06			0000		
USPS® Tracking Number Firm-specific Identifier		Address (Name, Street, City, State, and ZIP Code™)		Postage	Fee	Special Handling	Parcel Airlift
1.		Ronald B and Dolores P Gutfran 6 Chestnut Hill Rd. West Simsbury, CT 06092					
2.		Rosemary E Lemke Co-Trustee and Joseph M Lemke Co-Trustee 1 West St. Unit 213 Simsbury, CT 06070					
3.		Roy A and Lisa M Blixt 1 West St. Unit 106 Simsbury, CT 06070					
4.		Ruth S. Edwards 10E Wiggins Farm Dr. Simsbury, CT 06070					
5.		Sandra Bourke and Marshall Epstein (TC) 26 East Weatogue St. Simsbury, CT 06070					
6.		Sandra F Garcia 641 Hopmeadow St. Simsbury, CT 06070					



Certificate of Mailing — Firm

Name and Address of Sender		TOTAL NO. of Pieces Listed by Sender		TOTAL NO. of Pieces Received at Post Office™		Affix Stamp Here Postmark with Date of Receipt					
Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		6		6		U.S. POSTAGE PAID WESTERLY, RI 02881 DEC 08 20 AMOUNT \$2.58 R2305K132237-06					
Postmaster, per (name of receiving employee)		BGN				0000					
USPS® Tracking Number Firm-specific Identifier		Address (Name, Street, City, State, and ZIP Code™)		Postage		Fee		Special Handling		Parcel Airlift	
1.		Robert G Gaucher and Gary Palatnick 14 White Oak Ln. Simsbury, CT 06070									
2.		Robert J Bonetti 30 Ridge Rd. Granby, CT 06035									
3.		Robert K and Barbara M Griffin Trustees 1 West St. Unit 319 Simsbury, CT 06070									
4.		Robert W and Margaret Ann H Bamberg Co-Trustees 1 West St. Unit 219 Simsbury, CT 06070									
5.		Robert K Gran 17C Wiggins Farm Dr. Simsbury, CT 06070									
6.		Rodger Coyne Trustee 5 Highview Rd Simsbury, CT 06070									



Certificate of Mailing — Firm

Name and Address of Sender Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		TOTAL NO. of Pieces Listed by Sender 6		TOTAL NO. of Pieces Received at Post Office™ 6		Affix Stamp Here Postmark with Date of Receipt.					
Postmaster, per (name of receiving employee) BAJ		U.S. POSTAGE PAID WESTERLY, RI 02891-20 DEC 08 20 AMOUNT \$2.50 R2305K132237-06									
USPS® Tracking Number Firm-specific Identifier		Address (Name, Street, City, State, and ZIP Code™)		Postage		Fee		Special Handling		Parcel Airift	
1.		Renette Taylor-Ense 10A Wiggins Farm Dr. Simsbury, CT 06070									
2.		Richard F Ahles 1 West St. Unit 222 Simsbury, CT 06070									
3.		Richard J and Judy L Kaiser 1 West St. Unit 202 Simsbury, CT 06070									
4.		Richard P Brainerd Trustee 33 Riverside Rd. Simsbury, CT 06070									
5.		Robert A Duccini 14G Wiggins Farm Dr. Simsbury, CT 06070									
6.		Robert A Poutasse and Nancy Myerson 29 Riverside Rd. Simsbury, CT 06070									



Certificate of Mailing — Firm

Name and Address of Sender		TOTAL NO. of Pieces Listed by Sender	TOTAL NO. of Pieces Received at Post Office™	Affix Stamp Here Postmark with Date of Receipt		
Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		6	6	U.S. POSTAGE PAID WESTERLY, RI 02891 DEC 09, 20 AMOUNT \$2.58 R2305K132237-06 0000		
USPS® Tracking Number Firm-specific Identifier		Postmaster, per (name of receiving employee)				
		Address (Name, Street, City, State, and ZIP Code™)	Postage	Fee	Special Handling	Parcel Airlift
1.		Pradyumn Anirudha 12F Wiggins Farm Dr. Simsbury, CT 06070				
2.		Rajasekhar Balakrishnan 14E Wiggins Farm Dr. Simsbury, CT 06070				
3.		Regina K Nelson Trustee 1 West St. #118 Simsbury, CT 06070				
4.		Reginald E & Jane M Zurinkas 1 West St. Unit 102 Simsbury, CT 06070				
5.		Renata and Gregory Hayes 1 West St. Unit 110 Simsbury, CT 06070				
6.		Renee D Millas and Suzanne C Brannack and Marlene M Ruel 4 Great Meadow West Simsbury, CT 06092				



Certificate of Mailing — Firm

Name and Address of Sender		TOTAL NO. of Pieces Listed by Sender		TOTAL NO. of Pieces Received at Post Office™		Affix Stamp Here Postmark with Date of Receipt					
Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		6		6		U.S. POSTAGE PAID WESTERLY, RI 02891 DEC 09 20 AMOUNT \$2.58 R2305K132237-06 0000					
USPS® Tracking Number Firm-specific Identifier		Address (Name, Street, City, State, and ZIP Code™)		Postage		Fee		Special Handling		Parcel Airlift	
1.		Patricia L Eden (LU), Richard A Eden and Laura J Eden Kimble Trustees 1 West St. #124 Simsbury, CT 06070									
2.		Paul E Roberts 28 Woodland St. Simsbury, CT 06070									
3.		Peter J and Catherine Decoteau 44 Woodland St. Simsbury, CT 06070									
4.		Peter J Jenkelunas Sr 6 Riverview Cir. Simsbury, CT 06070									
5.		Pine Hill Home Owners Assoc Inc. P O Box 111 Weatogue, CT 06089									
6.		Powder Forest Homes Association Inc 111 Roberts St, Suite G-1 East Hartford, CT 06108									



UNITED STATES
POSTAL SERVICE®

Certificate of Mailing — Firm

Name and Address of Sender Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		TOTAL NO. of Pieces Listed by Sender 6	TOTAL NO. of Pieces Received at Post Office™ 6	Affix Stamp Here Postmark with Date of Receipt U.S. POSTAGE PAID WESTERLY, RI 02891 DEC 09, 20 AMOUNT \$2.58 R2308K132237-06 UNITED STATES POSTAL SERVICE® 0000			
USPS® Tracking Number Firm-specific Identifier		Address (Name, Street, City, State, and ZIP Code™)		Postage	Fee	Special Handling	Parcel Airift
1. _____		Ora Weiner Trustee 1 West St. Unit 112 Simsbury, CT 06070					
2. _____		P R Properties 625 Hopmeadow St. Simsbury, CT 06070					
3. _____		Pamela J Simmons 2 Riverview Cir. Simsbury, CT 06070					
4. _____		Patricia A Clifford 1 West St. Unit 215 Simsbury, CT 06070					
5. _____		Patricia A Hogard c/o Tricia Spence, Fiduciary 32 Heather Ln North Granby, CT 06060					
6. _____		Patricia A Scanlon 1 West St. Unit 322 Simsbury, CT 06070					



Certificate of Mailing — Firm

Name and Address of Sender		TOTAL NO. of Pieces Listed by Sender	TOTAL NO. of Pieces Received at Post Office™	Affix Stamp Here Postmark with Date of Receipt.	
Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		6	6	U.S. POSTAGE PAID WESTERLY, RI 02991-20 DEC 08 AMOUNT \$2.58 R2305K132237-06 0000	
USPS® Tracking Number Firm-specific Identifier	Address (Name, Street, City, State, and ZIP Code™)	Postage	Fee	Special Handling	Parcel AirLift
1.	Michael R Jennings 12E Wiggins Farm Dr. Simsbury, CT 06070				
2.	Michelle L Perrault 12C Wiggins Farm Dr. Simsbury, CT 06070				
3.	Nancy B. Delucia 15E Wiggins Farm Dr. Simsbury, CT 06070				
4.	Nancy C Ford 4 Billingsgate Dr. Simsbury, CT 06070				
5.	Nicole C Cloutier and Christopher W Collins 11 Mathers Crossing Simsbury, CT 06070				
6.	Odette M Conley 1 West St. Unit 123 Simsbury, CT 06070				



Certificate of Mailing — Firm

Name and Address of Sender Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		TOTAL NO. of Pieces Listed by Sender 6	TOTAL NO. of Pieces Received at Post Office™ 6	Affix Stamp Here <i>Postmark with Date of Receipt.</i>			
Postmaster, per (name of receiving employee) BEV		U.S. POSTAGE PAID WESTERLY, RI 02891 DEC 09, 20 AMOUNT \$2.58 R2305K132237-06					
USPS® Tracking Number Firm-specific Identifier		Address (Name, Street, City, State, and ZIP Code™)		Postage	Fee	Special Handling	Parcel Airlift
1.		Marilyn G King 1 West St. Unit 208 Simsbury, CT 06070					
2.		Matthew F and Josephine Schoenhardt 61 Westledge Rd. Simsbury, CT 06070					
3.		Matthew T Grande and Elizabeth Shine 605 Hopmeadow St. Simsbury, CT 06070					
4.		Michael A Pompa 12 Mathers Crossing Simsbury, CT 06070					
5.		Michael and Richard Kahn (TC) 3 Mathers Crossing Simsbury, CT 06070					
6.		Michael C and Catherine N Bruno 12H Wiggins Farm Dr. Simsbury, CT 06070					



Certificate of Mailing — Firm

Name and Address of Sender		TOTAL NO. of Pieces Listed by Sender		TOTAL NO. of Pieces Received at Post Office™		Affix Stamp Here Postmark with Date of Receipt.	
Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		6		6		U.S. POSTAGE PAID WESTERLY, RI 02891 DEC 08, 20 AMOUNT \$2.58 R2305K132237-06 0000	
USPS® Tracking Number Firm-specific Identifier		Address (Name, Street, City, State, and ZIP Code™)		Postage	Fee	Special Handling	Parcel Airlift
1.		Marie A Thompson - LU and Bradley A and Brian A Thompson 1 West St. Unit 120 Simsbury, CT 06070					
2.		Marion Christopoulos 14A Wiggins Farm Dr. Simsbury, CT 06070					
3.		Marion T and Addison G Ricker 6 Ascot Ln Old Lyme, CT 06371					
4.		Mark A and Carrie A Greene 8 Mathers Crossing Simsbury, CT 06070					
5.		Martha J Hickey 7 Mathers Crossing Simsbury, CT 06070					
6.		Mary J Clark 15B Wiggins Farm Dr. Simsbury, CT 06070					



Certificate of Mailing — Firm

Name and Address of Sender Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		TOTAL NO. of Pieces Listed by Sender 6		TOTAL NO. of Pieces Received at Post Office™ 6		Affix Stamp Here Postmark with Date of Receipt.					
		Postmaster, per (name of receiving employee) BEV		U.S. POSTAGE PAID WESTERLY, RI 02891 DEC 09, 20 AMOUNT \$2.58 R2305K132237-06							
USPS Tracking Number Firm-specific Identifier		Address (Name, Street, City, State, and ZIP Code™)		Postage		Fee		Special Handling		Parcel Airlift	
1.		Lubor and Andrea Stonawski 17A Wiggins Farm Dr. Simsbury, CT 06070									
2.		Lucinda C Ash 96 Wright Rd Canton, CT 06019									
3.		Lynn Ferris Pollack Trustee 7 Saddle Xing Avon, CT 06001									
4.		Margaret B and Raymond J Higgs 2 Gargan Pl. Simsbury, CT 06070									
5.		Margaret J Swanson 635 Hopmeadow St. Simsbury, CT 06070									
6.		Maria Giesey PO Box 905 Avon, CT 06001									



Certificate of Mailing — Firm

Name and Address of Sender		TOTAL NO. of Pieces Listed by Sender		TOTAL NO. of Pieces Received at Post Office™		Affix Stamp Here Postmark with Date of Receipt	
Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		6		6		U.S. POSTAGE PAID WESTERLY, RI 02891-20 DEC 09, 20 AMOUNT \$2.58 R2305K132237-06	
Postmaster, per (name of receiving employee)		PAV				0000	
USPS® Tracking Number Firm-specific Identifier	Address (Name, Street, City, State, and ZIP Code™)	Postage	Fee	Special Handling	Parcel Airlift		
1.	Lee J Wilder 5 Tamarack Ln. Simsbury, CT 06070						
2.	Leslie Mazur 19H Wiggins Farm Dr. Simsbury, CT 06070						
3.	Linda J Hughes 1 West St. #211 Simsbury, CT 06070						
4.	Lisa K Kozlowski 40 Woodland St. Simsbury, CT 06070						
5.	Lisa Schweidt 1 West St. Unit 201 Simsbury, CT 06070						
6.	Louise R Devanna 1 West St. Unit 303 Simsbury, CT 06070						



Certificate of Mailing — Firm

Name and Address of Sender		TOTAL NO. of Pieces Listed by Sender		TOTAL NO. of Pieces Received at Post Office™		Affix Stamp Here Postmark with Date of Receipt.					
Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		6		6		U.S. POSTAGE PAID WESTERLY, RI 02891 DEC 09, 20 AMOUNT \$2.58 R2305K132237-06 0000					
USPS® Tracking Number Firm-specific Identifier		Address (Name, Street, City, State, and ZIP Code™)		Postage		Fee		Special Handling		Parcel Airlift	
1.		Kaylor Real Estate LLC 29 Holcomb St. Simsbury, CT 06070									
2.		Keith & Brianna Appleton 631 Hopmeadow St. Simsbury, CT 06070									
3.		Ken D and Sharon L Lawson Trustees 1 West St. Unit 109 Simsbury, CT 06070									
4.		Kevin McKenna 639 Hopmeadow St. Simsbury, CT 06070									
5.		Larry Atherton 1 West St. Unit 122 Simsbury, CT 06070									
6.		Lauren D Pollack Trustee 7 Saddle Xing Avon, CT 06001									



Certificate of Mailing — Firm

Name and Address of Sender		TOTAL NO. of Pieces Listed by Sender		TOTAL NO. of Pieces Received at Post Office™		Affix Stamp Here Postmark with Date of Receipt.					
Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		6		6		U.S. POSTAGE PAID WESTERLY, RI 02891 DEC 09, 20 AMOUNT \$2.58 R2305K132237-06 0000					
USPS® Tracking Number Firm-specific Identifier		Address (Name, Street, City, State, and ZIP Code™)		Postage		Fee		Special Handling		Parcel Airlift	
1.		Joyce K & Stephen H Weinberg 4207 Warrens Way Wanaque, NJ 07465									
2.		Judith Kaufman 15D Wiggins Farm Dr. Simsbury, CT 06070									
3.		Judith Rubinstein 1 West St. Unit 105 Simsbury, CT 06070									
4.		Kara L Mealey 30 Woodland St. Simsbury, CT 06070									
5.		Karl H and Sarah H Warner 31 Woodland St. Simsbury, CT 06070									
6.		Katherine G Creedon 35 Pine Hill Dr. Simsbury, CT 06070									



Certificate of Mailing — Firm

Name and Address of Sender		TOTAL NO. of Pieces Listed by Sender		TOTAL NO. of Pieces Received at Post Office™		Affix Stamp Here Postmark with Date of Receipt.					
Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		6		6		U.S. POSTAGE PAID WESTERLY, RI 02891 DEC 09 20 AMOUNT \$2.58 R2305K132237-06 0000					
USPS® Tracking Number Firm-specific Identifier		Address (Name, Street, City, State, and ZIP Code™)		Postage		Fee		Special Handling		Parcel Airlift	
1.		Jon J Fearnley and Brigitte Boltz 33 Pine Hill Dr. Simsbury, CT 06070									
2.		Jonathan I Dahlstrom and Jane J Paddock 581 Hopmeadow St. Simsbury, CT 06070									
3.		Joseph & Karen R Hewes 1 West St. Unit 101 Simsbury, CT 06070									
4.		Joseph D Bronzino and Charles E Drummey Trustees 75 Isham Rd Suite 300 Blue Back West Hartford, CT 06107									
5.		Joshua and Sarah E Thayer 19G Wiggins Farm Dr. Simsbury, CT 06070									
6.		Joshua Orbach 10B Wiggins Farm Dr. Simsbury, CT 06070									



Certificate of Mailing — Firm

Name and Address of Sender		TOTAL NO. of Pieces Listed by Sender	TOTAL NO. of Pieces Received at Post Office™	Affix Stamp Here <i>Postmark with Date of Receipt.</i>		
Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		6	6	U.S. POSTAGE PAID WESTERLY, RI 02891 DEC 09 20 AMOUNT \$2.58 R2305K132237-06 0000		
USPS® Tracking Number Firm-specific Identifier	Address (Name, Street, City, State, and ZIP Code™)	Postage	Fee	Special Handling	Parcel Airlift	
1.	John J Kliska 1 West St. Unit 210 Simsbury, CT 06070					
2.	John K Miller 2 Tamarack Ln. Simsbury, CT 06070					
3.	John P Moynihan Jr 643 Hopmeadow St. Simsbury, CT 06070					
4.	John R Cronin 577 Hopmeadow St. Simsbury, CT 06070					
5.	John S Disbrow 4 Tamarack Ln. Simsbury, CT 06070					
6.	John T and Kenneth Letson 49 Longview Dr. Simsbury, CT 06070					



Certificate of Mailing — Firm

Name and Address of Sender		TOTAL NO. of Pieces Listed by Sender		TOTAL NO. of Pieces Received at Post Office™		Affix Stamp Here Postmark with Date of Receipt.	
Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		6		6		U.S. POSTAGE PAID WESTERLY, RI 02891 DEC 09, 20 AMOUNT \$2.58 R2305K132237-06 0000	
USPS® Tracking Number Firm-specific Identifier		Address (Name, Street, City, State, and ZIP Code™)		Postage	Fee	Special Handling	Parcel Airift
1.		Jeanine L and Nord E Christensen 35 West Mountain Rd. West Simsbury, CT 06092					
2.		Jeffrey T and Mary C Lent 36 Woodland St. Simsbury, CT 06070					
3.		Jessica Vastano 4 Mathers Crossing Simsbury, CT 06070					
4.		JGH Associates LLC and 573B Hopmeadow Street P O Box 95 Simsbury, CT 06070					
5.		Joann S Carvlin (LU), Stephanie M and Mark J Carvlin (TC) 1 West St. Unit 214 Simsbury, CT 06070					
6.		Joanne Dombrosky 4 Glen Hollow West Simsbury, CT 06092					



Certificate of Mailing — Firm

Name and Address of Sender		TOTAL NO. of Pieces Listed by Sender		TOTAL NO. of Pieces Received at Post Office™		Affix Stamp Here Postmark with Date of Receipt.					
Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		6		6		U.S. POSTAGE PAID WESTERLY, RI 02891 DEC 09, 20 AMOUNT \$2.58 R2305K132237-06 0000					
USPS® Tracking Number Firm-specific Identifier		Address (Name, Street, City, State, and ZIP Code™)		Postage		Fee		Special Handling		Parcel Airlift	
1.		Jane E and Richard H Bason Trustees 1 West St. Unit 212 Simsbury, CT 06070									
2.		Janice A Hughes 1 West St. #308 Simsbury, CT 06070									
3.		Janis Burnham 4 Riverview Cir. Simsbury, CT 06070									
4.		Jaymac LLC 542 Hopmeadow St., PMB138 Simsbury, CT 06070									
5.		Jean D Laskey 1 West St. #205 Simsbury, CT 06070									
6.		Jean M Soricich 19F Wiggins Farm Dr. Simsbury, CT 06070									



Certificate of Mailing — Firm

Name and Address of Sender		TOTAL NO. of Pieces Listed by Sender	TOTAL NO. of Pieces Received at Post Office™	Affix Stamp Here <i>Postmark with Date of Receipt.</i>			
Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		4	6	U.S. POSTAGE PAID WESTERLY, RI 02891 DEC 09, 20 AMOUNT \$2.58 R2305K132237-06 0000			
USPS® Tracking Number Firm-specific Identifier		Address (Name, Street, City, State, and ZIP Code™)		Postage	Fee	Special Handling	Parcel Airlift
1.		Helen Bernadine Becker Trustee 1 West St. Unit 209 Simsbury, CT 06070					
2.		Howard R Ebert Jr and Michelle M Kapanka 595 Hopmeadow St. Simsbury, CT 06070					
3.		Incy S Muir 33 Loveland Rd. North Granby, CT 06060					
4.		James A Rutt, Trustee, c/o Daniel J Rutt 15G Wiggins Farm Dr. Simsbury, CT 06070					
5.		James N and Rita M Bagnall 1 West St. #315 Simsbury, CT 06070					
6.		Jamie and Adam Cohen 2 Hazelmeadow Pl. Simsbury, CT 06070					



Certificate of Mailing — Firm

Name and Address of Sender Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		TOTAL NO. of Pieces Listed by Sender 6	TOTAL NO. of Pieces Received at Post Office™ 6	Affix Stamp Here <i>Postmark with Date of Receipt.</i>			
Postmaster, per (name of receiving employee) 362		U.S. POSTAGE PAID WESTERLY, RI 02891 DEC 09, 20 AMOUNT \$2.58 R2305K132237-06			0000		
USPS® Tracking Number Firm-specific Identifier		Address (Name, Street, City, State, and ZIP Code™)		Postage	Fee	Special Handling	Parcel Airlift
1.		Gilbert Parmele 1 West St. Unit 108 Simsbury, CT 06070					
2.		Gloria M Carbillo 1 West St. Unit 107 Simsbury, CT 06070					
3.		Grist Mill Partners LLC 28 Tower Ln., Suite 100 Avon, CT 06001					
4.		Harolyn J Erickson 3 Hazelmeadow Pl. Simsbury, CT 06070					
5.		Hazelmeadow LLC PO Box 491 Simsbury, CT 06070					
6.		Heather Parker 14 Cedar Hill Rd. West Simsbury, CT 06092					



Certificate of Mailing — Firm

Name and Address of Sender Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		TOTAL NO. of Pieces Listed by Sender 6	TOTAL NO. of Pieces Received at Post Office™ 6	Affix Stamp Here Postmark with Date of Receipt. U.S. POSTAGE PAID WESTERLY, RI 02891 DEC 09 20 AMOUNT \$2.58 R2305K132237-06 UNITED STATES POSTAL SERVICE 0000	
USPS® Tracking Number Firm-specific Identifier	Address (Name, Street, City, State, and ZIP Code™)	Postage	Fee	Special Handling	Parcel Airift
1.	Francis J Kelly Jr 1 West St. Unit 311 Simsbury, CT 06070				
2.	Francis J Salls 20 Hazelmeadow Pl. Simsbury, CT 06070				
3.	Gary A Bohner Jr and Hazelmeadow LLC PO Box 491 Simsbury, CT 06070				
4.	Gary S and Elizabeth J T Berman 6 Gargan Pl. Simsbury, CT 06070				
5.	George D and Jeannette M VanWormer 1 West St. Unit 307 Simsbury, CT 06070				
6.	Gertrude Conroy 1 West St. #304 Simsbury, CT 06070				



Certificate of Mailing — Firm

Name and Address of Sender		TOTAL NO. of Places Listed by Sender		TOTAL NO. of Places Received at Post Office™		Affix Stamp Here Postmark with Date of Receipt.					
Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		<i>b</i>		<i>6</i>		U.S. POSTAGE PAID WESTERLY, RI 02881 DEC 09 20 AMOUNT \$2.58 R2305K132237-06 0000					
USPS® Tracking Number Firm-specific Identifier		Address (Name, Street, City, State, and ZIP Code™)		Postage		Special Handling		Fee		Parcel Airlift	
1.		Ensign-Bickford Realty Corporation P O Box 711 Simsbury, CT 06070-0711									
2.		Eric W and Michelle M Chase 637 Hopmeadow St. Simsbury, CT 06070									
3.		Est of Frank E Walton and Betty S Walton (TC) 1 West St. Unit 204 Simsbury, CT 06070									
4.		Est of Veronica A Tarca, c/o Caroline M Tarca - Fiduciary 236 Westford Rd. Eastford, CT 06242									
5.		First Church of Christ and The Ecclesiastical Society of Simsbury Inc. 689 Hopmeadow St. Simsbury, CT 06070-2281									
6.		Frances J Gauthier (LU) & Debra A Grasfield et al Trustees 19J Wiggins Farm Dr. Simsbury, CT 06070									



Certificate of Mailing — Firm

Name and Address of Sender		TOTAL NO. of Pieces Listed by Sender	TOTAL NO. of Pieces Received at Post Office™	Affix Stamp Here Postmark with Date of Receipt.			
Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		6	6	U.S. POSTAGE PAID WESTERLY, RI 02891 DEC 09 20 AMOUNT \$2.58 R2305K132237-06 0000			
USPS® Tracking Number Firm-specific Identifier		Address (Name, Street, City, State, and ZIP Code™)		Postage	Fee	Special Handling	Parcel Airlift
1.		Eileen P Twigg 1 West St. Unit 220 Simsbury, CT 06070					
2.		Eleanor L Calabretta 12G Wiggins Farm Dr. Simsbury, CT 06070					
3.		Elizabeth G Dalnegro 14D Wiggins Farm Dr. Simsbury, CT 06070					
4.		Emily and Eliza Breno 14H Wiggins Farm Dr. Simsbury, CT 06070					
5.		Emily Dahmer Walsh 5 Hazelmeadow Pl. Simsbury, CT 06070					
6.		Ensign-Bickford Realty Corporation P O Box 711 Simsbury, CT 06070					



Certificate of Mailing — Firm

Name and Address of Sender		TOTAL NO. of Pieces Listed by Sender	TOTAL NO. of Pieces Received at Post Office™	Affix Stamp Here <i>Postmark with Date of Receipt.</i>			
Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		6	6	U.S. POSTAGE PAID WESTERLY, RI 02891 DEC 08, 20 AMOUNT \$2.58 R2305K132237-06 0000			
USPS® Tracking Number Firm-specific Identifier				Postage	Fee	Special Handling	Parcel Airlift
1. _____							
Dennis M Farrell 15C Wiggins Farm Dr. Simsbury, CT 06070							
2. _____							
Donald R and Gail-Gene Mercey 576 Hopmeadow St. Simsbury, CT 06070							
3. _____							
Donald T Zaylor 1 West St. Unit 313 Simsbury, CT 06070							
4. _____							
ECAC Associates LLC P O Box 95 Simsbury, CT 06070							
5. _____							
Edna M Forbes 7 Tamarack Ln. Simsbury, CT 06070							
6. _____							
Edward J Sansone 193 West Granby Rd. Granby, CT 06035							



Certificate of Mailing — Firm

Name and Address of Sender Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		TOTAL NO. of Pieces Listed by Sender 6	TOTAL NO. of Pieces Received at Post Office™ 6	Affix Stamp Here Postmark with Date of Receipt.			
Postmaster, per (name of receiving employee) BKV		U.S. POSTAGE PAID WESTERLY, RI 02891 DEC 09, 20 AMOUNT \$2.58 R2305K132237-06			0000		
USPS® Tracking Number Firm-specific Identifier		Address (Name, Street, City, State, and ZIP Code™)		Postage	Fee	Special Handling	Parcel Airlift
1.		Deborah L Martin 284 Main St., Suite 490 Wilton, ME 04294					
2.		Deborah L McDonald 3 Riverview Cir. Simsbury, CT 06070					
3.		Deborah McDonald 5 Riverview Cir. Simsbury, CT 06070					
4.		Deborah R Mason 29 Drake Hill Rd. Simsbury, CT 06070					
5.		Debra A McDermott 26 Woodland St. Simsbury, CT 06070					
6.		Dennis and Mauren Williams 37 Pine Hill Dr. Simsbury, CT 06070					



Certificate of Mailing — Firm

Name and Address of Sender		TOTAL NO. of Pieces Listed by Sender		TOTAL NO. of Pieces Received at Post Office™		Affix Stamp Here Postmark with Date of Receipt					
Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		6		6		U.S. POSTAGE PAID WESTERLY, RI 02891-20 DEC 09 AMOUNT \$2.58 R2305K132237-06 0000					
USPS® Tracking Number Firm-specific Identifier		Address (Name, Street, City, State, and ZIP Code™)		Postage		Fee		Special Handling		Parcel Airlift	
1.		David Litchfield PO Box 553 Simsbury, CT 06070									
2.		David N and Judith R Wiley 1 West St. Unit 104 Simsbury, CT 06070									
3.		David Pariseault 1 Riverview Cir. Simsbury, CT 06070									
4.		David Pettyjohn 19D Wiggins Farm Dr. Simsbury, CT 06070									
5.		David W and Pamela S Carter 35 Riverside Rd. Simsbury, CT 06070									
6.		Deborah H Spillane 9 Mathers Crossing Simsbury, CT 06070									



Certificate of Mailing — Firm

Name and Address of Sender		TOTAL NO. of Pieces Listed by Sender	TOTAL NO. of Pieces Received at Post Office™	Affix Stamp Here Postmark with Date of Receipt					
Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		6	6	VERIFIED DEC 9 2017 U.S. POSTAGE PAID WESTERLY, RI R2305K132237-06					
Postmaster, per (name of receiving employee)									
USPS® Tracking Number		Address		Postage			Fee	Special Handling	Parcel Airlift
Firm-specific Identifier		(Name, Street, City, State, and ZIP Code™)							
1.		Connecticut Light and Power P O Box 270 Hartford, CT 06141-0270							
2.		Corey Somerville 8 Gargan Pl. Simsbury, CT 06070							
3.		Daniel S Fabricant 10C Wiggins Farm Dr. Simsbury, CT 06070							
4.		David D and Maryellen Bailey 39 Pine Hill Dr. Simsbury, CT 06070							
5.		David E and Mina M Bullock 1 West St. Unit 314 Simsbury, CT 06070							
6.		David G. Shtromberg & Marina Lumelsky 14B Wiggling Farm Dr. Simsbury, CT 06070							



Certificate of Mailing — Firm

Name and Address of Sender Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		TOTAL NO. of Pieces Listed by Sender 6	TOTAL NO. of Pieces Received at Post Office™ 6	Affix Stamp Here <i>Postmark with Date of Receipt.</i>			
Postmaster, per (name of receiving employee) DEJ		U.S. POSTAGE PAID WESTERLY, RI 02881 DEC 08, 20 AMOUNT \$2.58 R2305K132237-06			0000		
USPS® Tracking Number Firm-specific Identifier		Address (Name, Street, City, State, and ZIP Code™)		Postage	Fee	Special Handling	Parcel Airlift
1.		Carol A McKenzie 1 Mathers Crossing Simsbury, CT 06070					
2.		Carol E Hurlbut 2 Mathers Crossing Simsbury, CT 06070					
3.		Carson Way LLC 76 West St. Simsbury, CT 06070					
4.		Casamira LLC 573A Hopmeadow St. Simsbury, CT 06070					
5.		Charles F and Patricia A Scanlon 5 Mathers Crossing Simsbury, CT 06070					
6.		Chen and Gao Realty LLC 19 Vining Dr. Simsbury, CT 06070					



Certificate of Mailing — Firm

Name and Address of Sender		TOTAL NO. of Pieces Listed by Sender		TOTAL NO. of Pieces Received at Post Office™		Affix Stamp Here Postmark with Date of Receipt			
USPS® Tracking Number Firm-specific Identifier		Address (Name, Street, City, State, and ZIP Code™)		Postage	Fee	Special Handling	Parcel Airlift		
1. Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		BMG Properties LLC 857 New Britain Ave. Farmington, CT 06032							
2. BMS Holdings LLC 583 Hopmeadow St. Simsbury, CT 06070									
3. Brookside Residence LLC 33 Riverside Rd. Simsbury, CT 06070									
4. Bruce R Jachym 1 Tamarack Ln. Simsbury, CT 06070									
5. BW Mill Commons LLC & Beachwold Residential LLC 314 Flanders Rd., Suite 2D East Lyme, CT 06333									
6. Carmelle Dwyer 19A Wiggins Farm Dr. Simsbury, CT 06070									

U.S. POSTAGE PAID
WESTERLY, RI
02891
DEC 09 20
AMOUNT
\$2.58
R2305K132237-06



0000



Certificate of Mailing — Firm

Name and Address of Sender		TOTAL NO. of Pieces Listed by Sender	TOTAL NO. of Pieces Received at Post Office™	Affix Stamp Here <i>Postmark with Date of Receipt.</i>		
Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		6	6		U.S. POSTAGE PAID WESTERLY, RI 02891 DEC 09 20 AMOUNT \$2.58 R2305K132237-06	0000
USPS® Tracking Number Firm-specific Identifier		Address (Name, Street, City, State, and ZIP Code™)				
1.		Anna Grupp 10H Wiggins Farm Dr. Simsbury, CT 06070				
2.		Asian Relish LLC 570 Hopmeadow St. Simsbury, CT 06070				
3.		Ayesha Dewan 14C Wiggins Farm Dr. Simsbury, CT 06070				
4.		Benjamin Woodhouse and Olivia McDonald 603 Hopmeadow St. Simsbury, CT 06070				
5.		Beverley H Inman 14J Wiggins Farm Dr. Simsbury, CT 06070				
6.		Beverly Longo 1 West St. Unit 119 Simsbury, CT 06070				



Certificate of Mailing — Firm

Name and Address of Sender Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		TOTAL NO. of Pieces Listed by Sender 6	TOTAL NO. of Pieces Received at Post Office™ 6	Affix Stamp Here <i>Postmark with Date of Receipt</i>  U.S. POSTAGE PAID WESTERLY, RI 02891 DEC 09, 20 AMOUNT \$2.58 R2305K132237-06 0000			
USPS® Tracking Number Firm-specific Identifier		Address (Name, Street, City, State, and ZIP Code™)		Postage	Fee	Special Handling	Parcel Airfltt
1.		Andres and Diane Child 10G Wiggins Farm Dr. Simsbury, CT 06070					
2.		Angel Wu 12D Wiggins Farm Dr. Simsbury, CT 06070					
3.		Anita L Mielert Trustee 1 West St. Unit 216 Simsbury, CT 06070					
4.		Ann C McDonald 3 Tamarack Ln. Simsbury, CT 06070					
5.		Ann D Prowda 15A Wiggins Farm Dr. Simsbury, CT 06070					
6.		Ann W and Anton H Brockelman Trustees 1802 Pine Glade Cir Ft Myers, FL 33907					



Certificate of Mailing — Firm

Name and Address of Sender		TOTAL NO. of Pieces Listed by Sender		TOTAL NO. of Pieces Received at Post Office™		Affix Stamp Here Postmark with Date of Receipt					
Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		6		6		U.S. POSTAGE PAID WESTERLY, RI 02891-0200 DEC 09, 20 AMOUNT \$2.58 R2305K132237-06 0000					
USPS® Tracking Number Firm-specific Identifier		Address (Name, Street, City, State, and ZIP Code™)		Postage		Fee		Special Handling		Parcel Airlift	
1.		275 Powder Forest LLC 75 West St Simsbury, CT 06070									
2.		Acorn Rentals 40 Pilfershire Rd. West Simsbury, CT 06092									
3.		Albee M Korn Trustee, Albee M Korn Rev Tr 1 West St. Unit 111 Simsbury, CT 06070									
4.		Albert Monet 15E Wiggins Farm Dr. Simsbury, CT 06070									
5.		Alfonso Rizo-Patron 1 West St. Unit 121 Simsbury, CT 06070									
6.		Andrea Dennis-Lavigne 1 West St. Unit 221 Simsbury, CT 06070									



Certificate of Mailing — Firm

Name and Address of Sender Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		TOTAL NO. of Pieces Listed by Sender 3	TOTAL NO. of Pieces Received at Post Office™ 3	Affix Stamp Here Postmark with Date of Receipt. U.S. POSTAGE PAID WESTERLY, RI 02891 DEC 09 20 AMOUNT \$1.29 R2305K132237-06 0000			
USPS® Tracking Number Firm-specific Identifier		Address (Name, Street, City, State, and ZIP Code™)		Postage	Fee	Special Handling	Parcel Airlift
1.		William R. Rice, Chair Planning Commission 933 Hopmeadow St. Simsbury, CT 06070					
2.		Margery C.B. Winters, Chair Conservation Commission/Inland Wetland & Watercourses Agency 933 Hopmeadow St. Simsbury, CT 06070					
3.							
4.		David Rogers Ryan, Chair Zoning Commission 933 Hopmeadow St. Simsbury, CT 06070					
5.							
6.							



Certificate of Mailing — Firm

Name and Address of Sender Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		TOTAL NO. of Pieces Listed by Sender 4		TOTAL NO. of Pieces Received at Post Office™ 4		Affix Stamp Here Postmark with Date of Receipt.					
Postmaster, per (name of receiving employee) BEJ						U.S. POSTAGE PAID WESTERLY, RI 02891 DEC 08 AMOUNT \$1.72 R2305K132237-06					
USPS® Tracking Number Firm-specific Identifier		Address (Name, Street, City, State, and ZIP Code™)		Postage		Fee		Special Handling		Parcel Airlift	
1.		Capitol Region Council of Governments 214 Main St. #4 Hartford, CT 06106									
2.		Hon. Eric Wellman, First Selectman Town of Simsbury 933 Hopmeadow St. Simsbury, CT 06070									
3.		Maria Capriola Town Manager 933 Hopmeadow St. Simsbury, CT 06070									
4.		Michael Glidden Director of Planning and Community Development 933 Hopmeadow St. Simsbury, CT 06070									
5.											
6.											



Certificate of Mailing — Firm

Name and Address of Sender Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		TOTAL NO. of Pieces Listed by Sender 6	TOTAL NO. of Pieces Received at Post Office™ 6	Affix Stamp Here <i>Postmark with Date of Receipt.</i> 0000			
USPS® Tracking Number Firm-specific Identifier		Address (Name, Street, City, State, and ZIP Code™)		Postage	Fee	Special Handling	Parcel Airlift
1.		Kurt Westby, Commissioner Department of Labor 200 Folly Brook Blvd. Wethersfield, CT 06109					
2.		Hon. Richard Blumenthal Senator 702 Hart Senate Office Building Washington, DC 20510					
3.		Hon. Chris Murphy Senator B40A Dirksen Senate Office Building Washington, DC 20510					
4.		Hon. Jahana Hayes U.S. Representative 1415 Longworth House Office Building Washington, DC 20515					
5.		Hon. Kevin D. Witkos State Senator, 8th District Legislative Office Building, Room 3400 Hartford, CT 06106					
6.		Hon. John K. Hampton Representative, 16th District Legislative Office Building, Room 5007 Hartford, CT 06106-1591					



Certificate of Mailing — Firm

Name and Address of Sender Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		TOTAL NO. of Pieces Listed by Sender 6	TOTAL NO. of Pieces Received at Post Office™ 6	Affix Stamp Here Postmark with Date of Receipt. U.S. POSTAGE PAID WESTERLY, RI 02891 DEC 09 20 AMOUNT \$2.58 R2305K132237-06 0000	
USPS® Tracking Number Firm-specific Identifier	Address (Name, Street, City, State, and ZIP Code™)	Postage	Fee	Special Handling	Parcel Airlift
1.	Melissa McCaw, Secretary Office of Policy and Management 450 Capitol Ave. Hartford, CT 06106				
2.	Joseph Giuletii, Commissioner Department of Transportation 2800 Berlin Turnpike Newington, CT 06111				
3.	David Lehman, Commissioner Department of Economic and Community Development 450 Columbus Blvd. Hartford, CT 06103				
4.	Regina Rush-Kittle, Dep. Comm'r. Division of Emergency Management and Homeland Security 1111 Country Club Rd. Middletown, CT				
5.	Michelle H. Seagull, Commissioner Department of Consumer Protection 450 Columbus Blvd., Suite 901 Hartford, CT 06103				
6.	Josh Geballe, Commissioner Department of Administrative Services 450 Columbus Blvd. Hartford, CT 06103				



Certificate of Mailing — Firm

Name and Address of Sender Justin Adams c/o All-Points Technology Corp., P.C. 567 Vauxhall St. Ext., Suite 311 Waterford, CT 06385		TOTAL NO. of Pieces Listed by Sender 6	TOTAL NO. of Pieces Received at Post Office™ 6	Affix Stamp Here Postmark with Date of Receipt.			
Postmaster, per (name of receiving employee) B6J		U.S. POSTAGE PAID WESTERLY, RI 02991 DEC 08 20 AMOUNT \$2.58 R2305K132237-06			UNITED STATES POSTAL SERVICE® 0000		
USPS® Tracking Number Firm-specific Identifier		Address (Name, Street, City, State, and ZIP Code™)		Postage	Fee	Special Handling	Parcel Airlift
1.		Hon. William Tong Attorney General 55 Elm St. Hartford, CT 06106					
2.		Katie Dykes, Commissioner Department of Energy and Environmental Protection 79 Elm St. Hartford, CT 06106-5127					
3.		Marissa Paslick Gillett, Chairman Public Utilities Regulatory Authority 10 Franklin Square New Britain, CT 06051					
4.		Dedre S. Gifford, MD, MPH Acting Commissioner Department of Public Health 410 Capitol Ave Hartford, CT 06134					
5.		Susan D. Merrow, Chair Council on Environmental Quality 79 Elm St. Hartford, CT 06106					
6.		Bryan P. Hurlburt, Commissioner Department of Agriculture 450 Columbus Blvd., Suite 201 Hartford, CT 06103					

Exhibit 9

Jennifer Young Gaudet

From: Jennifer Young Gaudet
Sent: Friday, December 4, 2020 7:18 AM
To: 'mglidden@simsbury-ct.gov'
Subject: Proposed Bloom Energy fuel cells - Dyno Nobel
Attachments: Bloom Energy plans - 660 Hopmeadow St-Drake Hill Rd.pdf; Bloom Energy plans - 65 Woodland St Bldg 200.pdf

Dear Mr. Glidden:

I am writing on behalf of Bloom Energy in connection with planned fuel cell installations at the Dyno Nobel property complex. Attached are plans depicting the two proposed installations, which will consist of energy servers and associated equipment and be fueled by natural gas. As shown, one will be located adjacent to 65 Woodland St., Building 200 and the other will be located off of Drake Hill Road east of Drake Hill Place.

Bloom will be submitting a petition to the Connecticut Siting Council for approval. In preparation for the filing, we are seeking any comments you or other appropriate Town departments may have on the proposed plans.

I am available to discuss the plans or answer any questions you may have. I can be reached by phone at the number below or by e-mail.

Thank you.

Jennifer Young Gaudet



Jennifer Young Gaudet
Program Manager

D: 860.581.4478

M: 860.798.7454

E: jyounggaudet@allpointstech.com

All-Points Technology Corporation, P.C.

567 Vauxhall Street Extension – Suite 311

Waterford, CT 06385

Please note our new corporate office address