

Kathleen M. Shanley
Manager – Transmission Siting
Tel: (860) 728-4527

September 2, 2021

Melanie Bachman, Esq.
Executive Director
Connecticut Siting Council
Ten Franklin Square
New Britain, CT 06051

Re: . Petition 1459 – The Connecticut Light and Power Company d/b/a Eversource Energy petition for a declaratory ruling, pursuant to Connecticut General Statutes §4-176 and §16-50k, for the proposed modifications to its existing Shunock Substation located at 25 Pendleton Hill Road, North Stonington, Connecticut and related electric transmission line structure improvements.

Dear Ms. Bachman,

On July 21, 2021 Eversource Energy filed the subject Petition with the Connecticut Siting Council. ("Council") Since the Petition was filed, the design of the synchronous condenser enclosure has changed slightly. The original enclosure was presented in the Petition as being 50 feet wide, 45 feet long and 25 feet in height. The new proposed enclosure is 56 feet wide 50 feet long and 38 feet in height. See the attached updated General Arrangement, which was Attachment A in the Petition filing.







Should you or other Council members have any questions regarding this submission, please do not hesitate to contact me via e-mail at kathleen.shanley@eversource.com or telephone at (860) 728-4527.

Sincerely,



Kathleen M. Shanley
Manager – Transmission Siting

Enclosure

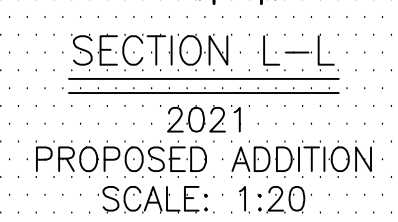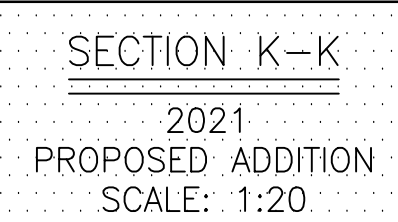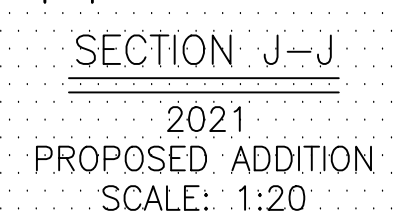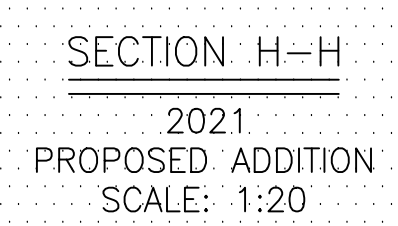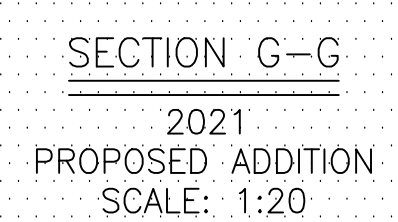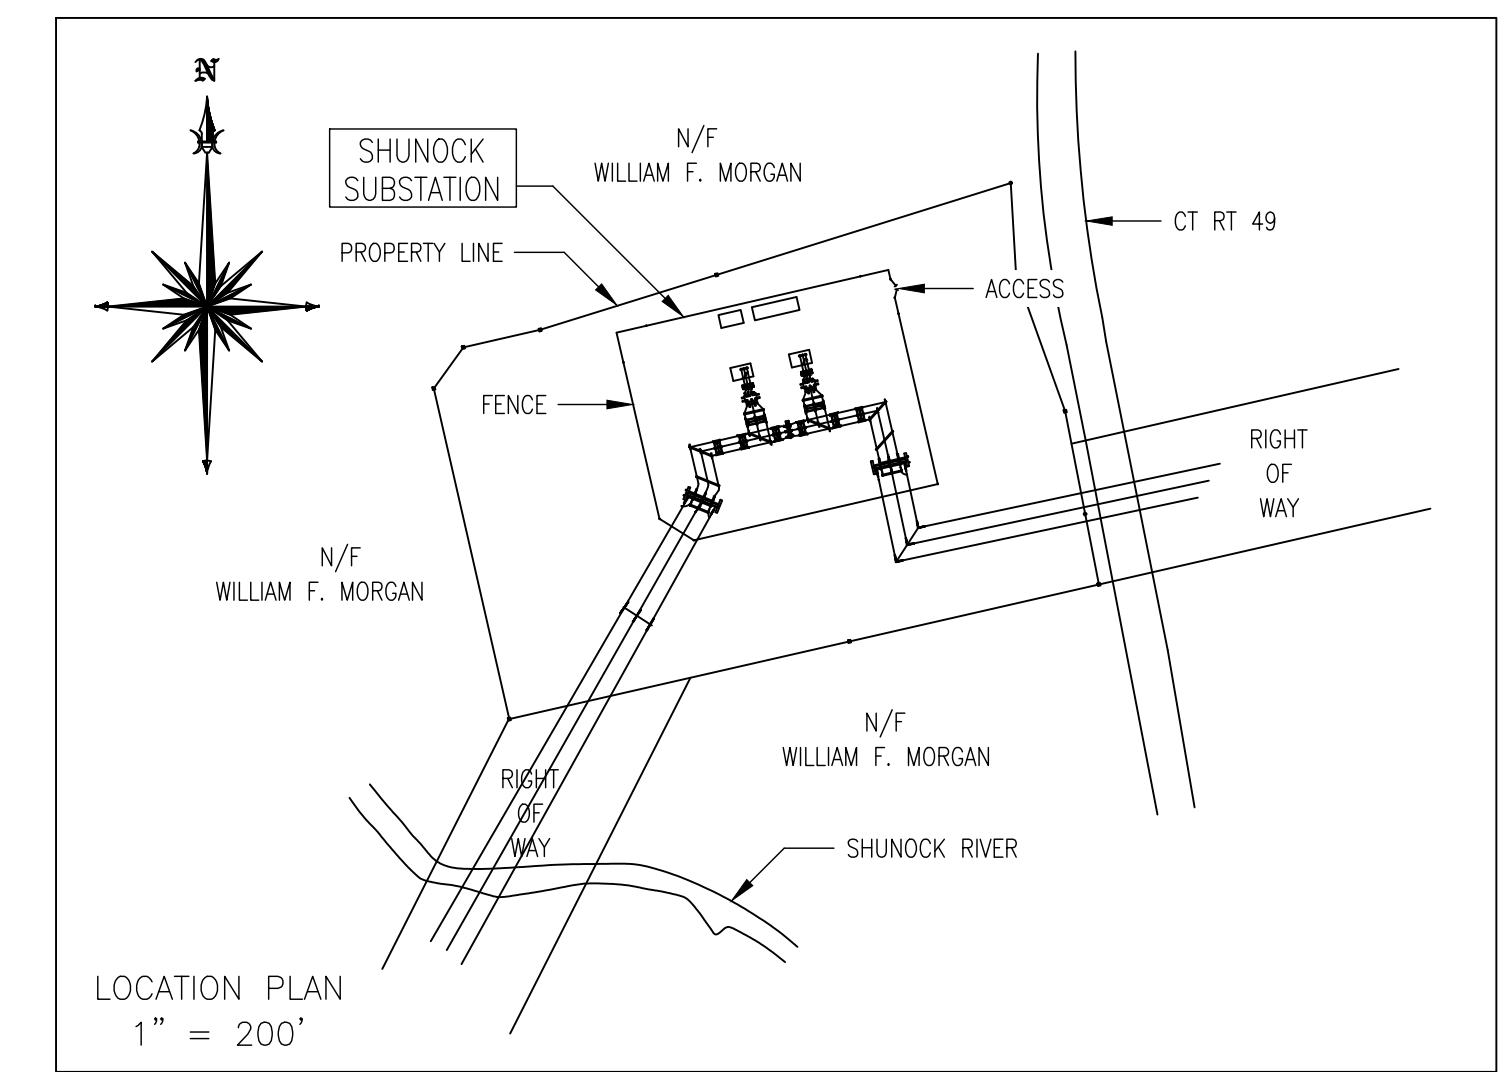

PROPOSED ADDITION

EVERSOURCE
ENERGY

TITLE		SHUNOCK SUBSTATION			
GENERAL ARRANGEMENT PLAN & SECTION - CSC					
PLAN & SECTION VIEW					
NORTH STONINGTON, CT					
BY	FP (BMCDC)	DWG	CAL (BMCDC)	APP	RLR (BMCDC)
DATE	02/21	DATE	02/21	DATE	02/21
H-Scale	AS NOTED	SIZE	E	FIELD BOOK & PAGES	
V-Scale		V.S.		R.L.E.	
S.E. PROJ. NUMBER				DWG. NO.	
				20201 02001	

20201-92001