




## CROSS/SECTIONS

| DRAWING        | DESCRIPTION  |
|----------------|--|
| INDEX MAP      | CROSS SECTION INDEX MAP  |
| FIGURE 1 LEMF  | TYPICAL CROSS SECTION SCOVILL ROCK S/S TO CHESTNUT JCT.                            |
| FIGURE 2 LEMF  | TYPICAL CROSS SECTION OXBOW JCT TO EAST OF ROYAL OAK AND MIDDLEFIELD TO BESECK S/S |
| FIGURE 3 LEMFB | TYPICAL CROSS SECTION BLACK POND JCT TO MERIDEN P.B.A.                             |
| FIGURE 3       | TYPICAL CROSS SECTION MERIDEN P.B.A. TO EAST MERIDEN S/S                           |
| FIGURE 4       | TYPICAL CROSS SECTION EAST MERIDEN S/S TO BESECK S/S                               |

## PLAN DRAWINGS

| DRAWING                  | DESCRIPTION  |
|--------------------------|--|
| 01225-15001 SHEET 1 OF 7 | BESECK S/S - OXBOW JCT 345/115kV LINE DEVELOPMENT & MANAGEMENT PLAN      |
| 01225-15001 SHEET 2 OF 7 | BESECK S/S - OXBOW JCT 345/115kV LINE DEVELOPMENT & MANAGEMENT PLAN      |
| 01225-15001 SHEET 3 OF 7 | BESECK S/S - OXBOW JCT 345/115kV LINE DEVELOPMENT & MANAGEMENT PLAN      |
| 01225-15001 SHEET 4 OF 7 | BESECK S/S - OXBOW JCT 345/115kV LINE DEVELOPMENT & MANAGEMENT PLAN      |
| 01225-15001 SHEET 5 OF 7 | BESECK S/S - OXBOW JCT 345/115kV LINE DEVELOPMENT & MANAGEMENT PLAN      |
| 01225-15001 SHEET 6 OF 7 | BESECK S/S - OXBOW JCT 345/115kV LINE DEVELOPMENT & MANAGEMENT PLAN      |
| 01225-15001 SHEET 7 OF 7 | BESECK S/S - OXBOW JCT 345/115kV LINE DEVELOPMENT & MANAGEMENT PLAN      |
| 01225-15002              | BESECK S/S - OXBOW JCT 345/115kV LINE EROSION CONTROL DETAILS            |
| 01225-60001              | BESECK S/S - OXBOW JCT 345/115kV LINE TYPICAL FOUNDATION DETAILS         |
| 01227-15001 SHEET 1 OF 3 | BESECK S/S - BLACK POND JCT 345/115kV LINE DEVELOPMENT & MANAGEMENT PLAN |
| 01227-15001 SHEET 2 OF 3 | BESECK S/S - BLACK POND JCT 345/115kV LINE DEVELOPMENT & MANAGEMENT PLAN |
| 01227-15001 SHEET 3 OF 3 | BESECK S/S - BLACK POND JCT 345/115kV LINE DEVELOPMENT & MANAGEMENT PLAN |
| 01227-15002              | BESECK S/S - BLACK POND JCT 345/115kV LINE EROSION CONTROL DETAILS       |
| 01227-60001              | BESECK S/S - BLACK POND JCT 345/115kV LINE TYPICAL FOUNDATION DETAILS    |
| 01228-15001 SHEET 1 OF 3 | CHESTNUT JCT - SCOVILL ROCK S/S 345kV LINE DEVELOPMENT & MANAGEMENT PLAN |
| 01228-15001 SHEET 2 OF 3 | CHESTNUT JCT - SCOVILL ROCK S/S 345kV LINE DEVELOPMENT & MANAGEMENT PLAN |
| 01228-15001 SHEET 3 OF 3 | CHESTNUT JCT - SCOVILL ROCK S/S 345kV LINE DEVELOPMENT & MANAGEMENT PLAN |
| 01228-15002              | CHESTNUT JCT - SCOVILL ROCK S/S 345kV LINE EROSION CONTROL DETAILS       |
| 01228-60001              | CHESTNUT JCT - SCOVILL ROCK S/S 345kV LINE TYPICAL FOUNDATION DETAILS    |

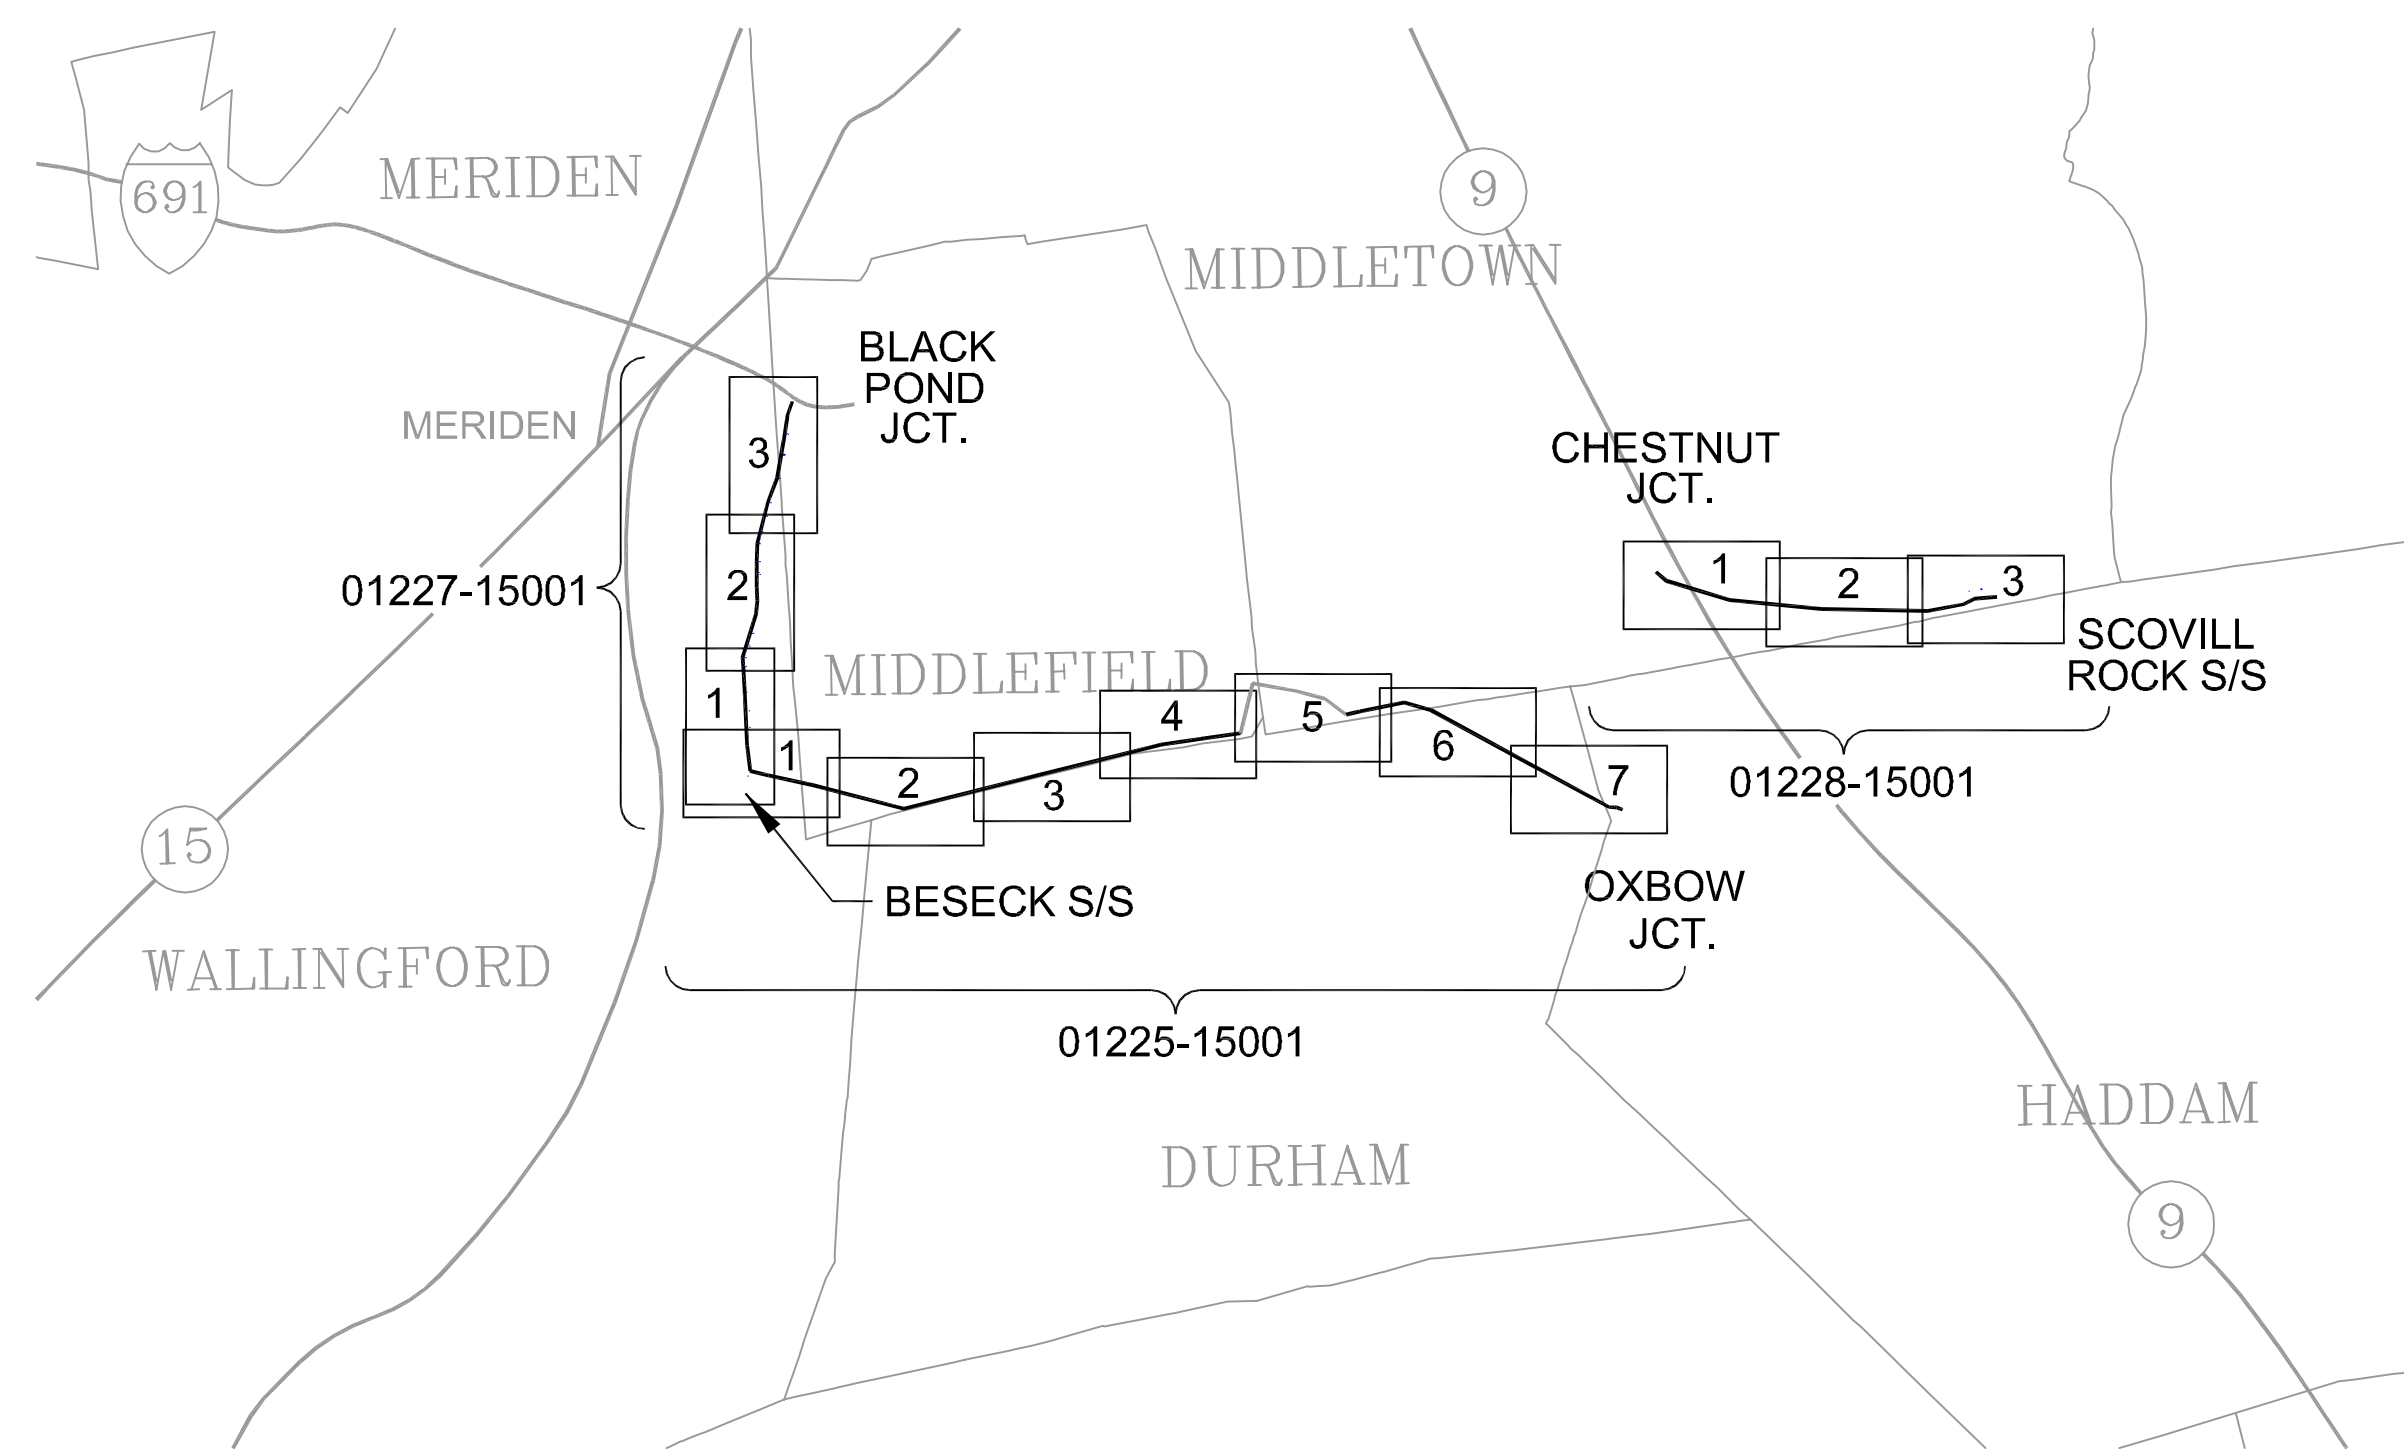

INDEX OF PLAN DRAWINGS



38565

date AUGUST 4, 2005  
 designed M. COLLINS  
 detailed J. BOYER  
 checked J. HOGAN

CAD GENERATED DWG

MAKE NO MANUAL CHANGES

| NORTHEAST UTILITIES SERVICE CO.                      |           |           |    |          |     |       |   |  |  |
|--|-----------|-----------|----|----------|-----|-------|---|--|--|
| FOR THE CONNECTICUT LIGHT & POWER CO.                |           |           |    |          |     |       |   |  |  |
| TITLE DEVELOPMENT & MANAGEMENT PLAN SEGMENT 1A INDEX |           |           |    |          |     |       |   |  |  |
| BY   | BMCD      | CHKD      | -  | APP      | -   | APP   | - |  |  |
| DATE   | SEPT 2005 | DATE      | -  | DATE     | -   | DATE  | - |  |  |
| SCALE  | NONE      | D         |    | DWG. NO. |     | INDEX |   |  |  |
| NO.  | DATE      | REVISIONS | BY | CHK      | APP | APP   |   |  |  |