

CASE 5B

***Connecticut Cable Resonance Study for
Dual DC Option (Case 5b) in Middletown
to Norwalk Project***

***Summary Report
August 2004***

**Prepared for:
Northeast Utilities**



***Connecticut Cable Resonance Study for
Dual DC Option (Case 5b) in Middletown
to Norwalk Project***

***Summary Report
August 2004***

**Principal Contributors:
Sang Y. Lee
Elizabeth R. Pratico
Reigh A. Walling**

***Energy Consulting
GE Energy
One River Road
Schenectady, NY 12345 USA***

Foreword

This document was prepared by General Electric Company in Schenectady, New York. It is submitted to Northeast Utilities (NU). Technical and commercial questions and any correspondence concerning this document should be referred to:

Elizabeth R. Pratico
Energy Consulting
GE Energy
1 River Road
Building 5, Room 310
Schenectady, New York 12345
Phone: (518) 385-5624
Fax: (518) 385-2860
E-mail: elizabeth.pratico@ps.ge.com

Legal Notice

This report was prepared by General Electric Company as an account of work sponsored by Northeast Utilities (NU). Neither NU nor GE, nor any person acting on behalf of either:

1. Makes any warranty or representation, expressed or implied, with respect to the use of any information contained in this report, or that the use of any information, apparatus, method, or process disclosed in the report may not infringe privately owned rights.
2. Assumes any liabilities with respect to the use of or for damage resulting from the use of any information, apparatus, method, or process disclosed in this report.

Table of Contents

INTRODUCTION	1
SYSTEM REPRESENTATION	1
RESONANCE RESULTS	5
CONCLUSIONS	8
APPENDIX A DRIVING-POINT IMPEDANCE PLOTS WITH LIGHT LOAD GENERATION	10
APPENDIX B DRIVING-POINT IMPEDANCE PLOTS WITH LOCAL GENERATORS OFF	15

Introduction

GE Energy's Energy Consulting group has performed a resonance study of a dual dc option in the Northeast Utilities (NU) Middletown to Norwalk 345 kV transmission cable project that is proposed in southwestern Connecticut. This option (Case 5b) has two HVDC links: one between East Devon 345 kV and Beseck 345 kV and the other between Norwalk 345 kV and Singer 345 kV. In this study, the two ac cables between Singer and East Devon were represented as 3000 kcmil XLPE cable, and one of the two HPFF cables between Plumtree and Norwalk was removed.

The objectives of this study were

- to investigate the change in the first resonance with the above modifications as compared to the proposed all-ac HPFF double circuit configuration and the XLPE alternative, and
- to investigate the effect of representing reduced generation in the area.

The study has been performed with the Electromagnetic Transients Program (ATP/EMTP), which is recognized as an industry standard for simulating the transient performance and frequency response of electric utility systems [www.emtp.org].

System Representation

The system model used in the Middletown to Norwalk study was used in this study with modifications.

Figure 1 shows the configuration of VSC-HVDC converter terminals and ac XLPE cables for the dual dc option. The impacts of this dual dc option on ac system frequency response, exclusive of the complex interactions associated with ac-dc interactions, were simulated by removing the ac line from East Devon to Beseck 345 kV and removing the ac cables from Norwalk to Singer 345 kV. More detailed representation of the VSC-HVDC was judged unnecessary to obtain a preliminary estimate of the impact on ac system resonances. The requirements for filters in a VSC-HVDC system, which are much less than for a conventional HVDC system, are dependent on details of the converter design and the ac system characteristics. Therefore, the small amount of ac shunt capacitance¹ they might contribute to the system resonant behavior was intentionally ignored.

¹ Typical VSC-HVDC converter ac harmonic filters might contribute MVARs equal to about 10% of the power rating, and would be on the low-voltage side of an interfacing transformer.

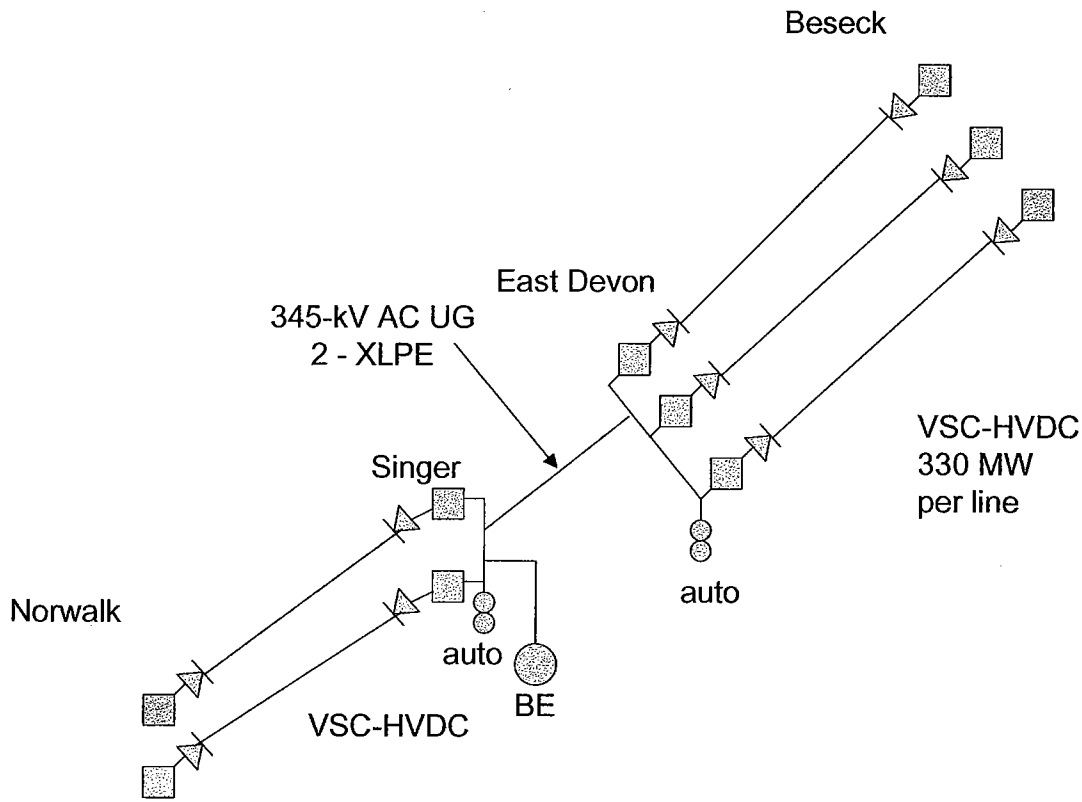


Figure 1. Dual DC Option Configuration

The charging capacitance of the 3000 kcmil XLPE cables is approximately 60% of that of the 2500 kcmil HPFF cables. The following parameters were used to represent the 3000 kcmil XLPE cables (per circuit in pu on a 100 MVA base):

East Devon to Singer - 8.1 miles

- Rpos=0.0001817 pu
- Rzero=0.0018715 pu
- Xpos=0.00217497 pu
- Xzero=0.0012426 pu
- Bposzero=1.0261907 pu

In addition to the above changes, one of the two 9.7-mile HPFF cable circuits between Plumtree and Norwalk was removed.

NU determined that the two capacitor banks at Norwalk 115 kV would be removed with the addition of the Middletown to Norwalk project, and were removed from the model accordingly. Table 1 shows the modified capacitor bank data for this study, and indicates the total MVAR at each bus and the capacitor bank MVAR in service under peak and light load conditions. This study considered conditions with all capacitor banks in service and all capacitor banks out of service. Table 2 shows the generators included in the original ASPEN

file, and the modified status originally provided for the Middletown to Norwalk (M/N) project, which indicates the generators that are on or off during peak and light load conditions. An additional generator dispatch scenario is given for "Light Post-Project," which depicts a more realistic scenario with more local generation off. This study considered the original light load dispatch of generators and the Light Post-Project dispatch with more local generation off.

Table 1. Modified Shunt Capacitor Conditions for System Model

Shunt Capacitors			All Banks	Peak Load	Light Load
Substation	Voltage (kV)	# Units	MVAR (total)	MVAR	MVAR
Southington 1	115	3	157.2	157.2	
Southington 2	115	3	157.2	157.2	
Frost Bridge	115	5	262.0	262.0	
Berlin	115	3	132.0	132.0	
Plumtree	115	2	92.2	0	
Glenbrook	115	5	190.8*	151.2	
Darien	115	1	39.6	39.6	
Waterside	115	1	39.6	39.6	
Norwalk	115	0	0	0	
East Shore	115	2	84.0	84.0	
No. Haven	115	1	42.0	42.0	
Sackett	115	1	42.0	42.0	
Rocky River	115	1	25.2	25.2	
Stony Hill	115	1	25.2	25.2	
Cross Sound Filters	200	3	103.0 (61 – 25 th , 32 – 41 st , 10 – 21 st)	103.0	103.0

* Actual maximum including Glenbrook Statcom is 335 MVAR (additional MVAR not included in analysis)

Table 2. Modified Generator Conditions for System Model

GENERATOR	KV	ID	ST	STATUS (PEAK)	STATUS (LIGHT)	Light Post-Project	IDENTIFICATION NOTES
MILLSTON	22.8	1	1	on	on	On	
MILLSTON	22.8	1	1	on	on	On	
RESCO	115	1	1	on	on	On	Bridgeport
ROCKY RV	13.8	1	1	on	on	Off	
ROCKY RV	13.8	1	1	on	on	Off	
ROCKY RV	13.8	1	1	on	on	Off	
STEVENSO	6.9	1	1	off	off	Off	
NORWALK	27.6	1	0	off	off	Off	
BULLS BR	27.6	1	1	on	on	Off	
FORESTVI	13.8	1	1	on	on	On	
brdgphbr	18.4	2	1	off	off	Off	
brdgphbr	20.2	3	1	on	on	Off	
brdgphbr	13.68	jt	1	off	off	Off	
COSCOBGE	13.8	1	1	off	off	Off	
COSCOBGE	13.8	2	1	off	off	Off	
COSCOBGE	13.8	3	1	off	off	Off	
DEVON 11	13.8	1	1	off	off	Off	
DEVON 12	13.8	1	1	off	off	Off	
DEVON 13	13.8	1	1	off	off	Off	
DEVON 14	13.8	1	1	off	off	Off	
English	13.68	8	1	off	off	Off	
English	13.68	7	1	off	off	Off	
ESHOREGE	13.8	1	1	on	on	Off	New Haven
G1/G2	13.8	1	1	off	off	Off	Wallingford
G3/G4	13.8	1	1	off	off	Off	Wallingford
G5	13.8	1	1	off	off	Off	Wallingford
GT1 (11)	16	1	1	off	off	Off	BE
GT2 (12)	16	1	1	off	off	Off	BE
Middleto	22	1	1	on	off	Off	Middletown
Milford	20.9	1	1	on	on	Off	
Milford	20.9	1	1	off	off	Off	
one (Meriden)	21	1	1	on	off	Off	Meriden
Shepaug	13.8	1	1	on	on	Off	
so norwa	4.8	1	1	off	off	Off	
so norwa	4.8	1	1	off	off	Off	
so norwa	13.8	1	1	off	off	Off	
ST1 (10)	16	1	1	off	off	Off	BE
Temp Gen (Waterside)	13.8	3	0	off	off	Off	Waterside
Temp Gen (Waterside)	13.8	1	0	off	off	Off	Waterside
Temp Gen (Waterside)	13.8	2	0	off	off	Off	Waterside
three (Meriden)	21	1	1	on	off	Off	Meriden

GENERATOR	KV	ID	ST	STATUS (PEAK)	STATUS (LIGHT)	Light Post-Project	IDENTIFICATION NOTES
two (Meriden)	21	1	1	on	off	Off	Meriden
Unit 10	13.8	1	1	off	off	Off	Devon 10
Unit 6J- (Norwalk)	17.1	1	1	off	off	Off	Norwalk-1
Unit 6J- (Norwalk)	13.8	1	1	off	off	Off	Norwalk -10
Unit 6J- (Norwalk)	19	1	1	off	on	Off	Norwalk-2
Unit 7	13.2	1	1	on	off	Off	Devon
Unit 8	13.2	1	1	on	off	Off	Devon
walrecge	4.16	1	1	on	off	Off	

Resonance Results

The resonance effects of the dual dc option was analyzed by evaluating the driving-point impedance versus frequency at various locations, with all capacitor banks in and out of service, and with the original light load and light post-project generator (local generation off) dispatches.

Table 3 shows the cases that were performed for the dual dc option and the resonant frequencies that were observed along with the corresponding impedance value at those frequencies, with the original light load generation dispatch. The resonant frequency is indicated by its harmonic number (HN), in per unit of 60 Hz, and impedance magnitude is in ohms. The corresponding driving-point impedance plots are provided in Appendix A. Table 4 shows the results with the local generation off (light post-project generator dispatch), and the corresponding driving-point impedance plots are provided in Appendix B.

**Table 3. Resonant Frequencies for M/N-XLPE Project with Light Load Generation
Beseck-East Devon & Singer-Norwalk DC Links**

Case	Location	Capacitor Banks	Resonant Frequency & Impedance (pu of 60Hz, Ohm)					
			Low		Middle		High	
			HN	Z(Ω)	HN	Z(Ω)	HN	Z(Ω)
M/N-XLPE-DC_1B	Plumtree 345 kV	All in Service	2.9	134	4.4	155	7.9	224
M/N-XLPE-DC_1C	Plumtree 345 kV	All Out of Service	3.8	156	5.0	549		
M/N-XLPE-DC_2B	Plumtree 115 kV	All in Service	2.9	21	4.4	26	10.0	90
M/N-XLPE-DC_2C	Plumtree 115 kV	All Out of Service	3.8	19	5.0	48	14.0	125
M/N-XLPE-DC_3B	Norwalk 345 kV	All in Service	2.9	152	4.4	181	7.8	344
M/N-XLPE-DC_3C	Norwalk 345 kV	All Out of Service	3.8	187	5.0	639		
M/N-XLPE-DC_4B	Norwalk 115 kV	All in Service	2.9	17	4.5	16		
M/N-XLPE-DC_4C	Norwalk 115 kV	All Out of Service	3.8	17	5.0	29	8.5	20
M/N-XLPE-DC_5B	Southington 345 kV	All in Service	2.9	66	4.3	105	12.1	129
M/N-XLPE-DC_5C	Southington 345 kV	All Out of Service	3.7	49	4.9	66	9.5	285
M/N-XLPE-DC_6B	Southington 115 kV	All in Service	2.9	11	4.3	25	9.4	125
M/N-XLPE-DC_6C	Southington 115 kV	All Out of Service	3.7	8	5.3	28		
M/N-XLPE-DC_7B	East Shore 345 kV	All in Service	2.9	63	6.2	226	14.6	571
M/N-XLPE-DC_7C	East Shore 345 kV	All Out of Service	3.7	67			9.2	218
M/N-XLPE-DC_8B	Devon 115 kV	All in Service	2.9	13				
M/N-XLPE-DC_8C	Devon 115 kV	All Out of Service	3.9	22				
M/N-XLPE-DC_9B	Frost Bridge 115 kV	All in Service	2.9	19	4.3	27	8.4	31
M/N-XLPE-DC_9C	Frost Bridge 115 kV	All Out of Service	3.8	11	5.3	28		
M/N-XLPE-DC_10B	Glenbrook 115 kV	All in Service	2.9	18	4.3	21		
M/N-XLPE-DC_10C	Glenbrook 115 kV	All Out of Service	3.8	17	4.5	23		
M/N-XLPE-DC_11B	Singer 345 kV	All in Service	2.9	248	5.0	24	8.1	41
M/N-XLPE-DC_11C	Singer 345 kV	All Out of Service	3.8	17	5.0	24	16.0	57
M/N-XLPE-DC_12B	Devon 345 kV	All in Service	2.9	248	4.4	2083		
M/N-XLPE-DC_12C	Devon 345 kV	All Out of Service	3.9	1002				
M/N-XLPE-DC_13B	Beseck 345 kV	All in Service	2.9	55	4.4	2085		
M/N-XLPE-DC_13C	Beseck 345 kV	All Out of Service	3.9	1002	5.1	564		
M/N-XLPE-DC_13B	Beseck 345 kV	All in Service	2.9	55	4.3	81	12.1	394
M/N-XLPE-DC_13C	Beseck 345 kV	All Out of Service	3.7	50	4.9	68	9.5	354

**Table 4. Resonant Frequencies for M/N-XLPE Project with Local Generators Off
Beseck-East Devon & Singer-Norwalk DC Links**

Case	Location	Capacitor Banks	Resonant Frequency & Impedance (pu of 60Hz, Ohm)					
			Low		Middle		High	
			HN	Z(Ω)	HN	Z(Ω)	HN	Z(Ω)
M/N-XLPE2-DC_1B	Plumtree 345 kV	All in Service	2.6	97	4.3	146	7.7	240
M/N-XLPE2-DC_1C	Plumtree 345 kV	All Out of Service	3.4	111	5.0	489		
M/N-XLPE2-DC_2B	Plumtree 115 kV	All in Service	2.6	16	4.3	26	9.9	88
M/N-XLPE2-DC_2C	Plumtree 115 kV	All Out of Service	3.3	15	5.0	44	13.9	115
M/N-XLPE2-DC_3B	Norwalk 345 kV	All in Service	2.6	113	4.3	165	7.7	352
M/N-XLPE2-DC_3C	Norwalk 345 kV	All Out of Service	3.4	134	5.0	570		
M/N-XLPE2-DC_4B	Norwalk 115 kV	All in Service	2.6	14	4.3	16		
M/N-XLPE2-DC_4C	Norwalk 115 kV	All Out of Service	3.4	14	5.0	28	8.4	19
M/N-XLPE2-DC_5B	Southington 345 kV	All in Service	2.5	51	4.2	107	12.1	127
M/N-XLPE2-DC_5C	Southington 345 kV	All Out of Service	3.3	43	4.9	64	9.4	264
M/N-XLPE2-DC_6B	Southington 115 kV	All in Service	2.5	9	4.2	24	9.4	118
M/N-XLPE2-DC_6C	Southington 115 kV	All Out of Service	3.3	8	5.3	23		
M/N-XLPE2-DC_7B	East Shore 345 kV	All in Service	2.5	68	6.1	256	14.2	456
M/N-XLPE2-DC_7C	East Shore 345 kV	All Out of Service	3.3	70			9.1	245
M/N-XLPE2-DC_8B	Devon 115 kV	All in Service	2.6	15	4.2	12		
M/N-XLPE2-DC_8C	Devon 115 kV	All Out of Service	3.4	21				
M/N-XLPE2-DC_9B	Frost Bridge 115 kV	All in Service	2.6	13	4.2	29	8.3	32
M/N-XLPE2-DC_9C	Frost Bridge 115 kV	All Out of Service	3.3	9	5.3	26		
M/N-XLPE2-DC_9C	Frost Bridge 115 kV	All Out of Service	3.3	9	4.9	13	9.0	21
M/N-XLPE2-DC_10B	Glenbrook 115 kV	All in Service	2.6	15	4.3	23		
M/N-XLPE2-DC_10C	Glenbrook 115 kV	All Out of Service	3.4	14	5.3	17		
M/N-XLPE2-DC_10C	Glenbrook 115 kV	All Out of Service	3.4	14	6.1	18		
M/N-XLPE2-DC_10C	Glenbrook 115 kV	All Out of Service	3.4	14	4.9	24	8.4	39
M/N-XLPE2-DC_10C	Glenbrook 115 kV	All Out of Service	3.4	14			15.9	55
M/N-XLPE2-DC_11B	Singer 345 kV	All in Service	2.6	242	4.3	1528		
M/N-XLPE2-DC_11C	Singer 345 kV	All Out of Service	3.5	628	5.0	532		
M/N-XLPE2-DC_12B	Devon 345 kV	All in Service	2.6	242	4.3	1529		
M/N-XLPE2-DC_12C	Devon 345 kV	All Out of Service	3.5	628	5.0	533		
M/N-XLPE2-DC_13B	Beseck 345 kV	All in Service	2.5	44	4.2	83	12.1	387
M/N-XLPE2-DC_13C	Beseck 345 kV	All Out of Service	3.3	44	4.9	67	9.4	325

Conclusions

Table 5 summarizes the variation in frequencies of the first resonance points for the M/N project, for the XLPE alternative, and for the dual dc option, with the original light load generator dispatch. Table 6 summarizes the variation in frequencies of the first resonance points in the light post-project dispatch with more local generation off. With the dual dc option and with the original light load generator dispatch, the first resonance is between 2.9 and 3.8 pu of 60 Hz at most 345 kV buses, with all capacitor banks in and out of service, respectively. With the dual dc option and with more local generation off, the first resonance is between 2.6 and 3.4 pu of 60 Hz at most 345 kV buses, with all capacitor banks in and out of service, respectively.

Table 5. Variation in Frequency of First Resonance Points (pu 60 Hz)
with Original Light Load Generator Dispatch

115 kV Capacitor Bank Conditions	M/N Project with HPFF Cable	M/N Project with XLPE Cable	Dual DC Option (Case 5b)
All in service	2.4	2.8	2.9
All out of service	2.8	3.5	3.8

Table 6. Variation in Frequency of First Resonance Points (pu 60 Hz)
in Light Post-Project Dispatch with More Local Generators Off




115 kV Capacitor Bank Conditions	M/N Project with HPFF Cable	M/N Project with XLPE Cable	Dual DC Option (Case 5b)
All in service	-	2.5	2.6
All out of service	-	3.3	3.4




The replacement of overhead line from East Devon to Beseck and cables from Norwalk to Singer with two VSC-HVDC links results in a slightly higher frequency of the first resonance, as compared to the all-ac XLPE alternative. Although the dc link from Norwalk to Singer removes ac cable charging, it also reduces short-circuit strength of the 345 kV system, resulting in resonances below 3rd harmonic. With the original light load generator dispatch and all capacitor banks in service, the frequency is 2.9 pu of 60 Hz. Risk of sustained overvoltages due to transformer inrush is increased when resonances are near 3rd harmonic or below. System outages are another important consideration, since a variety of




outages would similarly cause variation in resonant frequencies, because of the effect of changing either the strength of the system or the effective charging capacitance in the system. Consideration of minimum generator dispatches and system outages (such as an outage of the line from Plumtree to Long Mountain) which would weaken the system together with the maximum allowable 115 kV capacitor bank dispatches and 345 kV cable charging capacitance would result in the lowest frequencies of the first resonance. If all first resonances were located above 3rd harmonic, under such a range of variations, the risk of sustained overvoltages due to transformer inrush would be reduced. However, if varying system conditions result in resonances below 3rd harmonic, then extensive transient studies should be performed to investigate transformer inrush scenarios, under a range of system conditions. Fault and clear scenarios are particularly critical since special circuit breaker closing enhancements have no effect. If the dual dc option studied here is to be considered, then extensive transient studies would be recommended.




In addition to the resonances observed below 3rd harmonic, resonances at slightly higher frequencies are also of significant concern. At Singer and East Devon 345 kV, the XLPE cable system has been isolated from the rest of the 345 kV ac system due to the dc links, and resonances of very high magnitude are observed between 4th and 5th harmonic frequencies. These resonances, which are extremely poorly damped, would be expected to contribute to significant oscillatory behavior during transient disturbances. This XLPE cable system, connecting to dc converters at each end and autotransformers, are expected to have significant transient and temporary overvoltage issues. Additionally, the VSC-HVDC controls must be designed carefully to perform properly with the resonance characteristics observed at Singer and East Devon 345 kV. This dual dc option, having an ac cable system in the middle, appears technically inadvisable.


Appendix A Driving-Point Impedance Plots with Light Load Generation

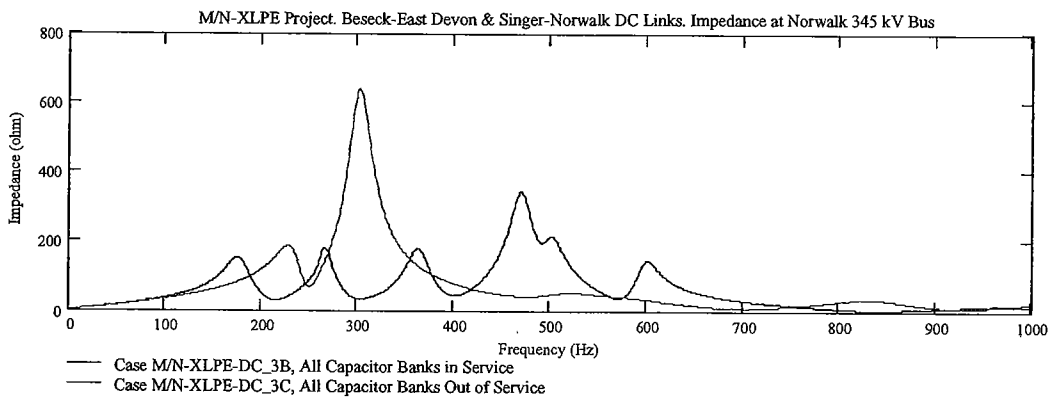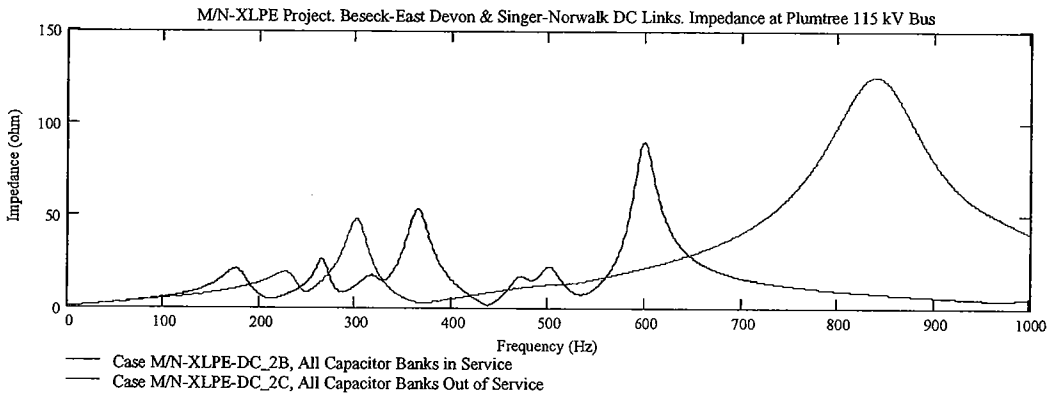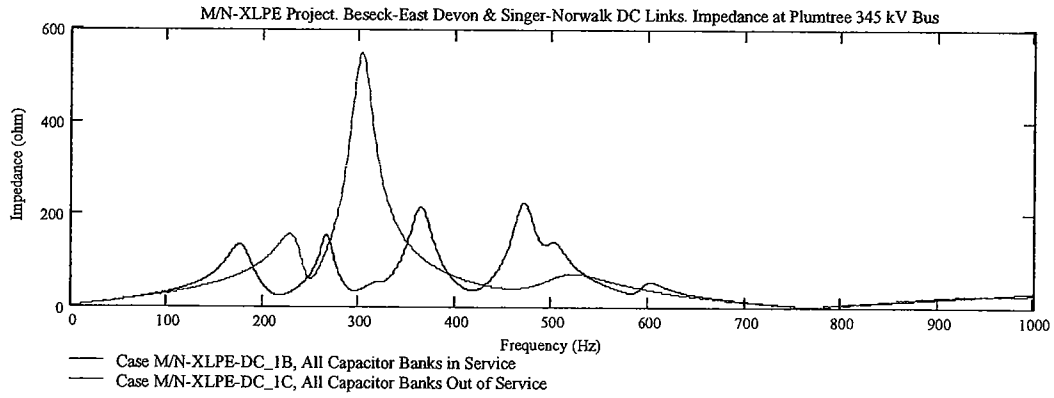

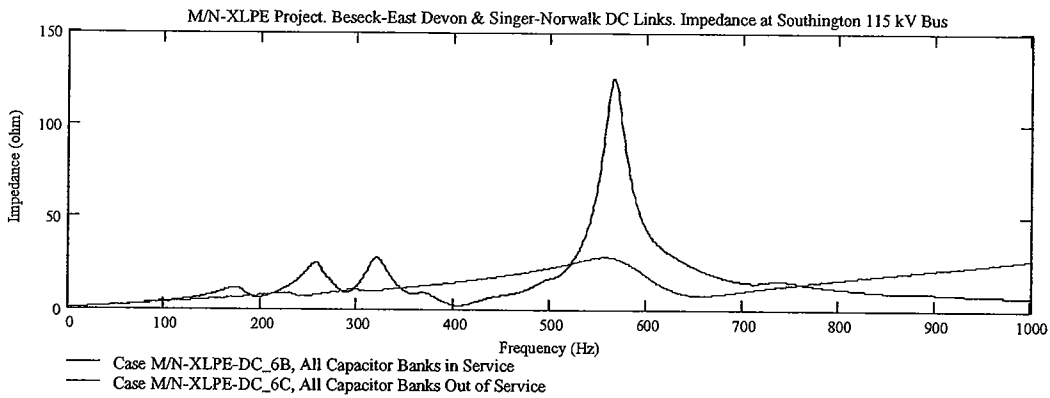
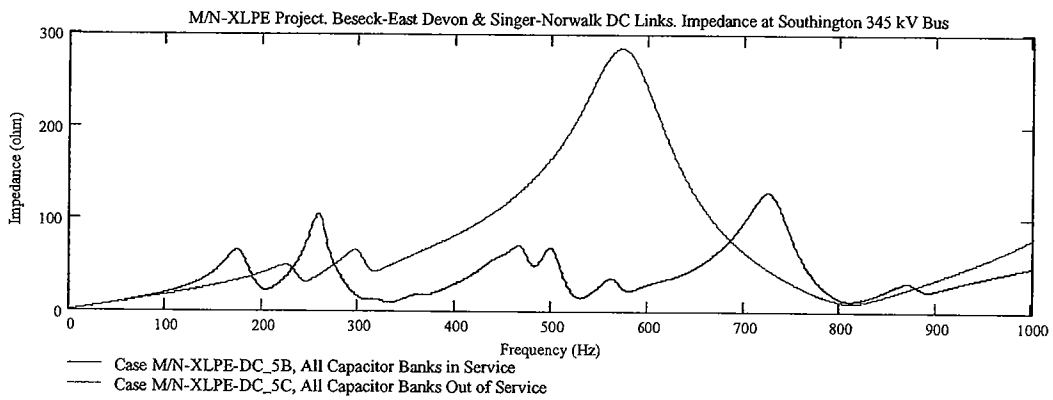
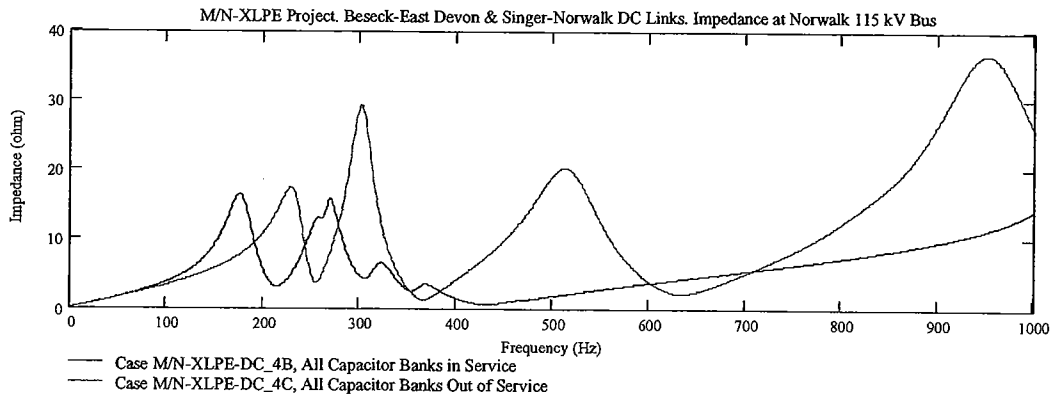


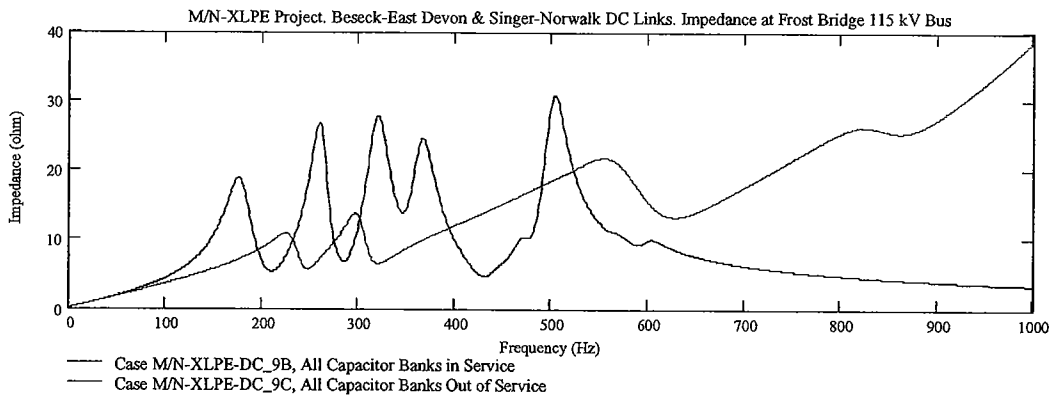
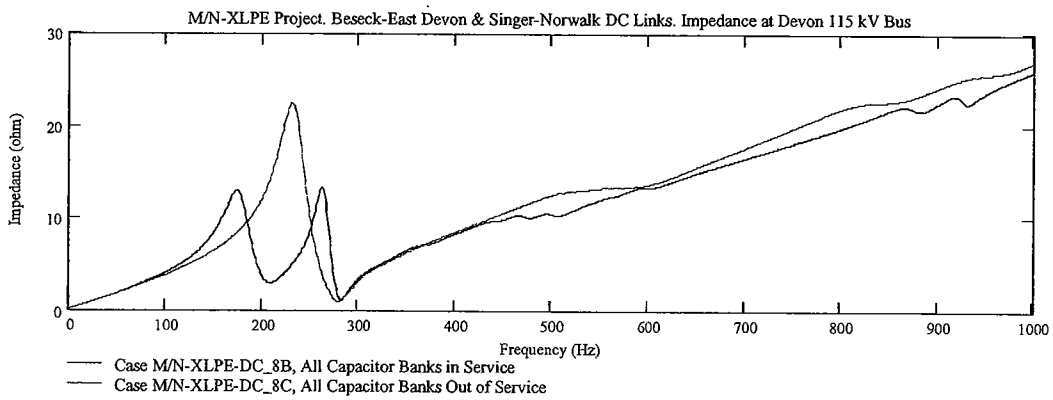
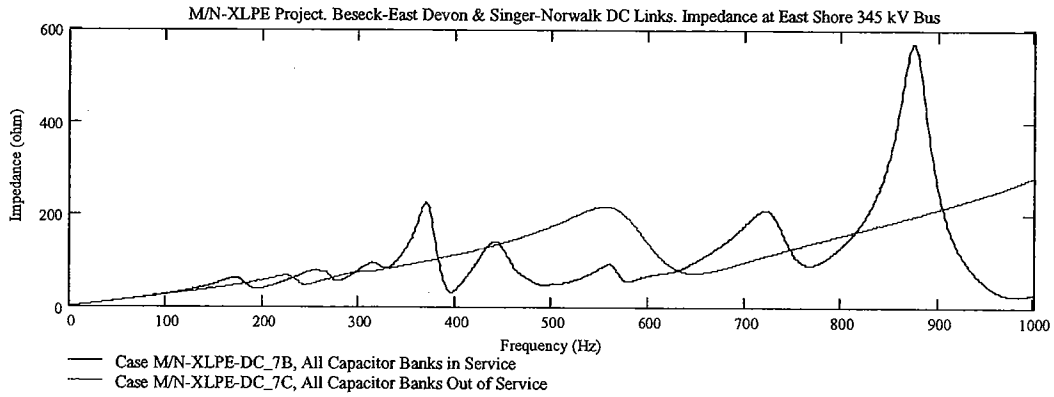


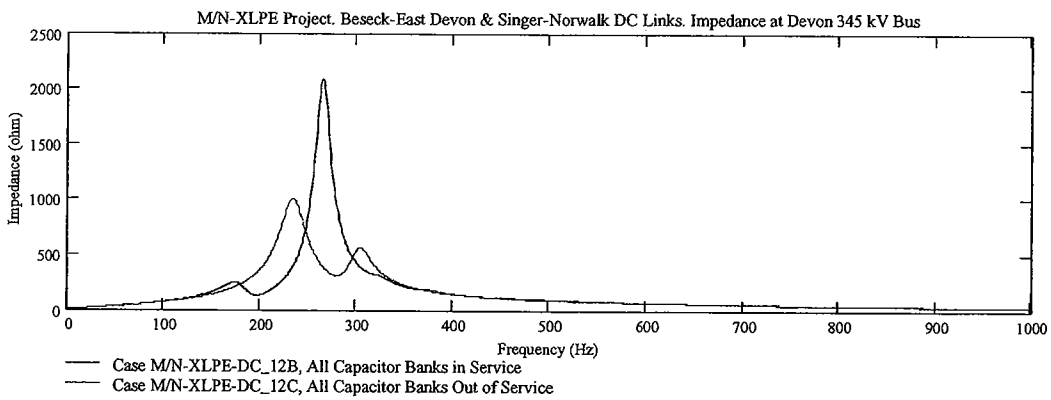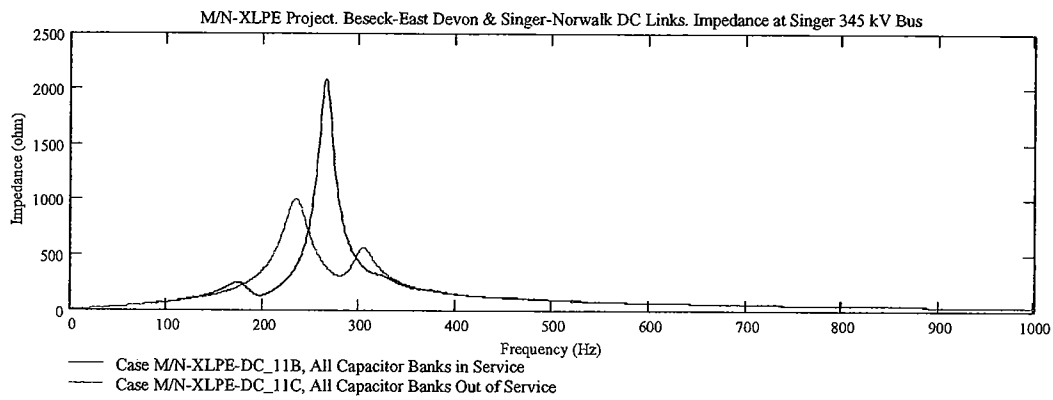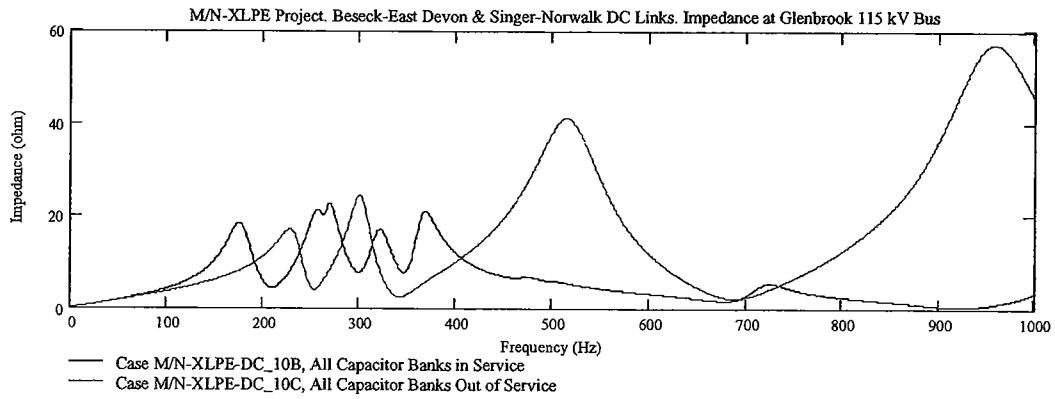

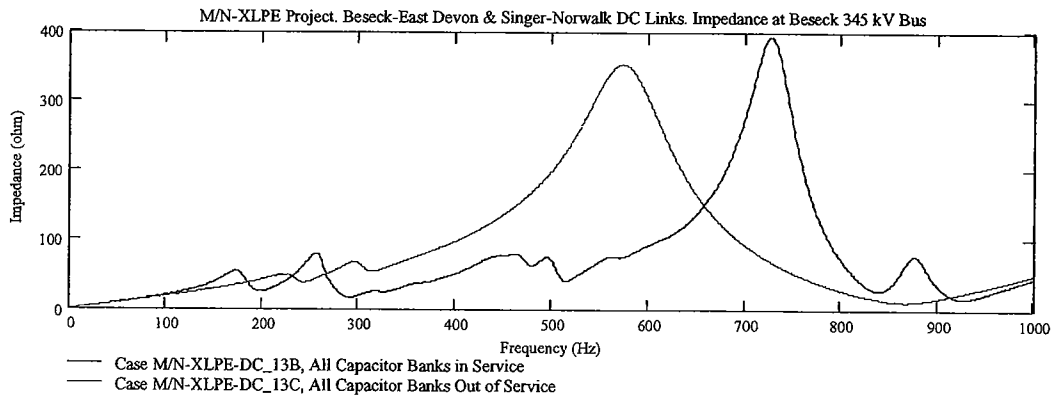


Appendix B Driving-Point Impedance Plots with Local Generators Off

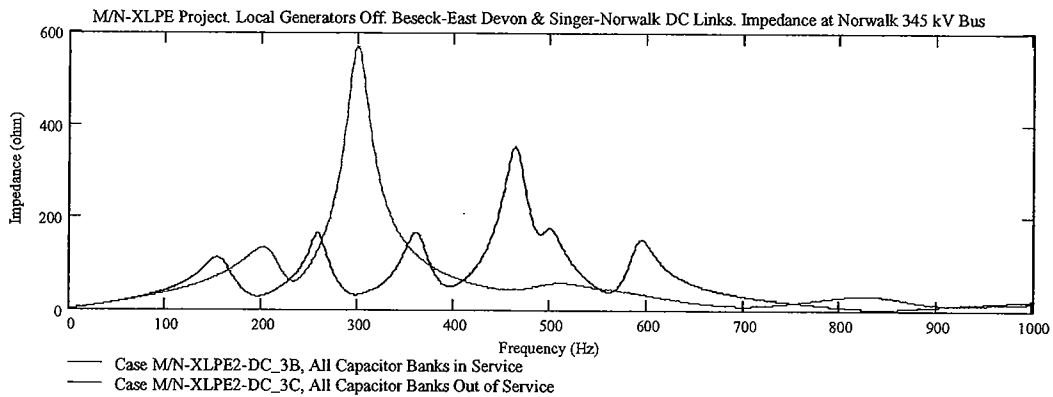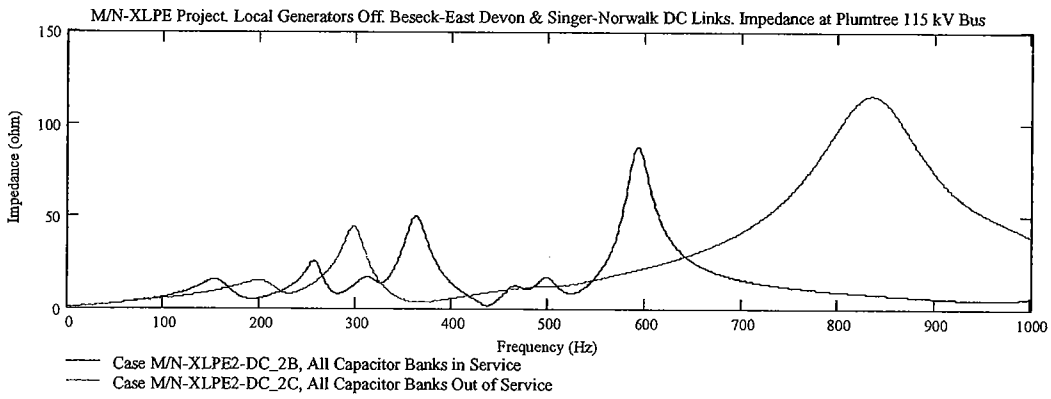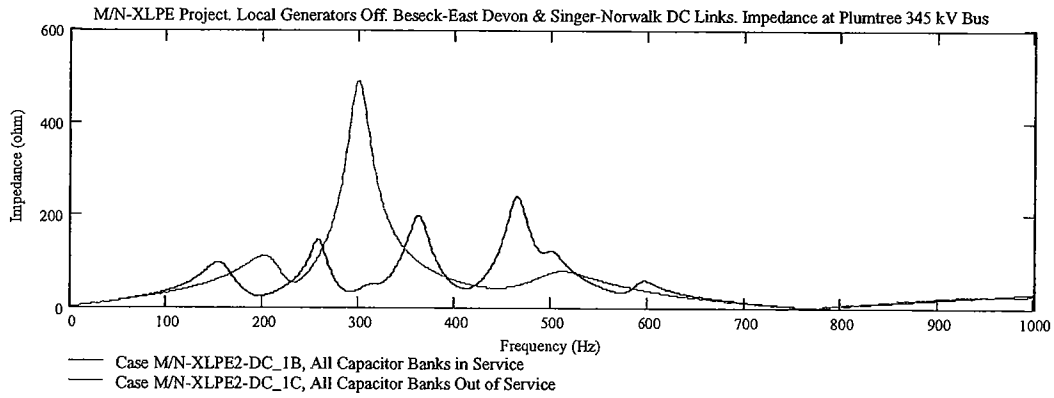


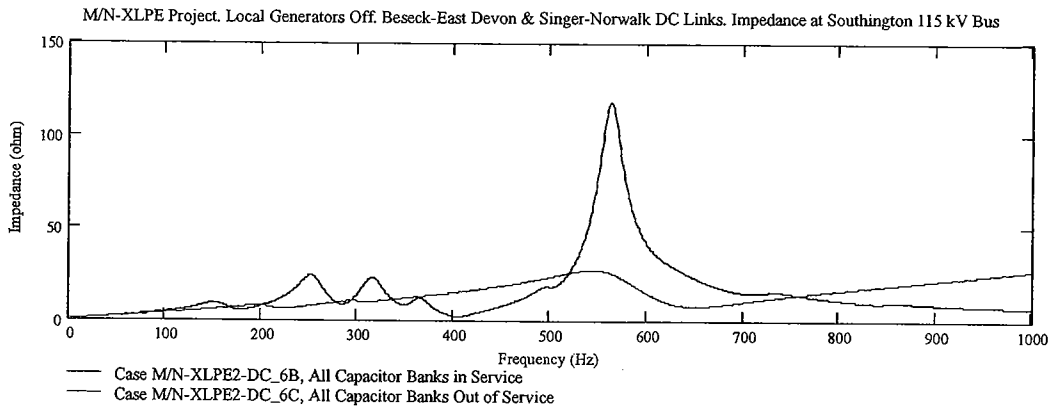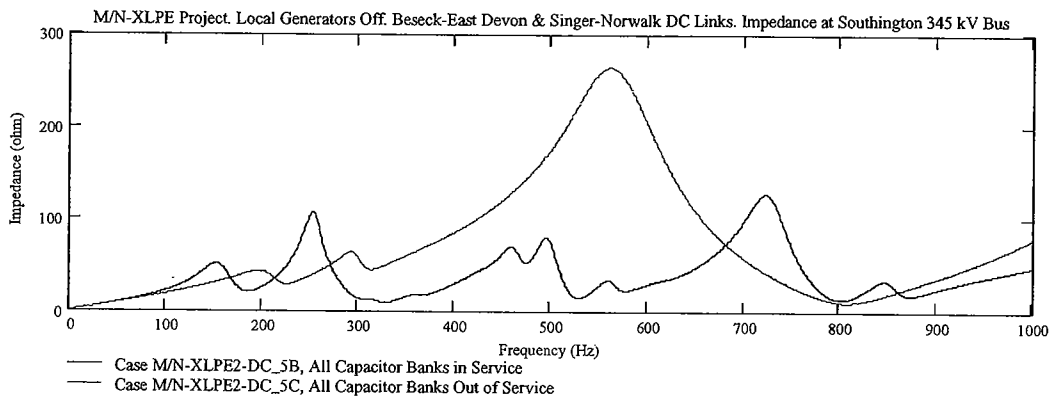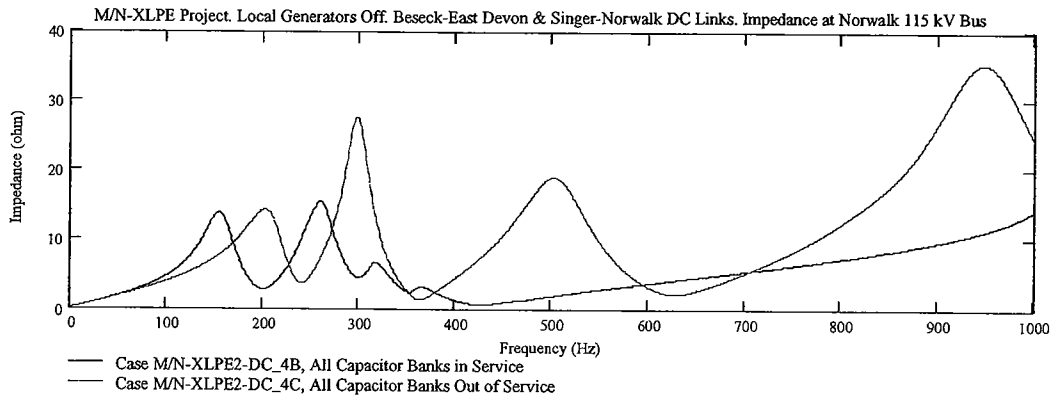


M/N-XLPE Project. Local Generators Off. Beseck-East Devon & Singer-Norwalk DC Links. Impedance at East Shore 345 kV Bus

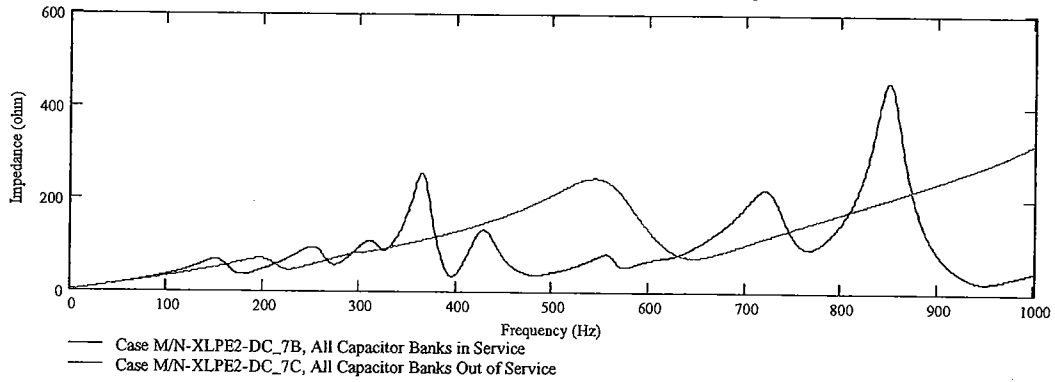


M/N-XLPE Project. Local Generators Off. Beseck-East Devon & Singer-Norwalk DC Links. Impedance at Devon 115 kV Bus

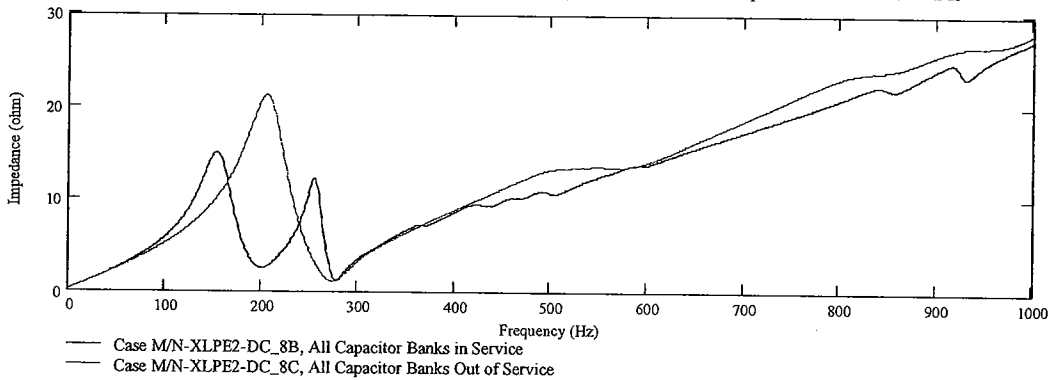


M/N-XLPE Project. Local Generators Off. Beseck-East Devon & Singer-Norwalk DC Links. Impedance at Frost Bridge 115 kV Bus

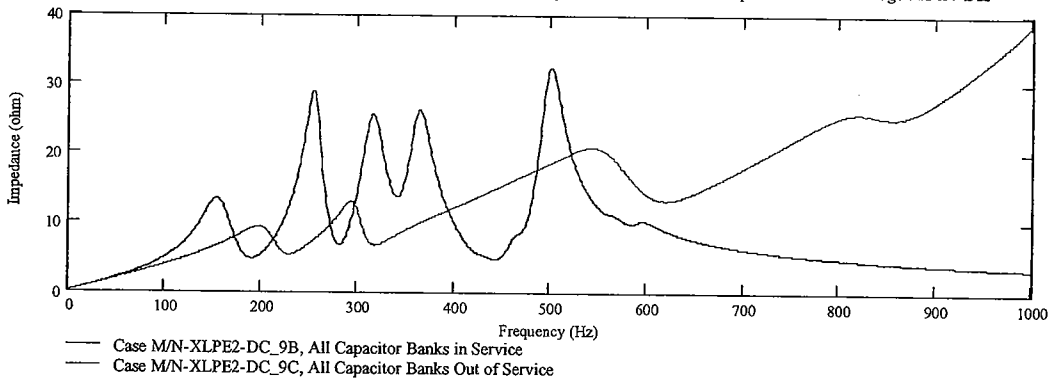


M/N-XLPE Project. Local Generators Off. Beseck-East Devon & Singer-Norwalk DC Links. Impedance at Glenbrook 115 kV Bus

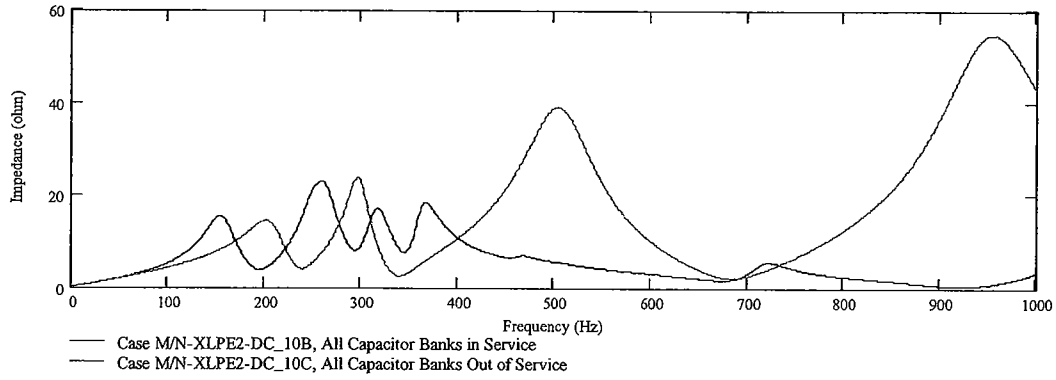


M/N-XLPE Project. Local Generators Off. Beseck-East Devon & Singer-Norwalk DC Links. Impedance at Singer 345 kV Bus

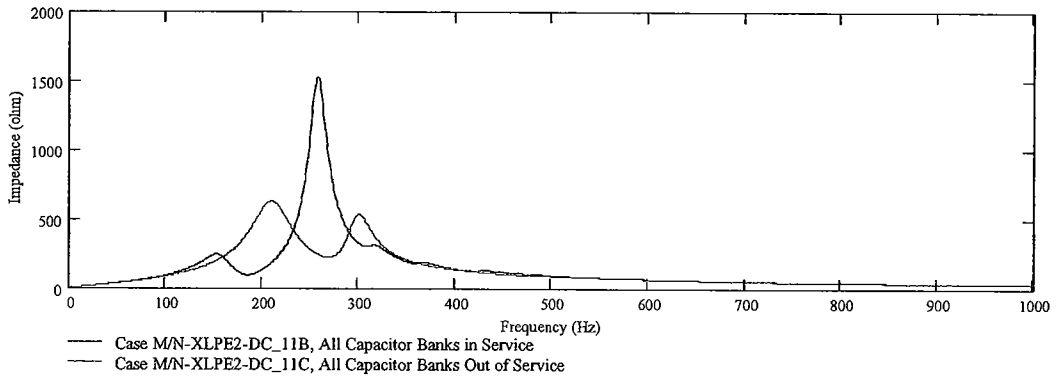

M/N-XLPE Project. Local Generators Off. Beseck-East Devon & Singer-Norwalk DC Links. Impedance at Devon 345 kV Bus

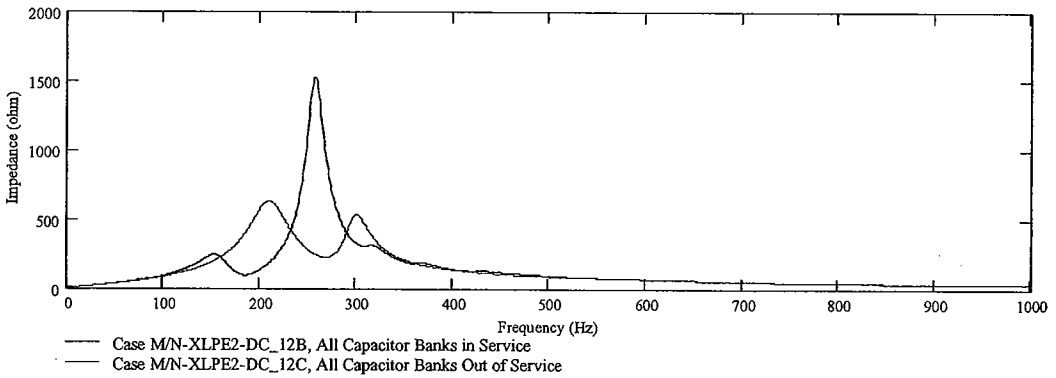

M/N-XLPE Project. Local Generators Off. Beseck-East Devon & Singer-Norwalk DC Links. Impedance at Beseck 345 kV Bus

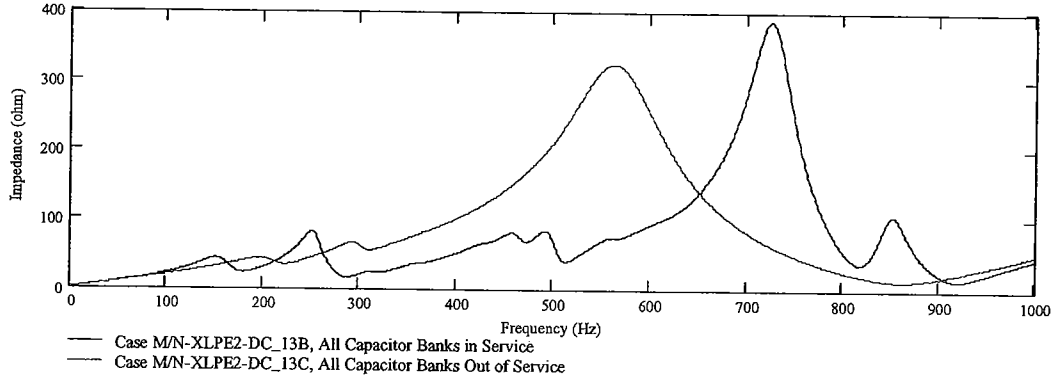

CASE 5C

***Connecticut Cable Resonance Study for
Synchronous Condenser Option 1
(Case 5c) in Middletown to Norwalk
Project***

***Summary Report
August 2004***

**Prepared for:
Northeast Utilities**



***Connecticut Cable Resonance Study for
Synchronous Condenser Option 1
(Case 5c) in Middletown to Norwalk
Project***

***Summary Report
August 2004***

**Principal Contributors:
Sang Y. Lee
Elizabeth R. Pratico
Reigh A. Walling**

***Energy Consulting
GE Energy
One River Road
Schenectady, NY 12345 USA***

Foreword

This document was prepared by General Electric Company in Schenectady, New York. It is submitted to Northeast Utilities (NU). Technical and commercial questions and any correspondence concerning this document should be referred to:

Elizabeth R. Pratico
Energy Consulting
GE Energy
1 River Road
Building 5, Room 310
Schenectady, New York 12345
Phone: (518) 385-5624
Fax: (518) 385-2860
E-mail: elizabeth.pratico@ps.ge.com

Legal Notice

This report was prepared by General Electric Company as an account of work sponsored by Northeast Utilities (NU). Neither NU nor GE, nor any person acting on behalf of either:

1. Makes any warranty or representation, expressed or implied, with respect to the use of any information contained in this report, or that the use of any information, apparatus, method, or process disclosed in the report may not infringe privately owned rights.
2. Assumes any liabilities with respect to the use of or for damage resulting from the use of any information, apparatus, method, or process disclosed in this report.

Table of Contents

INTRODUCTION	1
SYSTEM REPRESENTATION	1
RESONANCE RESULTS	4
CONCLUSIONS	7
APPENDIX A DRIVING-POINT IMPEDANCE PLOTS WITH LIGHT LOAD GENERATION	9
APPENDIX B DRIVING-POINT IMPEDANCE PLOTS WITH LOCAL GENERATORS OFF	14

Introduction

GE Energy's Energy Consulting group has performed a resonance study of "Synchronous Condenser Option 1" (Case 5c) in the Northeast Utilities (NU) Middletown to Norwalk 345 kV transmission cable project that is proposed in southwestern Connecticut. This option connects a 500 MVA synchronous condenser at East Devon 345 kV through a GSU. In this study, the two cables between Norwalk and Singer and the two cables between Singer and East Devon were represented as 3000 kcmil XLPE cable rather than 2500 kcmil HPFF cable, and one of the two HPFF cables between Plumtree and Norwalk was removed.

The objectives of this study were

- to investigate the change in the first resonance with the above modifications as compared to the proposed HPFF double circuit configuration and the XLPE alternative, and
- to investigate the effect of representing reduced generation in the area.

The study has been performed with the Electromagnetic Transients Program (ATP/EMTP), which is recognized as an industry standard for simulating the transient performance and frequency response of electric utility systems [www.emtp.org].

System Representation

The system model used in the Middletown to Norwalk study was used in this study with modifications.

A 500 MVA synchronous condenser was connected at East Devon 345 kV through a GSU. The synchronous condenser was modeled as a voltage source behind a subtransient reactance X_d'' , assumed to be 25% (on 500 MVA base) which is similar to that of 4-pole turbine-generator units.¹ A 500 MVA GSU transformer with 10% impedance (on 500 MVA base) was assumed.

The charging capacitance of the 3000 kcmil XLPE cables is approximately 60% of that of the 2500 kcmil HPFF cables. The following parameters were used to represent the 3000 kcmil XLPE cables (per circuit in pu on a 100 MVA base):

Singer to Norwalk - 15.5 miles

Rpos=0.0003477 pu
Rzero=0.00358118 pu
Xpos=0.00416198 pu
Xzero=0.0023779 pu
Bposzero=1.9637 pu

East Devon to Singer - 8.1 miles

Rpos=0.0001817 pu
Rzero=0.0018715 pu

¹ T.J.E. Miller, *Reactive Power Control in Electric Systems*, John Wiley & Sons, Inc., 1982, p. 277.

$X_{pos}=0.00217497$ pu
 $X_{zero}=0.0012426$ pu
 $B_{poszero}=1.0261907$ pu

In addition to the above changes, one of the two 9.7-mile HPFF cable circuits between Plumtree and Norwalk was removed. The overhead line between East Devon and Beseck was the same as in the Middletown to Norwalk project.

NU determined that the two capacitor banks at Norwalk 115 kV would be removed with the addition of the Middletown to Norwalk project, and were removed from the model accordingly. Table 1 shows the modified capacitor bank data for this study, and indicates the total MVAR at each bus and the capacitor bank MVAR in service under peak and light load conditions. This study considered conditions with all capacitor banks in service and all capacitor banks out of service. Table 2 shows the generators included in the original ASPEN file, and the modified status originally provided for the Middletown to Norwalk (M/N) project, which indicates the generators that are on or off during peak and light load conditions. An additional generator dispatch scenario is given for "Light Post-Project," which depicts a more realistic scenario with more local generation off. This study considered the original light load dispatch of generators and the Light Post-Project dispatch with more local generation off.

Table 1. Modified Shunt Capacitor Conditions for System Model

Shunt Capacitors			All Banks	Peak Load	Light Load
Substation	Voltage (kV)	# Units	MVAR (total)	MVAR	MVAR
Southington 1	115	3	157.2	157.2	
Southington 2	115	3	157.2	157.2	
Frost Bridge	115	5	262.0	262.0	
Berlin	115	3	132.0	132.0	
Plumtree	115	2	92.2	0	
Glenbrook	115	5	190.8*	151.2	
Darien	115	1	39.6	39.6	
Waterside	115	1	39.6	39.6	
Norwalk	115	0	0	0	
East Shore	115	2	84.0	84.0	
No. Haven	115	1	42.0	42.0	
Sackett	115	1	42.0	42.0	
Rocky River	115	1	25.2	25.2	
Stony Hill	115	1	25.2	25.2	
Cross Sound Filters	200	3	103.0 (61 – 25 th , 32 – 41 st , 10 – 21 st)	103.0	103.0

* Actual maximum including Glenbrook Statcom is 335 MVAR (additional MVAR not included in analysis)

Table 2. Modified Generator Conditions for System Model

GENERATOR	KV	ID	ST	STATUS (PEAK)	STATUS (LIGHT)	Light Post-Project	IDENTIFICATION NOTES
MILLSTON	22.8	1	1	on	on	On	
MILLSTON	22.8	1	1	on	on	On	
RESCO	115	1	1	on	on	On	Bridgeport
ROCKY RV	13.8	1	1	on	on	Off	
ROCKY RV	13.8	1	1	on	on	Off	
ROCKY RV	13.8	1	1	on	on	Off	
STEVENSO	6.9	1	1	off	off	Off	
NORWALK	27.6	1	0	off	off	Off	
BULLS BR	27.6	1	1	on	on	Off	
FORESTVI	13.8	1	1	on	on	On	
brdgphbr	18.4	2	1	off	off	Off	
brdgphbr	20.2	3	1	on	on	Off	
brdgphbr	13.68	jt	1	off	off	Off	
COSCOBGE	13.8	1	1	off	off	Off	
COSCOBGE	13.8	2	1	off	off	Off	
COSCOBGE	13.8	3	1	off	off	Off	
DEVON 11	13.8	1	1	off	off	Off	
DEVON 12	13.8	1	1	off	off	Off	
DEVON 13	13.8	1	1	off	off	Off	
DEVON 14	13.8	1	1	off	off	Off	
English	13.68	8	1	off	off	Off	
English	13.68	7	1	off	off	Off	
ESHOREGE	13.8	1	1	on	on	Off	New Haven
G1/G2	13.8	1	1	off	off	Off	Wallingford
G3/G4	13.8	1	1	off	off	Off	Wallingford
G5	13.8	1	1	off	off	Off	Wallingford
GT1 (11)	16	1	1	off	off	Off	BE
GT2 (12)	16	1	1	off	off	Off	BE
Middleto	22	1	1	on	off	Off	Middletown
Milford	20.9	1	1	on	on	Off	
Milford	20.9	1	1	off	off	Off	
one (Meriden)	21	1	1	on	off	Off	Meriden
Shepaug	13.8	1	1	on	on	Off	
so norwa	4.8	1	1	off	off	Off	
so norwa	4.8	1	1	off	off	Off	
so norwa	13.8	1	1	off	off	Off	
ST1 (10)	16	1	1	off	off	Off	BE
Temp Gen (Waterside)	13.8	3	0	off	off	Off	Waterside
Temp Gen (Waterside)	13.8	1	0	off	off	Off	Waterside
Temp Gen (Waterside)	13.8	2	0	off	off	Off	Waterside
three (Meriden)	21	1	1	on	off	Off	Meriden

GENERATOR	KV	ID	ST	STATUS (PEAK)	STATUS (LIGHT)	Light Post-Project	IDENTIFICATION NOTES
two (Meriden)	21	1	1	on	off	Off	Meriden
Unit 10	13.8	1	1	off	off	Off	Devon 10
Unit 6J- (Norwalk)	17.1	1	1	off	off	Off	Norwalk-1
Unit 6J- (Norwalk)	13.8	1	1	off	off	Off	Norwalk -10
Unit 6J- (Norwalk)	19	1	1	off	on	Off	Norwalk-2
Unit 7	13.2	1	1	on	off	Off	Devon
Unit 8	13.2	1	1	on	off	Off	Devon
walrecge	4.16	1	1	on	off	Off	

Resonance Results

The resonance effects of Synchronous Condenser Option 1 (Case 5c), including XLPE cables from East Devon to Singer and Singer to Norwalk and removal of one HPFF cable between Plumtree and Norwalk, was analyzed by evaluating the driving-point impedance versus frequency at various locations, with all capacitor banks in and out of service, and with the original light load and light post-project generator (local generation off) dispatches.

Table 3 shows the cases that were performed for Synchronous Condenser Option 1 and the resonant frequencies that were observed along with the corresponding impedance value at those frequencies, with the original light load generation dispatch. The resonant frequency is indicated by its harmonic number (HN), in per unit of 60 Hz, and impedance magnitude is in ohms. The corresponding driving-point impedance plots are provided in Appendix A. Table 4 shows the results with the local generation off (light post-project generator dispatch), and the corresponding driving-point impedance plots are provided in Appendix B.

Table 3. Resonant Frequencies for M/N-XLPE Project with Light Load Generation
A 500 MVA Synchronous Condenser at East Devon 345 kV Bus

Case	Location	Capacitor Banks	Resonant Frequency & Impedance (pu of 60Hz, Ohm)					
			Low		Middle		High	
			HN	Z(Ω)	HN	Z(Ω)	HN	Z(Ω)
M/N-XLPE-SC1_1B	Plumtree 345 kV	All in Service	2.9	124	5.7	114	13.5	1495
M/N-XLPE-SC1_1C	Plumtree 345 kV	All Out of Service	3.7	219			11.8	339
M/N-XLPE-SC1_2B	Plumtree 115 kV	All in Service	2.9	19	6.8	76	9.7	63
M/N-XLPE-SC1_2C	Plumtree 115 kV	All Out of Service	3.7	23			11.8	128
							14.9	97
M/N-XLPE-SC1_3B	Norwalk 345 kV	All in Service	2.9	136	5.7	172		
M/N-XLPE-SC1_3C	Norwalk 345 kV	All Out of Service	3.7	280				
M/N-XLPE-SC1_4B	Norwalk 115 kV	All in Service	2.9	14	4.6	15		
M/N-XLPE-SC1_4C	Norwalk 115 kV	All Out of Service	3.7	19			8.3	24
							16.1	33
M/N-XLPE-SC1_5B	Southington 345 kV	All in Service	2.9	77	4.6	59	8.2	87
							12.4	115
M/N-XLPE-SC1_5C	Southington 345 kV	All Out of Service	3.6	72			10.6	260
M/N-XLPE-SC1_6B	Southington 115 kV	All in Service	2.8	12	4.5	23	9.4	127
					5.3	33		
M/N-XLPE-SC1_6C	Southington 115 kV	All Out of Service	3.4	9			10.3	29
M/N-XLPE-SC1_7B	East Shore 345 kV	All in Service	2.8	64	6.2	225	12.4	247
							14.6	515
M/N-XLPE-SC1_7C	East Shore 345 kV	All Out of Service	3.6	68			10.3	245
M/N-XLPE-SC1_8B	Devon 115 kV	All in Service	2.8	11				
M/N-XLPE-SC1_8C	Devon 115 kV	All Out of Service	3.6	14				
M/N-XLPE-SC1_9B	Frost Bridge 115 kV	All in Service	2.9	19	4.6	24	8.3	34
					5.7	41		
M/N-XLPE-SC1_9C	Frost Bridge 115 kV	All Out of Service	3.6	13			10.3	27
M/N-XLPE-SC1_10B	Glenbrook 115 kV	All in Service	2.9	16	4.6	29		
					5.7	40		
M/N-XLPE-SC1_10C	Glenbrook 115 kV	All Out of Service	3.7	17	8.3	43	16.2	55
M/N-XLPE-SC1_11B	Singer 345 kV	All in Service	2.9	129	5.7	182	13.6	401
M/N-XLPE-SC1_11C	Singer 345 kV	All Out of Service	3.7	270				
M/N-XLPE-SC1_12B	Devon 345 kV	All in Service	2.9	122	5.7	163	13.6	509
M/N-XLPE-SC1_12C	Devon 345 kV	All Out of Service	3.7	249				
M/N-XLPE-SC1_13B	Beseck 345 kV	All in Service	2.8	69			12.5	308
M/N-XLPE-SC1_13C	Beseck 345 kV	All Out of Service	3.5	82			10.6	264

Table 4. Resonant Frequencies for M/N-XLPE Project with Local Generators Off
A 500 MVA Synchronous Condenser at East Devon 345 kV Bus

Case	Location	Capacitor Banks	Resonant Frequency & Impedance (pu of 60Hz, Ohm)					
			Low		Middle		High	
			HN	Z(Ω)	HN	Z(Ω)	HN	Z(Ω)
M/N-XLPE2-SC1_1B	Plumtree 345 kV	All in Service	2.6	99	5.7	116	13.6	1445
M/N-XLPE2-SC1_1C	Plumtree 345 kV	All Out of Service	3.5	162			11.7	304
M/N-XLPE2-SC1_2B	Plumtree 115 kV	All in Service	2.6	16	6.7	64	9.5	62
M/N-XLPE2-SC1_2C	Plumtree 115 kV	All Out of Service	3.4	18			11.7	118
							14.9	88
M/N-XLPE2-SC1_3B	Norwalk 345 kV	All in Service	2.6	111	5.7	176		
M/N-XLPE2-SC1_3C	Norwalk 345 kV	All Out of Service	3.5	205				
M/N-XLPE2-SC1_4B	Norwalk 115 kV	All in Service	2.6	13	4.5	15		
M/N-XLPE2-SC1_4C	Norwalk 115 kV	All Out of Service	3.4	16			8.1	23
							16.0	32
M/N-XLPE2-SC1_5B	Southington 345 kV	All in Service	2.6	64	4.5	57	8.2	92
M/N-XLPE2-SC1_5C	Southington 345 kV	All Out of Service	3.4	62			12.4	113
							10.4	238
M/N-XLPE2-SC1_6B	Southington 115 kV	All in Service	2.6	10	4.5	22	9.4	119
					5.2	26		
M/N-XLPE2-SC1_6C	Southington 115 kV	All Out of Service	3.3	9			10.1	28
M/N-XLPE2-SC1_7B	East Shore 345 kV	All in Service	2.5	71	6.1	248	12.4	267
							14.2	374
M/N-XLPE2-SC1_7C	East Shore 345 kV	All Out of Service	3.3	74			10.1	274
M/N-XLPE2-SC1_8B	Devon 115 kV	All in Service	2.6	12				
M/N-XLPE2-SC1_8C	Devon 115 kV	All Out of Service	3.4	14				
M/N-XLPE2-SC1_9B	Frost Bridge 115 kV	All in Service	2.6	15	4.5	23	8.3	35
					5.7	41		
M/N-XLPE2-SC1_9C	Frost Bridge 115 kV	All Out of Service	3.3	11			10.3	27
M/N-XLPE2-SC1_10B	Glenbrook 115 kV	All in Service	2.6	15	4.5	28		
					5.7	37		
M/N-XLPE2-SC1_10C	Glenbrook 115 kV	All Out of Service	3.4	15	8.1	41	16.1	53
M/N-XLPE2-SC1_11B	Singer 345 kV	All in Service	2.6	107	5.7	188	13.6	384
M/N-XLPE2-SC1_11C	Singer 345 kV	All Out of Service	3.5	200				
M/N-XLPE2-SC1_12B	Devon 345 kV	All in Service	2.6	101	5.7	168	13.6	493
M/N-XLPE2-SC1_12C	Devon 345 kV	All Out of Service	3.5	185				
M/N-XLPE2-SC1_13B	Beseck 345 kV	All in Service	2.6	56			12.4	296
M/N-XLPE2-SC1_13C	Beseck 345 kV	All Out of Service	3.4	66			10.4	239

Conclusions

Table 5 summarizes the variation in frequencies of the first resonance points for the M/N project, for the XLPE alternative, and for Synchronous Condenser Option 1, with the original light load generator dispatch. Table 6 summarizes the variation in frequencies of the first resonance points in the light post-project dispatch with more local generation off. With Synchronous Condenser Option 1 and with the original light load generator dispatch, the first resonance is between 2.9 and 3.7 pu of 60 Hz at most 345 kV buses, with all capacitor banks in and out of service, respectively. With Synchronous Condenser Option 1 and with more local generation off, the first resonance is between 2.6 and 3.5 pu of 60 Hz at most 345 kV buses, with all capacitor banks in and out of service, respectively.

Table 5. Variation in Frequency of First Resonance Points (pu 60 Hz)
with Original Light Load Generator Dispatch

115 kV Capacitor Bank Conditions	M/N Project with HPFF Cable	M/N Project with XLPE Cable	Synchronous Condenser Option 1 (Case 5c)
All in service	2.4	2.8	2.9
All out of service	2.8	3.5	3.7




Table 6. Variation in Frequency of First Resonance Points (pu 60 Hz)
in Light Post-Project Dispatch with More Local Generators Off




115 kV Capacitor Bank Conditions	M/N Project with HPFF Cable	M/N Project with XLPE Cable	Synchronous Condenser Option 1 (Case 5c)
All in service	-	2.5	2.6
All out of service	-	3.3	3.5




The addition of a 500 MVA synchronous condenser at East Devon results in a slightly higher frequency of the first resonance, as compared to the XLPE alternative without the synchronous condenser. Since the short-circuit contribution at 345 kV of a 500 MVA synchronous condenser, with assumed impedances including GSU, is relatively small (about 2.4 kA) compared with the existing short-circuit levels, it has a relatively small impact on the resonant frequency. With the original light load generator dispatch and all capacitor banks in




service, the frequency is 2.9 pu of 60 Hz. Risk of sustained overvoltages due to transformer inrush is increased when resonances are near 3rd harmonic or below. System outages are another important consideration, since a variety of outages would similarly cause variation in resonant frequencies, because of the effect of changing either the strength of the system or the effective charging capacitance in the system. Consideration of minimum generator dispatches and system outages (such as an outage of the line from East Devon to Beseck) which would weaken the system together with the maximum allowable 115 kV capacitor bank dispatches and 345 kV cable charging capacitance would result in the lowest frequencies of the first resonance. If all first resonances were located above 3rd harmonic, under such a range of variations, the risk of sustained overvoltages due to transformer inrush would be reduced. However, if varying system conditions result in resonances below 3rd harmonic, then extensive transient studies should be performed to investigate transformer inrush scenarios, under a range of system conditions. Fault and clear scenarios are particularly critical since special circuit breaker closing enhancements have no effect. If the Synchronous Condenser Option 1 (Case 5c) studied here is to be considered, then extensive transient studies would be recommended.


Appendix A Driving-Point Impedance Plots with Light Load Generation

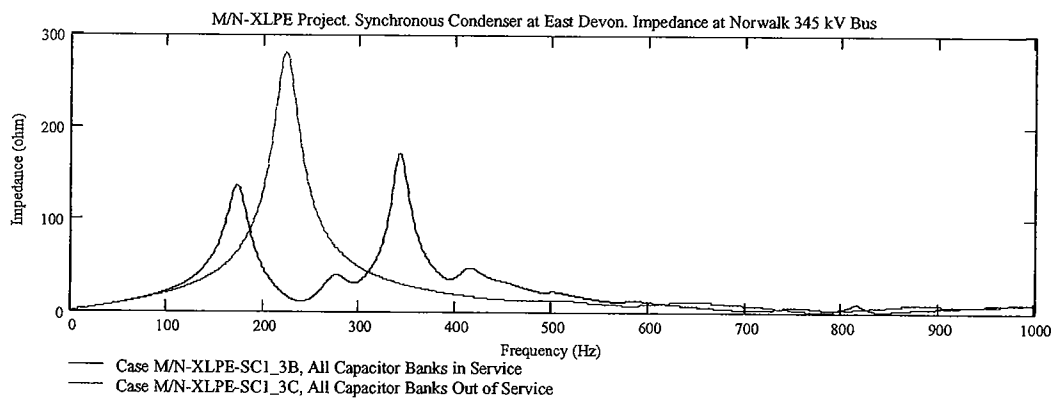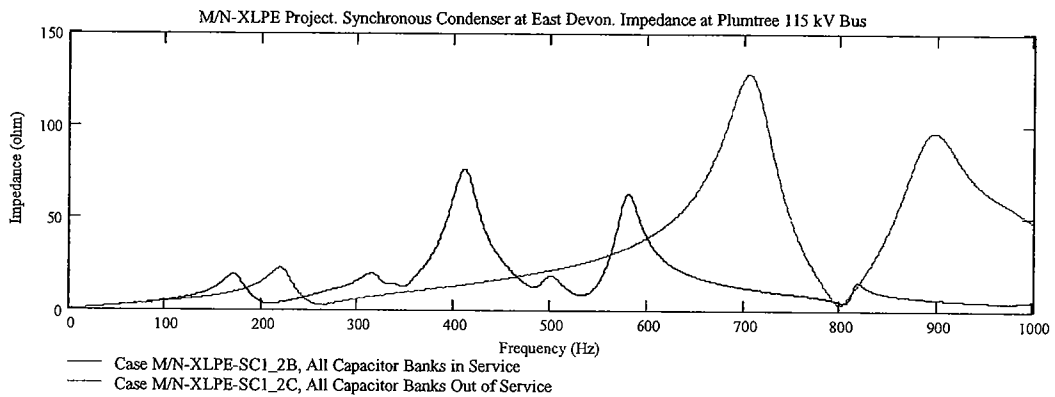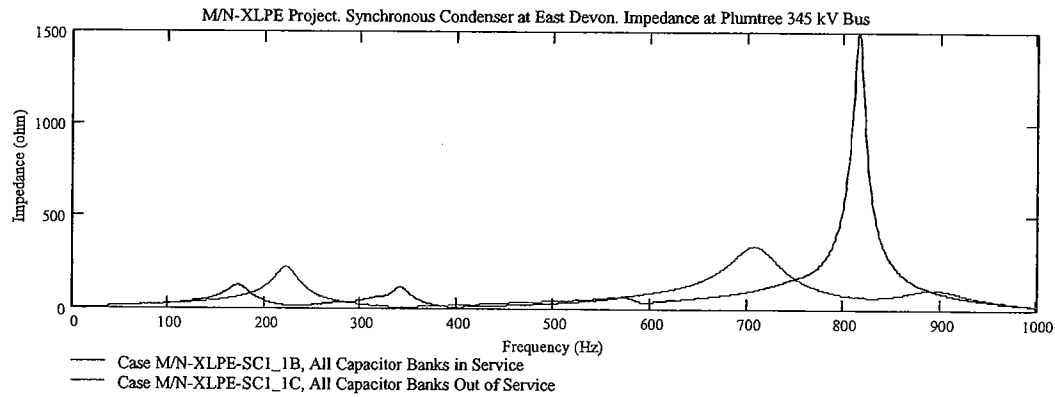

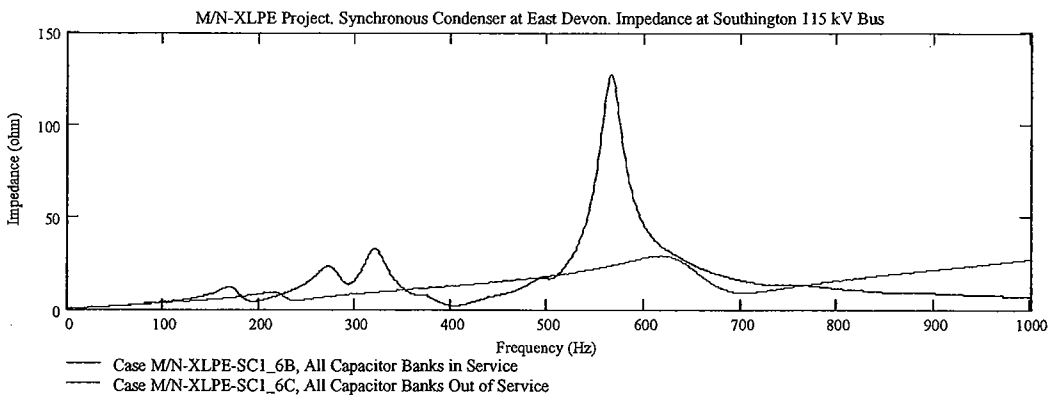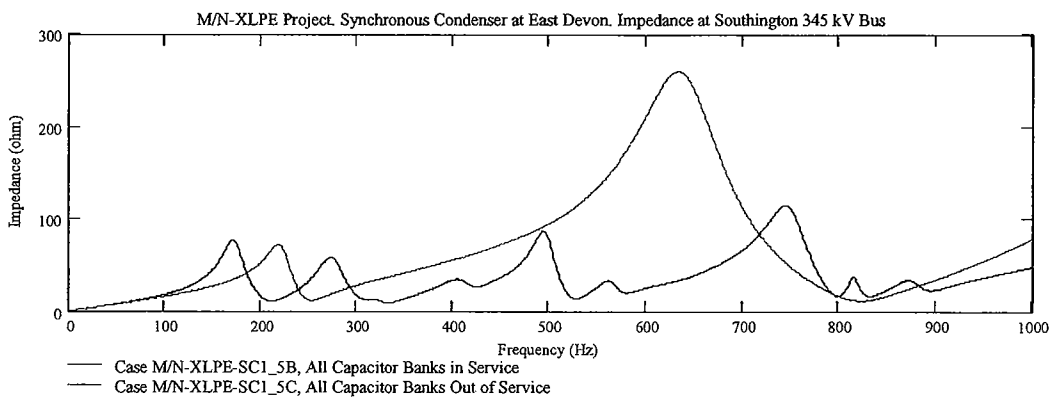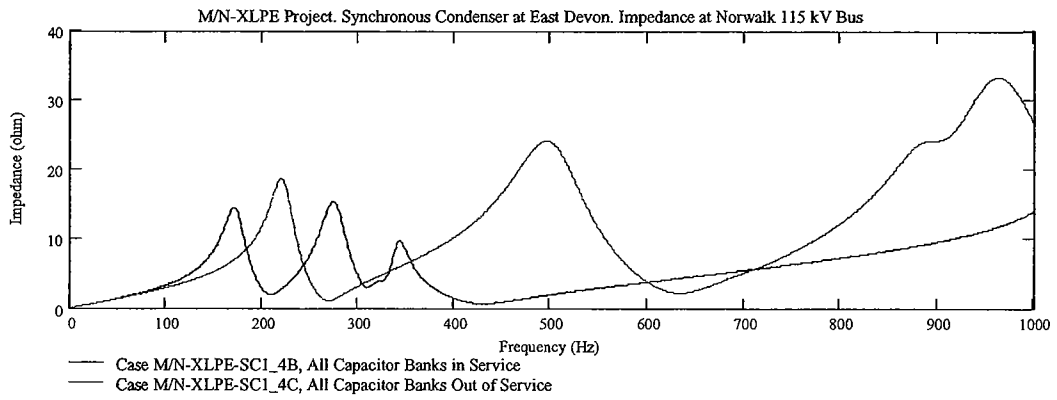

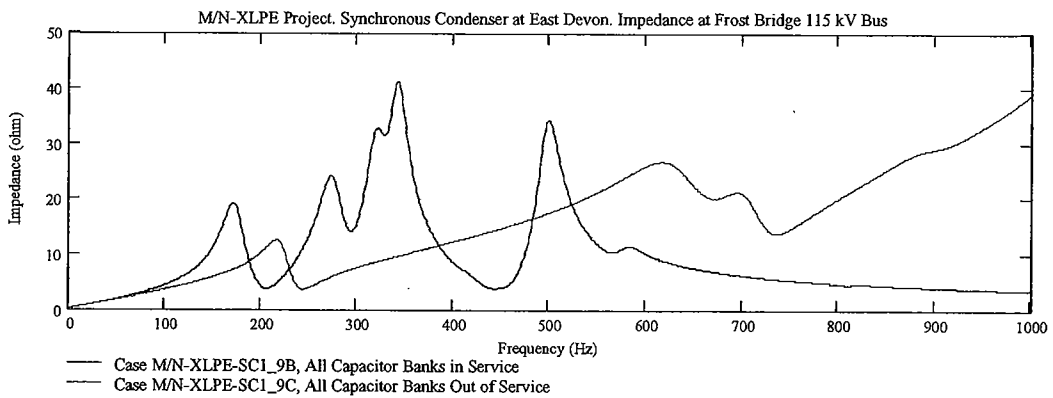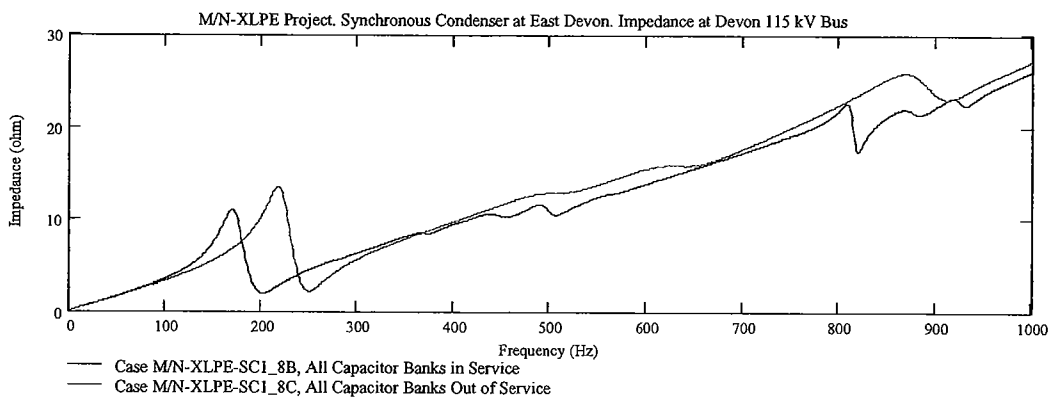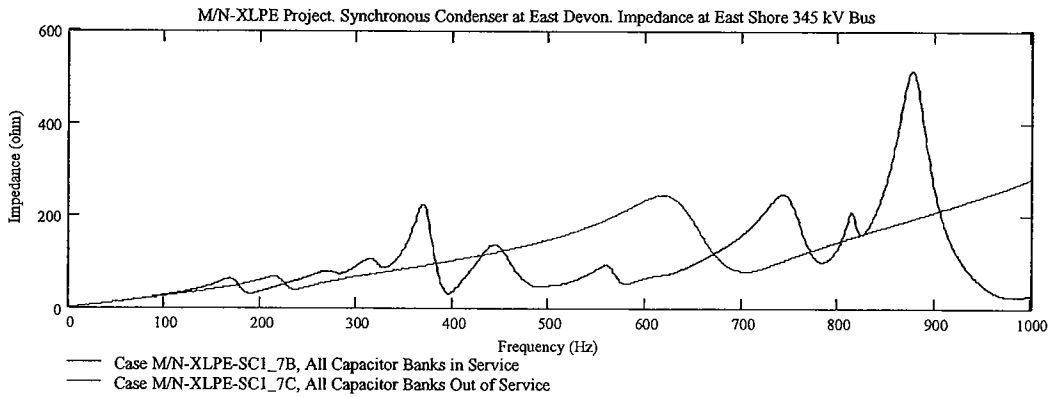

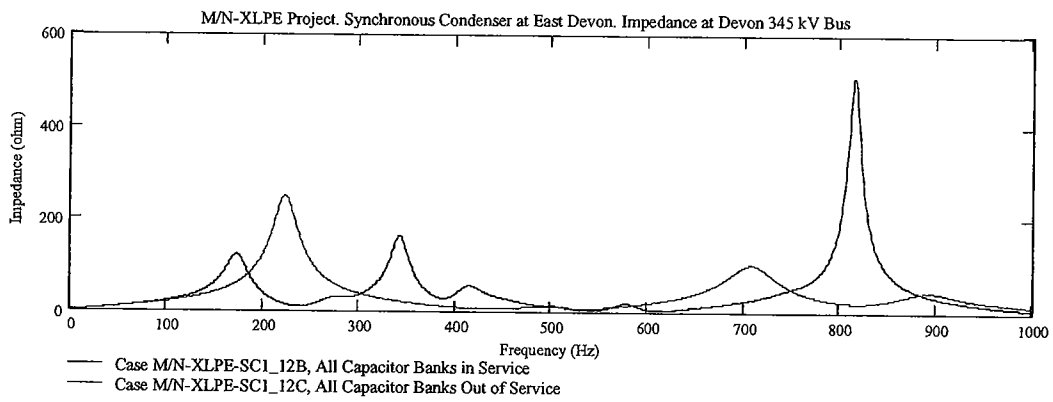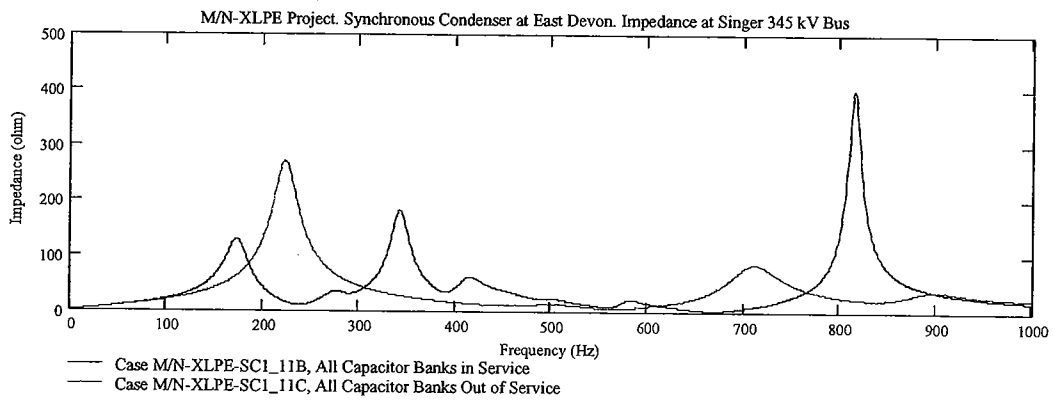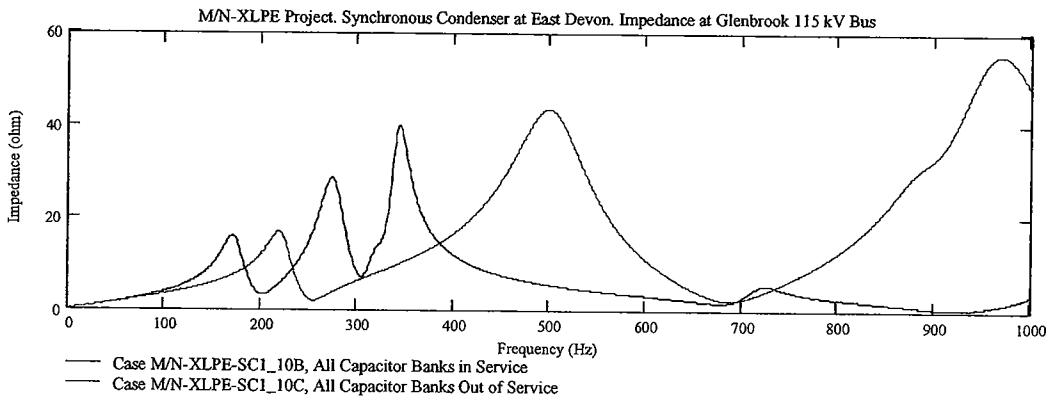

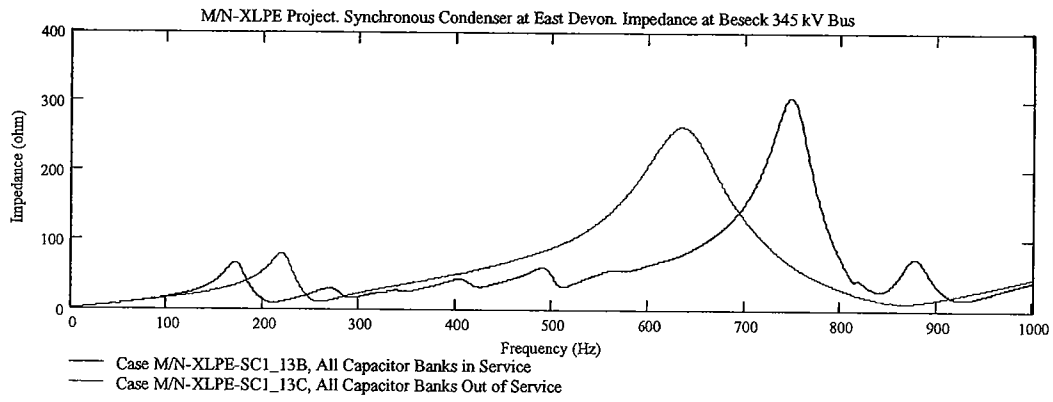

Appendix B Driving-Point Impedance Plots with Local Generators Off

