

Environmental Services, Inc.

90 Brookfield Street South Windsor, CT 06074-1262 (860) 528-9500 (860) 289-0138 (fax) www.e-s-i.com

SPILL UPDATE MEMORANDUM

AFFF Release – Bradley Airport Farmington River Discharge Windsor, Connecticut June 15, 2019

On Saturday June 8, 2019 a release of aqueous film forming foam (AFFF) occurred at a private aircraft hangar at Bradley Airport. The release was caused by a malfunction of a fire suppression system that discharged an estimated 50,000-gallons of the foam mixed with water inside the hangar. An unknown quantity of the foam and water mixture entered into an onsite oil water separator system that ultimately discharges to the sanitary sewer. Environmental Services, Inc. (ESI) responded to the spill to recover the foam from the hangar floor and oil water separator. In addition, foam was observed at the MDC's Wastewater Treatment Plant located at 1222 Poquonock Avenue in Windsor. Foam was also observed at the plant's outfall to the Farmington River and the Connecticut Department of Energy and Environmental Protection (CTDEEP) Emergency Response Unit was notified. Figure 1 depicts the location of the spill, the MDC plant, and the associated discharge outfall to the Farmington River.

ESI deployed a boom at the outfall location in the river to prevent the migration of foam downstream of the outfall. ESI's also positioned vac-trucks at both the MDC plant and at the river outfall to capture as much foam as possible prior to it entering into the river. At the direction of the CTDEEP, on June 9, 2019, ESI personnel also collected grab samples of the foam and river water to determine if the foam contained perfluorinated substances (PFAS) typically associated with fire fighting foam. The samples were collected from the following locations:

<u>Upstream</u> - collected via boat from the Farmington River upstream of the Windsor MDC plant's outfall where the foam discharge was observed.

<u>Plant</u> - collected from the influent coming into the MDC plant. Foam was not observed in the influent or in the sample.

<u>Outfall</u> - collected via boat at the MDC outfall into the Farmington River and consisted of the foam on the surface of the water.

<u>Downstream-1</u> - collected via boat from the Farmington River near the I-91 overpass bridge, approximately 3,300 feet downstream of the MDC outfall. Foam was not observed on the river in this area or in the sample.

<u>Downstream-2</u> - collected from the Farmington River north of the Palisado Avenue overpass at the boat launch, approximately 16,390 feet south of the MDC outfall. Foam was not observed on the river in this area or in the sample.





<u>Disposal</u> - this sample was collected from ESI's vac-truck that was used to contain and recover the foam from the wastewater treatment plant and river.

The sample locations are depicted on Figures 1 through 5. The samples were collected in accordance with the Environmental Protection Agency (EPA) and Interstate Technology Regulatory Council (ITRC) guidelines for sampling PFAS. The samples were analyzed at Eurofins Lancaster Laboratories Environmental in Lancaster, Pennsylvania using EPA Method 537 Version 1.1, which includes the 24 PFAS.

As the below table indicates, total PFAS were detected at varying concentrations in all of the samples. The results are reported in nanograms per liter (ng/L), where 1 ng/L = 1 part per trillion (ppt), which is also equivalent to 0.001 ug/L (part per billion [ppb]). The EPA Health Advisory and Connecticut Department of Public Health Action Level for combined PFOS and PFOA in drinking water is 70 ppt (ng/L). There are currently no State or federal surface water protection criteria for PFOS and PFOA compounds, and currently no regulatory limits for total PFAS in groundwater, surface water, sediment, or soil.

 Sample I.D/Location.:
 Upstream
 Plant
 Outfall
 Downstream-1
 Downstream-2
 Disposal

 Total PFAS – Method 537 1.1 (ng/L)
 37.72
 135,998
 1,515,700
 13,330
 10,253
 9,630,830

Table 1 – Total PFAS Detected in Samples Collected June 9, 2019

It should be noted that perfluorooctanesulfonic acid was detected in the laboratory method blank at 2.2 ng/L, which may result in a slightly high bias of PFOS reported in the samples. The laboratory noted that the PFOS presence in the blank was caused by the elevated concentrations of PFOS present in the samples. Other laboratory quality assurance/quality control (qa/qc) non-conformances were noted, but in all instances, they did not have any impact on the data results for its intended purposes to determine if PFAS were absent/present.

From June 8 to 11, 2019 ESI recovered approximately 19,000-gallons of foam from the MDC plant and the Farmington River outfall. On June 11, ESI noted that the foam at the plant and outfall locations had dissipated and the small amount of film observed at the outfall appeared to be from normal wastewater treatment plant operations and not specifically from the AFFF. ESI recommended that the boom remain at the outfall to the river, and that the area be inspected every six hours to document if foam was present and if it necessitated removal. ESI also collected a second sample (Outfall-2) of the light film observed at the outfall on June 11, 2019 to determine if elevated concentrations of PFAS were present. In addition, ESI collected a sample of the AFFF product (Signature) that remained in the fire suppression system. The table on the following page summarizes the results of the analyses.



Page | **3**

Table 2 – Total PFAS Detected in Samples Collected June 10 & 11, 2019

Sample I.D/Location.:	Outfall-2	Signature
Total PFAS – Method 537 1.1 (ng/L)	90,899.4	2,969,400,000

Pefluorohexanesulfonic acid (0.44 ng/L) and perfluorooctanesulfonic acid (3.8 ng/L) were detected in the laboratory method blank, which may result in a slightly high bias of PFOS reported in the samples. The laboratory noted that the PFOS presence in the blank was caused by the elevated concentrations of PFOS present in the samples. Other laboratory quality assurance/quality control (qa/qc) non-conformances were noted, but in all instances, they did not have any impact on the data results for its intended purposes to determine if PFAS were absent/present.

ESI's inspections from June 11 and 12, 2019 noted a minimal amount of foam that did not require removal. On June 13, 2019, foam was observed at the outfall, and removed from the boom area with the vac-truck. No additional foam removal occurred after June 13, 2019.

Table 3 displays the specific PFAS detected in each sample collected as part of ESI's spill response efforts. As the table indicates, there were no significant difference in the specific PFAS detected in the product sample (Signature) versus what was observed at the plant influent (Plant), captured by the vac-truck at the plant and river outfall (Disposal), at the outfall (Outfall & Outfall-2), and downstream (Downstream-1 and Downstream-2). The second outfall sample collected on June 11, 2019 contained significantly less total PFAS versus the June 9, 2019 outfall sample, and PFAS decreased downstream away from the spill area as the foam dispersed and was diluted. In addition, the Upstream sample confirmed that PFAS are present in the Farmington River surface water upgradient from the spill area, albeit at low concentrations. Copies of the laboratory reports for the PFAS sampling are included at the end of this document.

Based on the results of the spill response sampling, ESI recommends that the hangar area where the release occurred and the interior of the oil water separator be decontaminated to prevent any additional release of any residual AFFF to the sanitary sewer system. Foam has not been observed at the wastewater treatment plant since June 10, 2019 and it does not appear as if decontamination at the plant would be necessary. Once foam consistent with the appearance of the AFFF is not observed at the outfall, then the boom can be removed from the river.

Cindy Knight

Licensed Environmental Professional

Dustin Mitchell

President



Environmental Services, Inc.

90 Brookfield Street South Windsor, CT 06074-1262 (860) 528-9500 (860) 289-0138 (fax) www.e-s-i.com

FIGURES

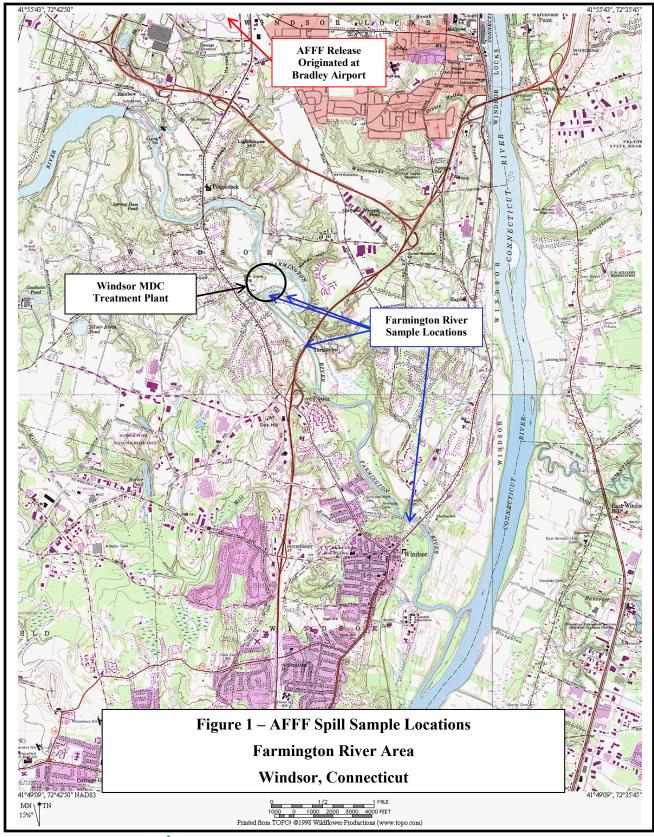




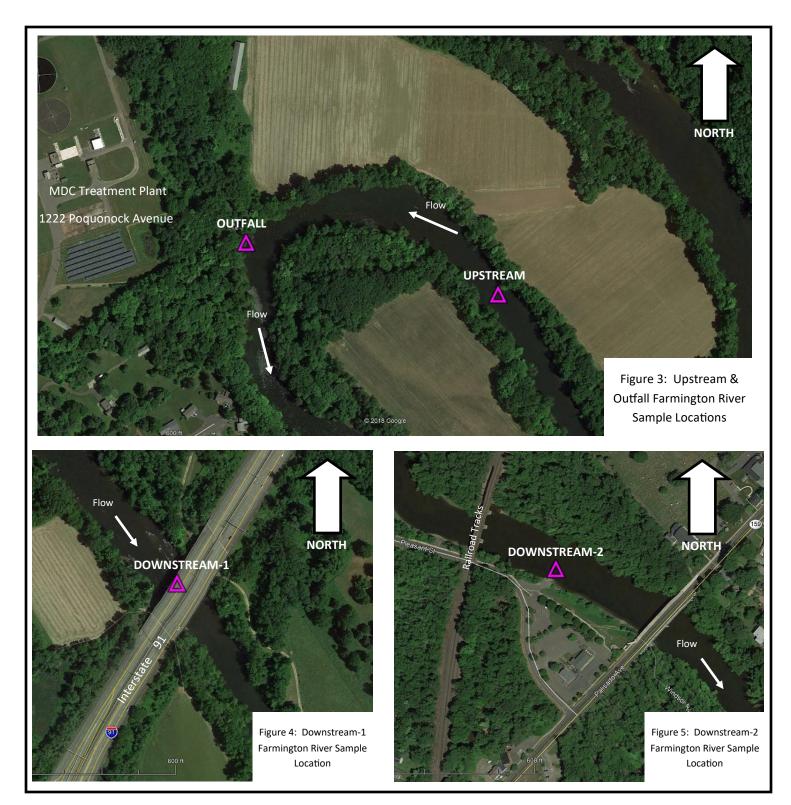


FIGURE 2 - Overview of Four Fire Fighting Foam Emergency Response Sampling Locations

June 9, 2019

Farmington River
Windsor, Connecticut





FIGURES 3, 4 & 5 - Fire Fighting Foam Emergency Response Sampling Locations

June 9, 2019

Farmington River - Windsor, Connecticut





Environmental Services, Inc.

90 Brookfield Street South Windsor, CT 06074-1262 (860) 528-9500 (860) 289-0138 (fax) www.e-s-i.com

TABLES

TABLE 3 AFFF Spill Sampling Data Total PFAS & Specific Compounds Detected June 9, 10 & 11, 2019

Sample I.D.:	Signature	Disposal	Plant	Outfall	Outfall-2	Downstream-1	Downstream-2	Upstream
Sample Date:	6/10/2019	6/9/2019	6/9/2019	6/9/2019	6/11/2019	6/9/2019	6/9/2019	6/9/2019
Total PFAS Detected (ng/L [ppt]))	2,969,400,000	9,630,830	135,998	1,515,700	90,899.4	13,330	10,253	37.72
NEtFOSAA	< 500,000	< 250	< 8.7	< 940	48	< 8.6	< 9.4	< 0.9
Perfluorobutanesulfonic acid	37,000,000	100,000	230	17,000	52	190	170	1.1
Perfluorobutanoic acid	< 1,000,000	26,000	68	5,300	18	61	57	2.0
Perfluorodecanesulfonic acid	2,600,000	530	84	< 570	86	< 5.2	< 5.6	< 0.54
Perfluoroheptanesulfonic acid	53,000,000	250,000	970	17,000	220	140	93	< 0.36
Perfluoroheptanoic acid	14,000,000	35,000	82	4,800	17	56	45	0.92
Perfluorohexanesulfonic acid	310,000,000	1,400,000	3,100	110,000	480(2)	1,200	1,000	1.8
Perfluorohexanoic acid	26,000,000	100,000	260	17,000	70	190	180	2.3
Perfluorononanesulfonic acid	6,700,000	1,600	270	1,000	680	9.2	11	< 0.54
Perfluorononanoic acid	< 200,000	700	19	< 380	5.4	< 3.5	< 3.8	0.9
Perfluorooctanesulfonamide	300,000	< 120	5.6	< 470	25	< 4.3	< 4.7	1.2
Perfluorooctanesulfonic acid	2,400,000,000 (3)	7,300,000(1)	130,000 (1)	1,300,000(1)	89,000(3)	11,000(1)	8,300(1)	22(1)
Perfluorooctanoic acid	62,000,000	260,000	510	19,000	85	200	160	3.0
Perfluoropentanesulfonate	56,000,000	120,000	300	18,000	60	210	170	< 0.36
Perfluoropentanoic acid	1,800,000	37,000	91	6,600	27	74	67	2.5
Perfluoroundecanoic acid	< 200,000	< 100	8.3	< 380	26	< 3.5	< 3.8	< 0.36

- (1) This compound was detected in the laboratory method blank at a concentration of 2.2 ng/L. The reported concentration may show slight high bias.
- (2) This compound was detected in the laboratory method blank at a concentration of 0.44 ng/L. The reported concentration may show slight high bias.
- (3) This compound was detected in the laboratory method blank at a concentration of 3.8 ng/L. The reported concentration may show slight high bias.





Environmental Services, Inc.

90 Brookfield Street South Windsor, CT 06074-1262 (860) 528-9500 (860) 289-0138 (fax) www.e-s-i.com

LABORATORY REPORTS









ANALYSIS REPORT

Prepared by:

Prepared for:

Eurofins Lancaster Laboratories Environmental 2425 New Holland Pike Lancaster, PA 17601 Environmental Services, Inc. 90 Brookfield Street South Windsor CT 06074

Report Date: June 12, 2019 16:18

Project: 2019-0537

Account #: 44484 Group Number: 2048083 PO Number: 79197 State of Sample Origin: CT

Electronic Copy To Environmental Services Inc. Attn: Cindy Knight Electronic Copy To Environmental Services Inc. Attn: Dustin Mitchell

Respectfully Submitted,

Lynn M. Frederiksen

Principal Specialist Group Leader

Lyn M. Frederiksen

(717) 556-7255

To view our laboratory's current scopes of accreditation please go to https://www.eurofinsus.com/environment-testing/laboratories-environmental/certifications-and-accreditations-eurofins-lancaster-laboratories-environmental/. Historical copies may be requested through your project manager.









SAMPLE INFORMATION

Client Sample Description	Sample Collection	ELLE#
	Date/Time	4070000
Upstream Grab Surface Water	06/09/2019 11:50	1076903
Outfall Grab Surface Water	06/09/2019 12:07	1076904
Plant Grab Surface Water	06/09/2019 12:24	1076905
Downstream-1 Grab Surface Water	06/09/2019 13:15	1076906
Downstream-2 Grab Surface Water	06/09/2019 14:05	1076907
Disposal Grab Surface Water	06/09/2019 13:10	1076908

The specific methodologies used in obtaining the enclosed analytical results are indicated on the Laboratory Sample Analysis Record.



Lancaster Laboratories Environmental







2425 New Holland Pike, Lancaster, PA 17601 • 717-656-2300 • Fax: 717-656-6766 • www.EurofinsUS.com/LancLabsEnv

Laboratory Analysis CT QA/QC Certification Form

Laboratory Name: Eurofins Lancaster Laboratories Environmental

Client: Environmental Services, Inc.

Project: 2019-0537

Sampling Date(s): 06/09/19

Laboratory Sample ID(s): 1076903-1076908

		Yes or No
1	For each analytical method referenced in this laboratory report package, were all specified QA/QC performance criteria followed (including the requirement to explain any criteria falling outside of acceptable guidelines, as specified in the CT DEP method-specific Reasonable Confidence Protocol documents)?	Yes
1A	Were method specified preservation and holding time requirements met?	Yes
1B	<u>VPH and EPH Methods only:</u> Was the VPH or EPH Method conducted without significant modifications (see Section 11.3 of respective methods)?	NA
2	Were all samples received by the laboratory in a condition consistent with that described on the associated chain-of-custody document(s)?	Yes
3	Were samples received at an appropriate temperature (<6° C)?	No
4	Were all QA/QC performance criteria specified in the CT DEP Reasonable Confidence Protocol documents achieved?	No
5	Were reporting limits* specified on the chain-of-custody met?	No
6	For each analytical method referenced in this laboratory report package, were results reported for all constituents identified in the method-specific analyte lists presented in the Reasonable Confidence Protocol documents?	Yes
7	Are project specific QC samples included in this data set?	No

Note: For all questions to which the response was "No" (with exception of question #7), additional information must be provided in an attached narrative. If the answer to #1, #1A or question #1B is "No", the data package does not meet the requirements for "Reasonable Confidence."

*The Limit of Quantitation (LOQ) meets requirements for the Reporting Limit (RL) as defined in the CT Reasonable Confidence Protocols, unless otherwise noted.

I, the undersigned, attest under the pains and penalties of perjury that the material contained in this analytical report is, to the best of my knowledge and belief, accurate and complete.

Kenneth Boley

Senior Specialist, Quality Assurance

Case Narrative

2425 New Holland Pike, Lancaster, PA 17601 • 717-656-2300 • Fax: 717-656-6766 • www.EurofinsUS.com/LancLabsEnv

Project Name: 2019-0537 ELLE Group #: 2048083

General Comments:

See the Laboratory Sample Analysis Record section of the Analysis Report for the method references.

All QC met criteria unless otherwise noted in an Analysis Specific Comment below.

Refer to the QC Summary for specific values and acceptance criteria.

Project specific QC samples are not included in this data set.

Matrix QC may not be reported if site-specific QC samples were not submitted. In these situations, to demonstrate precision and accuracy at a batch level, a LCS/LCSD was performed, unless otherwise specified in the method.

Surrogate recoveries (if applicable) which are outside of the QC window are confirmed unless attributed to a dilution or otherwise noted in an Analysis Specific Comment below.

The samples were received at the appropriate temperature and in accordance with the chain of custody unless otherwise noted.

The sample receipt temperature requirement was not met. The temperature of the temperature blank bottle(s) upon receipt at the lab was 7.3C using a digital thermometer. The sample bottles were then measured using an IR thermometer and were recorded at 7.3-14.1 C.

Analysis Specific Comments:

EPA 537 Version 1.1 Modified, LC/MS/MS Miscellaneous

Sample #s: 1076906, 1076907

Perfluorooctanesulfonic acid (PFOS) was detected in the associated method blank as noted on the QC Summary.

The recovery for target analyte PFOS is ouside of QC acceptance limits in the laboratory control spike duplicate as noted on the QC Summary.

Reporting limits were raised due to interference from the sample matrix.

Sample #s: 1076903, 1076904

Perfluorooctanesulfonic acid (PFOS) was detected in the associated method blank as noted on the QC Summary.

The recovery for target analyte PFOS is ouside of QC acceptance limits in the laboratory control spike duplicate as noted on the QC Summary.

The recovery for several extraction standards is outside of QC acceptance limits due to the matrix of the sample.

Reporting limits were raised due to interference from the sample matrix.

Sample #s: 1076905, 1076908

Perfluorooctanesulfonic acid (PFOS) was detected in the associated method blank as noted on the QC Summary.

The recovery for target analyte PFOS is ouside of QC acceptance



Lancaster Laboratories Environmental

Case Narrative

2425 New Holland Pike, Lancaster, PA 17601 • 717-656-2300 • Fax: 717-656-6766 • www.EurofinsUS.com/LancLabsEnv

limits in the laboratory control spike duplicate as noted on the QC Summary.

The recovery for several extraction standards is outside of QC acceptance limits due to the matrix of the sample.

The sample injection standard peak areas were outside of the QC limits for both the initial injection and the re-injection. The values here are from the initial injection of the sample.

Reporting limits were raised due to interference from the sample matrix.

Batch #: 19162014 (Sample number(s): 1076903-1076908)

The recovery(ies) for the following analyte(s) in the LCS and/or LCSD exceeded the acceptance window indicating a positive bias: Perfluorooctanesulfonic acid

The relative percent difference(s) for the following analyte(s) in the LCS/LCSD were outside acceptance windows: Perfluorooctanesulfonic acid

The recovery(ies) for one or more surrogates exceeded the acceptance window indicating a positive bias for sample(s) 1076903, 1076905, 1076908

2425 New Holland Pike, Lancaster, PA 17601 • 717-656-2300 • Fax: 717-656-6766 • www.EurofinsUS.com/LancLabsEnv

Sample Description: Upstream Grab Surface Water

2019-0537

Project Name: 2019-0537

Submittal Date/Time: 06/11/2019 07:50 Collection Date/Time: 06/09/2019 11:50 Environmental Services, Inc.
ELLE Sample #: WW 1076903
ELLE Group #: 2048083
Matrix: Surface Water

Method Limit of CAT Dilution **Analysis Name CAS Number Detection Limit*** Quantitation Result Factor No. EPA 537 Version 1.1 ng/l ng/l ng/l LC/MS/MS Miscellaneous Modified 14473 4:2-Fluorotelomersulfonic acid 757124-72-4 N.D. 0.90 2.7 1 6:2-Fluorotelomersulfonic acid 27619-97-2 N.D. 0.90 14473 1.8 14473 8:2-Fluorotelomersulfonic acid 39108-34-4 N.D. 1.8 5.4 14473 **NEtFOSAA** 2991-50-6 N.D. 0.90 2.7 NEtFOSAA is the acronym for N-ethyl perfluorooctanesulfonamidoacetic Acid. 14473 2355-31-9 N.D. 0.90 2.7 NMeFOSAA is the acronym for N-methyl perfluorooctanesulfonamidoacetic Acid. 14473 Perfluorobutanesulfonic acid 375-73-5 1.1 0.27 0.90 14473 Perfluorobutanoic acid 375-22-4 2.0 J 1.8 5.4 14473 Perfluorodecanesulfonic acid 335-77-3 N.D. 0.54 1.8 14473 Perfluorodecanoic acid 335-76-2 ΝD 0.81 18 14473 Perfluorododecanoic acid 307-55-1 N.D. 0.45 1.8 N.D. 1.8 14473 Perfluoroheptanesulfonic acid 375-92-8 0.36 Perfluoroheptanoic acid 0.92 14473 375-85-9 0.36 0.90 14473 Perfluorohexanesulfonic acid 355-46-4 1.8 0.36 1.8 Perfluorohexanoic acid 14473 307-24-4 23 0.36 1.8 14473 Perfluorononanesulfonic acid 68259-12-1 N.D. 0.54 1.8 14473 Perfluorononanoic acid 375-95-1 0.90 J 0.36 1.8 Perfluorooctanesulfonamide 1.2 14473 754-91-6 0.45 27 14473 Perfluorooctanesulfonic acid 1763-23-1 22 В 0.36 1.8 14473 Perfluorooctanoic acid 335-67-1 3.0 0.27 0.90 14473 Perfluoropentanesulfonate 2706-91-4 N.D. 0.36 1.8 14473 Perfluoropentanoic acid 2706-90-3 25 J 1.8 5.4 14473 Perfluorotetradecanoic acid 376-06-7 ΝD 0.27 0.90 14473 Perfluorotridecanoic acid 72629-94-8 N.D. 0.36 0.90 14473 Perfluoroundecanoic acid 2058-94-8 N.D. 0.36 1.8

Perfluorooctanesulfonic acid (PFOS) was detected in the associated method blank as noted on the QC Summary.

The recovery for target analyte PFOS is ouside of QC acceptance limits in the laboratory control spike duplicate as noted on the QC Summary.

The recovery for several extraction standards is outside of QC acceptance limits due to the matrix of the sample.

Reporting limits were raised due to interference from the sample matrix.

Sample Comments

The sample receipt temperature requirement was not met. The temperature of the temperature blank bottle(s) upon receipt at the lab was 7.3C using a digital thermometer. The sample bottles were then measured using an IR thermometer and were recorded at 7.3-14.1 C.

^{*=}This limit was used in the evaluation of the final result



2425 New Holland Pike, Lancaster, PA 17601 • 717-656-2300 • Fax: 717-656-6766 • www.EurofinsUS.com/LancLabsEnv

Sample Description: Upstream Grab Surface Water

2019-0537

Project Name: 2019-0537

Submittal Date/Time: 06/11/2019 07:50 Collection Date/Time: 06/09/2019 11:50

Environmental Services, Inc.
ELLE Sample #: WW 1076903
ELLE Group #: 2048083

Matrix: Surface Water

Laboratory Sample Analysis Record

CAT No.	Analysis Name	Method	Trial#	Batch#	Analysis Date and Time	Analyst	Dilution Factor
14473	PFAS - 24 compounds	EPA 537 Version 1.1 Modified	1	19162014	06/12/2019 10:43	Devon M Whooley	1
14091	PFAS Water Prep	EPA 537 Version 1.1 Modified	1	19162014	06/11/2019 16:00	Anthony C Polaski	1



2425 New Holland Pike, Lancaster, PA 17601 • 717-656-2300 • Fax: 717-656-6766 • www.EurofinsUS.com/LancLabsEnv

Sample Description: Outfall Grab Surface Water

2019-0537

Project Name: 2019-0537

Submittal Date/Time: 06/11/2019 07:50 Collection Date/Time: 06/09/2019 12:07 Environmental Services, Inc.
ELLE Sample #: WW 1076904
ELLE Group #: 2048083
Matrix: Surface Water

CAT No.	Analysis Name	CAS Number	Result	Method Detection Limit*	Limit of Quantitation	Dilution Factor
LC/MS	////	Version 1.1	ng/l	ng/l	ng/l	
	Modified					
14473	4:2-Fluorotelomersulfonic acid	757124-72-4	N.D.	940	2,800	1000
14473	6:2-Fluorotelomersulfonic acid	27619-97-2	N.D.	940	1,900	1000
14473	8:2-Fluorotelomersulfonic acid	39108-34-4	N.D.	1,900	5,700	1000
14473	NEtFOSAA	2991-50-6	N.D.	940	2,800	1000
	NEtFOSAA is the acronym for N-ethyl	perfluorooctanesulfonar	midoacetic Acid.			
14473	NMeFOSAA	2355-31-9	N.D.	940	2,800	1000
	NMeFOSAA is the acronym for N-met	hyl perfluorooctanesulfo	namidoacetic Acid.			
14473	Perfluorobutanesulfonic acid	375-73-5	17,000	280	940	1000
14473	Perfluorobutanoic acid	375-22-4	5,300 J	1,900	5,700	1000
14473	Perfluorodecanesulfonic acid	335-77-3	N.D.	570	1,900	1000
14473	Perfluorodecanoic acid	335-76-2	N.D.	850	1,900	1000
14473	Perfluorododecanoic acid	307-55-1	N.D.	470	1,900	1000
14473	Perfluoroheptanesulfonic acid	375-92-8	17,000	380	1,900	1000
14473	Perfluoroheptanoic acid	375-85-9	4,800	380	940	1000
14473	Perfluorohexanesulfonic acid	355-46-4	110,000	380	1,900	1000
14473	Perfluorohexanoic acid	307-24-4	17,000	380	1,900	1000
14473	Perfluorononanesulfonic acid	68259-12-1	1,000 J	570	1,900	1000
14473	Perfluorononanoic acid	375-95-1	N.D.	380	1,900	1000
14473	Perfluorooctanesulfonamide	754-91-6	N.D.	470	2,800	1000
14473	Perfluorooctanesulfonic acid	1763-23-1	1,300,000 B	3,800	19,000	10000
14473	Perfluorooctanoic acid	335-67-1	19,000	280	940	1000
14473	Perfluoropentanesulfonate	2706-91-4	18,000	380	1,900	1000
14473	Perfluoropentanoic acid	2706-90-3	6,600	1,900	5,700	1000
14473	Perfluorotetradecanoic acid	376-06-7	N.D.	280	940	1000
14473	Perfluorotridecanoic acid	72629-94-8	N.D.	380	940	1000
14473	Perfluoroundecanoic acid	2058-94-8	N.D.	380	1,900	1000

Perfluorooctanesulfonic acid (PFOS) was detected in the associated method blank as noted on the QC Summary.

The recovery for target analyte PFOS is ouside of QC acceptance limits in the laboratory control spike duplicate as noted on the QC Summary.

The recovery for several extraction standards is outside of QC acceptance limits due to the matrix of the sample.

Reporting limits were raised due to interference from the sample matrix.

Sample Comments

The sample receipt temperature requirement was not met. The temperature of the temperature blank bottle(s) upon receipt at the lab was 7.3C using a digital thermometer. The sample bottles were then measured using an IR thermometer and were recorded at 7.3-14.1 C.

^{*=}This limit was used in the evaluation of the final result



2425 New Holland Pike, Lancaster, PA 17601 • 717-656-2300 • Fax: 717-656-6766 • www.EurofinsUS.com/LancLabsEnv

Sample Description: Outfall Grab Surface Water

2019-0537

Modified

Project Name: 2019-0537

Submittal Date/Time: 06/11/2019 07:50 Collection Date/Time: 06/09/2019 12:07

Environmental Services, Inc.
ELLE Sample #: WW 1076904
ELLE Group #: 2048083

Matrix: Surface Water

	Laboratory Sample Analysis Record									
CAT No.	Analysis Name	Method	Trial#	Batch#	Analysis Date and Time	Analyst	Dilution Factor			
14473	PFAS - 24 compounds	EPA 537 Version 1.1 Modified	1	19162014	06/12/2019 11:01	Devon M Whooley	1000			
14473	PFAS - 24 compounds	EPA 537 Version 1.1 Modified	1	19162014	06/12/2019 11:56	Devon M Whooley	10000			
14091	PFAS Water Prep	EPA 537 Version 1.1	1	19162014	06/11/2019 16:00	Anthony C Polaski	1			

^{*=}This limit was used in the evaluation of the final result



2425 New Holland Pike, Lancaster, PA 17601 • 717-656-2300 • Fax: 717-656-6766 • www.EurofinsUS.com/LancLabsEnv

Sample Description: **Plant Grab Surface Water**

2019-0537

2019-0537 **Project Name:**

Submittal Date/Time: 06/11/2019 07:50 Collection Date/Time: 06/09/2019 12:24 **Environmental Services, Inc.** ELLE Sample #: WW 1076905 **ELLE Group #:** 2048083

Matrix: Surface Water

CAT No.	Analysis Name	CAS Numi	ber Result	Method Detection	Limit of Limit* Quantitation	Dilution Factor
LC/MS	mile imecomanicous	EPA 537 Version 1.1 Modified	ng/l	ng/l	ng/l	
14473	4:2-Fluorotelomersulfonic a	cid 757124-72	-4 N.D.	8.7	26	10
14473	6:2-Fluorotelomersulfonic a	cid 27619-97-2	2 N.D.	8.7	17	10
14473	8:2-Fluorotelomersulfonic a	cid 39108-34-4	4 N.D.	17	52	10
14473	NEtFOSAA	2991-50-6	N.D.	8.7	26	10
	NEtFOSAA is the acronym	for N-ethyl perfluorooctanesu	ulfonamidoacetic	Acid.		
14473	NMeFOSAA	2355-31-9	N.D.	8.7	26	10
	NMeFOSAA is the acronym	for N-methyl perfluorooctan	esulfonamidoac	etic Acid.		
14473	Perfluorobutanesulfonic aci	d 375-73-5	230	2.6	8.7	10
14473	Perfluorobutanoic acid	375-22-4	68	17	52	10
14473	Perfluorodecanesulfonic ac	id 335-77-3	84	5.2	17	10
14473	Perfluorodecanoic acid	335-76-2	N.D.	7.8	17	10
14473	Perfluorododecanoic acid	307-55-1	N.D.	4.3	17	10
14473	Perfluoroheptanesulfonic ad	oid 375-92-8	970	3.5	17	10
14473	Perfluoroheptanoic acid	375-85-9	82	3.5	8.7	10
14473	Perfluorohexanesulfonic ac	id 355-46-4	3,100	3.5	17	10
14473	Perfluorohexanoic acid	307-24-4	260	3.5	17	10
14473	Perfluorononanesulfonic ac	id 68259-12-	1 270	5.2	17	10
14473	Perfluorononanoic acid	375-95-1	19	3.5	17	10
14473	Perfluorooctanesulfonamide	e 754-91-6	5.6	J 4.3	26	10
14473	Perfluorooctanesulfonic acid	d 1763-23-1	130,00	0 B 350	1,700	1000
14473	Perfluorooctanoic acid	335-67-1	510	2.6	8.7	10
14473	Perfluoropentanesulfonate	2706-91-4	300	3.5	17	10
14473	Perfluoropentanoic acid	2706-90-3	91	17	52	10
14473	Perfluorotetradecanoic acid	376-06-7	N.D.	2.6	8.7	10
14473	Perfluorotridecanoic acid	72629-94-8	8 N.D.	3.5	8.7	10
14473	Perfluoroundecanoic acid	2058-94-8	8.3	J 3.5	17	10
Perfl	uorooctanesulfonic acid (PFO)	S) was detected in the associ	iated			

Perfluorooctanesulfonic acid (PFOS) was detected in the associated method blank as noted on the QC Summary.

The recovery for target analyte PFOS is ouside of QC acceptance limits in the laboratory control spike duplicate as noted on the QC Summary.

The recovery for several extraction standards is outside of QC acceptance limits due to the matrix of the sample.

The sample injection standard peak areas were outside of the QC limits for both the initial injection and the re-injection. The values here are from the initial injection of the sample.

Reporting limits were raised due to interference from the sample matrix.

^{*=}This limit was used in the evaluation of the final result



2425 New Holland Pike, Lancaster, PA 17601 • 717-656-2300 • Fax: 717-656-6766 • www.EurofinsUS.com/LancLabsEnv

Sample Description: Plant Grab Surface Water

2019-0537

Project Name: 2019-0537

Submittal Date/Time: 06/11/2019 07:50 Collection Date/Time: 06/09/2019 12:24

Environmental Services, Inc.

ELLE Sample #: WW 1076905

ELLE Group #: 2048083

Matrix: Surface Water

Sample Comments

The sample receipt temperature requirement was not met. The temperature of the temperature blank bottle(s) upon receipt at the lab was 7.3C using a digital thermometer. The sample bottles were then measured using an IR thermometer and were recorded at 7.3-14.1 C.

Laboratory Sample Analysis Record

			•				
CAT No.	Analysis Name	Method	Trial#	Batch#	Analysis Date and Time	Analyst	Dilution Factor
14473	PFAS - 24 compounds	EPA 537 Version 1.1 Modified	1	19162014	06/12/2019 09:12	Devon M Whooley	10
14473	PFAS - 24 compounds	EPA 537 Version 1.1 Modified	1	19162014	06/12/2019 11:19	Devon M Whooley	1000
14091	PFAS Water Prep	EPA 537 Version 1.1 Modified	1	19162014	06/11/2019 16:00	Anthony C Polaski	1

^{*=}This limit was used in the evaluation of the final result



2425 New Holland Pike, Lancaster, PA 17601 • 717-656-2300 • Fax: 717-656-6766 • www.EurofinsUS.com/LancLabsEnv

Sample Description: **Downstream-1 Grab Surface Water**

2019-0537

2019-0537 **Project Name:**

Submittal Date/Time: 06/11/2019 07:50 Collection Date/Time: 06/09/2019 13:15 **Environmental Services, Inc.** ELLE Sample #: WW 1076906 **ELLE Group #:** 2048083

Matrix: Surface Water

CAT No.	Analysis Name		CAS Number	Result	Method Detection Lim	Limit of it* Quantitation	Dilution Factor
LC/MS	/MS Miscellaneous	EPA 537 Ver Modified	sion 1.1	ng/l	ng/l	ng/l	
14473	4:2-Fluorotelomersulfonic		757124-72-4	N.D.	8.6	26	10
14473	6:2-Fluorotelomersulfonic		27619-97-2	N.D. N.D.	8.6	26 17	10
14473	8:2-Fluorotelomersulfonic		39108-34-4	N.D. N.D.	8.6 17	17 52	10
14473	NEtFOSAA	aciu	2991-50-6	N.D.	8.6	26	10
14473	NEtFOSAA is the acronyr	n for N othyl norfly			0.0	20	10
4.4470	•	ii ioi in-eiliyi perilu			0.0	00	40
14473	NMeFOSAA		2355-31-9	N.D.	8.6	26	10
	NMeFOSAA is the acrony						
14473	Perfluorobutanesulfonic a	cid	375-73-5	190	2.6	8.6	10
14473	Perfluorobutanoic acid		375-22-4	61	17	52	10
14473	Perfluorodecanesulfonic a	acid	335-77-3	N.D.	5.2	17	10
14473	Perfluorodecanoic acid		335-76-2	N.D.	7.8	17	10
14473	Perfluorododecanoic acid		307-55-1	N.D.	4.3	17	10
14473	Perfluoroheptanesulfonic	acid	375-92-8	140	3.5	17	10
14473	Perfluoroheptanoic acid		375-85-9	56	3.5	8.6	10
14473	Perfluorohexanesulfonic a	acid	355-46-4	1,200	3.5	17	10
14473	Perfluorohexanoic acid		307-24-4	190	3.5	17	10
14473	Perfluorononanesulfonic a	acid	68259-12-1	9.2 J	5.2	17	10
14473	Perfluorononanoic acid		375-95-1	N.D.	3.5	17	10
14473	Perfluorooctanesulfonami	de	754-91-6	N.D.	4.3	26	10
14473	Perfluorooctanesulfonic a	cid	1763-23-1	11,000 B	35	170	100
14473	Perfluorooctanoic acid		335-67-1	200	2.6	8.6	10
14473	Perfluoropentanesulfonate	е	2706-91-4	210	3.5	17	10
14473	Perfluoropentanoic acid		2706-90-3	74	17	52	10
14473	Perfluorotetradecanoic ac	id	376-06-7	N.D.	2.6	8.6	10
14473	Perfluorotridecanoic acid		72629-94-8	N.D.	3.5	8.6	10
14473	Perfluoroundecanoic acid		2058-94-8	N.D.	3.5	17	10
Perflu	uorooctanesulfonic acid (PF	OS) was detected	in the associated				

method blank as noted on the QC Summary.

The recovery for target analyte PFOS is ouside of QC acceptance limits in the laboratory control spike duplicate as noted on the QC Summary.

Reporting limits were raised due to interference from the sample matrix.

Sample Comments

The sample receipt temperature requirement was not met. The temperature of the temperature blank bottle(s) upon receipt at the lab was 7.3C using a digital thermometer. The sample bottles were then measured using an IR thermometer and were recorded at 7.3-14.1 C.

^{*=}This limit was used in the evaluation of the final result



2425 New Holland Pike, Lancaster, PA 17601 • 717-656-2300 • Fax: 717-656-6766 • www.EurofinsUS.com/LancLabsEnv

Sample Description: Downstream-1 Grab Surface Water

2019-0537

Project Name: 2019-0537

Submittal Date/Time: 06/11/2019 07:50 Collection Date/Time: 06/09/2019 13:15

Environmental Services, Inc.
ELLE Sample #: WW 1076906
ELLE Group #: 2048083

Matrix: Surface Water

Laboratory Sample Analysis Record

			•				
CAT No.	Analysis Name	Method	Trial#	Batch#	Analysis Date and Time	Analyst	Dilution Factor
14473	PFAS - 24 compounds	EPA 537 Version 1.1 Modified	1	19162014	06/12/2019 09:30	Devon M Whooley	10
14473	PFAS - 24 compounds	EPA 537 Version 1.1 Modified	1	19162014	06/12/2019 09:48	Devon M Whooley	100
14091	PFAS Water Prep	EPA 537 Version 1.1 Modified	1	19162014	06/11/2019 16:00	Anthony C Polaski	1



2425 New Holland Pike, Lancaster, PA 17601 • 717-656-2300 • Fax: 717-656-6766 • www.EurofinsUS.com/LancLabsEnv

Sample Description: **Downstream-2 Grab Surface Water**

2019-0537

2019-0537 **Project Name:**

Submittal Date/Time: 06/11/2019 07:50 Collection Date/Time: 06/09/2019 14:05 **Environmental Services, Inc.** ELLE Sample #: WW 1076907 **ELLE Group #:** 2048083

Matrix: Surface Water

CAT No.	Analysis Name	CAS	S Number		Method Detection Limit*	Limit of Quantitation	Dilution Factor
LC/MS		PA 537 Version lodified	n 1.1	ng/l	ng/l	ng/l	
14473	4:2-Fluorotelomersulfonic ac	id 757	124-72-4	N.D.	9.4	28	10
14473	6:2-Fluorotelomersulfonic ac	id 276	19-97-2	N.D.	9.4	19	10
14473	8:2-Fluorotelomersulfonic ac	id 391	08-34-4	N.D.	19	56	10
14473	NEtFOSAA	299	1-50-6	N.D.	9.4	28	10
	NEtFOSAA is the acronym fo	or N-ethyl perfluoroo	ctanesulfonamid	oacetic Acid.			
14473	NMeFOSAA	235	5-31-9	N.D.	9.4	28	10
	NMeFOSAA is the acronym	or N-methyl perfluor	ooctanesulfonan	nidoacetic Acid.			
14473	Perfluorobutanesulfonic acid	375	-73-5	170	2.8	9.4	10
14473	Perfluorobutanoic acid	375	-22-4	57	19	56	10
14473	Perfluorodecanesulfonic acid	335	i-77-3	N.D.	5.6	19	10
14473	Perfluorodecanoic acid	335	i-76-2	N.D.	8.5	19	10
14473	Perfluorododecanoic acid	307	'-55-1	N.D.	4.7	19	10
14473	Perfluoroheptanesulfonic aci	d 375	-92-8	93	3.8	19	10
14473	Perfluoroheptanoic acid	375	i-85-9	45	3.8	9.4	10
14473	Perfluorohexanesulfonic acid	355	-46-4	1,000	3.8	19	10
14473	Perfluorohexanoic acid	307	-24-4	180	3.8	19	10
14473	Perfluorononanesulfonic acid	l 682	59-12-1	11 J	5.6	19	10
14473	Perfluorononanoic acid	375	i-95-1	N.D.	3.8	19	10
14473	Perfluorooctanesulfonamide	754	-91-6 I	N.D.	4.7	28	10
14473	Perfluorooctanesulfonic acid	176	3-23-1	8,300 B	38	190	100
14473	Perfluorooctanoic acid	335	-67-1	160	2.8	9.4	10
14473	Perfluoropentanesulfonate	270	6-91-4	170	3.8	19	10
14473	Perfluoropentanoic acid	270	6-90-3	67	19	56	10
14473	Perfluorotetradecanoic acid	376	i-06-7	N.D.	2.8	9.4	10
14473	Perfluorotridecanoic acid	726	29-94-8	N.D.	3.8	9.4	10
14473	Perfluoroundecanoic acid	205	8-94-8	N.D.	3.8	19	10
Perflu	iorooctanesulfonic acid (PFOS) was detected in the	e associated				

method blank as noted on the QC Summary.

The recovery for target analyte PFOS is ouside of QC acceptance limits in the laboratory control spike duplicate as noted on the QC Summary.

Reporting limits were raised due to interference from the sample matrix.

Sample Comments

The sample receipt temperature requirement was not met. The temperature of the temperature blank bottle(s) upon receipt at the lab was 7.3C using a digital thermometer. The sample bottles were then measured using an IR thermometer and were recorded at 7.3-14.1 C.

^{*=}This limit was used in the evaluation of the final result



2425 New Holland Pike, Lancaster, PA 17601 • 717-656-2300 • Fax: 717-656-6766 • www.EurofinsUS.com/LancLabsEnv

Sample Description: Downstream-2 Grab Surface Water

2019-0537

Project Name: 2019-0537

Submittal Date/Time: 06/11/2019 07:50 Collection Date/Time: 06/09/2019 14:05

Environmental Services, Inc.
ELLE Sample #: WW 1076907
ELLE Group #: 2048083

Matrix: Surface Water

Laboratory Sample Analysis Record

			•				
CAT No.	Analysis Name	Method	Trial#	Batch#	Analysis Date and Time	Analyst	Dilution Factor
14473	PFAS - 24 compounds	EPA 537 Version 1.1 Modified	1	19162014	06/12/2019 09:57	Devon M Whooley	10
14473	PFAS - 24 compounds	EPA 537 Version 1.1 Modified	1	19162014	06/12/2019 10:06	Devon M Whooley	100
14091	PFAS Water Prep	EPA 537 Version 1.1 Modified	1	19162014	06/11/2019 16:00	Anthony C Polaski	1



2425 New Holland Pike, Lancaster, PA 17601 • 717-656-2300 • Fax: 717-656-6766 • www.EurofinsUS.com/LancLabsEnv

Sample Description: Disposal Grab Surface Water

2019-0537

Project Name: 2019-0537

Submittal Date/Time: 06/11/2019 07:50 Collection Date/Time: 06/09/2019 13:10

Environmental Services, Inc.

ELLE Sample #: WW 1076908

ELLE Group #: 2048083

Matrix: Surface Water

CAT No.	Analysis Name		CAS Number	Result	Method Detection Limit*	Limit of Quantitation	Dilution Factor
LC/MS	Time impounding	EPA 537 Vers Modified	sion 1.1	ng/l	ng/l	ng/l	
14473	4:2-Fluorotelomersulfonic a	cid	757124-72-4	N.D.	250	750	100
14473	6:2-Fluorotelomersulfonic a	cid	27619-97-2	N.D.	250	500	100
14473	8:2-Fluorotelomersulfonic a	cid	39108-34-4	N.D.	500	1,500	100
14473	NEtFOSAA		2991-50-6	N.D.	250	750	100
	NEtFOSAA is the acronym	for N-ethyl perfluc	orooctanesulfonan	nidoacetic Acid.			
14473	NMeFOSAA		2355-31-9	N.D.	250	750	100
	NMeFOSAA is the acronym	for N-methyl per	fluorooctanesulfor	amidoacetic Acid.			
14473	Perfluorobutanesulfonic aci	d	375-73-5	100,000	7,500	25,000	10000
14473	Perfluorobutanoic acid		375-22-4	26,000	500	1,500	100
14473	Perfluorodecanesulfonic ac	id	335-77-3	530	150	500	100
14473	Perfluorodecanoic acid		335-76-2	N.D.	220	500	100
14473	Perfluorododecanoic acid		307-55-1	N.D.	120	500	100
14473	Perfluoroheptanesulfonic ad	cid	375-92-8	250,000	10,000	50,000	10000
14473	Perfluoroheptanoic acid		375-85-9	35,000	100	250	100
14473	Perfluorohexanesulfonic ac	id	355-46-4	1,400,000	10,000	50,000	10000
14473	Perfluorohexanoic acid		307-24-4	100,000	10,000	50,000	10000
14473	Perfluorononanesulfonic ac	id	68259-12-1	1,600	150	500	100
14473	Perfluorononanoic acid		375-95-1	700	100	500	100
14473	Perfluorooctanesulfonamide	e	754-91-6	N.D.	120	750	100
14473	Perfluorooctanesulfonic acid	d	1763-23-1	7,300,000 B	10,000	50,000	10000
14473	Perfluorooctanoic acid		335-67-1	260,000	7,500	25,000	10000
14473	Perfluoropentanesulfonate		2706-91-4	120,000	10,000	50,000	10000
14473	Perfluoropentanoic acid		2706-90-3	37,000	500	1,500	100
14473	Perfluorotetradecanoic acid		376-06-7	N.D.	75	250	100
14473	Perfluorotridecanoic acid		72629-94-8	N.D.	100	250	100
14473	Perfluoroundecanoic acid		2058-94-8	N.D.	100	500	100
Perfli	uorooctanesulfonic acid (PEO	S) was detected in	n the associated				

Perfluorooctanesulfonic acid (PFOS) was detected in the associated method blank as noted on the QC Summary.

The recovery for target analyte PFOS is ouside of QC acceptance limits in the laboratory control spike duplicate as noted on the QC Summary.

The recovery for several extraction standards is outside of QC acceptance limits due to the matrix of the sample.

The sample injection standard peak areas were outside of the QC limits for both the initial injection and the re-injection. The values here are from the initial injection of the sample.

Reporting limits were raised due to interference from the sample matrix.

^{*=}This limit was used in the evaluation of the final result



2425 New Holland Pike, Lancaster, PA 17601 • 717-656-2300 • Fax: 717-656-6766 • www.EurofinsUS.com/LancLabsEnv

Sample Description: **Disposal Grab Surface Water**

2019-0537

2019-0537 **Project Name:**

CAT

Submittal Date/Time: 06/11/2019 07:50 Collection Date/Time: 06/09/2019 13:10 **Environmental Services, Inc. ELLE Sample #:** WW 1076908 **ELLE Group #:** 2048083

Matrix: Surface Water

Sample Comments

Laboratory Sample Analysis Record

The sample receipt temperature requirement was not met. The temperature of the temperature blank bottle(s) upon receipt at the lab was 7.3C using a digital thermometer. The sample bottles were then measured using an IR thermometer and were recorded at 7.3-14.1 C.

Method

		Dilution
		Factor
sion 1.1	Dolman	100
SION 1.1	Joiman	

Analysis Name No. 14473 PFAS - 24 compounds EPA 537 Vers Modified 14473 PFAS - 24 compounds EPA 537 Version 1.1 19162014 06/12/2019 11:47 Christine E Dolman 10000 Modified 14091 PFAS Water Prep EPA 537 Version 1.1 19162014 06/11/2019 16:00 Anthony C Polaski Modified

Quality Control Summary

Client Name: Environmental Services, Inc. Group Number: 2048083

Reported: 06/12/2019 16:18

Matrix QC may not be reported if insufficient sample or site-specific QC samples were not submitted. In these situations, to demonstrate precision and accuracy at a batch level, a LCS/LCSD was performed, unless otherwise specified in the method.

All Inorganic Initial Calibration and Continuing Calibration Blanks met acceptable method criteria unless otherwise noted on the Analysis Report.

Method Blank

Analysis Name	Result	MDL**	LOQ
	ng/l	ng/l	ng/l
Batch number: 19162014	Sample num	ber(s): 1076903-	-1076908
4:2-Fluorotelomersulfonic acid	N.D.	1.0	3.0
6:2-Fluorotelomersulfonic acid	N.D.	1.0	2.0
8:2-Fluorotelomersulfonic acid	N.D.	2.0	6.0
NEtFOSAA	N.D.	1.0	3.0
NMeFOSAA	N.D.	1.0	3.0
Perfluorobutanesulfonic acid	N.D.	0.30	1.0
Perfluorobutanoic acid	N.D.	2.0	6.0
Perfluorodecanesulfonic acid	N.D.	0.60	2.0
Perfluorodecanoic acid	N.D.	0.90	2.0
Perfluorododecanoic acid	N.D.	0.50	2.0
Perfluoroheptanesulfonic acid	N.D.	0.40	2.0
Perfluoroheptanoic acid	N.D.	0.40	1.0
Perfluorohexanesulfonic acid	N.D.	0.40	2.0
Perfluorohexanoic acid	N.D.	0.40	2.0
Perfluorononanesulfonic acid	N.D.	0.60	2.0
Perfluorononanoic acid	N.D.	0.40	2.0
Perfluorooctanesulfonamide	N.D.	0.50	3.0
Perfluorooctanesulfonic acid	2.2	0.40	2.0
Perfluorooctanoic acid	N.D.	0.30	1.0
Perfluoropentanesulfonate	N.D.	0.40	2.0
Perfluoropentanoic acid	N.D.	2.0	6.0
Perfluorotetradecanoic acid	N.D.	0.30	1.0
Perfluorotridecanoic acid	N.D.	0.40	1.0
Perfluoroundecanoic acid	N.D.	0.40	2.0

LCS/LCSD

Analysis Name	LCS Spike Added ng/l	LCS Conc ng/l	LCSD Spike Added ng/l	LCSD Conc ng/l	LCS %REC	LCSD %REC	LCS/LCSD Limits	RPD	RPD Max
Batch number: 19162014	Sample number	(s): 1076903-1	1076908						
4:2-Fluorotelomersulfonic acid	14.94	13.67	14.94	14.78	91	99	82-152	8	30
6:2-Fluorotelomersulfonic acid	15.17	14.67	15.17	15.56	97	103	66-155	6	30
8:2-Fluorotelomersulfonic acid	15.33	15.48	15.33	16.9	101	110	66-148	9	30
NEtFOSAA	5.44	5.78	5.44	6.40	106	118	55-169	10	30
NMeFOSAA	5.44	6.44	5.44	5.92	118	109	44-147	8	30

^{*-} Outside of specification

^{**-}This limit was used in the evaluation of the final result for the blank

⁽¹⁾ The result for one or both determinations was less than five times the LOQ.

⁽²⁾ The unspiked result was more than four times the spike added.

Quality Control Summary

Client Name: Environmental Services, Inc. Group Number: 2048083

Reported: 06/12/2019 16:18

LCS/LCSD (continued)

Analysis Name	LCS Spike Added ng/l	LCS Conc ng/l	LCSD Spike Added ng/l	LCSD Conc ng/l	LCS %REC	LCSD %REC	LCS/LCSD Limits	RPD	RPD Max
Perfluorobutanesulfonic acid	4.81	5.33	4.81	5.24	111	109	73-128	2	30
Perfluorobutanoic acid	5.44	6.83	5.44	6.51	126	120	74-142	5	30
Perfluorodecanesulfonic acid	5.24	5.72	5.24	6.09	109	116	60-135	6	30
Perfluorodecanoic acid	5.44	6.00	5.44	5.67	110	104	69-148	6	30
Perfluorododecanoic acid	5.44	6.07	5.44	6.44	112	118	75-136	6	30
Perfluoroheptanesulfonic acid	5.18	5.60	5.18	6.46	108	125	64-135	14	30
Perfluoroheptanoic acid	5.44	6.51	5.44	6.56	120	121	76-140	1	30
Perfluorohexanesulfonic acid	5.14	5.17	5.14	5.88	100	114	71-131	13	30
Perfluorohexanoic acid	5.44	6.53	5.44	6.49	120	119	75-135	1	30
Perfluorononanesulfonic acid	5.22	6.01	5.22	6.28	115	120	66-133	4	30
Perfluorononanoic acid	5.44	7.15	5.44	6.52	131	120	72-148	9	30
Perfluorooctanesulfonamide	5.44	5.71	5.44	5.66	105	104	65-164	1	30
Perfluorooctanesulfonic acid	5.20	6.00	5.20	9.54	115	183*	67-138	46*	30
Perfluorooctanoic acid	5.44	5.99	5.44	6.63	110	122	72-138	10	30
Perfluoropentanesulfonate	5.10	5.74	5.10	5.80	113	114	76-127	1	30
Perfluoropentanoic acid	5.44	6.46	5.44	5.99	119	110	74-134	8	30
Perfluorotetradecanoic acid	5.44	6.20	5.44	5.20	114	96	74-135	18	30
Perfluorotridecanoic acid	5.44	5.49	5.44	5.68	101	104	61-145	3	30
Perfluoroundecanoic acid	5.44	6.01	5.44	6.18	111	114	75-146	3	30

Labeled Isotope Quality Control

Labeled isotope recoveries which are outside of the QC window are confirmed unless otherwise noted on the analysis report.

Analysis Name: PFAS - 24 compounds

Batch number: 19162014

	13C4-PFBA	13C5-PFPeA	13C3-PFBS	13C2-4:2-FTS	13C5-PFHxA	13C3-PFHxS
1076903	83	106	139	248*	75	58
1076904	90	90	89	115	89	89
1076905	95	80	99	399*	98	95
1076906	96	98	99	154	95	94
1076907	94	98	101	151	95	100
1076908	96	85	81	455*	115	57
Blank	82	86	80	105	82	85
LCS	86	86	86	122	89	92
LCSD	84	85	84	115	85	82
Limits:	33-123	31-157	26-148	21-182	35-138	34-126

^{*-} Outside of specification

^{**-}This limit was used in the evaluation of the final result for the blank

⁽¹⁾ The result for one or both determinations was less than five times the LOQ.

⁽²⁾ The unspiked result was more than four times the spike added.

Quality Control Summary

Client Name: Environmental Services, Inc. Group Number: 2048083

Reported: 06/12/2019 16:18

eurofins

Labeled Isotope Quality Control (continued)

Labeled isotope recoveries which are outside of the QC window are confirmed unless otherwise noted on the analysis report.

Analysis Name: PFAS - 24 compounds

Batch number: 19162014

	13C4-PFHpA	13C2-6:2-FTS	13C8-PFOA	13C8-PFOS	13C9-PFNA	13C6-PFDA
1076903	40	183*	78	79	83	75
1076904	85	120	90	93	99	97
1076905	84	266*	92	214*	157*	96
1076906	85	133	92	101	105	98
1076907	94	132	98	96	94	99
1076908	70	179*	96	382*	166*	96
Blank	72	113	82	84	79	90
LCS	81	123	93	88	84	84
LCSD	72	108	86	80	79	87
_imits:	35-126	32-170	48-122	50-121	41-144	47-125
	13C2-8:2-FTS	d3-NMeFOSAA	13C7-PFUnDA	d5-NEtFOSAA	13C2-PFDoDA	13C2-PFTeDA
1076903	123	91	67	96	65	51
1076904	112	112	96	118	98	97
1076905	201*	111	88	91	60	85
076906	107	119	89	107	94	86
1076907	107	110	94	115	89	109
1076908	210*	131*	93	128	99	107
Blank	100	99	76	96	84	84
_CS	96	91	75	93	87	81
CSD	93	98	78	90	84	91
_imits:	27-164	30-127	30-128	30-142	39-130	26-119

	13C8-PFOSA
1076903	45
1076904	95
1076905	69
1076906	89
1076907	96
1076908	86
Blank	75
LCS	71
LCSD	75
Limits:	11-127

^{*-} Outside of specification

^{**-}This limit was used in the evaluation of the final result for the blank

⁽¹⁾ The result for one or both determinations was less than five times the LOQ.

⁽²⁾ The unspiked result was more than four times the spike added.

.00				~ *		
	$\boldsymbol{\alpha}$	1 1	rn	tı	n	C
66.0	•	и	10			

Environmental Analysis Request/Chain of Custody


For Eurofins Lancaster Laboratories Environmental use only

| Lancaster Laboratories | Laboratories | Lancaster Labora Environmental

COC # 545002

Client Information	n			Matrix _,									Requested			For Lab Use Only			
Client:	Acct. #:	30714160400040000000000000000000000000000	e coultive, con a contract						Preservat				ation Co	des	addity/menses/milline/acty/ilea/s-	FS	FSC:		
Environmental Services Inc					L——I				0							sc	R#:		
Project Name/#:	PWSID #:	,			Tissue	Ground			7	13				ASTRONOUS AND CONTRACTOR			Preserv	ation C	odes
2019-0537	İ				Ë	Ground			ar.	` 🤅		01/					H=HCI	T=Th	iosulfate
Project Manager:	P.O. #:					Su G				8	. T.	=					N=HNO ₃	B=Na	aOH
Dustin Mitchell	1 79	197						Sic	◁	ĭ	0 3	+9					S=H ₂ SO ₄	O =O	ther
Sampler:	Quote #:	· V I		ī	Ë	ᅵᅵᅵ		Ĭ	5	3	7. 5	3					Re	marks	***************************************
C. Knight				- 1	Sediment	Potable NPDES	li	nta	Q U	ام ا	8 3	5M					= other	: 7	Ci2ma
State where samples were collected: For Compliance:		· · · · · · · · · · · · · · · · · · ·			Ď	Potable NPDES		ટિ		FA	2	3.6				١٧) = () [9/64	15 1	1751770
CT Yes □	No 🔯			慧	ű	& \(\begin{array}{c}		of Containers	*	PF	~ \	Va							
	Call	ected		ğ l		<u>.</u>	:		Ş	1 1	53	3							
Sample Identification	Coll		Grab	Composite	Soil	Water	Other:	Total#	PFO	7	W,	1							
	Date	Time	<u> </u> 💆	ပို	<u>ග</u>	Š	ō	P	4	14							NOTATION AND AND AND AND AND AND AND AND AND AN	oneste and a constitution	
Upstream	6-9-19	11:50am	X			Surface		a	X										
Outfall	١	12:07pm				1		ì	١										
Plant		12:24pm		7															
		1:15pm		\dashv															
Downstream-				┪		 			\vdash				+						
Downstream -2		2:05pm		\dashv		 			\forall						+	\dashv			
Disposa	√	1:10pm	V			W		Ψ	_										
•																			
1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1 1																			
				Ť				İ										O. C.	
Turnaround Time (TAT) Requested	(please circ	le)	Relinqui	shed b	y /	12 11	}			Date	2020	Time	Received	by		nanana binanana	Dat	е	Time
	lush	.0,		Tine	#	Kill				G-10	-14	7:30a						and a second second	and the same of th
(Rush TAT is subject to laboratory approval and surcharg			Relinqui			0				Date	'/	Time	Received	by			Dat	0	Time
				,	1						-								
Date results are needed: ASAP		_	Relinqui	shed b	y					Date		Time	Received	by			Dat	е	Time
dustin @e-s-1.com	und	-						ALL PORTS	SHEET STATE OF THE SHEET STATE O										
E-mail address: CKnight @e-5-1, cor	rj .		Relinqui	shed b	у		ALCO MANAGEMENT AND ADDRESS OF THE PARTY OF			Date		Time	Received	by			Dat	е	Time
Data Package Options (circle if required)						- Carlotte Control of the Control of							Opensed						
Type I (EPA Level 3			Relinqui	shed b	y					Date		Time	Received	by	is in	0	Dat	е	Time
Equivalent/non-CLP)	· · · IVDE VI (Baw Data CDIV)															V	la	11/19	0750
	n TV	The Control of the Co		rism kanna baker	EDD Rec	uirec	1?_((ès)	No) 		Relinq	uished	by Comr	nercial	Carrier:			
Type III (Reduced non-CLP) NJ DKQ	- IX	TX TRRP-13				, format:	<u> P</u>	DF					UPS FedEx Other						
NYSDEC Category A or B MA MCF	CTI		Site-Specific QC (MS/MSD/Dup)? Yes (No)				Temperature upon receipt°C												
NYSDEC Category A or B MA MCF	COLL	105	(1	f yes,	indica	ate QC sampl	e and	submit	triplica	ite sam	ple vo	ume.)		rempe	ratule u	porried	seihr ——	7 1 kg27	_

7044 0216



Lancaster Laboratories Environmental

Sample Administration Receipt Documentation Log

Doc Log ID:

251099

Group Number(s):

Client: Environmental Services, Inc.

2019-0537

Delivery and Receipt Information

Delivery Method:

Fed Ex

Arrival Timestamp:

06/11/2019 7:50

Number of Packages:

1

Number of Projects:

1

State/Province of Origin:

CT

Arrival Condition Summary

Shipping Container Sealed:

Yes

Sample IDs on COC match Containers:

Yes

Custody Seal Present:

No

Sample Date/Times match COC:

Yes

Samples Chilled:

Yes

VOA Vial Headspace ≥ 6mm:

N/A

Paperwork Enclosed:

Yes

Total Trip Blank Qty:

0

Samples Intact:

Yes

Air Quality Samples Present:

No

Missing Samples:

No No

No

Extra Samples:

Discrepancy in Container Qty on COC:

Unpacked by Nicole Reiff (25684) at 08:24 on 06/11/2019

Samples Chilled Details: 2019-0537

Thermometer Types:

DT = Digital (Temp. Bottle)

IR = Infrared (Surface Temp)

All Temperatures in °C.

Samples

Cooler # Thermometer ID

Corrected Temp

Therm. Type

Ice Type

Ice Present?

Ice Container

Elevated Temp?

Collected Same Day as Receipt?

DT146

7.3

DT

Ice Pack

Ν

N/A

Elevated Temperature Details: 2019-0537

All Temperatures in °C

Thermometer Cooler# ID 1 32170023

Top Left Temp

Top Right Temp 10.2 14.1

Bottom Left <u>Temp</u> 8.0

<u>Bottom</u> Right Temp 14.7

Center Temp 14.7

Factors Contributing to Elevated Temp

Comments

Icepacks on top of samples were not frozen.

OK to proceed pm C. Knight, 1F593 6/11/19



Dry weight

basis

Explanation of Symbols and Abbreviations

The following defines common symbols and abbreviations used in reporting technical data:

BMQL	Below Minimum Quantitation Level	mL	milliliter(s)							
С	degrees Celsius	MPN	Most Probable Number							
cfu	colony forming units	N.D.	non-detect							
CP Units	cobalt-chloroplatinate units	ng	nanogram(s)							
F	degrees Fahrenheit	NTU	nephelometric turbidity units							
g	gram(s)	pg/L	picogram/liter							
IU	International Units	RL	Reporting Limit							
kg	kilogram(s)	TNTC	Too Numerous To Count							
L	liter(s)	μg	microgram(s)							
lb.	pound(s)	μL	microliter(s)							
m3	cubic meter(s)	umhos/cm	micromhos/cm							
meq	milliequivalents	MCL	Maximum Contamination Limit							
mg	milligram(s)									
<	less than									
>	greater than									
ppm	parts per million - One ppm is equivalent to one milligram per kilogram (mg/kg) or one gram per million grams. For aqueous liquids, ppm is usually taken to be equivalent to milligrams per liter (mg/l), because one liter of water has a weight very close to a kilogram. For gases or vapors, one ppm is equivalent to one microliter per liter of gas.									
ppb	parts per billion									

Analytical test results meet all requirements of the associated regulatory program (i.e., NELAC (TNI), DoD, and ISO 17025) unless otherwise noted under the individual analysis.

Results printed under this heading have been adjusted for moisture content. This increases the analyte weight

concentration to approximate the value present in a similar sample without moisture. All other results are reported on an

Measurement uncertainty values, as applicable, are available upon request.

as-received basis.

Tests results relate only to the sample tested. Clients should be aware that a critical step in a chemical or microbiological analysis is the collection of the sample. Unless the sample analyzed is truly representative of the bulk of material involved, the test results will be meaningless. If you have questions regarding the proper techniques of collecting samples, please contact us. We cannot be held responsible for sample integrity, however, unless sampling has been performed by a member of our staff.

This report shall not be reproduced except in full, without the written approval of the laboratory.

Times are local to the area of activity. Parameters listed in the 40 CFR Part 136 Table II as "analyze immediately" are not performed within 15 minutes.

WARRANTY AND LIMITS OF LIABILITY - In accepting analytical work, we warrant the accuracy of test results for the sample as submitted. THE FOREGOING EXPRESS WARRANTY IS EXCLUSIVE AND IS GIVEN IN LIEU OF ALL OTHER WARRANTIES, EXPRESSED OR IMPLIED. WE DISCLAIM ANY OTHER WARRANTIES, EXPRESSED OR IMPLIED, INCLUDING A WARRANTY OF FITNESS FOR PARTICULAR PURPOSE AND WARRANTY OF MERCHANTABILITY. IN NO EVENT SHALL EUROFINS LANCASTER LABORATORIES ENVIRONMENTAL, LLC BE LIABLE FOR INDIRECT, SPECIAL, CONSEQUENTIAL, OR INCIDENTAL DAMAGES INCLUDING, BUT NOT LIMITED TO, DAMAGES FOR LOSS OF PROFIT OR GOODWILL REGARDLESS OF (A) THE NEGLIGENCE (EITHER SOLE OR CONCURRENT) OF EUROFINS LANCASTER LABORATORIES ENVIRONMENTAL AND (B) WHETHER EUROFINS LANCASTER LABORATORIES ENVIRONMENTAL HAS BEEN INFORMED OF THE POSSIBILITY OF SUCH DAMAGES. We accept no legal responsibility for the purposes for which the client uses the test results. No purchase order or other order for work shall be accepted by Eurofins Lancaster Laboratories Environmental which includes any conditions that vary from the Standard Terms and Conditions, and Eurofins Lancaster Laboratories Environmental hereby objects to any conflicting terms contained in any acceptance or order submitted by client.



Data Qualifiers

Qualifier	Definition
С	Result confirmed by reanalysis
D1	Indicates for dual column analyses that the result is reported from column 1
D2	Indicates for dual column analyses that the result is reported from column 2
E	Concentration exceeds the calibration range
K1	Initial Calibration Blank is above the QC limit and the sample result is ND
K2	Continuing Calibration Blank is above the QC limit and the sample result is ND
K3	Initial Calibration Verification is above the QC limit and the sample result is ND
K4	Continuing Calibration Verification is above the QC limit and the sample result is ND
J (or G, I, X)	Estimated value >= the Method Detection Limit (MDL or DL) and < the Limit of Quantitation (LOQ or RL)
Р	Concentration difference between the primary and confirmation column >40%. The lower result is reported.
P^	Concentration difference between the primary and confirmation column > 40%. The higher result is reported.
U	Analyte was not detected at the value indicated
V	Concentration difference between the primary and confirmation column >100%. The reporting limit is raised
	due to this disparity and evident interference.
W	The dissolved oxygen uptake for the unseeded blank is greater than 0.20 mg/L.
Z	Laboratory Defined - see analysis report

Additional Organic and Inorganic CLP qualifiers may be used with Form 1 reports as defined by the CLP methods. Qualifiers specific to Dioxin/Furans and PCB Congeners are detailed on the individual Analysis Report.









ANALYSIS REPORT

Prepared by:

Prepared for:

Eurofins Lancaster Laboratories Environmental 2425 New Holland Pike Lancaster, PA 17601 Environmental Services, Inc. 90 Brookfield Street South Windsor CT 06074

Report Date: June 13, 2019 19:19

Project: 2019-0537

Account #: 44484 Group Number: 2048277 PO Number: 79207 State of Sample Origin: CT

Electronic Copy To Environmental Services Inc. Attn: Dustin Mitchell Electronic Copy To Environmental Services Inc. Attn: Cindy Knight

Respectfully Submitted,

Lynn M. Frederiksen

Principal Specialist Group Leader

Zyn M. Frederiksen

(717) 556-7255

To view our laboratory's current scopes of accreditation please go to https://www.eurofinsus.com/environment-testing/laboratories-environmental/certifications-and-accreditations-eurofins-lancaster-laboratories-environmental/. Historical copies may be requested through your project manager.









SAMPLE INFORMATION

Client Sample Description

Sample Collection
Date/Time

ELLE#

Signature Grab Foam

06/10/2019 04:20

1077619

The specific methodologies used in obtaining the enclosed analytical results are indicated on the Laboratory Sample Analysis Record.



Lancaster Laboratories Environmental







2425 New Holland Pike, Lancaster, PA 17601 • 717-656-2300 • Fax: 717-656-6766 • www.EurofinsUS.com/LancLabsEnv

Laboratory Analysis CT QA/QC Certification Form

Laboratory Name: Eurofins Lancaster Laboratories Environmental

Client: Environmental Services, Inc.

Project: 2019-0537

Sampling Date(s): 06/10/19

Laboratory Sample ID(s): Sample number(s): 1077619

		Yes or No
1	For each analytical method referenced in this laboratory report package, were all specified QA/QC performance criteria followed (including the requirement to explain any criteria falling outside of acceptable guidelines, as specified in the CT DEP method-specific Reasonable Confidence Protocol documents)?	Yes
1A	Were method specified preservation and holding time requirements met?	Yes
1B	<u>VPH and EPH Methods only:</u> Was the VPH or EPH Method conducted without significant modifications (see Section 11.3 of respective methods)?	NA
2	Were all samples received by the laboratory in a condition consistent with that described on the associated chain-of-custody document(s)?	Yes
3	Were samples received at an appropriate temperature (<6° C)?	No
4	Were all QA/QC performance criteria specified in the CT DEP Reasonable Confidence Protocol documents achieved?	No
5	Were reporting limits* specified on the chain-of-custody met?	No
6	For each analytical method referenced in this laboratory report package, were results reported for all constituents identified in the method-specific analyte lists presented in the Reasonable Confidence Protocol documents?	Yes
7	Are project specific QC samples included in this data set?	No

Note: For all questions to which the response was "No" (with exception of question #7), additional information must be provided in an attached narrative. If the answer to #1, #1A or question #1B is "No", the data package does not meet the requirements for "Reasonable Confidence."

*The Limit of Quantitation (LOQ) meets requirements for the Reporting Limit (RL) as defined in the CT Reasonable Confidence Protocols, unless otherwise noted.

I, the undersigned, attest under the pains and penalties of perjury that the material contained in this analytical report is, to the best of my knowledge and belief, accurate and complete.

Christiane S. Sweigart Senior Specialist



Case Narrative

2425 New Holland Pike, Lancaster, PA 17601 • 717-656-2300 • Fax: 717-656-6766 • www.EurofinsUS.com/LancLabsEnv

Project Name: 2019-0537 ELLE Group #: 2048277

General Comments:

See the Laboratory Sample Analysis Record section of the Analysis Report for the method references.

All QC met criteria unless otherwise noted in an Analysis Specific Comment below.

Refer to the QC Summary for specific values and acceptance criteria.

Project specific QC samples are not included in this data set.

Matrix QC may not be reported if site-specific QC samples were not submitted. In these situations, to demonstrate precision and accuracy at a batch level, a LCS/LCSD was performed, unless otherwise specified in the method.

Surrogate recoveries (if applicable) which are outside of the QC window are confirmed unless attributed to a dilution or otherwise noted in an Analysis Specific Comment below.

The samples were received at the appropriate temperature and in accordance with the chain of custody unless otherwise noted.

The sample receipt temperature requirement was not met. The temperature of the sample bottle(s) upon receipt at the lab was 16.2 - 17.0 C using an IR thermometer.

Analysis Specific Comments:

EPA 537 Version 1.1 Modified, LC/MS/MS Miscellaneous

Sample #s: 1077619

Reporting limits were raised due to interference from the sample matrix.

The sample injection internal standard peak areas were outside of the QC limits for both the initial injection and the re-injection. The values here are from the initial injection of the sample.

The recovery for a target analyte(s) in the Laboratory Control Spike(s) is outside the QC acceptance limits as noted on the QC Summary.

Target analytes were detected in the method blank as noted on the QC Summary.

Batch #: 19163008 (Sample number(s): 1077619)

The recovery(ies) for the following analyte(s) in the LCS and/or LCSD exceeded the acceptance window indicating a positive bias: Perfluorooctanesulfonic acid, Perfluorobutanoic acid



2425 New Holland Pike, Lancaster, PA 17601 • 717-656-2300 • Fax: 717-656-6766 • www.EurofinsUS.com/LancLabsEnv

Sample Description: Signature Grab Foam

2019-0537

2019-0537 **Project Name:**

Submittal Date/Time: 06/12/2019 08:15 Collection Date/Time: 06/10/2019 04:20 **Environmental Services, Inc.** ELLE Sample #: G5 1077619 **ELLE Group #:** 2048277

Matrix: Foam

CAT No.	Analysis Name	CAS Number	As Received Result	As Received Method Detection Limit*	As Received Limit of Quantitation	Dilution Factor
LC/MS	/MS Miscellaneous EPA 537	Version 1.1	ng/l	ng/l	ng/l	
14473	4:2-Fluorotelomersulfonic acid	757124-72-4	N.D.	500,000	1,500,000	1000
14473	6:2-Fluorotelomersulfonic acid	27619-97-2	N.D.	500,000	1,000,000	1000
14473	8:2-Fluorotelomersulfonic acid	39108-34-4	N.D.	1,000,000	3,000,000	1000
14473	NEtFOSAA	2991-50-6	N.D.	500,000	1,500,000	1000
	NEtFOSAA is the acronym for N-ethyl	perfluorooctanesulfona	midoacetic Acid.			
14473	NMeFOSAA	2355-31-9	N.D.	500,000	1,500,000	1000
	NMeFOSAA is the acronym for N-met	nyl perfluorooctanesulfo	namidoacetic Acid.			
14473	Perfluorobutanesulfonic acid	375-73-5	37,000,000	150,000	500,000	1000
14473	Perfluorobutanoic acid	375-22-4	N.D.	1,000,000	3,000,000	1000
14473	Perfluorodecanesulfonic acid	335-77-3	2,600,000	300,000	1,000,000	1000
14473	Perfluorodecanoic acid	335-76-2	N.D.	450,000	1,000,000	1000
14473	Perfluorododecanoic acid	307-55-1	N.D.	250,000	1,000,000	1000
14473	Perfluoroheptanesulfonic acid	375-92-8	53,000,000	200,000	1,000,000	1000
14473	Perfluoroheptanoic acid	375-85-9	14,000,000	200,000	500,000	1000
14473	Perfluorohexanesulfonic acid	355-46-4	310,000,000	2,000,000	10,000,000	10000
14473	Perfluorohexanoic acid	307-24-4	26,000,000	200,000	1,000,000	1000
14473	Perfluorononanesulfonic acid	68259-12-1	6,700,000	300,000	1,000,000	1000
14473	Perfluorononanoic acid	375-95-1	N.D.	200,000	1,000,000	1000
14473	Perfluorooctanesulfonamide	754-91-6	300,000 J	250,000	1,500,000	1000
14473	Perfluorooctanesulfonic acid	1763-23-1	2,400,000,000 B	20,000,000	100,000,000	100000
14473	Perfluorooctanoic acid	335-67-1	62,000,000	150,000	500,000	1000
14473	Perfluoropentanesulfonate	2706-91-4	56,000,000	200,000	1,000,000	1000
14473	Perfluoropentanoic acid	2706-90-3	1,800,000 J	1,000,000	3,000,000	1000
14473	Perfluorotetradecanoic acid	376-06-7	N.D.	150,000	500,000	1000
14473	Perfluorotridecanoic acid	72629-94-8	N.D.	200,000	500,000	1000
14473	Perfluoroundecanoic acid	2058-94-8	N.D.	200,000	1,000,000	1000
Reno	orting limits were raised due to interferen	ce from the sample mat	rix			

Reporting limits were raised due to interference from the sample matrix.

The sample injection internal standard peak areas were outside of the QC limits for both the initial injection and the re-injection. The values here are from the initial injection of the sample.

The recovery for a target analyte(s) in the Laboratory Control Spike(s) is outside the QC acceptance limits as noted on the QC Summary.

Target analytes were detected in the method blank as noted on the QC Summary.

Sample Comments

The sample receipt temperature requirement was not met. The temperature of the sample bottle(s) upon receipt at the lab was 16.2 - 17.0 C using an IR thermometer.

^{*=}This limit was used in the evaluation of the final result



2425 New Holland Pike, Lancaster, PA 17601 • 717-656-2300 • Fax: 717-656-6766 • www.EurofinsUS.com/LancLabsEnv

Sample Description: Signature Grab Foam

2019-0537

Project Name: 2019-0537

Submittal Date/Time: 06/12/2019 08:15 Collection Date/Time: 06/10/2019 04:20 Environmental Services, Inc.
ELLE Sample #: G5 1077619
ELLE Group #: 2048277

Matrix: Foam

	Laboratory Sample Analysis Record								
CAT No.	Analysis Name	Method	Trial#	Batch#	Analysis Date and Time	Analyst	Dilution Factor		
14473	PFAS - 24 compounds	EPA 537 Version 1.1 Modified	1	19163008	06/13/2019 14:33	Marissa C Drexinger	1000		
14473	PFAS - 24 compounds	EPA 537 Version 1.1 Modified	1	19163008	06/13/2019 14:42	Marissa C Drexinger	10000		
14473	PFAS - 24 compounds	EPA 537 Version 1.1 Modified	1	19163008	06/13/2019 15:45	Marissa C Drexinger	100000		
14091	PFAS Water Prep	EPA 537 Version 1.1 Modified	1	19163008	06/12/2019 11:00	Robert Brown	1		

^{*=}This limit was used in the evaluation of the final result

Quality Control Summary

Client Name: Environmental Services, Inc. Group Number: 2048277

Reported: 06/13/2019 19:19

Matrix QC may not be reported if insufficient sample or site-specific QC samples were not submitted. In these situations, to demonstrate precision and accuracy at a batch level, a LCS/LCSD was performed, unless otherwise specified in the method.

All Inorganic Initial Calibration and Continuing Calibration Blanks met acceptable method criteria unless otherwise noted on the Analysis Report.

Method Blank

Analysis Name	Result	MDL**	LOQ
	ng/l	ng/l	ng/l
Batch number: 19163008	Sample number	s): 1077619	
4:2-Fluorotelomersulfonic acid	N.D.	500	1,500
6:2-Fluorotelomersulfonic acid	650 J	500	1,000
8:2-Fluorotelomersulfonic acid	N.D.	1,000	3,000
NEtFOSAA	N.D.	500	1,500
NMeFOSAA	N.D.	500	1,500
Perfluorobutanesulfonic acid	N.D.	150	500
Perfluorobutanoic acid	N.D.	1,000	3,000
Perfluorodecanesulfonic acid	N.D.	300	1,000
Perfluorodecanoic acid	N.D.	450	1,000
Perfluorododecanoic acid	N.D.	250	1,000
Perfluoroheptanesulfonic acid	N.D.	200	1,000
Perfluoroheptanoic acid	N.D.	200	500
Perfluorohexanesulfonic acid	N.D.	200	1,000
Perfluorohexanoic acid	N.D.	200	1,000
Perfluorononanesulfonic acid	N.D.	300	1,000
Perfluorononanoic acid	N.D.	200	1,000
Perfluorooctanesulfonamide	N.D.	250	1,500
Perfluorooctanesulfonic acid	430 J	200	1,000
Perfluorooctanoic acid	N.D.	150	500
Perfluoropentanesulfonate	N.D.	200	1,000
Perfluoropentanoic acid	N.D.	1,000	3,000
Perfluorotetradecanoic acid	N.D.	150	500
Perfluorotridecanoic acid	N.D.	200	500
Perfluoroundecanoic acid	N.D.	200	1,000

LCS/LCSD

Analysis Name	LCS Spike Added ng/l	LCS Conc ng/l	LCSD Spike Added ng/l	LCSD Conc ng/l	LCS %REC	LCSD %REC	LCS/LCSD Limits	RPD	RPD Max
Batch number: 19163008	Sample number	(s): 1077619							
4:2-Fluorotelomersulfonic acid	3736	3591.31	3736	3471.17	96	93	82-152	3	30
6:2-Fluorotelomersulfonic acid	3792	4678.24	3792	4360.38	123	115	66-155	7	30
8:2-Fluorotelomersulfonic acid	3832	3797.45	3832	4615.03	99	120	66-148	19	30
NEtFOSAA	1360	1413.28	1360	1401.26	104	103	55-169	1	30
NMeFOSAA	1360	1346.71	1360	1414.41	99	104	44-147	5	30

^{*-} Outside of specification

^{**-}This limit was used in the evaluation of the final result for the blank

⁽¹⁾ The result for one or both determinations was less than five times the LOQ.

⁽²⁾ The unspiked result was more than four times the spike added.

Quality Control Summary

Client Name: Environmental Services, Inc. Group Number: 2048277

Reported: 06/13/2019 19:19

LCS/LCSD (continued)

Analysis Name	LCS Spike Added ng/l	LCS Conc ng/l	LCSD Spike Added ng/l	LCSD Conc ng/l	LCS %REC	LCSD %REC	LCS/LCSD Limits	RPD	RPD Max
Perfluorobutanesulfonic acid	1204	1430.64	1204	1326.42	119	110	73-128	8	30
Perfluorobutanoic acid	1360	2273.16	1360	2379.08	167*	175*	74-142	5	30
Perfluorodecanesulfonic acid	1310	1112.36	1310	1170.08	85	89	60-135	5	30
Perfluorodecanoic acid	1360	1491.81	1360	1547.26	110	114	69-148	4	30
Perfluorododecanoic acid	1360	1693.39	1360	1573.2	125	116	75-136	7	30
Perfluoroheptanesulfonic acid	1294	1366.43	1294	1428.75	106	110	64-135	4	30
Perfluoroheptanoic acid	1360	1536.72	1360	1397.29	113	103	76-140	10	30
Perfluorohexanesulfonic acid	1286	1289.57	1286	1475.44	100	115	71-131	13	30
Perfluorohexanoic acid	1360	1563.01	1360	1658.34	115	122	75-135	6	30
Perfluorononanesulfonic acid	1306	1395.35	1306	1281.76	107	98	66-133	8	30
Perfluorononanoic acid	1360	1790.86	1360	1629.2	132	120	72-148	9	30
Perfluorooctanesulfonamide	1360	1385.99	1360	1337.95	102	98	65-164	4	30
Perfluorooctanesulfonic acid	1300	1432.93	1300	1894.37	110	146*	67-138	28	30
Perfluorooctanoic acid	1360	1633.1	1360	1557.79	120	115	72-138	5	30
Perfluoropentanesulfonate	1276	1519.17	1276	1414.33	119	111	76-127	7	30
Perfluoropentanoic acid	1360	1642.72	1360	1593.53	121	117	74-134	3	30
Perfluorotetradecanoic acid	1360	1343.31	1360	1264.37	99	93	74-135	6	30
Perfluorotridecanoic acid	1360	1621.46	1360	1292.82	119	95	61-145	23	30
Perfluoroundecanoic acid	1360	1528.65	1360	1397.1	112	103	75-146	9	30

Labeled Isotope Quality Control

Labeled isotope recoveries which are outside of the QC window are confirmed unless otherwise noted on the analysis report.

Analysis Name: PFAS - 24 compounds

Batch number: 19163008

	13C4-PFBA	13C5-PFPeA	13C3-PFBS	13C2-4:2-FTS	13C5-PFHxA	13C3-PFHxS
1077619	82	82	74	101	74	61
Blank	75	78	76	97	77	79
LCS	82	81	77	95	78	87
LCSD	78	73	73	100	76	86
Limits:	33-123	31-157	26-148	21-182	35-138	34-126
	13C4-PFHpA	13C2-6:2-FTS	13C8-PFOA	13C8-PFOS	13C9-PFNA	13C6-PFDA
1077619	64	118	75	116	114	83
Blank	78	95	77	71	75	78
LCS	84	90	79	77	79	77
LCSD	86	100	79	77	74	75

^{*-} Outside of specification

^{**-}This limit was used in the evaluation of the final result for the blank

⁽¹⁾ The result for one or both determinations was less than five times the LOQ.

⁽²⁾ The unspiked result was more than four times the spike added.

2425 New Holland Pike, Lancaster, PA 17601 • 717-656-2300 • Fax: 717-656-6766 • www.EurofinsUS.com/LancLabsEnv

Quality Control Summary

Client Name: Environmental Services, Inc. Group Number: 2048277

Reported: 06/13/2019 19:19

Labeled Isotope Quality Control (continued)

Labeled isotope recoveries which are outside of the QC window are confirmed unless otherwise noted on the analysis report.

Analysis Name: PFAS - 24 compounds

Batch number: 19163008

Limits:	35-126	32-170	48-122	50-121	41-144	47-125	
	13C2-8:2-FTS	d3-NMeFOSAA	13C7-PFUnDA	d5-NEtFOSAA	13C2-PFDoDA	13C2-PFTeDA	
1077619	118	106	79	107	78	79	
Blank	80	86	73	86	73	72	
LCS	84	92	72	89	72	70	
LCSD	74	95	74	80	72	64	
l imits:	27-164	30-127	30-128	30-142	39-130	26-119	

	13C8-PFOSA
1077619	78
Blank	74
LCS	75
LCSD	72

Limits: 11-127

^{*-} Outside of specification


^{**-}This limit was used in the evaluation of the final result for the blank

⁽¹⁾ The result for one or both determinations was less than five times the LOQ.

⁽²⁾ The unspiked result was more than four times the spike added.

Environmental Analysis Request/Chain of Custody

🔅 eurofins						icaster Lab												4		. F A	- 0 0 0	
Lancaster Laboratories	Acct. #	1457	<u>ර</u> ්ධ	roup #	# _2	DH82	つ(こ) s	ample	#	lo	5	70	<u>۵(</u> ۲	<u> </u>				C	OC #	# 34	500 3	
Environmental	narya establisheki saski sebishi.	novávános sadnároj krástvájnum	ndo-cyclasti	nejejena je je	e Commence of the Commence of	and the second second	W. S. J. S.	•	·		*********						S.:		L			
Client Informatio	Acct. #:					Matrix	, , , ,					····		leque		1			For Lab U	se Only		
, <u>k</u>	ACGL #:							1	~			rese	rvati	on Co	odes		1		FSC:			
Environmenta Services Inc. Project Name/#:	PWSID #:				en	75 0			0										SCR#:		\	
2019 - 0537 Project Manager:	, ,,,,,,,				Tissue	Ground											İ		H=HCI	ervation (odes niosulfate	
Project Manager:	P.O. #:					aro Sur			¢]				ĺ			N=HNC		2	
Dustin Mitchell					Ш			STS	9		ĺ			ĺ					S =H ₂ S0	•		
Sampler:	Quote #:	Ci a a c			Ĭ			in	9											Remarks	3	
M. Couens Ky State where samples were collected: For Compliance:	. (9207	,		Ĕ	9c Si		nte	-6						İ				0:0	Mez = T	rizma	
	_			e	Sediment	Potable NPDES	1	ပိ														
CT Yes 🗆	No 🗟			sit	l ^s	lg z	1	ō	0)					Ì								
Sample Identification	Colle	ected	ab	Composite	m ⊨		Water	Other:	Total # of Containers	FO								,				
•	Date	Time	Grab	ပ	Soil	Wa	ା ଅ	L _O	д													
Alleldo Signature	6-10-19	4:20	\geq	·				2	8													
~~																						
							1															
							T															
							1															
— · · · · · · · · · · · · · · · · · · ·							1	<u> </u>								i				· ·, · · · <u>-</u>		
							+	-														
					_		+															
								!														
Turnaround Time (TAT) Requested	(nlease circ	le)	Relinq	uished	by	<u> </u>	- 	1		Date	,	Time	_	Receive	ed by				4	Date	Time	
t and a second and a second and a second and a second and a second and a second and a second and a second and	Rush	.0,		M_{\odot}	ري	Cover	1/_			Date 6 / 10 Date	/19	4,2	\mathcal{D}_{n}	พา	An	L		-1	4	6/10/1	4:30,	
(Rush TAT is subject to laboratory approval and surcharg	THE PARTY OF THE P		Relinq	uished	by	1 1	10			Date	,	Time		Receive	ed by	7		/		Date	Time	
1000				(LN	<u>ti</u>	XI				6/11	19	7:3	Dun	n	,	<i></i>						
Date results are needed: Austin @e-s-i . com E-mail address:	and	_	Relinq	uished	by/	O				Date '		Time		Receive	ed by					Date	Time	
dustin @ e-s-1 1 2007	rom		Rolina	uished	by					Date		Time		Receiv	ad bu					Date	Time	
Data Package Options (circle if r		_	TI BIII IQ	uisi ieu	DУ	,	(CONTRACTOR OF THE PARTY OF THE	and the same of th		Date		rune		neceiv	eu by	- species				Date	rime	
Type I /EPA Level 3			Reling	uished	by	- Lander State Control of the Land Control of				Date		Time		Receive	ed by				3	Date	Time	
Equivalent/non-CLP)	(Raw Data	Only)	i '		-										•	\wedge	N	~{		10/12/19		
	D TV 7	EDDD 40				EDD Re	quire	d? /	Ýes	No		************	on Pinteriol II	Relin	quish	ned b	y Coi	mme	rcial Carri		10010	
Type III (Reduced non-CLP) NJ DKQ	P IX	FRRP-13			If yes	, format: _	VI.	267 C							s		Fedi		Othe			
NYSDEC Category A or B MA MCF	CT i	SCP)				ecific QC						No)		Tor	nnor	ature	uno	n receipt _	16.2	°C	
1410020 Category A Of D MA MOR	(011	الا '		(If yes	s, indic	ate QC sam	ple and	l submit	triplica	ate samp	ole vo	lume.)	inera unices		1 년	uhei	aiule	upor	r receibr =		_ '	



Lancaster Laboratories Environmental

Sample Administration Receipt Documentation Log

Doc Log ID:

251225

Group Number(s):

Client: Environmental Services, Inc.

2019-0537

Delivery and Receipt Information

Delivery Method:

Fed Ex

Arrival Timestamp:

06/12/2019 8:15

Number of Packages:

1

Number of Projects:

1

State/Province of Origin:

CT

Arrival Condition Summary

Shipping Container Sealed:

Yes

Sample IDs on COC match Containers:

Yes

Custody Seal Present:

No

Sample Date/Times match COC:

Yes

Samples Chilled:

Yes

VOA Vial Headspace ≥ 6mm:

N/A

Paperwork Enclosed:

Yes

Total Trip Blank Qty:

0

Samples Intact: Missing Samples: Yes No

Air Quality Samples Present:

No

Extra Samples:

No

Discrepancy in Container Qty on COC:

No

Unpacked by Nicole Reiff (25684) at 09:01 on 06/12/2019

Samples Chilled Details: 2019-0537

Thermometer Types:

DT = Digital (Temp. Bottle)

IR = Infrared (Surface Temp)

All Temperatures in °C.

Cooler#

Thermometer ID

Corrected Temp

Therm. Type

Ice Type Ice Present? Ice Container

Elevated Temp?

Samples Collected Same Day as Receipt?

32170023

16.2

Ice Pack

1

1R

N/A

Elevated Temperature Details: 2019-0537 All Temperatures in °C

Thermometer Cooler# <u>ID</u>

32170023

Top Left Temp

Top Right **Temp**

17.0

Bottom Left <u>Temp</u>

Bottom Right Temp 16.8

Center Temp 16.3

Factors Contributing to Elevated Temp

Icepacks were warm. Bottles

Comments

were wrapped in thick layer of bubble wrap.

OK to proceed per C. Knight LF593 6/12/19



BMQL

Dry weight

basis

Explanation of Symbols and Abbreviations

milliliter(s)

The following defines common symbols and abbreviations used in reporting technical data:

Below Minimum Quantitation Level

			\					
С	degrees Celsius	MPN	Most Probable Number					
cfu	colony forming units	N.D.	non-detect					
CP Units	cobalt-chloroplatinate units	ng	nanogram(s)					
F	degrees Fahrenheit	NTU	nephelometric turbidity units					
g	gram(s)	pg/L	picogram/liter					
IU	International Units	RL	Reporting Limit					
kg	kilogram(s)	TNTC	Too Numerous To Count					
L	liter(s)	μg	microgram(s)					
lb.	pound(s)	μL	microliter(s)					
m3	cubic meter(s)	umhos/cm	micromhos/cm					
meq	milliequivalents	MCL	Maximum Contamination Limit					
mg	milligram(s)							
<	less than							
>	greater than							
ppm	parts per million - One ppm is equivalent to one milligram per kilogram (mg/kg) or one gram per million grams. For aqueous liquids, ppm is usually taken to be equivalent to milligrams per liter (mg/l), because one liter of water has a weight very close to a kilogram. For gases or vapors, one ppm is equivalent to one microliter per liter of gas.							
ppb	parts per billion							

Analytical test results meet all requirements of the associated regulatory program (i.e., NELAC (TNI), DoD, and ISO 17025) unless otherwise noted under the individual analysis.

Results printed under this heading have been adjusted for moisture content. This increases the analyte weight

concentration to approximate the value present in a similar sample without moisture. All other results are reported on an

Measurement uncertainty values, as applicable, are available upon request.

as-received basis.

Tests results relate only to the sample tested. Clients should be aware that a critical step in a chemical or microbiological analysis is the collection of the sample. Unless the sample analyzed is truly representative of the bulk of material involved, the test results will be meaningless. If you have questions regarding the proper techniques of collecting samples, please contact us. We cannot be held responsible for sample integrity, however, unless sampling has been performed by a member of our staff.

This report shall not be reproduced except in full, without the written approval of the laboratory.

Times are local to the area of activity. Parameters listed in the 40 CFR Part 136 Table II as "analyze immediately" are not performed within 15 minutes.

WARRANTY AND LIMITS OF LIABILITY - In accepting analytical work, we warrant the accuracy of test results for the sample as submitted. THE FOREGOING EXPRESS WARRANTY IS EXCLUSIVE AND IS GIVEN IN LIEU OF ALL OTHER WARRANTIES, EXPRESSED OR IMPLIED. WE DISCLAIM ANY OTHER WARRANTIES, EXPRESSED OR IMPLIED, INCLUDING A WARRANTY OF FITNESS FOR PARTICULAR PURPOSE AND WARRANTY OF MERCHANTABILITY. IN NO EVENT SHALL EUROFINS LANCASTER LABORATORIES ENVIRONMENTAL, LLC BE LIABLE FOR INDIRECT, SPECIAL, CONSEQUENTIAL, OR INCIDENTAL DAMAGES INCLUDING, BUT NOT LIMITED TO, DAMAGES FOR LOSS OF PROFIT OR GOODWILL REGARDLESS OF (A) THE NEGLIGENCE (EITHER SOLE OR CONCURRENT) OF EUROFINS LANCASTER LABORATORIES ENVIRONMENTAL AND (B) WHETHER EUROFINS LANCASTER LABORATORIES ENVIRONMENTAL HAS BEEN INFORMED OF THE POSSIBILITY OF SUCH DAMAGES. We accept no legal responsibility for the purposes for which the client uses the test results. No purchase order or other order for work shall be accepted by Eurofins Lancaster Laboratories Environmental which includes any conditions that vary from the Standard Terms and Conditions, and Eurofins Lancaster Laboratories Environmental hereby objects to any conflicting terms contained in any acceptance or order submitted by client.



Data Qualifiers

Qualifier	Definition
С	Result confirmed by reanalysis
D1	Indicates for dual column analyses that the result is reported from column 1
D2	Indicates for dual column analyses that the result is reported from column 2
E	Concentration exceeds the calibration range
K1	Initial Calibration Blank is above the QC limit and the sample result is ND
K2	Continuing Calibration Blank is above the QC limit and the sample result is ND
K3	Initial Calibration Verification is above the QC limit and the sample result is ND
K4	Continuing Calibration Verification is above the QC limit and the sample result is ND
J (or G, I, X)	Estimated value >= the Method Detection Limit (MDL or DL) and < the Limit of Quantitation (LOQ or RL)
Р	Concentration difference between the primary and confirmation column >40%. The lower result is reported.
P^	Concentration difference between the primary and confirmation column > 40%. The higher result is reported.
U	Analyte was not detected at the value indicated
V	Concentration difference between the primary and confirmation column >100%. The reporting limit is raised
	due to this disparity and evident interference.
W	The dissolved oxygen uptake for the unseeded blank is greater than 0.20 mg/L.
Z	Laboratory Defined - see analysis report

Additional Organic and Inorganic CLP qualifiers may be used with Form 1 reports as defined by the CLP methods. Qualifiers specific to Dioxin/Furans and PCB Congeners are detailed on the individual Analysis Report.









ANALYSIS REPORT

Prepared by:

Prepared for:

Eurofins Lancaster Laboratories Environmental 2425 New Holland Pike Lancaster, PA 17601 Environmental Services, Inc. 90 Brookfield Street South Windsor CT 06074

Attn: Dustin Mitchell

Attn: Cindy Knight

Report Date: June 13, 2019 18:00

Project: 2019-0537

Account #: 44484 Group Number: 2048283 PO Number: 79209 State of Sample Origin: CT

Electronic Copy To Environmental Services Inc.
Electronic Copy To Environmental Services Inc.

Respectfully Submitted,

Lynn M. Frederiksen

Principal Specialist Group Leader

Zyn M. Frederiksen

(717) 556-7255

To view our laboratory's current scopes of accreditation please go to https://www.eurofinsus.com/environment-testing/laboratories-environmental/certifications-and-accreditations-eurofins-lancaster-laboratories-environmental/. Historical copies may be requested through your project manager.









SAMPLE INFORMATION

Client Sample Description

Outfall-2 Grab Surface Water

Sample Collection

Date/Time

ELLE#

06/11/2019 09:25

1077628

The specific methodologies used in obtaining the enclosed analytical results are indicated on the Laboratory Sample Analysis Record.



Lancaster Laboratories Environmental







2425 New Holland Pike, Lancaster, PA 17601 • 717-656-2300 • Fax: 717-656-6766 • www.EurofinsUS.com/LancLabsEnv

Laboratory Analysis CT QA/QC Certification Form

Laboratory Name: Eurofins Lancaster Laboratories Environmental

Client: Environmental Services, Inc.

Project: 2019-0537

Sampling Date(s): 06/11/19

Laboratory Sample ID(s): Sample number(s): 1077628

		Yes or No
1	For each analytical method referenced in this laboratory report package, were all specified QA/QC performance criteria followed (including the requirement to explain any criteria falling outside of acceptable guidelines, as specified in the CT DEP method-specific Reasonable Confidence Protocol documents)?	Yes
1A	Were method specified preservation and holding time requirements met?	Yes
1B	<u>VPH and EPH Methods only:</u> Was the VPH or EPH Method conducted without significant modifications (see Section 11.3 of respective methods)?	NA
2	Were all samples received by the laboratory in a condition consistent with that described on the associated chain-of-custody document(s)?	Yes
3	Were samples received at an appropriate temperature (<6° C)?	No
4	Were all QA/QC performance criteria specified in the CT DEP Reasonable Confidence Protocol documents achieved?	No
5	Were reporting limits* specified on the chain-of-custody met?	No
6	For each analytical method referenced in this laboratory report package, were results reported for all constituents identified in the method-specific analyte lists presented in the Reasonable Confidence Protocol documents?	Yes
7	Are project specific QC samples included in this data set?	No

Note: For all questions to which the response was "No" (with exception of question #7), additional information must be provided in an attached narrative. If the answer to #1, #1A or question #1B is "No", the data package does not meet the requirements for "Reasonable Confidence."

*The Limit of Quantitation (LOQ) meets requirements for the Reporting Limit (RL) as defined in the CT Reasonable Confidence Protocols, unless otherwise noted.

I, the undersigned, attest under the pains and penalties of perjury that the material contained in this analytical report is, to the best of my knowledge and belief, accurate and complete.

Christiane S. Sweigart Senior Specialist



Case Narrative

2425 New Holland Pike, Lancaster, PA 17601 • 717-656-2300 • Fax: 717-656-6766 • www.EurofinsUS.com/LancLabsEnv

Project Name: 2019-0537 ELLE Group #: 2048283

General Comments:

See the Laboratory Sample Analysis Record section of the Analysis Report for the method references.

All QC met criteria unless otherwise noted in an Analysis Specific Comment below.

Refer to the QC Summary for specific values and acceptance criteria.

Project specific QC samples are not included in this data set.

Matrix QC may not be reported if site-specific QC samples were not submitted. In these situations, to demonstrate precision and accuracy at a batch level, a LCS/LCSD was performed, unless otherwise specified in the method.

Surrogate recoveries (if applicable) which are outside of the QC window are confirmed unless attributed to a dilution or otherwise noted in an Analysis Specific Comment below.

The samples were received at the appropriate temperature and in accordance with the chain of custody unless otherwise noted.

The sample receipt temperature requirement was not met. The temperature of the sample bottle(s) upon receipt at the lab was 16.2 - 17.0 C using an IR thermometer.

Analysis Specific Comments:

EPA 537 Version 1.1 Modified, LC/MS/MS Miscellaneous

Sample #s: 1077628

Reporting limits were raised due to interference from the sample matrix.

The sample injection internal standard peak areas were outside of the QC limits for both the initial injection and the re-injection. The values here are from the initial injection of the sample.

The recovery for several extraction standards is outside of QC acceptance limits as noted on the QC Summary, due to the matrix of the sample.

Target analytes were detected in the method blank associated with this sample as noted on the QC Summary.

The recovery for a target analyte(s) in the Laboratory Control Spike(s) is outside the QC acceptance limits as noted on the QC Summary.

Batch #: 19163010 (Sample number(s): 1077628)

The recovery(ies) for the following analyte(s) in the LCS and/or LCSD exceeded the acceptance window indicating a positive bias: Perfluorooctanesulfonic acid

The recovery(ies) for one or more surrogates exceeded the acceptance window indicating a positive bias for sample(s) 1077628



2425 New Holland Pike, Lancaster, PA 17601 • 717-656-2300 • Fax: 717-656-6766 • www.EurofinsUS.com/LancLabsEnv

Outfall-2 Grab Surface Water Sample Description:

2019-0537

Project Name: 2019-0537

CAT

No.

Submittal Date/Time: Collection Date/Time:

Environmental Services, Inc. ELLE Sample #: WW 1077628 **ELLE Group #:** 2048283 Matrix: Surface Water

06/12/2019 08:15 06/11/2019 09:25 Method Limit of Dilution **Analysis Name CAS Number Detection Limit*** Quantitation Result Factor

LC/MS	/MS Miscellaneous EPA 537 V Modified	ersion 1.1	ng/l	ng/l	ng/l	
14473	4:2-Fluorotelomersulfonic acid	757124-72-4	N.D.	9.1	27	10
14473	6:2-Fluorotelomersulfonic acid	27619-97-2	N.D.	9.1	18	10
14473	8:2-Fluorotelomersulfonic acid	39108-34-4	N.D.	18	54	10
14473	NEtFOSAA	2991-50-6	48	9.1	27	10
	NEtFOSAA is the acronym for N-ethyl pe	rfluorooctanesulfona	midoacetic Acid.			
14473	NMeFOSAA	2355-31-9	N.D.	9.1	27	10
	NMeFOSAA is the acronym for N-methyl	perfluorooctanesulfo	namidoacetic Acid.			
14473	Perfluorobutanesulfonic acid	375-73-5	52	2.7	9.1	10
14473	Perfluorobutanoic acid	375-22-4	18 J	18	54	10
14473	Perfluorodecanesulfonic acid	335-77-3	86	5.4	18	10
14473	Perfluorodecanoic acid	335-76-2	N.D.	8.2	18	10
14473	Perfluorododecanoic acid	307-55-1	N.D.	4.5	18	10
14473	Perfluoroheptanesulfonic acid	375-92-8	220	3.6	18	10
14473	Perfluoroheptanoic acid	375-85-9	17	3.6	9.1	10
14473	Perfluorohexanesulfonic acid	355-46-4	480 B	3.6	18	10
14473	Perfluorohexanoic acid	307-24-4	70	3.6	18	10
14473	Perfluorononanesulfonic acid	68259-12-1	680	5.4	18	10
14473	Perfluorononanoic acid	375-95-1	5.4 J	3.6	18	10
14473	Perfluorooctanesulfonamide	754-91-6	25 J	4.5	27	10
14473	Perfluorooctanesulfonic acid	1763-23-1	89,000 B	360	1,800	1000
14473	Perfluorooctanoic acid	335-67-1	85	2.7	9.1	10
14473	Perfluoropentanesulfonate	2706-91-4	60	3.6	18	10
14473	Perfluoropentanoic acid	2706-90-3	27 J	18	54	10
14473	Perfluorotetradecanoic acid	376-06-7	N.D.	2.7	9.1	10
14473	Perfluorotridecanoic acid	72629-94-8	N.D.	3.6	9.1	10
14473	Perfluoroundecanoic acid	2058-94-8	26	3.6	18	10

Reporting limits were raised due to interference from the sample matrix.

The sample injection internal standard peak areas were outside of the QC limits for both the initial injection and the re-injection. The values here are from the initial injection of the sample.

The recovery for several extraction standards is outside of QC acceptance limits as noted on the QC Summary, due to the matrix of the

Target analytes were detected in the method blank associated with this sample as noted on the QC Summary.

The recovery for a target analyte(s) in the Laboratory Control Spike(s) is outside the QC acceptance limits as noted on the QC Summary.

^{*=}This limit was used in the evaluation of the final result



2425 New Holland Pike, Lancaster, PA 17601 • 717-656-2300 • Fax: 717-656-6766 • www.EurofinsUS.com/LancLabsEnv

Sample Description: Outfall-2 Grab Surface Water

2019-0537

Project Name: 2019-0537

Submittal Date/Time: 06/12/2019 08:15 Collection Date/Time: 06/11/2019 09:25 Environmental Services, Inc.
ELLE Sample #: WW 1077628
ELLE Group #: 2048283

Matrix: Surface Water

Sample Comments

The sample receipt temperature requirement was not met. The temperature of the sample bottle(s) upon receipt at the lab was 16.2 - 17.0 C using an IR thermometer.

Laboratory Sample Analysis Record Trial# Batch# Analysis Analysis

CAT No.	Analysis Name	Method	Trial#	Batch#	Analysis Date and Time	Analyst	Dilution Factor
14473	PFAS - 24 compounds	EPA 537 Version 1.1 Modified	1	19163010	06/12/2019 21:35	Danielle D McCully	10
14473	PFAS - 24 compounds	EPA 537 Version 1.1 Modified	1	19163010	06/13/2019 15:00	Danielle D McCully	1000
14091	PFAS Water Prep	EPA 537 Version 1.1 Modified	1	19163010	06/12/2019 11:15	Robert Brown	1

Quality Control Summary

Client Name: Environmental Services, Inc. Group Number: 2048283

Reported: 06/13/2019 18:00

Matrix QC may not be reported if insufficient sample or site-specific QC samples were not submitted. In these situations, to demonstrate precision and accuracy at a batch level, a LCS/LCSD was performed, unless otherwise specified in the method.

All Inorganic Initial Calibration and Continuing Calibration Blanks met acceptable method criteria unless otherwise noted on the Analysis Report.

Method Blank

Analysis Name	Result	MDL**	LOQ					
	ng/l	ng/l	ng/l					
Batch number: 19163010	Sample number(s): 1077628							
4:2-Fluorotelomersulfonic acid	N.D.	1.0	3.0					
6:2-Fluorotelomersulfonic acid	N.D.	1.0	2.0					
8:2-Fluorotelomersulfonic acid	N.D.	2.0	6.0					
NEtFOSAA	N.D.	1.0	3.0					
NMeFOSAA	N.D.	1.0	3.0					
Perfluorobutanesulfonic acid	N.D.	0.30	1.0					
Perfluorobutanoic acid	N.D.	2.0	6.0					
Perfluorodecanesulfonic acid	N.D.	0.60	2.0					
Perfluorodecanoic acid	N.D.	0.90	2.0					
Perfluorododecanoic acid	N.D.	0.50	2.0					
Perfluoroheptanesulfonic acid	N.D.	0.40	2.0					
Perfluoroheptanoic acid	N.D.	0.40	1.0					
Perfluorohexanesulfonic acid	0.44 J	0.40	2.0					
Perfluorohexanoic acid	N.D.	0.40	2.0					
Perfluorononanesulfonic acid	N.D.	0.60	2.0					
Perfluorononanoic acid	N.D.	0.40	2.0					
Perfluorooctanesulfonamide	N.D.	0.50	3.0					
Perfluorooctanesulfonic acid	3.8	0.40	2.0					
Perfluorooctanoic acid	N.D.	0.30	1.0					
Perfluoropentanesulfonate	N.D.	0.40	2.0					
Perfluoropentanoic acid	N.D.	2.0	6.0					
Perfluorotetradecanoic acid	N.D.	0.30	1.0					
Perfluorotridecanoic acid	N.D.	0.40	1.0					
Perfluoroundecanoic acid	N.D.	0.40	2.0					

LCS/LCSD

Analysis Name	LCS Spike Added ng/l	LCS Conc ng/l	LCSD Spike Added ng/l	LCSD Conc ng/l	LCS %REC	LCSD %REC	LCS/LCSD Limits	RPD	RPD Max
Batch number: 19163010	Sample number	(s): 1077628							
4:2-Fluorotelomersulfonic acid	14.94	12.79	14.94	13.61	86	91	82-152	6	30
6:2-Fluorotelomersulfonic acid	15.17	14	15.17	14.82	92	98	66-155	6	30
8:2-Fluorotelomersulfonic acid	15.33	15.26	15.33	15.15	100	99	66-148	1	30
NEtFOSAA	5.44	5.26	5.44	5.85	97	108	55-169	11	30
NMeFOSAA	5.44	6.36	5.44	6.00	117	110	44-147	6	30

^{*-} Outside of specification

^{**-}This limit was used in the evaluation of the final result for the blank

⁽¹⁾ The result for one or both determinations was less than five times the LOQ.

⁽²⁾ The unspiked result was more than four times the spike added.

Quality Control Summary

Client Name: Environmental Services, Inc. Group Number: 2048283

Reported: 06/13/2019 18:00

LCS/LCSD (continued)

Analysis Name	LCS Spike Added ng/l	LCS Conc ng/l	LCSD Spike Added ng/l	LCSD Conc ng/l	LCS %REC	LCSD %REC	LCS/LCSD Limits	RPD	RPD Max
Perfluorobutanesulfonic acid	4.81	5.42	4.81	5.26	113	109	73-128	3	30
Perfluorobutanoic acid	5.44	6.62	5.44	6.98	122	128	74-142	5	30
Perfluorodecanesulfonic acid	5.24	4.86	5.24	5.66	93	108	60-135	15	30
Perfluorodecanoic acid	5.44	5.73	5.44	6.10	105	112	69-148	6	30
Perfluorododecanoic acid	5.44	6.00	5.44	6.34	110	116	75-136	5	30
Perfluoroheptanesulfonic acid	5.18	4.98	5.18	5.63	96	109	64-135	12	30
Perfluoroheptanoic acid	5.44	5.95	5.44	6.41	109	118	76-140	7	30
Perfluorohexanesulfonic acid	5.14	5.21	5.14	5.47	101	106	71-131	5	30
Perfluorohexanoic acid	5.44	5.96	5.44	6.05	110	111	75-135	1	30
Perfluorononanesulfonic acid	5.22	5.57	5.22	5.89	107	113	66-133	6	30
Perfluorononanoic acid	5.44	6.41	5.44	6.06	118	111	72-148	6	30
Perfluorooctanesulfonamide	5.44	5.31	5.44	5.81	98	107	65-164	9	30
Perfluorooctanesulfonic acid	5.20	7.73	5.20	6.49	149*	125	67-138	18	30
Perfluorooctanoic acid	5.44	6.13	5.44	6.26	113	115	72-138	2	30
Perfluoropentanesulfonate	5.10	5.48	5.10	5.78	107	113	76-127	5	30
Perfluoropentanoic acid	5.44	6.00	5.44	6.43	110	118	74-134	7	30
Perfluorotetradecanoic acid	5.44	5.48	5.44	5.50	101	101	74-135	0	30
Perfluorotridecanoic acid	5.44	5.92	5.44	6.14	109	113	61-145	4	30
Perfluoroundecanoic acid	5.44	6.52	5.44	6.23	120	115	75-146	4	30

Labeled Isotope Quality Control

Labeled isotope recoveries which are outside of the QC window are confirmed unless otherwise noted on the analysis report.

Analysis Name: PFAS - 24 compounds

Batch number: 19163010

	13C4-PFBA	13C5-PFPeA	13C3-PFBS	13C2-4:2-FTS	13C5-PFHxA	13C3-PFHxS
1077628	93	92	95	167	92	94
Blank	78	78	75	93	78	80
LCS	85	85	84	112	86	97
LCSD	74	75	74	93	75	78
Limits:	33-123	31-157	26-148	21-182	35-138	34-126
	13C4-PFHpA	13C2-6:2-FTS	13C8-PFOA	13C8-PFOS	13C9-PFNA	13C6-PFDA
1077628	88	152	87	143*	160*	93
Blank	80	96	75	76	72	80
LCS	88	113	84	85	83	79
LCSD	76	98	76	69	71	80

^{*-} Outside of specification

^{**-}This limit was used in the evaluation of the final result for the blank

⁽¹⁾ The result for one or both determinations was less than five times the LOQ.

⁽²⁾ The unspiked result was more than four times the spike added.

2425 New Holland Pike, Lancaster, PA 17601 • 717-656-2300 • Fax: 717-656-6766 • www.EurofinsUS.com/LancLabsEnv

Quality Control Summary

Client Name: Environmental Services, Inc. Group Number: 2048283

Reported: 06/13/2019 18:00

Labeled Isotope Quality Control (continued)

Labeled isotope recoveries which are outside of the QC window are confirmed unless otherwise noted on the analysis report.

Analysis Name: PFAS - 24 compounds

Batch number: 19163010

Limits:	35-126	32-170	48-122	50-121	41-144	47-125	
	13C2-8:2-FTS	d3-NMeFOSAA	13C7-PFUnDA	d5-NEtFOSAA	13C2-PFDoDA	13C2-PFTeDA	
1077628	118	115	92	119	94	102	
Blank	90	85	71	84	77	73	
LCS	91	87	73	91	76	74	
LCSD	94	91	75	91	76	83	
Limits:	27-164	30-127	30-128	30-142	39-130	26-119	

	13C8-PFOSA
1077628	86
Blank	68
LCS	71
LCSD	72

Limits: 11-127

^{*-} Outside of specification

^{**-}This limit was used in the evaluation of the final result for the blank


⁽¹⁾ The result for one or both determinations was less than five times the LOQ.

⁽²⁾ The unspiked result was more than four times the spike added.

Environmental Analysis Request/Chain of Custody

🗱 eurofins |

	Lancaster Laboratories Environmental			Acct. # _	449	484	Cro	up#_	20	48	2	83	Sample # _					*****	
Client: Environ	mental Services Inc.						Matrix					Α	nalyse	s Req	ueste	ed		For Lab Us	e Only
Project Name/#:	2019-0537	Site ID #:			I						Pre	serva	ation a	nd Fil	tratio	n Cod	des	SF #:	
Project Manager:	Dustin Mitchell	P.O. #: "	7920	9		Tissue	ace,			0								SCR #:	
Sampler: C. C.		PWSID#:				<u>=</u>	Ground Surface		s	A	5	(412/16					Preservat	on Codes
	4027069	Quote #:				ᇦᅵ			iner	PFO,	E	9	1/2					H = HCI	T = Thiosulfate
		Compliance:	Yes 🗌	No [¥-	Sediment	ble ES		onta	P	9	J-6	~					N = HNO ₃	B = NaOH
		Colle	ction				Potable NPDES	Ŀ	Total # of Containers	PFOS +	12	519	55					$S = H_2SO_4$ F = Field Filtered	$P = H_3PO_4$ $O = Other$
Sample Identific	ation	Date	Time	Grab	Ē	Soil	Water	Other:	Total	Ph	R	اناق	7						arks
Outfall - a		6-11-19	9.25	*			SUMF	1	2	45								0=0+h	in=Trize
					_											-			
					+		:	<u> </u>							-				
					\top		12.1 2.1												
.,,,,					_			_						\perp	_	ļ			
															-			_	
			dard 🗌		A. F	 Réline	guished	bv:			Da	l ate	Time	Re	eived	l l bv:		Date	Time
l .	re Requested (TAT) (please chec sh TAT is subject to laboratory approv	k): Stan val and surch	dard L	Rush	9	/	9/1	\ _		1	6-11								
Date results are ne					 F	Relin	quished	∫ by₂	1	/		ate	Time	Re	ceived	by:		Date	Time
		lail 🔠	Pho	ne 🗌			<i>ئ</i> ىي	surran [s	/					•					
	Austin @e-s-1.com	and			F	Relin	quished	l by:			Di	ate	Time	Re	ceived	l by:		Date	Time
		Knighte	De-5-1.	com			-												
	ptions (please check if required				F	Relin	quished	l by:			Da	ate	Time	Re	ceived	by:		Date	Time
Type I (Validation/	non-CLP) 🔲 MA MCP		_					**************************************											
Type III (Reduced	non-CLP) CT RCP	A	<i>-</i>		I F	Relin	quished	by:			Di	ate	Tim	Re	ceived		-0-	Date	Time
Type VI (Raw Data	a Only) 🔲 TX TRRF	P-13 🔲									<u> </u>					$^{\prime} \sim$	Q-	10 12 19	0915
NJ DKQP		Category	□ A o	r 🔲 E	3F	Relin	quished	by C	omm	ercial 	Carrie	er:						. \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \ \	·
EDD Required?	Yes No No	es, format:	PDF		ļ	UPS_		Fedl	Ξx,	\times	Other			_ Te	mpera	ture u	pon rece	ipt 16.2	°C



Lancaster Laboratories Environmental

Client: Environmental Services, Inc.

Sample Administration Receipt Documentation Log

Doc Log ID:

251225

Group Number(s):

2048283

2019-0537

Delivery and Receipt Information

Delivery Method:

Fed Ex

Arrival Timestamp:

06/12/2019 8:15

Number of Packages:

1

Number of Projects:

1

State/Province of Origin:

CT

Arrival Condition Summary

Shipping Container Sealed:

Yes

Sample IDs on COC match Containers:

Yes

Custody Seal Present:

No

Sample Date/Times match COC:

Yes

Samples Chilled:

Yes

VOA Vial Headspace ≥ 6mm:

N/A

Paperwork Enclosed:

Yes

Total Trip Blank Qty:

0

Samples Intact:

Yes No

Air Quality Samples Present:

No

Missing Samples: Extra Samples:

No

Discrepancy in Container Qty on COC:

No

Unpacked by Nicole Reiff (25684) at 09:01 on 06/12/2019

Samples Chilled Details: 2019-0537

Thermometer Types:

DT = Digital (Temp. Bottle)

IR = Infrared (Surface Temp)

All Temperatures in °C.

Samples Collected Same

Cooler # Thermometer ID Corrected Temp

Therm. Type

Ice Present? Ice Type

Ice Container

Elevated Temp?

Day as Receipt?

1

32170023

ΙR

ice Pack

Ν

N/A

16.2

N

Elevated Temperature Details: 2019-0537

All Temperatures in °C

Thermometer Top Left Cooler# <u>ID</u> Temp 32170023

Top Right Temp 17.0

Bottom Left Temp

Bottom Right Temp 16.8

Center Temp 16.3

Factors Contributing to Elevated Temp

Comments

Icepacks were warm. Bottles were wrapped in thick layer of bubble wrap.

OK to proceed por C. Knight.

UF593 6/12/19



BMQL

Dry weight

basis

Explanation of Symbols and Abbreviations

milliliter(s)

The following defines common symbols and abbreviations used in reporting technical data:

Below Minimum Quantitation Level

			\					
С	degrees Celsius	MPN	Most Probable Number					
cfu	colony forming units	N.D.	non-detect					
CP Units	cobalt-chloroplatinate units	ng	nanogram(s)					
F	degrees Fahrenheit	NTU	nephelometric turbidity units					
g	gram(s)	pg/L	picogram/liter					
IU	International Units	RL	Reporting Limit					
kg	kilogram(s)	TNTC	Too Numerous To Count					
L	liter(s)	μg	microgram(s)					
lb.	pound(s)	μL	microliter(s)					
m3	cubic meter(s)	umhos/cm	micromhos/cm					
meq	milliequivalents	MCL	Maximum Contamination Limit					
mg	milligram(s)							
<	less than							
>	greater than							
ppm	parts per million - One ppm is equivalent to one milligram per kilogram (mg/kg) or one gram per million grams. For aqueous liquids, ppm is usually taken to be equivalent to milligrams per liter (mg/l), because one liter of water has a weight very close to a kilogram. For gases or vapors, one ppm is equivalent to one microliter per liter of gas.							
ppb	parts per billion							

Analytical test results meet all requirements of the associated regulatory program (i.e., NELAC (TNI), DoD, and ISO 17025) unless otherwise noted under the individual analysis.

Results printed under this heading have been adjusted for moisture content. This increases the analyte weight

concentration to approximate the value present in a similar sample without moisture. All other results are reported on an

Measurement uncertainty values, as applicable, are available upon request.

as-received basis.

Tests results relate only to the sample tested. Clients should be aware that a critical step in a chemical or microbiological analysis is the collection of the sample. Unless the sample analyzed is truly representative of the bulk of material involved, the test results will be meaningless. If you have questions regarding the proper techniques of collecting samples, please contact us. We cannot be held responsible for sample integrity, however, unless sampling has been performed by a member of our staff.

This report shall not be reproduced except in full, without the written approval of the laboratory.

Times are local to the area of activity. Parameters listed in the 40 CFR Part 136 Table II as "analyze immediately" are not performed within 15 minutes.

WARRANTY AND LIMITS OF LIABILITY - In accepting analytical work, we warrant the accuracy of test results for the sample as submitted. THE FOREGOING EXPRESS WARRANTY IS EXCLUSIVE AND IS GIVEN IN LIEU OF ALL OTHER WARRANTIES, EXPRESSED OR IMPLIED. WE DISCLAIM ANY OTHER WARRANTIES, EXPRESSED OR IMPLIED, INCLUDING A WARRANTY OF FITNESS FOR PARTICULAR PURPOSE AND WARRANTY OF MERCHANTABILITY. IN NO EVENT SHALL EUROFINS LANCASTER LABORATORIES ENVIRONMENTAL, LLC BE LIABLE FOR INDIRECT, SPECIAL, CONSEQUENTIAL, OR INCIDENTAL DAMAGES INCLUDING, BUT NOT LIMITED TO, DAMAGES FOR LOSS OF PROFIT OR GOODWILL REGARDLESS OF (A) THE NEGLIGENCE (EITHER SOLE OR CONCURRENT) OF EUROFINS LANCASTER LABORATORIES ENVIRONMENTAL AND (B) WHETHER EUROFINS LANCASTER LABORATORIES ENVIRONMENTAL HAS BEEN INFORMED OF THE POSSIBILITY OF SUCH DAMAGES. We accept no legal responsibility for the purposes for which the client uses the test results. No purchase order or other order for work shall be accepted by Eurofins Lancaster Laboratories Environmental which includes any conditions that vary from the Standard Terms and Conditions, and Eurofins Lancaster Laboratories Environmental hereby objects to any conflicting terms contained in any acceptance or order submitted by client.



Data Qualifiers

Qualifier	Definition
С	Result confirmed by reanalysis
D1	Indicates for dual column analyses that the result is reported from column 1
D2	Indicates for dual column analyses that the result is reported from column 2
E	Concentration exceeds the calibration range
K1	Initial Calibration Blank is above the QC limit and the sample result is ND
K2	Continuing Calibration Blank is above the QC limit and the sample result is ND
K3	Initial Calibration Verification is above the QC limit and the sample result is ND
K4	Continuing Calibration Verification is above the QC limit and the sample result is ND
J (or G, I, X)	Estimated value >= the Method Detection Limit (MDL or DL) and < the Limit of Quantitation (LOQ or RL)
Р	Concentration difference between the primary and confirmation column >40%. The lower result is reported.
P^	Concentration difference between the primary and confirmation column > 40%. The higher result is reported.
U	Analyte was not detected at the value indicated
V	Concentration difference between the primary and confirmation column >100%. The reporting limit is raised
	due to this disparity and evident interference.
W	The dissolved oxygen uptake for the unseeded blank is greater than 0.20 mg/L.
Z	Laboratory Defined - see analysis report

Additional Organic and Inorganic CLP qualifiers may be used with Form 1 reports as defined by the CLP methods. Qualifiers specific to Dioxin/Furans and PCB Congeners are detailed on the individual Analysis Report.