



**Town of Ridgefield Train Station:**  
**-Branchville**

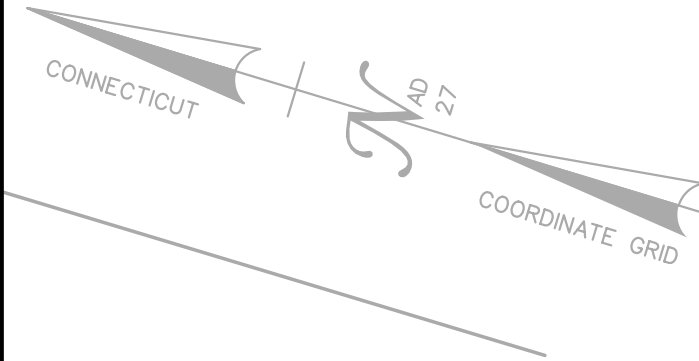

RAILROAD SOUTH TO  
NEW HAVEN MAIN LINE

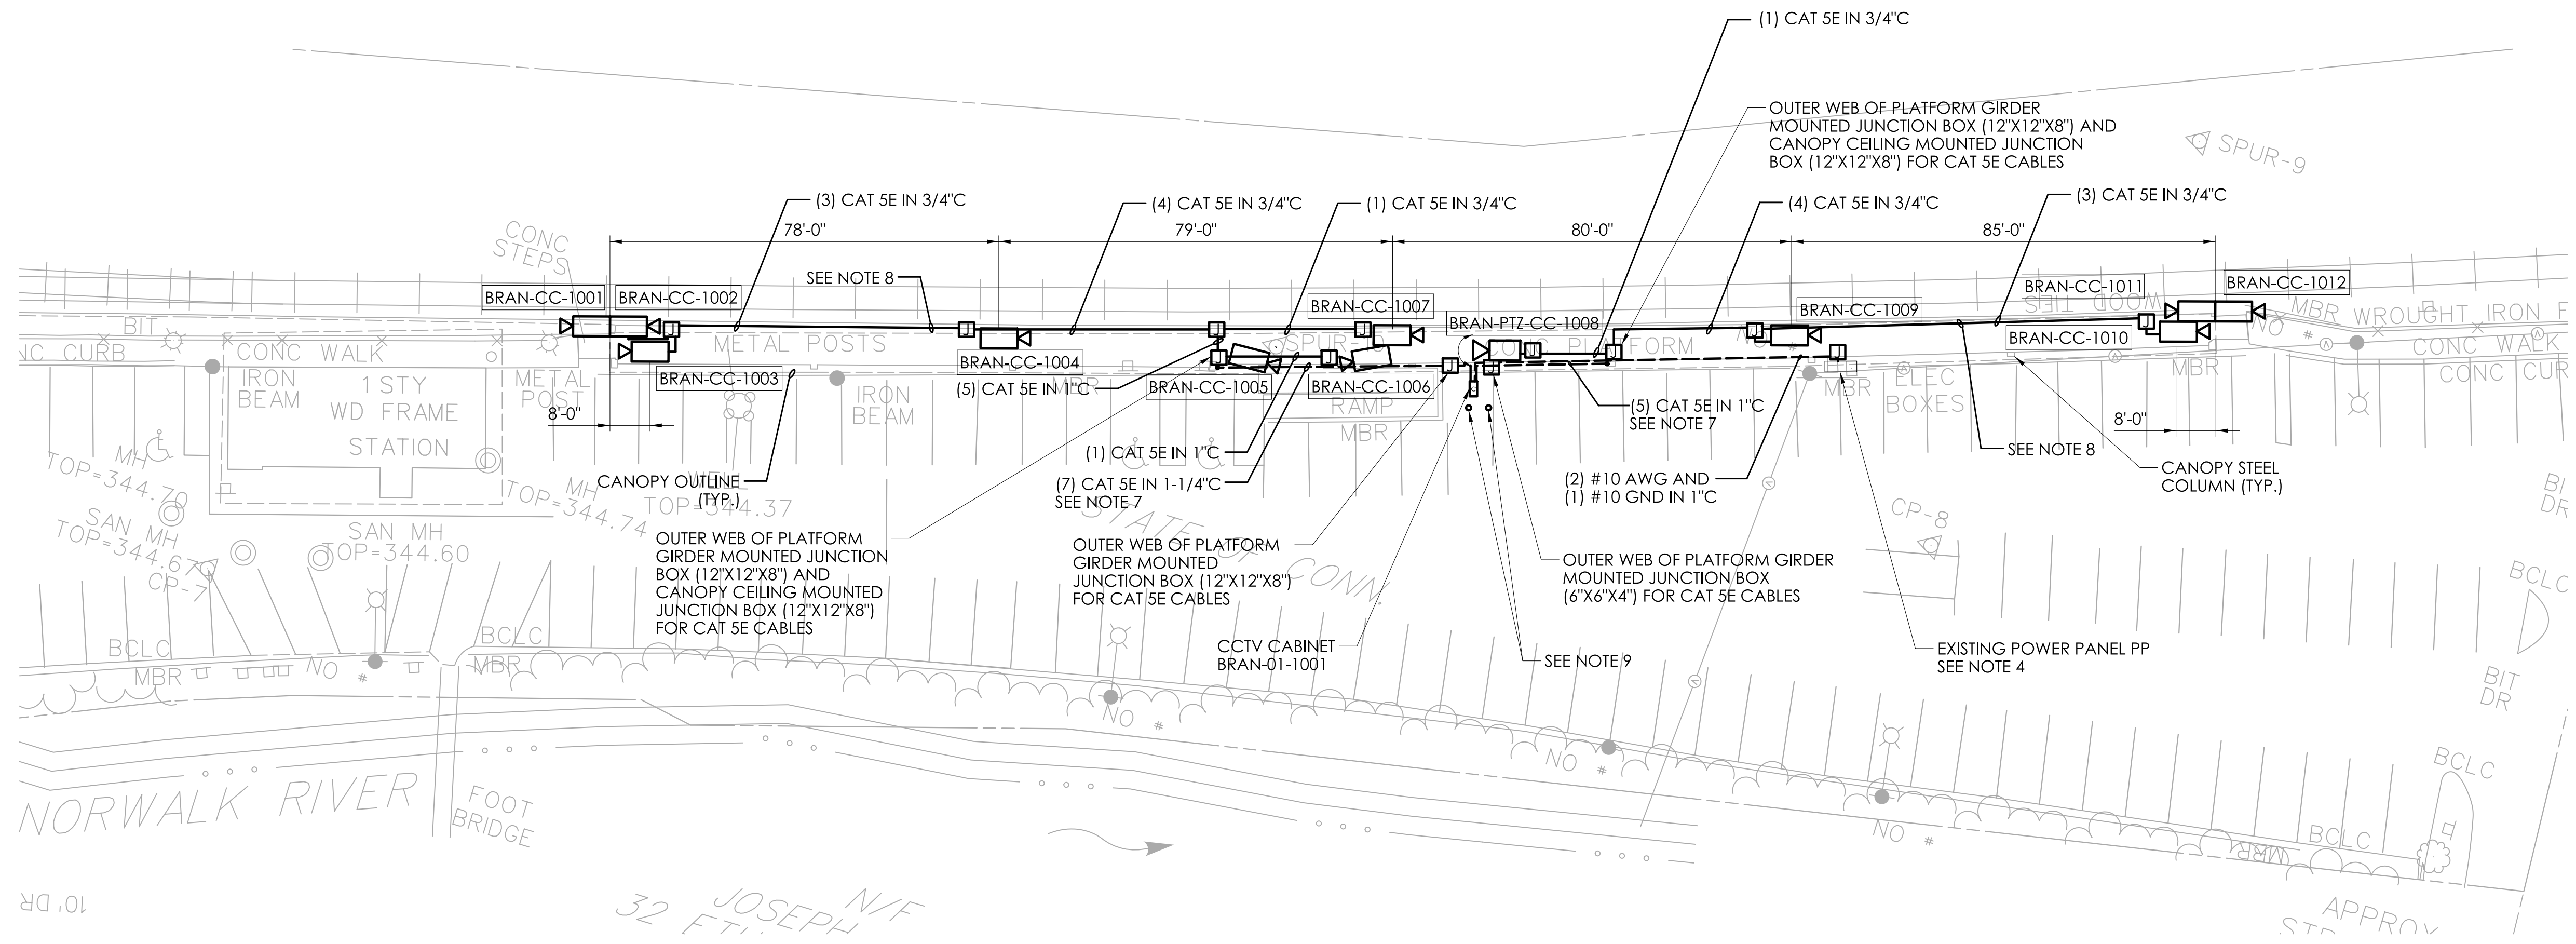

**BRANCHVILLE STATION CAMERA LAYOUT**  
SCALE: 1"=20'

**GENERAL NOTES:**


1. SEE DWG. G-002 FOR ELECTRICAL GENERAL NOTES.  
SEE DWG. G-003 FOR ELECTRICAL ABBREVIATIONS AND LEGEND.
2. SEE DWG. FCI-332 FOR CAMERA SCHEDULE.
3. SEE DWG. FCI-333 FOR DEVICE CONNECTIVITY DIAGRAM.
4. THE CONTRACTOR SHALL FURNISH AND INSTALL 20A-1P CIRCUIT BREAKER INSIDE EXISTING POWER PANEL, PP1, LOCATED IN MAIN ELECTRICAL CABINET. NEW CIRCUIT BREAKER SHALL MATCH EXISTING MANUFACTURER AND AIC RATING.
5. THE CONTRACTOR SHALL FURNISH AND INSTALL (2) #10 AWG + (1) #10 GND IN (1) 1" PVC COATED CONDUIT FROM EXISTING POWER PANEL "PP" LOCATED IN MAIN ELECTRICAL PAD MOUNT CABINET TO PROPOSED CCTV CABINET AS SHOWN ON THIS DRAWING. THE CONTRACTOR SHALL CORE DRILL THRU BOTTOM OF THE EXISTING ELECTRICAL CABINET AND INSTALL PVC COATED CONDUIT ALONG WITH EXPANSION FIRRING. THE CONTRACTOR SHALL FURNISH AND INSTALL NEW JUNCTION BOX ON BACK SIDE OF PLATFORM CONCRETE GIRDER AND INSTALL (1) 1" PVC COATED POWER CONDUIT TO NEW CCTV CABINET.
6. CCTV CABINET SHALL BE MOUNTED ON MIN. 48" THICK CONCRETE PAD. THE CONTRACTOR SHALL SUBMIT DETAILED SHOP DRAWING SHOWING NECESSARY REBARS FOR ENGINEER'S APPROVAL PRIOR TO PROCEED PAD INSTALLATION WORK. ALL INCOMING AND OUTGOING CONDUIT SHALL BE INSTALLED FROM BOTTOM OF THE CCTV CABINET AND RUN UNDERGROUND TO PLATFORM CONCRETE GIRDER MOUNTED JUNCTION BOX. ALL INCOMING, OUTGOING CONDUITS AND SPARE CONDUITS SHALL BE SEALED AT THE CCTV CABINET WALL AND AT THE OPENING BY USING APPROVED MATERIAL.
7. CONDUIT ON THIS SHEET SHALL BE MOUNTED ON BACK SIDE OF PLATFORM CONCRETE GIRDER. ALL ABOVE GROUND AND UNDERGROUND CONDUITS SHALL BE PVC COATED RGSC, UNLESS OTHERWISE NOTED. THE CONTRACTOR SHALL SUBMIT DETAIL CONDUIT INSTALLATION PLAN FOR ENGINEER'S APPROVAL PRIOR TO PROCEED CONDUIT INSTALLATION WORK.
8. THE CONTRACTOR SHALL FURNISH AND INSTALL PVC COATED CONDUITS FROM PLATFORM CONCRETE GIRDER MOUNTED JUNCTION BOX UP TO CANOPY CEILING. ROUTE CONDUIT ALONG CANOPY STEEL COLUMN TO CANOPY CEILING AND RUN HORIZONTALLY IN CANOPY STEEL BEAM TO PROPOSED CAMERA JUNCTION BOX.
9. THE CONTRACTOR SHALL INSTALL TWO (2) BOLLARDS IN FRONT OF NEW CCTV CABINET AS SHOWN IN THIS DRAWING, SEE DETAIL 4/FCI-643 FOR BOLLARD.
10. THE CONTRACTOR SHALL INSTALL JUNCTION BOX TO COMPLY NEC WIRE PULL REQUIREMENT. JUNCTION BOX SHALL BE SIZED PER NEC.

REV.	DATE	REVISION DESCRIPTION

DESIGNER/DRAFTER: T. LUY      CHECKED BY: A. PATEL, P.E.

SCALE AS NOTED

SIGNATURE/BLOCK: GARG CONSULTING SERVICES, INC.  
2096A Silos Deane Highway  
Rocky Hill, CT 06067  
Tel: (860) 563-0582

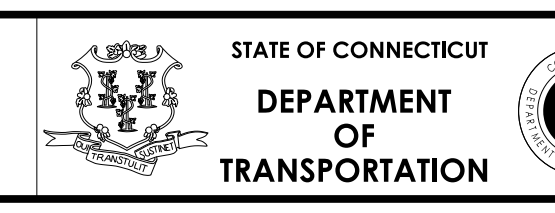

PROJECT NUMBER: 0300-0215  
PROJECT DESCRIPTION: NETWORK INFRASTRUCTURE UPGRADE FOR SECURITY - PHASE 4  
TOWN(S): BRANCHVILLE  
DRAWING TITLE: BRANCHVILLE STATION PLAN

DRAWING NO. FCI-331  
SHEET NO.