

STATE OF CONNECTICUT

PUBLIC UTILITIES REGULATORY AUTHORITY
TEN FRANKLIN SQUARE
NEW BRITAIN, CT 06051

DOCKET NO. 22-07-01

APPLICATION OF AQUARION WATER COMPANY OF
CONNECTICUT TO AMEND ITS RATE SCHEDULE

March 15, 2023

By the following Commissioners:

Marissa P. Gillett
Michael A. Caron

DECISION

TABLE OF CONTENTS

I.	INTRODUCTION	1
A.	EXECUTIVE SUMMARY.....	1
B.	BACKGROUND OF PROCEEDING	1
C.	CONDUCT OF PROCEEDING	1
D.	PARTIES AND INTERVENORS.....	2
E.	POSITIONS OF PARTIES AND INTERVENORS	2
F.	PUBLIC COMMENT	4
II.	STANDARD OF REVIEW	6
III.	TEST YEAR AND MULTI-YEAR RATE PLAN	8
A.	TEST YEAR.....	8
B.	MULTI-YEAR RATE PLAN.....	8
IV.	RATE BASE	9
A.	SUMMARY	9
B.	PLANT-IN-SERVICE	11
1.	Test Year Plant-in-Service.....	11
2.	Pro Forma Plant Additions	16
3.	IT Projects.....	22
C.	ACCUMULATED DEPRECIATION	22
D.	DEFERRED INCOME TAX.....	24
E.	WORKING CAPITAL.....	24
F.	CAPITALIZED EXPENSES	24
G.	FIVE-YEAR CAPITAL PLAN	25
V.	COST OF CAPITAL	27
A.	SUMMARY	27
B.	FINANCIAL CONDITION AND FLEXIBILITY	28
C.	PROXY GROUP	31
D.	CAPITAL STRUCTURE.....	33
1.	Summary.....	33
2.	Positions of the Parties	33
E.	COST OF DEBT	37
1.	Long-Term Debt.....	37
2.	Short-Term Debt	38
F.	RETURN ON EQUITY	39
1.	Summary.....	39
2.	Comparable Allowed ROEs	39
3.	Treasury Rate Trends & Static Analysis.....	40
4.	Discounted Cash Flow (DCF) Model	41
5.	Capital Asset Pricing Model (CAPM)	49
6.	Expected Earnings Model.....	52
7.	Other Factors	53
8.	Approved ROE	57
VI.	ALLOWABLE EXPENSES	58

A.	LATE FILED EXHIBITS	58
B.	OPERATIONS AND MAINTENANCE EXPENSES	59
1.	Summary.....	59
2.	Employee Compensation	60
3.	Employee Service Awards Program	64
4.	Management Fee Compensation	65
5.	Performance Metrics	66
6.	Benefits	69
7.	Purchases.....	71
8.	Eversource Merger	74
9.	Inflation Adjustment.....	79
10.	Administrative and General Costs	81
11.	Conservation.....	83
12.	Communication Expense	89
13.	Entertainment Expenses	90
14.	Relocation Expense	91
15.	Acquisition Adjustment Amortization	91
16.	Fee Free Program	92
17.	Software Maintenance, Non-SAP Costs	93
18.	Bad Debt Expense	95
C.	DEPRECIATION EXPENSE	95
1.	Summary.....	95
2.	Depreciation Study	96
3.	Amortization of General Plant Reserve	96
4.	Depreciation Rates	97
D.	ADJUSTMENT TO PLANT-IN-SERVICE	104
E.	TAXES.....	104
1.	Payroll Tax.....	104
2.	State Tax	104
3.	Federal Tax.....	104
4.	Excess Accumulated Deferred Income Taxes.....	105
5.	Summary of Tax Adjustments	107
VII.	APPROVED REVENUE REQUIREMENT	108
VIII.	RATE DESIGN.....	108
A.	SALES FORECASTS AND REVENUE	108
B.	COST ALLOCATION.....	109
C.	RATE DESIGN	111
1.	Overview	111
2.	Single Year Rate Design	112
3.	Inclining Block Rate Design	112
4.	Rate Consolidation (Single-Tariff Pricing)	115
5.	Customer Service Charge	115
6.	Fire Protection	116
7.	Miscellaneous Fees.....	116
D.	VEOLIA WHOLESALE ALLOCATION	117
E.	RATE/REVENUE ADJUSTMENT MECHANISMS	117
1.	WICA.....	117
2.	Revenue Adjustment Mechanism.....	118

3. Earnings Sharing Mechanism	119
F. RATE-RELATED PROPOSALS	120
1. Low-Income Rate Assistance Program	120
2. Incremental Bad Debt Write-Off Regulatory Asset	133
3. Property Tax Reconciliation.....	133
4. Lead Service Line Replacement Program.....	134
IX. CUSTOMER SERVICE & WATER SUPPLY	138
A. CUSTOMER SERVICE REVIEW	138
1. Standard Bill Form and Notices	138
2. Estimated Bills	139
3. Security Deposit Policies	139
4. Late Payment Charges.....	141
5. Rules and Regulations.....	142
6. Customer Complaints	142
B. WATER SUPPLY.....	143
1. Water Quality.....	143
2. Water Quantity	144
3. Adequacy of Water Supply & Storage	144
4. Interconnections and Purchased Water	145
5. Water Conservation Plan.....	145
6. Periodic Meter Testing.....	145
X. CONCLUSION AND ORDERS	146
A. CONCLUSION.....	146
B. ORDERS	146
XI. APPENDIX.....	1

DECISION

I. INTRODUCTION

A. EXECUTIVE SUMMARY

The Public Utilities Regulatory Authority (Authority or PURA) approves an annual revenue requirement for Aquarion Water Company of Connecticut (Aquarion or Company) in the amount of \$195,561,690 for the rate year commencing on March 15, 2023. The approved annual revenue requirement represents a decrease of \$1,969,517, or approximately 0.997%, from the Company's currently approved revenue requirement. While the Company requests a 10.35% return on equity, the Authority determines that an allowed return on equity of 8.70% is appropriate.

B. BACKGROUND OF PROCEEDING

Aquarion is a public service company within the meaning of Conn. Gen. Stat. § 16-1. Aquarion is a subsidiary of Aquarion Water Company (Parent Company). The Company currently provides water service, including fire protection service, to approximately 207,000 customer connections in 56 communities across Connecticut. Application, p. 5.

Aquarion previously increased its base rates in October 2013. Decision (2013 Decision), Sept. 24, 2013, Docket No. 13-02-20, Application of Aquarion Water Company of Connecticut to Amend Its Rates (2013 Rate Case).

On July 1, 2022, Aquarion submitted formal notice of its intent to file an application to amend its existing rate schedules.

C. CONDUCT OF PROCEEDING

On August 26, 2022, Aquarion filed an application to amend its existing rate schedules (Application) pursuant to Conn. Gen. Stat. § 16-19, Conn. Agencies Regs. § 16-1-53a, and the Standard Filing Requirements.

The Authority held a noticed scheduling conference on September 8, 2022, via teleconference.

The Authority conducted a noticed revenue audit on September 23, 2022, via remote access, and a noticed audit of the books and records of the Company on September 29 and 30, 2022, at the offices of the Company, 600 Lindley Street, Bridgeport, Connecticut.

The Authority held two noticed in-person public comment hearings; the first on September 8, 2022, at the Westport Town Hall and the second on October 12, 2022, at the Stratford Library. The Authority also held two noticed virtual public comment hearings on October 6, 2022, and on October 25, 2022.

The Authority conducted inspections of the Company's plant and facilities throughout Connecticut on November 8 and 9, 2022.

The Authority held noticed evidentiary hearings on November 22, 28, 29, and 30, and on December 1, 5, and 6, 2022, at PURA's offices, Ten Franklin Square, New Britain, Connecticut (PURA's Offices).

The Authority held late filed exhibit hearings on December 14 and 15, 2022, at PURA's Offices.

The Authority issued a Proposed Final Decision in this matter on February 16, 2023. All Parties and Intervenors were given the opportunity to file Written Exceptions to the Proposed Final Decision and to present Oral Argument. The Authority heard Oral Argument on March 3, 2023.¹

D. PARTIES AND INTERVENORS

The Authority recognized the following as Parties to this proceeding: Aquarion Water Company of Connecticut, 835 Main Street, Bridgeport, CT 06604; Office of Education, Outreach, and Enforcement, Ten Franklin Square, New Britain, CT 06051; Office of Consumer Counsel, Ten Franklin Square, New Britain, CT 06051; and the Commissioner of the Department of Energy and Environmental Protection, 55 Elm Street, Hartford, CT 06106.

The Authority designated the following as Intervenors to this proceeding: the Office of the Attorney General; the City of Rye and the Villages of Port Chester and Rye Brooke, New York; Smart Water Westport; Veolia Water New York, Inc.; and all towns and municipalities in Aquarion Water Company of Connecticut's service territory. A list of the towns and municipalities designated as Intervenors is provided in the Appendix.

E. POSITIONS OF PARTIES AND INTERVENORS

The Company acknowledges that Connecticut continues to grapple with the COVID-19 pandemic and that the current economic and global political climate is impacting the cost of energy and other consumer goods. Aquarion Brief, p. 11. The Company asserts, however, that access to "a reliable, safe, and high-quality water supply" remains a public necessity. *Id.* According to Aquarion, its current rates are insufficient to cover the costs of providing safe and reliable service to customers. *Id.*, p. 12. The Company also alleges that the rates are insufficient to cover the capital infrastructure investments the Company has made since the 2013 Rate Case. *Id.* Accordingly, the Company is requesting approval to increase base rates for a three-year period to address revenue deficiencies. *Id.*, p. 1.

¹ A majority of the Commissioners heard the matter and/or read the record of the proceeding; therefore, although the Authority provided the opportunity for written exceptions and oral argument, a proposed final decision was not required. Conn. Gen. Stat. § 4-179(a).

The Authority's Office of Education, Outreach, and Enforcement (EOE) actively participated in this proceeding,² issuing nearly 90 interrogatories, providing expert testimony, conducting cross examination during both the evidentiary hearings and late filed exhibit hearings, and filing a brief. EOE recommends that the Company update its customer notices to educate customers about the process of requesting a return of their security deposit and to identify regulatory security deposit exemptions. EOE Brief, pp. 5-6. EOE also provides suggestions to modify the proposed Low-Income Discount Rate Program. *Id.*, p. 13. As stated by EOE's expert witness, Aaron Rothschild, the Authority should approve a return on equity (ROE) between 7.65% and 8.91%, as it reflects the Company's and ratepayers' needs best compared to other ROEs proposed by experts who testified in this proceeding. *Id.*, pp. 14, 25. Specifically, EOE identifies deficiencies in the testimony provided by Aquarion's ROE expert, Joshua Nowak. *Id.*, pp. 23-25.

OCC also actively participated in this proceeding, issuing over 350 interrogatories, providing expert testimony, conducting cross examination during both the evidentiary hearings and late filed exhibit hearings, and filing a brief. OCC states, among other issues raised, that the Company's proposed Low-Income Discount Rate Program fails to provide a measurable benefit to vulnerable customers. OCC Brief, p. 9. Further, the Company has not demonstrated that it has undertaken the necessary steps to understand why its customers fail to pay their bills and, therefore, should not be able to recover uncollectible revenues. *Id.*, p. 25. OCC asserts that projects less than 100% complete by the last day of the hearing should be removed from the plant in service rate base calculation consistent with past PURA precedent. *Id.*, p. 27. OCC does not support a multi-year rate increase. *Id.*, p. 59. OCC does, however, support the proposed four-tier inclining block rate structure as it will provide relief for low-income residential customers by shifting costs to higher-volume residential users. *Id.*, pp. 61-62.

DEEP actively participated in this proceeding, issuing over 30 interrogatories, conducting cross examination in the evidentiary hearings and late filed exhibit hearings, and filing a brief. DEEP supports an inclining block rate structure but recommends that the Authority approve a three-tier structure for residential single-family customers that more aggressively targets discretionary uses (*e.g.*, lawn irrigation). DEEP Brief, pp. 2-3. DEEP also supports approval of a 15% Low-Income Rate Assistance Program (LIRAP), with suggested modifications. *Id.*, p. 6. Additionally, DEEP requests that the Authority order the Company to submit a plan to bring non-compliant DEEP authorized diversion permits and registrations into compliance and to submit a study evaluating the impact of Aquarion's water withdrawals that may be potentially harmful to the environment. *Id.*, pp. 9-11.

The Office of the Attorney General (OAG) objects to Aquarion's proposed rate increase on the basis that the Company has failed to meet its burden of demonstrating resulting rates are just and reasonable and specifically rejects the multi-year rate proposal. OAG Brief, pp. 1, 16. The OAG states that Aquarion's proposed ROE is unreasonably high, is based upon a biased analysis, and is inconsistent with market conditions and PURA decisions and, therefore, recommends an ROE in the range of

² Pursuant to Conn. Gen. Stat. § 16-19j(b), the Authority appointed EOE as a party to the proceeding.

8.33% and 9.00%. Id., pp. 1-2, 10. Further, the OAG finds that Aquarion has overstated its proposed costs and recommends adjustments to reduce the Company's proposed revenue requirement by more than \$20 million in Rate Year 1. Id., p. 2. In addition, the OAG recommends that PURA reject the Company's proposed capital structure, in part because the cost of equity is unfairly high given that Eversource Energy (Eversource), Aquarion's parent company, maintains a lower equity level. Id., pp. 5-6.

The City of Rye and the Villages of Port Chester and Rye Brooke, New York (New York Municipalities or NYM) propose adjustments to the calculation of the resale rate by which Aquarion sells water to the New York Municipalities. New York Municipalities Brief, p. 2. The NYM do not take issue with the amended cost allocation methodology (ACAM) as approved in Docket No. 19-12-27, Petition of Aquarion Water Company of Connecticut for Approval of Amended Cost Allocation Methodology Under an Existing Water Supply Agreement with Suez Water Westchester (Docket No. 19-12-27); however, the NYM raise concerns that the corresponding adjustments to the inputs in the ACAM have not been updated in the cost of service. Id., p. 3. Aquarion is making improvements to the Southwest Regional Pipeline (SWRP) to increase water supply, but the allocation of capital costs puts a significant burden on the Greenwich Division. Id., p. 4. As such, the NYM request that the Authority reduce the allocation of capital costs for the SWRP to the Greenwich Division and assigned to Veolia, and flow through adjustments in the rate of return and cost of operations to the methodology used to set the resale rate. Id., p. 9.

Veolia Water New York, Inc. (Veolia) purchases water from Aquarion pursuant to a water supply agreement. The rate is determined by the ACAM, which was approved by the Authority in Docket No. 19-12-27. As proposed in the Application, Aquarion seeks to increase Veolia's rate by \$1.6 million, or 41.63%. Given that this rate proceeding is the first time ACAM would be utilized, Veolia sought intervention to ensure that the Company was appropriately complying with ACAM. After conducting limited discovery, Veolia determined that Aquarion did comply with ACAM and is not recommending specific adjustments to the inputs Aquarion used. Veolia Brief, p. 3. Should PURA make any adjustments to Aquarion's proposed rate increase, Veolia requests that those adjustments flow through the ACAM. Id., p. 4.

Smart Water Westport (Smart Water), consisting of Westport residents, raised concerns about Aquarion's transparency in costs, use of data, and marketing as their rationale for opposing Aquarion's rate increase. Smart Water asserts that Aquarion has failed to demonstrate how its marketing benefited ratepayers and seeks a \$3 million reduction in capital expenditures. Smart Water Brief, p. 22.

F. PUBLIC COMMENT

The Authority held four public comment hearings, two in person and two virtually. Sixteen people attended the in-person public comment hearing on September 8, 2022, at the Westport Town Hall; seventeen people attended the in-person public comment hearing on October 12, 2022, at the Stratford Library; approximately forty-two people attended the virtual public comment hearing on October 6, 2022; and approximately thirty-

three people attended the second virtual hearing on October 25, 2022. Aquarion provided a presentation via PowerPoint at the beginning of each of the public comment hearings.

The Authority received oral and written comments from forty-eight entities. Of those entities, five were elected officials,³ two were organizations,⁴ and the remaining forty-two were ratepayers. Of those who submitted written comments, four self-identified as senior citizens.⁵ The American Association of Retired Persons Connecticut (AARP CT) also filed a petition opposing the rate increase, which was signed by 2,389 of its members. AARP Corresp., Oct. 26, 2022.

Opposition to Aquarion's application for a rate increase was unanimous. None of the comments received advocated for increased rates, and most comments were critical of Aquarion's proposal in full, with the limited exception being that, in some instances, commenters opposed the overall increase but supported one element of the proposal. For example, the Town of Simsbury opposed the rate increase but supported the tiered rate structure.⁶ AARP opposed the increase but supported the creation of a low-income rate.⁷ The Town of Greenwich opposed the rate increase because of its impact on customers, as well as the impact on municipal costs such as the rental of hydrants.⁸ In one instance, a commenter did find Aquarion's response to the 2022 drought to be appropriate.⁹

The top reasons commenters opposed the increase included that the proposed increase was too high (60% of complaints);¹⁰ and general opposition to the proposed rate structure (33% of complaints).¹¹ More specifically, the majority of these comments were opposed to the inclining-block structure for residential accounts.¹² Commenters also asserted that the proposed increase is due to corporate greed or otherwise not justified (11% of complaints),¹³ and expressed general dissatisfaction with water quality (11% of complaints).¹⁴

³ See Brenda Kupchick, First Selectman, Town of Fairfield, Corresp., Sept. 1, 2022; State Senator Tony Hwang, 28th District, Connecticut General Assembly, Corresp., Sept. 8, 2022 and Jan. 6, 2023; State Representative Joseph Gresko, Tr., Oct. 12, 2022, 17:13-19:22; Maria E. Capriola, Town Manager, Town of Simsbury, et al., Corresp., Sept. 30, 2022; Monica M. McNally, First Selectman, Town of Darien, Corresp., Oct. 20, 2022; Tr., Sept. 8, 2022, 25:17-26:1.

⁴ See Gary Wilcox, President, and James Baldis, Fire Chief, Simsbury Fire District Corresp., Oct. 11, 2022; Josh Erlingheuser, Advocacy Director, AARP CT Corresp., Oct. 3, 2022.

⁵ See, e.g., Cornelia Baker Corresp., Sept. 28, 2022; Teresita Pastorelle Corresp., Sept. 28, 2022.

⁶ Maria E. Capriola, Town Manager, Town of Simsbury, et al., Corresp., Sept. 30, 2022.

⁷ John Erlingheuser, Advocacy Director, AARP CT Corresp., Oct. 3, 2022.

⁸ Fred Camillo, First Selectman, Town of Greenwich, Dec. 2, 2022.

⁹ Tr., Oct. 12, 2022, 18:25-19:1.

¹⁰ See, e.g., Maryanne Joyce Corresp, Sept. 13, 2022; Bill Hunter Corresp., Sept. 13, 2022; Martha Durham Corresp., Sept. 20, 2022; Alistair Phipps Corresp., Sept. 26, 2022; Tr., Oct. 6, 2022, 27:3-6.

¹¹ See, e.g., Tr., Sept. 8, 2022, 22:22-23:13; Tr., Oct. 12, 2022, 20:17-21:18; Tr., Oct. 25, 2022, 27:15-28:13.

¹² See, e.g., James A. Landmon Corresp., Sept. 28, 2022; Tr., Oct. 12, 2022, 20:17-21:18; Tr., Oct. 25, 2022, 27:15-28:13.

¹³ See, e.g., Ronald J. Murray Corresp., Sept. 29, 2022.

¹⁴ See, e.g., Carlos DeCarvalho Corresp., Sept. 29, 2022.

Finally, one commenter raised questions regarding the prudence of two specific projects: the water tank storage in Westport, and Aquarion's recent water diversion project.¹⁵ In the first instance, the commenter felt Aquarion overstated the need for tank storage in Westport, and in the latter instance the commenter questioned whether the diversion project was properly approved.¹⁶

II. STANDARD OF REVIEW

Aquarion is a public service company within the meaning of Conn. Gen. Stat. § 16-1. The Authority is statutorily charged with regulating the rates of Connecticut's public service companies. Conn. Gen. Stat. § 16-19. Consequently, Aquarion must "file any proposed amendment of its existing rates with the [A]uthority in such form and in accordance with such reasonable regulations as the [A]uthority may prescribe." Conn. Gen. Stat. § 16-19(a).¹⁷ Once a proposed amendment has been filed, the Authority conducts an investigation "to determine whether such rates conform to the principles and guidelines set forth in section 16-19e, or are unreasonably discriminatory or more or less than just, reasonable and adequate, or that the service furnished by such company is inadequate to or in excess of public necessity and convenience, . . ." *Id.*¹⁸

The statutory prerogative to establish just, reasonable, and sufficient utility rates is based upon principles established in two landmark United States Supreme Court cases, as recognized by the Connecticut Supreme Court. See Connecticut Light & Power Co. v. Dep't of Pub. Util. Control, 216 Conn. 627, 635 (1990). Specifically, a regulated utility is entitled to an opportunity to recover prudent operating expenses as well as capital costs, including a fair and reasonable rate of return on capital investments. Fed. Power Comm'n v. Hope Nat. Gas Co., 320 U.S. 591, 603 (1944) (*Hope*); Bluefield Waterworks & Imp. Co. v. Pub. Serv. Comm'n of W. Va., 262 U.S. 679, 690 (1923) (*Bluefield*); see also Duquesne Light Co. v. Barasch, 488 U.S. 299, 310 (1989). "The prudence of a management decision depends on good faith and reasonableness, judged at the time the decision is made." Connecticut Light & Power Co., 216 Conn. at 645.

Ultimately, however, rate setting requires "a balancing of the investor and consumer interests." Woodbury Water Co. v. Pub. Utilities Comm'n, 174 Conn. 258, 264 (1978) (citing Hope, 320 U.S. at 603). Further, the Authority "is not bound to the use of any single formula or combination of formulae in determining rates. Its rate-making function . . . involves the making of 'pragmatic adjustments.'" *Id.* (citations omitted).

¹⁵ Tr., Sept. 8, 2022, 19:10-15.

¹⁶ Tr., Sept. 8, 2022, 20:21-23:13.

¹⁷ Conn. Agencies Regs. §§ 16-1-53 *et seq.* apply to rate amendment applications.

¹⁸ Conn. Gen. Stat. § 16-19(a) also permits the Authority to "(A) evaluate the reasonableness and adequacy of the performance or service of the public service company using any applicable metrics or standards adopted by the authority pursuant to section 1 of Sept. Sp. Sess., Public Act 20-5, and (B) determine the reasonableness of the allowed rate of return of the public service company based on such performance evaluation."

In striking this balance and making pragmatic adjustments, the Authority is guided by Conn. Gen. Stat. § 16-19e(a), which states, in relevant part, that the Authority shall examine proposed rates in accordance with the following principles:

- (4) that the level and structure of rates be sufficient, but no more than sufficient, to allow public service companies to cover their operating costs including, but not limited to, appropriate staffing levels, and capital costs, to attract needed capital and to maintain their financial integrity, and yet provide appropriate protection to the relevant public interests, both existing and foreseeable . . . ;
- (5) that the level and structure of rates charged customers shall reflect prudent and efficient management of the franchise operation[.]

Importantly, the utility “has the burden of proving the proposed rate under consideration is just and reasonable.” Conn. Gen. Stat. § 16-22. This burden requirement implemented by the General Assembly in rate cases is significant because it attempts to remedy a critical challenge in setting rates — asymmetric access to information. The utility retains the majority of the relevant and critical information necessary for the Authority to make findings of fact and associated determinations on rates. Therefore, the Authority and other parties are at an information disadvantage compared to the utility and must rely on the utility’s application materials, the utility’s responses to interrogatories, and the utility’s witness testimony. The clarified burden under Conn. Gen. Stat. § 16-22 addresses this information imbalance by imposing an affirmative obligation on the utility to present sufficient evidence to support the proposed rate amendment.

In administrative proceedings, the appropriate standard of proof is the preponderance of the evidence. Jones v. Connecticut Med. Examining Bd., 309 Conn. 727, 734-735 (2013); Connecticut Light & Power Co. v. Connecticut Dept. of Pub. Util. Control, Docket No. CV094019951S, 2010 WL 797137, at *10 (Conn. Super. Ct. Feb. 5, 2010); Goldstar Med. Services, Inc. v. Dep’t of Soc. Services, 288 Conn. 790, 821 (2008). Consequently, to carry its statutory burden, the utility must provide (or ensure the record contains) a preponderance of evidence that the requested rates are “sufficient, but no more than sufficient” and “reflect prudent and efficient management.” See Tianti v. William Raveis Real Estate, Inc., 231 Conn. 690, 702, (1995) (finding that the preponderance of evidence standard is met when a fact is “more probable than not.”).

Notably, this burden requires the utility to provide more than mere declarations of fact. Connecticut Nat. Gas Corp. v. Pub. Utilities Comm’n, 29 Conn. Supp. 379, 394 (1971)(“[t]here is no sacrosanctity about the testimony of any company officer regardless of his position which gives such testimony any godlike fiat that must be accepted out of hand by the PUC.”). More to the point, “[b]ald statements need to be covered with some evidential hair” Id. Further, “[a]n administrative agency is not required to believe any witness, even an expert.” Goldstar, 288 Conn. at 830 (citations omitted). It is the Authority’s province to “make determinations of credibility, crediting some, all, or none of a given witness’ testimony.” Id.

III. TEST YEAR AND MULTI-YEAR RATE PLAN

A. TEST YEAR

The test year is required to “consist of the most recent twelve-month period available ending at a calendar quarter. The data presented in any statement concerning any test year shall be limited to the actual income and expenses as determined on the accrual basis during the subject period without adjustment or alteration.” Conn. Agencies Regs. § 16-1-54. Applicants are required to present financial data through the Authority’s Standard Filing Requirements. See Conn. Agencies Regs. § 16-1-53a.

Here, Aquarion has proposed the 12-month period ending on December 31, 2021, as the test year. Morrissey Pfiled Test., Aug. 29, 2022, p. 13. Based on its review of the financial data provided, the Authority accepts the period beginning on January 1, 2021, and ending on December 31, 2021, as the test year (Test Year).

B. MULTI-YEAR RATE PLAN

The Authority approves an amended rate schedule effective March 15, 2023, but declines to approve the three-year rate plan requested by the Company.¹⁹ Specifically, in addition to the initially requested \$27.5 million rate increase effective March 15, 2023, the Company requested that the Authority approve subsequent rate increases totaling \$13.6 million and \$8.8 million effective March 15, 2024, and March 15, 2025, respectively, “based on forecasted plant additions for [Rate Years 2 and 3], exclusive of WICA.” Morrissey PFT, p. 16.

The Company provides two rationales for a multi-year rate plan – neither of which are persuasive. First, the Company states that its “singular concern is the necessity of supporting the increasing capital requirements of the system.” *Id.* However, as the Company acknowledges, the General Assembly has already established the Water Infrastructure and Conservation Adjustment (WICA), which “provides an opportunity for recovery of a portion of capital investment in between rate cases.” *Id.*; Conn. Gen. Stat. § 16-262w. Specifically, under WICA, Aquarion is permitted to increase revenues to contemporaneously recover the costs of an expansive range of eligible capital projects. See Conn. Gen. Stat. § 16-262v(1) (defining “eligible projects”). This rate case resets Aquarion’s WICA to zero, allowing the Company to increase its annual revenues by up to 5% per year and up to 10% between rate case filings. Conn. Gen. Stat. § 16-262w(i). The Company did not provide any explanation as to why these prospective additional WICA revenues are insufficient to address the Company’s capital requirements.

Instead, the Company simply notes that the rate increases under WICA are capped at 10%. Morrissey PFT, pp. 17-18. However, the existence of a statutory cap on rate increases for capital expenditures between water rate cases is a strong indicator that the General Assembly disfavors substantial rate increases between regulatory reviews and

¹⁹ The Company proposed three rate years: March 15, 2023, through March 14, 2024 (Rate Year 1); March 15, 2024, through March 14, 2025 (Rate Year 2); and March 15, 2025, through March 14, 2026 (Rate Year 3). Morrissey PFT, p. 16.

weighs heavily against the Authority approving a rate plan that would essentially circumvent the statutory cap.

The Company also briefly notes that its proposed multi-year plan is similar to multi-year rate plans approved for Connecticut's electric and gas utilities. *Morrissey PFT*, p. 17. Even if true, the argument is a non sequitur. Water companies are not similarly situated because electric and gas utilities do not have a statutory mechanism equivalent to WICA that supports capital investments between rate cases. Consequently, there is no evidence to find that a multi-year rate plan is needed to support the Company's capital requirements.

Additionally, despite capital requirements being its "singular concern," the Company also posits that a multi-year rate plan provides rate stability for customers by "extend[ing] the time period between rate cases and mitigate[ing] the potential for more frequent rate cases." *Morrissey PFT*, p. 17. Importantly though, Aquarion was not previously on a multi-year rate plan, and its last rate case was nearly 10 years ago. See 2013 Decision. Consequently, there is no evidence in this record to support the argument that multi-year rate plans provide rate stability, or even that "more frequent rate cases" are necessarily to be avoided.²⁰

In summary, the Company did not meet its burden of demonstrating that its proposed multi-year rate plan comports with Conn. Gen. Stat. § 16-19e(a).

IV. RATE BASE

A. SUMMARY

Rate base is a fundamental principle of cost-of-service ratemaking. Rate base is comprised of the investor-supplied facilities and other investments necessary to supply utility service to consumers in a safe, reliable, and cost-effective manner. For purposes of ratemaking, rate base is the capital on which the investor is able to earn a return. Bluefield, 262 U.S. at 690 ("This is so well settled by numerous decisions of this court that citation of the cases is scarcely necessary: What the company is entitled to ask is a fair return upon the value of that which it employs for the public convenience.")(citations and internal quotation marks omitted); Pub. Serv. Co. of New Mexico v. Fed. Energy Regulatory Comm'n, 653 F.2d 681, 683 (D.C. Cir. 1981) ("As a general proposition, a regulated utility is allowed to recover . . . a reasonable return on capital invested in the enterprise and allocated to public use.").

Cost-of-service ratemaking provides a return on the capital that has been invested by shareholders and put to public use. This capital invested for public use is known as

²⁰ Indeed, in its March 16, 2022 Decision rejecting the Company's unsolicited attempt to further delay a rate case proceeding by resetting Aquarion's WICA surcharge, the Authority concluded that the deferral of a general rate proceeding based on the available record offered "limited benefits and material risks for ratepayers." Decision, March 16, 2022, Docket No. 13-02-20RE06, Application of Aquarion Water Company of Connecticut to Amend Its Rates – WICA Reset Settlement, p. 11 (2022 Decision).

rate base. Consequently, to determine an appropriate return on capital, the Authority must first establish Aquarion's rate base.

Rate base is determined by taking the test year net book value of prudent capital investments and accounting for other factors, including accumulated depreciation, working capital, and non-rate base capital such as deferred taxes. The Authority will then allow certain pro forma adjustments to recognize capital investments and other changes to rate base that occur subsequent to the test year. Connecticut Nat. Gas Corp., 29 Conn. Supp. at 390 (utilities are generally "permitted to adjust the test year forward for a reasonable period of time where definitely ascertainable expenses are involved during such future period . . .").

The purpose of the pro forma adjustments to rate base is to have rates that are reasonably reflective of the Company's actual rate base during the rate year, subject to the limitations of a prospective ratemaking process. Specifically, the adjustments are appropriate for "definite, ascertainable expenses maturing or certain to materialize [and such] expenses of course must not be based upon speculation or contingencies that are likely, but not certain, to occur . . ." Id. Consequently, in addition to being prudent, the pro forma adjustments must be "known and measurable" and supported by substantial evidence, with the burden resting on the utility to make such a showing. Id.; Connecticut Nat. Gas Corp. v. Dep't of Pub. Util. Control, 51 Conn. Supp. 307, 322 (2009) (noting that the agency applied the "known and measurable" standard to pro forma adjustments).

Here, the Company proposed a Test Year rate base of \$972,488,145 and pro forma adjustments, through December 15, 2022, of \$76,531,208, for a total rate base of \$1,049,019,354. Late Filed Ex. 1 Suppl. 2 (Dec. 19, 2022), Att. 1,²¹ Sch. B-1.0A. As shown in the table below and described in the following sections, the Authority modifies certain components of the proposed rate base, resulting in a reduction of \$57,349,471 in rate base for a total approved rate base of \$991,669,882.

²¹ Late Filed Exhibit 1, Suppl. 2 (Dec. 19, 2022), Att. 1, is hereinafter referred to as Final Late Filed Ex. 1 in the Decision.

Table 1: Pro Forma Rate Base (\$)

	Rate Base Component	Company Pro Forma (12/15/2022)	Authority modification	Approved Pro Forma Rate Base
1	Plant in Service	1,875,384,344	(48,060,300)	1,827,324,044
2	Accumulated Depreciation	(620,956,042)	(5,318,731)	(626,274,773)
3	Net in service (1-2)	1,254,428,302	(53,379,031)	1,201,049,271
4	Working capital allowance	13,665,003	(1,966,338)	11,698,665
5	Amortization on CIAC	33,154,785		33,154,785
6	Deferred Tank Painting	10,788,711		10,788,711
7	Deferred Sales Tax	8,475,603		8,475,603
8	Other deferred debits	216,206		216,206
9	CIAC	(140,611,418)		(140,611,418)
10	Customer advances, etc.	(43,225,369)		(43,225,369)
11	Deferred taxes (ADIT)	(87,872,470)	(1,092,000)	(88,964,470)
12	Capitalized Expenses		(912,102)	(912,102)
13	Rate Base Total	1,049,019,354	(57,349,471)	991,669,882

B. PLANT-IN-SERVICE**1. Test Year Plant-in-Service**

The Company has identified \$1,776,894,698 of plant-in-service at the end of the Test Year. Application, Sch. B-2.0A. To determine the test year plant-in-service, the amount of completed capital investments made by the Company through the end of the Test Year is added to the Company's previously approved utility plant. The additional plant includes both WICA and non-WICA investments. Notably, the Company seeks approximately \$600 million in new plant additions since its last rate case through the Test Year, one third of which was through the WICA program. Id. Table 2 summarizes the Company's purported plant-in-service through the Test Year.

Table 2: Company's Test Year Plant-in-Service Additions

Plant-in-service (Sept. 30, 2013) ²²	1,175,122,602
WICA Additions	202,312,780
Non-WICA Additions	399,459,316
Total Plant-in-Service	1,776,894,698

The plant-in-service includes five categories: (1) source of supply; (2) pumping; (3) water treatment; (4) transmission and distribution; and (5) general plant, as well as certain plant acquisition adjustments. Application, Sch. B-2.1A, B-3.1A, B-2.0A.

A water company may only include in rate base plant that which is in service and used and useful in providing water service. See Smyth v. Ames, 169 U.S. 466, 546 (1889), rev'd on other grounds; Hope, 320 U.S. at 605. ("We hold . . . that the basis of all calculation as to the reasonableness of rates to be charged by a [public utility] must be the fair value of the property being used by it for the convenience of the public."); Southern New England Telephone Co. v. Public Utilities Commission, 29 Conn. Super. 253, 259-260 (1970) (citation omitted) ("Generally speaking, property not employed in the public service should not be incorporated into the base to be used to compute the fair rate of return. It must be kept in mind, however, that whether utility property is used or useful for inclusion in the rate base is a factual determination rather than a legal question."); Decision, May 19, 2021, Docket No. 20-10-31, Application of the Jewett City Water Company to Amend Rate Schedules, pp. 23-24 ("The Authority does not allow for the inclusion of incomplete system additions or improvements into a Company's proforma rate base The Authority finds that the ratepayers benefit from the plant additions when they are in-service and that the ratepayers should not be responsible for providing a return on plant that is not in-service.").

In addition, and of equal import, the Company may only recover the cost of plant investments that were incurred prudently and reasonably. Conn. Gen. Stat. § 16-19e(a)(5) ("the level and structure of rates charged customers shall reflect prudent and efficient management of the franchise operation"). Specifically, "there exists a distinction between, on one hand, utility property and, on the other hand, the cost of utility property allowed in rate base, because only that portion of utility property that is the result of prudent and reasonable management is included in rate base." Connecticut Light & Power Co. v. Dep't of Pub. Util. Control, 219 Conn. 51, 67-68 (1991). With respect to timing, the prudence determination is typically the critical path because it requires a final accounting of and justification for the incurred costs, which can only occur after the project is completed and final invoices are paid.


Consequently, for the costs of plant investments to be included in rate base, the Company bears the burden of demonstrating that: (1) the plant is in service; and (2) the costs were prudently and reasonably incurred. To meet this burden, the Company must provide actual supporting evidence. Notably, "[t]here is no sacrosanctity about the testimony of any company officer regardless of his position which gives such testimony

²² 2013 Decision, pp. 20, 37.

any godlike fiat that must be accepted out of hand by the PUC.” Connecticut Nat. Gas Corp., 29 Conn. Supp. at 394 (“Bald statements need to be covered with some evidential hair . . .”).

Since the Company’s 2013 Rate Case, it has made approximately \$800 million in plant additions through August 31, 2022. Lawrence Prefiled Test., Aug. 29, 2022, p. 28; RRU-127, Att. 1, Summary; Aquarion Interrog. Resp. OCC-6.²³ This is an astounding level of plant investment, averaging almost \$100 million per year. Notably, the pace of investment has risen substantially in the last few years, averaging more than \$116 million per year since 2018. The figure below illustrates the significant and increasing levels of annual plant addition since 2013.

Figure 1: Annual Capital Additions (\$) by Year

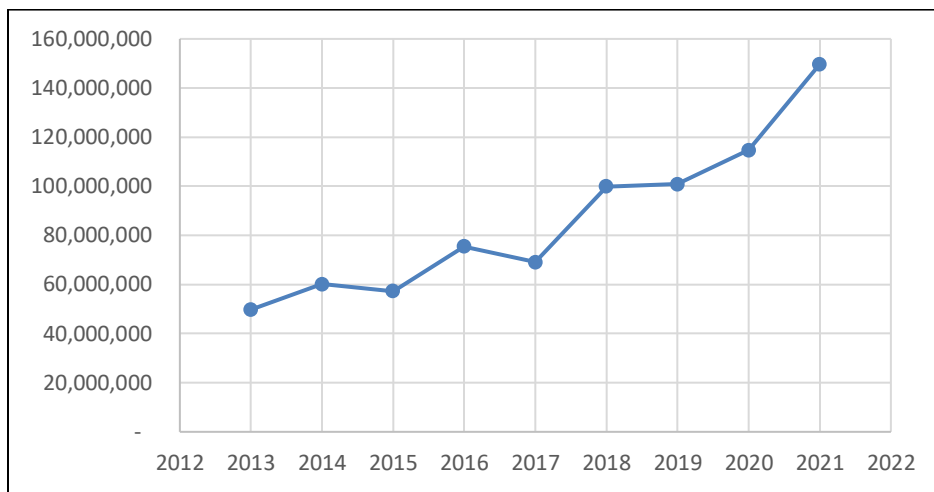

Aquarion Interrog. Resp. RRU-127, Att. 1, Summary.²⁴

Notably, this level of investment substantially exceeds the amount projected by the Company in the 2013 Rate Case. Specifically, at that time, the Authority expressed concern about the Company spending \$287 million as part of its five-year capital plan covering 2013-2017. 2013 Decision, p. 24. In fact, the Authority cautioned the Company that annual capital improvement spending from 2011-2013 had already increased by almost 50% from the \$40 million in annual investment for 2008-2010. *Id.*, pp. 20-21. Nonetheless, despite the Authority’s determination that the Company “should be scaling back,” the Company exceeded even its own projections, spending \$312 million (\$57

²³ In the 2013 Rate Case, the Authority approved a pro forma (through September 30, 2013) utility plant-in-service of \$1,175,122,602. 2013 Decision, p. 37. The Company states that its December 31, 2021 Test Year plant-in-service is \$1,776,894,698, for a difference of about \$600 million. Final Late Filed Ex. 1, Sch. B-2.0A. However, the Company testified that it had completed \$763 million as of March 31, 2022, and approximately \$800 million as of August 31, 2022. Lawrence PFT, p. 28.

²⁴ The annual addition of \$50 million for 2013 is extrapolated based on \$12.4 million for 4Q 2013.

ably additions have ballooned to \$116 million per year on average. *Id.*²⁵ Although capital additions are within the Company's discretion, the rapid and substantial increases in spending, together with the Authority's prior admonitions, would normally signal to a utility that the prudence of such additions would be particularly scrutinized and, thus, would need to be adequately supported by record evidence and balanced against the parameters of Conn. Gen. Stat. § 16-19e(a).

The question before the Authority then is whether the Company has provided sufficient evidence in the record to satisfy its burden of demonstrating that the hundreds of millions of dollars of investments made through the end of the Test Year are in-service and that the costs were prudently and reasonably incurred. To put this in context, it is helpful to consider what level of documentation might be expected if a government agency were to expend, or to authorize the expenditure of, close to a billion (with a "b") dollars. With that in mind, the Authority turns to the evidence in the record.

To support its capital additions through the Test Year, the Company relies primarily on evidence located in two places: (1) the prefiled testimony of Daniel Lawrence, Exhibit A-3-DRL-1, and (2) the Company's response to Interrogatory RRU-127 as supplemented by Late Filed Exhibit 4. *See* Aquarion Brief, pp. 37-45. Mr. Lawrence's prefiled testimony includes 15 pages related to "Infrastructure Improvement and Pro Forma Plant Additions." Lawrence PFT, pp. 28-42. The testimony includes Table DRL-5, which identifies groups of "Major Additions to Utility Plant" through August 31, 2022, totaling \$531.8 million. *Id.*, p. 30. This amount is comprised of 18 relatively discreet projects totaling approximately \$138.8 million (Items B, C, D, E, F G, H, I, M, N, O, P, Q, R, S, T, U and V) and five general categories of additions totaling \$393 million (Items A, J, K, L, and W).

For each of the discrete projects, the Company provides 2-3 sentences generally explaining the completed additions and providing a cursory rationale for why the projects were undertaken. *See, e.g.*, Lawrence PFT, p. 33 (\$8.9 million "to increase the capacity of the raw water main"), p. 36 (\$4.3 million to "optimize the performance of . . . filter units"), and p. 37, (\$3 million "to replace an inadequate facility"). However, the testimony does not, for any of the discrete projects, specifically address why the chosen investment was the best option or why the incurred costs were prudent and reasonable. A review of the transcript from Mr. Lawrence's cross examination reveals limited details supporting a prudence finding as to the \$138.8 million spent on these 18 projects. *See, e.g.*, Tr., Nov. 22, 2022, 93:7-10 ("If you want the actual projects that go with that, I would need to give you a Late-File that actually explains what exactly was going on in each year, but it's varying.").

For the five general categories representing \$393 million in plant additions, the prefiled testimony provides a similar paucity of detail despite the significantly larger expenditures. Lawrence PFT, pp. 31, 34-35, 39. The discussion for the \$233 million in water main costs (Item A) consists of four sentences, none of which address specific projects or prudence of the costs. *Id.*, p. 31. The Company notes that \$149.8 million of

²⁵ Notably, the sharp increase in capital additions is coincident with Eversource Energy's 2017 acquisition of Aquarion.

the \$233 million in water main projects was completed under the WICA program, *Id.*; however, the Authority does not make prudence determinations on WICA projects until the subsequent rate case.²⁶ Consequently, a project's eligibility as a WICA project is not evidence of prudence. Similarly, the explanation for \$49.9 million to replace "aged and leaking service lines, inoperable valves, and obsolete fire hydrants" also spans four sentences, none of which apportion the costs between those activities or address the prudence of the expenditures. *Id.*, p. 34. The hearing testimony also adds little, if any, evidence as to the prudence of these investments. Tr., Nov. 22, 2022, 72:9-14 ("[the meter replacement program is] going to be about 3 and a half million dollars. So things like that we don't need to devote a lot of time on in the project management process. Similarly, in terms of valves, hydrants and the like, they would follow that type of an approach.").

Notably, the word "prudent" does not appear anywhere in Mr. Lawrence's prefiled testimony. Further, the prefiled testimony is completely silent on approximately \$268.2 million in additions. Mr. Lawrence stated that \$800 million in additions were made through August 31, 2022; however, Table DRL-5 and the related testimony covers only \$531.8 million. The remaining \$268.2 million does not appear to be addressed elsewhere in the prefiled testimony.

The Company also cites to the Company's response to Interrogatory RRU-127, which was ostensibly supplemented by Late Filed Exhibit 4. The Company did not, either in the Application or prefiled testimony, provide an itemized list of projects it seeks to add to the Test Year rate base. Needless to say, the identification of the projects for which a utility seeks recovery is a bare prerequisite for any prudence review and determination. Consequently, the Authority requested such a schedule of capital improvements since 2013 through the 2021 Test Year. Interrog. RRU-127. In this request, the Authority required the Company to provide "the types of construction, the quantities, the actual and estimated costs" and a discussion of "the results of those improvements." *Id.* In response, the Company provided only a list of projects and associated costs but did not offer other information responsive to the interrogatory. Aquarion Interrog. Resp. RRU-127, Att. 1. The Company's Late Filed Exhibit 4 supplemented the RRU-127 Attachment 1 with "the list of projects 100% complete and closed to plant in 2022 through November totaling \$94,897,843." Late Filed Ex. 4, Suppl. Att. 1 (Dec. 19, 2022).²⁷ Neither the response to RRU-127 nor Late Filed Exhibit 4 provide direct evidence in support of a determination that the investments, either individually or in aggregate, were prudent.

Notably, the Company offered evidence that it has a process for identifying and prioritizing capital investments. Lawrence PFT, pp. 3-16. Specifically, the Company

²⁶ In a WICA proceeding, the Authority's determination is limited to WICA-eligibility only and is not a prudence finding regarding the final cost to complete each project. See Decision, April 30, 2008, Docket No. 07-09-09, DPUC Review and Investigation of the Requirements for Implementation of a Water Infrastructure and Conservation Adjustment, p. 5. The Authority makes a finding regarding the prudence of any project costs at the time of a rate proceeding. *Id.*

²⁷ Late Filed Exhibit 4, Suppl. Att. 1 (Dec. 19, 2022), is hereinafter referred to as Final Late Filed Ex. 4 in the Decision.

“follows a four-stage process to ensure the Company’s capital project objectives are met.” Id., p. 4.²⁸ In particular, during the planning stage, “each capital project goes through an alternatives analysis to identify the project alternative that meets the project objectives most cost effectively.” Id. At the design stage, the project is sent out to bid and awarded to the lowest cost qualified contractor.” Id., p. 5. Finally, the Company will “track progress against agreed upon budgets and schedules, and update and revise as appropriate” during the project delivery stage. Id. A Project Management Committee (PMC) oversees this process and provides a “quality control step to review proposed projects, costs, technical merit and benefits to the customer” Id., p. 4.

From this testimony, it can be inferred that a significant portion of capital projects will have documentation supporting, among other things, the project selection, budgeted costs, alternatives analysis, and customer benefits. All of the aforementioned materials would be relevant to a prudency review, and all would be within the Company’s exclusive control; however, no such documents were provided by the Company during this proceeding. Consequently, the Company is asking the Authority to obligate ratepayers for almost a billion dollars of expenditures on a mere wisp of “evidential hair” covering “bald statements” of Company executives. Connecticut Nat. Gas Corp., 29 Conn. Supp. at 394.²⁹

Neither OCC, DEEP, nor OAG took a specific position on the prudency of the approximately \$600 million in additional test year plant-in-service. As a result, the Authority will allow the Company a Test Year plant-in-service of \$1,776,894,698.

Prudency determinations on a utility’s capital investments are an essential check on a utility’s monopoly position. The burden is on the utility to demonstrate prudency; therefore, the utility must provide sufficient evidence. This task is complicated where, as here, the amount of annual investment is substantial, and the period of investment is extended.

2. Pro Forma Plant Additions

The Company has continued to make capital plant investments subsequent to the end of the 2021 Test Year. In recognition of these continued investments, the Authority permits utilities to make pro forma adjustments to the test year plant-in-service for a reasonable period of time for “definite, ascertainable expenses maturing or certain to materialize.” Connecticut Nat. Gas Corp., 29 Conn. Supp. at 390. The Authority applies the same standard of review to pro forma plant adjustments as it does for test year plant-in-service. In other words, the Company must demonstrate that: (1) the plant is in service; and (2) the costs were prudently incurred. The pro forma adjustments must also be

²⁸ All capital projects, with the exception of programmatic work and budgeted projects less than \$100,000, are subject to the four-stage process. Id.

²⁹ The Company criticized the Proposed Final Decision for “threaten[ing] the financial integrity of Aquarion.” Aquarion Exceptions, p. 4. However, it is Aquarion’s decision to support over \$600 million of capital investment with the evidence cited that exposes the Company to significant risk on administrative appeal.

“known and measurable” and supported by substantial evidence, with the burden resting on the utility to make such a showing. Id.

The Company initially identified a net \$47,851,486 of pro forma plant additions and retirements as of the August 31, 2022 Application date. Application, Sch. B-2.2A. During the proceeding, the Company identified \$75,015,929 in plant additions as of September 30, 2022, and projected an additional \$54,092,201 in the fourth quarter of 2022. Aquarion Interrog. Resp. RRU-132. The total actual and projected additions for 2022 was \$128,108,130. Id. On December 14, 2022, the Company submitted a supplemental late filed exhibit identifying approximately \$88 million in pro forma plant addition activity as of November 30, 2022. Late Filed Ex. 1, Suppl. Att. 1 (Dec. 14, 2022), Sch. B-2.2A; Late Filed Ex. 4, Suppl. Att. 1 (Dec. 14, 2022). Several days later, on December 19, 2022, the Company submitted another supplemental exhibit identifying approximately \$99 million in pro forma plant additions as of December 15, 2022. Final Late Filed Ex. 1, Sch. B-2.2A. In addition to these plant additions and retirements, the total plant-in-service adjustment is affected by “Utility Plant Acquisition Adjustments.” Application, Sch. B-2.0A, and Final Late Filed Ex. 1, Sch. B-2.0A. The Company’s proposed pro forma adjustments are summarized below.

Table 3: Proposed Plant-in-Service Pro Forma Adjustments (\$)

	As of 08/31/2022	As of 12/15/2022
Plant Additions	60,898,937	109,105,585
Retirements	(13,047,451)	(9,867,393)
Subtotal	47,851,486	99,238,192
Acquisition Adj.	(551,216)	(748,546)
Total Adjustment	47,300,270	98,489,646

In the Application, the Company submitted a request for plant additions between the end of the Test Year (i.e., December 31, 2021) and August 31, 2022. Presumably, these pro forma additions are covered by the same limited evidential hair as the plant additions through the Test Year (i.e., Lawrence prefiled testimony and Aquarion Interrog. Resp. RRU-127). Consequently, the record contains some, albeit limited, evidence in support of the prudence and usefulness of these plant additions.

However, the evidence to support the inclusion of capital additions completed subsequent to August 31, 2022, is deficient. The Company did not offer any pre-filed testimony with respect to these additions. Instead, the Company cites to an interrogatory response (RRU-132), Final Late Filed Exhibit 4, Attachment 1, and hearing testimony. Aquarion Exceptions, p. 25.

In the response to Interrogatory RRU-132, the Company provides a table of year-to-date (i.e., September 30, 2022) actual and fourth quarter projected plant additions. Id. The table disaggregates the \$128,108,130 into 15 groups (e.g., main replacement, blowoffs, asset purchase, etc.) and provides a summary table of \$34.5 million in

investments greater than \$1 million. Id. The response also includes two Excel file attachments that provide various accounting details (e.g., group code, asset number, cap. date, town, transaction type, etc.).

Final Late Filed Exhibit 4, Attachment 1 provides similar information with respect to \$98,897,843 in plant additions from January 1, 2022, through November 30, 2022. The spreadsheets identify a variety of accounting information, including categories, asset numbers, divisions, locations, etc. Id. The Company notes that the “detail” sheet includes “a brief description of the project,” which consists primarily of the location of the project along with a one-word descriptor such as “improvements”, “settlers”, “chlorination”. Id.

Lastly, the Company refers to the transcript of the cross examination of Company witnesses Mr. Lawrence and Ms. Szabo by Authority staff (Ms. Szul) from the December 14, 2022 Late Filed Exhibit Hearing. Aquarion Exceptions, p. 25. The transcript indicates that Authority staff struggled to understand the Company’s filings. Tr., Dec. 14, 2022, 11:18-20:23 (“it took me some time to find out where this number, almost \$10 million, come from. So would you be able to clarify this attachment with exact numbers for accounts 340?”; “So this project cost almost \$2.6 million. What was spent on this project?”; “the project service replacement in Fairfield, 1 inch cost twenty-three thousand five hundred dollars. Would you be able to explain why the service line replacement is so expensive?”).

Notably, the Company highlights the quantity of data provided to the Authority. Aquarion Exceptions, pp. 25-26 (“One-hundred and four pages”, “5,869 lines of data”, “11 pages of oral testimony”). Based on the sheer volume of data, the Company concludes that the Authority cannot “simply reject the evidence” Id., p. 26.

The Company confuses quantity of evidence with quality and relevance of evidence. The Company has provided large volumes of data to support a finding that it has spent millions of dollars on capital improvements. Specifically, the Company provided hundreds of pages of spreadsheets containing detailed accounting information for each expenditure, including the division, class, asset number, project ID, WBS element, and transaction number. The Company also provided a variety of permutations of this data — as of September 30, 2022, as of November 30, 2022, and as of December 15, 2022. There appears to be little dispute that the Company spent over \$99 million on capital plant in 2022.

However, to be included as a pro forma adjustment to rate base, a finding that the expenditures were made is simply not enough. Instead, the Authority must find that the expenditures were prudent and that the plant is used and useful. Here, the Authority is not rejecting any evidence, as the Company asserts; rather the Authority is searching for evidence that will support a finding on the prudence and usefulness of the purported capital improvements.

But none of the evidence cited by the Company is relevant to the prudence of the expenditures or usefulness of those plant additions. Nowhere in the transcript does a

Company witness describe the plant additions as prudent or useful. None of the evidence explains why the expenditures were made, which options were considered, how the costs were managed, or any of the other factors that would allow the Authority to assess the “good faith and reasonableness” of the management decisions related to the expenditures. Connecticut Light & Power Co., 216 Conn. at 645.³⁰

By failing to submit material evidence as to the prudence of capital additions occurring between September 1, 2022, and December 15, 2022, the Company has failed to meet its burden demonstrating that these capital costs satisfy the standard for a pro forma adjustment to rate base. Indeed, there is simply *no* evidence (not even a bald statement) on which the Authority could make a prudence determination for these proposed pro forma adjustments. The Company offers that “no party or intervenor offered any testimony that rebutted or undermined this unrefuted evidence.” Aquarion Exceptions, p. 38. Even if true, this assertion improperly seeks to shift the burden where the legislature has definitively concluded that it is the utility that has the burden to prove with substantial evidence that an expenditure was prudent.³¹

Consequently, the Authority will only allow a pro forma adjustment to plant-in-service for plant additions through August 31, 2022. To determine the amount of plant addition, the Authority filtered the data provided by the Company in Final Late Filed Ex. 4, Supplemental Attachment 2 for all projects noted as being completed (“Cap.date”) between January 1, 2022, and August 31, 2022. Applying this filter, the Authority identified 673 projects constituting \$52,315,630 of additions and \$1,137,738 of retirements, for a total plant addition of \$51,177,892. To verify this number, the Authority applied the same date filter to the list of projects contained in Final Late Filed Ex. 4, Supplemental Attachment 1. This process identified total plant additions of \$51,708,342 for the same period; however, this data did not separately identify additions and retirements. Consequently, the Authority finds the \$51,177,892 calculation to be more reliable.³² The allowed pro forma plant additions are shown in the table below.

³⁰ Citing to 2013 and 2022 rate cases, the Company asserts that the Authority has created a “new, heightened evidentiary burden of proof.” Aquarion Exceptions, p. 28. However, neither the legal standard nor the evidentiary burden has changed — the Company must provide substantial evidence that the plant additions were prudent and are used and useful. Given that the Authority allowed \$600 million of Test Year plant additions on a wisp of evidentiary hair, one could (and did) argue that the evidentiary burden has, instead, been lowered. See Smart Water Westport Exceptions, pp. 3-6. That the Authority may have found sufficient evidence as to prudence and usefulness in prior rate proceedings on different facts does not indicate a change in the Company’s evidentiary burden here.

³¹ The absence of evidence also makes a determination on the second prong of the rate base test (i.e., in-service, used and useful) impossible.

³² The Company asserts that the Authority miscalculated the pro forma plant-in-service amount. Aquarion Exceptions, pp. 8-9. However, the new table attached to its written exceptions purporting to correct the miscalculation includes projects completed prior to January 1, 2022, including many projects with a “Cap.date” in years 2016, 2017, and 2018. These projects were completed prior to or during the Test Year and are not pro forma additions. As such, the Company’s tabulation of \$57,101,366 for pro forma plant-in-service appears to erroneously include projects that should be excluded. Therefore, in addition to being filed after the close of the evidentiary record, the Authority finds this data to be unreliable. In light of the Company’s failure to otherwise provide an accurate tabulation of capital investments through August 31, 2022, the Authority finds the sorting of data provided by the Company in Final Late Filed Exhibit 4 to be the most reliable method for determining pro forma additions through August 31, 2022.

Table 4: Pro Forma Plant-in-Service Adjustment (\$)

	Company Proposed (12/15/2022)	Authority Allowed (8/31/2022)	Authority Modification
Plant Additions	109,105,585	52,315,630	56,789,955
Retirements	(9,867,393)	(1,137,738)	8,729,655
Subtotal	99,238,192	51,177,892	(48,060,300)

Separate from the Authority's determination above, the Authority is concerned about the use of late filed exhibits as a vehicle for proposing substantial changes to the Application.³³ Here, the Company initially included \$48 million in pro forma plant additions through August 31, 2022. Application, Sch. B-2.2A. During the proceeding, the Company provided year-to-date plant additions as of September 30, 2022, as well as projections for the remainder of 2022; however, the interrogatory response did not indicate a change to the Company's proposed pro forma plant additions. Aquarion Interrog. Resp. RRU-132.

Then, less than two days before the late filed exhibit evidentiary hearings, the Company increased its proposed pro forma plant additions from \$48 million through August 31, 2022, to \$109 million through December 15, 2022. Late Filed Ex. 1, Suppl. Att. 1 (Dec. 14, 2022), Sch. B-2.2A; Late Filed Ex. 4, Suppl. Att. 1 (Dec. 14, 2022).³⁴ At the Late Filed Exhibit Hearing, the Company acknowledged this \$61 million change to its Application. Tr., Dec. 14, 2022, 29:18-23 (Ms. Szabo: "the application, which was a pro forma as of August, included estimates for projects being completed from the test year through August of 2022; and the [Late Filed Exhibit] supplemental update is for actual projects completed as of November 30, 2022, plus 100 percent complete through December 15th."). Further, the Company's witnesses were unable to provide responses with respect to five categories of data, requiring the Company to file additional supplemental information after hearings concluded. Aquarion Exceptions, p. 36.

By modifying the requested pro forma plant additions in its Application by \$61 million immediately prior to the last evidentiary hearings, the Company deprived the Authority, other parties, and intervenors of a meaningful opportunity to review and challenge the information and the proposed changes to the Application. Therefore, although the Authority is not excluding Final Late Filed Exhibits 1 and 4, in future proceedings, substantial changes to an application and any supporting evidence should be presented prior to the close of the discovery period and normal evidentiary hearings.

³³ For purposes of administrative efficiency, late filed exhibits are generally reserved for clarifying or correcting evidence previously introduced or addressed in pre-filed testimony or cross-examination. As such, the procedural schedules typically provide very limited durations for submitting and reviewing such exhibits. Using late filed exhibits to introduce significant new evidence is contrary to this administrative process.

³⁴ The Company filed Late Filed Exhibit 1 on December 12, 2022, but the file was not accessible. The Company refiled on December 14, 2022.

In addition, during the proceeding, a debate arose as to which pro forma capital additions should be eligible for inclusion in rate base. In this case, the sheer dearth of evidence with respect to capital additions alleged to be prudent and complete after the August 31, 2022 Application date, regardless of eligibility, renders the debate superfluous. However, for regulatory predictability in future rate cases, the Authority is compelled to address the issue.³⁵

Citing the Authority's July 28, 2021 decision in the most recent rate case for a water utility, the Company took the position that eligibility should extend to projects that are 75% complete on the last day of evidentiary hearings (*i.e.*, December 15, 2022). Aquarion Brief, p. 36. Conversely, citing to six prior rate cases, including a decision issued May 29, 2021, OCC argued that capital projects should be 100% complete by the last evidentiary hearing to be eligible. OCC Brief, pp. 26-27.

As noted at the outset of this section, the legal standard is clear — capital additions can only be added to rate base upon a determination by the Authority that the project is in service and that the costs incurred are prudent. The issue then is not only when and to what extent a project is complete; rather, the issue is at what point can the Authority review the evidence presented by the utility and other parties and reasonably make the requisite findings. Using a specific percentage complete as of the end of evidentiary hearings has been, at best, an imperfect proxy; however, such proxies cannot circumvent the applicable legal standard for pro forma adjustments, nor relieve the utility of its statutorily defined burden to provide substantial evidence on the issues of prudence and usefulness.

As this proceeding has demonstrated, a rate case requires the Authority to assess and make prudence findings on hundreds of millions of dollars in capital expenditures. For water utilities, the Authority has less than 200 days to issue a decision in a rate case. Accounting for the various administrative and procedural steps (*e.g.*, a proposed final decision is typically issued a month in advance of the final decision), the Authority is left with a narrow window within which to review and process massive volumes of documentation, conduct hearings, and make prudence determinations. In addition, the relevant evidence needed for a prudence determination (*i.e.*, final invoices and costs) is not typically available for several weeks or months after a project is placed in service.

Consequently, with respect to future water utility rate cases, the Authority finds that pro forma adjustments for plant-in-service should generally be limited to plant that is or will be placed in service as of the date of the rate amendment application – a date that is notably within a utility's sole discretion. The utility will be able to supplement the record for such completed projects through the proceeding as the financial and accounting information becomes available. This will provide the Authority with sufficient time to review and conduct sufficient inquiry into both test year and pro forma plant-in-service

³⁵ The Company asserts that the Authority is making a Post Hoc change; however, the Authority is simply providing guidance on how it intends to apply the relevant legal standard in the future. Aquarion Exceptions, pp. 30-31. As noted herein, the application of this guidance to the instant proceeding is superfluous as the Company did not satisfy its evidentiary burden for the expenditures in question.

additions. Exceptions may be warranted in certain circumstances (e.g., a major capital investment is placed in service shortly after the application filing date); however, utilities will still bear the burden of providing sufficient, reliable evidence for the Authority to determine that a project is both in-service and that the costs incurred were prudent.

3. IT Projects

The Company appears to have violated its procurement practices when choosing its suppliers and vendors for information technology (IT) investments. Specifically, six IT projects were subject to the Company's four-stage capital project approval process but were not competitively bid. Aquarion Interrog. Resp. RRU-165; Lawrence PFT, p. 4.³⁶ The Company's explanations for why these projects were not competitively bid generally focused on the Company choosing an existing vendor or using a "small group" of consultants rather than seeking out an alternative vendor through competitive bidding. Interrog. Resp. RRU-165 and RRU-376. This practice is not representative of a competitive bid and raises significant questions as to the prudence of the Company's IT expenditures. In this case, the projects were not in-service as of August 31, 2022, and were disallowed as a pro forma adjustment due to the lack of evidence supporting a prudence determination. However, to the extent the Company seeks recovery for these investment in the future, it will need to reconcile deviations from its procurement protocols.

C. ACCUMULATED DEPRECIATION

The Company originally filed a pro forma adjustment to its depreciation reserve of \$15,089,370, for a total reserve for accumulated depreciation of \$605,276,245. Application, Sch. B-1.0A. Subsequently, the Company increased its pro forma depreciation reserve adjustment to \$30,769,168, for a total reserve for accumulated depreciation of \$620,956,042. Final Late Filed Ex. 1, Sch. B-1.0A.

The Authority will make several adjustments to the Company's accumulated depreciation. The first adjustment is to account for pro forma additions and the disallowance of plant additions made after August 31, 2022, as explained in Section IV.B.2. Pro Forma Plant Additions. Second, the accumulated depreciation will include \$577,287 to account for increasing the amortization period of the unrecovered reserve from the proposed five years to ten years. Finally, the Authority has also incorporated the \$4,266,128 in depreciation expense as discussed in Section VI.C. Depreciation Expense. The result is an increase in reserve for accumulated depreciation of \$5,318,731. The table below summarizes the adjustments.

³⁶ The six projects are: (1) Customer Portal; (2) Human Capital Management; (3) Project Portfolio Management; (4) supervisory control and data acquisition (SCADA); (5) S4 HANA Assessment; and (6) Meter Reading Software Upgrade. Aquarion Interrog. Resp. RRU-165; Lawrence PFT, p. 4.

Table 5: Adjusted Reserve for Accumulated Depreciation (\$)

(A)	Reserve for Acc Dep. 12/31/21 Final Late Filed Ex. 1, Sch. B-3.1A	586,389,124
(B1)	Annual Dep. Expense Application, Sch. B-3.1A	40,186,159
(B2)	Amortization of general plant reserve	577,287
(C)	Balance prior to dep. on additions and reduction for Retirements $C=A+B1+B2$	627,152,569
(D)	Pro Forma Additions Final Late Filed Ex. 4	52,315,630
(E)	Depreciation For Additions Final Late Filed Ex. 4, Supp. Attach. 2	748,648
(F)	Retirements as of 8/31/2022 Final Late Filed Ex. 4, Supp. Attach. 2	(1,137,738)
(G)	Reserve for Acc Dep. $G=C+E-F$	626,763,479
(H)	Less: Dep adjustment Section IV.C.	(4,286,456)
(I)	Plus: SWRP Amort. Sch B-3.0A	3,797,750
(J)	Total Accumulated Depreciation Reserve $J=G+H+I$	626,274,773
(K)	Company Proposed	620,956,042
(L)	Adjustment $L=J-K$	5,318,731

In its written exceptions, the Company claims that, because the Authority excluded pro forma plant additions after August 31, 2022, the Authority should only account for accumulated depreciation of rate base up to the same date “to be internally consistent.” Aquarion Exceptions, pp. 9-12. However, this argument arbitrarily conflates pro forma plant additions, which the Company must demonstrate are prudent and useful, and accumulated depreciation, which is a known and measurable quantity.

The Authority’s disallowance of new plant additions for the September through December 2022 period was solely a result of the Company’s failure to satisfy its evidentiary burden with respect to plant additions after August 31, 2022, as noted in Section IV.B.2. Pro Forma Plant Additions. Consequently, the August 31, 2022 date has no specific accounting relevance except that the Company provided no material evidence regarding prudence of plant additions made after that date. The Company’s evidentiary failure does not suspend the depreciation of rate base, which continued through the entirety of 2022 in a known and measurable manner. Consequently, the Authority finds it reasonable to account for depreciation of Test Year and pro forma plant-in-service through December 31, 2022.³⁷

³⁷ The Company’s objection raises the issue of whether the Authority should account for the known and measurable accumulated depreciation up to the beginning of the Rate Year (March 15, 2023). Presently, the Company is recovering depreciation expense in current rates through March 15, 2023;

D. DEFERRED INCOME TAX

The Company proposed a pro forma accumulated deferred income tax (ADIT) of \$87,872,470, including a pro forma decrease of \$1,092,000 from the test-year ADIT of \$88,964,470. As discussed in Section VI.E.4., the Authority rejects the Company's proposed annual amortization of \$2,804,852 for excess accumulated deferred income tax (EADIT). There is no rate base adjustment required for this reversal as the Company has not reflected amortization of the ADIT in its request. Concerning the \$1,092,000 pro forma decrease of ADIT, the Authority disallows this adjustment pending the outcome of the independent audit ordered in Section VI.E.4. Consequently, the approved pro forma ADIT is \$88,964,470.

E. WORKING CAPITAL

Working capital is included in rate base and is a calculation of funds that the Company must provide to fund daily operations due to the timing difference between the payment of expenses and the receipt of payments from customers. The Company performed a lead/lag study as part of its application, which detailed the lead/lag period of expense and revenues and included a working capital allowance of \$13,319,003. Application, Sch. B-4.0A. Subsequently the Company adjusted its working capital allowance to \$13,665,003. Final Late Filed Ex. 1.

However, the Authority is disallowing approximately \$10.7 million in operating expenses (see Section VI.B. Operations and Maintenance Expenses), which results in a lower working capital requirement. The Authority recalculated the working capital using the original lead/lag study, subject to the removal of the cost of chemicals.³⁸ Application, Sch. H-1.1. Consequently, the Authority will further reduce the required working capital by \$1,966,338, for a total working capital allowance of \$11,698,665.

F. CAPITALIZED EXPENSES

The Company's rate base includes the capitalization of a portion of its expense accounts. Specifically, the Company applies a 76.8% expense / 23.20% capitalization ratio to its expense accounts. Application, Sch. C-3.2. The Authority's disallowance of certain expenses as determined in Section VI.B. Operations and Maintenance Expenses also requires a concomitant reduction of the capitalized portion of such expenses. The table below identifies the capitalized portion of certain disallowed expenses and the total modification to rate base.

however, accumulated depreciation for the Rate Year is accounted for only through December 31, 2023. Consequently, the Company is benefitting from depreciation expenses during a period in which depreciation is not accumulated. The Authority may re-examine this issue in a future proceeding.

³⁸ As discussed in Section VI.B.6.b. Chemicals, the Company included chemical expenses in both its cash working capital calculation and in rate base inventory, leading to a double recovery of the expense. OCC Brief, p. 27. The Company similarly included chemicals in both working capital and rate base in a previous rate proceeding; see Decision (2010 Decision), Sept. 8, 2010, Docket No. 10-02-13, Application of Aquarion Water Company of Connecticut for Amended Water Service Rate Schedules. The Authority's predecessor, the DPUC, determined a cash working capital amount by removing chemicals from the lead/lag calculation. 2010 Decision, p. 25.

Table 6: Disallowed Capitalized Portions of Expenses (\$)

Expenses	Capitalized Amount
Payroll	285,129
Employee Incentive Comp	515,573
Employee Benefits	48,139
Payroll Taxes	63,261
Total	912,102

G. FIVE-YEAR CAPITAL PLAN

The Company provided a Five-Year Capital Improvement Program (Five-Year Capital Program) for projected construction and maintenance projects. Application, Sch. F-7.0. The following table summarizes the Five-Year Capital Program:

Table 7: Five-Year Capital Improvement Program Summary

FIVE-YEAR CAPITAL BUDGET SPEND (\$ millions)						
Description	2022	2023	2024	2025	2026	Total
Mains	51.2	58.4	59.1	62.6	63.9	295.2
Dams	1.3	3.8	8.6	7.4	8.8	29.9
Trans. & Dist.	10.8	17.7	19.1	22.3	20.5	90.4
IT	6.6	9.6	8.1	5.1	4.7	34.1
Meters	4.6	3.6	3.7	3.7	3.6	19.2
Source of Supply	5.1	5.3	2.5	3.3	2.0	18.2
Treatment	31.8	18.3	24.2	25.7	39.3	139.3
Pumping	11.8	13.3	14.2	8.9	7.6	55.8
SWFC Supply Imp.	14.3	28.6	35.4	39.6	31.6	149.5
Housatonic WTP	0.3	1.2	1.2	6.0	18.0	26.7
General Plant	5.4	4.4	3.6	3.5	3.4	20.3
Total	143.2	164.2	179.7	188.1	203.4	878.6

Lawrence PFT, pp. 43-44.

Within the five-year planning period, the most significant facility upgrades for the Company will occur in the Pipeline Rehabilitation Program (Mains), Dams, Transmission and Distribution, Treatment, Pumping, and Southwest Fairfield County Supply Improvements categories.

Mains (\$295.2M) - Most of this investment is for WICA-eligible water main replacement work.

Dams (\$29.9M) - This work includes alternative analysis, design, and/or execution on up to 10 dam projects.

Transmission and Distribution (\$90.4M) - The major capital investments in this category are Traps Falls Storage Tank, Mansfield HS Tank Replacement, Pine Street

Tank Replacement, Nichols Tank Replacement, Fairchild Wheeler Tank Replacement, Lead Service Line Replacement, and Service Line Inventory.

Treatment (\$139.3M) – This category is for treatment improvements due to the increasing age of Aquarion’s facilities, increasingly stringent water quality requirements, and regulations.


Pumping (\$55.8M) – These investments would pertain to alternative analysis, design, and execution of pumping facilities.

SWFC Supply Improvements (\$149.5M) – These investments are designed to increase the transfer capacity of the Southwest Regional Pipeline (SWRP) from the Company’s Bridgeport Water System to the Southwest Fairfield County Water System to meet water supply demands, improve drought resiliency, and meet the Stream Flow Regulations that go into effect in 2029. Lawrence PFT, pp. 44-48.

Additionally, the Company has identified the following water systems where, in the next five years, increased storage is needed: Nichols Tank in the Greater Bridgeport water system; Pine Street Tank in the Greater Bridgeport water system; Fairchild Wheeler Tank in the Greater Bridgeport System; Mianus Low Service Tank in the Greenwich System; and Greenfield Hill Tank in the Greater Bridgeport System. Aquarion Interrog. Resp. RRU-143.

In summary, between 2022-2026, the Company plans to spend approximately \$878.6M on capital improvements to its water systems. The figure below illustrates the Company’s actual and projected annual expenditures since 2013.

Figure 2: Actual and Projected Annual Capital Expenditures

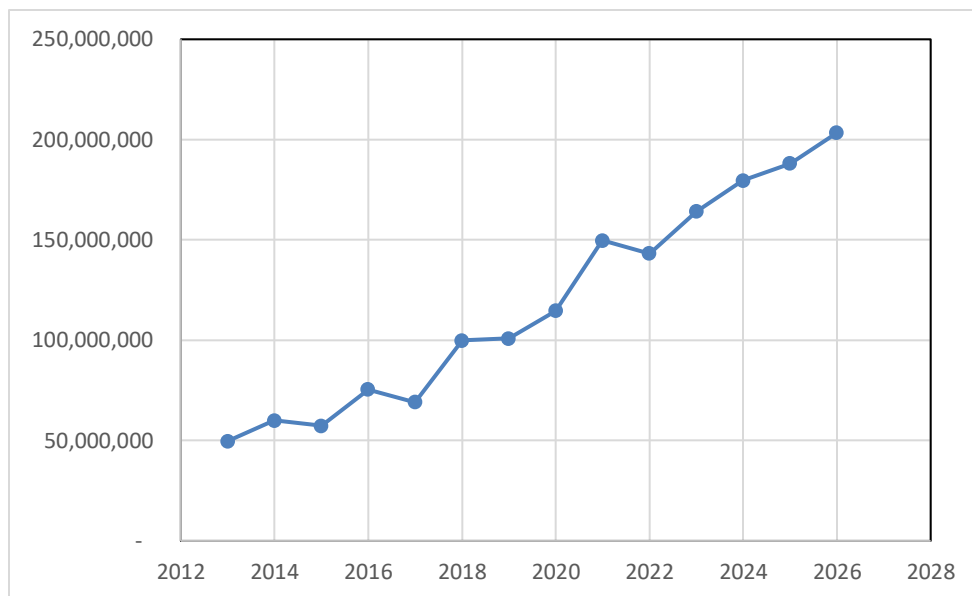

Importantly, this rapidly increasing level of capital investment may not be sustainable. At some level, individual projects may be prudent, but the aggregation of even prudent projects within a short time period may not be prudent, particularly when evaluated in the context of the parameters outlined in Conn. Gen. Stat. § 16-19e. As a monopoly, Aquarion does not face the usual market impediments to excessive capital investments; however, those investments (both individually and in aggregate) must be prudent and reasonable – the regulatory proxy for the free market. Importantly, the burden is on the Company to demonstrate prudence and reasonableness at both levels of investment. Yet, this proceeding has demonstrated that the Company’s ability to justify the prudence of individual projects, let alone aggregate annual expenditures, is deficient.

The Company’s Five-Year Capital Program provides no basis on which the Authority could conclude that the projected level of expenditures is reasonable or prudent. The Authority’s prior admonitions about the Company’s accelerating capital expenditures have gone largely unheeded. Consequently, the Authority will dispense with such perfunctory warnings and sanguine expectations for judicious capital expenditures. Instead, the Authority will simply, as it must, hold the Company to account. As noted previously, “there exists a distinction between, on one hand, utility property and, on the other hand, the cost of utility property allowed in rate base, because only that portion of utility property that is the result of prudent and reasonable management is included in rate base.” Connecticut Light & Power Co., 219 Conn. at 67-68.

The burden will be on the Company to demonstrate that its future capital expenditures, both individually and in the aggregate, are prudent, reasonable, and protect the relevant public interests, both existing and foreseeable. There is certainly no evidence in this proceeding to support such a conclusion at this time.

V. COST OF CAPITAL

A. SUMMARY

The Authority approves a weighted cost of capital of 6.46% based upon an 8.70% return on common equity, a 4.28% cost of long-term debt, a 2.48% cost of short-term debt, and a capitalization mix of 50.35% common equity, 47.07% long-term debt, and 2.58% short-term debt. The Capitalization and Weighted Average Cost of Capital is depicted in the table below.

Table 8: Approved Weighted Average Cost of Capital

Capital Source	Allocation	Cost	Weighted Cost
Long-term Debt	47.07%	4.28%	2.015%
Short-term Debt	2.58%	2.48%	0.064%
Equity (ROE)	50.35%	8.70%	4.380%
Total	100.00%		6.46%

The determination as to the allocation and cost of each source of capital is provided below.

B. FINANCIAL CONDITION AND FLEXIBILITY

The Authority finds that the Company has maintained its financial condition and flexibility since the 2013 Decision; specifically, the Company has increased its operating income and rate base and reduced its embedded cost of debt. Overall, the Company achieved improved financial flexibility, from 2013 to 2022, since its last fully adjudicated rate proceeding. Based upon the review, the Authority determines Aquarion to be financially stable.

The Company's currently allowed ROE is 9.63%. 2013 Decision, p. 115. This ROE includes a 50-basis point premium awarded pursuant to Section 8 of Public Act 13-78,³⁹ and a 10-basis point subtraction for a reduction in risk as a result of the revenue adjustment mechanism. Id.

The Company maintains an A3 Stable Rating from Moody's Investor services. The Company's rating was upgraded to A3 following the completion of the Company's merger with Eversource. Aquarion Interrog. Resp. OCC-107, Att. 2, p. 5. The Company's corporate credit issuer ratings from Moody's, since January 1, 2018, are included in the following table.

Table 9: Moody's Rating, January 1, 2018 through May 19, 2022

Date	Moody's Rating
January 1, 2018	Baa1
March 2, 2018	Baa1
May 18, 2018	A3
May 17, 2019	A3
May 20, 2020	A3
May 14, 2021	A3
May 19, 2022	A3

Aquarion Interrog. Resp. RRU-59.

As part of the rationale for a rating upgrade, Moody's indicated that Aquarion benefits from being a part of Eversource, a large and financially low risk regulated utility holding company, after the merger in December 2017. Aquarion Interrog. Resp. RRU-59, Att. 1, p. 5. In its May 19, 2022 Credit Opinion, Moody's cited the Company's ownership by a large, diverse regulated utility holding company like Eversource as a credit positive. Id. Moody's further asserted that Aquarion benefits from synergies as part of a corporate family of regulated utilities with overlapping service territories through cost sharing services and risk mitigation opportunities. Id. Furthermore, Moody's stated that Aquarion benefits from the increased financial flexibility that comes with being part of a large corporate structure, which allows the Company to retain cash flow and reinvest in

³⁹ Section 8 of Public Act 13-78, An Act Concerning Water Infrastructure and Conservation, Municipal Reporting Requirements and Unpaid Utility Accounts at Multi-Family Dwellings, amended Conn. Gen. Stat. § 16-262s.

its operations when necessary. Id. The Company is owned by Aquarion Water Company, which is owned by Eversource.

Moody's listed several credit strengths in its most recent credit opinion: the Company has a low-risk business profile as a regulated water company; the Company operates in a credit supportive regulatory environment with timely cost recovery provided by key rate adjustment mechanisms; and the Company's financial metrics, although expected to be lower than historic levels (due to its elevated capital expenditure program), continue to support credit quality. Aquarion Interrog. Resp. RRU-59, Att. 1, pp. 1-2.

The following table provides the previous, as well as the most recent, credit ratings of Eversource (the ultimate parent company), Aquarion Water Company (Parent Company), and Aquarion.

Table 10: Current Credit Ratings

	Moody's			Fitch	S&P	
	Eversource	Aquarion Water Company	Aquarion	Eversource	Eversource	Aquarion Water Company
7/25/19	Baa1	Baa2	A3	BBB+	A-*	A-*
5/17/18	Baa2	Baa2*	A3*	BBB+	A+	A+
12/5/17	Baa3	Baa3	Baa1	BBB+	A+*	A+*
1/1/17	Baa4	Baa3	Baa1	BBB+	A+	BBB
* denotes ratings change						

Aquarion Interrog. Resp. OCC-107, Att. 1.

The Company provided a list of financial metrics that are followed by Moody's investor services. Aquarion Interrog. Resp. RRU-59, Att. 1, p. 1. Moody's indicated the factors that would lead to an upgrade, such as the Company's ratio of funds from operations (FFO) to net debt maintained above 21%, and, conversely, indicated that a ratio of FFO to net debt that is sustained under 16% is a factor that could lead to a downgrade. Id., p. 3. Moody's indicated that the Company's FFO to net debt will be within the 17%-18% range going forward versus its FFO to net debt of 20.4% last year. Id., p. 1.

The Company also provided results of several financial ratios that are core metrics typically reviewed by Moody's for 2019, 2020, and 2021, valued at December 31st. Aquarion Interrog. Resp. RRU-63. The Authority compiled the actual historical ratios for the Company in the table below.

Table 11: Historical Ratios for the Company

	Actual	Actual	Actual
	2019	2020	2021
FFO Interest Coverage	6.0x	5.9x	6.2x
FFO/ Net Debt	20.8%	21.2%	20.4%
Debt / Capitalization;	41.1%	38.3%	37.8%
Retained Cash Flow (RCF)/Net Debt.	15.3%	16.8%	14.0%

Aquarion Interrog. Resp. RRU-63.

The Moody's benchmarks for each of the above listed Aquarion historical results are included in the table below. The Authority takes into consideration the effect the ROE has on these metrics and the revenue requirement.

Table 12: Moody's Rating Factor Benchmarks

Rating Factor	Weight	Aaa	Aa	A	Baa
Interest Coverage Ratio	12.50%	≥8x	4.5x-8x	2.5x-4.5x	1.5x-2.5x
OR					
FFO Interest Coverage		≥10x	7x-10x	4.5x-7x	2.5x-4.5x
Net Debt/Regulated Asset Base	10%	<25%	25%-40%	40%-55%	55%-70%
OR					
Debt/Capitalization					
FFO/Net Debt	12.50%	≥40%	25%-40%	15%-25%	10%-25%
RCF/Net Debt	5%	≥30%	20%-30%	10%-20%	6%-10%

Aquarion Interrog. Resp. RRU-63

The Company also projected the financial ratios reviewed by Moody's and several other financial bank solvency ratios under the ROE scenarios proposed by OCC's and by EOE's cost of capital witnesses. The scenarios were as follows: OCC proposed ROE of (1a) 8.90% and (2a) 9.00% and the proposed capital structure of 50% Equity and 50% Debt; EOE proposed ROE within a range of (1b) 7.76%, (2b) 8.33%, and (3b) 8.91%, and the proposed capital structure of 48.43% Equity and 51.57% Debt. Aquarion Interrog. Resp. RRU-407, Att. 1 (Redacted).

Under all the recommendations offered by the Company, OCC, and EOE, the Authority concludes that the metrics remain in the range of the core metrics followed by Moody's to maintain its A3 rating. The Company stated that the metrics Moody's considers as "core" are: FFO interest coverage, debt to capitalization, FFO to debt, and retained cash flows to debt. Tr., Dec. 6, 2022, 1388:5-7. With regard to Moody's rating determination methodology, the Company indicated that 40% of the rating is based on the aforementioned core metrics, 50% is based on business profile, and 10% is based on

financial policy. Tr., 1388:14-19. Other metrics are considered supplementary. Tr., 1389:5-10. If these supplementary metrics fall outside of Moody's rating range, this is typically not a concern for the Company or for Moody's. Tr., 1389:20-25, 1390:1-4. Ultimately, the Authority's analysis concluded that some of the core metrics ratios are reduced when the lower range of ROEs are used; however, the ratios do not breach the lower bound ranges of the metrics.

The Authority weighted the multiple scenarios in its determination of the appropriate required ROE in its analysis to ascertain what the potential impact of various ROEs would have on credit metrics that are deemed significant to the credit rating agencies. The Authority concludes that under various ROE scenarios, as represented in Table 12, and under various pro forma scenarios presented in Attachment 1 of Aquarion's Response to Interrogatory RRU-407 (redacted), the Company's credit metrics remain in acceptable ranges set by the credit rating agencies. Hence, an ROE set within the ranges presented by EOE, OCC, and the Company (i.e., 7.765% to 10.35%) would not adversely affect the Company's credit rating.

C. PROXY GROUP

The methodology of arriving at a cost of equity for a regulated company begins with the selection of a proxy group of comparable companies that can be analyzed to ascertain what the market-based range of the cost of equity is for this group. The Authority typically applies the following criteria (Authority Screening Criteria) in the selection process: (1) predominantly in the same utility industry as the subject utility (70% for electric, 50% for gas) reported by Value Line; (2) publicly traded and reported by Value Line and augmented with AUS Utility Industry for water companies; (3) has paid consistent dividends for 8 quarters and is expected to continue; (4) the company cannot be in financial distress; (5) the company is not the target of an acquisition or merger activity; (6) credit ratings should be at least investment grade as determined by Standard & Poor's (BBB- and above) and/or (Moody's (Baa3 and above)); and (7) the company has similar revenues to the company being analyzed.

The Authority considered the proxy groups presented by the Company, EOE, and the OCC. All parties recommended using proxy groups consisting of publicly traded water companies and gas companies followed by Value Line.

For the proxy group criteria selection, the Company started with 17 investor-owned domestic water utilities and natural gas utilities and then screened the companies based on specific criteria. Nowak Prefiled Test., Aug. 29, 2022, p. 24. The screening criteria evaluated whether the proxy company: (1) consistently pays quarterly cash dividends; (2) maintains an investment grade long-term issuer rating (BBB- or higher) from S&P; (3) is covered by more than one equity analyst; (4) has positive earnings growth rates published by at least two of the following sources: Value Line, First Call (as reported by Yahoo! Finance), and Zacks Investment Research (Zacks); (5) owns regulated assets that make up more than 60% of the consolidated company's assets (based on a 3-year average from 2019-2021); and (6) is not involved in a merger or other transformative transaction for an approximate six-month period prior to the analysis. Id. After applying the screening

criteria, the Company arrived at a proxy group of 13 investor-owned companies. Id., p. 25.

OCC used the proxy group developed by the Company. Woolridge Prefiled Test., Oct. 26, 2022, p. 21. OCC concluded that the risk metrics are mixed for the water and gas companies. Id., p. 23. The water and gas companies' relative average Beta (0.82 vs. 0.83), S&P issuer credit rating (A vs. A-), and earnings predictability (71 vs. 59), suggest water companies are less risky than the gas companies. Id. On the other hand, a comparison of the water companies' and gas companies' relative average financial strength (B++ vs. A-), safety measures (2.7 vs. 2.2), and stock price stability (89 vs. 92) suggests that the water companies are riskier than the gas companies. On balance, given the Beta and S&P issuer credit rating, OCC concludes that the water companies in the proxy group are slightly less risky than the gas companies. Id., pp. 23-24.

In addition to using the Company's proxy group, EOE applied the cost of equity models to the following three proxy groups: (1) RFC Water Proxy Group, which consists of publicly traded water utility companies for which Value Line provides quarterly full company reports; (2) RFC Electric LEAPS Proxy Group, which is comprised of the 12 companies that trade LEAPS (Long-Term Equity Anticipation Securities) out of the 36 publicly traded electric utility companies for which Value Line provides quarterly full company reports; and (3) Nowak's Proxy Group, which is comprised of 13 publicly traded water and natural gas utility companies used by Mr. Nowak in his cost of equity analysis. Rothschild Prefiled Test., Oct. 26, 2022, p. 11.

The Authority approves the Company's proxy group, which consists of the following 13 companies that are most closely aligned with Aquarion's business and financial characteristics and have met the specifications indicated in the Authority's Screening Criteria (Authority's Proxy Group):

- (1) American Water Works Company,
- (2) American States Water Co.,
- (3) Atmos Energy Corporation,
- (4) California Water Service Group,
- (5) Essential Utilities, Inc.,
- (6) Middlesex Water Company,
- (7) New Jersey Resources Corporation,
- (8) NiSource Inc.,
- (9) Northwest Natural Gas Company,
- (10) ONE Gas Inc.,
- (11) SJW Group,
- (12) Spire Inc., and
- (13) York Water Company.

The Company took exception to the use of York Water Company (York Water) in the Authority's Proxy Group, citing data limitations. Aquarion Exceptions, p. 51. However, the Company included York Water in its original proxy group, stating that the

group of 13 water and natural gas utilities adequately reflects the broad set of risks that investors consider when investing in a U.S regulated water utility such as Aquarion. Nowak PFT, p. 25. After updating its financial models, the Company chose to exclude York Water from its proxy group, claiming “Value Line no longer provides full coverage with projections for [York Water].” Nowak Rebuttal Test. to Rothschild, Nov. 9, 2022, p, 10. However, in conducting its analysis, the Authority was able to ascertain credible financial information for York Water to keep it in the proxy group. Generally, a larger sample set proxy group provides a better holistic picture of what equity investors are requiring as a return for regulated utilities. Notably, the Company appears to have removed York Water from the proxy group after determining that its exclusion resulted in increases in the Discounted Cash Flow Model and Capital Asset Pricing Model results favorable to the Company. Tr., Dec. 5, 2022, 1323: 20-25. Consequently, the Authority’s Proxy Group will be the same as the proxy group originally proposed by the Company.

D. CAPITAL STRUCTURE

1. Summary

The Authority finds that the evidence supports a capital structure consisting of 50.35% common equity, 47.07% long-term debt, and 2.58% short-term debt. The table below summarizes the allocation authorized herein.

Table 13: Approved Capital Structure

Capital Source	Allocation
Long-term Debt	47.07%
Short-term Debt	2.58%
Equity	50.35%
Total	100.00%

The Company’s current authorized capital structure is 51.53% common equity, 48.23% long-term debt, and 0.23% short-term debt. 2013 Decision, p. 115.

2. Positions of the Parties

a. Aquarion

In its Application, Aquarion proposes a financial capital structure of 53.06% common equity and 46.94% long-term debt for determining its cost of capital. Nowak PFT, p. 53. The Company’s proposal is based upon the “weighted average capital structures of each of the proxy group operating companies for the most recent year reported.” *Id.*, p. 54. Notably, the Company did not use the capital structure of the *proxy* companies; rather, the Company used the capital structure of the *operating subsidiaries*. As a result, the Company calculated a common equity range of 43.23% - 63.28% and a mean of 54.25% in 2019, and a slightly lower range of 41.92% - 60.04% and a mean of 53.22% for 2020. *Id.*, p. 55 and Ex. A-8-JCN-13.

The Company did not propose short-term debt as a component of its capital structure. However, for the proxy group, the Company's witness calculated a range of 0.00% - 13.69% and a mean of 4.71% for 2020, and a range of 0.00% - 15.98% with a mean of 4.66% for 2019. Nowak PFT, p. 55 and Ex. A-8-JCN-13, p. 2.

b. OCC

OCC's recommended capital structure is 50.15% common equity, 44.37% long-term debt, and 5.47% short-term debt. Woolridge PFT, p. 5. OCC maintains that the Company's proposed capital structure of 53.06% / 46.94% includes a higher common equity ratio than maintained by the companies in the proxy group; is higher than approved for water utility companies in recent years; and is a higher common equity ratio than is employed by Aquarion's parent company, Eversource. Id.

According to OCC, the average common equity ratio for the water and gas companies in the proxy group is 46.8%. Woolridge PFT, p. 24.⁴⁰ The common equity ratio ranged between 36.0% and 61.9%. Id.; Ex. JRW-3.1. OCC used the capital structure ratios for the holding companies rather than the operating subsidiaries, noting that, unlike the operating companies, the holding companies' stock is traded in the market. Id. OCC further suggested that the operating company capital structure reflects an artificially higher equity ratio due to "double leverage." Id., pp. 27-28. Specifically, OCC pointed out that Aquarion's holding company, Eversource Energy, has a common equity ratio of 41.62% as of December 31, 2021, well below Aquarion's proposed 53.06%. Id. OCC avers that a proposed common equity of 50.15% is more reflective of the capital structures of other publicly held water companies, as well as those approved by state utility commissions for water companies. Id., p. 4.

With respect to short-term debt, OCC states that the Company has consistently used short-term debt to finance its operations over the past three years and has consistently held short-term debt outstanding on a daily basis. Aquarion Interrog. Resp. OCC-115, Att. A. Specifically, from 2018 through 2021, the Company consistently used short-term debt in the range of 1.32% to 10.25% on a quarterly basis from 2018 to 2021, with the exception of one quarter (quarter ending June 30, 2021). Tr., Dec. 6, 2022, 1445:12-23; Aquarion Interrog. Resp. OCC-111, Att. 1. The average use of short-term debt over the 2018 to 2021 time period was approximately 3.86%. See Aquarion Interrog. Resp. OCC-111, Att. 1. OCC computed the average daily amount of short-term debt outstanding for Aquarion of \$37.5 million in 2020, \$44.2 million in 2021, and \$99.2 million in 2022, and averaged these figures to arrive at \$60.3 million in short-term debt, which OCC then incorporated into the total capital structure of \$1,096,374,574, resulting in a 5.47% ratio. Woolridge PFT, p. 31 and Ex. JRW-4.1. Based on Aquarion's consistent use of short-term debt, OCC determined that it would be appropriate to include short-term debt in the Company's capital structure. OCC Brief, p. 87.

⁴⁰ York Water is excluded from this proxy group.

c. EOE

EOE proposed a capital structure of 48.43% common equity, 48.99% long term-debt, and 2.58% short-term debt. Rothschild Supplemental Prefiled Test., Nov. 30, 2022, p. 47. EOE presented a proxy group common equity ratio range of 32.9% - 60.0% with a mean of 48.64% for 2020, and a range of 33.5% - 61.6% with a mean of 46.51% for 2021. Id., Ex. ALR-13, p 4. With respect to short-term debt, the data used by EOE indicated a proxy group range of 1.0% - 33.5%, with a median of 3.7%. Id.⁴¹

EOE asserts that the Company's current capital structure is not appropriate because it contains a significantly higher common equity ratio (51.53%) than the current common equity ratio of its parent, Eversource (45%), and it contains significantly more than the average common equity ratio used by other water utility companies in the country. Id., pp. 46-47. EOE included short-term debt in its recommended capital structure based on the average common equity ratio of the water utility companies in the proxy group and the Company's reported short-term ratio for the Test Year; EOE also observed that Aquarion did not explain why it excluded short-term debt in the Company's preferred capital structure. Id.

d. Capital Structure Analysis

The Authority establishes the ratemaking capital structure by carefully weighing several factors, including: the actual capital structure of the utility and its parent company; the range of capital structures of the proxy group; and the credit rating agency requirements for maintaining the current utility rating. In weighing these factors, the Authority considers the credibility of the expert witnesses on these issues.

Aquarion's proposed capital structure is 53.06% common equity and 46.94% long-term debt. Aquarion's capitalization reflects management choices and decisions related to the allocation of such items as common equity, dividend payments, and retained earnings. The more "equity rich" the capitalization structure is, the higher the Company's weighted average cost of capital (WACC). Aquarion's parent company maintains an equity ratio of 41.62% as of December 31, 2021. Consequently, although the Company's actual capital structure is a useful data point, it does not necessarily represent the optimal or most reasonable capital structure. To balance the interests of the Company with fairness to the ratepayers, the Authority broadens its analysis beyond the management decisions at the operating company level.

Another factor in determining a reasonable capitalization is the range of capital structures of the proxy group. As noted above, the Company calculated a common equity range of 43.23% - 63.28% and a mean of 54.25% in 2019, and a slightly lower range of 41.92% - 60.04% and a mean of 53.22% for 2020. Id. Nowak PFT, p. 55 and Ex. A-8-JCN-13. By contrast, OCC presented an average common equity ratio for the proxy group of 46.8% with a range of 36.0% - 61.9%. Woolridge PFT, p. 24; Ex. JRW-3.1. Consistent with OCC, EOE identified a common equity ratio range of 32.9% - 60.0% with a mean of 48.64% for 2020, and a range of 33.5% - 61.6% with a mean of 46.51% for 2021. Using

⁴¹ York Water is excluded from this analysis as the financial ratios were not listed in the exhibit.

Value Line data for years 2020 and 2021, the Authority found equity ratios that were generally consistent with OCC and EOE. The table below summarizes the data.

Table 14: Proxy Group Equity Ratio

	Company		OCC	EOE		Authority	
	2019	2020	2021	2020	2021	2020	2021
Low	43.23	41.92	36.0	32.9	33.5	32.90	33.50
High	63.28	60.04	61.9	60.0	61.6	60.00	61.60
Mean	54.25	53.22	46.8	48.6	46.5	49.08	46.96
Median						50.80	47.20

The key difference between the Company's proxy group ratios and those identified by OCC, EOE, and the Authority appears to arise from the fact that the Company does not use the available financial data for the proxy group but, instead, calculates the ratios using the consolidated financial information of the subsidiary operating companies. Nowak PFT, Ex. A-8-JCN-13. As previously noted, the capitalization of operating subsidiaries is the result of management decisions and, in some cases, the allocation of parent company debt to the subsidiaries as equity. In addition, the stocks of the operating companies are not publicly traded and, therefore, the financials are subject to less market scrutiny. Consequently, the use of operating subsidiary financial data for the proxy group raises questions as to whether this data is an accurate reflection of the market expectations.

The Authority also considers how the capital structure will impact the credit rating of the Company. The Authority analyzed the effect that the different capital structures and ROEs presented by the Parties would have on the Company's core metrics as it relates to the rating agency that provides ratings for the Company. (See Section V.B., Financial Condition and Flexibility for full analysis). The analysis concluded that the core metrics remained in the ranges that would allow the Company to maintain its current A3 rating by Moody's across all proposed and recommended capital structures.

Consequently, for ratemaking purposes, the Authority will use a capital structure consisting of 50.35% common equity, 47.07% long-term debt, and 2.58% short-term debt. The equity ratio balances the average equity ratios for the proxy group companies (ranging from 46.5% to 49.08%) with those of the operating subsidiaries (ranging from 53.22% to 54.25%). It is also consistent with the most recent median equity ratios for the proxy companies (50.8% and 47.2%). Additionally, the Authority's determination with respect to the short-term debt ratio acknowledges that the Company uses short-term debt for a variety of purposes but credits the testimony of the OCC and EOE witnesses that a portion of the short-term debt supports rate base. The 2.58% ratio reflects a number of factors, including the Company's proxy group analysis (mean ratio of 4.66%, Nowak PFT, Ex. A-8-JCN-13), the Company's average daily outstanding short-term debt balance (average of 5.47%, Woolridge PFT, p. 31 and Ex. JRW-4.1), the EOE proxy group (median of 3.7%, Rothschild PFT, Ex. ALR-13, p. 4), and the Company's position that it does not use short-term debt for rate base (0%).

In conclusion, the adopted capital structure is consistent with industry practice and was based upon a careful balancing of the actual capitalization mix employed by the Company, the range of equity employed by companies in the Authority's Proxy Group – both at the parent company and at the operating company level, credit rating agency requirements for maintaining an A3 rating, and the analysis and recommendations of Parties in this proceeding. Importantly, the capitalization mix is within the range employed by other companies in the Authority's Proxy Group.

E. COST OF DEBT

1. Long-Term Debt

Long-term debt is defined as debt that matures in more than one year. The Company proposes a cost of long-term debt cost of 4.28%. Application, Sch. D-3.0A. Both EOE and OCC employed the Company's cost of long-term debt of 4.28%. Rothschild PFT, p. 7; Woolridge PFT, p. 4. The proposed cost of debt includes \$70 million of projected issuance of long-term debt. Aquarion Interrog. Resp. OCC-113. The actual financing was completed on August 29, 2022, with no variance to the assumed cost and rate of 4.69%. See Aquarion Interrog. Resp. OCC-116, Att. 1.

The Authority requires that ratepayers benefit from any opportunity that company management may have to reduce expenses, such as lowering interest rate payments by refinancing debt at lower rates during periods of declining interest rates. To that extent, the Company has successfully refinanced or replaced seven tranches of higher cost long-term debt totaling over \$140 million, reducing the weighted average interest rate from 5.24% down to 4.28% as shown in Schedule D-3.0A of the Application and the table below. The Company's approach to managing its long-term debt has not changed since its last rate case, nor since the acquisition of Aquarion by Eversource. Aquarion Interrog. Resp. RRU-410.

Consequently, the Authority finds that the Company's actual cost of long-term debt is 4.28%. The table below summarizes the Company's long-term debt costs.

Table 15: Cost of Long-Term Debt

Debt Issue	Rate	Amount Outstanding	% of Debt	Net Rate	Weighted Rate
Series R Bonds	6.88%	5,000	0.00%	6.88%	0.00%
2004 Private Placement Issue	6.43%	8,500,000	1.75%	6.94%	0.12%
General Mortgage Bonds, 7.330%	7.33%	14,000,000	2.88%	7.38%	0.21%
General Mortgage Bonds, 9.290%	9.29%	4,500,000	0.92%	9.41%	0.09%
General Mortgage Bonds, 8.040%	8.04%	3,500,000	0.72%	8.15%	0.06%
2012 HIMCO Private Placement Issue	4.40%	30,000,000	6.17%	4.54%	0.28%
2012 Himco/ Babson Private Placement Issue	4.29%	60,000,000	12.33%	4.30%	0.53%
2013 Prudential Private Placement Issue Series A	4.00%	35,000,000	7.19%	4.31%	0.31%
2013 Prudential Private Placement Issue Series B	4.07%	15,000,000	3.08%	4.08%	0.13%
2015 MetLife/Omaha Private Placement Issue	3.75%	46,000,000	9.46%	4.47%	0.42%
2016 NYL Private Placement Issue	3.67%	25,000,000	5.14%	3.83%	0.20%
2017 NYL Private Placement Issue	3.57%	30,000,000	6.17%	3.93%	0.24%
2019 MetLife/NYL Private Placement Issue	3.54%	45,000,000	9.25%	3.55%	0.33%
2021 Met Life Private Placement Issue	3.31%	100,000,000	20.55%	3.32%	0.68%
2022 New Private Placement Issue	4.69%	70,000,000	14.39%	4.72%	0.68%
Total		486,505,000	100%		4.28%

Application, Sch. D-3.0A.

2. Short-Term Debt

The Company obtains cash through short-term loans from Aquarion Water Company at the same rate as Eversource pays through its commercial paper program. Aquarion Interrog. Resp. RRU-412. The Company uses cash available from the short-term loans to pay for capital expenditures until the proceeds of long-term debt financings are available to pay off those loans; in turn, the short-term loans are paid off with the

proceeds of long-term debt financings. Id. Since the Eversource acquisition of Aquarion, the only difference that has occurred is that Aquarion Water Company now borrows from Eversource as opposed to relying on its own revolving credit facility, resulting in interest rate spread savings. Id.

The Company provided the short-term debt and daily cost rates for the years 2020 through August of 2022. Aquarion Interrog. Resp. OCC-115, Att. 1. The Company paid an average rate of 1.13% from January 1, 2022, to August 29, 2022. Id., Column R Rate.

OCC's recommended cost of short-term debt is 2.48%, which was the most recent monthly (August) cost of short-term debt. Woolridge PFT, p. 4. EOE's recommended cost of short-term debt is 0.20%. Rothschild PFT, p. 7, Table 1; Application, Sch. D-2.0. The table below summarizes the short-term debt recommendations.

Table 16: Cost of Short-Term Debt

	Cost
Company	n/a
OCC	2.48%
EOE	0.20%
Approved	2.48%

The Authority finds OCC's recommended cost of short-term debt of 2.48% to be reasonable and will adopt it for calculating the Company's WACC.

F. RETURN ON EQUITY

1. Summary

The Authority examined several factors in determining a just and reasonable ROE, including current economic and market conditions, analytical models and cost of equity capital methodologies, such as the Discounted Cash Flow (DCF) Model and the Capital Asset Pricing Model (CAPM), ROEs of similar companies in other jurisdictions, and the Company's financial risk and credit rating. In reviewing these cost of capital methods, the Authority made determinations regarding each method's input components and reviewed variations of the models. Additionally, other relevant factors were analyzed in the process of evaluating and applying the cost of equity models. The Authority finds an 8.70% ROE to be consistent with these cost of equity methodologies and the factors considered herein.

2. Comparable Allowed ROEs

Allowed ROEs from other jurisdictions merely serve as a guide to establish the trends in allowed ROEs. Over the period 2021 through July 26, 2022, water company allowed ROEs ranged from 7.46% to 10.00%, with an average of 9.37%. Aquarion

Interrog. Resp. RRU-50.⁴² The allowed returns for the regulated gas companies ranged between 8.80% to 10.24%, with an average of 9.50% and a median of 9.49% for that same period. Id. Importantly, the data did not indicate either an upward or downward trend on authorized ROEs over this period.

3. Treasury Rate Trends & Static Analysis

Throughout this proceeding, the Company and the Parties presented to the Authority the state of capital market conditions for the utility space. The Company indicated that capital market conditions have been significantly impacted by the economic repercussions of the COVID-19 pandemic and the subsequent reaction. According to the Company, federal measures taken to contain the economic fallouts from COVID-19 were extraordinary by any measure. Nowak PFT, p. 11. In order to moderate economic consequences of the pandemic, the federal government took a series of unprecedented steps to stabilize financial markets. Id. The Company indicated the Federal Reserve decreased the federal funds rate in March of 2020, resulting in a target range of 0.00% to 0.25%, purchased at least \$80 billion per month in Treasury securities from December 2020 through November of 2021, began expansive programs to support credit to large employers, and supported the flow of credit to consumers and businesses through Term Asset-Backed Securities Loan Facilities. Id., pp. 11-12. In addition, U.S. Congress passed approximately \$4.5 trillion in fiscal stimulus programs. Id. In March of 2020, for the first time on record, the 10-year treasury bond yield dropped below 1% and remained there for the duration of 2020. Id.

The Company claims that the cost of equity has been affected by these circumstances and claims that utility company stocks have traded more in line with the broader market since February 2020 when the COVID-19 pandemic began; thus, the Company cites higher beta coefficients for the proxy group. Nowak PFT, pp. 16-17. The Company goes on to cite the current economic recovery and inflation risk that has occurred after the pandemic. Id. The Federal Reserve, since March of 2022, started to raise interest rates and unwind its quantitative easing and the Company indicated projections for year-end Federal Open Market Committee jumped from 2.6% to 4.3%. Nowak PFT, pp. 20-21. According to the Company, inflation is at its highest level in approximately 40 years and if investors expect higher levels of inflation, they will require higher yields. Id., p. 22.

OCC contends that despite the 2022 increase in yields, interest rates and capital costs remain at historically low levels and long-term expectations on inflation remain in the 2.50% range. Woolridge PFT, pp. 5-9. Additionally, inflation and interest rates have increased significantly in 2022, due primarily to: (1) the recovering economy coming out of the height of the COVID-19 pandemic; (2) the production shutdowns during the pandemic, which led to supply chain shortages as the global economy recovered; and (3) the war in Ukraine, which has led to higher energy and gasoline prices worldwide. OCC Brief, pp. 71-72. While inflationary expectations have risen over the next five years, these

⁴² Aquarion noted that the ROE listed for Blue Granite Water Company of 7.46% included a reduction for service quality issues; however, the amount of the penalty was not provided in the record. Nowak Rebuttal Test. to Rothschild, p. 7.

expectations are lower over ten and thirty years such that long-term inflationary expectations are still in the 2.25% to 2.50% range. Woolridge PFT, p. 13. Authorized ROEs have trended down with interest rates and capital costs in the past fifteen years, hitting an all-time low in 2020 and 2021. Id.

OCC argues that the greater financial burden on utility ratepayers associated with higher gas prices and interest rates should put increased pressure on regulatory commissions to look hard at utility rate increase requests. OCC Brief, p. 75. OCC concluded that studies provide evidence that authorized ROEs have not declined in line with capital costs over the past several decades and past ROEs have overstated the actual cost of equity. Id. To support this conclusion, OCC's witness indicated Moody's recognized that utilities and regulatory commissions were having trouble justifying higher ROEs in the face of lower interest rates and cost recovery mechanisms. Woolridge PFT, p. 71. Consequently, OCC's witness did not feel higher interest rates alone would justify higher ROEs for regulated water companies. OCC Brief, p. 75. OCC's witness referred to significant interest rate decreases during the pandemic, which have come back up. Id. Specifically, interest rates went down 150 basis points while ROEs went down only 20 basis points. Tr., Dec. 6, 2022, 1442:6-17. OCC's witness also indicated the reason ROEs have not increased with higher rates and capital costs is that they did not decline in line with risk free rates. Tr., 1443:1-19.

EOE asserts "that despite high current inflation and recent increases in interest rates, capital market conditions are favorable for utility companies to raise low-cost equity capital." Rothschild PFT, p. 14; Tr., Dec. 6, 2022, 1506-07. EOE notes the outperformance of water utility stocks in the market since March 28, 2013, which indicates a declining cost of equity, relative to the overall market. Rothschild PFT, pp. 14-15. According to EOE, data shows investors have continued to consider water utility stocks to be less risky than the overall market. Id. Since February 2022, there is a significantly lower chance that water utility stocks will experience a large drop as compared to the overall market, which indicates that the cost of capital of water utility stocks remains lower than the overall market. Id., p. 16.

The Authority acknowledges the increased volatility in rates and that this volatility is still present in market trends. As such, the Authority has taken that into consideration in its analysis. Notwithstanding this acknowledged volatility, however, the Authority finds persuasive the reasoning presented by both the OCC and EOE witnesses; particularly, that the correlation between interest rates and ROEs appears to be historically one-sided.

4. Discounted Cash Flow (DCF) Model

a. DCF Model Description

The DCF model is a market-based financial model that attempts to replicate the valuation process that sets the price investors are willing to pay for a share of stock. It is a valuation technique used by major financial institutions and well entrenched in finance theory and academia. The DCF assumes that investors evaluate stocks in a classical economic framework and buy and sell securities rationally at prices that reflect the assets

value assessment. Under the DCF model, the value of a financial asset is determined by its ability to generate future cash flows. Specifically, the present value of a financial asset equals the discounted value of its expected future cash flows. Investors discount these expected cash flows at their required rate of return (i.e., the cost of common equity or ROE). The traditional constant growth DCF Model requires the following assumptions: a constant growth rate for earnings and dividends; a stable dividend payout ratio; a constant price-to-earnings ratio; and a discount rate greater than the expected growth rate.

The DCF model is represented by the formula of $K = D1 / P_0 + G$, where:

K = the market-required ROE;
D1 = the forecasted dividend paid one period into the future;
P₀ = an estimate to the current market price of the stock; and
G = investors' long-run growth expectations.

Consequently, once the dividend yield (D1/P₀) and the expected growth rate (G) are determined, an ROE can be calculated.

b. Dividend Yield

The Company used analysts' estimates based on market data on dividend yields and analysts' projected earnings per share (EPS) growth rates from reputable third-party sources. Nowak PFT, pp. 5, 29; Aquarion Interrog. Resp. RRU-52, OCC-118, and OCC-119. The Company provided three models using 30-day, 90-day, and 180-day average stock prices; however, the results were substantially the same. Nowak PFT, pp. 28-31, Ex. A-8-JCN-5. The Company calculates the expected dividend yield by escalating the actual dividend yield by one-half the expected growth rate in EPS. Id., p. 29. The Company used the average of EPS growth rates from Value Line, Yahoo! Finance, and Zacks.⁴³

Using data as of June 30, 2022, and a 30-day average stock price, the Company projected a mean expected dividend yield of 2.60% (median of 2.52%). Id. In its rebuttal testimony, the Company, using data as of October 31, 2022, projected a mean expected dividend yield of 2.92% (median of 2.76%). Nowak Rebuttal Test. to Rothschild, Ex. B-8-JCN-3.

OCC determined a dividend yield in a similar manner using data as of October 2022. OCC calculated the dividend yield using the current annual dividend and the 30-day, 90-day, and 180-day average stock prices. Woolridge PFT, p. 43 and Ex. JRW-5, p. 2. Based on the mean and median dividend yields of the proxy group using the 30-day, 90-day, and 180-day average stock prices, OCC selected 2.40% as the dividend yield for the OCC Proxy Group. Woolridge PFT, p. 43. OCC then adjusted the dividend yield by one-half the expected growth to reflect growth over the coming year. Id., p. 44. Using projected and historical growth rates from Value Line and projected growth rates from Value Line, Yahoo! Finance, Zacks, and S&P Cap IQ, OCC selected a growth rate

⁴³ The testimony cites to First Call; however, the models cite to Yahoo! Finance.

of 6.50%. Id., p. 53. The resulting adjusted dividend yield is 2.48%. Woolridge PFT, Ex. JRW-5.

Applying a similar approach, but using a smaller proxy group, EOE projected a dividend yield of 1.77% as of September 30, 2022. Rothschild PFT, p. 62, Ex. ALR-3. Adjusting for growth, EOE calculated an expected dividend yield of 1.83%. Id.

In addition to determining the dividend yield using the 1+.5g factor approach, the Authority also considers the dividend yield calculated using commercially available data from Value Line that estimates the dividend for the next 12 months. Specifically, the Authority examines the dividend yield that results from dividing the projected 12-month dividend by the average daily stock price. The projected dividend is available at Value Line: Summary & Index's column (f), Estimated Dividend Yield Next 12 Months (Value Line Column (f)). The Value Line Column (f) data is based upon Value Line's proprietary algorithm that projects the timing and amount of dividend payments to estimate the dividend payment for the next 12 months rather than using the 1+.5g factor approach. The Authority finds that this data is equally reliable (if not more reliable) than the growth assumptions supporting the 1+.5g factor. Notably, the Authority has previously expressed a preference for Value Line Column (f). See Decision, Dec. 14, 2016, Docket No. 16-06-04, Application of The United Illuminating Company to Increase Rates and Charges (2016 UI Rate Case Decision), p. 82; Decision, Aug. 14, 2013, Docket No. 13-01-19, Application of The United Illuminating Company to Increase Rates and Charges (2013 UI Rate Case Decision), p. 127.

Regarding the time period for averaging stock prices, the Authority finds a 30-business day average stock price to be sufficiently long enough to capture changes in stock price movements; it is also relatively simple to obtain from public sources online. See Decision (2021 CWC Rate Case Decision), July 28, 2021, Docket No. 20-12-30, Application of the Connecticut Water Company to Amend its Rate Schedules, p. 35 (citing 2016 UI Rate Case Decision, p. 82; 2013 UI Rate Case Decision, p. 127). In this proceeding, the 30-business day period is appropriate because it is devoid of stock market price shocks or other anomalies that could occur over the longer time periods (i.e., 90-day and 180-day).

Using the Value Line Column (f) estimates for 12-month dividends for the proxy group as of November 4, 2022, Value Line Investment Survey Summary and Index and the 30-day average daily stock price as of December 9, 2022, the average expected dividend yield is 2.57% (median is 2.52%).

Table 17: DCF Dividend Yield Estimates (%)

	Mean	Median
Company (June)	2.60	2.52
Company (Oct.)	2.92	2.76
OCC (Oct.)	2.48	
EOE (Sept.)	1.83	
Column (f) Analysis (Nov./Dec.)	2.57	2.52

The 32-basis point increase in Company's dividend yield from June to October is attributable to a decline in the stock prices of the proxy companies in the fall of 2022. The stock price is the denominator in the equation; therefore, as stocks decline, the dividend yield increases. Stock prices generally recovered by the end of the year. Specifically, the June data reflected a \$72.24 average stock price, but the October data had a \$68.17 average stock price. Nowak PFT, Ex. A-8-JCN-3; Nowak Rebuttal Test. to Rothschild, Ex. B-8-JCN-3. The stock price data examined by the Authority in December reflected an average stock price of \$74.78.⁴⁴ Consequently, the analyses using the October and September data are skewed higher. Accordingly, there is a general consensus that the mean dividend yield rate is in the range of 2.50% - 2.60%.

c. Expected Growth Rate

The constant growth form of the DCF Model assumes a single growth estimate in perpetuity. To reduce the long-term growth rate to a single measure, one must assume a constant payout ratio, and that earnings per share (EPS), dividends per share (DPS), and book value per share (BVPS) all grow at the same constant rate. Over the long-run, dividend growth can only be sustained by earnings growth. Therefore, it is important to incorporate a variety of sources of long-term earnings growth rates into the Constant Growth DCF Model.

The Company only uses the consensus analyst five-year growth estimates in EPS from First Call and Zacks and EPS growth rate estimates published by Value Line. Nowak PFT, p. 29; Aquarion Interrog. Resp. RRU-52, OCC-118, and OCC 119. As a result, the Company initially calculated an average growth rate for the proxy group of 6.80% (median of 6.10%) as of June 30, 2022. Nowak PFT, Ex. A-8-JCN-5. In rebuttal, the Company calculated an average growth rate for the proxy group of 6.81% (median of 6.28%) as of October 31, 2022. Nowak Rebuttal Test. to Rothschild, Ex. B-8-JCN-3.

OCC noted that the better methodology to employ in estimating the growth component of the DCF Model is to examine a range of growth measures. By definition, the growth component represents investors' expectations of the long-term dividend growth rate. Investors use some combination of historical and/or projected growth rates for earnings and dividends per share and for internal or book-value growth to assess long-term potential. Woolridge PFT, p. 45. OCC analyzed a number of measures of growth for companies in the proxy group; specifically, Value Line's historical and projected growth rate estimates for EPS, DPS, and BVPS. Id. In addition, OCC utilized the average EPS

⁴⁴ Average stock prices exclude York Water, which the Company excluded from its rebuttal analysis.

growth rate forecasts of Wall Street analysts as provided by Yahoo! Finance, Zacks, and S&P Cap IQ. Id. These services solicit five-year earnings growth rate projections from securities analysts and compile and publish the means and medians of these forecasts. OCC also assessed prospective growth as measured by prospective earnings retention rates and earned returns on common equity. Id. OCC indicated the overall range for the projected growth rate indicators (ignoring historical growth) is 4.4% to 6.6%. Id. Giving primary weight to the projected EPS growth rate of Wall Street analysts, OCC concluded that the appropriate projected growth rate range is 6.50%. Woolridge PFT, p. 53, Ex. JRW5. OCC noted this growth rate figure is in the upper end of the range of historic and projected growth rates for the proxy group. Id.

EOE approaches the growth rate calculation differently, asserting that the growth rate “g” must be representative of the constant sustainable growth. Rothschild PFT, p. 59. To obtain an accurate constant growth DCF result, the mathematical relationship between earnings, dividends, book value, and stock price must be respected. Id., pp. 59-60. EOE also stated that growth rates such as five-year projected growth in EPS are not indicative of long-term sustainable growth rates in cash flow. Id., p. 112. As a result, they are not applicable for direct use in the simplified DCF Model. Id. Applying its methodology, EOE calculated an average proxy group growth rate of 6.27%.

The Authority has traditionally used a blended approach to analyze growth rates. While EPS growth is the primary contributing factor to overall growth of a company, there is not always a direct correlation with the growth of dividends, book value, and EPS. Therefore, the Authority's analysis takes into consideration that dividend growth is the ultimate input factor of the DCF model because exclusive reliance on EPS growth can be misconstrued because dividends and book value may not grow at the same rates as EPS. A similar rationale was offered by the EOE witness, Mr. Rothschild, who credibly testified that EPS growth rates are not indicative of future sustainable growth rates, in part because the sources of cash flow to an investor are dividends and stock price appreciation. Rothschild PFT, p. 112. While both stock price and dividends are impacted in the long run by the company's earnings, earnings growth is rarely synchronized with cash flow growth from dividends and the stock price. Id.

Mr. Rothschild further explains that a raw, unadjusted, five-year EPS growth rate is usually a poor proxy for either short-term or long-term cash flow growth that an investor expects to receive, and further, that a five-year EPS growth is a poor indicator of five-year dividend growth expectations. Id., p. 113. In order for earnings growth to equal dividend growth, at a minimum, earnings per share in the first year of the five-year earnings growth rate period would have to be exactly on the long-term earnings trend line expected by investors. Since earnings in most years are above or below the trend line, the earnings per share growth rate over most five-year periods is different from what is expected for dividend growth. Id. Notably, this is one of the main contributing factors in the disparity between the ranges generated by the Company as compared to the Authority and other parties.

The Authority has previously considered the inclusion of Value Line’s historical projected DPS and BVPS growth rates. In prior rate cases, the Authority reviewed but excluded the Value Line historical EPS, DPS, and BVPS rates. See, e.g., 2021 CWC Rate Case Decision, p. 36; 2013 UI Rate Case Decision, pp. 127-129; and 2016 UI Rate Case Decision, p. 83. However, the Authority has previously included Value Line *projected* DPS and BVPS growth rates in its analysis, primarily due to the Authority’s expectation that investors will likely examine all the projected growth rate data available. 2016 UI Rate Case, p. 83.

Accordingly, the Authority will incorporate the analysts’ 5-year EPS growth rates from Yahoo! Finance, Zacks, and Value Line. In addition, consistent with prior rate cases, the Authority incorporates Value Line’s projected DPS, BVPS, and retention growth rates into its analysis. See 2021 CWC Rate Case Decision, p. 36; 2013 UI Rate Case Decision, pp. 127-129; and 2016 UI Rate Case Decision, p. 83. The Authority finds that historical growth rates can overestimate future growth of mature companies such as public utilities. The growth rate of public utilities is typically a function of the growth of the overall economy; as such, the Authority excludes historical growth rates from its analysis. With respect to retention growth rates, the Authority calculated the rates using the simple sustainable earnings/retention growth formula and respective data from Value Line’s projections for 2025-2027.

Specifically, the Authority examined the 5-year projected EPS growth rates of the proxy group using estimates from Yahoo! Finance, Zacks, Value Line, as of November 25, 2022, which ranged from 3.20% (Yahoo! Finance, Middlesex Water) to 14.00% (Value Line, SJW Group). The average growth rate based on EPS growth was 7.05%. Next, the Authority analyzed the Value Line projected DPS, BVPS, and retention growth rates, which ranged from 2.50% (Middlesex Water, BVPS) to 9.00% (American States Water, DVPS). The average projected growth was 5.23%. The lower growth rate based on DPS, BVPS, and retention is expected given that EPS growth rates can overestimate dividend growth. Applying an equal weighting to these two growth categories, the average growth is 6.14% (median of 6.21%).

The table below summarizes the various growth estimates for the DCF analysis.

Table 18: DCF Expected Growth Estimates (%)

	Mean	Median
Company (June)	6.80	6.10
Company (Oct.)	6.81	6.28
OCC (Oct.)	6.50	
EOE (Sept.)	6.27	
EPS/BVPS/DVPS/Ret. Analysis	6.14	6.21

d. DCF Analysis

The Company, OCC, and EOE each performed a DCF model, using the constant growth form as well as a non-constant growth form. Nowak PFT, pp. 27-28; Woolridge PFT, pp. 39-42; EOE PFT, pp. 58-60.

The Company's model was based on a constant growth DCF model that assumed a (1) constant average growth rate for earnings and dividends, (2) a stable dividend payout, (3) a constant price-to-earnings multiple, and (4) a discount rate greater than the expected growth rate. Nowak PFT, pp. 27-28. The Company calculated the DCF results using the average stock price, over 30-, 90-, and 180- trading days through June 30, 2022. As discussed above, the Company projected a mean dividend yield of 2.60% and an average growth rate of 6.80%. Consequently, the Company's model calculated a proxy group mean ROE of 9.40% (9.78% excluding Middlesex Water). Nowak PFT, Ex. A-8-JCN-5. On rebuttal, the Company adjusted the numbers to reflect a proxy group mean ROE of 9.72% (10.15% excluding Middlesex Water). *Id.* The Company excluded Middlesex Water because the DCF ROE for the company was below the current cost of debt, which Aquarion deemed to not "meet [the] basic test of reasonableness." Nowak Rebuttal Test. to Woolridge, p. 23.

OCC's model was based on a constant growth DCF model that used a 2.48% dividend yield, a $1 + \frac{1}{2}$ growth adjustment on dividends, and a dividend growth rate of 6.50%. The result of the OCC DCF model is 9.00%, rounded up from 8.98%. Woolridge PFT, p. 54.

EOE used two constant growth DCF methods. One of those methods is based on the sustainable retention growth procedure and the other method is based on option-implied growth as indicated from stock option prices. EOE also used a non-constant DCF method. EOE's constant growth DCF Model results in a range between 7.71% and 7.87% when using a sustainable growth rate, and between 6.62% and 7.55% when using an option-implied growth rate. Rothschild PFT, p. 57. EOE calculated a non-constant DCF ROE between 6.54% and 6.87%. *Id.*, pp. 57-58.

Accounting for DPS, BVPS, and retention growth rates in addition to EPS growth rates, the Authority calculates a ROE range of 5.55% to 10.30%, with a mean of 8.71% and a median of 9.02%. In its calculation, the Authority includes Yahoo!, Zacks, and Reuters' forecasts of EPS in the analysis, Value Line's five-year projected growth rate per share estimates for earnings dividends, and book values, as well as retention growth rates. The single-stage, constant growth DCF Model was applied to the companies in the Authority's Proxy Group over the most current 30-business day period on the stock price. The Authority's analysis is based on a company specific basis, not a point average as per OCC's approach.

A benefit of accounting for projected DPS, BVPS, and retention growth rates in the analysis rather than relying exclusively on projected EPS growth rates is that the inclusion of this additional data has a moderating effect on the range of ROEs. Specifically, the Company's range of mean ROEs for the proxy group is 4.99 – 14.42%, or 9.43%. Nowak

PFT, Ex. A-8-JCN-5. By contrast, the analysis of ROEs when including the broader set of growth data has a narrower range of 5.55% - 10.30%. Therefore, the result is a much more normal distribution of data and a smaller standard deviation. Given this type of data distribution, the Authority finds that the mean ROE (8.71%) is a more accurate reflection of the full ROE data set compared to the median (9.02%), which is a metric more appropriate for data that contains significant outliers or a skewed distribution.

The Authority also considered the issue of proxy group outliers. Notably, the Company removed Middlesex Water from its proxy group based on the premise that the Company's projected DCF ROE for Middlesex Water (4.99%) was too low. Nowak PFT, pp. 30-31. By contrast, OCC did not exclude Middlesex Water from its DCF analysis. Woolridge PFT, p. 74 ("this results in an asymmetric approach to identify outliers – throw out the low ones but not the high ones."). The Authority has previously applied bottom-end and top-end screens based on the cost of debt as represented by bond yields in order to exclude outlier ROEs. Specifically, the Authority will examine those proxy group ROEs that are less than 400 basis points above or more than 750 basis points above the rated bond averages.

In this case, Middlesex Water's projected DCF ROE falls within the bottom-end screen and requires further consideration to determine if a change to the proxy group is warranted. One option is to simply exclude Middlesex Water from the proxy group, as the Company did, which increases the mean DCF ROE by 30-40 basis points. See Nowak PFT, Ex. A-8-JCN-5. This substantial upward shift is due not only to the ROE amount but to the relatively small size of the proxy group. With only 13 companies in the proxy group, the elimination of one company has a significant impact on the mathematical averages. In addition, the removal of the lowest ROE while retaining all other ROEs may unreasonably bias the proxy group data towards the higher range. Notably, the Company excluded the 4.99% ROE for Middlesex Water but retained the 14.42% ROE for SJW Group, resulting in an upward bias. Id. Consequently, a second option, which avoids this upward bias, is to exclude both the lowest and the highest ROEs of the proxy group. This results in a more pragmatic upward shift (approximately 15 basis points) in the mean ROE because it removes both ends of the statistical range. A key issue with this approach, though, is that it diminishes the proxy group even further to 11 companies, undermining the overall reliability of the resulting data.

Here, due to the relatively small size of the proxy group, the Authority is disinclined to exclude 2 of the 13 companies in the proxy group or to bias the mean ROE upward by excluding only the lowest ROE. Therefore, the Authority will use the results of the full proxy group. In reaching this conclusion, the Authority gives credence to the testimony of OCC's witness regarding the averaging out of errors by use of proxy groups. Tr., 1429:18-23 (Woolridge: "the way you deal with [outlier DCF results] is [to] put together a group. And you don't exclude one or another, you just say these errors are going to average out if you average a group. And that's why you always use a group in any type of valuation analysis or anything like that.").

Consequently, the Authority will consider the DCF ROE results that include the full proxy group. The results are summarized in the table below.

Table 19: DCF Results

Type	Mean	Median	Mean Range
Aquarion			
30-Day Const Growth (June)	9.40%	9.83%	4.99 – 14.42%
30-Day Const Growth (Oct.)	9.72%	9.96%	5.04 – 14.35%
OCC			
Constant Growth Rate (Oct.)	9.00%		
EOE			
Sustainable Growth Rate			7.71 - 7.87%
Option Implied Growth Rate			6.62 - 7.55%
Non-Constant Growth Rate			6.54 - 6.87%
EPS/BVPS/DVPS/Ret. Analysis	8.71%	9.02%	5.55% - 10.30%

In considering the various estimates, the Authority finds that, due to the dip in stock prices in the fall of 2022, the analyses using stock prices from that period (*i.e.*, October) are biased high and are less representative of prevailing market conditions than the analyses conducted using June and December 2022 stock prices. In addition, the Authority finds that the Company's exclusive reliance on EPS growth rates overestimates dividend growth by ignoring the impact of projected DPS, BVPS, and retention growth. Consequently, the Authority finds that a mean DCF ROE of 8.71% and a range of 5.55% to 10.30% is reflective of the prevailing market conditions.

5. Capital Asset Pricing Model (CAPM)

a. CAPM Model Description

CAPM evaluates the relationship between the expected return and risk of investing in a security and is used to calculate the expected returns of an asset. To determine the cost of equity, CAPM first determines the appropriate risk-free rate and then adds a beta, or the degree of co-movement of the security's rate of return with the market's rate of return, multiplied by the expected equity risk premium, which is the amount by which investors expect the future return on equities, in general, to exceed that on the riskless asset.

The CAPM model is represented by the formula $Ke = Rf + \beta (Rm - Rf)$, where:

- Ke = the required market ROE;
- β = Beta coefficient of an individual security;
- Rf = the risk-free rate of return; and

R_m = the required return on the market; the term $(R_m - R_f)$ represents the equity risk premium (ERP).

Consequently, once the Beta (β) and ERP ($R_m - R_f$) are determined, an ROE can be calculated.

b. Beta Coefficient

The measure of Beta represents the volatility of a proxy group of companies as compared to the aggregate market. The Company noted that Beta coefficients increased substantially between January 2020 and May 2022 for the utility companies used in its cost of capital analysis. Nowak PFT, p. 17. The Company considered two measures of Beta for the proxy group companies: (1) the Beta coefficients from Bloomberg, which are calculated using ten years of weekly data against the S&P 500 Index; and (2) the Beta coefficients from Value Line, which are calculated using five years of weekly data against the New York Stock Exchange Composite Index. Id., pp. 34-35. The Company used Betas with a mean of 0.80. Id., Ex. A-8-JCN-7.

OCC noted that utility Betas as measured by Value Line have been in the 0.55 to 0.70 range for the past 10 years, but utility stocks were much more volatile relative to the market in March and April of 2020, which resulted in an increase of above 0.30 to the average utility beta. Woolridge PFT, p. 58. OCC used Value Line Betas in its CAPM. Id., p. 60. Specifically, OCC adopted a Beta of 0.80. Id., Ex. JRW-6.

The Authority has traditionally incorporated both Value Line and Bloomberg Betas into its analysis by taking the simple average of the two estimates on a per company basis for the companies included in the Authority's Proxy Group. See 2021 CWC Rate Case Decision, pp. 38-39. By incorporating the average of the two sources of Beta, the Authority finds that such approach is less likely to overstate or understate the reflective Betas in the proxy group. Consequently, the Authority determined the Beta by averaging the Value Line Beta of all companies in the Authority's Proxy Group (0.82) and the Bloomberg Beta of all the companies in the Authority's Proxy Group (0.79), thereby resulting in a Beta of 0.805. Consequently, there was general agreement on the applicable Beta.

c. Risk-Free Rate (R_f)

As part of the Company's risk-free rate variable in its CAPM analysis, it considered projected bond yields to provide a forward-looking perspective on the cost of capital of its long-term assets. Nowak PFT, p. 34. The Company considered the following three estimates of the risk-free rate: (1) the current 30-day average yield on 30-year U.S. Treasury bonds (i.e., 3.18%); (2) the projected 30-year U.S. Treasury bond yield for Q4 2022 through Q4 2023 (i.e., 3.74%); and (3) the projected 30-year U.S. Treasury bond yield for 2024 through 2028 (i.e., 3.80%). Id.

Conversely, OCC typically uses the Duff & Phelps recommended normalized risk-free rate, which currently stands at 3.5%. Woolridge PFT, 56. If the 20-year Treasury

spot rate is above 3.5%, the recommended risk-free rate is the spot on the 20-year, which is 4.5%. Id.

EOE's short-term risk-free rate is based on the yield of 3-month U.S. Treasury bills, while the long-term risk-free rate is based on the yield of 30-year U.S. Treasury bonds. Rothschild PFT, p. 73. EOE's spot and weighted average short-term risk-free rates are 3.33% and 2.98%, respectively, and the spot and weighted average long-term risk-free rates are 3.79% and 3.42%, respectively. Id., Ex. ALR-4, p. 2.

The Authority notes that this rate case was filed during a time of both increasing *and* fluctuating rates, with respect to both short-term and long-term rates. See Section V.F.3. Treasury Rates and Static Analysis. As such, the Authority took into consideration both the increase in rates and the volatility of Treasury Market rates in its analysis. Based upon the recent observed trend in interest rate yields, and in an effort to smooth out interest rate volatility, the Authority finds an acceptable and conservative proxy for the return on long-term risk-free asset (Rf) to be 3.70%.

d. Equity Risk Premium

The equity risk premium (ERP) is equal to the expected return on the stock market; the expected return on the S&P 500 (Rm) minus the risk-free rate of interest (Rf). In short, $ERP = Rm - Rf$. The ERP is difficult to measure because it requires an estimate of the expected return on the market (Rm). There was significant debate in this proceeding regarding the estimation of the equity risk premium.

In the Application, the Company calculated an expected return for the overall market of 13.41%. Nowak PFT, p. 35. Then, based on FERC convention, the Company considered a subset of S&P 500 companies with growth rates between 0% and 20%, which indicated expected market return of 12.37%. Id. Applying the Company's Rf estimates, the Company projected an ERP of 8.57% to 9.20% (FERC methodology). Id., Ex. A-8-JCN-7. The Rm value used by the Company in the rebuttal testimony was 15.61% (12.76% for FERC methodology). Nowak Rebuttal Test. to Rothschild, Ex. B-8-JCN-4. Applying the Company's Rf estimates, the Company projected an ERP of 8.76% to 8.96% (FERC methodology). Id., Ex. B-8-JCN-2.

OCC asserted that the ERP of 12.37% (FERC methodology) proposed by the Company was "excessive" because it assumes 25% higher returns in the future than in the past. Woolridge PFT, p. 79. OCC considers several market risk premium studies reflecting a range of 3.00% to 6.71%. Id., pp. 62-68. Applying the "more timely and relevant studies," OCC identified a range of 4.0% to 6.0%. Id., p. 68. Ultimately, OCC used an ERP of 5.5%, giving most weight to estimates of Duff & Phelps, KPMG, the Fernandez survey, and Damodaran. Id. During the evidentiary hearings, OCC stated that, under current market conditions, an ERP of 6% would be appropriate, coupled with a reduction in the risk-free rate to 3.8% to arrive at a CAPM of 8.6% (using a 0.8 beta). Tr., Dec. 6, 2022, 1447:1-9.

EOE calculated its ERP using option-implied return expectations. Rothschild PFT, p. 95. Under EOE’s approach, once the option-implied growth rate of the S&P 500 has been estimated, the dividend yield is added and the risk-free rate is subtracted to arrive at the market risk premium. Id., p. 96. EOE used ERPs of 7.66% and 7.21% based on short- and long-term risk-free rates, respectively. Id.

Accordingly, the overall estimated ERP range is 5.50% to 9.20%. The Authority previously accepted OCC’s methodology in arriving at the ERP. See 2013 UI Rate Case Decision, p. 133. Additionally, in past analyses, the Authority incorporated OCC’s survey of methodologies (OCC ERP Survey) into the PURA analysis. Woolridge PFT, Ex. JRW-611. While the Authority considered the Company’s approach of using a DCF analysis on dividend paying companies in the S&P 500 to back into the equity risk premium, the Authority took exception to such an approach in the 2013 UI Rate Case Decision. 2013 UI Rate Case Decision, pp. 131-133. Here, the Authority maintains that skepticism regarding the indicated CAPM results of this methodology and, instead, finds the methodology employed by OCC to be more credible. Specifically, the Authority places more weight on OCC’s 6.0% ERP recommendation as it is derived from a careful review of financial literature and history and comports with the findings of other experts, while the Company’s approach is in excess and out of step with peer reviewed studies and noted field experts such as Duff & Phelps. In sum, weighting the approach employed by OCC most heavily, the Authority finds an ERP of 6.3% appropriately reflects the market conditions.

e. CAPM Results

Using the components as determined above, the Authority’s CAPM result is 8.77%, based upon the CAPM formula $Ke = Rf + \beta (Rm - Rf)$. The Authority’s components and result are summarized as follows:

Table 20: CAPM Results

Component	Rf	Beta	Rm	ERP	ROE
CAPM Calculation	3.70%	0.805	10.00%	6.30%	8.77%

6. Expected Earnings Model

The Company proposed using an expected earnings model for determining ROE. The Authority declines to apply this model for the same reasons it has declined to do so in prior rate cases.

First, the Company’s Expected Earnings approach uses proxy company ROEs resulting from state and federal regulatory proceedings as input variables. These ROEs are not determined by competitive market forces, which set the standard for an investor’s required return. Woolridge PFT, p. 96. Second, the approach is not widely accepted today in utility ratemaking as this benchmarking-comparison methodology has been replaced by regulators with market-based approaches, such as DCF, bond yield plus risk premium, or CAPM.

The Authority most recently rejected the Expected Earnings approach in the CWC Rate Case Decision. 2021 CWC Rate Case Decision, p. 41. In that Decision, the Authority reconsidered the version of the Expected Earnings/Comparable Earnings approach as applied by CWC and found the methodology as applied to be highly dependent on the number of companies included in the comparison group and the time period covered. Id. The Authority found that the Expected Earnings approach did not measure market cost of equity as it is accounting-based and not a measure of investors' market-based required returns. Id.

Consequently, the Authority rejects the Expected Earnings approach.

7. Other Factors

a. Company's Financial Risk

The Authority considers the financial risk of the Company as it relates to the Authority's Proxy Group to determine if there are unique financial risks or risk mitigations that should be considered in establishing an ROE.

The Company cites its capital expenditures and regulatory risks as components that have a direct bearing on Aquarion's risk profile. Nowak PFT, p. 39. OCC notes these risk factors are already considered by credit rating agencies in assessing the risk of an entity. Woolridge PFT, p. 98. EOE observes that the Company made no specific adjustments to the ROE recommendation to account for the capital investment program or regulatory risk despite claiming these factors impact the Company's risk profile. Rothschild PFT, p. 56.

The Authority did not find any evidence to suggest that the Company has a higher risk profile than the Authority's Proxy Group. Further, the Authority notes that, to the extent any perceived risk exists, ownership from a corporate family of regulated utilities mitigates some financial risk as the entity benefits from the increased financial flexibility and the synergies provided from the ownership structure.

Importantly, the regulatory framework in Connecticut, by design, also provides certain risk mitigation mechanisms that should be accounted for in setting a reasonable ROE. Specifically, the Company benefits from two statutory provisions — the revenue adjustment mechanism (RAM) and the WICA program.

RAM provides a more stable revenue stream by substantially reducing the risk of actual revenues diverging from the Company's allowed revenue. Specifically, the mechanism "reconciles in rates the difference between the actual revenues of a water company and allowed revenues." Conn. Gen. Stat. § 16-262y(a). In Aquarion's last rate case, the Authority found "there must be a reduction in risk from the revenue adjustment mechanism . . . when the Company has argued that historically, allowed revenues have been lower than actuals. The Authority takes into consideration the evidence that this reduction in risk cannot be measured and as such finds that only a nominal reduction of 10 basis points [in ROE] should be made to recognize this reduction in risk." 2013

Decision, p. 110. The Authority finds that RAM continues to reduce Aquarion's revenue risk to a similar extent and warrants consideration of a similar ROE reduction.

As discussed in Section III.B. Multi-Year Rate Plan, the WICA program "provides an opportunity for recovery of a portion of capital investment in between rate cases." Morrissey PFT, p. 16; Conn. Gen. Stat. § 16-262w. Specifically, under WICA, Aquarion is permitted to increase revenues to contemporaneously recover capital investments. This rate case resets Aquarion's WICA to zero, allowing the Company to increase its annual revenues by up to 5% per year and up to 10% between rate case filings. Conn. Gen. Stat. § 16-262w(i). By providing Aquarion the opportunity to increase revenues between rate cases, the WICA program, similar to RAM, reduces Aquarion's risk. As such, the Authority will consider this reduction in risk when determining the ROE.

b. Flotation Cost

The Company requests a 0.07% addition to the ROE to account for flotation costs. Nowak PFT, p. 4. Flotation costs are the costs associated with the sale of new issues of common stock. These costs include out-of-pocket expenditures for preparation, filing, underwriting, and other costs of issuance of common stock. To the extent that a company is denied the opportunity to recover prudently incurred flotation costs, Aquarion asserts that actual returns will fall short of expected (or required) returns, thereby diminishing the utility's ability to attract adequate capital on reasonable terms. Nowak PFT, p. 48. The Company contends that if it is denied the opportunity to recover prudently incurred flotation costs through its ROE, its allowed return will be insufficient, and equity share value will be diluted. Id. As such, the Company is requesting the inclusion of 7 basis points in the ROE to account for flotation costs. Nowak PFT, p. 4. The Company provided a breakdown of equity infusions from the parent company and dividends paid. Aquarion Interrog. Resp. OCC-110.

OCC argues that the Company did not provide any evidence that Aquarion has paid flotation costs and, therefore, should not be allowed to collect additional revenues in the form of a higher ROE for flotation costs that have not been identified or paid. Woolridge PFT, p. 98.

Similarly, EOE also does not think it is appropriate to increase Aquarion's ROE to account for flotation costs because the common stock of water companies is currently selling at a market price that is approximately 200% above book value. Rothschild PFT, p. 57 and Ex. ALR-3, p. 1. As a result, selling new stock becomes a net profit, rather than a contributor to costs, as the effect is book value per share increases. Id.

Flotation costs are reviewed on a case-by-case basis by the Authority, as each utility has a unique corporate structure. The Company stated that no flotation costs were paid over the period 2015-2022. Interrog. Resp. OCC-112. Equity is infused through the ultimate parent Eversource. Id. Flotation costs are incurred by Eversource and netted against the proceeds from the issuance equity at the ultimate parent. Aquarion Interrog. Resp. OCC-123. The Company was not able to quantify the direct costs to the Company as equity issued at the ultimate parent is infused to the holding company, then to the

Company itself. Consequently, the Authority finds that the Company has failed to meet its burden of demonstrating that the cost of equity will be specifically affected by the flotation cost incurred at the parent level. As such, the Authority will not factor flotation costs into the ROE determination based on this evidentiary record.

c. ROE Adder under Conn. Gen. Stat. § 16-262s

The Authority denies Aquarion's request, made pursuant to Conn. Gen. Stat. § 16-262s(b), for a 25-basis points adder to its ROE (ROE Adder) for acquiring and taking over the operation of four small water systems since 2013, which the Company asserts were economically non-viable: Bedrock Water Association (Bedrock),⁴⁵ Hickory Hills Corporation (Hickory Hills), Interlaken Water Company, Incorporated (Interlaken), and Litchfield Condominium Associates, Inc. (Litchfield). The Authority may award a water company that acquires another economically non-viable water company a ROE Adder if the acquiring water company can demonstrate that the proposed acquisition will provide benefits to customers by (1) enhancing system viability, or (2) avoiding capital costs or savings in operating costs, or as otherwise determined by the Authority. Conn. Gen. Stat. § 16-262s(b). Here, notwithstanding the issue of whether the Authority determined the acquired systems were economically nonviable, Aquarion did not demonstrate that the acquisitions would provide benefits to customers by enhancing system viability or by avoiding capital costs or savings in operating costs. Accordingly, Aquarion failed to sustain its burden of proof for any of the cited acquisitions.

Further, Aquarion did not incur any detrimental effects from the acquisitions. As part of the acquisitions, the Authority required the customers of the acquired water systems to pay surcharges and contributions in aid of construction (CIAC), which mitigated the financial impact on Aquarion.^{46,47,48} Additionally, Aquarion acquired each of

⁴⁵ Aquarion is not eligible for an ROE Adder for its acquisition of Bedrock as the Company has already been awarded a ROE Adder for this acquisition pursuant to the September 2, 2015 Decision (2015 ROE Adder Decision) in Docket No. 13-02-20RE03, Application of Aquarion Water Company of Connecticut to Amend its Rates—Premium ROE. 2015 ROE Adder Decision, p. 43.

⁴⁶ In the June 15, 2017 Decision (Litchfield Hills Decision) in Docket No. 10-01-16, Joint Investigation of PURA and DPH Regarding Litchfield Condominium Associates, Inc. to Cease Operations as a Water Supply Company, the Authority and the Department of Public Health (DPH; jointly, Agencies) ordered the customers of the Litchfield water system to provide a CIAC in the amount of \$284,000 to Aquarion, which was approximately 70% of the estimated cost of the main extension from Aquarion's system to the Litchfield water system. Litchfield Hills Decision, pp. 10, 15.

⁴⁷ In the October 4, 2017 Decision (Hickory Hills Decision) in Docket No. 14-05-11, PURA and DPH Joint Review of the Petition of Hickory Hills Corporation to Cease Operations as a Water Company, the Agencies ordered the customers of the Hickory Hills water system to pay a capital surcharge of \$29.78 per month for 13 years. Hickory Hills Decision, p. 8. In lieu of the capital surcharge, the Agencies authorized the customers of the Hickory Hills water system to provide a CIAC in the amount of \$54,000 to Aquarion. Id.

⁴⁸ In the May 15, 2019 Decision (Interlaken Decision) in Docket No. 14-04-22, Petition of Interlaken Water Company, Incorporated to Cease Operations as a Water Supply Company, the Authority ordered the customers of the Interlaken water system to pay a surcharge of \$69.33 per month, or \$831.96 annually, over a 40-year period. Interlaken Decision, p. 12. The Authority asserted that the "surcharge prevents legacy ratepayers from paying for the full amount of improvements by recovering more than 60% of the revenue requirement from [the customers of the Interlaken water system]." Id., p. 12.

these systems for free, i.e., it did not pay a purchase price or other fee to acquire the systems. Aquarion had no financial disincentive to acquire these systems; therefore, an ROE adder is unnecessary to incent these specific acquisitions, or similarly situated ones.^{49,50}

In addition, the acquisition of these systems helped Aquarion meet its growth metric, which in turn benefits both the Company's employees and its shareholders, rather than customers. Specifically, Aquarion has a growth metric that is built into the Company's short-term incentive plan that rewards employees with incentive compensation for increasing the number of customers served by Aquarion through the acquisition of systems. Tr., Nov. 29, 2022, 634:3-21. This approach also rewards shareholders by "[delivering] strong financial results to shareholders through focus on delivery of net income and growth initiatives," such as acquisition of new water systems. Aquarion Interrog. Resp. OCC-31, Att. 4, p. 4. Additionally, the acquisition of water systems is part of Aquarion's growth strategy. Tr., Nov. 30, 2022, 814:18-21, 815:6-13. Requiring the Company's ratepayers to fund an ROE Adder when the acquisition of the systems is part of Aquarion's growth strategy is illogical.⁵¹

Lastly, even if Aquarion had sustained its evidentiary burden that an ROE adder is warranted (which it did not), the Company failed to demonstrate that the amount of the ROE Adder, i.e., 25 basis points, is appropriate. Aquarion asserts that a 25-basis points ROE adder for the acquisition of 3 water systems⁵² is appropriate when compared to the 50-basis point ROE adder that the Authority approved in the Company's 2015 ROE Adder Decision for the acquisition of 56 water systems. Nowak PFT, p. 53. This correlation, however, is not proportional and lacks any evidentiary or logical basis.

Accordingly, the Authority finds that Aquarion failed to provide sufficient evidence to support a 25-basis points ROE Adder for the acquisition of the Hickory Hills, Interlaken, and Litchfield Hills water systems.

d. Conn. Gen. Stat. § 16-19kk Factors

In establishing a company's authorized return, the Authority must consider:

Quality, reliability and cost of service provided by the company, the reduced or shifted demand for electricity, gas or water resulting from the company's conservation and load management programs approved by the authority,

⁴⁹ ROE Adders are supposed to be forward looking to encourage future management behavior. Tr., Dec. 6, 2022, 1556:8-10; 1556:24-1557:4. The ROE Adder in this construct, as Aquarion proposes it, is a reward for what a company did in the past, not to incentivize a company to do something in the future.

⁵⁰ ROE Adders shift the risk of the adjustment, which in this case is for the acquisitions, from the Company to its ratepayers so that it is the ratepayers who end up paying for the risk. Tr., Dec. 6, 2022, 1450:16-22. Here, the Company was made whole, or close to it, when Aquarion acquired the water systems. Therefore, shifting the risk to ratepayers by requiring that they pay an ROE Adder is not appropriate.

⁵¹ Interestingly, ratepayers also pay the salaries of the Aquarion employees that search for and work on acquisitions. Tr., Dec. 1, 2022, 856-25-857:12.

⁵² As stated above in footnote 45, Aquarion is not eligible to receive an ROE Adder for the acquisition of Bedrock as it has already received one.

the company's successful implementation of programs supporting economic development of the state and the company's success in decreasing or constraining dependence on the use of petroleum or any other criteria consistent with the state energy or other policy.

Conn. Gen. Stat. §16-19kk(c).

In determining the ROE, the Authority considered these statutory factors and finds that the record does not support an adjustment to the Authority-allowed ROE based on these considerations.

8. Approved ROE

In determining a reasonable ROE, the Authority considers the analytical models, the prevailing market conditions, and the Company's risk profile. A key determinant in setting an ROE is whether the ROE will allow the utility to maintain its current financial condition and credit rating. In Section V.B. Financial Condition and Flexibility, the Authority conducted a rigorous analysis of the effect of the proposed capital structures and ROEs on the Company's credit rating, concluding that "an ROE set within the ranges presented by EOE, OCC, and the Company (i.e., 7.765% to 10.35%) would not adversely affect the Company's credit rating."

To narrow this range, the Authority considers the two analytical models (DCF and CAPM). The Authority generally weighs the DCF model results more heavily than the CAPM results. Notably, the DCF model relies on directly observable market data and provides a better measure of the cost of equity for utilities given the relative stability of the utility business and the valuation process. Conversely, the CAPM relies primarily on risk-premium studies, which are more subjective in nature. Based on the proxy group and the various permutations of analytical models examined in the proceeding, the Authority finds that a reasonable ROE for the Company is in the range of 8.00% to 9.50%.

Within this range, the Authority must determine the ROE that is "sufficient, but no more than sufficient" for Aquarion to "cover [its] capital costs, to attract needed capital and to maintain [its] financial integrity." Conn. Gen. Stat. § 16-19e(a)(4). In doing so, the Authority "is not bound to the use of any single formula or combination of formulae" but must balance "investor and consumer interests" and make "pragmatic adjustments." Woodbury Water Co., 174 Conn. at 264. Cognizant of this legal framework, the Authority has analyzed a wide array of considerations in reaching a determination, including, without limitation, the Company's capital structure, its financial condition, ROEs from other jurisdictions, analytical models, testimony from the Parties and Intervenors, prevailing and anticipated market conditions, and the regulatory environment.

In brief, the Company is financially stable, maintaining an A3 Stable Rating from Moody's Investor services. Since its last rate case, the Company merged with Eversource, providing additional financial flexibility, and potential synergies for cost sharing and risk mitigation. In addition, the Company operates in a regulatory environment that reduces risk through the RAM and WICA programs. In light of these

and other factors discussed in more detail throughout this section, the Authority finds that an ROE of 8.70% is reasonable and provides the proper balance between shareholders and ratepayers.

VI. ALLOWABLE EXPENSES

A. LATE FILED EXHIBITS

At the November 22, 2022 hearing, the Company proposed submitting a customary late filed exhibit, marked as Late Filed Exhibit 1, to provide any corrections and agreed-upon adjustments to the Company's Application identified during the discovery process and evidentiary hearings.⁵³ In essence, Late Filed Exhibit 1 is intended to revise, as needed, all of the schedules contained in the Application to reflect discrepancies and errors identified during the proceeding.

On December 8, 2022, the Company submitted Late Filed Exhibit 1, which included the anticipated corrections and agreed-upon adjustments; however, Late Filed Exhibit 1 also included material changes to the Application. Late Filed Ex. 1, Att. 1 (Dec. 8, 2022). Subsequently, the Company submitted supplements and revisions to Late Filed Exhibit 1 on December 12 and 14, 2022. At the December 14, 2022 hearing, the Authority requested the Company submit a revised Late Filed Exhibit 1 consistent with the Company's proposal to include only corrections and agreed-upon adjustments, to which the Company agreed. Tr., Dec. 14, 2022, 66:22-67:13.

Notwithstanding these instructions, the Company filed a revised Late Filed Exhibit 1 (Final Late Filed Exhibit 1), which contained the corrections and agreed-upon adjustments, but also continued to include material modifications to the Application. See Final Late Filed Ex. 1.⁵⁴ Final Late Filed Exhibit 1 was submitted four days after the last

⁵³ See Tr., Nov. 22, 2022, 23:15-24:5 (Attorney Pace: "Chairman, just one evidentiary matter, and that is before we start to take Late-File exhibits, I know in rate cases it's customary that the company provides as a Late-File all of the corrections we've made during the discovery process so there could be one Late-File where, if there are corrections, we would put it in one convenient place for all the parties. We'd like the Authority's permission to mark as Late-File 1 all the corrections identified during the discovery process as well as any that will identified during the hearing process for the benefit of the Authority and for the parties to have it in one convenient location. Is that acceptable to the Chairman?" Chairman Gillett: "That is."; see also Tr., 24:23-25:7 (Chairman Gillett: "And apologies, Attorney Pace, did you say this Late-File exhibit captures any corrections that were made during the discovery process including the prefile testimony?" Mr. Pace: "And also identified during the hearing. So Chairman, if we do identify any further corrections during the course of the hearing, we can always proceed to provide a supplement to the Late-File at the appropriate time.").

⁵⁴ The Final Late Filed Exhibit 1 includes two attachments: Supplemental 2 Attachment 1, which is referred to in the body of the Decision as Supplemental Attachment 1 and in citations as Suppl. Att. 1, and Supplemental 2 Attachment 2. According to Aquarion, Supplemental Attachment 1 to the Final Late Filed Exhibit 1 includes: (1) Corrections, agreed-upon adjustments, and material changes to the Company's B Schedules on rate base, which includes actual plant additions as of the end of November and projected closings (100% complete) as of December 15, 2022, and C Schedules on income statement, revenue adjustments, and expenses; and (2) corrections, agreed-upon adjustments, and material changes to Aquarion's Schedules B-4.0 through B-9.0, which are based on actual balances as of November 30, 2022. See Final Late Filed Ex. 1. The Company indicated that Supplemental 2

evidentiary hearing, which was held on December 15, 2022. Consequently, similar to the Company's substantial changes to pro forma plant additions, its material modifications to the expense portion of the Application shortly before, and again after, the late filed exhibit hearings, is not consistent with good administrative practice.⁵⁵

B. OPERATIONS AND MAINTENANCE EXPENSES

1. Summary

Allowable operating expenses must “reflect prudent and efficient management of the franchise operation.” Conn. Gen. Stat. § 16-19e(a)(5). Therefore, only those expenses that are reasonable and necessary to provide service to the public may be included as an allowable expense. To determine a utility's allowable expenses, the Authority will consider the Test Year expenses as adjusted for known and measurable changes. The Company has the burden of proving that such expenses under consideration are just and reasonable. See Conn. Gen. Stat. § 16-22.

For purposes of establishing a revenue requirement, the Company proposed operations and maintenance expenses of \$80,261,512. Final Late Filed Ex. 1, Sch. C-3.0. The table below summarizes the Authority's modifications to the Company's proposed operations and maintenance expenses by category. The subsequent sections provide an explanation for each of the modifications.

Attachment 2 includes the corrections, agreed-upon adjustments, and material changes included in Supplemental 2 Attachment 1, plus the impact of plant additions for projects that are at least 75% complete as of December 15, 2022. See Late Filed Ex. 1, Suppl. 2 (Dec. 19, 2022), Att. 2.

⁵⁵ The Company asserts that Final Late Filed Exhibit 1 includes material adjustments to its Application, in addition to corrections and agreed-upon adjustments, “[b]ecause Conn. Gen. Stat. § 4-177c(a) authorizes [Aquarion] to submit evidence on ‘all issues involved’ in this rate case while the record is open – and because Conn. Gen. Stat. § 16-19e(a)(4) states that rates must be sufficient to enable ‘public service companies to cover their operating costs.’” Aquarion Brief, p. 28. However, the question is not whether the Company can submit evidence; rather, the question is whether the Authority can rely on such evidence. The submission of new evidence shortly before and after the close of evidentiary hearings deprives the Authority and parties of a meaningful opportunity to review the evidence and to test its reliability and credibility.

Table 21: O&M Expense Modifications

Company Proposed	\$80,261,512
Jobbing Income	(700,578)
Net Company Proposed	79,560,934
Employee Compensation – Salaries	(772,489)
Employee Compensation - COLA	(275,558)
Incentive Compensation – Aquarion	(97,716)
Incentive Compensation - Employees	(1,706,725)
Employee Service Awards Program	(17,632)
Management Fee	(205,338)
Employee Benefits	(159,359)
SERP	(401,010)
Purchases: Purchased Power Expense	(722,379)
Purchases: Chemicals	(3,149,286)
Merger Cost Recovery	(483,753)
Inflation Adjustment	(1,194,200)
Memberships and Affiliation Dues	(300,712)
Donations	(81,491)
Directors and Officers Liability Insurance	(31,097)
Rate Case Costs	(137,164)
Non-Revenue Water	(138,012)
Communications Expense	(265,948)
Deferred Conservation Expense	(249,675)
Annual Conservation Expense	(94,629)
Entertainment Expense	(37,812)
Relocation Expense	(22,500)
Maintenance, Non-SAP	(176,954)
Bad Debt Expense	(1,998)
Total Modifications	(\$10,723,437)
Total Allowed O&M Expenses	68,837,497

2. Employee Compensation

a. Full-Time Equivalent Positions and Open Positions

The Company requests \$29,214,689 for employee salaries, which includes employee salaries for 320.6 full-time equivalent (FTE) employee positions and 12 open positions, for a total of 332.6 FTEs. Added to this amount is annualized payroll -part time (\$652,016), incentive compensation (\$2,222,298), and Overtime (\$1,982,691), for a total request of \$34,071,693. Final Late Filed Ex. 1, Sch. WPC-3.2. As of December 19, 2022, the Company had 320.6 FTEs. *Id.* In September 2022, Aquarion had 311 FTEs. Aquarion Interrog. Resp. OCC-260, Att. 2. In the previous five years, the Company has had an average vacancy rate of: 5.7, 6.1, 9.4, 10.4, and 11.5 in 2017, 2018, 2019, 2020, and 2021, respectively, for a five-year average vacancy rate of 8.6 FTEs. Aquarion Interrog. Resp. OCC-57, Att. 1-5. In 2022, the Company averaged 17.6 vacancies for the period from January through September. Aquarion Interrog. Resp. OCC-260, Att. 2.

Based on the evidence in the record, including the Company's five-year average vacancy rate, the Authority determines the appropriate number of FTEs is 324 (332.6 – 8.6), which is further reduced to 323 FTEs as a result of the additional FTE disallowance discussed below. The Authority concludes that this level of allowed FTEs is sufficient for the Company to provide safe and reliable service to its customers without burdening ratepayers with excessive wage expenses.

Additionally, the Authority notes that the Company currently has two Directors of Business Development, one of which previously worked for the New England Service Company (NESC) and, when the Company acquired NESC, joined Aquarion as a condition of their employment. Late Filed Ex. 35; Tr., Dec. 14, 2022, 133:6-15. Both Directors of Business Development have similar responsibilities, and the Company did not offer any evidence or explanation as to why two identical positions are necessary. Tr., 133:16-20. Accordingly, the Authority denies recovery for one of the two Directors of Business Development as this is a duplicative job title with duplicative job responsibilities.

Due to this disallowance and using the salary for the open position of Director of Customer Service as a proxy, the Authority adjusts employee compensation by \$151,500. Additionally, the Authority is adjusting employee compensation for the Company's average vacancy rate of 8.6 FTEs. The resulting reduction in the Company's request for employee compensation expense is \$772,489, which is the average pro forma FTE payroll expense of \$76,295, excluding wage increases and incentive compensation, multiplied by the average vacancy rate of 8.6, plus the wage expense of \$116,352 ($\$151,500 * 0.768$) for the elimination of the duplicative position of Director of Business Development ($(\$76,295 * 8.6) + (151,500 * 0.768)$).

b. Wage Increase

The Company requests \$1,135,723 for a 4% wage increase for non-union employees effective April 2023, as it "expects to provide a slightly higher general increase in 2023 of [4%]." Teixeira Prefiled Test., Aug. 29, 2022, p. 37; Szabo & Unger Prefiled Test., Aug. 29, 2022, p. 33; Final Late Filed Ex. 1, Sch. WPC-3.2. A wage increase of 3% was provided to non-union and union employees effective April 1, 2022. Teixeira PFT, pp. 36-37. The Authority finds that the Company did not substantiate its burden for the additional 4% wage increase, explaining only that it expects to provide a "slightly higher general increase in 2023" due to "current market trends." *Id.*, p. 37. Accordingly, the Authority denies the Company's request for the 4% wage increase; however, the Authority will permit a 3% wage increase commensurate with the survey data cited to justify the 3% increase afforded to non-union employees effective the previous calendar year. *Id.* As such, the Authority allows \$776,923 [$(\$31,076,906^{56} * .03) / 12$] * 10 months] for a 3% wage increase effective April 2023. The adjustment to the requested amount results in a reduction of \$358,800 ($\$1,135,723 - \$776,923$). When multiplied by the expense ratio of 76.8%, this equals a \$275,558 expense reduction.

⁵⁶ $\$31,076,906 = \$34,071,693 - \$2,222,298 - \$772,489$

c. Officer Compensation

The Company requests \$1,954,310 ($(\$2,940,460 * 86.54\%)^{57}(76.8\%)$) for Aquarion officer compensation in base rates, which includes Aquarion officers' base salary, incentives, and benefits. Application, Sch. G-2.12; Aquarion Interrog. Resp. RRU-441, Att. 1.⁵⁸

The Authority approves the inclusion of 90%, or \$1,758,879, of Aquarion officer compensation in base rates. Similar to Eversource officer incentive compensation, discussed infra in Section VI.B.4. Management Fee Compensation, the Authority approves the inclusion of 50% of the remaining 10%, or \$97,716 ($(\$1,954,310 * 10\%)(50\%)$), in base rates (but importantly, subjects such amount to reconciliation), and the inclusion of the other 50% of the remaining 10%, or \$97,716, to be recovered through the revenue adjustment mechanism (RAM), *if* the Company meets the metrics discussed in Section VI.B.5. Performance Metrics. The amount the Company may ultimately recover from ratepayers is dependent on the percentage by which Aquarion meets the metrics. For example, if the Company meets 50% of the metrics, then the 5% of the Aquarion officer compensation included in rate base would be used to compensate the Aquarion officers. With respect to the 5% of the Aquarion officer compensation for which recovery is disallowed (due to the Company achieving only 50% of the defined metrics), the Company would take no action toward seeking recovery of the remaining 5% of the Aquarion officer compensation from customers in RAM. If, however, the Company fails to meet less than half of the metrics, then the Company is directed to return the proportional share of the Aquarion officer compensation included in rate base (\$97,716) to customers through the RAM as a credit and will again forego recovery of the other 5% through the RAM. The Company may seek recovery from its shareholders of any portion of the Eversource officer compensation for which recovery from customers is disallowed. The Authority directs the Company, no later than February 1, 2024, and annually thereafter, to file as a compliance filing the amount of Aquarion officer compensation customers are paying through base rates and through the RAM, or conversely how much is being returned to customers through the RAM.

⁵⁷ During the proceeding, the Company revised the Mass formula allocation to reflect Aquarion Company's acquisition of New England Service Company in December 2021 and Torrington Water Company in October 2022. Late Filed Ex. 17, Att. 1.

⁵⁸ The Company asserts that the Authority disallowed recovery of Aquarion officer incentive compensation two times, once in Section VI.B.2.c, Officer Compensation, when it disallowed recovery of Aquarion officer incentive compensation, and a second time in Section VI.B.2.d, Employee Incentive Compensation, when PURA disallowed recovery of employee incentive compensation. Aquarion Exceptions, pp. 19-20. First, contrary to the Company's assertion, the Authority did not disallow recovery of the Aquarion officer compensation. Second, it is unclear that the Aquarion officer incentive compensation included in Schedule G-2.12 of the Application is the same as the employee incentive compensation included in Schedule WPC-3.2 of Final Late Filed Exhibit 1. Further, if the Aquarion officer incentive compensation included in Schedule G-2.12 of the Application is also included in the employee incentive compensation in Schedule WPC-3.2 of Final Late Filed Exhibit 1, the Company sought recovery for the Aquarion officer incentive compensation twice, once in Schedule G-2.12 of the Application and a second time in Schedule WPC-3.2 of Final Late Filed Exhibit 1.

d. Employee Incentive Compensation

The Company requests \$2,222,298 to fund its employee incentive compensation program (Incentive Program). Final Late Filed Ex. 1, Sch. WPC-3.2. According to the Company, the Incentive Program is designed to promote its mission by incentivizing employee behavior towards the achievement of the goals and objectives outlined in Aquarion's business plan. Teixeira PFT, p. 38. The Company asserts that by tying a portion of employee compensation to the employee's performance of the goals and objectives, Aquarion's total employee compensation package provides "great motivation for employees to increase operating efficiencies and productivity." *Id.*, pp. 38-39. In addition, the Company asserts its "total rewards" approach is "designed to compensate employees competitively in comparison to the general industry sector." *Id.*, p. 33.

The evidence in the record does not support a finding that the Incentive Program properly incentivizes employees or benefits ratepayers in such a way that it constitutes prudent and efficient management of the Company's operation. First, the Company failed to demonstrate that the Incentive Program is required to maintain competitive salaries and employee retention. Specifically, for non-executive compensation, the Company appears to use base wages when comparing Aquarion employee compensation to compensation offered by peer utilities. *See, e.g.*, Tr., Nov. 29, 2022, 626:5-13 (Chairman Gillett: "Do you recall whether the survey gets into the granularity . . . of what the comp's breakdown between base and incentive is?" Ms. Teixeira: "For the senior team, yes it does." Chairman Gillett: "Not for all job classifications?" Ms. Teixeira: "Not for all job classifications."); Tr., 625-626:14-25 (Chairman Gillett: "Okay. So for all job classifications . . . are you comparing total compensation package to the results of the survey?" Ms. Teixeira: "We look at base wages, and then we look at what is a typical percentage of your base wages that is competitive to the market.").

Second, the Company provided no evidence to substantiate its burden that the Incentive Program incentivizes its employees. Almost 100% of eligible employees receive employee incentive compensation, which raises significant doubt as to the degree to which the program provides motivation to meet or exceed any goals set. *See* Aquarion Interrog. Resp. OCC-30 and OCC-32. The record evidence instead supports a finding that the Program has no discernable impact on the customer-facing metrics. *See* Aquarion Interrog. Resp. OCC-34, Att. 6 and 7.⁵⁹

Third, employees only receive employee incentive compensation if the Incentive Program is funded.⁶⁰ Teixeira, Szabo, Unger Rebuttal Test., Nov. 9, 2022, p. 14. This

⁵⁹ As noted by OCC, customer complaint targets and results for the years 2017-2020 for both categories of complaints (*i.e.*, customer service complaints and customer quality complaints) indicate no discernible year-over-year sustained improvement. OCC Brief, pp. 36-37; Aquarion Interrog. Resp. OCC-34. More troublesome perhaps is that the "target" for each category was unchanged between 2017-2020. *Id.* In other words, not only is the plan yielding no demonstrable impact on these customer-facing metrics (and thus no quantifiable benefit to ratepayers), but the Company has also failed to appropriately incentivize any improvement in its employees' performance given that the targets remain unchanged year-to-year.

⁶⁰ For example, if the Company met only 60% of the 70% tied to financial goals and 100% of the 30% tied to operation goals, then the total pool of incentive funds would be adjusted downwards 10% to reflect meeting only 60% of the 70% tied to financial goals. *See* Tr., Nov. 29, 2022, 593:16-595:21.

funding approach protects shareholders at the expense of ratepayers. Specifically, if the Company does not meet its goals, the Company can reduce or eliminate Incentive Program funding for employees while retaining the funds provided by ratepayers through this line item. Tr., Nov. 29, 2022, 581:24-25 (“You have to have enough financial, you know, success in order to fund the plan”; 585:7-10 (Mr. Defever: “So if the company had a great year, incentive comp would be better than if the company had a bad year financially?” Ms. Teixeira: “Yes.”).

Finally, since 70% of the employee incentive compensation is tied to achievement of financial goals, the Incentive Program primarily benefits the Company’s shareholders, rather than ratepayers. See Teixeira, Szabo, Unger Rebuttal, pp. 12, 14; Aquarion Interrog. Resp. OCC-31, OCC-37, and OCC-208;

In sum, the program “is more accurately described as a bonus plan than an incentive plan.” OCC Brief, p. 34. Accordingly, the Authority denies the Company’s request to recover \$2,222,298 from ratepayers to fund the Incentive Program as the program provides little, if any, benefit to ratepayers. Instead, the Authority suggests that the Company fund 100% of the Incentive Program using Aquarion’s 50% share of its Earnings Sharing Mechanism (ESM), which is a more appropriate indicator of whether the Company has achieved financial goals that are mutually beneficial to shareholders and ratepayers. If there is no ESM triggered in any given year, then the Company’s shareholders may opt to fund the Incentive Program, since it primarily incents achievement of shareholder-prioritized financial goals.

The adjustment to employee incentive compensation expense is a reduction of \$1,706,725 ($\$2,222,298 * 76.8\%$). Final Late Filed Ex. 1, Sch. WPC-3.2.

In its written exceptions, the Company argues that “it is not sufficient for the Authority to simply declare it is ‘unpersuaded’ that the plan does not work.” Aquarion Exceptions, p. 65. However, the Company does, in fact, have the burden to persuade the Authority through sufficient evidence that the Incentive Program is a prudent and efficient use of ratepayer funds, including that the program provides a direct or derivative benefit for ratepayers (e.g., improving consumer metrics, employee retention, etc.). Here, the Company has not met this burden. Even in its written exceptions, the Company continues to advance multiple strained and disparate characterizations of the Incentive Program, undercutting the credibility of the Company’s proffered evidence. Aquarion Exceptions, pp. 65-66.

3. Employee Service Awards Program

The Company’s Employee Service Award Program rewards employees for years of service. Aquarion Interrog. Resp. OCC-24. The awards start at \$150 after the first 5 years of service and increase to a maximum of \$1,250 after 50 years of service. Id. The Company asserts it developed the Employee Service Award Program for employee retention, though it is doubtful an employee will choose to stay with Aquarion for \$150 after 5 years. Defever Prefiled Test., Oct. 26, 2022, p. 22. Since it is unlikely that the

small awards impact employee retention, the Employee Service Award program provides no benefit for ratepayers.

Consequently, the Authority denies recovery of \$17,632 for the Employee Service Awards Program because it has not been shown to be a prudent expense that provides benefit to ratepayers.⁶¹

4. Management Fee Compensation

Aquarion requests recovery of \$410,676 ($\$474,550 \times 86.54\%$), which represents the Company's share (Management Fee) of the flat fee that Eversource charges Eversource's affiliates for a portion of the Eversource officers' compensation⁶² (Flat Fee) based on the Massachusetts (MASS) Formula.⁶³ Aquarion Interrog. Resp. EOE-45; Late Filed Ex. 18, Att. 1; Final Late Filed Ex. 1, Sch. WPC-3.28(2). Aquarion pays 86.54% of the Flat Fee and the other Eversource subsidiaries pay the other 13.46%. Final Late Filed Ex. 1, Sch. C-3.28(2). The Management Fee equates to \$7,898 per week, or \$197 an hour (based on a 40-hour work week). The way in which Eversource determines the amount charged for the Flat Fee, which is set annually, is unclear. Tr., Nov. 28, 2022, 358:15-259:4. In addition, whether the Eversource officers track their time spent on the affiliates is unknown. Tr., Nov. 28, 2022, 358:15-259:4. The Company also does not know how the decision was made to include the 12 officers listed in the Management Fee. Tr., Dec. 14, 2022, 140:6-19.

Accordingly, if the Company seeks recovery of the Management Fee in a future rate case, Aquarion is on notice that the provision of evidence to support the imposition of such fees is a prerequisite to recovery; in other words, detailed documentation will be required regarding, at a minimum, how Eversource chose the officers included in the fee, the tracked time Eversource officers spend on Aquarion work, and examples of demonstrable benefits that accrued to the Company's ratepayers traceable to the direct management provided by each officer included in the Flat Fee.

Despite the lack of information regarding how Eversource determined the amount of the Flat Fee, the Authority approves the inclusion of \$205,338 (50% of \$410,676) of the Management Fee in base rates (but importantly, subjects such amount to reconciliation), and the inclusion of the remainder of the Management Fee, or \$205,338 (50% of \$410,676), in RAM, but only *if* the Company meets certain metrics discussed

⁶¹ Importantly, the Authority is not requiring the Company to cease employee programs. Rather, the Authority is requiring the Company to demonstrate these programs are a prudent and efficient part of its operations that benefits ratepayers or to use shareholder money to fund them in the alternative.

⁶² The Eversource officers whose compensation is included in the Flat Fee are: executive vice president and general counsel; chairman, president, and chief executive officer; executive vice president-customer and corporate relations; executive vice president and chief operating officer; vice president, controller; vice president, investor relations; senior vice president, finance and regulatory and treasurer; corporate secretary and deputy general counsel; vice president, internal audit and security; senior vice president and chief financial officer; and director of taxes. Late Filed Ex. 18, Att. 1; Tr., Dec. 14, 2022, 138:24-140:5, 140:25-141:10.

⁶³ The MASS Formula is used to allocate current year expenses are based upon *prior year* actual revenues, gross plant, payroll, and customer counts.

infra in Section VI.B.5. Performance Metrics. The amount the Company may ultimately recover from ratepayers is dependent on the percentage by which Aquarion meets the metrics.

For example, if the Company meets only 50% of the metrics, then the 50% of the Management Fee included in base rates would be used to pay the Management Fee, while the Company would forgo seeking recovery of the other 50% from customers through the RAM. If, however, the Company fails to meet less than half of its metrics, then the Company is directed to return the proportional share of the Management Fee included in base rates (\$205,338) to customers through the RAM as a credit and will again forego recovery of the other 50% through the RAM. The Company may seek recovery from its shareholders of any portion of the Management Fee for which recovery from customers is disallowed. The Authority directs the Company, no later than February 1, 2024, and annually thereafter, to file as a compliance filing the amount of the Management Fee customers are paying through base rates and through the RAM, or conversely how much is being returned to customers through the RAM.

5. Performance Metrics

The Authority is required in a rate case to “consider the implementation of financial performance-based incentives and penalties and performance-based metrics.” Conn. Gen. Stat. § 16-19a(b). Additionally, in exercising its discretion regarding whether to allow the recovery through rates of any portion of the compensation package for executives or officers or of any portion of any incentive compensation for employees of a water company, the Authority is required to consider whether to require that any such compensation that is recoverable through rates be dependent upon the achievement of performance targets. Conn. Gen. Stat. § 16-19yy.⁶⁴ If the Authority approves such performance-based incentives and penalties for a particular company, PURA is required to include in the framework for periodic monitoring and review of the company’s performance pursuant to metrics developed by the Authority. Conn. Gen. Stat. § 16-19a(b). Based on the record in this proceeding, the Authority determines that implementation of financial performance-based incentives is both appropriate and necessary.

The Authority is tying the Company’s recovery from ratepayers of a portion of the Aquarion officer compensation expenses and the Management Fee expenses to the achievement of affordability metrics to appropriately motivate its executives to develop and faithfully implement programs that directly and meaningfully benefit the Company’s low-income customers. In 2017, as a condition of approval for the merger between the Company and Eversource, the Authority directed the Company to “develop and propose in its next rate case a low-income program that could best benefit its customers in need.” Decision (Merger Decision), Oct. 27, 2017, Docket No. 17-06-30, Joint Application of

⁶⁴ Given that the Company did not substantiate its burden with respect to the Management Fee in particular, as discussed in Section VI.B.4. Management Fee Compensation, the opportunity to recover these costs from ratepayers subject to achievement of certain performance metrics is more beneficial to the Company than the alternative, which is the disallowance of recovery of 100% of the Management Fee from ratepayers.

Eversource and Macquarie Utilities Inc. for Approval of Change of Control, p. 26 (emphasis added). Despite having over five years to compile and analyze data regarding its low-income customers to develop a program that would best benefit those customers, the Company instead proposed a program providing a 15% credit to low-income customers simply because the Authority approved a 15% credit for Connecticut Water Company in the 2021 CWC Rate Case Decision. Aquarion Interrog. Resp. RRU-325; Tr., Dec. 5, 2022, 1160:3-5; 1255:12-18.

In addition, rather than leveraging the experience of Aquarion's affiliated companies, The Connecticut Light and Power Company d/b/a/ Eversource Energy (CL&P) and the Yankee Gas Services Company d/b/a Eversource Energy (Yankee), both of which have extensive experience with implementing financial hardship programs, the Company instead elected to have only high-level discussions with them. See Aquarion Interrog. Resp. EOE-41; Tr., Dec. 1, 2022, 1028:9-10. Lastly, when asked about the Company's familiarity with the Authority's recent Decision in which PURA ordered the electric distribution companies in Connecticut, including CL&P, to implement a low-income discount rate, the Company replied that they were not aware of it. Tr., 1075:23-1076:7. The Authority is equally perplexed and disheartened by Aquarion's apparent lack of awareness considering CL&P was actively engaged in the proceeding, which occurred over an almost two-year period, and was ultimately ordered to implement a low-income discount rate. Accordingly, the Authority finds it is more than necessary and appropriate to connect the recovery of Eversource and Aquarion officer compensation to achievement of certain affordability metrics.

The Authority finds that the following metrics by which PURA will measure Aquarion's performance are reasonable and appropriate. Aquarion is deemed to have met or exceeded the performance metrics if the difference between the data for the calendar year for which the Company is reporting (Current Year) is equal to or greater than 10% of the data for the Historical Period, based on the average of the results of all four metrics. The Company is deemed to have met 90% of the performance metrics if the data for the Current Year is between 9% but less than 10% greater than the data for the Historical Period, based on the average of the results of all four metrics; 80% if the difference between the data for the Current Year is between 8% and 9% greater than the data for the historical, based on the average of the results of all four metrics; 70% if the difference between the data for the Current Year is between 7% and 8% greater than the data for the historical, based on the average of the results of all four metrics, etc. The Historical Period shall be the average of the data from 2017 through 2022, unless the Authority finds that such data is unreliable due to missing or incomplete data, in which case the Historical Period shall be data from the Test Year.⁶⁵

1. Payment Regularity Ratio Metric: Aquarion shall calculate the payment regularity ratio (Payment Regularity Ratio) for its residential customers by using

⁶⁵ In the event that the Company is unable to supply baseline data for one or more metrics in any of the years, the Authority will be unable to assess the Company's achievement of the metrics for a given cycle; thus, the Company would be prohibited from recovering any portion of the compensation earmarked as contingent on these performance targets for the applicable year.

- data for the Historical Period and comparing it to the data for the Current Year to determine how many payments the Company received for every 100 residential monthly bills rendered. The Payment Regularity Ratio is calculated by placing the number of payments in the numerator and the number of bills in the denominator. Late Filed Ex. 75, pp. 8-9.
2. Payment Coverage Ratio Metric: Aquarion shall calculate the payment coverage ratio (Payment Coverage Ratio) for its residential customers by using the data for the Historical Period and comparing it the Current Year to determine the amount of payments the Company received for every 100 residential monthly bills rendered. The Payment Coverage Ratio is calculated by dividing the dollars of payments by dollars of bills. Colton Prefiled Test., Oct. 26, 2022, pp. 21-22.
 3. Nonpayment Disconnection Ratio Metric: Aquarion shall calculate the rate of nonpayment disconnections (number of nonpayment disconnections per 100 customers) for its residential customers by using data for the Historical Period and comparing it to number of nonpayment disconnections for every 100 customers in the Current Year. See Late Filed Ex. 75, p. 8.
 4. Average Monthly Arears Metric: Aquarion shall calculate the average number of accounts in arrears monthly by using data for the Historical Period and comparing it to average number of accounts in arrears monthly in the Current Year. Id., p. 8.

The Authority directs the Company to submit as a motion for review and approval no later than May 1, 2023, the data for each year from 2017 through 2022 required to calculate the baseline for each of the performance metrics. In its ruling on the motion, PURA will approve the Company's use of either an average of the data from 2017 through 2022, or the data from the Test Year for Aquarion's calculation of the various performance metrics in Rate Year 1, depending on whether the Authority finds the data submitted for 2017 through 2022 is unreliable due to missing or incomplete data.⁶⁶ In addition, the Authority directs the Company to annually, on or before January 15th, submit as a compliance filing detailed information regarding whether Aquarion met or exceeded each of the metrics during the preceding calendar year. The compliance filing shall include an unlocked workable Excel spreadsheet providing the data on which the Company relied in making its determination.

⁶⁶ This determination will also affect whether the baseline used to assess achievement of the Company's progress in 2024 is calendar year 2023 data, or a rolling average between 2018-2023. For clarity, the February 1, 2024 RAM filing will assess whether the Company achieved its performance metrics during calendar year 2023, using the baseline of either the Test Year or the 2017-2022 Historical Average as determined by the Authority, and any necessary adjustments would be made to the RAM rate effective April 1, 2024. The February 1, 2025 RAM filing will assess whether the Company achieved its performance metrics during calendar year 2024, using the baseline of either calendar year 2023 data, or a rolling average between 2018-2023, as determined by the Authority, and any necessary adjustments would be made to the RAM rate effective April 1, 2025; and so on.

6. Benefits

a. Employee Benefits

As a result of the disallowance of 8.6 FTEs and the Director of Business Development position in Section VI.B.2.a., the employee benefits expense, which includes Group Medical and Dental, Life Insurance, and Long-Term Disability, is reduced by \$159,359. This is the total of the average expense portion of the benefits per FTE (\$16,599) multiplied by the 8.6 vacancy rate plus \$16,599 for the disallowed Director position.

b. SERP

The Authority denies Aquarion's Supplemental Executive Retirement Plan (SERP) expense of \$401,010, which is consistent with PURA's past precedent of denial of this optional employer sponsored benefit that accrues to only a select few highly compensated employees. See 2013 Decision, pp. 68-69. The Authority also finds that lack of clarity with which the Company identified the SERP expenses in the instant Application provides further support for the denial as the Company has not met its burden.

In its Application, the Company did not include a specific pro forma adjustment schedule for SERP. The Application included Schedule WPC-3.25, which made reference to SERP expense for Connecticut Business Tax purposes. See Application, Sch. WPC-3.25. OCC initially identified a disallowance of only the \$13,746 for the defined benefit portion of the SERP and \$97,728 (later corrected to \$26,613) for the 401k portion of the SERP that were not included in the Management Fee. Defever PFT, pp. 15-16; Final Late Filed Ex. 1, Sch. 3.19(2) and 3.28; Late Filed Ex. 29 and 30; Suppl. Late Filed Ex. 30, Dec. 16, 2022; Tr., Dec. 14, 2022, 121:1-25.

Through discovery and testimony at the Late Filed Exhibit hearing, the Authority learned that the \$13,746 and \$26,613 amounts for Defined Benefit and Defined Contribution SERP, respectively, provided in the Application were related to the Connecticut Business Tax portion only. The Company indicates that the amounts questioned by OCC (i.e., \$13,746 related to the SERP Defined Benefit portion and \$26,613 related to the SERP 401k employer match portion) were a distinct part of the SERP expense excluded from the inflation adjustment of the Application. The remainder of the proposed SERP amount of \$360,651 was included in the Management Fee. Final Late Filed Ex. 1, Sch. 3.19(2) and 3.28; Late Filed Ex. 29; Late Filed Ex. 30; Tr., Dec. 14, 2022, 121:1-25.

Aquarion's SERP currently covers three active participants hired prior to 2009 and eight retired employees that are eligible for the benefit. Aquarion Interrog. Resp. RRU-3; OCC-68. The purpose of SERP is to provide a two-pronged benefit⁶⁷ to eligible

⁶⁷ SERP allows an employee to contribute pre-tax dollars in excess of IRS Limits (savings benefit) and allows the employee to receive a credit for compensation in excess of the IRS Limits (pension benefit). Aquarion Interrog. Resp. OCC-67.

executives whose compensation exceeds the maximum level allowed⁶⁸ (IRS Limits) by the Internal Revenue Service (IRS) for consideration under Defined Benefit and 401k pension plans (jointly, Qualified Plan), which are both qualified retirement plans. Aquarion Interrog. Resp. OCC-67, OCC-69. Thus, if an executive's compensation exceeds the IRS Limits (which are indexed annually), then no benefit may be earned under the Qualified Plan. Aquarion Interrog. Resp. OCC-67. The SERP is an employer benefit that relates only to the compensation exceeding the IRS limits. Id.

OCC recommends that the Authority continue with its past precedent of disallowing both the Defined Benefit and 401k SERP expenses given that these expenses relate to the portion of salary of a few highly compensated executives whose salary exceeds the IRS salary limits for qualified pension plans.⁶⁹ Defever PFT, pp. 15-16.

Based on the evidence in the record, the Authority finds no reason to revise PURA's past precedent to instead allow this expense for customer ratemaking purposes. The SERP expense accrues to a few select executives and relates only to the portion of employee salary that exceeds IRS Limits for Qualified Plans. Therefore, the IRS Limits prevent a high earning employee from earning a pension benefit on the portion of their salary that exceeds the limit; thus, that portion of an employee's salary is essentially considered excessive for ratemaking purposes. Accordingly, the Authority denies in total Aquarion's SERP expense of \$401,010 (\$360,651+13,746+\$26,613).

Moreover, the Authority is deeply concerned by the Company's convoluted presentation of the SERP expense through the course of this proceeding. It appears that the Company's initial Application only presented a small portion of SERP expense for Authority review. See Application, Sch. WPC-3.25. The Company buried the greater portion of the SERP expense in the Management Fee section of the Application, which had to be ferreted out by Authority staff. See Application, Sch. C-3.28. This led to much delay and confusion in the record as to what the Company was actually proposing to recover.

Furthermore, the Authority finds that there were other instances where the Company included pro forma O&M benefits-related expenses for ratemaking purposes but did not include separate schedules in the Application. Specific examples include the defined benefit pension plan expense, post-retirement health care benefit, and 401k pension expense. Accordingly, in future rate amendment applications, the Authority directs the Company to provide a separate schedule for each O&M expense item included in the Test Year and for pro forma ratemaking purposes in the Rate Year. In addition, the Authority directs the Company to provide, in future rate amendment applications, a

⁶⁸ The 2023 IRS Limits are \$265,000 for the qualified defined benefit plan and 401k plan. OCC Interrog. Resp. RRU-445. Furthermore, the 401k plan limits employee contributions and employer match to the lesser of 100% of compensation or \$66,000 for 2023. OCC Interrog. Resp. RRU-446; Tr., Nov. 29, 2022, 522:1-9 and 527:1-20.

⁶⁹ OCC's disallowance initially identified only the \$13,746 for the defined benefit portion of the SERP and \$97,728 (later corrected to \$26,613) for the 401k portion of the SERP that were not included in the management fee. Defever PFT, pp. 15 and 16; Final Late Filed Ex. 1, Sch. 3.19(2) and 3.28; Late Filed Ex. 29 and 30; Late Filed Ex. 30 Suppl. (Dec. 16, 2022); Tr. Dec. 14, 2022, 121:1-25.

separate schedule for the SERP expense that provides a detailed breakdown of the actual amount of SERP expense proposed, both direct and allocated.

7. Purchases

a. Fuel or Power Purchased for Pumping

The Company initially identified a total Test Year power purchase expense of \$7,015,184. Application, Sch. C-3.19(2). The Company proposed pro forma inflation adjustments for a small portion of the Test Year power purchase expense because the majority of the Company's power is procured through multi-year contracts that extend through December 2023 and would remain fixed. Aquarion Interrog. Resp. OCC-221; Tr., Nov. 28, 2022, 330:14-18. Specifically, the Company applied the 10.625% inflation factor to \$490,936 of "other" non-electric expenses, resulting in a pro forma increase of \$52,161. Aquarion Interrog. Resp. OCC-221; Application, Sch. C-3.19. The total proposed pro forma expense was, therefore, \$7,067,345 (\$7,015,184+ \$52,161). Id.

During the proceeding, Company stated that standard service rates for Eversource and United Illuminating were set to increase on January 1, 2023. Tr., Nov. 28, 2022, 330:14-25. Subsequently, the Company revised the Test Year amount to \$6,689,504 and requested a proposed adjustment of \$722,379 for the power purchase expense to reflect the new standard service electric generating prices going into effect January 1, 2023. Final Late Filed Ex. 1, Sch. C-3.0 A Adj, C-3.29.

Eighty percent of the Company's power is procured through a multi-year contract. Tr., Dec. 14, 2022, 70:16-21. According to the Company, its power consumption profile is attractive to bidders. Tr., Dec. 14, 2022, 70:21-23. The remaining 20%, which is power for the Company's smaller systems, is procured through standard service. Tr., 70:24-71:3.

The proposed adjustment of \$722,379 is primarily the result of the standard service generation rates increasing by approximately 200% - 300%. Tr., Nov. 28, 2022, 330:20-26; Final Late Filed Ex. 1, Sch. C-3.29(2) (e.g., UI rate increasing from \$0.7934 to \$0.2097). However, there are two reasons that prevent the Authority from finding that the \$722,379 adjustment constitutes a known and measurable change.

First, the standard service electric rate changes every six months, on January 1 and July 1 of each year. For this matter, the Rate Year commences in March 2023. Different (and possibly lower) standard service rates will go into effect in July 2023 and January 2024. Therefore, the standard service rates identified by the Company will only be in effect for a small portion of the Rate Year, but the proposed adjustment assumes, without any evidentiary basis, that the January 1, 2023 rates will be in effect during the entirety of the rate year. This assumption is improper, and the Authority is unable to conclude that the proposed adjustment reflects known costs.

Second, the Company could (and, in the current retail electric market, should) procure the non-fixed 20% portion of its electric portfolio in the competitive supplier

market. Surprisingly, the Company acknowledged that it was not aware of the retail market. Tr., Dec. 14, 2022, 89:15-16 (Mr. Ulrich: “I’m not sure what the rate board is.”). Further, the Company misunderstands standard service rates, believing that “Eversource and UI roll us back and forth to what is the most attractive rate” Tr., 89:23-25. This is simply not true and exposes the Company (and ratepayers) to paying unnecessarily high electric rates. The Authority notes that retail electric rates well below standard service rates are and have been available to customers in the competitive market. Participating in the retail market requires a level of sophistication to obtain the best rates; however, a commercial customer like Aquarion should have the requisite capacity. Consequently, the Company has not shown that using the standard service rates for this portion of its energy portfolio reflects prudent or efficient management of this expense category.

Consequently, the Authority finds that the proposed pro forma adjustment of \$722,379 for the increase in standard service rates on January 1, 2023, does not constitute a known and measurable cost nor reflect prudent management of the Company’s energy cost. As such, the pro forma power purchase expense will be reduced by \$722,379.

b. Chemicals

The Company initially requested recovery of \$5,446,444 in chemical expenses, which represents an increase of \$1,375,420 to the Test Year amount of \$4,071,025. Application, Sch. C-3.4. Subsequently, the Company submitted an updated chemical expense of \$8,595,730, which represents an increase of \$4,524,706 to the Test Year amount. Aquarion Interrog. Resp. OCC-136, Att. 1; Final Late Filed Ex. 1, Sch. C-3.4.

Below is a table indicating the Company’s actual chemical expense over a five-year period. Aquarion Interrog. Resp. OCC-136, Att. 1.


Table 22: Annual Chemical Expenses

Year	Cost	Change
2017	\$3,276,584	
2018	\$4,253,537	29.8%
2019	\$4,014,018	-5.6%
2020	\$4,005,415	-0.2%
2021	\$4,071,025	1.6%
Pro forma (initial)	\$5,446,444	33.8%
Pro forma (final)	\$8,595,730	111.1%

The Company’s chemical expenses between 2017 and 2021 were largely unchanged, with the Test Year amount of \$4,071,025 statistically identical to the expenses in 2018 and 2019. Given this uniformity of cost, the Authority finds the Test Year amount represents an accurate quantification of the Company’s annual chemical expense.

The issue, then, is whether there are known and measurable changes that warrant a pro forma adjustment to the Test Year chemical expense. Notably, the Company requests a 111% increase in the Test Year expense — more than doubling a cost that has remained static for the five previous years. The chart below illustrates the substantial increase in the pro forma expense (indicated as 2022) from the historical expenses.

Figure 3: Historical and Pro Forma Chemical Expense

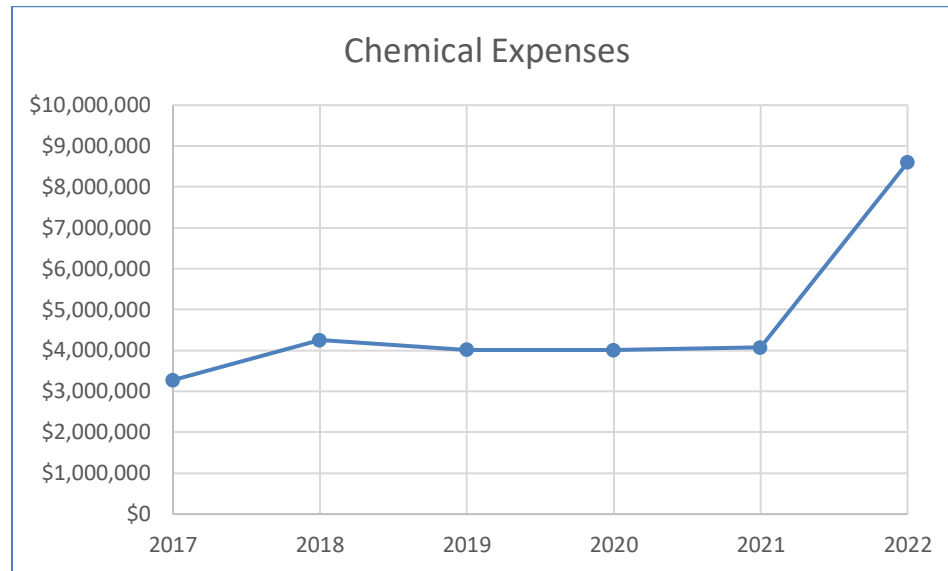

The \$1,375,420 adjustment to the Test Year amount initially proposed by the Company appears to reflect fourth quarter 2022 costs based upon competitive bids conducted in October 2021 for 2022 contracts. Aquarion Interrog. Resp. OCC-136, OCC-235, and OCC-236. As such, this adjustment reflects actual pricing that is known and measurable.

By contrast, the revised pro forma adjustment of \$4,524,706 is based on estimates from several vendors. Aquarion Interrog. Resp. OCC-136 (“In August 2022, Aquarion contacted several chemical vendors and requested budgetary price forecasts for next year.”). A review of evidence provided by the Company indicates that the price forecasts are not particularly precise. Among other things, the correspondence include statements such as “Budgetary 2023 number only . . . future pricing will depend on market”; “Given the volatility in the market, we are unable to quote and hold a price for the year . . .”; “With the market being so unpredictable, we are not even getting much of an outlook from our suppliers for more than 90 days.”; and “whatever info we share is speculative” Aquarion Interrog. Resp. OCC-237, Att. 2, 4, 5, and 11. The evidence indicates that the chemical market is volatile and that various disruptions in the markets have created a high degree of unpredictability. *Id.* However, the mere anticipation of a price increase is inadequate. Given the “speculative” nature of these forecasts, there is insufficient evidence to conclude that a 111% increase in chemical costs is known and measurable.

Accordingly, the Authority will adjust the Test Year amount of \$4,071,025 for known and measurable costs of \$1,375,420, resulting in a reduction in the Company's pro forma chemical expense of \$3,149,286.⁷⁰

8. Eversource Merger

a. Merger Costs

The Authority denies recovery of Aquarion's share of the costs associated with the Company's merger with Eversource.⁷¹ In the Merger Decision, the Authority stated that "Eversource will only recover transaction costs to the extent savings from [the Merger] exceed costs as adjudicated in future rate cases." Merger Decision, p. 13. The Authority further conditioned recovery on such request being submitted in a rate proceeding within a seven-year timeframe from the closing date of the transaction, *Id.*, which the Company purports to do here; however, Aquarion failed to substantiate its burden. Accordingly, the Authority denies recovery of Aquarion's share of the merger costs.

The Company requests recovery of \$4.9 million (Aquarion Merger Costs) out of approximately \$5.3 million in total merger costs, as Aquarion's share of the merger costs.⁷² Szabo & Unger PFT, p. 42. Rather than recover the Aquarion Merger Costs from customers all in one year, the Company proposes to amortize the costs over 10 years, which results in a pro forma adjustment expense of \$483,753 for the Test Year. *Id.*; Final Late Filed Ex. 1, Sch. WPC-3.13. The Company asserts that the savings it experienced as a result of the merger exceed the amount of the Aquarion Merger Costs. Szabo & Unger PFT, p. 44. The table below provides a breakdown of the total merger costs, including the Aquarion Merger Costs.

⁷⁰ While the Company is permitted to recover this expense, as discussed in Section IV.E. Working Capital, the Authority will adjust the Company's cash working capital by removing chemical expenses from the lead/lag study. The Company improperly included chemical expenses in both its cash working capital calculation and in its rate base inventory, leading to a double recovery of the chemical expense. OCC Brief, p. 27.

⁷¹ The Authority approved the merger of Aquarion and Eversource in 2017. See Merger Decision.

⁷² The total amount of Eversource's merger costs is \$5.3 million. Aquarion Interrog. Resp. Suppl. RRU-413. By contrast, for the Kelda/Yorkshire Water's (Kelda) acquisition of Aquarion in 2000, and the Macquarie Utilities acquisition of Aquarion from Kelda in 2006, the Company stated that "[t]here were not transaction costs requested or permitted related to the two acquisitions of Aquarion prior to Eversource." Late Filed Ex. 50.

Table 23: Aquarion's Share of the Merger Costs

Category	Costs
Investment Banker	\$3,017,000
Legal Services	\$1,417,128
Other Outside Services	\$717,287
Application approval fees	\$125,000
Environmental Outside Services	\$27,177
Printing services for customer bill inserts	\$9,486
Other	\$1,581
Total	\$5,314,659
Costs allocated to AWC MA	(\$163,679)
Costs recovered in AWC NH rate case	(\$249,671)
Costs allocated to non-utility	(63,776)
Aquarion's Total Share of Merger Costs	\$4,837,534

Final Late Filed Ex. 1, Sch. C-3.13.

b. Claimed Merger Savings

The Authority finds that Aquarion has failed to provide evidence demonstrating savings as a result of the merger.

The Company asserts it achieved net savings in the amount of \$2,563,000 annually (Merger Savings) as a result of the merger and, therefore, argues that the Authority should approve recovery of the Aquarion Merger Costs. Late Filed Ex. 44. According to the Company, the Merger Savings are the result of specific cost reduction initiatives undertaken by management personnel in the following five areas, with savings quantified through the comparison of pre-merger cost levels to current cost levels: employee benefit costs (medical insurance); consolidation of corporate insurance policies; legal costs provided by Eversource's in-house counsel, which Aquarion previously out-sourced at a higher cost; migrating the Company's external auditor to Eversource's auditor; and engaging Eversource's internal auditor to provide internal audit reviews, which were performed pre-merger by an external auditor. Szabo & Unger PFT, pp. 39-40. Aquarion asserts that it also achieved costs savings in other areas, such as procurement and fleet vehicles, but is unable to discretely identify and quantify these savings as direct benefits to customers; therefore, they are not included in the claimed Merger Savings. *Id.* The table below provides a breakdown of those claimed annual savings as a result of the merger, followed by the Authority's analysis with respect to each category.

Table 24: Aquarion's Claimed Annual Merger Savings

Category	Savings
Medical Insurance	\$1,571,000
Other Insurance	\$548,000
Long-Term Debt	\$161,000
Rating Agency	\$99,000
Audit – internal	\$108,000
Legal	\$76,000
Total	\$ 2,563,000

Late Filed Ex. 44.

The Company claims it saved \$1,571,000 in employee medical insurance costs as a result of the Merger. Szabo & Unger PFT, p. 40; Late Filed Ex. 44, Att. 2 (supplementing Interrog. Resp. RRU-185). Prior to the Merger, the Company routinely solicited requests for proposals for medical insurance but elected to self-insure because a fully insured plan from a third-party provider was not financially viable for the Company to purchase on its own. Szabo & Unger PFT, p. 40; Tr., Nov. 30, 2022, 792:17-793:1. In 2020, however, the Company states that CIGNA, a previous insurer for Eversource, offered Aquarion medical insurance for \$7,723,000, which the Company asserts is \$1,571,000 less than the Company's self-insurance plan. Szabo & Unger PFT, p. 40.

While the Company asserts it experienced costs savings in employee medical insurance as a result of the merger, Aquarion did not provide any evidence with which to support that assertion. Specifically, when asked how CIGNA's bids compared with bids received prior to the merger, Aquarion responded that it does not have any analysis related to marketing done for fully insured medical plans pre-merger as the Company switched vendors and did not retain any physical reports. Late Filed Ex. 43. Accordingly, the Authority finds that the Company did not produce evidence to support its claim that Aquarion experienced cost savings in medical insurance after the merger or, if it did experience any costs savings, that the merger was directly responsible for the cost savings.

The Company also asserts it experienced \$548,000 in costs savings with respect to other types of non-medical insurance, including property insurance, auto liability, excess liability, and workers compensation. Szabo & Unger PFT, p. 42; Late Filed Ex. 44, Att. 2. When the Authority requested evidence to support the claimed savings, the Company stated that it did not have any quotes, but rather based the claimed savings on Aquarion's "experience of what the policy premium was prior to the merger and the impact of consolidating policies [post] merger. Tr., Nov. 30, 2022, 800:8-21. While the Company did provide a spreadsheet showing a calculation of insurance savings, Late Filed Ex. 44, Att. 2, the corresponding narrative failed to include an explanation of or evidence for the various inputs and assumptions in the spreadsheet. Accordingly, the Authority finds that the Company did not produce sufficient evidence to support its claim that it experienced

savings in non-medical insurance costs after the merger or that, if it did experience any costs savings, the merger was directly responsible for the cost savings.

The Company indicated that the merger resulted in approximately \$260,000 related to debt costs and rating agency fees. Late Filed Ex. 44, Att. 2; Szabo & Unger PFT, pp. 41-42. As with the other purported merger savings, the Company relies on a cursory description of the savings and a tabulation based on unknown and unexplained assumptions. Consequently, there is insufficient evidence in the record to support a finding that these savings will accrue.

The Company asserts it saved \$76,000 annually in legal costs as a result of the merger. Late Filed Ex. 44, Att. 2; Tr., Nov. 30, 2022, 805:22-806:3. However, the general explanations provided by the Company and the submitted spreadsheet comparing external and internal legal costs for 2021 are insufficient to support a finding that the Company has been or will be saving \$76,000 per year in legal costs. Among other things, there is no explanation as to why 2021 is representative of average legal costs; nor is there evidence supporting the assigned hourly rates of external or internal counsel. Accordingly, the Authority denies the Company's \$76,000 in claimed savings in legal costs and removes it from overall claimed Merger Savings.

Lastly, the Company asserts it saved \$108,000 by migrating Aquarion's external auditor to Eversource's auditor and by engaging Eversource's internal auditor to provide internal audit reviews, which were performed pre-merger by an external auditor. Szabo & Unger PFT, pp. 39-40; Aquarion Interrog. Resp. RRU-185, Att. 1, Supp. The general explanations provided by the Company along with a spreadsheet purporting to show audit savings is insufficient to support a finding that the Company has been or will be saving \$108,000 per year, as neither provide actual evidence of savings. Among other things, while Eversource is now performing some of the audit services, there is no indication as to how much the Company is paying Eversource for such services through allocated costs or the Management Fee. Accordingly, the Authority denies the Company's \$108,000 in claimed savings in audit costs and removes it from overall claimed Merger Savings.

Based on the evidence in the record, or rather the lack thereof, the Authority finds the Company has not demonstrated its claimed Merger Savings.⁷³

c. Benefits of the Merger to Aquarion and Eversource Shareholders

The Authority finds that the merger benefitted Aquarion, Eversource, and their shareholders, not the Aquarion ratepayers. Specifically, any savings that did accrue to

⁷³ As noted by OCC, in other merger and acquisition proceedings of financially viable companies, the companies have either not requested, or the Authority has not allowed, recovery of transactions costs. OCC Brief, p. 51; see Decision, Nov. 10, 2010, Docket No. 10-07-09, Joint Application of UIL Holdings Corporation and Iberdrola USA, Inc. for Approval of a Change of Control of Connecticut Natural Gas Corporation and The Southern Connecticut Gas Company, p. 26. ("The Department's position remains that any goodwill or acquisition adjustment and other acquisition related expenses resulting from an acquisition or a merger of a public service company will not be recorded as reductions to income for regulatory accounting purpose nor included in rates charged to customers.")

the Company by virtue of the merger also likely increased the earnings of Aquarion, which is a benefit to the Aquarion shareholders, not its ratepayers. For example, prior to the merger in 2017, Aquarion's earned ROE was 8.35%, whereas in 2018, 2019, and 2020, the Company's realized ROE was 9.44%, 8.81%, and 8.68%, respectively. Aquarion Interrog. Resp. RRU-58. When asked about the increase in Aquarion's ROE in the years following the merger, the Company stated that it was "certainly reasonable to think that some of the increase is due to synergy, but I would also think there is a lot of variables, a lot of pieces that may have led to that increase." Tr., Nov. 30, 2022, 818:1-5. The Company also agreed that in the absence of the merger, Aquarion's earned ROE would likely have been lower.⁷⁴ Tr., 819:1-5. Accordingly, the Authority finds that the increase in Aquarion's ROE was reasonably attributable to the merger and, thus, the merger benefitted Aquarion and its shareholders through increased earnings, not the Company's ratepayers.

Additionally, the Authority finds the merger benefitted Eversource and its shareholders in other ways too. In communications with its Board of Trustees, Eversource states that it viewed the acquisition of Aquarion as a "unique investment opportunity" that "provides entrance into a new, regulated utility segment and a platform for future growth." Aquarion Interrog. Resp. RRU-416, Att. 1, p. 5. The merger also furthered Eversource's strategic plan to expand into the regional water utility realm. Aquarion Interrog. Resp. RRU-416, Att. 1, p. 12; Tr., Nov. 20, 2022, 814:15-816:1, 816:4-19. Accordingly, since Eversource's acquisition of Aquarion furthered Eversource's growth strategy, to the benefit of Eversource and its shareholders, Aquarion ratepayers should not have to pay for the Company's share of Eversource's acquisition costs.

In addition, the merger benefitted Eversource as it was the most advantageous use of the proceeds from Eversource's sale of generation assets in New Hampshire as the merger would provide \$0.07 in EPS in the first year. Aquarion Interrog. Resp. RRU-416, Att. 1, p. 5; Tr., Nov. 30, 2022, 813:19-24. From an EPS perspective, Eversource's investment banking advisory firm stated in its market value opinion of the merger that acquiring Aquarion is accretive compared to the alternative use of the proceeds to pay down debt, but is dilutive to EPS when compared to using the proceeds to buy back shares. Aquarion Interrog. Resp. RRU-416, Att. 1, p. 5; Tr., 813:9-13. The Company testified, therefore, that the long-term prospects of purchasing Aquarion were more favorable to Eversource than the other two options under consideration. Tr., 813:14-18. Accordingly, the acquisition of Aquarion benefitted Eversource and its shareholders, not the Aquarion ratepayers.

Lastly, the Aquarion ratepayers likely already paid for the Aquarion Merger Costs, at least in part, by paying the salaries of the Company's employees who worked on the

⁷⁴ The Company states that as a result of the higher ROEs, it avoided coming in for a rate case sooner, which it asserts benefitted ratepayers. Tr., 819:25-820:1. The Company did, however, acknowledge that it continued to pursue a WICA surcharge increase during those intervening years. Tr., 820:5-8. Further, as discussed supra in Section III.B.2. Multi-Year Rate Plan, the Authority has previously articulated that a rate case deferral may not necessarily be to the benefit of ratepayers. See 2022 Decision, p. 11.

merger. Since, however, Aquarion employees do not track their time spent on acquisitions, including the merger at issue here, there is no way to quantify these costs. Aquarion Interrog. Resp. RRU-415; Tr., Dec. 1, 2022, 855:14-22, 855:23-856:7, 863:1-7. The Authority finds this practice to be unacceptable, and thus directs the Company to track all employee time spent on future acquisitions, including mergers. As an addendum to the Company's next rate case filing, the Company shall append an unlocked, workable Excel spreadsheet that details the requested information for each year between 2023 and the test year proposed in the next rate proceeding.

9. Inflation Adjustment

a. Inflation Rate

The Company requests a 12.150% inflation factor. Final Late Filed Ex. 1, Sch. WPC 3.19. According to Aquarion, the 12.150% inflation factor is based upon its adoption and application of the methodology (2021 CWC Rate Case Methodology) used in the 2021 CWC Rate Case Decision. Szabo & Unger PFT, pp. 33, 34.

Initially, the Company used the 2021 CWC Rate Case Methodology to calculate a composite factor and calculated a proposed composite inflation factor of 10.625%. *Id.*, p. 34. The Company used the Gross Domestic Product Price Index (GDP-PI) from the Blue Chip Financial Forecast, Vol. 41, No. 4 (BCFF), dated April 29, 2022, to calculate the composite. *Id.* The Company subsequently revised the inflation factor based upon an updated BCFF dated November 1, 2022 (Aquarion Methodology). Late Filed Ex. 19.

The Aquarion Methodology develops a GDP-PI composite inflation factor that spans nine financial quarters – the period from the mid-point of the Test Year through and including the mid-point of the Rate Year (*i.e.*, Q3 2021 through Q4 2023). *Id.*, Atts. 1 and 2. Essentially, the Company summed up nine quarterly GDP-PI inflation factors to arrive at the 12.150% proposal.

The Authority subsequently requested that the Company update Aquarion's proposed inflation factor using the methodology approved in the 2013 Decision. Tr., Nov. 28, 2022, 410:19-411:12. The methodology from the 2013 Decision also uses the GDP-PI inflation factor but instead computes a percentage change of inflation from the mid-point of the Test Year to the mid-point of the Rate Year (*i.e.*, compares Q2 and Q3 2021 with Q1 and Q2 2023).⁷⁵ The application of the 2013 Decision methodology to today's GDP-PI inflation figures results in an inflation factor of 6.814%. Late Filed Ex. 19, Suppl. Att. 1; Tr., Dec. 14, 2022, 74: 21-25; 77:20-25 and 78:1-6:

OCC recommends denying all proposed inflation based upon its assessment that the Company was applying inflation to O&M expenses that do not consistently increase. Defever PFT, pp. 7-8. OCC did not, however, take a position as to the validity of the method used to compute the proposed inflation rate. OCC Interrog. Resp. RRU-442, RRU-443, and RRU-444; Tr., Nov. 28, 2022, 450:20-25, 451:1-12.

⁷⁵ The source of this data is the US Bureau of Economic Analysis (BEA) and Moody's Analytics Forecasts. Late Filed Ex. 19, Suppl. Att. 1.

The Authority rejects the Company's proposed 12.150% inflation factor derived from Aquarion's modified application of the 2021 CWC Rate Case Methodology. The Authority finds the approach is flawed because it incorrectly provides for inflation to accrue during the interim regulatory lag period dating from the first quarter of 2022 through the first quarter of 2023. Instead, the Authority finds the simple percentage change methodology used in the 2013 Decision to be appropriate for ratemaking purposes. Accordingly, the Authority adopts a 6.814% inflation rate, as the methodology is consistent with the 2013 Decision methodology, and because the accrual of inflation during the interim regulatory lag period is inappropriate for ratemaking purposes.

b. Inflation Expense Items

The Company requests recovery of an inflation adjusted expense of \$3,191,826. Final Late Filed Ex. 1, Sch. WPC-3.19.

The Authority determines that the Company included expenses in Aquarion's calculation that should not be increased for inflation. Specifically, the Authority determines that \$557,172 of the \$21,652,752 inflation adjusted expenses (\$21,091,735 + \$561,017 Valley) should not be adjusted for inflation. The \$557,172 consists of disallowed expenses for membership dues (\$270,712), conference (\$20,512), and communications expense (\$265,948), which are disallowed for reasons discussed in subsequent sections. Accordingly, the Authority adjusts the expenses subject to inflation downward by \$557,172 to \$21,095,580.

Further, based upon the adopted inflation rate of 6.814%, the total inflation expense is reduced from \$3,191,826 to \$1,997,626. Therefore, the Authority reduces the Company's requested inflation adjusted expense by \$1,194,200. Accordingly, the Authority allows the recovery of an inflation adjusted expense of \$1,997,626 (\$3,191,826 - \$1,194,200). The table below summarizes the changes to the inflation calculation and expense reduction.

Table 25: Approved Changes to the Inflation Calculation and Expense Reduction

Company's proposed inflation adjustment for eligible items	\$21,652,752
Expenses not subject to inflation adjustment.	(\$557,172)
Items eligible for inflation adjustment	\$21,095,580
Allowed Inflation Rate	6.81%
Inflation Adjustment for Aquarion	\$1,436,609
Valley Jan.-Nov. 2022 unadjusted expenses	\$561,017
Subtotal Inflation Expense	\$1,997,626
Company's Proposed Inflation Expense	\$3,191,826
Inflation Expense Adjustment	\$1,194,200

10. Administrative and General Costs

a. Industry and Non-Industry Dues

The Company requests recovery for \$210,750 in industry membership dues and \$89,962 in non-industry membership dues, for a total of \$300,712. Late Filed Ex. 34, pp. 1-2.

To support a prudency determination for the industry membership dues, the Company provided a dues schedule depicting the amount paid to each industry organization, invoices, and a general explanation of possible benefits the membership dues provide to Aquarion and its customers. Aquarion Interrog. Resp. OCC-19; Late Filed Ex. 34, Att. 1. When asked to quantify the benefit of the industry dues to ratepayers, however, the Company witness stated: "I don't know that I'm able to put a dollar figure on it because [I am not able to] quantify what would be the cost of not providing this...." Tr., Nov 29, 2022, 563:7-10. Additionally, a portion of the industry membership dues of at least one of the organizations "were for expenditures paid or incurred in connection with lobbying activities," for which the Company itself has no expense. Aquarion Interrog. Resp. OCC-19.

Similarly, to support a prudency determination for the non-industry membership dues, which include dues to chambers of commerce and business organizations, the Company provided a dues schedule depicting the amount paid to each organization and invoices. Aquarion Interrog. Resp. OCC-20; Late Filed Ex. 34, Att. 2.⁷⁶ The Company also stated that the non-industry organizations "work to engage and promote overall economic growth and development in the communities that they serve and in which [Aquarion] serves....," which Aquarion asserts benefits customers. Aquarion Interrog. Resp. OCC-20. While economic growth and development benefits Aquarion and its shareholders through increased growth, it is unclear how it benefits ratepayers. In addition, when asked to quantify the benefit of the non-industry dues to ratepayers, the Company witness stated: "I'm not able to quantify what the cost would be or detriment to a customer if we didn't engage in these activities. These are organizations that are in our service territories that the company supports, that our customers engage in as well." Tr., Nov. 29, 2022, 564:11-15. Accordingly, the membership dues paid to chambers of commerce and business organizations provide little, if any, benefit to ratepayers and are not needed for the Company's provision of water service.

Therefore, the Authority finds that the Company failed to demonstrate that memberships in these industry and non-industry organizations provide a quantifiable benefit, if any, to the ratepayers. Accordingly, the Authority disallows recovery of 100%, or \$300,712, of the Company's requested industry and non-industry membership dues from ratepayers. The Authority does not prohibit the Company from engaging in such activities, but rather directs the Company's shareholders to bear these costs should the shareholders support such continued engagements.

⁷⁶ One of the non-industry membership dues invoices is an invoice requesting a \$7,500 contribution for an employee's corporate membership in the Housatonic Valley Association. Late Filed Ex. 34, Att. 2, p. 5.

b. Charitable Donations

The Company requests recovery of \$81,491 in civic and community related activity expenses (Charitable Donations). Aquarion Interrog. Resp. OCC-11. This amount includes the \$73,644 Test Year amount plus an inflation adjustment. Id.; Application, Sch. G-2.9.

The Authority finds that the Company failed to demonstrate that the Charitable Donations benefit ratepayers. For example, when asked how ratepayers benefit from donations to the Beardsley Zoo, the Company testified that it believes in supporting non-profits in Aquarion's service area. Tr., Nov. 28, 2022, 414:5-11. The Company also conceded, however, that it is ratepayers, not the Company or its shareholders, who are paying for the donations. Tr., 414:12-17. In addition, when asked about the Company's internal review process for providing such donations, the Company stated that approval for donations under \$1,000 is not required as long as the donations fall within the approved operating budget. Tr., Dec. 14, 2022, 137:18-138:6; Tr. Dec. 15, 2022, 6:5-9. Further, the Authority has historically disallowed recovery of charitable donations in the Company's previous rate cases. 2013 Decision, p. 51; Decision, Sept. 8, 2010, Docket No. 10-02-13, Application of Aquarion Water Company of Connecticut for Amended Water Service Rate Schedules, p. 69; Decision, Dec. 12, 2007, Docket No. 07-05-19, Application of Aquarion Water Company of Connecticut for Amended Water Service Rate Schedules, p. 56.

Accordingly, the Authority denies recovery of the \$81,491 Charitable Donations expenses, as well as the inflation adjustment associated with such expenses, from ratepayers. The Authority does not prohibit the Company from engaging in such activities, but rather directs the Company's shareholders to bear these costs should the shareholders support such continued donations.

c. Directors and Officers Liability Insurance

The Company requests recovery of the Company's share of the \$35,936 policy for Directors and Officers Liability insurance (DOL Insurance) maintained by Eversource, which Aquarion includes as part of the corporate expenses for the Test Year. Final Late Filed Ex. 1, Sch. C-3.28. The \$35,936 represents Aquarion's share of Eversource's DOL Insurance costs, which is then allocated to Aquarion Water Company of Connecticut at 85.64% based on the MASS Formula. Id.; Aquarion Interrog. Resp. OCC-18. The Company does not carry separate DOL Insurance. Aquarion Interrog. Resp. OCC-18.

The Authority denies recovery of the Company's share of the \$35,936 policy for DOL Insurance because it is the directors and officers who are protected by and benefit from the DOL Insurance, not the ratepayers. Aquarion's shareholders, who are the ones who typically bring the cases against the officers and directors, also benefit from the DOL Insurance if the shareholders win their case and receive a payout from the insurance. Accordingly, the Authority denies recovery of 100% of Aquarion's allocated portion of DOL Insurance expense, or \$31,097 ($35,936 \times 85.64\%$), as the Company's ratepayers are not

the beneficiaries of the DOL Insurance; rather, the direct beneficiaries are Aquarion's officers, directors, and shareholders.⁷⁷

d. Rate Case Costs

The Company requests recovery of \$1,050,320 in expenses related to this rate case. Final Late Filed Ex. 1, Sch. WPC-3.12. The Company is proposing to recover the costs over a period of five years, which results in an amortization expense of \$210,064 per year. *Id.* In cases of expenditures that inure to the benefit of both ratepayers and shareholders, the Company must demonstrate that the cost sought to be recovered were incurred for the benefit of ratepayers.

As part of the rate case expense, the Company includes \$250,000 for PURA and OCC consultants. *Id.* The retention of these consultants benefits ratepayers and is, therefore, recoverable. The Company also seeks recovery of transcript preparation (\$35,000), administrative costs (\$125,000) and Cost of Service/Rate Design costs (\$69,000). The Company did not provide direct evidence that these costs benefit ratepayers; however, the Authority will split these \$229,000 of costs equally and allow recovery of \$114,500 from ratepayers in this instance barring further legislative direction. Finally, the Company has allocated \$390,000 for outside legal costs, \$104,360 for its Cost of Equity consultant, and \$76,960 for its depreciation consultant. Again, the Company did not provide any direct evidence that these costs were prudent or benefitted ratepayers. Further, these consultants and lawyers represented and advocated for the positions of Company and its shareholders during the proceeding. As such, the Authority denies the recovery of these \$571,320 in costs because they have not been shown to provide a benefit to ratepayers.

In sum, the Authority will allow recovery of \$364,500 (\$250,000 + \$114,500) in rate case expenses from ratepayers. As a result, the annual amortization for rate case expenses to be recovered from ratepayers is \$72,900. [\$364,500 / 5 years]. This equates to a reduction of \$137,164.

11. Conservation

a. Non-Revenue Water

Non-revenue water (NRW) is the difference between the volume of water produced or purchased by a company's water system and the volume of water delivered to its customers. Aquarion Interrog. Resp. OCC-85; Tr., Nov. 20, 2022, 686:25-687:8. NRW losses may be due to theft and illegal connections, water used at unmetered connections, fire hydrant usage, overflowing tanks, and water leakage within the distribution system. Tr., 689:1-20. A company can reduce NRW by implementing leakage management techniques, carrying out main replacement programs, and calibrating all large production meters on an annual basis. *Id.*

⁷⁷ Both OCC and OAG recommend denial of recovery of at least 75% of DOL Insurance expense. OCC Brief, p. 44; OAG Brief, p. 14.

At a minimum, 85% of the water produced by a water system should be used to supply water to its customers. Therefore, a water system should not have more than 15% of NRW, which is the guideline recommended by the National Association of Regulatory Utility Commissioners (NARUC). Tr., Nov. 30, 2022, 691:16-692:1. All water companies should continue to initiate supply and demand management techniques to curtail high NRW levels. When a company has more than 15% NRW loss within the system, the Authority recommends that the company investigate various ways to reduce the operating cost associated with the power and chemicals required to supply the water, including the NRW.

Separate but related is the concept of unaccounted for water (UAW), which put simply is the water that cannot be accounted for; therefore, the Company discounts the NRW amount slightly given that some sources of NRW are identifiable. Tr., Nov. 30, 2022; 687:9-11. In other words, UAW is the difference between the NRW and the Company's water usage, such as flushing hydrants, flushing of the water mains, water main breaks, and any other Company water usage of the system. Aquarion Interrog. Resp. RRU-139; Tr., 687:11-22. The Company has some control over the amount of its UAW. Tr., 689: 9-15. For example, when the Company flushes its mains or when a water main breaks, Aquarion is in control and can quantify the amount of water expended during those planned or unplanned events, but the Company does not have control over the actions of fire departments or landscapers that use fire hydrants. Tr., 689:1-15. To calculate the total amount of UAW, the Company subtracts from the amount of NRW the amount of UAW over which it has control. Tr., 689:11-18. For example, in 2021, Aquarion's NRW was 15.2%, but the Company knew about a main break and the approximate usage attributable to it, and thus discounted the NRW percentage resulting in 11.8%. Application, Sch. G-6.0; Tr., 690:4-18.

The Company has not performed any specific studies of the causes of NRW in its systems. Aquarion Interrog. Resp. OCC-85. In order to reduce its NRW, Aquarion did, however, purchase and install acoustic loggers in 2020 for \$774,000 as part of a pilot program. Ulrich Prefiled Test., Aug. 29, 2022, p. 20; Aquarion Interrog. Resp. RRU-117. As a result of installing loggers, Aquarion asserts it saved approximately \$126,000 in 2020, and \$44,000 in 2021, in cost of water production. Aquarion Interrog. Resp. RRU-117. The Company also performs leak surveys on an average of approximately 3,600 miles of main each year. Ulrich PFT, p. 18.

The Authority reviewed the impact that installing loggers has on reducing NRW and concludes that the loggers are a useful tool for leak detection, *in water deficient areas*. Although Connecticut experiences drought conditions, they are not chronic and if a drought occurs during warmer months, Connecticut usually recovers from drought conditions during cooler months. Moreover, loggers are just one of the tools used for water conservation and leak detection. Aquarion has other tools that can help to conserve water and reduce NRW, some of which are presented in the Company's water conservation plan (WCP). Application, Sch. H-3.0. As such, the Authority recommends that the Company review all options before making expensive investments, including the investment in loggers, moving forward. Specifically, as a prerequisite to cost recovery

associated with prospective logger investments, the Authority will require the Company to conduct a cost/benefit analysis of the installation of loggers compared to other leak detection tools or mitigation measures, and to submit the results of such analysis coincident with any rate amendment application through which associated cost recovery is sought.

The Company provided the five-year history of NRW and UAW for the Company as a whole, as well as for 13 of its water systems with annual production of over 20 million gallons (MG). Ulrich PFT, p. 14; Application, Sch. G-6.0. Over the past five years, the Company's systemwide NRW has ranged between a low of 13.79% (11.2 million gallons per day (MGD)) in 2016, up to a high of 19.3% (15.1 MGD) in 2019. Ulrich PFT, p. 14. Between 2019 and 2021, 48 water systems exceeded the 15% NRW threshold. Aquarion Interrog. Resp. RRU-125.

The Company's overall variable cost of production of NRW is \$420 per MG, which represents the average of the variable cost metric for 2019, 2020, and 2021. *Id.* Aquarion allocates the cost of production of NRW to all customer classes within the cost-of-service study according to their relative average water consumption. Aquarion Interrog. Resp. OCC-86.

For each of the Company's water systems, the Authority calculated a historical five-year average NRW using data for years 2017-2021, as well as the average water produced for these same years, finding a number of water systems to have exceeded the 15% NRW threshold based on averages derived for years 2017-2021. Based on these calculations, as detailed in the below table, the Company spent \$138,012 on the production of water above 15% of NRW. For many of the water systems in the following table, such as the Chimney Heights, Newtown, and Arlington Acres water systems, the Company acquired the systems and did not seek surcharges or CIAC from the customers to cover the costs to own and operate the systems. See, e.g., Decision, May 13, 2009, Docket No. 08-10-09, DPUC and DPH Joint Investigation into the Application of United Water Connecticut, Inc. to Acquire Assets of Bethel Consolidated Company, Inc.; Decision, Aug. 22, 2012, Docket No. 12-03-08, PURA and DPH Review of Joint Application of Aquarion Water Company of Connecticut, United Water Works, Inc. and United Water Connecticut, Inc. for Approval of a Change of Control of United Water Connecticut Inc. and Merger of United Water Connecticut Inc. into Aquarion Water Company of Connecticut; Decision, Jan. 30, 2019, Docket No. 17-08-10, PURA and DPH Review of the Application of the Aquarion Water Company of Connecticut and Arlington Homes, LLC, and Valleywood LLC for Aquarion Water Company of Connecticut to Acquire the Assets of the Arlington Acres and Pleasure Valley Systems. In addition, the Company does not plan to install advanced metering infrastructure (AMI), which would positively impact NRW and conservation efforts. Tr., Nov. 28, 2022, 284:3-8. Therefore, despite having ways in which to reduce NRW and its costs to customers, the Company has not done so. Accordingly, the Authority denies recovery of \$138,012.

Table 26: Calculation of the Cost Associated with NRW above 15%

Water System	NRW (%)			Production (MG)		Cost (\$/MG)	
	Total	Allowed	Excluded (2-3)	Total	Excluded (4x5)	Cost (\$/MG)	Reduced (6x7)
1	2	3	4	5	6	7	8
Greenwich	17.86	15	2.86	5,324.6	152.3	420	63,966
Simsbury	20.38	15	5.38	755.6	40.6	420	17,052
New Canaan	21.42	15	6.42	582	37.4	420	15,708
Mystic	17.68	15	2.68	479.6	12.9	420	5,418
Ridgefield	15.76	15	0.76	333.8	2.5	420	1,050
Newtown	28.74	15	13.74	229.2	31.5	420	13,230
Lakeville/ Salisbury	17.08	15	2.08	108	2.2	420	924
Woodbury	24.0	15	9	59	5.3	420	2,226
Chimney Heights	18.5	15	3.5	67.2	2.6	420	1,092
East Derby	16.88	15	1.88	50	0.9	420	378
Norfolk	32.88	15	17.88	31.4	5.6	420	2,352
Other < 20 MG	24.78	15	9.78	356	34.8	420	14,616
Grand Total					328.6	420	138,012

See Application, Sch. G-6.0; Aquarion Interrog. Resp. RRU-125.

b. Deferred Conservation Expense

The Company requests approval of its deferred conservation costs in the amount of \$2,996,101 to be amortized over six years. Aquarion Suppl. Interrog. Resp. OCC-151; Final Late Filed Ex. 1, Sch. C-3.18. The Authority authorized deferred regulatory asset treatment for any new conservation expenses approved in the July 6, 2016 Decision (Conservation Decision) in Docket No. 13-08-16, PURA Investigation of Water and Energy Conservation Programs Eligible for Costs Recovery during General Rate Cases,⁷⁸ and incurred prior to the company's next rate case, provided that the company "implements [such programs] and demonstrates that the expenses for such programs were reasonable and prudent." Conservation Decision, pp. 2-3 (emphasis added).⁷⁹

⁷⁸ The Authority initiated Docket No. 13-08-16 on its own motion pursuant to Section 2 of Public Act 13-78, An Act Concerning Water Infrastructure and Conservation, Municipal Reporting Requirements and Unpaid Utility Accounts at Multi-Family Dwellings (Public Act 13-78), which required PURA to identify water and energy conservation programs that would be eligible for recovery by any water company in a general rate case, provided that the company implements them and demonstrates that the expenses for such programs were reasonable and prudent. Public Act 13-78, § 2.

⁷⁹ The Authority allowed deferred regulatory asset treatment until a formal conservation expenditure budget is established in the Company's next rate case. Id., p. 3.

The Company's deferred conservation costs consist of: (1) communication costs, including costs incurred for television ads, radio spots, social media, print media, including its Water Watch bill insert, and its website; and (2) costs incurred for pilot programs in nine towns, education and irrigation consultants, and summer help to patrol during irrigation season. Ulrich PFT, pp. 22-24; Aquarion Interrog. Resp. OCC-93; Aquarion Suppl. Interrog. Resp. OCC-151; Late Filed Ex. 41. According to the Company, the objective of its conservation program is to "protect water resources" and "change people's behaviors to reduce overall demand, reduce the strain on the environment, on the amount of water that has to be withdrawn . . ." Tr., Dec. 1, 2022, 765:6-15.

To support its request, the Company provided invoices for conservation expenses being sought for deferred treatment. Aquarion Interrog. Resp. 130, Att. 1-5; Aquarion Suppl. Interrog. Resp. OCC-151. The Company did not, however, demonstrate that 100% of the expenses are reasonable and prudent.

When asked how it assesses the efficacy of its conservation program, Aquarion testified it compares the amount of usage in the current year with the amount of water usage in the five years prior to implementation of the program. Ulrich PFT, p. 25.; Tr., Nov. 30, 2022, 763:9-20. According to the Company, the average annual reduction from 2017-2021 is 754 million gallons, or 12% of production. Ulrich PFT, p. 26; Aquarion Interrog. Resp. EOE-52. The Company also had Ms. Vickers, the same individual who Aquarion worked with to identify water conservation opportunities and who ultimately recommended the 2-day per week irrigation program, assess the success of the program. Tr., Nov. 30, 2022, 764:2-14. Predictably,⁸⁰ Ms. Vickers concluded that the program resulted in decreased water use. Late Filed Ex. 42, Att. 1, p. 96.

While the Company is able to determine whether water usage has decreased in the aggregate across its systems, it is unable to attribute these reductions specifically to its conservation program; nor does the Company have any other way in which to assess the program's success, particularly with respect to its heavy reliance on customer communication and behavioral programs. Specifically, the Company does not have any goals regarding water conservation. Tr., Nov. 30, 2022, 776:1-2. It also does not have any Key Performance Indicators (KPIs) associated with its conservation communication campaigns, which encompasses the majority of the costs of Aquarion's conservation program. Tr., 776:11-12; Final Late Filed Ex. 1, Sch. 3.18.

The Company asserts it experienced costs savings as a result of its conservation program due to both variable cost savings that result from less consumption, primarily driven by reductions in chemical and power costs, and present and future plant avoidance. Aquarion Interrog. Resp. RRU-108, EOE-52; Tr., Nov. 30, 2022, 743:18-744:6. According to the Company, it saved approximately \$1.5 million in variable cost savings. Aquarion Interrog. Resp. RRU-108, EOE-52. When asked regarding savings associated with the remaining approximately \$1.5 million in costs, the Company testified

⁸⁰ The Authority notes that a long-held best practice in the energy efficiency arena is to use an independent third-party evaluation, management, and verification consultant, who is not the same entity or individual that designed or implemented the initial program.

that the costs savings are due to capital investment avoidance. Tr., Nov. 30, 2022, 743:8-20. The Company was, however, unable to quantify those savings. Tr., 740:24-741:7, 742:25-743:7, 744:2-6.

Based on the foregoing, the Authority finds that only \$1,498,051 million, or 50%, of the deferred conservation expenses were reasonable and prudent. Accordingly, the Authority denies recovery for \$1,498,050 of the deferred conservation expenses.⁸¹

c. Annual Conservation Expense

The Company requests approval of an annual conservation expense of \$494,629, which is based on a five-year average of costs. Final Late Filed Ex. 1, Sch. C-3.7. The annual conservation expense includes costs for conservation messaging and implementation of the two-day per week irrigation program. Ulrich PFT, pp. 26-27. The conservation messaging consists of costs for television, print, and social media advertising; automated letters sent to customers with high meter reads; and conservation kits provided to customers by request and at community events. Id., p. 26.

As discussed above, the Company's historical expenditures through its conservation program are heavily dependent on customer communications, and also include various pilot programs and consultant fees. Late Filed Ex. 41. As such, EOE questions whether the requested annual conservation expense is appropriately determined by the Company, or whether it should be adjusted downward to reflect the lessons learned from previous pilots and one-time consultant expenditures. EOE Brief, p. 12. The Authority is persuaded that the proposed amount may be inappropriate for the reasons articulated by EOE, and regardless, finds that the proposed amount is certainly inappropriately high given the dearth of detail associated with the Company's planned expenditures. Therefore, the Authority approves recovery of a \$400,000⁸² annual

⁸¹ The Company asserts in exceptions that the Authority "ignores the record evidence, including the Company's response to OCC-151 and EOE-52 and, therefore, fails the test for substantial evidence on the record to support the merits of PURA's decision." Aquarion Exceptions, pp. 68-69. As stated above, the Company provided only invoices in response to Interrogatory OCC-151 to support \$ 2,996,101 in deferred conservation costs; therefore, Aquarion did not demonstrate that 100% of the expenses are reasonable and prudent. In addition, as stated above, the Company was only able to quantify cost savings associated with 50% of the deferred conservation costs and could not quantify savings for the other 50%. Aquarion Interrog. Resp. RRU-108, EOE-52; Tr., Nov. 30, 2022, 740:24-741:7, 742:25-743:7, 743: 8-744:6, 744:2-6. Accordingly, it is the Company, not PURA, that failed to meet its burden.

⁸² In 2021, the Company reports that it spent approximately \$525,000 on its conservation program, primarily for conservation messaging (\$310,000); the remainder (\$215,000) was spent on implementation of its twice-weekly irrigation program conducted in 10 towns. Ulrich PFT, pp. 26-27. In the absence of detailed projections and KPIs for the conservation expenditures moving forward, the Authority is unable to comprehensively determine the appropriate budget moving forward; however, at a minimum, the Authority is not persuaded that monies earmarked for communications should more than double expenditures on actual programs and measures. Further, the Authority reminds the Company that should it find additional opportunities for demonstrable savings through conservation expenditures, such as through the purchase of leak detection equipment, the purchase of energy efficient equipment for its company operations, etc., all such expenditures would qualify under the statutory definition of "eligible projects" through the WICA program, for which the Company could seek interim rate increases to accommodate. Conn. Gen. Stat. § 16-262v.

conservation expense; further, the recovery is conditioned on the successful completion of several items.

First, the Authority directs the Company, within 60 days following issuance of the Decision, to provide as a compliance filing projections associated with conservation expenditures to be made in the first rate year (i.e., March 15, 2023 – March 14, 2024), as well as for the subsequent two rate years.⁸³ Such projections should include, at a minimum, budgeted values on a per measure (or per sub-program) basis for administrative and customer incentive costs, as well as for the projected water and electricity (if applicable) savings. Second, the Authority directs the Company to provide an annual compliance filing indicating its performance against the previously submitted targets no later than June 1 following completion of the rate year. Third, no later than January 15, 2026, provided Aquarion has not filed an intervening rate proceeding, the Authority directs the Company to submit as a compliance filing annual projections associated with conservation projections for the three years commencing March 15, 2026. Such projections shall include, at a minimum, budgeted values on a per measure (or per sub-program) basis for administrative and customer incentive costs, as well as for the projected water and electricity (if applicable) savings. Fourth, the Authority advises the Company, that to the extent that it plans to seek recovery of an annual conservation expense in future rate cases, it is expected to retain an independent third-party evaluation, management, and verification (EM&V) consultant to review and assess the Company's conservation program results after every three-years of implementation, including for the expenditures authorized herein. The EM&V consultant shall not be the same consultant responsible for designing or implementing the Company's conservation program. The consultant's report shall be filed in the instant Docket as compliance no later than September 15, 2026, and every three years thereafter until the Company's next rate case proceeding.

Finally, the Authority directs the Company in its next rate case to include a breakdown of costs included in the planned annual conservation expense, as well as a cost-benefit calculation of the total conservation expense. The application shall also include invoices provided by third parties for each year of conservation expenditures incurred in the intervening years between rate cases, along with a narrative and data that compares and contrasts the authorized annual conservation expenses with actual expenditures, as well as the savings targets compared to actual realized savings.

12. Communication Expense

The Company requests recovery of \$265,948 for communication expenses. Aquarion Interrog. Resp. EOE-66, Att. 1. However, the Company did not provide sufficient evidence to demonstrate that this amount is not already included in the \$494,629 requested for annual conservation expenses.

⁸³ Annual projections for the subsequent three years commencing March 15, 2026, shall be submitted as compliance no later than January 15, 2026, provided that the Company has not filed an intervening rate proceeding.

The Authority disallows recovery of the proposed \$265,948 communications expense because the Company provides no explanation as to why it has two communications budgets, i.e., one for conservation communications and the other for corporate communications, especially when the Company stated that its communication efforts are predominantly conservation related. Aquarion Interrog. Resp. EOE-66, Att. 1 (“The majority of the Company’s communication is focused on Water Conservation and Value of Water messaging.”); Tr., Nov. 28, 2022, 429:4-430:11. It is therefore difficult to distinguish between the two communications budgets, or to ascertain how such expenditures are made in furtherance of the Company’s statutory obligations or are in the public interest.

In addition, the Company did not demonstrate the proposed \$265,948 communications expense is reasonable and prudent.⁸⁴ To support a prudence determination, the Company provided spreadsheets containing the amounts spent in 2014 through 2021 on various types of communication, such as yard signs, social media, printing, photography, and direct mail. See Aquarion Interrog. Resp. EOE-66, Att. 1, and EOE-68, Att. 1. For example, Attachment 1 to Aquarion’s response to Interrogatory EOE-68 provides that in 2021, the Company paid MPX \$58,725 and Payne Davidson \$39,803 for “printing” services.” Aquarion Interrog. Resp. EOE-66, Att. 1. This scarcity of evidence does not support a prudence determination.

In addition, while the Company does have KPIs related to the corporate communications plan that it tracks on a monthly basis (e.g., the number of impressions Aquarion makes on social media), the way in which the KPIs influence the corporate communications budget or how the Company uses KPIs to determine success of a specific communications campaign is unclear. Tr., Nov. 28, 2022, 431:6-15. Further, because the Company did not start tracking KPIs until around 2020 when it hired a manager of social media, Tr., 431:12-13, there is no historical data available to assess or to correlate certain expenditure levels to specific outcomes. Lastly, it is unclear why the Company has a separately defined corporate communications budget when it appears communication budgets are built into other non-conservation program costs as well, e.g., communications regarding LIRAP. See Tr., Dec. 1, 2022, 1040:5-14. Accordingly, the Authority denies the \$265,948 communications expense.

13. Entertainment Expenses

The Company requests \$37,812 for entertainment expenses in the Test Year. Aquarion Interrog. Resp. OCC-25. The \$37,812 entertainment expense includes \$25,000 for a Webster Bank Arena suite and \$9,180 for reserved seats at the Hartford Healthcare Amphitheater, as well as a 10.625% inflation factor. Id.; Tr., Nov. 28, 2022, 412:9-12. The Company testified that employees who volunteer in the community are given first preference on tickets for both venues. Tr., 412:23-413:1.

⁸⁴ Aquarion asserts in written exceptions that the Authority “ignores the record evidence, including the Company’s responses to EOE-66 and EOE-68 and, therefore, fails the test for substantial evidence on the record to support the merits of PURA’s decision.” Aquarion Exceptions, p. 69. Contrary to Aquarion’s assertion, the evidence provided by the Company does not demonstrate that the communication expenses are reasonable and prudent.

The Authority disallows the \$37,812 entertainment expense as the suite and reserved seats are not necessary for the provision of water service. In addition, ratepayers should not pay for amenities and perks for Aquarion employees who volunteer in the community, as such service is defined as voluntary. Further, it is unclear based on the instant record whether such volunteer hours occur outside of working hours, or are incremental to the hours for which the Aquarion employees are appropriately compensated. As such, the Authority directs the Company to track the amount of time Aquarion employees spend volunteering during paid working hours as these costs are charged to ratepayers. In its next rate case application, the Company shall provide an unlocked, workable Excel spreadsheet that details the requested information for each year between 2023 and the test year proposed in the next rate proceeding.

14. Relocation Expense

The Authority denies the Company's proposed employee relocation expense of \$22,500, which the Company asserts represents the Test Year expense associated with the recruitment process. Aquarion Interrog. Resp. OCC-65. Though Aquarion stated, "it is common market practice to reimburse certain candidates for the cost of relocating to the Company's service territory," the Company also conceded that there was no relocation expense during the years 2017-2020. *Id.* Further, the Company stated it incurred the Test Year expense for one employee only, and that said employee worked for Aquarion for less than six months; incredibly, the Company did not include any "clawback" provision associated with this expense and thus could not recover the expenditure from the separated employee. Tr., Nov. 29, 2022, 569:21-25, 570:1:13. Perhaps more egregiously, the Company did not seek any estimates for the moving expenses from multiple vendors, instead relying on the one-time expense as the basis of its request. Tr., 560:14-17. Lastly, the Company has not demonstrated that this expense will likely occur annually, as it has only occurred once in the last five years. Based on the evidence in the record, the Authority disallows the Company's relocation expense of \$22,500.

15. Acquisition Adjustment Amortization

The Company requested to amortize the acquisition adjustments over three years. Final Late Filed Ex. 1, Sch. WPC-3.22. To prevent over recovery of the amortization expense, the Authority finds that five years, not three, is the appropriate period for amortizing the acquisition adjustments as it is more in line with the typical period of time between water company rate cases. In the Authority's experience, water companies do not typically file rate cases every three years, but rather tend to stay out longer (as illustrated by the instant case). This increase in the amortization period from three to five years applies to acquisition adjustments allowed in the 2013 Decision, as well as any new deferrals since the Company's last rate case. Consequently, the Authority authorizes the Company to recover the \$833,173 acquisition adjustment amount over five years, which amounts to \$166,635 ($\$833,173 / 5$ years). The Authority's adjustment to the Company's revised amortization expense of \$277,724 is a reduction of \$111,089 ($\$277,724 - \$166,635$). Final Late Filed Ex. 1, Sch. WPC-3.22.

16. Fee Free Program

The Authority approves Aquarion's proposed Fee Free program in which the Company would eliminate the convenience fee for residential customers who pay their bills using credit and debit cards. Teixeira PFT, p. 21. Under this Fee Free program, instead of the residential customer being charged a convenience fee, the Company would cover the cost of the transaction fee in its cost of service to be recovered in rates from residential customers. Id. Aquarion modeled its program after the fee free programs approved by the Authority for other Eversource affiliates. Id.; see Decision, Apr. 18, 2018, Docket No. 17-10-46, Application of The Connecticut Light and Power Company d/b/a/ Eversource Energy to Amend its Rate Schedules, pp. 12-14; Decision, Dec. 12, 2018, Docket No. 18-05-10, Application of Yankee Gas Services Company d/b/a/ Eversource Energy to Amend its Rate Schedules, p. 16.

The Company contracts with a third-party vendor, Kubra, for payment processing. Aquarion Interrog. Resp. RRU-303. The rate Aquarion negotiated most recently is \$1.95 per one-time transaction; this fee would remain the same under the Fee Free program. Id. Aquarion derived the value based on transaction fees incurred in the Test Year. Teixeira PFT, p. 26. In 2021, 42% of customers paid their bills using a credit or debit card, incurring the \$1.95 transaction fee, which in aggregate totaled \$271,137. Id., pp. 22-23. The Company reduced this amount by \$54,207 for certain adjustments, resulting in an annual program cost of \$216,930. Application, Sch. WPC-3.17, p. 1; Tr., Dec. 1, 2022, 1044:22 - 1045:1. Any under-collection of program costs incurred would be deferred for recovery in rates at the time of the Company's next rate case and any over-collection of these program costs would be credited to residential customers. Teixeira PFT, p. 27.

Aquarion indicated that the purpose of implementing the Fee Free program is solely to improve customer satisfaction. Tr., Dec. 1, 2022, 1048-49. The Company does not anticipate any cost savings in eliminating the transaction fee, Tr., 1049:18-20, nor does the Company anticipate an impact on reducing uncollectibles. Aquarion Interrog. Resp. RRU-314. In fact, the Company anticipates that the number of customers who would benefit from this program will decrease as more customers enroll in e-billing, which does not charge customers a transaction fee when paying their bills by credit or debit card. Aquarion Interrog. Resp. RRU-307. The Company anticipates customer enrollment in e-billing will increase 3% per year. Id.

In addition to improving customer satisfaction, the Company intends for the Fee Free program to benefit vulnerable customers who may pay their bills using a secured credit card, a prepaid debit card, or an Electronic Benefits Transfer (EBT) card. Teixeira PFT, p. 25. Specifically, low-income customers would benefit from saving the \$1.95 when they pay their bills. Tr., Dec. 1, 2022, 1050:14-19.⁸⁵ The Company indicated that it would track the information about the Fee Free program on an annual basis using the same

⁸⁵ Customers also informed Aquarion about frustration that they must pay the transaction fee in addition to a reconnection fee when they seek to have their service restored after it has been shut off. Teixeira PFT, p. 23.

metrics approved in The Connecticut Light and Power Company d/b/a Eversource Energy and Yankee Gas Services Company respective rate cases. Teixeira PFT, p. 24. In addition to those compliance metrics, the Company stated it would track the program by other means that the Authority determined were appropriate, such as data regarding actual write-offs. Aquarion Interrog. Resp. RRU-315. Consistent with the tracking metrics implemented in the Eversource affiliate rate cases, the Authority directs Aquarion, on an annual basis, beginning March 1, 2024, to file compliance as outlined in Section X.B. Orders. As envisioned by the Company, the Fee Free program will last until the Company's next rate case, at which time the Authority will determine whether the program should be continued and in what form.

Currently, Aquarion covers the transaction fees associated with other forms of customer payments of bills. For example, customers enrolled in autopay through the Company's portal, who pay in person, or who pay through their banks do not pay a transaction fee; instead, the Company covers the fees. Tr., Dec. 1, 2022, 1047:19 - 1048:3; Late Filed Ex. 65. Such costs are already accounted for in the Company's O&M expenses. Tr., 1061:7-14. The Company stated numerous times that eliminating the transaction fee is "a normal form of doing business." Tr., 1053:6-7. Given this view of the Company absorbing the credit and debit card transaction fee, in the Company's next rate case, the Authority will consider whether the Fee Free program should exist as a standalone program when it operates like the other transaction fees the Company already covers instead of the customer.

The Company anticipates starting the Fee Free program 30 days after approval. Aquarion Interrog. Resp. RRU-306. Implementation will involve configuring Aquarion's billing system with Kubra, updating the website language and phone system, and training service technicians and customer service representatives about the new program. Tr., Dec. 1, 2022, 1058:17 – 1059:11. The Company is directed to implement the program within 30 days of the issuance of this Decision.

The Company's original Fee Free program proposal only included the cost of the \$1.95 transaction fee. However, Aquarion recognizes there are additional fees that could be adjusted to better reflect the savings that are associated with implementation of the Fee Free program, such as the impact on other bill related costs (e.g., postage, bill printing, and bank fees). Late Filed Ex. 73. For example, the removal of the transaction fee may result in customers who typically pay via a check to pay with their credit card. As such, the Authority will reconcile the costs of the Fee Free program as well as its impact on other bill related costs at the Company's next rate case. Based on the facts and analysis presented by the Company, the Authority approves the proposed Fee Free credit card/debit card program, subject to the modifications discussed herein.

17. Software Maintenance, Non-SAP Costs

The Company proposed several adjustments to its Test Year level of information technology-related O&M expense. Application, Sch. WPC-3.14. The Company claimed these adjustments were known, measurable, and incremental to the costs the Company incurred during the Test Year. Tr., Nov. 29, 2022, 539.

One component of these proposed adjustments was an increase in expense of \$217,277 attributable to Microsoft Office 365 (O365) software.⁸⁶ Application, Sch. WPC-3.14(2). The Company testified that the \$217,277 cost of O365 should be deemed incremental to the costs incurred during the Test Year because “generally accepted accounting principles” allow Aquarion to “capitalize the first year of licenses.” Tr., Nov. 29, 2022, 541-542. The Company further testified that O365 licenses were expensed as depreciation during the first year. Tr., 542.

To determine whether the O365 costs claimed by the Company were truly incremental, the Authority sought additional information that would help validate that neither O365 costs nor costs related to other similar software (i.e., software that would be redundant with O365) were embedded in the Company’s test year amounts.⁸⁷ The information requested included the date the Company switched to O365. The Company did not disclose this information, nor did Aquarion make any reference to the O365 transition date in the Late Filed Exhibit it filed in response to this request. Tr., Nov. 29, 2022, 547-548, 562; Late Filed Ex. 32. Without knowing the date on which the Company made the transition to O365, it is impossible for the Authority to determine whether a full year’s worth of expense was taken during the Test Year, or if a portion of the capitalized licenses remained unamortized at the end of the Test Year.

The Company was also asked by the Authority to provide the Test Year costs “related to Microsoft products or other products that Office 365 would encompass that would no longer be necessary given [the Company’s] subscription to Office 365.” Tr., Nov. 29, 2022, 547-548. With regard to this request, the Company appears to have provided an incomplete list of such costs. Specifically, the Company’s response included a \$12,800 expense reduction adjustment related to legacy Microsoft office products incurred during the Test Year, but the response did not reference any other software utilized during the Test Year that would be redundant with O365 (thereby indicating there were no examples of such software). Late Filed Ex. 32. However, based on responses from the Company during cross-examination at the hearings, there is at least one example — specifically, the virtual meeting service Zoom — of software used by Aquarion during the Test Year that would clearly be redundant with the functionality encompassed in O365. Tr., Dec. 14, 2022, 108-109. Based on the Company’s responses, there is insufficient information to determine what the cost to Aquarion of this virtual meeting software was during the Test Year. Late Filed Ex. 32.⁸⁸

The information sought, but not provided, in these requests was critical in assessing the reasonableness of the Company’s adjustment. Without this information, it is not possible to reasonably conclude whether, and to what extent, the costs being

⁸⁶ For ease of reference, this, and related figures, are shown on a pre-allocated basis. In its Application, the Company allocated 8.54% of these costs to its affiliates. Tr., Nov. 29, 2022, 549.

⁸⁷ The Company initially offered to provide this information as Read-In F at the evidentiary hearings. The Company subsequently requested to provide this information in Late Filed Ex. 32. Tr., Nov. 29, 2022, 562.

⁸⁸ While the Company claimed such costs were removed from the Company’s revenue requirement, the Authority sees no evidence of this removal in the related Application schedule. Application, Sch. WPC-3.14(2); Tr., Dec. 14, 2022, 108.

sought by the Company are truly incremental to the Test Year. Accordingly, the Authority denies this adjustment and approves rate recovery for only those costs actually incurred during the Test Year. Specifically, the Authority disallows the Company's proposed adjustment made in the Application to increase its O&M expense by \$217,277, and the Authority also disallows the proposed adjustment made in the Company's revenue requirement update to reduce O&M expense by \$12,800. Application, Sch. WPC-3.14(2) and Late Filed Ex. 32.

In addition to the findings described above, the Authority discovered another issue related to the O365 licenses: the Company purchased dozens more O365 licenses than it has employees.⁸⁹ Specifically, as of the Application date, the Company had only 323 employees, yet the Company purchased (or, more accurately, was assigned) 358 licenses — 35 more licenses than employees. Morrissey PFT, p. 6; Late Filed Ex. 32. The Company claimed the additional licenses were appropriate in order for Aquarion to have them available for “seasonal or temp employees, consultants and the overlap required during computer refreshes.” Late Filed Ex. 32. The Authority is not convinced that charging customers for dozens of excess software licenses is fiscally prudent or standard business protocol — particularly when such additional licenses would result in several thousand dollars of increased costs to ratepayers. Aquarion Interrog. Resp. OCC-184, Att. 2.

The expenses above are allocated to the Company at 86.54%. Therefore, the Authority will adjust the Software Maintenance expense downward by \$176,954 $[(\$217,277 \times .8654) - (\$12,800 \times .8654)]$.

18. Bad Debt Expense

As noted in Section VIII.F.2. Rate-Related Proposals, the Authority allows \$195,996 in bad debt expense, compared to the Company's request of \$197,994 for bad debt expense. Final Late Filed Ex. 1, Sch. WPC-3.15. The Authority therefore adjusts bad debt expense by \$1,998.

C. DEPRECIATION EXPENSE

1. Summary

The Company proposes a depreciation expense of \$44,356,567. Final Late Filed Ex. 1, Sch. WPC-3.0A. The following table summarizes adjustments to the depreciation expense. The sections below provide a detailed analysis for each of the adjustments.

⁸⁹ This finding did not impact the quantification of the Authority's ultimate ruling for these costs. However, the Authority will address such incongruities between employees and software licenses in future proceedings, as necessary.

Table 27: Depreciation Expense (\$)

Company Proposed	44,346,567
Authority Adjustments	(6,745,696)
General Plant Reserve Adj. ⁹⁰	(577,287)
Service Life and Net Salvage	(4,286,456)
Plant-in-Service Adjustment	(1,881,953)
Total	37,600,871

2. Depreciation Study

Aquarion filed a depreciation study related to the utility plant-in-service as of December 31, 2021. Allis Prefiled Test., Aug. 29, 2022, Ex. A-7-NWA-3 (Aquarion 2021 Study). Aquarion's 2021 Study employed a depreciation system composed of the straight-line method, average service life procedure, and remaining life technique. Allis PFT, Ex. A-7-NWA-1, p. 4. Ned Allis of Gannett Fleming Valuation and Rate Consultants, LLC (Gannett Fleming) performed Aquarion's 2021 Study. Id., p. 1.

The application of the present depreciation rates to the depreciable plant-in-service as of December 31, 2021, results in an annual depreciation expense of \$44,128,798. Id., p. 2. In comparison, the application of the proposed rates to the depreciable plant-in-service as of December 31, 2021, results in an annual depreciation expense of \$41,322,676, which represents a decrease of \$2,806,122 from current rates. Id. The composite annual depreciation rate under present rates is 2.78%, while the proposed December 31, 2021 composite depreciation rate is 2.60%. Id.

In preparing the Aquarion 2021 Study, Gannett Fleming utilized actual Company data to investigate and analyze historical plant data to determine the remaining plant asset lives. Allis PFT, pp. 5-6. The Aquarion 2021 Study applied the Retirement Rate method to analyze the Company's service life data sorted by age to develop a survivor curve for each account. Id., p. 6. For every account, a survivor curve served as the basis on which smooth curves (standard Iowa Curves) were fitted to determine the average service life (ASL) being experienced by the property account under study. Aquarion 2021 Study, pp. 54-194.

3. Amortization of General Plant Reserve

The Company recommends a five-year amortization to adjust the reserve for the amortization accounts because "[t]his approach will achieve consistent amortization rates for existing assets as well as future assets and is consistent with the approach previously adopted by PURA for The Connecticut Light and Power Company and Yankee Gas Services Company." Allis PFT, p. 11.

OCC contends an adjustment or accounting order from the Authority is necessary in this rate proceeding to ensure that ratepayers receive the appropriate accounting of

⁹⁰ In the Proposed Final Decision, this table included an error. The Authority is increasing the amortization period of the \$5,872,822 unrecovered reserve from the proposed five years to ten years; therefore, the depreciation expense should be reduced by \$577,287 to account for the longer amortization period.

this reserve adjustment. Instead of the five-year period suggested by the Company, OCC recommends a 10-year amortization of the unrecovered reserve adjustment. OCC Brief, p. 54. OCC argues that a ten-year amortization more closely follows the period for which Aquarion has performed new depreciation studies in rate cases. Id.

The Authority finds that the ten-year amortization period to adjust the reserve for the applicable general plant accounts proposed by OCC is reasonable in this proceeding. The Authority will continue to review the general plant reserve amortization issue on a case-by-case basis in future rate cases and recognizes that longer amortization periods may be appropriate in some cases. The ten-year amortization period results in a \$577,287 increase to depreciation expense, as opposed to the five-year amortization, which results in \$1,154,573, or a reduction of \$577,287 as shown in the table below.

Table 28: General Plant Reserve Amortization (\$)

	Company Proposed	PURA Finding	Adjustment
General	5,872,822	5,872,822	0-
Unrecovered Reserve	1,154,573	577,287	(577,287)

4. Depreciation Rates

a. Service Life

For service life estimates, the Aquarion 2021 Study relies on original life tables (OLT), which can be displayed in the form of an original survivor curve (OLT curve). See Aquarion 2021 Study, pp. 54-194. The exposures at the beginning of the age interval are obtained from the corresponding age interval of the exposure schedule, and the retirements during the age interval are obtained from the corresponding age interval of the retirement schedule. The retirement ratio is the result of dividing the retirements during the age interval by the exposures at the beginning of the age interval. The percent surviving at the beginning of each age interval is derived from survivor ratios, each of which equals one minus the retirement ratio. The percent surviving is developed by starting with 100% at age zero and successively multiplying the percent surviving at the beginning of each interval by the survivor ratio, i.e., one minus the retirement ratio for that age interval. Id., p. 26.

The smoothing of the original survivor curve eliminates any irregularities and serves as the basis for the preliminary extrapolation to zero percent surviving of the original stub curve. In the Aquarion 2021 Study, the smoothing of the original curve with established type curves was used to eliminate irregularities in the original curve. The Iowa type curves are used in the Aquarion 2021 Study to smooth those original stub curves, which are expressed as a percent surviving at ages in years. Each original survivor curve can be compared to the Iowa curves using visual and mathematical matching in order to determine the better fitting smooth curves. Id., p. 28.

The Authority has conducted visual and mathematical analyses of the Iowa curves selected by Gannett Fleming to represent the service lives and depreciation rate

calculations for each depreciable account included in the depreciation study. The Authority finds that the methods, procedures, and depreciation system relied upon by the Company are generally reasonable; however, based on the Authority’s analysis, the service life estimates proposed in the depreciation study for five accounts are unreasonably short given the historical data upon which the service life estimates were based. The five accounts impact three categories of assets (source of supply plant, pumping plant, and transmission and distribution plant). The table below presents a summary of the lowa curves proposed by the Company and those determined by PURA to more accurately reflect the service life for those accounts.

Table 29: Aquarion and PURA lowa Curve Comparison

Account No.	Description	Company lowa Curve	PURA lowa Curve
SOURCE OF SUPPLY PLANT			
312.00	COLLECTING AND IMPOUNDING RESERVOIRS	S0 - 75	R0.5 - 84
316.00	SUPPLY MAINS	S3 - 65	S3 - 75
PUMPING PLANT			
325.00	ELECTRIC PUMPING EQUIPMENT	S1.5 - 30	S1.5 - 33
TRANSMISSION AND DISTRIBUTION PLANT			
342.00	DISTRIBUTION RESERVOIRS AND STANDPIPES	R3 - 65	R3 - 75
343.00	TRANSMISSION AND DISTRIBUTION MAINS	R3 - 65	R4 - 65
346.00	METERS	L3 - 14	L3 - 17

For each of these accounts, the lowa curve adopted by PURA results in a closer mathematical fit to the observed retirement data presented in the OLT curve for each account. The Authority finds that, for each of these accounts, the Company did not present sufficient evidence beyond the statistical analysis to warrant a material deviation from the service lives indicated by the historical statistical data. As demonstrated in the figures, the lowa curve selected by the Authority more reasonably correspond to the OLT curves for each of these accounts.

Figure 4: Account 312.00 – Collecting and Impounding Reservoirs

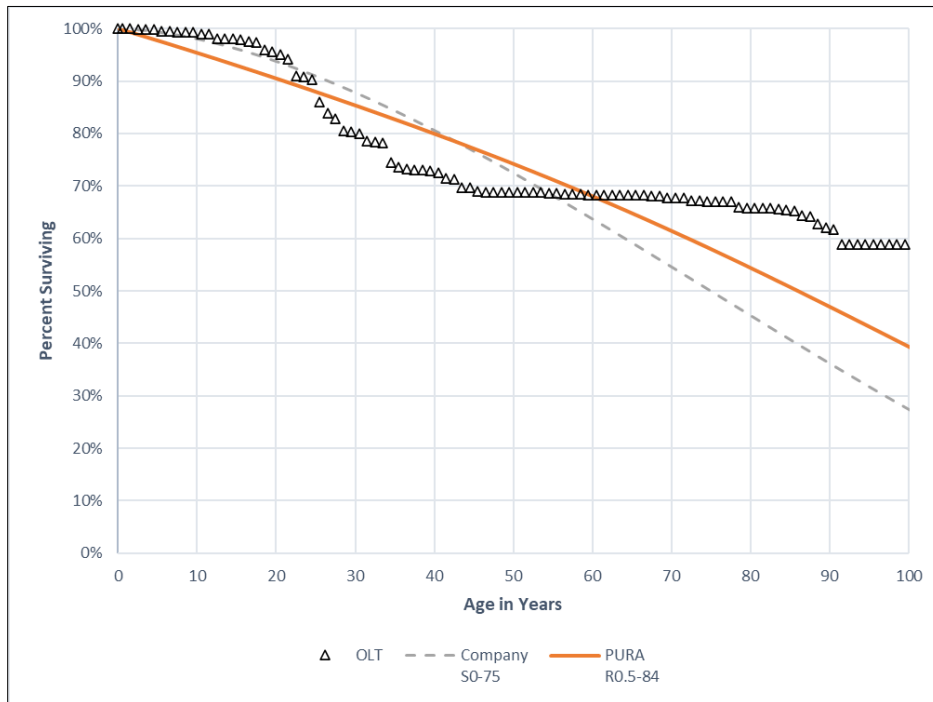


Figure 5: Account 316.00 – Supply Mains

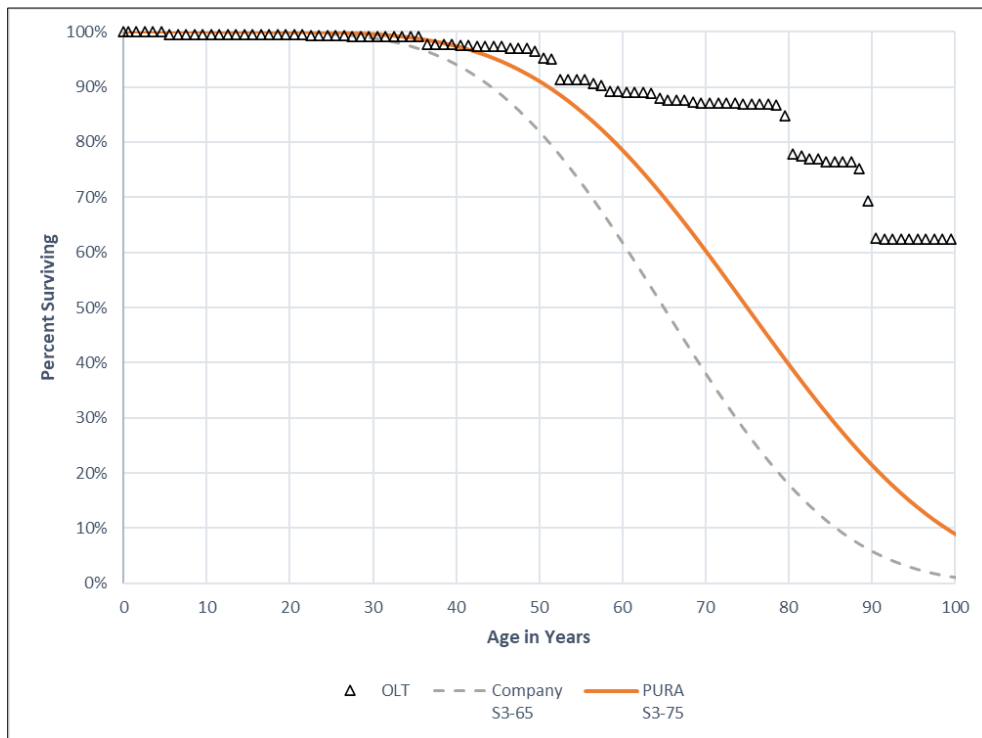


Figure 6: Account 325.00 – Electric Pumping Equipment

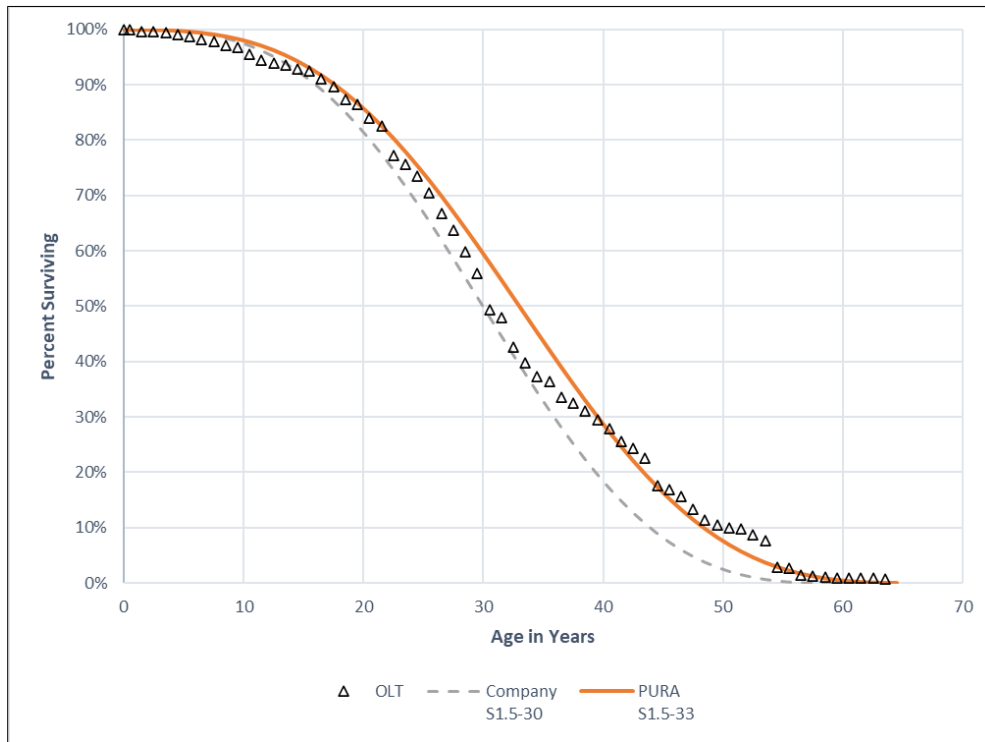


Figure 7: Account 342.00 – Distribution Reservoirs and Standpipes


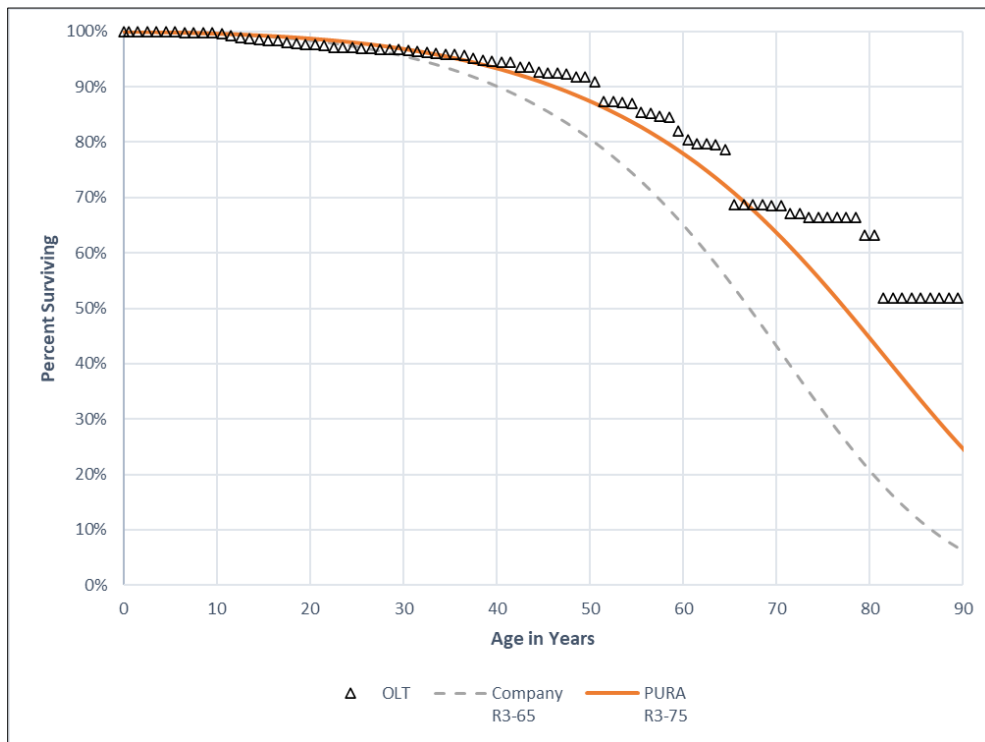


Figure 8: Account 346.00 – Meters

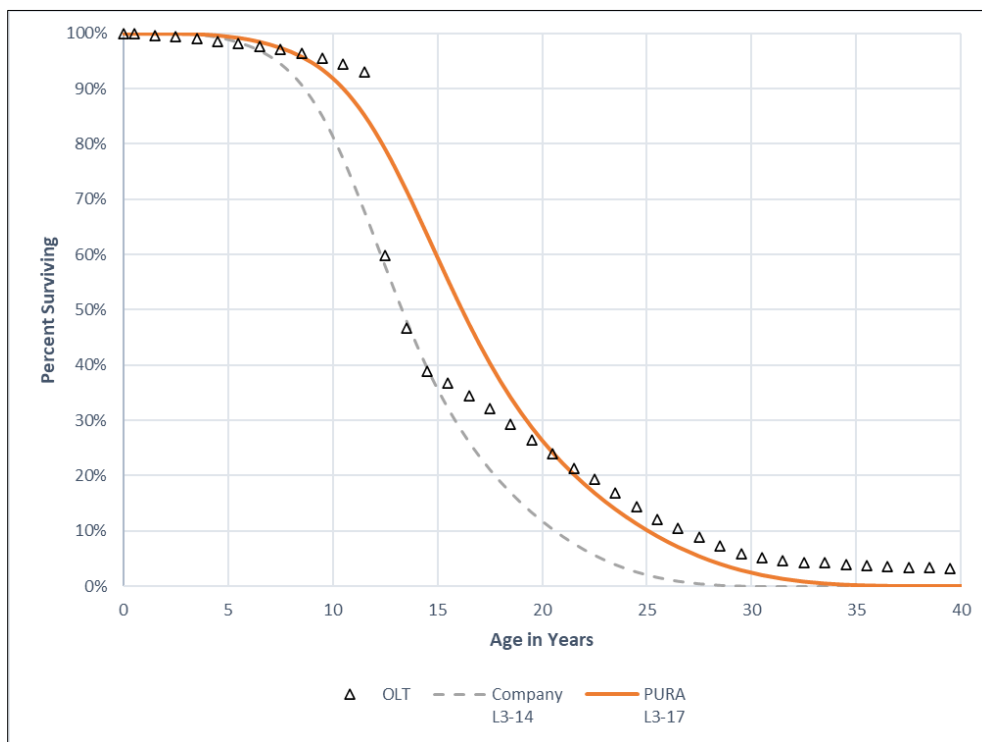

The primary reason the lowa curves presented here are more reasonable than those proposed by the Company is that they result in mathematically closer fits to the observed OLT curves for each account. Specifically, the distance between each point on the OLT curve and the Company’s proposed lowa curve is longer than the distance between the OLT curve and the lowa curves adopted by the Authority.

Applying these more reasonable lowa curves to these accounts results in a reduction to the Company’s proposed annual depreciation expense.⁹¹

b. Net Salvage

Net salvage is the gross salvage less the cost of removal. The estimates of future net salvage are expressed as percentages of surviving plant in service. In cases in which removal costs are expected to exceed salvage receipts, a negative net salvage percentage is estimated. Aquarion 2021 Study, p. 39. The Company’s analyses of

⁹¹ The Company objects to the Authority selecting different lowa cures and net salvage rates, stating that “[i]f the Company was aware that PURA wanted to use different survivor curves [or net salvage rates], the Company would have provided an explanation as to why the survivor curve [or net salvage rate] it was proposing was the most appropriate curve for that individual account.” Aquarion Exceptions, pp. 61-62 (emphasis added). This statement exemplifies the Company’s misunderstanding of its evidentiary burden in a rate case. The Company had the burden and obligation from the outset of this proceeding to explain “why the survivor curve [or net salvage rate] it was proposing was the most appropriate curve for that individual account.” This obligation does not arise only when a party, intervenor, or the Authority questions the Company. The Company’s acknowledgment that it “would have provided an explanation” is a de facto admission that it did not do so in this proceeding.

historical costs of removal and salvage data are presented in the Aquarion 2021 Study. Id., pp. 195-219.

The Authority conducted an analysis of the historical net salvage data presented in the Aquarion 2021 Study and determines that the net salvage estimates proposed in the Aquarion 2021 Study for nine accounts are unreasonably low given the historical data upon which the net salvage estimates were based. These nine accounts affect four categories of assets (source of supply plant, pumping plant, water treatment plant, and transmission and distribution plant). The results of the analysis are presented in the table below.

Table 30: Net Salvage Rates

Account No.	Description	Company Salvage	PURA Salvage
SOURCE OF SUPPLY PLANT			
	COLLECTING AND IMPOUNDING		
312.00	RESERVOIRS	-25%	-16%
314.00	WELLS AND SPRINGS	-15%	-3%
316.00	SUPPLY MAINS	-10%	0%
PUMPING PLANT			
325.00	ELECTRIC PUMPING EQUIPMENT	-15%	-5%
326.00	DIESEL PUMPING EQUIPMENT	-10%	0%
328.00	OTHER PUMPING EQUIPMENT	-10%	0%
WATER TREATMENT PLANT			
332.00	WATER TREATMENT EQUIPMENT	-10%	-7%
TRANSMISSION AND DISTRIBUTION PLANT			
	TRANSMISSION AND DISTRIBUTION		
343.00	MAINS	-15%	-2%
348.00	HYDRANTS	-10%	-4%

For each of these accounts, the negative net salvage rate proposed in the Aquarion 2021 Study is greater than the negative net salvage rate observed over the past five years. Conversely, each of the net salvage rates listed under the “PURA Salvage” header in the above table equates to the most recent five-year average net salvage rate.

Aquarion 2021 Study, pp. 197, 199, 200, 204, 205, 206, 208, 211, 215. The Authority finds that, for each of these accounts, the Company did not present sufficient evidence beyond the statistical analysis to warrant a material deviation from the service lives indicated by the historical statistical data. Accordingly, the Authority determines that the net salvage rates in this case are more appropriately determined to coincide with the most recent five-year average net salvage rates for the accounts in question.

c. Adjustment to Depreciation Expense

Based on the adjustments to the Iowa curves and salvage rates, the Authority adjusts the Company's depreciation expense. The table below summarizes the adjustments.

Table 31: Service Life and Net Salvage (\$)

Plant Function	Plant Balance 12/31/2021	Company Accrual	PURA Finding	Adjustment
Source of Supply	131,192,586	3,202,230	2,662,484	(539,746)
Pumping	114,824,883	3,176,177	2,790,724	(385,453)
Water Treatment	302,443,904	7,313,874	7,088,437	(225,437)
Trans. and Dist.	948,994,303	20,603,000	17,467,180	(3,135,820)
Total Depreciation	\$ 1,587,195,960	\$ 41,322,676	\$ 37,056,548	\$ (4,286,456)

The table below summarizes the adjustments made by account.

Table 32: Depreciation rates by Account

ACCT NO.	DESCRIPTION	COMPANY POSITION		PURA FINDING	
		DEP. RATE	ANNUAL ACCRUAL	DEP. RATE	ANNUAL ACCRUAL
	SOURCE OF SUPPLY PLANT				
312.00	Collecting and Impounding Reservoirs	1.85%	\$1,470,829	1.37%	\$ 1,090,278
314.00	Wells and Springs	3.43%	\$723,168	2.90%	612,793
316.00	Supply Mains	1.71%	\$172,305	1.23%	123,580
	PUMPING PLANT				
325.00	Electric Pumping Equipment	2.91%	\$2,081,015	2.41%	\$1,722,762
326.00	Diesel Pumping Equipment	3.50%	\$55,420	2.59%	\$40,982
328.0	Other Pumping Equipment	3.91%	\$105,231	3.46%	\$92,989
	WATER TREATMENT PLANT				
332.00	Water Treatment Equipment	2.71%	\$4,907,492	2.59%	\$4,680,578
	TRANSMISSION AND DISTRIBUTION PLANT				
342.00	Distribution Reservoirs and Standpipes	2.17%	\$1,279,773	1.79%	\$1,056,189
343.00	Transmission and Distribution Mains	1.75%	\$12,019,260	1.48%	\$10,209,193
346.00	Meters	8.16%	\$3,515,938	5.72%	\$2,463,678
348.00	Hydrants	2.34%	\$539,370	2.14%	\$491,993

D. ADJUSTMENT TO PLANT-IN-SERVICE

The Company's depreciation expense is calculated based on the Company's plant additions through December 15, 2022; however, as discussed in Section IV.B.2. Pro Forma Plant Additions, the Authority will only include in rate base plant additions completed as of August 31, 2022. Consequently, the Company's depreciation expense must be adjusted to reflect the allowed rate base. Specifically, the Authority will decrease the Company's depreciation expense by \$1,881,953, which is the Authority allowed depreciation expense of \$1,282,609 for plant through August 31, 2022, as opposed to the Company requested depreciation expense of \$3,164,562 for plant through December 15, 2022. Final Late Filed Ex. 4.

E. TAXES**1. Payroll Tax**

The Company requests \$2,213,635 as a payroll tax expense. Final Late Filed Ex. 1, Sch. WPC-3.23. As a result of the reduction in allowed FTEs to 323, the Authority authorizes a \$2,004,219 payroll tax expense, which is a reduction of \$209,416 (\$2,213,635-\$2,004,219) to the Company's request.

2. State Tax

The Company requests \$4,042,930 as a state tax expense. Final Late Filed Ex. 1, Sch. WPC-3.25. The Authority has made tax impacted adjustments equaling \$8,145,310, which when multiplied by the 8.25% Connecticut Business Tax (CBT) rate create an additional CBT of \$671,988 and increases pro forma CBT to \$4,714,918. The Authority has reduced the Company's request by \$37,274,053, which when multiplied by 8.25% results in a CBT reduction of \$3,075,109 and an allowance for CBT of \$1,639,809 (\$4,714,918 - \$3,075,109). When measured against the Company's request of \$4,042,930, this is a reduction of \$2,403,121.

3. Federal Tax

The Company requests \$6,949,815 as a federal tax expense. Final Late Filed Ex. 1, Sch. WPC-3.26. The Authority has made tax impacted adjustments equaling \$8,145,310, which when multiplied by the 8.25% CBT rate generates \$671,988 of increased CBT. When determining the FIT, the CBT of \$671,988 is subtracted from the overall adjustments of \$8,145,310 as CBT is deductible in the determination of FIT (\$8,145,310-\$671,988=\$7,473,322). The remaining \$7,473,322 is then multiplied by the 21% FIT rate, which creates an additional FIT of \$1,569,398 and an increase in pro forma FIT to \$8,519,213. When the CBT of \$3,075,109 in Section VI.E.2. State Tax is subtracted from the Authority's \$37,274,053 reduction to the Company's revenue request, and then that amount is multiplied by the 21% FIT rate, the result is a FIT reduction of \$7,181,778 (((\$37,274,053)-\$3,075,109)(21%)) and an allowance for FIT of \$1,337,434 (\$8,519,213 - \$7,181,778). When measured against the Company's request of \$6,949,815 as a federal tax expense, it results in a reduction of \$5,612,381 (\$6,949,815-1,337,434).

4. Excess Accumulated Deferred Income Taxes

When the 2017 Tax Cuts and Jobs Act (Tax Act) reduced the corporate tax rate from 35% to 21%, there was a corresponding reclassification of deferred taxes the Company had accumulated on its books as of the date of the change in the tax law. Tr., Nov. 28, 2022, 315-316. This reclassification resulted in a category of deferred taxes called Excess Accumulated Deferred Income Taxes (EADIT). Tr., 315. EADIT represent funds collected from Aquarion customers in the past that are now owed back to customers based on the reduction of the corporate tax rate. Id. There are two categories of EADIT: (1) Protected EADIT and (2) Unprotected EADIT. Szabo & Unger PFT, p. 37. The table below summarizes the EADIT amounts claimed by the Company.

Table 33: Unamortized EADIT as December 31, 2021

	Protected	Unprotected	Total
Aquarion	(\$49,750,714)	(\$1,020,029)	(\$50,770,743)
Valley	(\$636,100)	\$0	(\$636,100)
Total	(\$50,386,814)	(\$1,020,029)	(\$51,406,843)

Application, Sch. WPC-3.16.

While both categories of EADIT are similar in that they represent amounts owed back to customers, the speed in which these different categories of EADIT can legally be refunded to customers is different. Tr., Nov. 28, 2022, 316-17. IRS normalization provisions restrict how quickly Protected EADIT may be refunded to customers, while there are no such restrictions for Unprotected EADIT. Szabo & Unger PFT, p. 37. The additional restrictions placed on the timing of when Protected EADIT may be refunded to customers make the categorization of EADIT critically important to all stakeholders, including customers. Tr., Nov. 28, 2022, 317-18. Specifically, due to these IRS restrictions, Protected EADIT is refunded to customers more slowly than Unprotected EADIT. Tr., 317.

Here, the Company proposes to refund Protected EADIT to customers over an approximately 20-year period and to refund Unprotected EADIT over a four- to five-year period. Application, Sch. WPC-3.16. The Company's aggregate annual amortization is (\$2,804,852). The table below provides the amortization periods and annual amortization amounts for the EADIT liability proposed by the Company.

Table 34: Proposed Amortization of EADIT

	EADIT Liability	Amortization Period	Annual Amortization
Depreciation	(\$49,750,714)	19.41	(\$2,563,149)
FCIC	(\$822,043)	5	(\$164,409)
Other	(\$197,986)	4	(\$49,497)
	(\$50,770,743)		(\$2,777,054)
Valley Division			
	(\$636,100)	22.8825	(\$27,799)
Total	(\$51,406,843)		(\$2,804,852)

Application, Sch. WPC-3.16.

Approximately 98% (\$50,386,814 of \$51,406,843) of the Company's claimed EADIT has been categorized by the Company as Protected EADIT. Application, Sch. WPC-3.16.

The Company has the burden of proving that its rates are just and reasonable. Conn. Gen. Stat. § 16-22. In order for a public service company to adequately satisfy the burden of proof standard, the Authority concludes that a necessary (though not necessarily sufficient) condition is that the subject company provides witnesses who are adequately experienced and knowledgeable in the subject areas they sponsor. The Company chose not to provide such a witness for this proceeding. Even though the EADIT is a highly complex and unusual tax issue that has significant consequences to ratepayers, the Company offered no tax expert to support its EADIT quantification and categorization. See Tr., Nov. 28, 2022, 314, 321:8. Nor was the sponsoring witness involved in calculating the EADIT. Tr., 318:22-319:1. The Company also did not produce a witness who could provide a reliable description of the EADIT workpapers (i.e., the documentation that memorialized the calculation of the EADIT). Tr., 319:12-24. The Authority is not critical of the individual Company witness who sponsored this subject area; rather, the Authority's critique is targeted at the Company for choosing not to utilize alternative Company personnel (e.g., the Company's Director of Taxes) who are experts in the field of taxation, and, thus, would have presumably been able to adequately respond to the Authority's inquiries related to this issue.

In addition to not producing an appropriate witness, there were multiple instances in which the Company provided either inaccurate or incomplete responses to interrogatory requests related to its EADIT proposal. For example, Interrogatory RRU-221, subpart b, asked the Company to provide "Any and all workpapers that were developed and relied upon for purposes of establishing the EADIT regulatory liability." It was later discovered that the Company had not provided all workpapers with its original response. Late Filed Ex. 12. While the Company provided additional workpapers in a subsequent filing, the sponsor of the supplemental response was the same witness who explicitly stated that she was not a tax expert during the evidentiary hearings. Aquarion Interrog. Resp. RRU-221; Late Filed Ex. 12; Tr., Nov. 28, 2022, 314, 321:8. Thus, although the Company ultimately provided additional documentation related to its EADIT

calculation (several weeks after the initial response was due), it failed to produce a tax expert who could corroborate these calculations.⁹²

In summary, based on the record evidence in this proceeding, the Authority finds that the Company has not adequately met its burden of proof with regard to its quantification and categorization of the EADIT.

The Authority finds it appropriate to begin returning some portion of EADIT to customers as a result of this proceeding. Therefore, the Company shall return over a five-year period the unprotected EADIT balance of \$1,020,029, or an annual amount of \$204,006. The resulting adjustment to EADIT amortization is \$2,600,846 (\$2,804,852 - \$204,006).

For the protected EADIT, the Authority directs the Company to engage an independent third-party accounting firm (*i.e.*, not the Company's current financial statement auditor) to perform a review to vet both the quantification and categorization of the Company's claimed protected EADIT. The Authority orders this review to be conducted as an agreed-upon procedures engagement in accordance with the attestation standards established by the American Institute of Certified Public Accountants. The Authority directs the Company to have the review conducted and results of the review submitted to the Authority for review and approval no later than one year after issuance of the Decision. Because this review is necessitated by the failure of the Company to substantiate its burden herein to the detriment of ratepayers, the cost of this review shall not be recoverable in rates. Upon satisfactory completion of the third-party review, the Authority will determine the appropriate method for returning the unamortized EADIT back to customers, which may include, but is not limited to, an immediate return to customers either through a distribution bill credit, a credit adjustment in the RAM calculation, or continuation of the regulatory liability until the Company's next rate case. The Authority further orders that the EADIT liability shall accrue carrying charges at the WACC rate until it is returned to customers.

5. Summary of Tax Adjustments

Based on the foregoing, the Authority determines that the reasonable and appropriate tax adjustments are as follows:

Table 35: PURA Determined Tax Adjustments (\$)

Payroll Tax	(209,416)
State	(2,403,121)
Federal	(5,612,381)
EADIT Amortization	2,600,846
Total	(5,624,072)

⁹² The Company also provided no explanation for why the full set of workpapers were not produced with its original response, even though such an explanation was explicitly requested by the Authority. See Aquarion Interrog. Resp. RRU-221; Tr., p. 320; Late Filed Ex. 12.

VII. APPROVED REVENUE REQUIREMENT

The table below summarizes the various components of the Company's approved revenue requirement, as adjusted by the Authority, and provides the total approved revenue requirement for the rate year.

Table 36: Approved Revenue Requirement

Section in Decision	Component	Amount
	Cost of Capital	
IV	Rate base	991,669,882
V	WACC	6.46%
	Subtotal	64,061,874
	Allowable Expenses	
VI.B	Operations & Maintenance	68,837,497
VI.C	Depreciation Expense	37,600,871
VI.B.14	Acquisition Adjustment	166,635
VI.E	Taxes	
	Taxes, Sales and Payroll	2,004,219
	Property Taxes	17,312,504
	State Taxes	1,639,809
	Federal Taxes	1,337,434
VI.E.4	EADIT Amortization	2,600,846
	Total Revenue Requirement	195,561,690

VIII. RATE DESIGN

A. SALES FORECASTS AND REVENUE

In order to determine the sales and estimated revenues the Company would achieve during the rate year, Aquarion used its 2021 Test Year billing determinants and applied adjustments in customer growth and usage per customer across residential, commercial, industrial, and public authority rate classes. Application, Sch. E-5.4. Projected annual growth adjustments to the Test Year data were based on actual usage data over a four-year average using data from 2017, 2018, 2019, and 2021. *Id.*, p. 2. For usage adjustments, the Company excluded 2020 because usage patterns across rate classes were impacted by the COVID-19 pandemic. Aquarion Interrog. Resp. RRU-253.

Aquarion asserts that its current rates are insufficient to recover the cost of providing safe and reliable service to its customers. Szabo & Unger PFT, p. 5. The Company attributes capital improvements placed into service since the Company's 2013 Rate Case as the primary driver of the revenue deficiency under its current rates. *Id.* According to the Company, the incremental revenue deficiency is approximately \$27.5 million for the Rate Year. *Id.*, p. 10. The Company provided an exhibit that compared current rates and revenues to the proposed rates and revenues for Rate Year 1 by rate

class, division, and for the total company. Application, Sch. E-5.1A, p. 5. Under current rates, total retail revenues were approximately \$198.25 million. Under the Company's proposed Rate Year 1 rates, the projected revenues totaled approximately \$225.75 million, a difference of \$27,497,825. Id.

The Company's Application included an exhibit that identified its miscellaneous service revenues. Application, Sch. E-5.2A, p. 94. In that exhibit, Aquarion identified pro forma and proposed revenues of \$546,925 in fees collected for late payment charges (LPC). Id.

The Authority examined the Company's Rate Year 1 forecast growth and usage adjustments. The Authority determines that the 2020 usage data was atypical as the impact from the pandemic influenced the increase or decline in water usage depending on rate class when compared to years 2017-2019 and 2021.⁹³ The Authority accepts the usage adjustments for the rate year as reasonable.

B. COST ALLOCATION

The Company's Cost of Service Study (COSS) utilized the Base-Extra Capacity method. Under this method, the various cost elements are assigned to the following cost functions: Base, Extra Capacity (maximum day and peak hour), and Customer (meters/services and billing and accounting) costs. Guastella Prefiled Test., Aug. 29, 2022, pp. 2-3. This methodology identifies and classifies the various cost components that comprise the revenue requirement, functionalizes those cost components according to the general design criteria and operation of a water utility, and allocates the functionalized costs to the customer classes. Id., p. 2.

The COSS included multiple schedules that supported the cost allocations for the functions described above. Id., Exhibit A-6-JFG-2 (COSS). The below table summarizes the revenue requirements data from Schedule 1 of the COSS and includes a PURA-calculated percentage of revenue contribution for each rate class.

⁹³ The 2020 usage data reflected higher residential usage across its divisions and lower commercial usage across its divisions compared to the four-year average for years 2017-2019 and 2021. Aquarion Interrog. Resp. RRU-253, Att. 1; Tr., Dec. 1, 2022, 893:1-18.

Table 37: Revenue Requirements (\$) and Rate Class % Contribution

Customer Class	Revenue Requirement	Percentage of Revenue Requirement
Residential (single)	\$123,480,146	57.9%
Multi-Family	22,155,898	10.4%
Commercial	33,474,143	15.7%
Industrial	3,991,930	1.9%
Public Authority	5,891,047	2.8%
Fire Services (capacity & hydrants)	24,238,369	11.4%
Total	\$213,231,533	100%

COSS, Sch. 1.

Generally, OCC found the Company's COSS to be reasonable and agreed with Aquarion's use of the Base-Extra Capacity cost methodology. Mierzwa Prefiled Test., Oct. 26, 2022, p. 6. One notable exception, however, is that OCC faulted the Company for understating the base consumption volumes for fire protection and recommended that the volumes be updated from 620,000 gallons to 2,539,750 gallons based on 2021 actual data to reflect Aquarion's actual recent experience. *Id.*, p. 7; Aquarion Interrog. Resp. OCC-82. Aquarion's COSS witness testified that he disagreed with the adjustment on the base fire protection volume based on the use of maximum flow and over a period of time, and using hydrant flushing water as part of the fire rate. Tr., Dec. 1, 2022, 900:8-12. In response, OCC's witness stated that he disagreed because the Company's response to OCC-82 indicated that the use was for firefighting, training, and testing, and not for hydrant flushing. Tr., 998:12-99:3.

According to OCC's calculations, this base volume adjustment would increase fire protection costs by an additional \$1,126,148, or approximately 4.6%. Mierzwa PFT, p. 8, Table 1. With this adjustment, OCC's revised total cost of service mirrored the Company's at \$213,231,533. *Id.* No further adjustment was necessary to the fire protection revenue allocation as the Company's initially proposed rates still recover revenues slightly in excess of the indicated cost of service. *Id.*, pp. 10-11. To summarize, despite its cost-of-service modifications, OCC recommends that the Authority accept the total revenue allocation amount proposed by the Company.

In assessing the Company's proposed COSS, the Authority is guided by the principle of cost causation and how well the study assigns costs to the customers that cause them. One way that cost causation can be approximated is by determining the functions certain costs tend to support and allocating those costs to the customer classes that utilize those functions. This principle is adhered to within the Base-Extra Capacity method.

The Authority reviewed the Company's COSS and compared the cost allocation and revenue contributions by rate class between current rates, the COSS, and proposed rates. Absent a major known change to a particular rate class, the Authority would expect

relative consistency between the cost allocations. Indeed, a comparison of the COSS schedules by rate class for total Company level reflects consistency between revenue contributions from current rates, design rates, COSS proposed rates, and application proposed rates as shown in the table below.

Table 38: COSS Schedules Revenue Contribution Percentages Compare

	Current Rates %	Designed Rates %	COSS Proposed Rates%	Application Proposed Rates
Residential	64.0	65.8	65.2	65.2
Commercial	15.1	15.0	14.8	14.8
Industrial	1.8	1.8	1.8	1.8
Public Authority	2.8	2.6	2.6	2.6
Fire Protection	13.0	11.2	12.0	12.1
Sales for Resale	2.0	2.4	2.4	2.4
Miscellaneous	1.5	1.3	1.3	1.3
Credits & Adjustments	(0.1)	(0.2)	(0.2)	(0.1)

Late Filed Ex. 51, Att. 1.

While the Authority finds the Company's use and implementation of the Base Extra Capacity method appropriate as it allocates costs based on cost causation, the Authority agrees with OCC's updated fire protection volumes based on the previously noted testimony. Accordingly, the Authority directs the use of the modified fire protection base consumption volumes recommended by OCC. For its next rate case, the Company is directed to review its inputs related to fire protection to ensure that the most accurate values are being utilized in the COSS. Despite its cost-of-service modifications, OCC accepted the revenue allocation proposed by the Company; therefore, the Authority determines there is no need for the Company to file an updated COSS in the instant proceeding. Instead, the Company shall proportionately reduce its proposed allocated revenue to each rate schedule to match the overall revenue requirement ordered in this case.

C. RATE DESIGN

1. Overview

Rate design objectives include: the approval of cost-based, just, and reasonable rates that promote further equalization of rates across the Company's divisions; revenue stability; affordability of water service for low-income households at subsistence consumption levels; and water conservation incentives. The Company's proposed rate design seeks to further these goals by equalizing rates across divisions, increasing meter charges, introducing a 4-tiered inclining block rate design for single family residential customers, increasing fire protection service charges, and introducing a low-income discount rate. Szabo & Unger PFT, pp. 45-49. The Company seeks to limit customer bill increases to no more than 2 to 2.5 times the overall revenue increase. *Id.*, p. 46. The

notable exception is the Company's Valley Water Division (Valley), where rates will remain unchanged as Valley was acquired by Aquarion in September 2021, and its customers experienced a rate increase that became effective on January 1, 2022. Id., p. 22.⁹⁴

The Authority recognizes an inter-relationship or interdependency in achieving these goals in that the pursuit of one goal may be counterproductive in the pursuit of another goal, and therefore, some degree of balancing must be applied in deciding a just and reasonable rate design.

2. Single Year Rate Design

As described in Section III.B. Multi-Year Rate Plan, the Authority approves a revenue requirement for Rate Year 1 and rejects Aquarion's Multi-Year Rate Plan. The Company will be directed to file a revised single year rate design plan consistent with the Authority's findings contained herein that will include revised tariffs and revenue proof.

3. Inclining Block Rate Design

The Company is proposing a four-tiered inclining block rate design for its residential single-family customers with the following four tiers of monthly consumption measured by hundreds of cubic feet (CCF): Tier 1 - Up to 5 CCF; Tier 2 - Over 5 CCF, up to 9 CCF; Tier 3 - Over 9 CCF, up to 20 CCF; and Tier 4 - Over 20 CCF. Szabo & Unger PFT, p. 49.

The Company's proposed inclining block rate structure for the single-family residential customer class would apply to all but three of its divisions with the exceptions being Eastern–Tyler Indian Spring & Clearview, Northern, and Valley Divisions. Id. An inclining block tiered rate design establishes water usage thresholds with different price points. The rates increase as usage exceeds a tier's monthly threshold limit. Under Aquarion's proposed design, Tier 2 imposes a 10% premium over Tier 1, Tier 3 imposes a 10% premium over Tier 2, and Tier 4 imposes a premium of 20% over Tier 3. Id., pp. 48-49.

The table below shows Aquarion's proposed four-tier inclining block rate design for single-family residential customers that would apply to all of its divisions, except Eastern – (Tyler Indian Spring & Clearview), Northern and Valley, with the rate per CCF:

⁹⁴ See Decision, Sept. 22, 2021, Docket No. 20-11-14, Application for Valley Water Systems, Inc. for Amendment of Rate Schedule (Valley Decision).

Table 39: Aquarion’s Proposed Inclining Block Rate Design

Tier:	Monthly Consumption Hundred Cubic feet (CCF) = 748 gallons	Rate per CCF*:
Tier 1	First 5 CCF	\$ 4.999
Tier 2	Over 5 CCF, up to 9 CCF	\$ 5.499
Tier 3	Over 9 CCF, up to 20 CCF	\$ 6.049
Tier 4	Over 20 CCF	\$ 7.247

*assumes a 10% meter service charge increase

Szabo & Unger PFT, p. 49.

OCC recommends that the Authority adopt Aquarion’s proposed inclining block rate design and surmised that it would likely result in lower bills for low-income customers and also send pricing signals to higher-volume residential customers who will face increased costs due to higher water usage. Mierzwa PFT, p. 12.

DEEP recommends a three-tiered rate design that aggressively targets discretionary residential uses, such as lawn irrigation, while encouraging efficiency for non-discretionary uses. DEEP Brief, p. 3. To accomplish its recommended three-tiered rate design, DEEP suggests combining Aquarion’s proposed tiers two and three. Id. Specifically, the tiers would be designed as follows: “a baseline tier rate up to 5 CCF of consumption per month, a second tier of over 5 CCF per month up to 15 CCF per month at a rate that is 10% higher than the baseline tier, and third tier that is 20% higher than the second tier.” DEEP Brief, p. 6; see also Aquarion Interrog. Resp. BETP-2. Further, DEEP highlighted that Aquarion is not aware of any other companies utilizing a four-tier block rate design. Tr., Dec. 1, 2022, 908-09.

Implementing an inclining block rate structure for residential single-family customers is a significant change from the Company’s current rate design. An inclining block rate structure is designed to encourage water conservation by sending price signals for excessive water use for discretionary uses such as lawn irrigation. High water usage customers may consider limiting discretionary water use because it is more costly. In contrast, Aquarion’s current residential single-family volumetric rate design consists of either a two-tiered, declining block rate structure for its Eastern, Western, and Southern divisions with a reduced rate for monthly usage in excess of 140 CCFs, or a single water usage rate for its Northern and Topstone, Rural, Brookfield, and Ron Black A-C smaller Eastern divisions. Application, Sch. E-5.0A; Tr., Dec. 1, 2022, 912:3-5. The current rate design does not encourage water conservation.

The Authority is generally in favor of the inclining rate design for the reasons set forth by the Company, including affordability of subsistence level water usage and incentives to encourage water conservation and discourage wasteful water use.

However, the implementation of tiered inclining rates would be the first time these customers have been billed in this fashion, which is very different from the current rate design. Because this is a new rate design, the Authority finds that DEEP's recommendation for a three-tiered design, rather than the Company's proposed four-tiered design, would be a less drastic change for customers and is more likely to yield the desired adherence.

The Company provided another inclining rate block rate design that combines the Company's proposed Tiers 1 and 2, thereby making the first-tier threshold 9 CCF, which is near the average monthly household consumption level of 9.4 CCF. Aquarion Interrog. Resp. RRU-396 and RRU-397. This design would benefit households that maintain monthly consumption at or below the average usage, add a premium to all consumption above average, while adding an additional premium onto excessive consumption above 20 CCF. This proposal introduces the inclining tier rates in a more gradual fashion than Aquarion's original four-tiered design and can be revisited during the next rate case once customers and the Company gain more experience with the design.

With these considerations, the Authority directs the Company to design a three-tiered volumetric rate structure for single-family residential customers, with the first tier up to 9 CCF, the second tier above 9 to 20 CCF, and the third tier over 20 CCF. Since the Tier 1 has been expanded from the proposed 5 CCF to 9 CCF, thereby combining Tiers 1 and 2, the rate differential between Tier 2 and Tier 1 shall be 20%, and the rate differential between Tier 3 and Tier 2 shall be 20% as depicted in the table below. The Authority finds that the three-tiered volumetric rate structure establishes a sound foundation for long-term water conservation today by sending appropriate price signals via significant percentage rate threshold increases to high usage customers who use water for discretionary purposes. In subsequent rate cases, the pricing signals may further drive customer behavior towards greater conservation dependent on the rate outcome of those cases. The Authority accepts Aquarion's model adjustments for conservation and adopts the three-tier rate design as shown in the table below.

Table 40: Approved Three-Tiered Volumetric Rate Structure

Tier:	Monthly Consumption Hundred Cubic feet (CCF) = 748 gallons	Rate
Tier 1	First 9 CCF	Initial Consumption Rate
Tier 2	Over 9 CCF, up to 20 CCF	20% higher than Tier 1 Rate
Tier 3	Over 20 CCF	20% higher than Tier 2 Rate

Aquarion Interrog. Resp. RRU-397.

4. Rate Consolidation (Single-Tariff Pricing)

A principal rate design consideration in the instant case is to consolidate Aquarion rates by maintaining consistent meter charges across divisions, and where possible, to consolidate and standardize volumetric water rates across Divisions, including a uniform application of inclining block rates for the residential customer class. The Authority generally accepts the Company's proposal to achieve these equalization goals, with the exception provided below on the design of certain rate elements.

The Company provides water service to thirteen different divisions across the State of Connecticut. Szabo & Unger PFT, p. 16. While meter charges across Aquarion's divisions are already equalized (i.e., all divisions are charged the same rate by customer class), current volumetric water usage rates are not equalized. Since Aquarion's last rate case, the Company has acquired and integrated 19 water systems. Morrissey PFT, p. 8. To consolidate rate schedules of both the legacy Divisions and the newly acquired Divisions, Aquarion looks to the COSS for guidance on cost-causation to move toward single tariff pricing and rate equalization amongst all Aquarion Divisions. Szabo & Unger PFT, pp. 44-46. In this proceeding, the Company's analysis showed that it is not practical to accomplish equalization in a single rate case, as there is also the required balancing of longstanding rate design principles of cost-causation with rate gradualism. Therefore, equalization will take place over multiple rate cases. As a guideline, the Company is limiting customer bill increases to no more than 2 to 2.5 times the overall revenue increase. Id., p. 46. The Company testified that when looking at rate equalization, some divisions were paying less than its Eastern Division, where the majority of its customers reside. Tr., Dec. 1, 2022, 906:2-7.

Accordingly, the Company's proposed rate design reflects rate equalization across all but three of its thirteen divisions: Eastern Division – Tyler Indian Spring & Clearview, Northern Division, and Valley. Szabo & Unger PFT, p. 45. The Company's Valley customers recently experienced a 20% rate increase effective January 1, 2022. Id. The current residential usage rates for Eastern Division Tyler Indian Spring & Clearview and Northern Division are priced lower than other Aquarion divisions. Application, Sch.E-5.0A, pp. 7, 10. The Company's proposed usage rates for these divisions increased rates and introduced four-tier inclining block rate, but at different price points than other divisions. Id. Notably, no party opposed the Company's equalization proposals.

5. Customer Service Charge

The Company proposes a 10% increase in meter charges across all Divisions and all customer classes. Szabo & Unger PFT, p. 48. Citing the zeroing out of the 10% WICA surcharge in the instant rate case, the Company argues that this 10% increase maintains current total levels on meter charges (inclusive of the WICA surcharge). Id. The Company's COSS suggests a decrease in meter charges from the current meter rate levels without consideration of the WICA 10% surcharge. Guastella PFT, Sch. 17. Specifically, on a percentage basis, the differential ranges from 4.5% for a 5/8" meter to 40.3% for an 8" meter. Id.

OCC opposes the Company's proposal to increase the meter charges. Mierzwa PFT, p. 11; OCC Brief, p. 59. At the hearing, the Company conceded that increases in the meter charges will cause bills of low usage households to increase. Tr., Dec. 1, 2022, 878:16-22.

This effect of increasing meter charges is counterproductive to the affordability objectives pursued through the inclining rate design for the volumetric rates. When combined with the fact that the Company's cost of service analysis suggests that meter charges should be decreased, the Authority does not find an increase in meter charges just and reasonable. Furthermore, the Authority is unpersuaded by the Company's argument that the reset of the current 10% WICA surcharge to 0% offsets Aquarion's proposed 10% increase to meter charges when their own cost of service suggests otherwise. See Guastella PFT, Sch. 17; Szabo & Unger PFT, p. 48. The WICA surcharge merely applies the same percentage increase to meter and consumption charges as a temporary measure until base rates are set in a subsequent rate proceeding. Therefore, because the COSS results show that meter costs are below current meter rates, the Company's proposal to increase the meter charges is denied and the Company is ordered to maintain the current levels of the meter charges.

6. Fire Protection

The Authority finds the public and private fire protection rate design to be acceptable, subject to the modifications described in Section VIII.B, Cost Allocation, and the approved revenue requirement revisions determined by the Authority in the instant decision.

7. Miscellaneous Fees

The Company proposed changes to its miscellaneous service charges in the instant proceeding, including the elimination of the Valley Division's current miscellaneous service charge, thereby incorporating all customers under one set of miscellaneous charges. Szabo & Unger PFT, p. 67. The Company also recommends the elimination of tapping fees, which will eliminate the potential costs being borne by other ratepayers should the tapping fees fall short of the actual costs incurred by the Company. Id.; Aquarion Interrog. Resp. RRU-84. Additionally, the Company proposes a universal fee for all backflow prevention device tests and elimination of meter vault charges. Szabo & Unger PFT, p. 67. Lastly, the Company is requesting a change to lien filing fees to have these fees set "at cost" to remove the potential of costs being borne by other ratepayers, as well as the elimination of the economic development rate because it is not applicable to any current customers and is contrary to the Company's conservation initiative. Id., p. 68.

The Authority reviewed the Company's proposed changes to miscellaneous charges and the changes discussed during the evidentiary hearing. Tr., Dec. 1, 2022, 913:19-919:19. Notably, no party expressed opposition to these changes. The Authority is satisfied that the Company has demonstrated these changes are reasonable and, thus, approves them as proposed.

D. VEOLIA WHOLESALE ALLOCATION

The Company seeks a rate increase of \$1.6 million, or 41.63%, for Veolia, a company that purchases water from Aquarion pursuant to a water supply agreement. Szabo & Unger PFT, p. 47. The rate increase to Veolia is derived from the ACAM approved by the Authority in Docket No. 19-12-27. The ACAM governs the allocation of the total cost of production between Aquarion and Veolia for the water Aquarion sells to Veolia. Id., p. 53.

Veolia, as an intervenor in this case, states that they have reviewed the application of the ACAM by the Company and have no objection to its proposal. Veolia Brief, p. 3. Veolia does, however, request that any Authority orders that impact inputs to the ACAM be flowed through the ACAM to adjust the costs allocated to Veolia. Id., pp. 3-4.

Additionally, the New York Municipalities moved to intervene in this proceeding because Veolia is their public water supplier. Motion No. 2, p. 1. The New York Municipalities raised concerns that the adjustments to the inputs in the ACAM have not been updated in the cost of service and proposed adjustments to the calculation of the resale rate in which Aquarion sells water to the New York Municipalities. New York Municipalities Brief, pp. 2-3. Aquarion is making improvements to the SWRP to increase water supply, but the allocation of capital costs puts a significant burden on Aquarion's Greenwich Division. Id., p. 3. As such, the NYM request the Authority reduce the allocation of capital costs for the SWRP to the Greenwich Division and assigned to Veolia and flow through adjustments in the rate of return and costs of operations to the methodology used to set the resale rate. Id., p. 9.

The Authority determines that the record does not support the NYM's position and finds the calculations presented in the NYM's brief unclear. Conversely, in weighing the evidence, the Authority finds Veolia's request reasonable and consistent with sound ratemaking principles. Accordingly, the Authority will direct the Company to comply with updated ACAM results, where appropriate, to reflect adjustments the Authority has made in the instant decision.

E. RATE/REVENUE ADJUSTMENT MECHANISMS

1. WICA

WICA is an interim rate adjustment mechanism unique to Connecticut that allows water companies to recover the costs of replacing existing water system infrastructure in between general rate case proceedings, thereby enabling the acceleration of the rate of replacement and/or rehabilitation of existing water system infrastructure to mitigate the effect of decay of aging water systems and to promote conservation measures. See Conn. Gen. Stat. § 16-262w. The amount of a water company's WICA charged to customers cannot exceed 10% (10% WICA Cap) of the water company's annual retail water revenues approved in its most recent rate case and also cannot exceed 5% of such revenues for any 12-month period between general rate case proceedings. Conn. Gen. Stat. § 16-262w(i). Once a water company reaches the 10% WICA Cap, it cannot propose an incremental WICA surcharge unless the company appears before the Authority for a

rate proceeding. See id. Upon Authority approval of new base rates, however, a water company's WICA shall be reset to zero. Id. At that time, the plant associated with the current WICA charge will become part of base rates, subject to a finding of usefulness and prudence.

Effective April 1, 2021, Aquarion was authorized to implement a 9.78% WICA surcharge, thereby (practically speaking) reaching the 10% WICA Cap. Szabo & Unger PFT, p. 21. As of the date of this Decision, the Company's WICA surcharge will be reset to zero, and the Company may submit future WICA filings to the Authority in accordance with Conn. Gen. Stat. § 16-262w and the April 30, 2008 Decision in Docket No. 07-09-09, DPUC Review and Investigation of the Requirements for Implementation of a Water Infrastructure and Conservation Adjustment.

2. Revenue Adjustment Mechanism

A water company is authorized to utilize an annual RAM. Conn. Gen. Stat. § 16-262y. The RAM filing reconciles the Company's actual revenues to its allowed revenues (commonly referred to as decoupling) and the variance results in either a RAM surcharge (when allowed revenues exceed actual revenues) or a RAM surcredit (when actual revenues exceed allowed revenues), which is applied as a percentage adjustment to customer bills.

Since the 2013 Decision, Aquarion has annually filed a RAM for Authority approval. 2013 Decision, Order No. 7, p. 133. Most recently, the Authority approved Aquarion's 2021 RAM of 0.48%, effective April 1, 2022, through March 31, 2023. 2013 Decision, Motion No. 21 Ruling, March 23, 2022. According to the Company, "[a]ctual revenues in 2021 include decoupling adjustments totaling \$1,470,816 to reconcile collected revenue with authorized revenue for both the base revenue adjustment mechanism (the "RAM"), totaling \$1,119,774, and the WICA reconciliation mechanism, totaling \$351,040." Szabo & Unger PFT, p. 21.

The RAM surcharge currently applies to water rates, sales for resale, and non-fixed contractual miscellaneous charges. 2013 Decision, Motion No. 21 Ruling, p. 2. Cost allocation of the RAM is applied to all customers; however, the Company excludes revenues from Valley customers in calculating the RAM because a separate RAM calculation is applied to Valley customers.

Beginning with the 2023 RAM filing, and annually thereafter, the Company is allowed to submit information in its annual RAM filing regarding Aquarion's actual bad debt expense, as detailed in Section VIII.F.2, Incremental Bad Debt Write-Off Regulatory Asset.

Additionally, beginning with the 2024 RAM filing, and annually thereafter, the Company is directed to submit as part of its annual RAM filing the amount of the Aquarion officer compensation and the Management Fee customers are paying through the RAM, as well as how much is being returned to customers through the RAM.

In addition, beginning with the 2024 RAM filing, and annually thereafter, the Company is directed to submit as part of its annual RAM filing the revenue shortfall in a given calendar year resulting from the provision of the LIRAP that the Company believes to be prudently incurred.

Finally, the Company submitted miscellaneous service revenues for late payment fees of \$4,676 for the Test Year and \$546,925 pro forma and proposed revenues, respectively. Application, Sch. 5.2A, p. 94. The Authority determines that the revenues obtained from late payment fees are additional revenues that extend beyond the Company's allowed revenue requirement and should be removed from rate base. In terms of proposed revenues, the Authority directs Aquarion to remove the proposed miscellaneous revenues of \$546,925 for late payment fees. The reduction of the late payment fee reduces the pro forma revenues as follows: \$198,078,132 - \$546,925 = \$197,531,207. Application, Sch. C-1.0.

Furthermore, the Authority directs the Company to include the revenues collected from late payment fees in its annual RAM filing as a "surplus" for RAM purposes that will serve to offset potential revenue shortfalls.

3. Earnings Sharing Mechanism

An earnings sharing mechanism (ESM) requires a water company's earnings above its allowed ROE in any calendar year to be split equally between the water company's ratepayers and shareholders. Conn. Gen. Stat. § 16-262y(f).

Concurrently with the implementation of Aquarion's RAM, the Authority established the Company's ESM, which is measured on a cost of capital basis. 2013 Decision, p. 110. Annually, the Company is required to submit compliance filings providing the amount of earnings in excess of the allowed ROE over the previous calendar year. *Id.*, pp. 110, 136. The Company then shares the earnings in excess of the allowed ROE equally between its customers and shareholders. *Id.*, p. 110.

Since the Company's ESM implementation, Aquarion has only calculated an ROE in excess of the authorized amount for a single year (2014), in which the calculated ROE was 10.28%. Tr., Dec. 5, 2022, 1329:12-18. Specific to that filing, the excess ROE was applied to the carried capital position, which included a lower equity position of 50.44% versus the authorized 51.63%. Tr., 1332:6-16. Using an actual lower carried equity position benefited ratepayers for that respective year. EOE Brief, p. 27.

In the instant proceeding, EOE recommends that the Authority provide guidance to the Company whereby the ESM's ROE is calculated using the lesser of the (a) authorized or (b) carried equity position. *Id.* Accordingly, the Authority directs the Company to calculate any future determination of the ESM ROE using the lesser of the Company's authorized equity position or the lesser of the actual equity carried position at the time of the calculation. This practice will allow the Company to still achieve its allowed ROE based on the authorized capital structure, while also ensuring that ratepayers are provided with a more appropriate sharing of excess earnings when the ESM is triggered

as the effect of a higher than authorized equity position is mitigated with the use of the lesser of either the authorized or actual equity position at the time of the ESM calculation.

F. RATE-RELATED PROPOSALS

1. Low-Income Rate Assistance Program

a. Summary

In the Merger Decision, the Authority directed Aquarion to “develop and propose in its next rate case a low-income program that could best benefit its customers in need.” Merger Decision, p. 26. In response, Aquarion proposed a LIRAP.

The LIRAP would provide a 15% credit to residential customers who meet the income eligibility requirements and would be applied to the entirety of the customer’s bill. Teixeira PFT, pp. 17-18; Aquarion Interrog. Resp. RRU-379. Both tenants and owners are eligible for LIRAP. Teixeira PFT, p. 18. However, the water bill must be in the tenant’s name for the tenant to be eligible.^{95,96} Teixeira PFT, p. 18; Tr., Dec. 1, 2022, 1018:7-18.

Since this is a new customer offering, Aquarion asserts that the cost of the LIRAP is unknown and has not yet been factored into the rate design in this proceeding. Morrissey PFT, p. 31; Tr., Dec. 1, 2022, 1041:19-1042:22. The Company therefore requests that the impact of the program on the Company’s revenue collections be deferred and accounted for through future RAM proceedings. Morrissey PFT, p. 31. Once implemented, the Company proposes to track the participation and impact of the LIRAP to determine whether it is advantageous to factor the program into rate design at the time of its next rate case. *Id.*; Tr., Dec. 1, 2022, 1043:2-8. At the time of its next rate case, the Company also proposes to submit its recommendations and adjustments to the LIRAP. Aquarion Interrog. Resp. RRU-325; Tr., Dec. 1, 2022, 1074:1-4.

Based on the record in this proceeding, the Authority approves the LIRAP in the interim, subject to the direction provided herein, unless and until modified by the Authority in a future proceeding. The Authority directs the Company to submit by January 1, 2026, a detailed proposal containing modifications to the LIRAP, such as a tiered discount, including the number of tiers and amount of the discount, changes to the eligibility requirement, and cost control measures, and a detailed proposal regarding the implementation of an arrearage forgiveness proposal. The proposals shall include the costs and an implementation timeline to make such modifications and implement such arrearage forgiveness program. The Company shall share its proposals with EOE and OCC, as well as any other interested stakeholders, at least 60 days prior to its filing and

⁹⁵ Aquarion testified that 67% of the people that live below the poverty level in Bridgeport live in a multi-family housing. Tr., Dec. 5, 2022, 1212:7-17. 6,427 of the Company’s customers in Bridgeport are multi-family houses. Late Filed Ex. 63, Att. 1. In addition, 12,541 of Aquarion’s customers are multi-family houses. *Id.*

⁹⁶ The Company testified that it is willing to work with Operation Fuel to help tenants receive the LIRAP if there is some sort of cooperation between the landlord and tenant. Tr., Dec. 5, 2022, 1178:4-1179:2. The Company also testified, however, that Aquarion is not sure it is possible to qualify a tenant for LIRAP. Tr., 1211:6-10.

incorporate feedback prior to submission to the Authority. The Authority will consider the proposals in a future proceeding.

b. Objectives

i. Water Affordability

A meaningful low-income program should be grounded in meeting two objectives: (1) achieving water affordability, which is defined as the allocation of no more than 2% of household income to water bills, Colton PFT, p. 24; and (2) reducing uncollectible expenses paid by all ratepayers, in part, by reducing the number of service disconnections, service reconnections, and terminations. *Id.*, pp. 51-55. While there is insufficient evidence by which to measure the ability of the LIRAP to achieve water affordability for all the Company's low-income customers or to measure the impact on the uncollectible expenses paid by all ratepayers, there is evidence that the LIRAP will provide some rate relief to Aquarion's low-income residential customers and is likely reduce uncollectibles.

Although Aquarion asserts the LIRAP would assist customers in affording their water bills, the Company did not specifically design the LIRAP with water affordability in mind. *See* Tr., Dec. 5, 2022, 1159:19-23. Rather, the Company selected the 15% credit because the Authority approved a 15% credit for CWC in the 2021 CWC Rate Case Decision. Aquarion Interrog. Resp. RRU-325 ("The Company determined it was a reasonable proxy for the [proposed LIRAP] since it had been reviewed and approved by the Authority"); Tr., Dec. 5, 2022, 1160:3-5; 1255:12-18. In addition, the Company asserted that the LIRAP should be simple for customers to understand since it would be a new program for the Company. Aquarion Interrog. Resp. RRU-325; Tr., Dec. 1, 2022, 1073:16-25; 1074:12-15; Tr., Dec. 5, 2022, 1140:3-15, 1141:7-12. Aquarion also asserted that implementation of the LIRAP as proposed would be quick and would not result in significant administration costs. Tr., Dec. 5, 2022, 1169:22-1170:3, 1170:17-21.

Aquarion did not develop any metrics or other methodologies by which to measure whether its rates and the resulting bills are affordable at the individual customer level. Specifically, Aquarion did not conduct a bill frequency analysis to determine the average monthly bill for residential customers in each of the Company's divisions, nor did it conduct a price sensitivity analysis that would calculate the difference between the water bills at Aquarion's proposed rates and a rate that would achieve water affordability when designing its LIRAP proposal. *See* Aquarion Interrog. Resp. RRU-336 and EOE-54. In addition, the Company asserted that it does not have a metric by which to measure water affordability and therefore Aquarion could not rely on a metric to arrive at a discount. Aquarion Interrog. Resp. 326; Tr., Dec. 1, 2022, 1071:25-1072:3. Aquarion also does not have and did not rely on any studies or reports that discuss the relationship between low-income status or the impact of low-income burdens on, for example, nonpayment disconnections, level of arrears, or payment patterns when designing its LIRAP proposal. Aquarion Interrog. Resp. OCC-309 and 310; Tr., Dec. 5, 2022, 1251:15-18. Lastly, Aquarion does not identify and track its low-income customers. Aquarion Interrog. Resp. 271. The Company does, however, agree that an important component of an impactful

low-income program is to make the rate that a customer is required to pay affordable within the customer's budget. Tr., Dec. 5, 2022, 1159:14-20.

Without information by which to measure whether Aquarion's rates and the resulting bills are affordable at the individual customer level, it is difficult to determine the impact the LIRAP will have on low-income customers and to assess whether additional tiers are needed and if so, at what income levels. Aquarion indicated it would not, however, be opposed to collecting data to more closely study the specific needs of the Company's customers, including financial need based on income level. Aquarion Interrog. Resp. RRU-325; Tr., Dec. 1, 2022, 1074:1-4; Tr., Dec. 5, 2022, 1142:23-1143:3. Accordingly, the Authority directs the Company to track the number of customers enrolled in LIRAP and the impact of the LIRAP on low-income customers' ability to pay their bills and to submit such data in the compliance filing required in Section VIII.F.1.j, Reporting Requirements.

ii. Reduction in the Uncollectible Expenses

The Company provided no evidence indicating that a 15% LIRAP will reduce the uncollectible expenses paid by all Aquarion ratepayers.⁹⁷ The Company stated that it does not know the direct impact that LIRAP will have on uncollectibles or the general operations of the Company, but asserted that it is likely customers who qualify for the LIRAP will potentially be able to pay their bills more readily and therefore reduce the potential for disconnections and arrearages. Aquarion Interrog. Resp. RRU-323. Accordingly, the Authority directs the Company to track the impact of LIRAP not only on uncollectibles, but also on the dollar level and age of arrearages, and to submit such data in the compliance filing required in Section VIII.F.1.j, Reporting Requirements.⁹⁸

c. Eligibility and Enrollment

i. Customer Eligibility

In Aquarion's proposal, household income eligibility for LIRAP is set at 60% state median income (SMI), which is outlined in the table below. Aquarion Interrog. Resp. EOE-40; Tr., Dec. 1, 2022, 1065:1-10. This means that if a customer's household income is at or below 60% SMI, the customer is eligible to receive the 15% LIRAP credit. The Authority approves of setting the maximum household income eligibility for LIRAP at 60% SMI as the eligibility level is the same as other low-income programs, such as the Low-Income Household Water Assistance Program (LIHWAP) and the Connecticut Energy Assistance Program (CEAP). See Tr., Dec. 1, 2022, 1024:19-10:25:9, 1014:11-10:15:6; see also, Tr., Dec. 5, 2022, 1125:23-1126:1.

⁹⁷ The Company does not have information on collections directed towards low-income customers. Aquarion Interrog. Resp. OCC-279, OCC-281, and OCC-283.

⁹⁸ The Company already collects data on uncollectibles and reports it to the Authority. See Tr., Dec. 5, 2022, 1149:7-10, 1248:5-13; see also Late Filed Ex. 66, Att. 1. Using that data, as well as data collected after the LIRAP is implemented, the Company will be able to track the impact of the LIRAP on uncollectibles.

Table 41: Household Income Eligibility Requirements

Based on 60% State Median Income (for 2022 to 2023)	
Household Size	60% SMI
1	\$39,761
2	\$51,996
3	\$64,230
4	\$76,465
5	\$88,699
6	\$100,933
7	\$103,227
8	\$105,521

Tr., Dec. 12, 2022, 1126:6-13.

ii. Enrollment

Aquarion proposes that Operation Fuel will qualify and enroll customers in the LIRAP.⁹⁹ Teixeira PFT, p. 18. The Company asserts it cannot enroll customers as it does not collect personal information, such as income information or social security numbers, and does not have systems in place to comply with Payment Card Industry security requirements related to the collection and retention of customer personal information.¹⁰⁰ Aquarion Interrog. Resp. EOE-41; Tr., Dec. 15, 2022, 16-20. In addition, the Company's billing system does not have the ability to identify customers that are eligible for a financial hardship designation, *i.e.*, code customers as financial hardship, and Aquarion has not explored a billing system modification that would allow for financial hardship coding. Aquarion Interrog. Resp. RRU-432; Tr., Dec. 5, 2022, 1216:10-15. According to Aquarion, its proposal is the most efficient way to handle the program, without incurring significant IT and privacy issues as it relates to personal data. Aquarion Interrog. Resp. EOE-41. Additionally, Aquarion states the proposal is similar to how the Company handles its customer assistance program (CAP). Aquarion Interrog. Resp. RRU-337.

The Company asserts that if a customer is already enrolled in a low-income discount program through Operation Fuel with the same or more stringent eligibility requirements as the LIRAP, *i.e.*, 60% SMI, such as CEAP, Operation Fuel would automatically qualify the customer for the LIRAP program, making the qualification and enrollment process simple. Aquarion Interrog. Resp. BETP-21; Tr., Dec. 1, 2022, 1024:19-10:25:9.

⁹⁹ The town social services agencies would promote the LIRAP. Teixeira PFT, p. 18. The Company would not work directly with the town social services agencies, but rather would communicate the availability of the LIRAP with them. Tr., Dec. 5, 2022, 1133:9-10, 15-19, 23-25. The town social services agencies would refer customers to Operation Fuel. Tr., 1133:112-15. Operation has a relationship with the town social services agencies. Tr., 1133:11.

¹⁰⁰ Notably, Operation Fuel identifies customers eligible for the CAP through an account number, name, and address. Tr., Dec. 5, 2022, 1144:10-15.

Although the eligibility requirements for LIHWAP and LIRAP are the same, *i.e.*, 60% SMI, Aquarion asserts it did not explore automatically enrolling customers that receive LIHWAP funds into the LIRAP. See Tr., Dec. 1, 2022, 1014:11-10:15:6; see also Tr., Dec. 5, 2022, 1125:23-1126:1. According to the Company, Aquarion does not track customers who receive benefits through LIHWAP. Aquarion Interrog. Resp. OCC-290.

The Authority finds that the Company is missing opportunities to streamline and simplify the enrollment of customers in the LIRAP by not automatically enrolling all LIHWAP recipients and making billing modifications to allow for financial hardship coding. Accordingly, the Authority directs Aquarion to explore a billing system modification that would allow for financial hardship coding of the Company's residential customers and submit as a motion for review and approval by June 1, 2025, a detailed billing system modification proposal, including the costs and implementation timeline associated with the proposal.

iii. Reenrollment

Under Aquarion's proposal, a customer is required to reapply one year after the customer becomes eligible. Aquarion Interrog. Resp. RRU-330. The Company asserts that the reenrollment process is the same as the initial enrollment process. Tr., Dec. 1, 2022, 1027:13-21. Since customers will be enrolling throughout the year rather than by a specific date, reenrollment will be required on different dates. Aquarion Interrog. Resp. RRU-330. To ensure a customer is aware that his or her enrollment in the LIRAP will end unless the customer reenrolls by a certain date, Aquarion testified that it could develop communications that would be sent to the customer informing the customer that it is time for reenrollment in LIRAP. Tr., Dec. 1, 2022, 1027:8:12. Accordingly, the Authority directs Aquarion to develop a reenrollment communication and to submit it as part of the compliance filing required pursuant to Section VIII.F.1.j, Reporting Requirements.

A customer is also required to reapply if the customer changes premises but remains a customer of the Company. Teixeira PFT, p. 18. Requiring a customer to reenroll every time the customer moves to a new residence would, however, negatively impact program participation since low-income customers are likely to move more frequently than non-low-income populations. Colton PFT, p. 71. The Company asserts reenrollment in LIRAP when a customer changes premises is necessary because it does not collect social security numbers, making it difficult to verify the customer in the new address is the same person as the customer receiving the LIRAP.¹⁰¹ Tr., Dec. 5, 2022, 1147:10-15. Aquarion did, however, express willingness to explore this as an option. See Tr., 1147:8-15. Accordingly, the Authority directs the Company to submit as a compliance filing no later than 90 days after issuance of the Decision a proposal to eliminate the reenrollment process for customers who change addresses within Aquarion's service territory. OCC proposed one way in which the Company may avoid the reenrollment requirement, which is to require customers who change their addresses to notify Aquarion

¹⁰¹ When an Aquarion customer changes premises, the customer receives a new account number. Tr., Dec. 5, 2022, 1147:16-19.

of their new address and of their prior participation in the LIRAP to continue to receive benefits under the program. OCC Brief, p. 7.

iv. Customer Removal

The Company proposes removing a customer from the LIRAP at the discretion of the Company if: (1) the customer no longer meets the eligibility requirements; (2) it is determined the customer has filed a fraudulent claim for eligibility; or (3) the program is discontinued for all customers. Aquarion Interrog. Resp. RRU-327; Tr., Dec. 5, 2022, 1147:20-1148:3. According to the Company, it will contact the customer in writing to explain the reason for the disqualification prior to the customer's removal from the LIRAP. Aquarion Interrog. Resp. BETP-19. Also, Aquarion asserts that there will be a process for appeal to ensure that the Company has "all the facts" and Operation Fuel would assist in the appeal process. Tr., Dec. 5, 2022, 1148:3-9. The Authority approves the removal process proposed by the Company but directs the Company to add to the list of reasons that a customer may be removed when the customer stops being an Aquarion customer, including when the customer stops being a customer of the Company as a result of having the customer's service disconnected for nonpayment.

d. Additional Partnerships

In Aquarion's proposal, only Operation Fuel can enroll customers in the LIRAP. Teixeira PFT, p. 18. However, in order to capture the maximum number of eligible Aquarion customers, entities in addition to Operation Fuel need to facilitate customers enrollment into the LIRAP. Community Action Agencies (CAA) currently enroll customers in LIHWAP, as well as CEAP, and therefore have income and household size information for any customer applying for those programs. Decision (EDCs Low-Income Discount Rate Decision), Oct. 19, 2022, Docket No. 17-12-03RE11, PURA Investigation into Distribution System Planning of the Electric Distribution Companies – New Rate Designs and Rates Review, pp. 17, 31; Tr., Dec. 1, 2022, 1013:17-22. Partnering with CAAs would therefore increase the number of avenues through which low-income customers may enroll in the LIRAP.

While the Company does not currently have a relationship with CAAs, it does work with them on the implementation of LIHWAP. Aquarion Interrog. Resp. EOE-41; Tr., Dec. 5, 2022, 1158:6-18. In addition, the Company indicated its willingness to partner with CAAs to facilitate customer enrollment of the LIRAP. Aquarion Interrog. Resp. EOE-41. Tr., Dec. 1, 2022, 1014:1-5; Tr., Dec. 5, 2022, 1158:19-1159:13. Accordingly, to ensure those Aquarion customers who qualify for the LIRAP are enrolled into the program as efficiently and effectively as possible, the Authority directs the Company to explore working through CAAs to enroll eligible customers into the LIRAP and to submit as a motion for review and approval no later than 30 days after issuance of the Decision a detailed proposal to partner with the CAAs to enroll customers, including the costs associated with such arrangement and a draft memorandum of understanding to facilitate such arrangement, if approved.

e. Data sharing

The Company asserts that it does not share data with CL&P and Yankee because CL&P and Yankee have different IT systems than Aquarion, as well as different service territory footprints. Aquarion Interrog. Resp. RRU-337; Tr., Dec. 1, 2022, 1-28:9-12; Tr., Dec. 5, 2022, 1143:14-20. The Company stated, however, that it has spoken with its Eversource counterparts, who are well versed with various hardship programs, at a high level.¹⁰² Aquarion Interrog. Resp. EOE-41; Tr., Dec. 1, 2022, 1028:9-10. Such discussions, however, do not appear to have resulted in any solutions. In response to a question regarding whether it could match customer information if CL&P provided a list of customers in the Company's service area that CL&P had identified as eligible for LIRAP, Aquarion stated that it would have to investigate further how difficult it would be to accomplish. Tr., Dec. 5, 2022, 1143:2-9.

The Authority is both dismayed and disappointed that Aquarion, CL&P, and Yankee do not and cannot share data. The lack of data sharing is not only a disservice to low-income customers but to all customers, who have funded IT upgrades and other improvements in the companies only to find out the companies have no data sharing capabilities. Accordingly, the Authority directs Aquarion to investigate data sharing with CL&P, Yankee, and the Department of Social Services (DSS),¹⁰³ and to submit as a motion for review and approval no later than 30 days after issuance of the Decision, the Company's proposal to data share, including costs and a timeline to implement.

f. Customer Communication and Outreach

The Company proposes communicating the availability of the LIRAP through: Operation Fuel and other community agencies that administer similar programs; bill inserts to all customers; social media posts; inclusion in the Company's monthly newsletter; in an initial press release; and on its website. Teixeira PFT, p. 18; Aquarion Interrog. Resp. EOE-40. The Company asserts that once a customer is enrolled, the LIRAP would appear on a customer's bill as a separate line item with a corresponding credit amount. Tr., Dec. 5, 2022, 1038:2024. The line-item credit on a customer's bill would be called "LIRAP." Tr., 1038:2025-1039:1. Aquarion would include an explanation of what LIRAP is on the back of the bill. Tr., 1039:1-5. The Authority directs Aquarion to file samples of each type of communication it will provide, including reenrollment communications and sample bills, as a compliance filing no later than 30 days after issuance of the Decision. Prior to filing such materials, the Company shall make the materials available to, at a minimum, OCC, EOE, and Operation Fuel for the organizations' review and feedback, with at least five business days' notice prior to the filing date.

¹⁰² It does not appear the Company's discussions with CL&P and Yankee included discussions regarding data sharing. See Tr., Dec. 1, 2022, 1028:25-1029:6 ("Attorney Keenan: "Understanding that you have different IT programs, did you discuss data sharing, another method of data sharing?" Ms. Teixeira: "Well, we—don't handle in any of our systems personal information for our customers. We don't collect Social Security numbers and things like that.")

¹⁰³ Eversource is currently working with DSS towards low-income customer data-sharing. EDCs Low-Income Discount Rate Decision, p. 16 (citation omitted).

g. Interactions with Other Programs

Connecticut has existing programs and offerings designed to help low-income customers pay their water bills, including the LIHWAP and Aquarion's CAP.¹⁰⁴ The Company does not offer an arrearage forgiveness plan, other than what is included in the CAP.¹⁰⁵ Aquarion Interrog. Resp. RRU-334. The Company asserts that the LIRAP would be an additional offering to customers, not in place of the existing programs and offerings. Aquarion Interrog. Resp. RRU-225. Based on its review of the record, the Authority determines that the LIRAP may be offered in conjunction with existing programs and offerings.

LIHWAP is a temporary federally funded program administered by DSS in partnership with the statewide network of CAAs. LIHWAP provides benefits for eligible water customers who have an annual household income that is below 60% of the SMI. Aquarion Interrog. Resp. RRU-331; Tr., Dec. 5, 2022, 1123:23 -1124:1. States must obligate all of their LIHWAP funds by September 2023, and expend all of their LIHWAP funds by December 2023. Tr., Dec. 1, 2022, 1082:18-24. Accordingly, unless it is reauthorized, LIHWAP ends when all funds are expended.¹⁰⁶ Tr., 1082:25-1083:6.

The CAP is an Aquarion shareholder-funded program established by the Company in 2007 that awards vouchers in various increments to residential customers. Aquarion Interrog. Resp. RRU-337. Initially, the CAP was administered by local agencies. Id.; Tr., Dec. 5, 2022, 1132:25-1133:2. Aquarion subsequently changed the program administration to expand its reach. Teixeira PFT, p. 19. Specifically, beginning in 2020, Aquarion transitioned to a new partnership with Operation Fuel. Id.

There are two CAP vouchers: a \$50 CAP voucher and an up to \$250 CAP voucher. The \$50 CAP voucher is designed to provide a benefit to customers who may be current with their bill but are still struggling with the cost of basic needs. Aquarion Interrog. Resp. RRU-331. There are no eligibility requirements associated with the \$50 voucher. See Tr., Dec. 1, 2022, 1009:6-23; see also Tr., Dec. 5, 2022, 1162:1-5. If approved, a credit of \$50 is applied to a customer's water bill. Aquarion Interrog. Resp. RRU-331. The up to \$250 CAP voucher provides bill payment assistance to customers who meet the income eligibility requirement, which is 75% SMI, and have a past due balance of 30 days or more, have a shut off notice, need assistance making a required payment, or are currently without service. Id.; Tr., Dec. 5, 2022, 1161:24-1162:5.

¹⁰⁴ The Company's proposed Inclining Block Rate Design, as modified in Section VIII.C.3, Inclining Block Rate Design, of the Decision, is designed to incentivize customers, including low-income customers, to restrict their water use to fall under the lowest and least costly tier. While not designed to specifically benefit low-income customers, Inclining Block Rate Design would provide some rate relief for low-income customers by shifting costs to higher volume users.

¹⁰⁵ The Company testified that under the CAP's arrearage forgiveness plan, a customer may receive forgiveness for past bills if the customer pays the customer's bill for a set period of time. Tr., Dec. 1, 2022, 1011:10-25:

¹⁰⁶ The Company testified that it has been working with the National Association of Water Companies (NAWC) to make LIWHAP permanent as Aquarion sees value in doing that. Tr., Dec. 1, 2022, 1096:1-3.

All costs associated with the CAP, except for the administrative salaries of the Company's customer service reps, which are covered by ratepayers, are paid for by Aquarion shareholders. Tr., Dec. 5, 2022, 1162:24-1164:2; Tr., Dec. 6, 2022, 1376:23-1277:2. This includes the cost of the vouchers, as well as the \$10,000 administration fee the Company pays to Operation Fuel each year to administer the CAP, which includes running the program, qualifying customers, and providing information to Aquarion so it may credit customers' accounts. Aquarion Interrog. Resp. EOE-42; Tr., Dec. 5, 2022, 1127:2-5, 1130:22-1131:1.

h. Implementation and Costs

i. LIRAP Calculation

In the Aquarion proposal, the Company would provide a 15% LIRAP credit to a customer's total bill, which includes both the service and usage charges, as well as RAM and WICA charges.¹⁰⁷ Aquarion Interrog. Resp. RRU-379; Tr., Dec. 5, 2022, 1032:15-1033:13. If a customer also receives LIHWAP funds, a CAP voucher, or both, the Company would first apply the LIRAP to the customer's total bill. Late Filed Ex. 64; Tr., Dec. 15, 2022, 16:19-24. It would then apply the LIHWAP funds, CAP voucher, or both, to the remainder of the total bill. Late Filed Ex. 64; Tr., Dec. 15, 2022, 16:25-17:3. By applying the LIRAP in this order, the customer will receive the greatest benefit from the 15% credit.

ii. Timing of Implementation

The Company estimates that it will take 30 to 60 days from the date of the Decision to implement the LIRAP. Aquarion Interrog. Resp. RRU-339 and RRU-379; Tr., Dec. 5, 2022, 1031:8-23. This includes working with Operation Fuel on the administration of the LIRAP, configuring the Company's System Applications and Products in Data Processing (SAP) system to apply the LIRAP credit to a customer's bill, and training its customer service representatives on the LIRAP. Tr., 1031:13-24. Eligible customers who are enrolled in the LIRAP will see a credit on the first bill they receive within approximately 30 to 60 days after the date of the Decision. Tr., 1032:7:14. Accordingly, the Authority directs the Company to implement the LIRAP, subject to the direction herein, no later than 60 days after issuance of the Decision.

iii. Implementation Costs

The Company estimates that the costs associated with the implementation of the LIRAP would be approximately \$11,000 to \$12,000. Aquarion Interrog. Resp. EOE-40 and EOE-54; Tr., Dec. 1, 2022, 1029:21-1030:4, 1030:12-19. This includes approximately \$10,000 for IT costs associated with the configuration of the Company's SAP system to add the credit to customer bills and a one-time cost of \$1,000 to \$2,000

¹⁰⁷ Aquarion did not consider designing the LIRAP to apply only to the service charge, rather than the total bill, because the service charge is a relatively small portion of a customer's bill. Aquarion Interrog. Resp. RRU-379. If the LIRAP only applied to the service charge, the Company asserts that the benefit to the low-income program would not be sufficient to be deemed a "valuable" benefit. *Id.* Also, including both the service charge and the volumetric charge is appropriate because the size of a low-income family, and therefore the amount of water used by the family, may vary. *Id.*

for initial marketing materials. Id. Other than the IT and marketing costs, Aquarion asserts that there are not any other costs associated with implementation of the LIRAP. Tr., 1030:20-25.

If and when modifications are made to the LIRAP, it is imperative that the modifications do not require substantial and unnecessary IT costs, especially since the Company is spending \$10,000 now to configure the Company's SAP system. Accordingly, the Authority directs the Company to submit as a motion for review and approval no later than 30 days after issuance of the Decision, a detailed cost proposal to configure its SAP system to allow for the addition of two or more tiers, including a timeline for implementation of such proposal.

iv. Administrative Costs

The Company asserts that the costs associated with the administration of the LIRAP are the costs paid to Operation Fuel for LIRAP administration. Tr., Dec. 1, 2022, 1039:6-17. There are no other costs associated with the administration of the LIRAP.¹⁰⁸ Tr., 1039:14-17. Since the Company has not finalized its discussions with Operation Fuel, Aquarion does not know yet how much the per-application fee will be, though it expects it to be in the \$10 to \$12 range.¹⁰⁹ Tr., Dec. 1, 2022, 1021:8:10, 16:18; Tr., Dec. 5, 2022, 1137:17-24, 1138:3-13. Aquarion also does not know whether the fee per application will increase or decrease depending on the number of applications. Tr., Dec. 1, 2022, 1021:19-1022:20. The Company testified, however, that the fee paid to Operation Fuel will be an incremental expense, e.g., the additional work created by LIRAP may result in the current Operation Fuel fee of \$10,000 for administration of the CAP increasing to \$15,000. Tr., Dec. 5, 2022, 1171:25-11:72:6. The Authority directs the Company to file the agreement between Aquarion and Operation Fuel for administration of the LIRAP as a compliance filing no later than one week after the agreement is fully executed, and no later than 60 days from the date of the Decision. The agreement shall make clear the duration of its applicability and the process for establishing and revising applicable fees, among other things.

v. Cost Controls

The Company has not identified any cost control measures, such as a budget or usage cap. Aquarion Interrog. Resp. EOE-54. According to Aquarion, since this is a new program, it is not able to identify any costs control measures. Tr., Dec. 1, 2022, 1040:20-22. In addition, based on its experience with the CAP and conversations it has had with CWC, the Company does not anticipate participation to be significant enough to warrant cost control measures. Tr., 1041:5-16. Aquarion would, however, identify cost control measures if, through implementation of the LIRAP, the Company identified areas where cost controls would be beneficial. Tr., 1040:22-25. Accordingly, once the LIRAP is implemented, the Authority directs Aquarion to identify potential cost control measures

¹⁰⁸ The Company testified that a communications budget for the establishment of the LIRAP is not needed because the current communications manager, as well as some of its customer service representatives, will handle it. Tr., Dec. 5, 2022, 1215:20-1216:6.

¹⁰⁹ Aquarion pays Operation Fuel \$10,000 annually to administer the CAP. Aquarion Interrog. Resp. EOE-42; Tr., Dec. 1, 2022, 1068:23-1069:9; Tr., Dec. 5, 2022, 1127:2-5.

and submit such costs control measures in the compliance filing required in Section VIII.F.1.j, Reporting Requirements.

i. Cost Recovery

i. Implementation and Administration Costs

The Company does not propose any pro forma adjustments, nor does it propose regulatory asset treatment or some other deferred accounting, for any of the implementation or administration costs. Aquarion Interrog. Resp. EOE-40; Tr., Dec. 1, 2022, 1070:24-1071:8. Instead, the IT costs will be capitalized and the costs of the initial communication materials and Operation Fuels' administration fee¹¹⁰ will be booked as expenses and recovered in the Company's next rate case. Tr., Dec. 1, 2022, 1077:14-1078:22, 1079:14-1080:9. Aquarion stated that it would not incur any carrying costs by deferring the implementation and administration costs to the Company's next rate case. Tr., 1078:23-24.

The Authority reminds Aquarion that the burden of demonstrating prudently incurred costs to implement and administer the LIRAP, as directed herein, rests with the Company. To demonstrate prudence in its next rate case, Aquarion will need to provide sufficiently detailed cost information and evidence to support the finding that all reasonable efforts were taken to minimize costs, including, but not limited to, evidence that: (1) existing internal resources were leveraged to the extent possible; (2) investments in new resources were selected with current and future investments, programs, and public policies in mind; and (3) unnecessary costs were avoided.

ii. Impact of the LIRAP on the Revenue Requirement

The Company proposes deferring the impact of the LIRAP on its revenue requirement and to instead account for it through future RAM proceedings.¹¹¹ Szabo & Unger PFT, p. 63. Specifically, the Company proposed to recover the foregone revenue associated with the LIRAP through RAM. Tr., Dec. 1, 2022, 1070:18-23. The Company stated that it does not have a cost estimate to assess the impact that would result from the 15% credit. Aquarion Interrog. Resp. EOE-40. The Company did, however, provide two estimates of the cost of the LIRAP using the proposed Eastern Division residential rate: one estimate was based on the number of customers currently receiving a CAP voucher,¹¹² which is \$138,526; and a second was based on the percentage of CWC

¹¹⁰ Since the fee paid to Operation Fuel will be an incremental expense, e.g., the additional work created by LIRAP may result in the current fee of \$10,000 increasing to \$15,000, Aquarion would therefore not request a deferral between now and the next rate case since the amount would only be, e.g., \$5,000. Tr., Dec. 5, 2022, 171:25-11:72:6.

¹¹¹ Aquarion's RAM surcharge is a percentage rate that is applied to all customers, including both residential and commercial. Tr., Dec. 5, 2022, 1040:3-12. Aquarion asserts residential customers enrolled in a LIRAP cannot be excluded from cost recovery. Aquarion Interrog. Resp. RRU-328. The Company incurs a cost to provide service to all customers, including the customers enrolled in these programs. Id. As such they are a component of the overall cost of service that cannot be bifurcated. Id.

¹¹² Aquarion based it on 2019 CAP numbers as the Company waived the eligibility requirements during COVID. Aquarion Interrog. Resp. EOE-54.

customers enrolled in CWC's water rate assistance program, or 0.52%, which is \$158,926. Aquarion Interrog. Resp. EOE-54.

The Authority directs Aquarion to submit the revenue shortfall in a given calendar year resulting from the provision of the LIRAP that the Company believes to be prudently incurred into the subsequent year's annual review of the RAM proceeding, e.g., costs incurred in 2023 shall be submitted in the 2024 RAM proceeding, etc. In addition, the Authority directs Aquarion to quantify and include a narrative explanation of any variance of the annual RAM expenses (e.g., uncollectibles, payment plans, late payments, etc.) in its RAM proceeding that may be impacted by the establishment of a LIRAP.

j. Reporting Requirements

Developing metrics and other reporting requirements to measure progress of implementation of the LIRAP toward achieving water affordability will be critical to the program's success. In this Decision, the Authority establishes an annual review of the LIRAP as part of Aquarion's RAM proceeding. Unless otherwise directed, the Authority intends to conduct its first LIRAP review in its 2024 RAM proceeding. Accordingly, the Authority directs the Company to cross-file all motions and compliance filings in this Decision that are associated with the LIRAP in this docket and in the applicable current year's RAM proceeding.

Parties, including Aquarion, supported the creation of a set of LIRAP reporting requirements information based on data from the previous calendar year, i.e., January 1 through December 31. The reporting period for the compliance filing due on February 1, 2024, will be from the date of implementation through December 31, 2023.

- i. Number of customers enrolled in the LIRAP each month by income level. The Company shall provide the information regarding income level as soon as Aquarion has customer income information;
- ii. Number of customers enrolled in the LIRAP each month by the presence and level of pre-existing arrearages;
- iii. Number of customer accounts with past due balances, along with the aggregate and average dollars of the past due balances;
- iv. Number of LIRAP recipient accounts with past due balances, disaggregated by past due balances attributed to LIRAP bills that are unpaid and bills that were unpaid at the time of LIRAP enrollment;
- v. Number of LIRAP recipients with past due balances, along with the aggregate and average dollars of the past due balances;
- vi. Number of customer accounts with past due balances: %/# LIRAP recipients;
- vii. Net Write-Offs;
- viii. Net Write-Offs: %/\$/# LIRAP recipients;
- ix. Total annual costs of providing the LIRAP credit, disaggregated by the following program components: (a) the bill discount credit provided; (b) the dollars of arrearage forgiveness provided, if any; (c) the administrative costs (paid to an external agency); and (d) the incremental internal administrative costs (i.e., internal costs not incurred in the absence of the LIRAP);

- x. Number of service terminations in the year preceding the LIRAP implementation and monthly thereafter, along with the average dollars of arrears of accounts that were disconnected;
- xi. Amount of bad debt in the year preceding the LIRAP implementation and annually thereafter;
- xii. Amount of uncollectibles in the year preceding the LIRAP implementation and annually thereafter, along with the dollar level and age of arrearages;
- xiii. Number of customers applying for the LIRAP through Operation Fuel by income level (i.e., at or below 160% of Poverty; above 160% of Poverty but at or below 60% of SMI) and by public assistance program used, if any, to certify income. The Company shall provide the information regarding income level and public assistance program used as soon as Aquarion has this customer information;
- xiv. Number of customers applying for the LIRAP through their CAAs, delineated by each CAA, and by income level (i.e., at or below 160% of Poverty; above 160% of Poverty but at or below 60% of SMI) and by public assistance program used, if any, to certify income. The Company shall provide the information regarding income level and public assistance program used as soon as Aquarion has this customer information;
- xv. Number of customers removed from the LIRAP each month by reason for removal, i.e., no longer meets LIRAP eligibility requirements; customer filed a fraudulent claim for eligibility; and program discontinued for all customers; customer stops being an Aquarion customer, including when a customer stops being an Aquarion customer as a result of having service disconnected for nonpayment;
- xvi. Number of customers who were enrolled in LIRAP the preceding year but did not enroll in the current year by income level. The Company shall provide the information regarding income level as soon as Aquarion has customer income information; and
- xvii. Additional recommended reporting requirements to add to the Company's annual compliance filing.

The Authority also directs Aquarion to work with EOE and OCC, as well as any other interested stakeholders, to develop additional recommended reporting requirements to track the benefits and drawbacks of the LIRAP, including a mechanism for identifying and tracking LIRAP offsets, and to submit the recommendations with its annual compliance filing.

k. Conclusion

The Authority approves the Company's proposed LIRAP, which will provide direct assistance to qualifying residential customers in the form of a 15% credit to such customers total bills, subject to the direction provided herein. As soon as possible, but no later than 60 days after the issuance of the Decision, Aquarion shall implement the LIRAP with an eligibility cap of 60% SMI. The Authority will consider modifications to the LIRAP in a future proceeding.

2. Incremental Bad Debt Write-Off Regulatory Asset

The Company proposes a continuation of the bad debt write-off deferral and reconciliation mechanism authorized in Docket No. 20-03-15, Emergency Petition of William Tong, Attorney General for the State of Connecticut for a Proceeding to Establish a State of Emergency Utility Shutoff Moratorium. Szabo & Unger PFT, p. 64. The Company states that “[d]ue to the prolonged COVID shutoff moratorium, net write-offs for the Company since March 2020 have been well below historical levels, while arrearages are substantially higher.” Id. The Company further asserts that its bad-debt expense proposed in its revenue requirement is based on a five-year average of net write-offs during 2017 through 2021; although, the Company observes that “the COVID collection policies have substantially distorted that experience.” Id. The Company further articulates that “[o]nce typical collection activities resume, the Company anticipates net charge-offs will exceed what is reflected in the proposed revenue requirement.” Id. The Company proposes at the time of its next rate proceeding, Aquarion will submit a reconciliation of the actual level of bad debt write-offs against the amount included in base rates and a proposal for the recovery of the deferral. Szabo & Unger PFT, p. 64.

According to the Company, its five-year average net write-off for 2017-2021 was \$156,545. Late Filed Ex. 21. The bad debt expense increases to \$166,220 after adding \$9,676 for Valley’s bad debt expense.¹¹³ Aquarion Interrog. Resp. RRU-89; and OCC-187. As noted by the Company, the net write-off of \$37,443 in 2020 represents an anomaly due to the pandemic, and artificially suppresses the five-year average. Late Filed Ex. 21. If the anomalous 2020 data is removed, the average net write-off amount increases to \$186,320, or \$195,996, with the addition of Valley.

Accordingly, the Authority establishes the amount of \$195,996 as the level of bad debt expense authorized through this rate case. Removing the 2020 experience acknowledges the unique circumstances of 2020 with respect to collections activities. Concerning the reconciliation of bad debt expense, the Authority finds that due to the unique circumstances impacting collections during the COVID period, it is reasonable to allow for a reconciliation of this expense item with actual results. However, the Authority is concerned about future obligations being accumulated for recovery in the next rate case. Therefore, the Company shall be allowed to submit information regarding actual bad debt expense in the Company’s annual RAM. The actual bad debt expense will be measured against the \$195,996 four-year average, where the difference between actual bad debt expense realized by the Company compared to the bad debt expense established herein will be credited or debited in calculating the overall RAM adjustment. For the 2023 RAM, the Company shall calculate the amount to be measured against as the pro rata share of bad debt expense embedded in rates from the 2013 Decision and the amount included from this rate case as of the date of this Decision.

3. Property Tax Reconciliation

As part of its Application, the Company proposes a property tax reconciliation mechanism that would apply if the Authority denies the Company’s request for a Multi-

¹¹³ Valley Water’s net write-off value is cited from the Valley Decision.

Year Rate Plan. Szabo & Unger PFT, p. 64. According to the Company, the property tax reconciliation would allow for the recovery of property tax amounts in relation to incremental capital investments made from year to year that exceed the level authorized in rates. *Id.*, pp. 64-65.

The Company acknowledges that it is possible that other expense items established in a rate case have the potential to fluctuate. Tr., Nov. 28, 2022, 382:6-15. Consequently, the Authority finds that reconciling this one expense item in the absence of good cause to do so while not considering all other items has the potential to disadvantage ratepayers as property taxes will generally increase as plant is put into service over the years between rate cases. Indeed, a failure to reconcile all other items will preclude the accumulation of offsets for expenses that have decreased from levels established in this rate case. The Authority, therefore, denies the Company's request for a property tax reconciliation mechanism.

4. Lead Service Line Replacement Program

a. Summary

Lead service line replacement is an emerging issue in the water industry, and this is the first time that Aquarion has formally presented a program to the Authority for consideration. Tr., Nov. 22, 2022, 158:16-20. As part of the Company's Capital Improvement Program, Aquarion has budgeted \$11.6 million to be spent over the next five years on a lead service line replacement program (LSLR Program). Lawrence PFT, p. 45. The LSLR Program would replace lead service lines that the Company discovers during meter or main replacement as well through inspections. The Company proposes to fund Company-side lead service lines as traditional plant in-service and, to the extent possible, fund the customer-owned replacements with Drinking Water State Revolving Fund (DWSRF) grants. Szabo & Unger PFT, pp. 62-63. When DWSRF funding is not available, Aquarion proposes a mechanism to allow for the deferral and future recovery of Company-funded replacements of customer-owned lead service lines at the Company's next rate case. *Id.*

Based on the record in this proceeding, the Authority approves the LSLR Program, including a deferred regulatory asset for the up to \$5.8 million in program costs.

b. Lead and Copper Rule Revisions

In 1991, the United States Environmental Protection Agency (EPA) promulgated the Lead and Copper Rule (LCR) to limit the amount of lead and copper in drinking water and has subsequently amended the rule several times over the years. Lawrence PFT, p. 53. Corrosion of service lines, plumbing, and fixtures is the greatest source of lead and copper in drinking water. *Id.* Pursuant to the LCR, Aquarion is required to monitor the concentration of lead and copper in each of its systems by sampling water in select customers' homes. *Id.* Aquarion posts sampling results on its website and includes them in its annual Water Quality Reports, which are available on the Company's website. Lawrence PFT, p. 53. If lead or copper concentrations exceed the action level, the water company is required to take action to control corrosion, which can include the installation

of treatment improvements, replacement of lead service lines, and public education. Id. The Company's water systems are in compliance with the regulatory lead standard. Id.

The Company submits the LSLR Program proposal in anticipation of revisions to the LCR. Szabo & Unger PFT, p. 62. In December 2021, EPA announced the finalization of the LCR Revisions (LCRR). 86 Fed. Reg. 71574. Water utilities must comply with the LCRR by October 16, 2024, including the requirement to prepare a LSLR Program for each water system. Lawrence PFT, p. 55.

Water utilities with lead service lines must prepare a LSLR Program for each water system. If system-wide lead sampling results exceed certain levels (i.e., either the new "trigger level" defined in the LCRR or the existing "Action Level"), the water utility will be required to replace a certain percentage of lead service lines for two years, with the replacement rate determined using the sum of lead service lines, "lead status unknown" lines, and galvanized lines requiring replacement. Id. Only full lead service line replacements (i.e., both company-owned and customer-owned portions) count towards the replacement goals. If a customer is unable or unwilling to have their portion of a service line replaced, a utility is required to notify the customer and follow risk mitigation procedures in their LSLR plan. When a utility replaces a lead service line, the water utility will be required to notify the affected customers, provide educational materials, provide pitcher or faucet filters, and perform follow-up sampling.

The LCRR includes numerous new requirements for public communications and education. Aquarion is proposing a proactive approach to the identification and replacement of company-owned and customer-owned lead service line material through the review of existing records, utilizing outreach communication, obtaining customer information through periodic meter replacements, and through pothole excavations at the curb stop to identify the Company-owned service line material and customer-owned service line material. Lawrence PFT, pp. 55-56.

c. Aquarion's LSLR Program Proposal

Service lines consist of two parts: (1) from the main to the curb box, and (2) from the curb box to the customer's house. Part one is maintained by the Company, while part two is maintained by the customer. It is a common practice that when the Company replaces a main, it also replaces the service line from the main to the curb box. Maintenance of the service line from the curb box is at the customer's expense, not the water utility. Conn. Agencies Regs. § 16-11-62(4).

At this time, the Company can replace the Company-owned side of the lead service line, but it cannot replace the customer-owned side of the water service line, as it is owned by the customer. Lawrence PFT, p. 57. As stipulated by the LCRR, any disturbance of a lead service line or galvanized service line that is/was connected to a lead line, can result in an increase in lead in a residence. Id. Because of this, the Company has committed to only replacing lead service lines when the Company-owned *and* customer-owned portion can be replaced at the same time. Id. The Company testified that it will also replace the Company-owned portion of a service line when the

customer-owned side is non-lead (copper or plastic). Id. The Company states that this decision is consistent with LCRR and is protective of the health of the customer. Id. After the customer side lead service line is replaced, it will continue to be owned by and will remain the responsibility of the customer. Tr., Nov. 22, 2022, 162:8-19.

As part of the LSLR Program, the Company has been developing an inventory of the material of service lines, on both the Company-owned and customer-owned portion of service lines. Lawrence PFT, p. 53. Services with unknown materials that may be lead will be classified as “lead status unknown” service lines and will count towards the total number of lead service lines in the system, which will impact any lead service line replacement requirements; conversely, unknown materials that are unknown but known not to be lead can be classified as “non-lead” service lines. Id., p. 54. Approximately 73% of the service lines in Aquarion’s system are made of unknown material. Id.

d. Costs of the LSLR Program

While water utilities do not need to start complying with the LCRR until October 2024, Aquarion is proactively developing its LSLR Program and expending other funds in anticipation of the LCRR’s implementation. The Company estimates that the cost of the LSLR Program for the next five years will be approximately \$11.6 million. Late Filed Ex. 9, Att. 1.

The Company plans to proactively identify and replace lead service lines, both the company-owned and customer-owned portions. Lawrence PFT, p. 58. The cost to replace the lead service lines will be significant. Id. Based on the Company’s current records and investigations, Aquarion estimates the cost to replace lead service lines will be between \$5,000 and \$12,500 each, or approximately \$67 million system wide. Id.

Aquarion anticipates that the process of identifying the material of the “lead status unknown” service lines, which includes the cost of field investigations, will constitute a significant cost. Lawrence PFT, p. 58. As noted above, the Company has approximately 73% of service lines in its systems categorized as “lead status unknown.” Identifying the material comprising these service lines is prudent because if Aquarion were to exceed a regulatory limit that triggered the requirement to replace lead service lines, the required lead service line replacement rate is based on the sum of all lead service lines, “lead status unknown” lines, and galvanized lines requiring replacement. Id. As the Company identifies the number of “lead status unknowns,” the number of required lead service line replacements would be reduced, so long as those service lines are not lead or galvanized. Id. The costs to complete the needed investigations is estimated to be between \$900 and \$1,100 each, or approximately \$43 million system wide. Lawrence PFT, p. 58. This estimate is based on the Company’s projected number of “lead status unknown” service lines that can be determined by records review, periodic meter replacements, and field investigations. Id.

Aquarion also estimates other costs associated with complying with the LCRR, including upgrades to IT systems and work processes for the requirements related to schools and childcare facilities program, lead service line replacements, lead service line

disturbances, and the development of public education materials. Id. Additionally, there will be annual costs to remain in compliance with the LCRR, including for additional lead sample collection, lead sample lab testing, public education/communications, management of the school/childcare facility program, and pitcher or faucet filters. Lawrence PFT, pp. 58-59.

e. Funding the LSLR Program

To offset costs of the LSLR Program, the Company has applied to the Department of Public Health (DPH) for grant and loan funding through the DWSRF Program.¹¹⁴ Lawrence PFT, p. 59. Funding under the DWSRF can be used to replace either the customer-owned or Company-owned portion of the service line. Id. Thus, the Company is proposing that the Company-owned lead service lines be treated in the same manner as any other required service line replacement and be recovered at the next rate case. Id. The replacement of customer-owned lead service lines will be accomplished using the grant funds from the DWSRF, where funds are available.

The Company is also eligible to apply for subsidy funding under the Bipartisan Infrastructure Law (BIL), so long as it complies with the DWSRF requirements. Aquarion Interrog. Resp. RRU-431. As part of the DWSRF, DPH administers the Disadvantaged Community Assistance Program (DCAP) where DPH is required to provide between 6% and 35% of their capitalization grant provided under the BIL as an additional subsidy to disadvantaged communities. Id. One of the requirements of DCAP is that 49% of the project must be in a vulnerable community. Tr., Nov. 22, 2022, 217:2-6. If that criterion is met, the individual project can receive up to 49% loan principal forgiveness. Tr., 217:2-6. By applying the 49% funding, the Company believes that the LSLR Program would not require general ratepayer funding. Tr., 185:15-20. As of the date of the hearing, Aquarion was awaiting DPH approval of DPH's Intended Use Plan, which would include the amount of loan principal forgiveness the Company would receive. Tr., 187:8-14. When grant funding is not available, costs related to the replacement of the customer-owned portion will be treated as an amortized expense that will be addressed within the next rate case.

The Company referred to the LSLR Program as a work in progress and stated that it could adjust as it learns from experience implementing the Program. Tr., 196:11-13. For instance, the Company has no contract or other document that details the Company's and customer's responsibilities or addresses items such as warranties, unusual site conditions, or indemnification. Tr., 162:14-19, 175:14-176:5, 178:20-23. Customer contracts were part of many of the other states' LSLR programs that Aquarion referenced in its testimony. See Lawrence PFT, p. 59; Aquarion Interrog. Resp. RRU-225. The Company estimated it would have a document that addresses these issues prepared by the end of the year. Tr., Nov. 22, 2022, 163:22-24. As of the close of the evidentiary record, the Authority has not been made aware of any such document. The Company is also considering a customer self-identification pilot program where customers would take a picture of their service line and send it to the Company to be assessed using a QR

¹¹⁴ The Company provided a list of other potential funding sources that are available for customers to apply for. Aquarion Interrog. Resp. RRU-238.

code. Tr., 198:2-13. Such a self-identification program has been utilized in other states and could be significantly less expensive than having to do investigative work. Tr., 198:6-199:1-13.

f. Authority Analysis

The Company originally requested an allowance for up to a \$11.6 million deferral over the next five years for costs associated with the LSLR Program. The Company estimates that it could replace 500-1,000 service lines in this five-year period. Tr., Nov. 22, 2022, 188:15-17. During the hearings, the Company testified that the budgeted estimate of 4,000 investigations per year is a number that the Company is probably not going to accomplish. Tr., 182:6-9. The Authority is concerned with allowing a significant deferral for a program that is still a work in progress. When asked to reassess the original \$11.6 million, the Company suggested that the amount could be reduced by 50% as the \$11.6 million did not anticipate DWSRF funding. Tr., Dec. 14, 2022, 34:4-14. This would equate to a \$5.8 million funding cap over the five years of the LSLR Program.

The Authority recognizes the need to begin a replacement program in light of the LCRR. Therefore, the Authority will allow a deferred regulatory asset of up to \$5.8 million over the five-year period commencing with the first rate year (i.e., March 15, 2023 – March 14, 2024). The Company is directed to file its customer contract and related materials associated with the LSLR Program prior to beginning its LSLR Program. Projects to be completed by the Company are those that have received funding through DWSRF and fund the customer-side lead service line 100%. After beginning the LSLR Program, the Company is directed to submit annually, on or before January 15, a compliance filing regarding the LSLR Program, including at a minimum the number of Company service lines replaced in the previous calendar year, the number of customer service lines replaced in the previous calendar year, and information regarding the cost of such replacements and the associated funding source, such as the amount of DWSRF money applied.

IX. CUSTOMER SERVICE & WATER SUPPLY

A. CUSTOMER SERVICE REVIEW

1. Standard Bill Form and Notices

Aquarion provided a Standard Bill Form with its application materials at Schedule H-2.1. The Standard Bill Form was reviewed and found to comply with the requirements of Conn. Agencies Regs. § 16-11-69. Aquarion also provided a Termination Notice at Schedule H-2.1.01-02. The Company confirmed that it does not include unregulated charges on its termination notices. Tr., Dec. 5, 2022, 1194:11-16.

Customers must be provided an annual notice explaining the rights provided by Conn. Agencies Regs. § 16-3-100(c)(1)(B) regarding termination of service. Aquarion provided a Customer Rights Notice, which the Authority finds is in compliance with the regulation.

2. Estimated Bills

The Company asserts that its estimated bill notices and forms are in compliance with applicable regulations. Aquarion Interrog. Resp. EOE-22. An estimated bill is issued if the Company is unable to obtain a meter reading. Conn. Agencies Regs. § 16-3-102. After bill estimates are issued in two consecutive billing periods, the Company must send a notice letter informing the customer that the Company needs to obtain an actual meter reading. Id.

Aquarion submitted its policies and procedures for generating an estimated bill, sample estimated bills, and sample notice letters. Application, Sch. H-2.3.01, H-2.3.02, and H-2.3.03. Aquarion's billing system calculates the estimated reading by using data such as last year's meter reading for the same period or a per diem based upon the total annual consumption divided by the number of days in the year. Id. Additionally, the Company will adjust estimated readings on certain variables, for example, if the previous year's reading was during a time that the customer had a leak or stopped meter. Aquarion Interrog. Resp. EOE-19. If there are two or more consecutive estimated readings, the reading will be placed onto an implausible reading list. Application, Sch. H-2.3.01. Further work is then performed by the Company's Billing Department to review and determine the appropriate next steps, such as calling the customer, sending a notice, or sending a service person or meter reader to the location. Id.

The Company's estimated billing procedures and notice letters comply with Authority regulations. Further, based on a review of information presented by the Company in this proceeding, the Company's use of estimated bills remains an infrequent occurrence over the last three years. EOE Brief, p. 3.

3. Security Deposit Policies

The Authority concludes that Aquarion's current security deposit policies and associated materials are not in compliance with applicable regulations. Utilities may require customers to supply a security deposit not to exceed an amount equivalent to an estimated maximum bill for 90 days. Conn. Agencies Regs. § 16-11-68(a). Aquarion provided its security deposit policy and procedure at Schedule H-2.4. During the COVID-19 pandemic, the Company suspended its practice of requiring a security deposit for both residential and commercial customers and had not resumed as of the date of filing the Application. Application, Sch. H-2.4.

The first area of concern involves Conn. Agencies Regs. § 16-11-68(i), which states, in part, that security deposits, along with accrued interest shall be returned where satisfactory credit has been established. According to Aquarion, satisfactory credit is established when the customer is in good payment status, meaning that the customer has not defaulted on their bill or received late notices or fees for a year. Application, Sch. H-2.4; Tr., Dec. 5, 2022, 1183:10-18. It has been the current and past practice of the Company to return the security deposit, with interest, in connection with a customer's final bill during the move-out process or at a customer's request. Tr., Dec. 15, 2022, 20:20-22. However, Aquarion does not undertake periodic or proactive reviews of customers'

credit to determine if any security deposit should be returned. Aquarion Interrog. Resp. EOE-1.

Conn. Agencies Regs. § 16-11-68(h) states, in part, that security deposits may be retained by the Company so long as is required to ensure payment of the bills. Aquarion stated that should a customer call to request the return of their security deposit, and if the customer has met the definition of satisfactory credit, the security deposit would be returned. Tr., Dec. 5, 2022, 1184:22-1185:7; Aquarion Interrog. Resp. EOE-1. However, there is no automated process within the Company's system that will return a customer's security deposit, plus interest, once said customer has met the definition of satisfactory credit. Aquarion stated that it is working to implement an automated system that would accomplish this task. Tr., Dec. 15, 2022, 19:23-20:6. In the instances in which a customer is required to provide a security deposit, the customer must submit an online application form to initiate new service. At the end of that form the customer will be made aware of the Company's definition of satisfactory credit. Aquarion Interrog. Resp. EOE-23, Att. 1; Tr., Dec. 15, 2022, 19:6-9. However, there is no other customer-facing written notice or bill insert that provides the customer this information. Tr., 18:25-19:6.

At this time, Aquarion does not track information regarding the number of customers that have achieved satisfactory credit but have not contacted the Company to request the return of the security deposit. Late Filed Ex. 68. In addition, Aquarion stated that currently there may be active customers that have achieved satisfactory credit but have not had the security deposit returned to them. Tr., Dec. 15, 2022, 21:8-15. Therefore, the Authority directs Aquarion to revise its customer notices (e.g., Welcome Letter, online application form, receipt upon collecting security deposit) to educate customers about the process of requesting a return of their security deposit.

The second area of concern is the lack of information provided in the application form to discuss whether a customer may be exempt from providing the security deposit. This online form is required of certain customers in order to start a new service. According to the Company, it is aware that the Company may not refuse to provide service to a residential customer where said customer lacks the financial ability to pay the security deposit. Tr., Dec. 5, 2022, 1182:5-12. This exemption for certain residential customers is fully defined in Conn. Agencies Regs. § 16-11-68(b). If there was a customer that did not have access to the internet, the questions on the online form can be asked by a Company representative over the telephone or the application form could be mailed to that customer. Tr., 1181:23-1182:4. However, the online form lacks the exemptions to the security deposit requirement, as defined in Conn. Agencies Regs. § 16-11-68(b). Aquarion Interrog. Resp. EOE-23, Att. 1. The Company stated that there are no specific reasons for the exclusion of this information but that it plans on updating the form. Similarly, if a customer was completing the security deposit application form via a telephone conversation with the Company, the customer would not be told of these exemptions. Tr., Dec. 5, 2022, 1182:20-1183:1. Consequently, the Authority will direct Aquarion to revise its application form to include the provisions of Conn. Agencies Regs. § 16-11-68(b) and to revise its internal procedures so that in the event the form is being completed over the telephone, a prospective customer is made aware of the security

deposit exemptions. A failure to comply with this directive and applicable regulations moving forward will subject the Company to civil penalties levied in accordance with Conn. Gen. Stat. § 16-41.

4. Late Payment Charges

The Company collects a late payment charge (LPC) or interest fee of 1.50% per month on outstanding balances. Application, Sch. H-3.0, p. 64; see also, Application, Sch. H-2.6.02, Rules and Regulations, p. 7. After a bill is outstanding for 34 days, the LPC is assessed. Application, Sch. H-2.6.02, Rules and Regulations, p. 7. The fee is assessed each month on the payment amount that is outstanding. Id. In accordance with the Authority's decision herein, the LPCs do not count as revenue for purposes of RAM, as discussed above in Section VIII.E.2, Revenue Adjustment Mechanism.

Aquarion's LPC of 1.50% is in line with the fees charged by other investor-owned utilities in Connecticut. See Decision, Dec. 7, 2022, Docket No. 22-03-16, Petition of the Office of Consumer Counsel for an Investigation into The United Illuminating Company and Eversource Energy Regarding Collections Practices During the COVID-19 Moratorium, Appendix B, pp. 10-11. Aquarion's LPC has not changed since its 2004 rate case and is the same rate applied to all customer classes. Id., Appendix B, p. 10.

The Company suspended all LPCs during the COVID-19 moratorium. Aquarion Interrog. Resp. OCC-50. The Company resumed late payment fees in October 2022. Aquarion Interrog. Resp. OCC-213.¹¹⁵ As of October 14, 2022, 8,880 customers were billed an LPC, totaling \$11,753 in fees. Aquarion Interrog. Resp. OCC-273, Att. 1. Given the suspension of LPCs as a result of the COVID-19 pandemic, the most recent data on the Company's use of the LPC is limited. Furthermore, it is unclear from the record whether the LPCs are adequately serving their purpose. Additional information is necessary to evaluate the practice of utilizing late payment charges. In the Company's next rate proceeding application, Aquarion is directed to provide an analysis of the type of customers who incur late payment charges; the average, maximum, and minimum late payment charges incurred by customers, by class, in a given year; and the impact LPCs have on uncollectibles.

OCC proposes that Aquarion direct the fees collected by the LPCs as "crisis grants" to be awarded to income-qualified customers who are most at risk for disconnection, which results in the assessment of additional fees. OCC Brief, pp. 18-19. At this time, the Authority is not considering this proposal, but directs the Company to provide an analysis of such a program in its next rate case filing. The Authority appreciates OCC's recommendation to further support low-income customers and, therefore, directs Aquarion to allow its customer service representatives to waive LPCs when establishing reasonable payment plans. Specifically, as soon as LIRAP is implemented, the Company shall allow its customer service representatives to waive LPCs when establishing reasonable payment plans for customers receiving LIRAP. In

¹¹⁵ On July 14, 2022, in Docket No. 20-03-15, the Authority granted the Company's motion filed on June 28, 2022, to restart LPCs.

addition, as soon as the Company implements the billing system modification required in Section VIII.F.1.c.ii, Enrollment, that would allow for financial hardship coding of Aquarion's residential customers, the Company shall allow its customer service representatives to waive LPCs when establishing reasonable payment plans for financial hardship customers, which includes customers receiving LIRAP.

5. Rules and Regulations

The Company submits its Rules and Regulations as part of its Application and is proposing updates such as: changing from quarterly to monthly billing; requiring municipalities to maintain the hydrants they own; clarifying that new water meters will be installed in a meter pit or vault; and affirming that customers must maintain and install part of the service line owned by the customer. Application, Sch. H-2.6.01. The Authority accepts the updated Rules and Regulations.

6. Customer Complaints

Aquarion provided a summary of the major types of customer complaints, including water quality and quantity issues, that the Company has recorded and monitored since the 2013 Decision. Application, Sch. H-4.0. The Company listed the major types of service quality complaints (e.g., taste, odor, appearance/discoloration, chemical, illness/biological) that are reported to the Authority on a quarterly basis. Aquarion Interrog. Resp. RRU-107. Historically, customer complaints filed with the Authority are low. Teixeira PFT, pp. 8-9. From 2013 through 2021, 3.3 complaints were filed on average each year. Id., p. 8.

Notwithstanding the foregoing, the Authority finds that the magnitude and content of the customer comments filed in the instant proceeding highlight a growing phenomenon across all regulated utilities in the state, i.e., general customer dissatisfaction with the pricing and availability of essential public utility services. See Section I.F, Public Comment. As such, historic trends regarding complaints filed with the Authority may not necessarily be indicative of future trends in this instance; nor is it prudent to wait to implement best practices that may mitigate or help identify problematic trends as they arise. Therefore, the Authority will direct the Company to meet with EOE on a regular basis, but no less than once per month, to discuss outstanding customer complaints and noticeable trends, covering both those complaints and inquiries submitted to the Authority as well as those routed directly to the Company. During the meetings, the Company shall discuss performance metrics tied to customer complaints, including any improvements thereto, and how such metrics regarding customer complaints about water quality and quantity issues tie to infrastructure improvements. Not later than 60 days after the issuance of the Decision, the Company shall submit a compliance filing detailing at minimum: the metrics to be discussed at said meetings; a proposed standing agenda; the proposed frequency of the meetings; and the proposed Company attendees (by job title). Prior to submission, the Company shall provide EOE no less than 15 business days to review and provide feedback on such proposal. To the extent that EOE's feedback is not incorporated, the Company's submission to the Authority shall include a detailed narrative as to why.

Additionally, the Authority observes that customer inquiries and complaints often stem from miscommunications, or missed opportunities for communication, by regulated entities. Indeed, as discussed in Section VI.B.12, Communication Expense, the Company only recently began tracking KPIs with respect to its communication campaigns and could not articulate how the KPIs are utilized to shape future engagement strategies. As such, the Authority will direct the Company as part of its above-established regular meetings with EOE to also report on Aquarion's planned and executed communications with customers, including through the provision of KPI data that is provided on an, at minimum, quarterly basis. To enhance the value of this exercise, the Company must first define written processes and procedures governing how KPI data is used to improve the efficacy of its communications, which EOE asserts is a low-cost way to ensure a consistent approach to review and improvement. EOE Brief, pp. 9-10. These written policies and procedures shall be appended to the Company's submission due to the Authority no later than 60 days following issuance of the Decision.

B. WATER SUPPLY

1. Water Quality

As an owner and operator of public water systems, Aquarion closely monitors changes in state and federal water quality regulations and guidance. For example, the Company has observed the following regulatory changes: the use of the manganese maximum contaminant level (MCL) in lieu of a secondary standard; the arsenic MCL lowering from 10 parts per billion (ppb) to 5 ppb; and the perfluoroalkyl and polyfluoroalkyl substances (PFAS) Action Levels (AL). Lawrence PFT, pp. 22-23. The final MCLs established for PFAS will result in significant capital investment in water treatment at groundwater sources and possibly surface water sources. Id., p. 23. Currently, the Company has five systems (i.e., Biggs Wellfield, Ball Pond System, Renda Wellfield, Ball Pond System, Cedar Heights System, Shirley Court Well No. RA1, New Milford regional System and Woodbury Well Nos 2 and 3, Woodbury System) that exceed the perfluorooctane sulfonate (PFOS) AL (part of PFAS substances). Aquarion Interrog. Resp. RRU-109.

The Company indicated that its water systems are in compliance with state and federal drinking water regulations. However, Oscaleta Caisson Well No. 4 is subject to an E. coli correction. Aquarion Interrog. Resp. RRU-103. There are also other systems subject to raw water E. coli contamination as well as other Notices of Violation (NOV) related to monitoring and reporting that were issued between 2013-2022. Aquarion Interrog. Resp. RRU-106, Att. 2.

As discussed in Section VIII.F.4, Lead Service Line Replacement Program, Aquarion is taking action to ensure compliance with the LCRR, which will become effective in October 2024. This includes identification of service lines materials; development of a lead service line replacement program plan; preparation of and updates to systems and process related to lead service line replacement, lead service line disturbances, compliance sampling, school sampling; performing corrosion control

evaluations; and development of communication and public materials. Aquarion Interrog. Resp. RRU-103.

2. Water Quantity

According to the Company, Aquarion is in compliance with all permitted and registered diversions, with the exception of Morehouse Brook Diversion. Aquarion Interrog. Resp. BETP-28; DEEP Exceptions, p. 2. Aquarion stated that it will work with DEEP to resolve these issues. Tr., Nov. 30, 2022, 708:22-709:6. DEEP requests that Aquarion produce a detailed plan to bring its diversion permit and registration into full compliance with DEEP's protocols. DEEP Brief, p. 9. The Authority approves the Department's request. Accordingly, the Company is directed to produce a detailed plan by May 1, 2023, that includes a detailed timeline with specific deadlines for completing each step outlined in the plan, which shall be filed as compliance in the instant Docket.

Additionally, DEEP raised concerns about Aquarion's groundwater withdrawals in the vicinity of Bissell Brook and Cobble Brook and questioned whether the withdrawals negatively impact the environment. Tr., Nov. 30, 2022, 715:2-18. DEEP requests that the Authority order Aquarion to hire a DEEP-approved third party to conduct an impact study (Withdrawal Impact Study) at Bissell Brook and Cobble Brook. DEEP Brief, p. 11. The Authority also concurs with DEEP's request regarding this matter. Accordingly, the Authority directs Aquarion to hire a DEEP-approved third party to conduct a Withdrawal Impact Study and to submit the results of such study to DEEP and the Authority no later than September 29, 2023, as a compliance filing.

3. Adequacy of Water Supply & Storage

The Company provides the present and projected water demands and safe yields in each of Aquarion's water systems. Application, Sch. G-6.1. Most of its water systems have adequate supply to meet current and projected demands over the 50-year planning period. See id. The Chimney Heights, Clearview, and the Falls Village water systems, however, have a margin of safety (MOS) less than 1.15. Aquarion Interrog. Resp. RRU-123, Att. 1. The MOS for maximum daily water (MDD) demand determines the adequacy of the water supply. If MOS for MDD is 1.15 or more, then the water system has appropriate water supply. Aquarion's current MOS for MDD is 1.15 or more for all of its water systems, except for Chimney Heights (1.13), Clearwell (1.0), and the Falls Village (0.8) water systems. Aquarion Interrog. Resp. RRU-123, Att. 1.

According to Aquarion, the Company took the following actions to improve and correct MOS for MDD: (1) consolidated the Chimney Heights water system into the Newton water system, which resolved Chimney Height's MOS issue; and (2) purchases water for its Clearview waters system from the Countryside Apartments water system. Aquarion Interrog. Resp. RRU-363. Aquarion stated that the Falls Village System was acquired in April 2021, and based on actual operations after acquisition, it has no issues meeting MDD. Id. Aquarion does, however, plan to confirm the available water based on the Company's actual operational data. Id.

The Company evaluates the adequacy of storage in each of its pressure zones through a regular program of master planning. Aquarion Interrog. Resp. RRU-143. Storage is evaluated based on the ability to meet diurnal fluctuations in system demand and provide service during an emergency. Id. The analyses are combined with the Company's tank inspection program. Id. Based on condition and capacity, the Company develops a list of storage improvement needs. Id.

4. Interconnections and Purchased Water

Aquarion has 26 interconnections with neighboring water public water systems through which it receives and supplies water. Aquarion Interrog. Resp. RRU-114, Att. 1. The interconnections are with Veolia Water Westchester, Frederic Gunn School, Inc., South Norwalk Electric & Water, Classee Water – Latimer Point, The Connecticut Water Company, Ethel Walker School, Danbury Water Department, Groton Utilities, New Britain Water Department, Norwalk First Taxing District, Regional Water Authority, South Norwalk Electric & Water, and Torrington Water Company. Id. Of the 26 interconnections, 9 are emergency interconnections. The emergency interconnections are: AWC Greenwich to W. Putnam and Anderson Hill (Veolia); AWC Judea Main (Green) to Frederick Gunn School, Inc.; AWC Main System to South Norwalk Electric & Water; AWC Simsbury to Ethel Walker School; Danbury Water Department to AWC chimney Heights; Norwalk First Taxing District to AWC Main System; Danbury Water Department to AWC Indian Spring; South Norwalk Electric & Water to AWC Main system; and South Norwalk Electric & Water to AWC Norton (Darien). Id.

In 2021, Aquarion supplied 5.05 million gallons per day (mgd) through interconnections and received 1.64 mgd water through interconnections. Aquarion Interrog. Resp. RRU-114, Att. 1.

5. Water Conservation Plan

Aquarion provided a WCP in its Application. Application, Sch. H-3.0. The Company's WCP provides many options for the Company to implement directly or educate customers on, such as using high efficiency toilets, commercial and industrial equipment upgrades, two-day per week irrigation restrictions, water use audits, water conservation rebate pilot program, public education and outreach, meter management, water system evaluation, tracking of water main flushing program water usage, hydrant maintenance and repair, pressure reduction, water main infrastructure restoration, notifications to customers when there is an increase over historic water usage, offer to conduct high bill investigations at a customer's premises, and make conservation kits available for customers with high bills or areas with supply problems. Id.

6. Periodic Meter Testing

In order to maintain meter effectiveness, a water company must periodically test its meters for accuracy. Meter tests are necessary to determine their accuracy in order to: (1) ensure that billings to customers are accurate; (2) assist a company in controlling its levels of NRW; and (3) assist customers in reducing their consumption. A water company is required to test all 5/8-inch, 3/4-inch, and 1-inch meters at intervals of 8 years and all other size meters at more frequent intervals. Conn. Agencies Regs. § 16-11-88.

If a water company meets certain requirements, the Authority may grant it an extension. Conn. Agencies Regs. § 16-11-88(1). The water company may also be required to conduct meter testing more frequently as a result of a customer request or an order by the Authority. Conn. Agencies Regs. § 16-11-89.

The Company submits its periodic meter testing reports on an annual basis to the Authority. Conn. Agencies Regs. § 16-11-86. Prior to January 21, 2022, Aquarion was on a 12-year cycle for periodic meter testing. The Company requested an extension from 12 to 14 years for its periodic meter testing interval for Aquarion's 5/8-inch, 3/4-inch and 1-inch meters on November 18, 2021. Aquarion Interrog. Resp. OCC-261, Att. 1. Aquarion provided data depicting that over the past three years, 90% to 102% of all meters tested registered between 96% to 102% accuracy. *Id.* Upon a review of the Company's periodic meter test reports for the past three years, the Authority granted the requested extension to implement the 14-year meter testing interval on January 21, 2022. *Id.*

The Company stated that due to the COVID-19 pandemic, it did not complete the required number of meter testing for 2020 because customers did not allow the Company to access meters located in homes, which resulted in a cumulative backlog of approximately 10,000 meters to be tested. Aquarion Interrog. Resp. RRU-120; Aquarion Interrog. Resp. OCC-261, Att. 1, p. 2. The additional two-year extension provided the Company needed time to address the 2020 and 2021 backlog of meter testing and will level out future meter replacements. Aquarion Interrog. Resp. OCC-261, Att. 1, p. 2.

The Authority will review the Company's next annual periodic meter test report to ensure that the Aquarion meter testing backlog is addressed.

X. CONCLUSION AND ORDERS

A. CONCLUSION

Based on the foregoing, the Company's requested rate increase in annual revenues and the proposed rate schedule is approved accounting for the Authority's adjustments. The approved decrease in the current revenue requirement is \$1,969,517 or approximately 0.997% below revenue at current rates.

B. ORDERS

For the following Orders, the Company shall file an electronic version through the Authority's website at www.ct.gov/pura. Submissions filed in compliance with the Authority's Orders must be identified by all three of the following: Docket Number, Title and Order Number. Compliance with orders shall commence and continue as indicated in each specific Order or until the Company requests and the Authority approves that the

Company's compliance is no longer required after a certain date.

1. (ACAM) On or after the issuance date of the Decision, the Company shall comply with updated ACAM results, where appropriate, to reflect adjustments the Authority has made in the Decision.
2. (Rate Design) No later than 10 days after issuance of the Decision, the Company shall file as a compliance filing a revised single year rate design plan consistent with the Authority's findings contained in the Decision that will include revised tariffs and revenue proof.
3. (Rate Design) No later than 10 days after issuance of the Decision, the Company shall design a three-tiered volumetric rate structure for single-family residential customers, with the first tier up to 9 CCF, the second tier above 9 to 20 CCF, and the third tier over 20 CCF.
4. (LIRAP) No later than 30 days after issuance of the Decision, the Company shall submit samples of each type of communication it will provide, including reenrollment communications and sample bills. Prior to filing such materials, the Company shall make the materials available to, at a minimum, OCC, EOE, and Operation Fuel for the organizations' review and feedback, with at least five business days' notice prior to the filing date.
5. (LIRAP) No later than 30 days after issuance of the Decision, the Company shall submit as a motion for review and approval a detailed proposal to partner with the CAAs to enroll customers into the LIRAP, including the costs associated with the partnership and a draft memorandum of understanding to facilitate such arrangement, if approved.
6. (LIRAP) No later than 30 days after issuance of the Decision, the Company shall submit as a motion for review and approval a detailed data-sharing proposal to share data with CL&P, Yankee, and DSS, including costs and a timeline to implement.
7. (LIRAP) No later than 30 days after issuance of the Decision, the Company shall submit as a motion for review and approval a detailed cost proposal to configure its SAP system to allow for the addition of two or more LIRAP tiers, including a timeline for implementation of such proposal.
8. (Fee Free) No later than 30 days after issuance of the Decision, the Company shall implement the Fee Free program.
9. (Performance Metrics) No later than May 1, 2023, the Company shall submit as a motion for review and approval the data for each year from 2017 through 2022 required to calculate each of the performance metrics in Section VI.B.5., Performance Metrics.

10. (Diversions) No later than May 1, 2023, Aquarion shall submit as a compliance filing a detailed plan regarding how it will bring the Company's diversion permit and registration into compliance.
11. (LIRAP) No later than one week after the Company's agreement with Operation Fuel regarding the administration of LIRAP is fully executed, and no later than 60 days after issuance of the Decision, Aquarion shall submit the agreement as a compliance filing. The agreement shall make clear the duration of its applicability and the process for establishing and revising applicable fees, among other things.
12. (LIRAP) No later than 60 days after issuance of the Decision, the Company shall implement LIRAP, as modified in Section VIII.F.1., Low-Income Rate Assistance Program, with an eligibility cap of 60% SMI.
13. (Annual Conservation Expense) No later than 60 days after issuance of the Decision, the Company shall provide as a compliance filing projections associated with conservation expenditures to be made in the first rate year (i.e., March 15, 2023 – March 14, 2024), as well as for the subsequent two rate years. Such projections shall include, at a minimum, budgeted values on a per measure (or per sub-program) basis for administrative and customer incentive costs, as well as for the projected water and electricity (if applicable) savings.
14. (Customer Complaints) No later than 60 days after issuance of the Decision, the Company shall submit a compliance filing detailing at minimum:
 - a. metrics to be discussed at its meetings with EOE;
 - b. written processes and procedures governing how KPI data is used to improve the efficacy of Aquarion's communications with customers;
 - b. proposed standing agenda;
 - c. proposed frequency of the meetings, which shall not be less than quarterly; and
 - d. proposed Company attendees (by job title).

Prior to submission of the compliance filing, the Company shall provide EOE no less than 15 business days to review and provide feedback on such proposal. To the extent that EOE's feedback is not incorporated, the Company's submission to the Authority shall include a detailed narrative as to why.

15. (Customer Service) No later than 60 days after issuance of the Decision, the Company shall revise its customer notices (e.g., Welcome Letter, online application form, receipt upon collecting security deposit) to educate customers about the process of requesting a return of their security deposit and submit them as a compliance filing.

16. (Customer Service) No later than 60 days after issuance of the Decision, the Company shall revise its application form to include the provisions of Conn. Agencies Regs. § 16-11-68(b) and its internal procedures so that in the event the form is being completed over the telephone, a prospective customer is made aware of the security deposit exemptions, and the Company shall submit such revised application form and internal procedures as a compliance filing.
17. (LIRAP) No later than 90 days after issuance of the Decision, the Company shall submit as a compliance filing a proposal to eliminate the reenrollment process for LIRAP customers who change addresses within Aquarion service territory.
18. (Conservation) No later than September 29, 2023, Aquarion shall:
 - a. Hire a third party, approved by DEEP, to conduct a Withdrawal Impact Study at Bissell Brook and Cobble Brook;
 - b. Conduct the Withdrawal Impact Study at Bissell Brook and Cobble Brook; and
 - c. Submit the results of the Withdrawal Impact Study to DEEP and the Authority as a compliance filing.
19. (Performance Metrics) No later than January 15, 2024, and annually thereafter, the Company shall submit as a compliance filing detailed information regarding whether Aquarion met or exceeded each of the metrics in Section VI.B.5., Performance Metrics, during the previous calendar year. The compliance filing shall include an unlocked workable Excel spreadsheet providing the data on which the Company relied in making its determination.
20. (LSLR Program) No later than January 15, 2024, and annually thereafter, the Company shall submit as a compliance filing information regarding the LSLR Program, including at a minimum the number of Company service lines replaced in the previous calendar year, the number of customer service lines replaced in the previous calendar year, and information regarding the cost of such replacements and the associated funding source, such as the amount of DWSRF money applied.
21. (LIRAP) No later than February 1, 2024, and annually thereafter, the Company shall submit as a compliance filing the information on the enumerated list in Section VIII.F.1.j., Reporting Requirements, based on the data from the previous calendar year, i.e., January 1 through December 31. Aquarion shall work with EOE and OCC, as well as any other interested stakeholders, to develop additional recommended reporting requirements to track the benefits and drawbacks of LIRAP, including a mechanism for

identifying and tracking LIRAP offsets, and to submit the recommendations with its annual compliance filing.

22. (RAM) No later than February 1, 2024, and annually thereafter, the Company shall submit its annual RAM filing. Such filing shall include, among other things:
 - a. The amount of the Aquarion officer compensation and the Management Fee that customers are paying through base rates and through the RAM, or conversely how much is being returned to customers through the RAM, in accordance with Sections VI.B.2.c, Officer Compensation, and VI.B.4, Management Fee Compensation, respectively;
 - b. The revenue shortfall in a given calendar year resulting from the provision of LIRAP that the Company believes to be prudently incurred. The Company shall quantify and include a narrative explanation in its compliance filing of any variance of the annual RAM expenses (e.g., uncollectibles, payment plans, late payments, etc.) that may be impacted by the establishment of LIRAP;
 - c. The amount of revenues collected from late payment fees, which shall be used as a “surplus” for RAM purposes that will serve to offset potential revenue shortfalls; and
 - d. Information regarding the Company’s actual bad debt expense.
23. (RAM) No later than February 1, 2024, the Company shall submit in its 2023 RAM filing, the amount of bad debt expense to be measured against as the pro rata share of bad debt expense embedded in rates from the 2013 Decision and the amount included from this rate case as of the date of the Decision.
24. (Fee Free) No later than March 1, 2024, and annually thereafter, the Company shall file the following data for the immediately preceding calendar year:
 - a. The number of credit/debit card payments;
 - b. All costs associated with the following payment methods:
 - i. credit/debit card payments;
 - ii. checks;
 - iii. payments in person at payment locations; and
 - iv. payments online or by phone – One Time Payments;
 - c. How quickly payments are being received from the date a bill is issued;
 - d. The number of credit card payments made by financial hardship customers, if the Company has implemented a customer code for such designation;
 - e. The annual amount of uncollectibles;
 - f. The qualitative improvements in customer satisfaction with the option; and
 - g. The annual amount of write-offs.

25. (EADIT) No later than March 15, 2024, the Company shall hire an independent third-party accounting firm, (i.e., not its current financial statement auditor) to perform a review to vet both the quantification and categorization of Aquarion's claimed EADIT in accordance with Section VI.E.4., Excess Accumulated Deferred Income Taxes, and shall submit the results of the review as a motion for review and approval. The cost of this review shall not be recoverable in rates.
26. (Annual Conservation Expense) No later than June 1, 2024, and annually thereafter, the Company shall provide an annual compliance filing indicating its performance associated with conservation expenditures during the previous rate year against the previously submitted targets.
27. (LIRAP) No later than June 1, 2025, the Company shall explore a billing system modification that would allow for financial hardship coding of Aquarion's residential customers and submit as a motion for review and approval a detailed billing system modification proposal, including the costs and implementation timeline associated with the proposal.
28. (LIRAP) No later than January 1, 2026, the Company shall submit a detailed proposal containing modifications to the LIRAP, such as a tiered discount, including the number of tiers and amount of the discount, changes to the eligibility requirement, and cost control measures, and a detailed proposal regarding the implementation of an arrearage forgiveness program. The proposals shall include the costs and an implementation timeline to make such modifications and implement an arrearage forgiveness program. The Company shall share its proposals with EOE and OCC, as well as any other interested stakeholders, at least 60 days prior to its filing and incorporate feedback prior to submission to the Authority.
29. (Annual Conservation Expenses) No later than January 15, 2026, provided Aquarion has not filed an intervening rate proceeding, the Company shall submit as a compliance filing annual projections associated with conservation projections for the three years commencing March 15, 2026. Such projections shall include, at a minimum, budgeted values on a per measure (or per sub-program) basis for administrative and customer incentive costs, as well as for the projected water and electricity (if applicable) savings.
30. (Annual Conservation Expenses) No later than September 15, 2026, and every three years thereafter, the Company shall submit as a compliance filing the independent EM&V consultant's report regarding the consultant's review and assessment of Aquarion's conservation program results after every three years of implementation, including for the expenditures authorized in the Decision.


31. (Communication) The Company shall meet with EOE on a regular basis, but no less than once per month, to discuss:
 - a. Aquarion's planned and executed communications with customers, including through the provision of KPI data that is provided on an, at minimum, quarterly basis;
 - b. Outstanding customer complaints, covering both those complaints and inquiries submitted to the Authority as well as those routed directly to the Company; and
 - c. Performance metrics tied to customer complaints, including any improvements thereto, and how such metrics regarding customer complaints about water quality and quantity issues tied to infrastructure improvements.
32. (Employee Time) The Company shall track the amount of time Aquarion employees spend volunteering during paid working hours. In its next rate case application, the Company shall provide an unlocked, workable Excel spreadsheet that details the requested information for each year between 2023 and through the test year proposed in the next rate proceeding.
33. (ESM) The Company shall calculate any future determination of the ESM ROE using the lesser of Aquarion's authorized equity position or the lesser of the actual equity carried position for the relevant period-end.
34. (LSLR Program) No later than 30 days prior to commencing its LSLR Program, the Company shall file as compliance a copy of its customer contract and any related materials associated with the LSLR Program.
35. (Acquisitions) The Company shall track all employee time spent on any future acquisitions, including mergers. As an addendum to the Company's next rate case filing, the Company shall append an unlocked, workable Excel spreadsheet that details the requested information for each year between 2023 and through the test year proposed in the next rate proceeding.
36. (LIRAP) The Company shall cross-file all motions and compliance filings required by this Decision that are associated with LIRAP in this docket and in the applicable current year's RAM proceeding.
37. (LPCs) After implementation of LIRAP, the Company shall allow its customer service representatives to waive LPCs when establishing reasonable payment plans for customers receiving LIRAP. After implementation of a billing system modification required subsequent to a motion ruling on Order No. 27, the Company shall allow its customer service representatives to waive LPCs for financial hardship customers, including customers receiving LIRAP, when establishing reasonable payment plans.

38. (Rate Case) In its next rate case application, the Company shall provide:
 - a. A breakdown of costs included in the planned annual conservation expense, as well as a cost-benefit calculation of the total conservation expense; and
 - b. invoices provided by third parties for each year of conservation expenditures incurred in the intervening years between rate cases, along with a narrative and data that compares and contrasts the authorized annual conservation expenses with actual expenditures, as well as the savings targets compared to actual realized savings.
39. (Rate Case) In its next rate case application, the Company shall provide a separate schedule for each O&M expense item included in the Test Year and for pro forma ratemaking purposes in the Rate Year.
40. (Rate Case) In its next rate case application, the Company shall provide a separate schedule for SERP expense that includes a detailed breakdown of the actual amount of SERP expense proposed, both direct and allocated.
41. (Rate Case) As a prerequisite to cost recovery associated with prospective logger investments, the Company shall conduct a cost/benefit analysis of the installation of loggers compared to other leak detection tools or mitigation measures, and submit the results of such analysis coincident with any rate amendment application through which associated cost recovery is sought.
42. (Rate Case) In its next rate case application, the Company shall provide an analysis of a program that uses the fees collected by the LPCs as “crisis grants” to be awarded to income-qualified customers who are most at risk for disconnection.
43. (Rate Case) In its next rate case application, the Company shall provide an analysis of the type of customers who incur late payment charges; the average, maximum, and minimum late payment charges incurred by customers, by class, in a given year; and the impact LPCs have on uncollectibles.

DOCKET NO. 22-07-01

APPLICATION OF AQUARION WATER
COMPANY OF CONNECTICUT TO
AMEND ITS RATE SCHEDULE

This Decision is adopted by the following Commissioners:

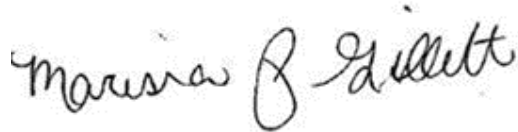

Marissa P. Gillett



Michael A. Caron

CERTIFICATE OF SERVICE

The foregoing is a true and correct copy of the Decision issued by the Public Utilities Regulatory Authority, State of Connecticut, and was forwarded by Certified Mail to all parties of record in this proceeding on the date indicated.



March 15, 2023

Jeffrey R. Gaudiosi, Esq.
Executive Secretary
Public Utilities Regulatory Authority

Date

XI. APPENDIX

INTERVENOR	REPRESENTATIVE
City of Bridgeport	Joseph Ganim Mayor City of Bridgeport 999 Broad Street Bridgeport, CT 06604
City of Danbury	Dean Esposito Mayor City of Danbury City Hall 155 Deer Hill Avenue Danbury, CT 06810-7726
City of Derby	Richard Dziekan Mayor City of Derby Office of the Mayor 1 Elizabeth Street Derby, CT 06418
City of Norwalk	Harry W. Rilling Mayor City of Norwalk Norwalk City Hall 125 East Avenue Norwalk, CT 06856-5125
City of Norwich	Peter A. Nystrom Mayor City of Norwich 100 Broadway Room 330 Norwich, CT 06360
City of Shelton	Mark A. Lauretti Mayor City of Shelton 54 Hill Street P.O. Box 364 Shelton, CT 06484

City of Stamford	Caroline Simmons Mayor City of Stamford Stamford Government Center 888 Washington Blvd., 10 th Floor Stamford, CT 06902
Town of Beacon Falls	Gerald F. Smith First Selectman Town of Beacon Falls 10 Maple Avenue Beacon Falls, CT 06403
Town of Bethel	Matthew Knickerbocker First Selectman Town of Bethel Clifford J. Hurgin Municipal Center 1 School Street Bethel, CT 06801
Town of Brookfield	Tara Carr First Selectman Town of Brookfield 100 Pocono Road Brookfield, CT 06804-5106
Town of Canaan	Henry W. Todd First Selectman Town of Canaan 108 Main Street Canaan, CT 06031
Town of Cornwall	Gordon M. Ridgway First Selectman Town of Cornwall 16 Pine Street Cornwall, CT 06753
Town of Darien	Monica M. McNally First Selectman Darien Town Hall 2 Renshaw Road Darien, CT 06820
Town of East Granby	Eden Wimpfheimer First Selectwoman Town of East Granby 9 Center Street East Granby, CT 06026

Town of East Hampton	David Cox Town Manager Town of East Hampton 1 Community Drive East Hampton, CT 06424
Town of East Hampton	Mark Philhower Town Council Chairman Town of East Hampton 1 Community Drive East Hampton, CT 06424
Town of Easton	David Bindelglass First Selectman Town of Easton 225 Center Road Easton, CT 06612
Town of Fairfield	Brenda L. Kupchick First Selectman Town of Fairfield Sullivan Independence Hall, Second Floor 725 Old Post Road Fairfield, CT 06824
Town of Farmington	C.J. Thomas Town Council Chairman Town of Farmington 1 Monteith Drive Farmington, CT 06432
Town of Farmington	Kathleen A. Blonski Town Manager Town of Farmington 1 Monteith Drive Farmington, CT 06032-1053
Town of Goshen	Todd M. Carusillo Town of Goshen 42A North Street Goshen, CT 06756
Town of Granby	Erica P. Robertson Town Manager Town of Granby 15 North Granby Road Granby, CT 06035

Town of Granby	Mark H. Florentino First Selectman Town of Granby 15 North Granby Road Granby, CT 06035-2101
Town of Greenwich	Heather R. Spaide, Esq, Marino, Zabel & Schellenberg, PLLC 657 Orange Center Road Orange, CT 06477
Town of Greenwich	Fred Camillo First Selectman Town of Greenwich Greenwich Town Hall 101 Field Point Road P.O. Box 2540 Greenwich, CT 06836-2540
Town of Groton	John Burt Town Manager Town of Groton 45 Fort Hill Road Groton, CT 06340
Town of Groton	Juan Melendez, Jr. Mayor Town of Groton 45 Fort Hill Road Groton, CT 06340
Town of Kent	Jean C. Speck First Selectman Town of Kent 41 Kent Green Boulevard P.O. Box 678 Kent, CT 06757-0678
Town of Lebanon	Kevin T. Cwikla First Selectman Town of Lebanon 579 Exeter Road Lebanon, CT 06249
Town of Litchfield	Denise Raap First Selectman Town of Litchfield 74 West Street P.O. Box 488 Litchfield, CT 06759-0488

Town of Mansfield	Antonia Moran Mayor Town of Mansfield Audrey P. Beck Municipal Building 2 S Eagleville Road Mansfield, CT 06268
Town of Mansfield	Ryan Aylesworth Town Manager Town of Mansfield Audry P. Beck Municipal Building 4 South Eagleville Road Mansfield, CT 06268
Town of Marlborough	Amy Traversa Interim Town Manager Town of Marlborough 26 North Main Street P.O. Box 29 Marlborough, CT 06477
Town of Middlebury	Edward B. St. John First Selectman Town of Middlebury 1212 Whittemore Road Middlebury, CT 06762
Town of Monroe	Ken Kellogg First Selectman Town of Monroe 7 Fan Hill Road Monroe, CT 06468
Town of New Canaan	Kevin Moynihan, III First Selectman Town of New Canaan New Canaan Town Hall 77 Main Street New Canaan, CT 06840-0447
Town of New Fairfield	Patricia Del Monaco First Selectman Town of New Fairfield 4 Brush Hill Road New Fairfield, CT 06812
Town of New Milford	Pete Bass Mayor Town of New Milford 10 Main Street New Milford, CT 06776

Town of Newtown	Daniel C. Rosenthal First Selectman Town of Newtown Newtown Municipal Center 3 Primrose Street Newtown CT 06470
Town of Norfolk	Matthew T. Riiska First Selectman Town of Norfolk 19 Maple Avenue P.O. Box 592 Norfolk, CT 06058
Town of North Canaan	Charles P. Perotti, Jr. First Selectman Town of North Canaan 100 Pease Street, #1 North Canaan, CT 06018
Town of Oxford	George R. Temple First Selectman Town of Oxford 486 Oxford Road Oxford, CT 06478-1298
Town of Plainville	Katherine Pugliese Town Council Chair Town of Plainville 50 Broad Street Plainville, CT 06062
Town of Plainville	Michael T. Paulhus Town Manager Town of Plainville Municipal Center 1 Central Square Plainville, CT 06062
Town of Redding	Julia Pemberton First Selectman Town of Redding 100 Hill Road Redding, CT 06875
Town of Ridgefield	Rudolph Marconi First Selectman Town of Ridgefield 400 Main Street Ridgefield, CT 06877

Town of Seymour	Annmarie Drugonis First Selectman Town of Seymour 1 First Street Seymour, CT 06483
Town of Sherman	Don Lowe First Selectman Town of Sherman 9 Rt. 39 North P.O. Box 39 Sherman, CT 06784
Town of Simsbury	Maria Capriola Town Manager Town of Simsbury 933 Hopmeadow Street Simsbury, CT 06070
Town of Simsbury	Wendy Mackstutis First Selectman Town of Simsbury 933 Hopmeadow Street Simsbury, CT 06070
Town of Southbury	Jeff Manville First Selectman Town of Southbury 501 Main Street South Southbury, CT 06488
Town of Southington	Mark J. Sciota Town Manager Town of Southington 75 Main Street Southington, CT 06489
Town of Southington	Victoria Triano Town Council Chair Town of Southington 33 Bellevue Avenue Southington, CT 06489
Town of Stonington	Danielle Chesebrough First Selectman Town of Stonington 152 Elm Street Stonington, CT 06378

Town of Stratford	Laura R. Hoydick Mayor Town of Stratford 2725 Main Street Stratford, CT 06615
Town of Suffield	Colin Moll First Selectman Town of Suffield 83 Mountain Road Suffield, CT 06078
City of Torrington	Elinor Carbone Mayor City of Torrington 140 Main Street Torrington, CT 06790
Town of Trumbull	Vicki Tesoro First Selectman Town of Trumbull 5866 Main Street Trumbull, CT 06611
Town of Washington	James L. Brinton First Selectman Town of Washington 2 Bryan Plaza Washington, CT 06794
Town of Weston	Samantha Nestor First Selectman Town of Weston 56 Norfield Road Weston, CT 06883
Town of Westport	Jennifer Tooker First Selectman Town of Westport 110 Myrtle Avenue Westport, CT 06880
Town of Wilton	Lynne Vanderslice First Selectman Town of Wilton 238 Danbury Road Wilton, CT 06897-4008

Town of Wolcott	Thomas G. Dunn Mayor Town of Wolcott Town Hall 10 Kenea Avenue Wolcott, CT 06716-2114
Town of Woodbury	Barbara Perkinson First Selectman Town of Woodbury 281 Main Street South Woodbury, CT 06798