



Salvatore D. Ianiero

16 Chestnut Street, Suite 220
Foxboro, MA 02035
Tel (401) 533-0728
Fax (774) 215-5423

Melanie Bachman
Acting Executive Director
Connecticut Siting Council
10 Franklin Square
New Britain, CT 06051

RECEIVED
FEB 10 2014
CONNECTICUT
SITING COUNCIL

Re: **Notice of Exempt Modification - Emergency Backup Generator**
FA#: 10128682/ 699 Old Main Street, Rocky Hill, CT 06067/ Project Code: 2051691699

Dear Ms. Bachman:

American Telephone and Telegraph Company ("AT&T") currently maintains a wireless telecommunications facility at the above referenced address. AT&T's facility consists of antennas at the 105' mark of the existing 150' tower and an existing AT&T equipment area. The tower and AT&T's area are located within an existing lease area. The existing cement equipment pad supports AT&T's equipment and space for a back-up generator. AT&T does not currently maintain a generator at this cell site.

In an effort to further enhance multiple tenants' network reliability, AT&T intends to modify its facility by installing a new 50kw diesel-powered generator outside in a designated 5' x 11' ground space. The diesel fuel tanks are double walled for added safety and will be filled by a licensed fuel filling company. The proposed modification will remain within the existing fenced compound within the limits of the existing lease area. The new generator and tank will be surrounded by a security fence and gate. (See Facility Compound Plan attached).

Please accept this letter as notification pursuant to R.C.S.A Section 16-50j-73, for construction that constitutes modification pursuant to R.C.S.A Section 16-50j-72(b)(2). In accordance with R.C.S.A Section 16-50j-73, a copy of this submission is being sent to the Town of Rocky Hill. A copy of this submission is also being sent to Crown Castle, the property owners on which the tower is located.

ATCs' Proposed Wireless Modifications Constitutes An "Exempt Modification"

The proposed modification to the above mentioned Facility constitutes an exempt modification of an existing facility provided for in R.C.S.A Section 16-50j-72(b)(2) and Council regulations promulgated pursuant thereto.

- 1) The proposed modification will not result in an increase in the height of the existing tower.

- 2) The generator and attached fuel tank will remain entirely within the limits of the leased area. The modifications therefor, will not require the extension of the boundary.
- 3) The proposed modification does not increase the noise levels at the boundary by six(6) decibels or more under normal conditions. Proposed modification is only used during emergency power failure.
- 4) The installation of a new generator and attached fuel tank will not change, in any way, radio frequency (RF) emissions at the facility.
- 5) The facility has received all municipal zoning approvals and building permits. (Regs., Conn. State Agencies Section 16-50j-72))

For all the foregoing reasons, American Telephone and Telegraph Company respectfully submits that the proposed modifications to the above-referenced telecommunications facility constitutes an exempt modification under R.C.S.A Section 16-50j-72(b)(2)

Respectfully submitted,




Sal Ianiero 401-533-0728

On behalf of American Tower Corporation
c/o Tower Resource Management, Inc.
16 Chestnut Street, Suite 220
Foxboro, MA 02035

cc: **Town of Rocky Hill, CT**
Crown Castle

Exhibit I

Site Plan

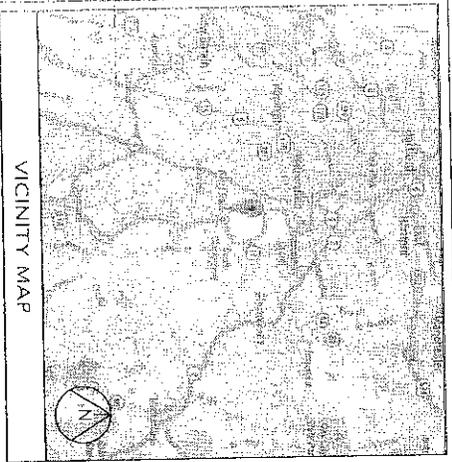

VICINITY MAP




BACKUP POWER PROJECT

SITE IDENTIFICATION:

SITE NUMBER: 10128682
 SITE NAME: ROCKY HILL OLD MAIN STREET
 STREET
 SITE ADDRESS: 699 OLD MAIN STREET
 ROCKY HILL, CT 06067

PROJECT DESCRIPTION:
 THE PROPOSED PROJECT INCLUDES PLACING A 50 KW GENERATOR IN AN EXISTING CELLULAR TOWER COMPOUND.

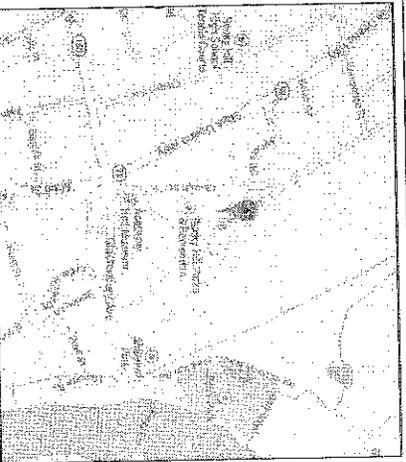

LOCAL MAP

NOTE:
 CONTRACTOR TO VERIFY EXISTING MUX LOCATION. IF MUX LOCATION IS OUTSIDE OF AT&T EQUIPMENT AREA, CONTRACTOR IS TO FIELD VERIFY THE PRESENCE OF EMERGENCY BACK-UP SERVICE TO THE MUX. IF EMERGENCY BACK-UP SERVICE IS NOT PRESENT, CONTRACTOR IS TO ROUTE NEW SERVICE FROM AT&T EQUIPMENT AREA

500 EVERETT DRIVE, SUITE 3A
 ROCKY HILL, CT 06067

at&t

Sabre Industries

Hudson
 Equipment Services

1600 GARDEN STREET
 BUILDING 20 NORTH, SUITE 3006
 N. AVONDALE, CT 06001
 TEL: (860) 452-4553
 FAX: (860) 452-5166

SITE NUMBER:
10128682

SITE NAME:
ROCKY HILL OLD MAIN STREET

SITE ADDRESS:
 699 OLD MAIN STREET
 ROCKY HILL, CT 06067



STAMP HERE
 DRAWN BY: KSA
 CHECKED BY: SB
 DATE DRAWN: 1-27-14
 JOB NO.: 1029.01
 SHEET TITLE:

TITLE SHEET
 VICINITY MAP
 GENERAL INFORMATION

SHEET NUMBER: T-1 REV. # 0

PROJECT NOTES

1. THE FACILITY IS UNMANNED.
2. A TECHNICIAN WILL VISIT THE SITE APPROXIMATELY ONCE A MONTH FOR ROUTINE INSPECTION AND MAINTENANCE.
3. THE PROJECT WILL NOT RESULT IN ANY SIGNIFICANT AND DISTURBANCE OR EFFECT OF STORM WATER DRAINAGE.
4. NO SANITARY SEWER, POTABLE WATER OR TRASH DISPOSAL IS REQUIRED.
5. HANDICAP ACCESS IS NOT REQUIRED.

PROJECT LOCATION DIRECTIONS

START OUT GOING NORTHEAST ON ENTERPRISE DR TOWARD CAPITOL BLVD. 0.4 MI. TURN LEFT ONTO CAPITOL BLVD. 0.3 MI. TURN RIGHT ONTO WEST ST. 1.4 MI. TURN LEFT ONTO MAIN ST/CT-99. 0.8 MI. TURN RIGHT ONTO CT-160/GLASTONBURY AVE. 0.0 MI. TURN SLIGHT LEFT ONTO OLD MAIN ST. 0.2 MI. AND AT 699 OLD MAIN ST. ROCKY HILL, CT 06067

PROJECT SUMMARY

GEOGRAPHIC COORDINATES:
 LATITUDE: 41° 39' 57.99" N (41.6661 N)
 LONGITUDE: -72° 38' 15.99" W (-72.6377 W)
 GROUND ELEVATION: N/A

CODE BLOCK:
 BUILDING CODE:
 2003 INTERNATIONAL BUILDING CODE & 2003 CT STATE BUILDING CODE WITH 2009 & 2011 AMENDMENTS

AT&T OPS FOR POWER CUT OVER:
 NEED 24 HOUR NOTICE TO OPEN A TAP TICKET
 DIAL: 1-800-638-2922
 SELECT OPTION 1, THEN OPTION 2

PROJECT TEAM

APPLICANT:
 AT&T MOBILITY
 350 CONSTITUTION ROAD
 SUITES 13 & 14
 FRAMINGHAM, MA 01702

CUSTOMER REPRESENTATIVE:

REGGIE ROHR
 MARKET REPRESENTATIVES
 MARKET LEAD - AT&T NE GENERATOR PROGRAM
 13001 MORRIS ROAD, 6TH FLOOR, BLDG 1
 ALPHARETTA, GA 30004
 CELL: 770-990-0137
 E-MAIL: rrohr@atandtindustries.com

LANDLORD:

ROCKY HILL CASTLE USA
 2000 CORPORATE DR
 GARDENBURG, PA 15317
 GARDENBURG, PA 15317
 TEL: 717-677-0085


UTILITIES:

POWER COMPANY:
 NAME: NORTHEAST UTILITIES


Have plans laid out.
 Call before you dig.



NOTE:
 CONTRACTOR TO VERIFY EXISTING MUX LOCATION. IF MUX LOCATION IS OUTSIDE OF AT&T EQUIPMENT AREA, CONTRACTOR IS TO FIELD VERIFY THE PRESENCE OF EMERGENCY BACK-UP SERVICE TO THE MUX. IF EMERGENCY BACK-UP SERVICE IS NOT PRESENT, CONTRACTOR IS TO ROUTE NEW SERVICE FROM AT&T EQUIPMENT AREA

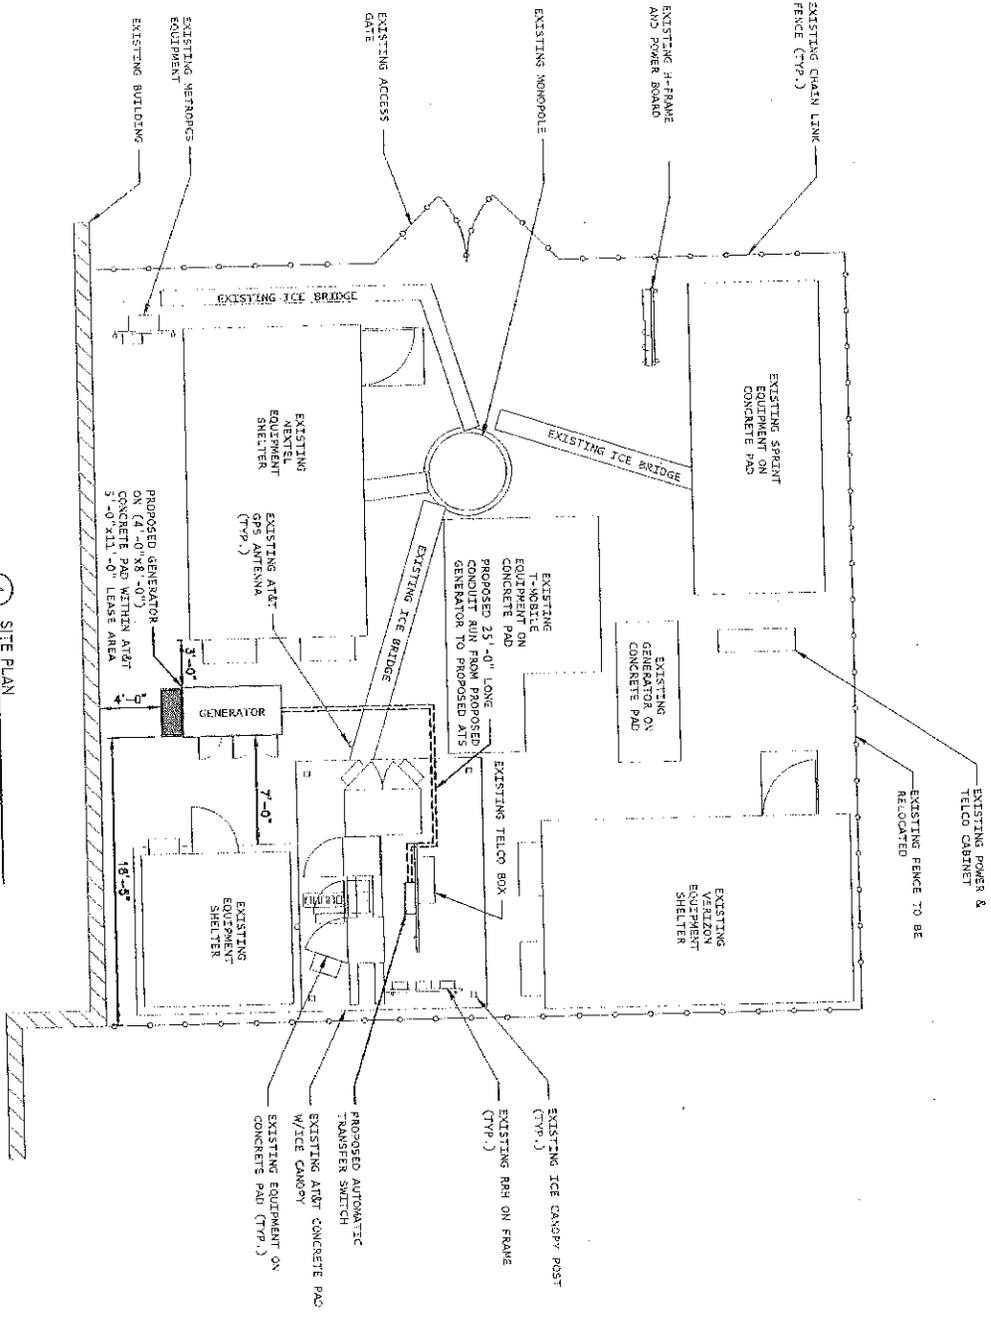

1 SITE PLAN
 SCALE 1/8" = 1'-0" (11"x17")
 1/4" = 1'-0" (24"x36")

300 ENTERPRISE DRIVE, SUITE 304
 ROCKY HILL, CT 06067




8800 ORGON STREET
 BLDG 20 NORTH, SITE 306
 BRIDGEVIEW, NJ 07003
 TEL: (973) 557-5555
 FAX: (973) 556-5588

SITE NUMBER:
10128682

SITE NAME:
**ROCKY HILL OLD
 MAIN STREET**

SITE ADDRESS:
 699 OLD MAIN STREET
 ROCKY HILL, CT 06067



Stamp: Daniel P. Ataman, Professional Engineer, No. 10128682, State of Connecticut, Exp. 12/31/01

STAMP HERE	DATE DRAWN: 1-27-14
DRAWN BY: KSR	JOB NO: 10391.01
CHECKED BY: SS	SHEET TITLE: SITE PLAN
SHEET NUMBER: A-1	REV. # 0