



Sal Ianiero

16 Chestnut Street, Suite 220
Foxboro, MA 02035
Tel (401) 533-0728
Fax

RECEIVED
FEB 10 2014

**CONNECTICUT
SITING COUNCIL**

Melanie Bachman
Acting Executive Director
Connecticut Siting Counsel
10 Franklin Square
New Britain, CT 06051

Re: **Notice of Exempt Modification - Emergency Backup Generator**

FA#: 10035413/ 307 Indian Park Ledge Road, Trumbull, CT 06611/ Project code: 2051691628

Dear Ms. Bachman:

American Telephone and Telegraph Company ("AT&T") currently maintains a wireless telecommunications facility at the above referenced address. AT&T's facility consists of antennas at the 175' mark of the existing 195' tower and an existing AT&T equipment shelter. The tower and AT&T's shelter are located within an existing lease area. The shelter houses AT&T's equipment and space for a back-up generator. AT&T does not currently maintain a generator at this cell site.

In an effort to further enhance multiple tenants' network reliability, AT&T intends to modify its facility by installing a new diesel generator outside in a designated 7'x12' ground space. The generator incorporates a built-in fuel tank as part of the unit. The diesel fuel tanks are double walled for added safety and will be filled by a licensed fuel filling company. The proposed modification will remain within the existing fenced compound within the limits of the existing lease area. The new generator and tank will be surrounded by a security fence and gate. (See Facility Compound Plan attached).

Please accept this letter as notification pursuant to R.C.S.A Section 16-50j-73, for construction that constitutes modification pursuant to R.C.S.A Section 16-50j-72(b)(2). In accordance with R.C.S.A Section 16-50j-73, a copy of this submission is being sent to the Town of Trumbull. A copy of this submission is also being sent to Crown Castle, the property owner on which the tower is located.


ATCs' Proposed Wireless Modifications Constitutes An "Exempt Modification"

The proposed modification to the above mentioned Facility constitutes an exempt modification of an existing facility provided for in R.C.S.A Section 16-50j-72(b)(2) and Council regulations promulgated pursuant thereto.

- 1) The proposed modification will not result in an increase in the height of the existing tower.
- 2) The generator and attached fuel tank will remain entirely within the limits of the leased area. The modifications therefor, will not require the extension of the boundary.
- 3) The proposed modification does not increase the noise levels at the boundary by six(6) decibels or more under normal conditions. Proposed modification is only used during emergency power failure.
- 4) The installation of a new generator and attached fuel tank will not change, in any way, radio frequency (RF) emissions at the facility.
- 5) The facility has received all municipal zoning approvals and building permits. (Regs., Conn. State Agencies Section 16-50j-72))

For all the foregoing reasons, American Telephone and Telegraph Company respectfully submits that the proposed modifications to the above-referenced telecommunications facility constitutes an exempt modification under R.C.S.A Section 16-50j-72(b)(2)

Respectfully submitted,

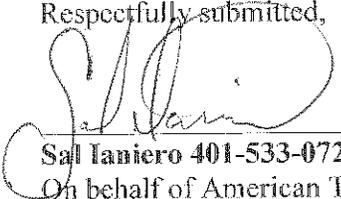


Sal Ianiero 401-533-0728

On behalf of American Tower Corporation
c/o Tower Resource Management, Inc.
16 Chestnut Street, Suite 220
Foxboro, MA 02035


cc: **Town of Trumbull, CT**
Crown Castle

Exhibit 1

Site Plan

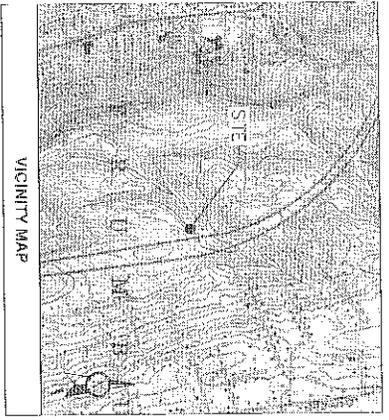

VICINITY MAP

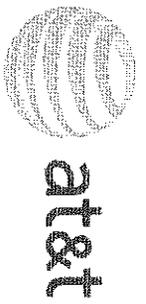


BACKUP POWER PROJECT

SITE IDENTIFICATION
SITE NUMBER: 10035413
SITE NAME: TRUMBULL INDIAN LEDGE

CROWN SITE #: 881535
SITE ADDRESS: 307 INDIAN PARK LEDGE ROAD
TRUMBULL, CT 06611

PROJECT DESCRIPTION
THE PROPOSED PROJECT INCLUDES PLACING A 50 KW GENERATOR WITHIN AN EXISTING CELLULAR TOWER COMPOUND.

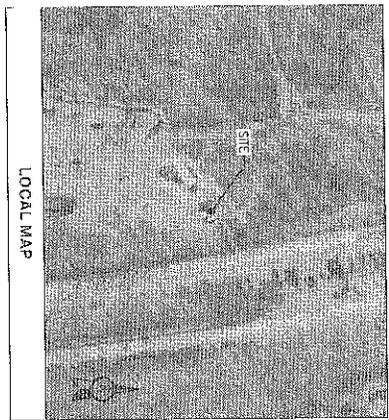

LOCAL MAP

PROJECT TEAM

OWNER: TRUMBULL ENGINEERING ASSOCIATES, LLC
 550 SPRINGFIELD ROAD
 TRUMBULL, CT 06611
 203-881-7400

ARCHITECT: KRIE VOLLMER
 500 WEST MAIN STREET
 FRAMINGHAM, MA 01702

ELECTRICAL ENGINEER: SARGE INDUSTRIES
 500 WEST MAIN STREET
 FRAMINGHAM, MA 01702
 770-890-0132

ANALYST: CROWN SERVICE
 300 SPRINGFIELD DRIVE
 TRUMBULL, CT 06611
 203-881-7400

PLUMBER: CROWN SERVICE
 300 SPRINGFIELD DRIVE
 TRUMBULL, CT 06611
 203-881-7400

PROJECT SUMMARY

SECURITY COMPLIANCE:
 LONG-TIME # 7212107

EDGE BLOCK:
 OF ALLOWING CODE 3099 A TYPICAL BUILDING CODE

MARK NOTE:
 CONTRACTOR TO VERIFY EXISTING VOLTAGE IN MAIN
 CONDUIT TO BE USED FOR NEW GENERATOR. IF VOLTAGE
 CONTRACTOR IS TO FIELD SERVICE THE PRESENCE OF
 EXISTING BACK-UP SERVICE IS NOT PRESENT
 CONTRACTOR IS TO PROVIDE NEW SERVICE FROM A NEW
 EQUIPMENT AREA.

PROJECT NOTES

1. THE FACILITY IS UNMANNED
2. A TECHNICIAN WILL VISIT THE SITE APPROXIMATELY ONCE A MONTH FOR ROUTINE INSPECTION AND MAINTENANCE
3. THE PROJECT WILL NOT RESULT IN ANY SIGNIFICANT LAND CONTAMINATION OR EFFECT OF STORM WATER DRAINAGE
4. NO SIGNIFICANT EROSION CONTROL MEASURES OR EROSION CONTROL IS REQUIRED
5. PARKWAY ACCESS IS NOT REQUIRED

PROJECT LOCATION DIRECTIONS

- TAKE I-490 WEST TOWARDS SPRINGFIELD/ALBANY NY
- TAKE EXIT 9 TO US-90 ON CT-24 TOWARDS US-20
- /HARTFORD/NEW YORK CITY
- COGNITIVE ONTO CT-15 SOUTH
- TAKE EXIT 09 ONTO CT-15 SOUTH TOWARDS NEW YORK CITY
- TAKE EXIT 14 ONTO CT-20 WEST TOWARDS FRAMINGHAM
- TAKE EXIT 14 ONTO CT-20 WEST
- TURN LEFT ONTO MAIN STREET
- TURN LEFT ONTO WINDING AVE
- TURN RIGHT ONTO INDIAN LEDGE PARK ROAD

SHEET INDEX

SHEET NO.	DESCRIPTION	REV.	DATE	BY
T-1	TITLE SHEET, VICINITY MAP & GENERAL INFORMATION	2	02/09/14	DW
A-1	SITE PLAN	2	02/05/14	DW
A-2	CONCRETE PAD DETAILS	2	02/03/14	DW
E-1	GENERATOR WIRING DIAGRAM	2	02/03/14	DW
E-2	ELECTRICAL DETAILS	2	02/03/14	DW
E-3	GENERATOR CON-TOL & ALARM WIRING	2	02/03/14	DW
G-1	FOUNDING & TRENCH DETAILS	2	02/03/14	DW

at&t

AT&T MOBILITY
 550 SPRINGFIELD ROAD
 TRUMBULL, MA 01702

TRM

TOWER RESOURCE MANAGEMENT
 30 WALK STREET
 WILMINGTON, MA 01897
 PHONE: (508) 299-1731
 www.trm.com

GIAPPPELLI ENGINEERING ASSOCIATES, LLC

317 WASHINGTON STREET
 TRUMBULL, CT 06611
 PHONE: (203) 881-7400
 www.giappelliengineering.com

TRUMBULL INDIAN LEDGE

307 INDIAN PARK LEDGE ROAD
 TRUMBULL, CT 06611

STATE OF CONNECTICUT

REGISTERED PROFESSIONAL ENGINEER

10035413


DATE: 02/09/14

TITLE SHEET
VICINITY MAP & GENERAL INFO

DATE: 02/09/14

BY: DW

- NOTES:**
1. A SITE VERIFICATION WAS NOT CONDUCTED BY CHASELL ENGINEERING ASSOCIATES, INC. THE PLAN REPRESENTS THE DESIGN OF THE PROJECT AS OF THE DATE OF THE ENGINEERING, DATED 07/21/11.
 2. CONTRACTOR SHALL VERIFY ALL UNDEVELOPED AREAS BEING UTILIZED FOR THE PROJECT AND AVOIDANCE OF ANY OBSTRUCTIONS.
 3. CONTRACTOR TO VERIFY EXISTING AIR QUALITY LOCATION. LOCATION IS OUTSIDE OF ALL EXISTING AIR QUALITY CONTROL ZONES TO BEYOND THE PRESENCE OF EXISTING EXHAUST SYSTEMS AND ALL EQUIPMENT SHALL BE MAINTAINED.
 4. CONTRACTOR TO MAINTAIN 10' MINIMUM CLEARANCE FROM ALL EXISTING UTILITIES AND ALL CLEARANCE SHALL BE MAINTAINED.

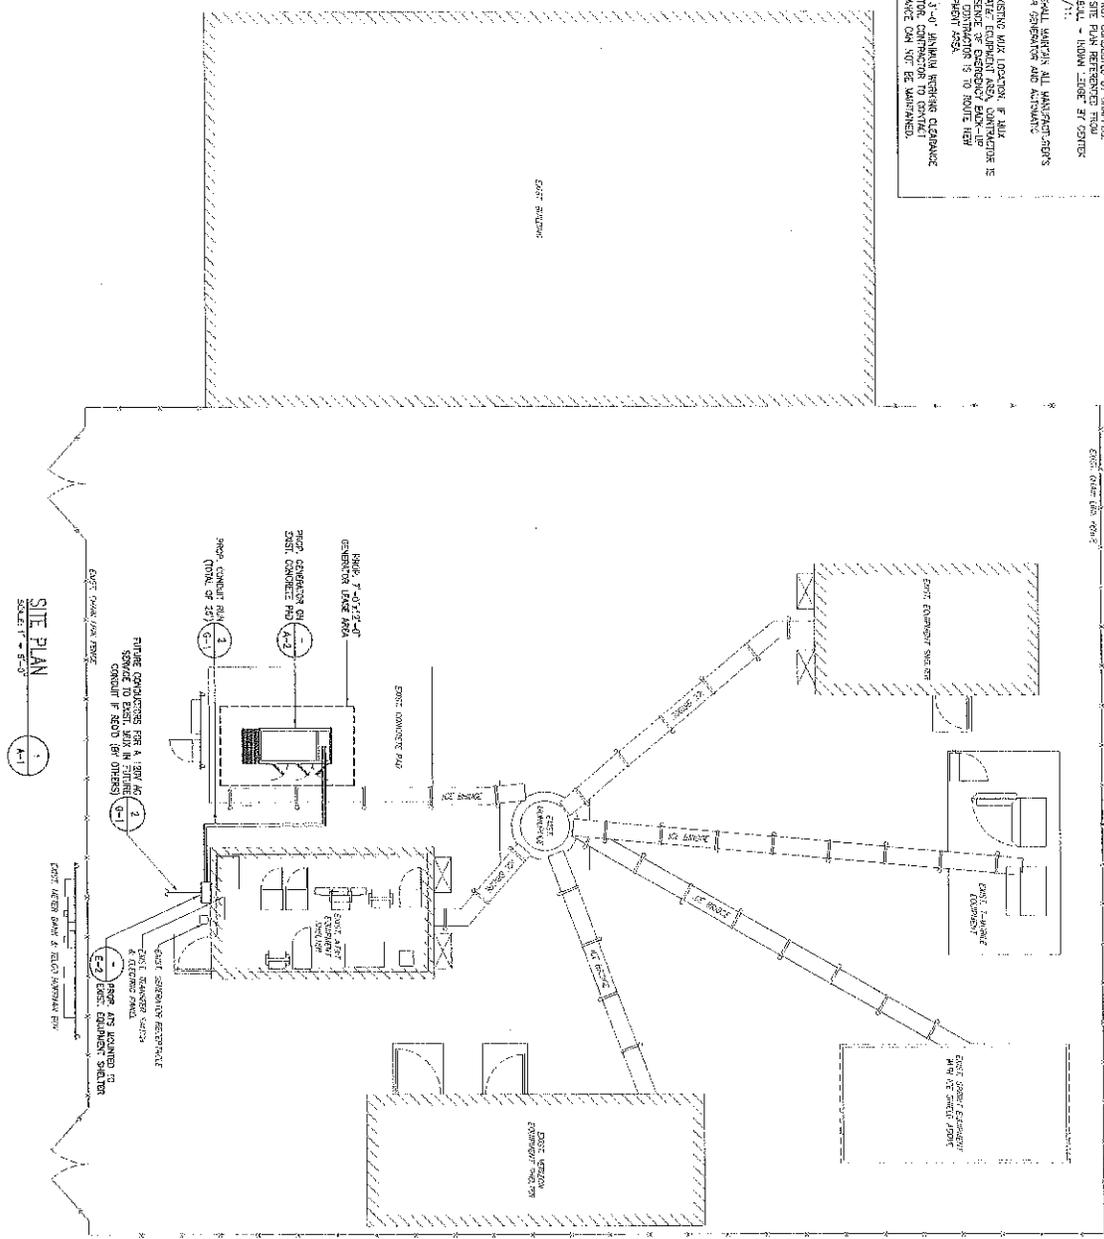

SITE PLAN
SCALE: 1" = 5'-0"

<p>CHASELL ENGINEERING ASSOCIATES, LLC</p> <p>F.R. EXECUTIVE CENTER 301 BOSTON POST ROAD WEST WALDEN, MA 01724 (508) 941-7400 www.chaseLLeng.com</p>		<p>TPM OWNER REPRESENTATIVE MANAGEMENT 10 LYMAN STREET WESTBOROUGH, MA 01581 PHONE: (508) 333-1731 www.tpm.com</p>		<p>at&t 950 STATE STREET SALEM, MA 01970 FRAMINGHAM, MA 01701</p>	
<p>SITE NAME: TRUMBULL INDIAN LEDGE COMMON SITE # 90320</p> <p>SITE ADDRESS: 391 INDIAN PANE LEDGE ROAD TRUMBULL, CT 06611</p>		<p>SITE NUMBER: 10035413</p>		<p>THOMAS J. MANSUETI REGISTERED PROFESSIONAL ENGINEER STATE OF CONNECTICUT NO. 13807B</p>	
<p>DATE: 07/21/11</p> <p>DATE REVISION: 11/07/11</p> <p>DRAWING TITLE: SITE PLAN</p>		<p>ISSUANCE NO.: A-1</p> <p>REVISIONS: 2</p>			