




OVERALL AREA PLAN SCALE 1"=80' 4

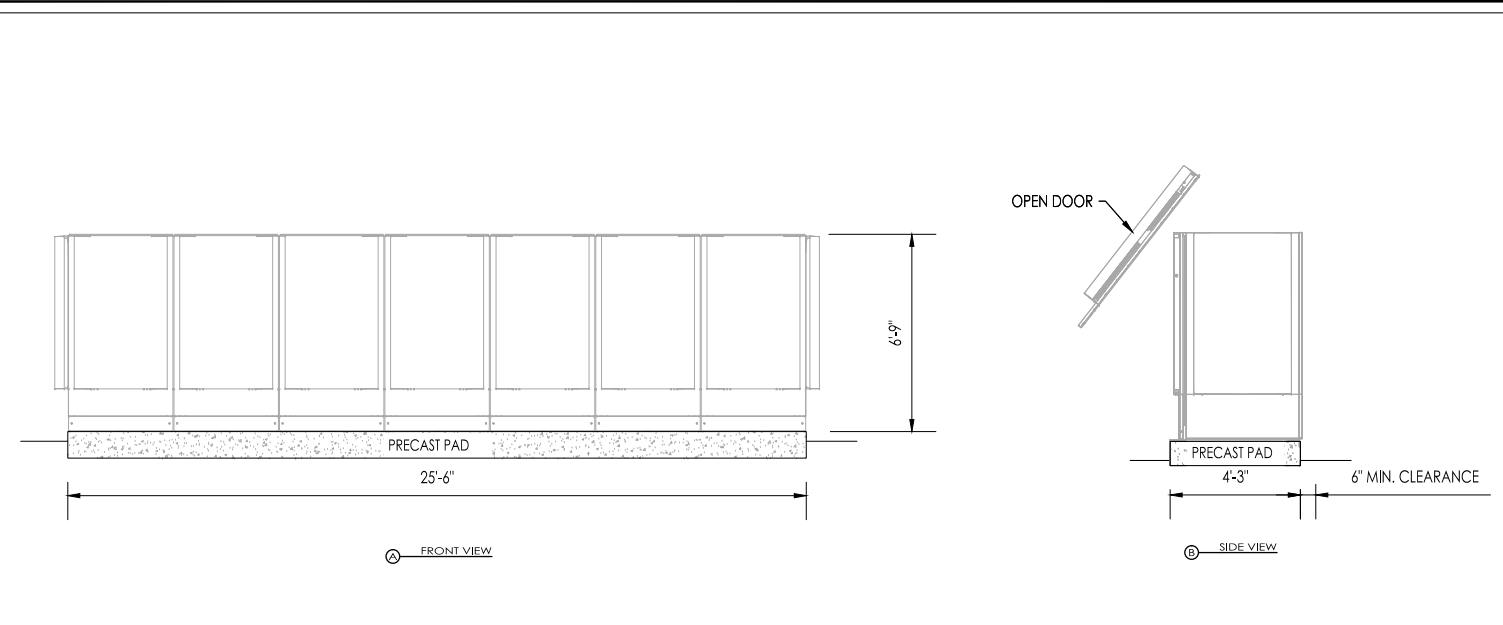

TYP ELEV OF ONE ES-5 BLOOMENERGY ES UNIT SCALE N.T.S. 2

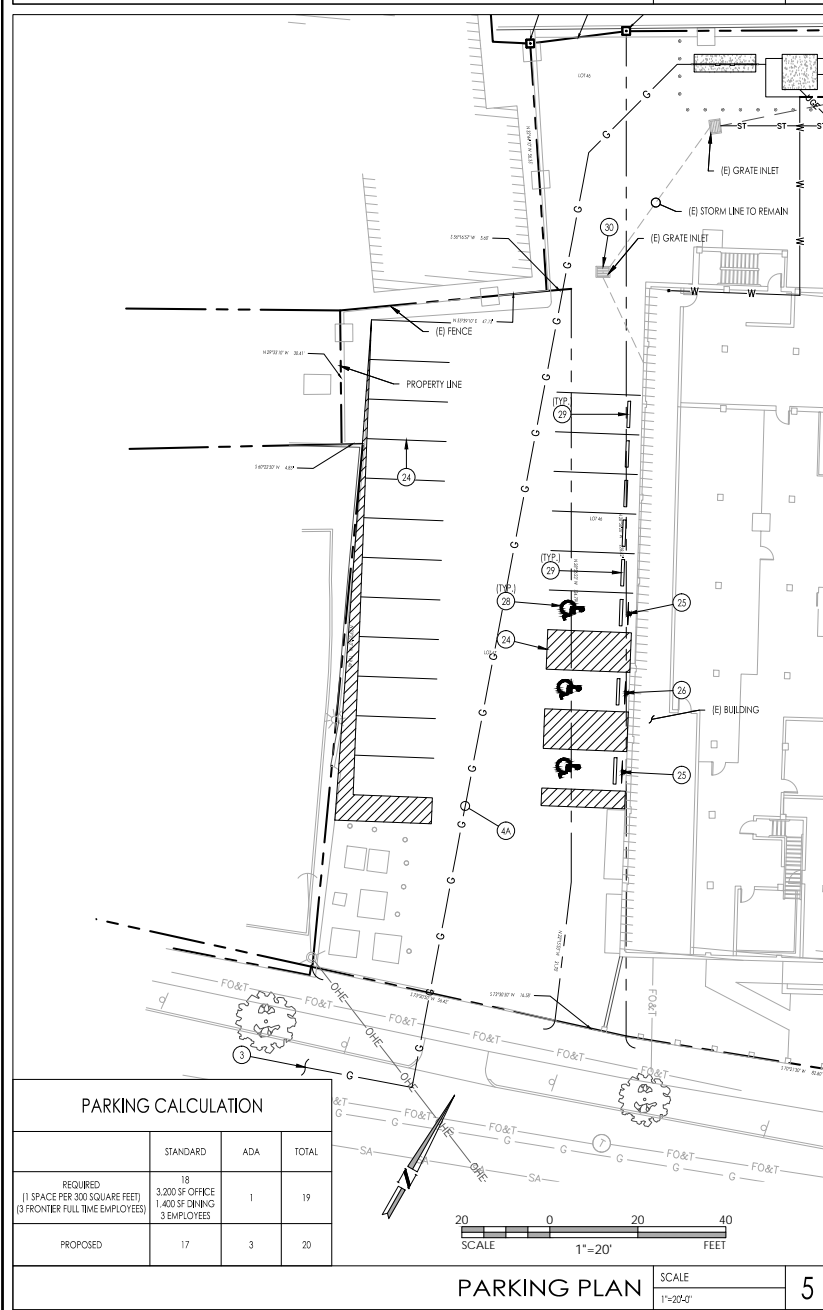

PARKING PLAN SCALE 1"=20' 5

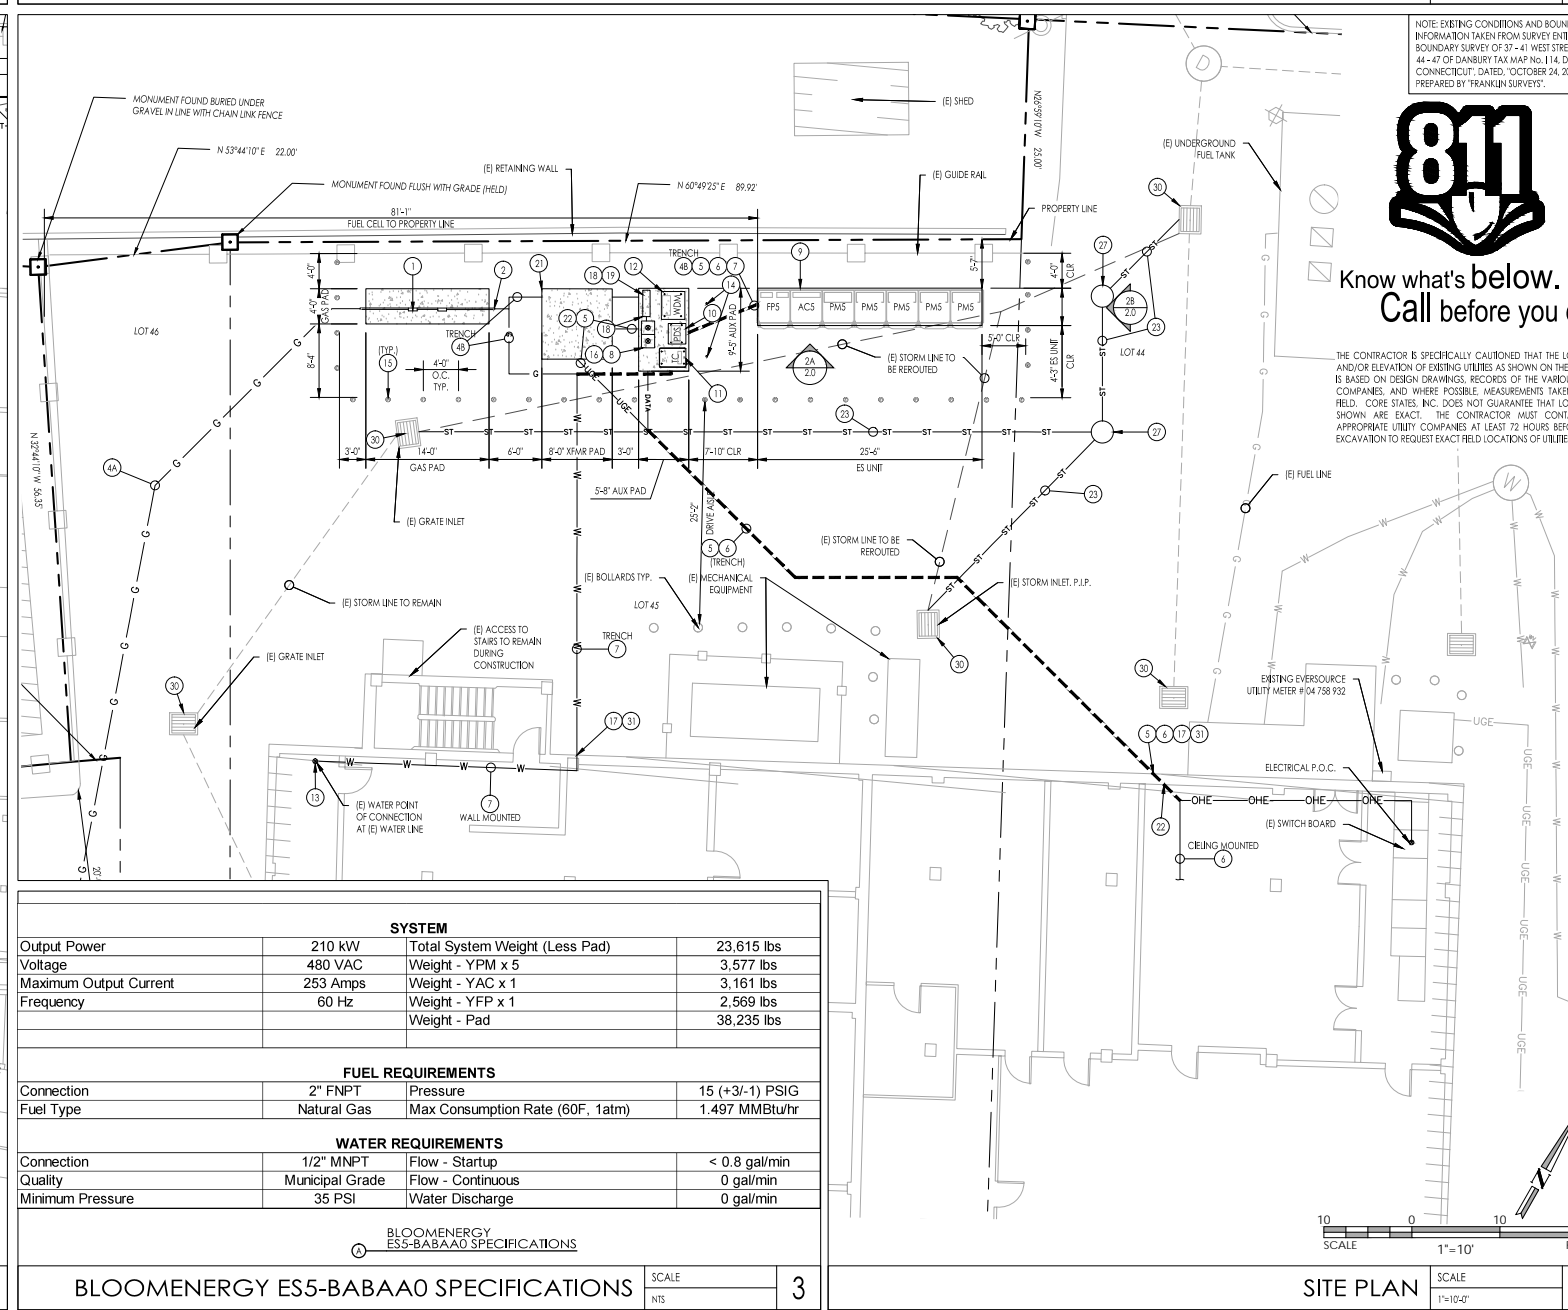

SYSTEM			
Output Power	210 kW	Total System Weight (Less Pad)	23,615 lbs
Voltage	480 VAC	Weight - YPM x 5	3,577 lbs
Maximum Output Current	253 Amps	Weight - YAC x 1	3,161 lbs
Frequency	60 Hz	Weight - YFP x 1	2,569 lbs
		Weight - Pad	38,235 lbs

FUEL REQUIREMENTS			
Connection	2" FNPT	Pressure	15 (+3/-1) PSIG
Fuel Type	Natural Gas	Max Consumption Rate (60F, 1atm)	1.497 MMBtu/hr

WATER REQUIREMENTS			
Connection	1/2" MNPT	Flow - Startup	< 0.8 gal/min
Quality	Municipal Grade	Flow - Continuous	0 gal/min
Minimum Pressure	35 PSI	Water Discharge	0 gal/min

BLOOMENERGY ES5-BABAA0 SPECIFICATIONS SCALE N.T.S. 3

- ### RESPONSIBILITY NOTES
- THE FOLLOWING EQUIPMENT SHOWN ON THESE PLANS WILL BE PROVIDED AND DELIVERED BY BLOOM ENERGY. APPLICABLE TRADES TO MOUNT AND MAKE FINAL CONNECTIONS:
 - POWER DISTRIBUTION SECTION (PDS)
 - TELEMETRY CABINET (TC)
 - WATER DEIONIZATION MODULE (WDM)
 - SIGNAGE (SEE SAFETY SIGNAGE)
 - SITE KIT (SEE SITE KIT NOTES)
 - THE FOLLOWING EQUIPMENT SHOWN ON THESE PLANS WILL BE PROVIDED, DELIVERED AND MOUNTED BY BLOOM ENERGY. APPLICABLE TRADES TO MAKE FINAL CONNECTIONS:
 - CLEAN ENERGY SERVER
 - PRECAST SUPPORT PADS
 - CONTRACTOR TO REFER TO ELECTRICAL PLANS FOR ASSOCIATED WORK.
- ### SITE KIT NOTES
- BLOOMENERGY TO PROVIDE AND DELIVER THE SITE KIT.
 - ELECTRICAL AND PLUMBING CONTRACTOR TO INSTALL THE SITE KITS, CONSULTING OF PAD PLUMBING AND BUS BARS, ON THE PRECAST CONCRETE PAD PER MANUFACTURER SPECIFICATIONS.
 - PUMP DEFLECTORS ARE NOT REQUIRED AT THIS SITE.
- ### UTILITIES
- GAS: YANKEE GAS SERVICE COMPANY
ELECTRIC: EVERSOURCE
- ### CONDUIT & PIPE LENGTHS
- | TYPE | TOTAL DISTANCE FROM TRENCH TO FURTHERMOST ES UNIT (LINEAR) |
|----------------------------|--|
| ELECTRICAL CABLE (TO T.P.) | 375 |
| DATA CONDUIT | 125 |
| WATER PIPE | 125 |
- ### LEGEND OF UTILITY LINES
- | | | | |
|---------------------|---------------------|-----------------------|----------------|
| DATA LINE | FENCE LINE | UNDERGROUND FUEL TANK | SANITARY LINE |
| FIBER OPTIC & PHONE | GAS LINE | STORM LINE | TELEPHONE LINE |
| JOINT UTILITY RUN | OVERHEAD ELECTRICAL | UNDERGROUND ELECT. | WATER LINE |
- ### KEYNOTES
- (N) UTILITY GAS METER SET ASSEMBLY (MSA) FOR CLEAN ENERGY SERVER. COORDINATE LOCATION & INSTALLATION REQUIREMENTS WITH UTILITY COMPANY PRIOR TO INSTALLATION. MAINTAIN MINIMUM 3'-0" CLEARANCE FROM ALL KNOWN SOURCES. CONTRACTOR TO PROVIDE PRECAST CONCRETE PAD.
 - (N) PRIVATE GAS BEER FOR CLEAN ENERGY SERVER WITH SHUT-OFF VALVE. MAINTAIN MINIMUM 3'-0" CLEARANCE FROM ALL KNOWN SOURCES & WET UTILITIES.
 - (N) GAS SERVICE BY UTILITY COMPANY. EXACT LOCATION AND LENGTH TO BE COORDINATED WITH UTILITY & BLOOM ENERGY. SIZES & TRENCHING REQUIREMENTS PER UTILITY COMPANY.
 - (N) GAS PIPE FROM (N) GAS TAP TO TERMINATE AT (N) UTILITY MSA INSTALLED BY UTILITY COMPANY. SIZES & TRENCHING REQUIREMENTS PER UTILITY COMPANY.
 - (N) GAS PIPE DATA CONDUIT & CABLE (WHERE NEEDED) FROM (N) UTILITY GAS MSA TO TERMINATE AT (N) ES UNIT INSTALLED BY CONTRACTOR.
 - (N) ELECTRICAL CONDUIT & WIRES FROM (N) ES UNIT TO (N) PDS TO (N) DISCONNECT TO (N) CT CABINET TO (N) LREC METER WITH FINAL TERMINATION AT (N) SWITCHGEAR.
 - (N) DATA CONDUIT & CABLE FROM (N) LREC METER TO TERMINATE AT (N) DATA ES/BACK LOCATION.
 - (N) WATER PIPE FROM BUILDING DOMESTIC WATER SYSTEM TO (N) WDM. CONNECT TO NEAREST AVAILABLE LOCATION.
 - (N) DISCONNECT SWITCH & NEMA 3R ENCLOSURE. MOUNT TO UNSTRUT PER MANUFACTURER SPECIFICATIONS & SHEET 3.1. ENSURE LOCATION MEETS ALL REQUIRED N.E.C. CLEARANCES. PROVIDE MODEL NUMBER ON THE OUTSIDE OF THE FRONT PANEL.
 - (N) BLOOMENERGY ES-5 ENERGY SERVER.
 - (N) POWER DISTRIBUTION SECTION (PDS). CAST-IN-PLACE PAD AND MOUNTING SPECIFICATIONS PER GRADING PLAN, CONDUIT SUB-UP LOCATIONS PER ELECTRICAL CONDUIT PLAN.
 - (N) TELEMETRY CABINET (TC) WITH FACTORY WIRED CLEAN ENERGY SERVER. EMERGENCY POWER-OFF SWITCH (EPO). CAST-IN-PLACE PAD AND MOUNTING SPECIFICATIONS PER GRADING PLAN, CONDUIT SUB-UP LOCATIONS PER ELECTRICAL CONDUIT DETAILS.
 - (N) WATER DEIONIZATION MODULE (WDM). CAST-IN-PLACE PAD AND MOUNTING SPECIFICATIONS PER GRADING PLAN, PIPE & CONDUIT SUB-UP LOCATIONS PER PIPE PLAN & DETAILS & ELECTRICAL CONDUIT DETAILS.
 - (N) WATER TAP.
 - (N) 10'-0" COPPER GROUNDING RODS 4'-0" APART. SPECIFICATIONS PER ONE LINE DIAGRAM.
 - (N) BOLLARD (TYP.) TYPE, SIZE AND LOCATION PER IMPACT PROTECTION PLAN. ENSURE SLEEVES FLUSH WITH GRADE AND NO ANGLES OR HOOKS EXIST THAT WOULD FORBID ACCESS.
 - (N) PROVIDE SECURITY BOXES OF CONDUIT & WIRE AT ALL ELECTRICAL SUB-UP LOCATIONS.
 - CORE CONDUIT AND/OR PIPE THROUGH WALL. SCAN WALL PRIOR TO CORING. CONTRACTOR SHALL PROVIDE FIRE STOP SEALANT AT ALL WALL PENETRATIONS PER LOCAL CODES.
 - (N) UTILITY APPROVED CT CABINET IN NEMA 3R ENCLOSURE. MOUNT TO UNSTRUT PER MANUFACTURER SPECIFICATIONS. ENSURE LOCATION MEETS ALL REQUIRED N.E.C. CLEARANCES. PROVIDE MODEL NUMBER ON THE OUTSIDE OF THE FRONT PANEL. COMPLETE SPECIFICATION PER ELECTRICAL SPECIFICATIONS.
 - (N) UTILITY APPROVED LREC METER. MOUNT ABOVE CT CABINET WITH UNSTRUT PER MANUFACTURER SPECIFICATIONS. ENSURE LOCATION MEETS ALL REQUIRED N.E.C. CLEARANCES. PROVIDE MODEL NUMBER ON THE OUTSIDE OF THE FRONT PANEL. COMPLETE SPECIFICATION PER ELECTRICAL SPECIFICATIONS.
 - NOT USED.
 - (N) CONCRETE PAD FOR (N) TRANSFORMER. CONTRACTOR TO VERIFY DIMENSIONS WITH BLOOMENERGY PROVIDED NECESSARY PRIOR TO POURING OF PAD.
 - CONTRACTOR SHALL PROVIDE ALL NECESSARY PULLBOXS FOR POWER AND DATA CONDUITS AS REQUIRED.
 - REPLACE (E) STORM LINE WITH (N) STORM LINE. PIPE SIZE AND MATERIAL TO MATCH EXISTING. EXISTING PIPE SIZE, SLOPE AND CONDITION TO BE VERIFIED IN FIELD PRIOR TO CONSTRUCTION. CONTRACTOR TO MAINTAIN MINIMUM 0.5% SLOPE.
 - RESTRIPE (E) PARKING SPACES WITH (N) 4" WIDE WHITE THERMO PLASTIC TRAFFIC PAINT STRIPING FOR 9' X 18' PARKING STALLS. TOTAL OF 20 SPACES.
 - (N) STANDARD ACCESSIBLE SPACE PARKING SIGN. SIGN TO BE MOUNTED AT MINIMUM 6' ABOVE FINISHED GRADE. (TOTAL OF 2)
 - (N) VAN ACCESSIBLE SPACE PARKING SIGN. SIGN TO BE MOUNTED AT MINIMUM 6' ABOVE FINISHED GRADE. (TOTAL OF 2)
 - (N) CONCRETE MANHOLE AT PIPE INTERCONNECTION PER TRENCHING, ANCHORAGE, & SITE DETAILS.
 - (N) STANDARD ACCESSIBLE PARKING SPACE DECAL. (TOTAL OF 3)
 - (N) CONTRACTOR TO PROVIDE AND INSTALL CONCRETE WHEEL STOP. (TOTAL OF 8)
 - CONTRACTOR TO PROVIDE INLET PROTECTION AT EXISTING INLET LOCATIONS. (TOTAL OF 4)
 - CONTRACTOR SHALL TRANSITION ALL ABOVE GROUND NEW LINES TO UNDERGROUND TOWARD ANCILLARY EQUIPMENT. ABOVE GROUND UTILITIES SHALL BE PROTECTED AS NECESSARY. THEN ROUTED UNDERGROUND TO EQUIPMENT. SUB-UP LOCATIONS PER MECHANICAL DETAIL.

SITE PLAN SCALE 1"=10' 1

Bloomenergy
1232 Oskans Drive, Sunnyvale CA, 94089
Tel: 408 443 1500
Fax: 408 443 1501
www.bloomenergy.com

Frontier COMMUNICATIONS
NEW CONSTRUCTION OF
CLEAN ENERGY SERVER
39 WEST STREET
DANBURY, CT 06810

CORE STATES
group
SHARON BIRRE ROAD
WARREN, NJ 07059
www.corestates.com

DOCUMENTS PREPARED BY CORE STATES SHALL BE USED ONLY FOR THE SPECIFIC PROJECT AND INTENDED EXTENSION OF USE TO ANY OTHER PROJECTS. BY OWNER THE EMPLOYER'S GROUP USE OF CORE STATES GROUP LOGO AND NAME IS A TRADEMARK OF CORE STATES GROUP. CORE STATES GROUP SHALL HOLD CORE STATES GROUP HARMLESS FROM ALL CLAIMS AND LOSSES.

ISSUE	DATE	DESCRIPTION
1	10-28-16	PRELIM. SUBMISSION
2	11-07-16	PRELIM. SUBMISSION (REV 1)
3	11-10-16	PARKING RESTRIPTING
4	11-17-16	CD SET (70%)
5	11-18-16	UTILITY SUBMISSION
6	12-19-16	CD SET (90%)
7	01-18-17	ISSUE FOR PERMIT


PROJECT INFORMATION
JOB # BEC-21230
DATE: 10-20-16
DRAWN BY: MMD
CHECKED BY: MDS

MODEL
(1) ES5-BABAA0

SHEET TITLE
SITE PLAN

SHEET NUMBER
2.0

NOTE: EXISTING CONDITIONS AND BOUNDARY INFORMATION TAKEN FROM SURVEY ENTITLED, "BOUNDARY SURVEY OF 37 - 41 WEST STREET, LOTS 44-47 OF DANBURY TAX MAP No. 114, DANBURY, CONNECTICUT, DATED, OCTOBER 24, 2016," AS PREPARED BY FRANKLIN SURVEYS."

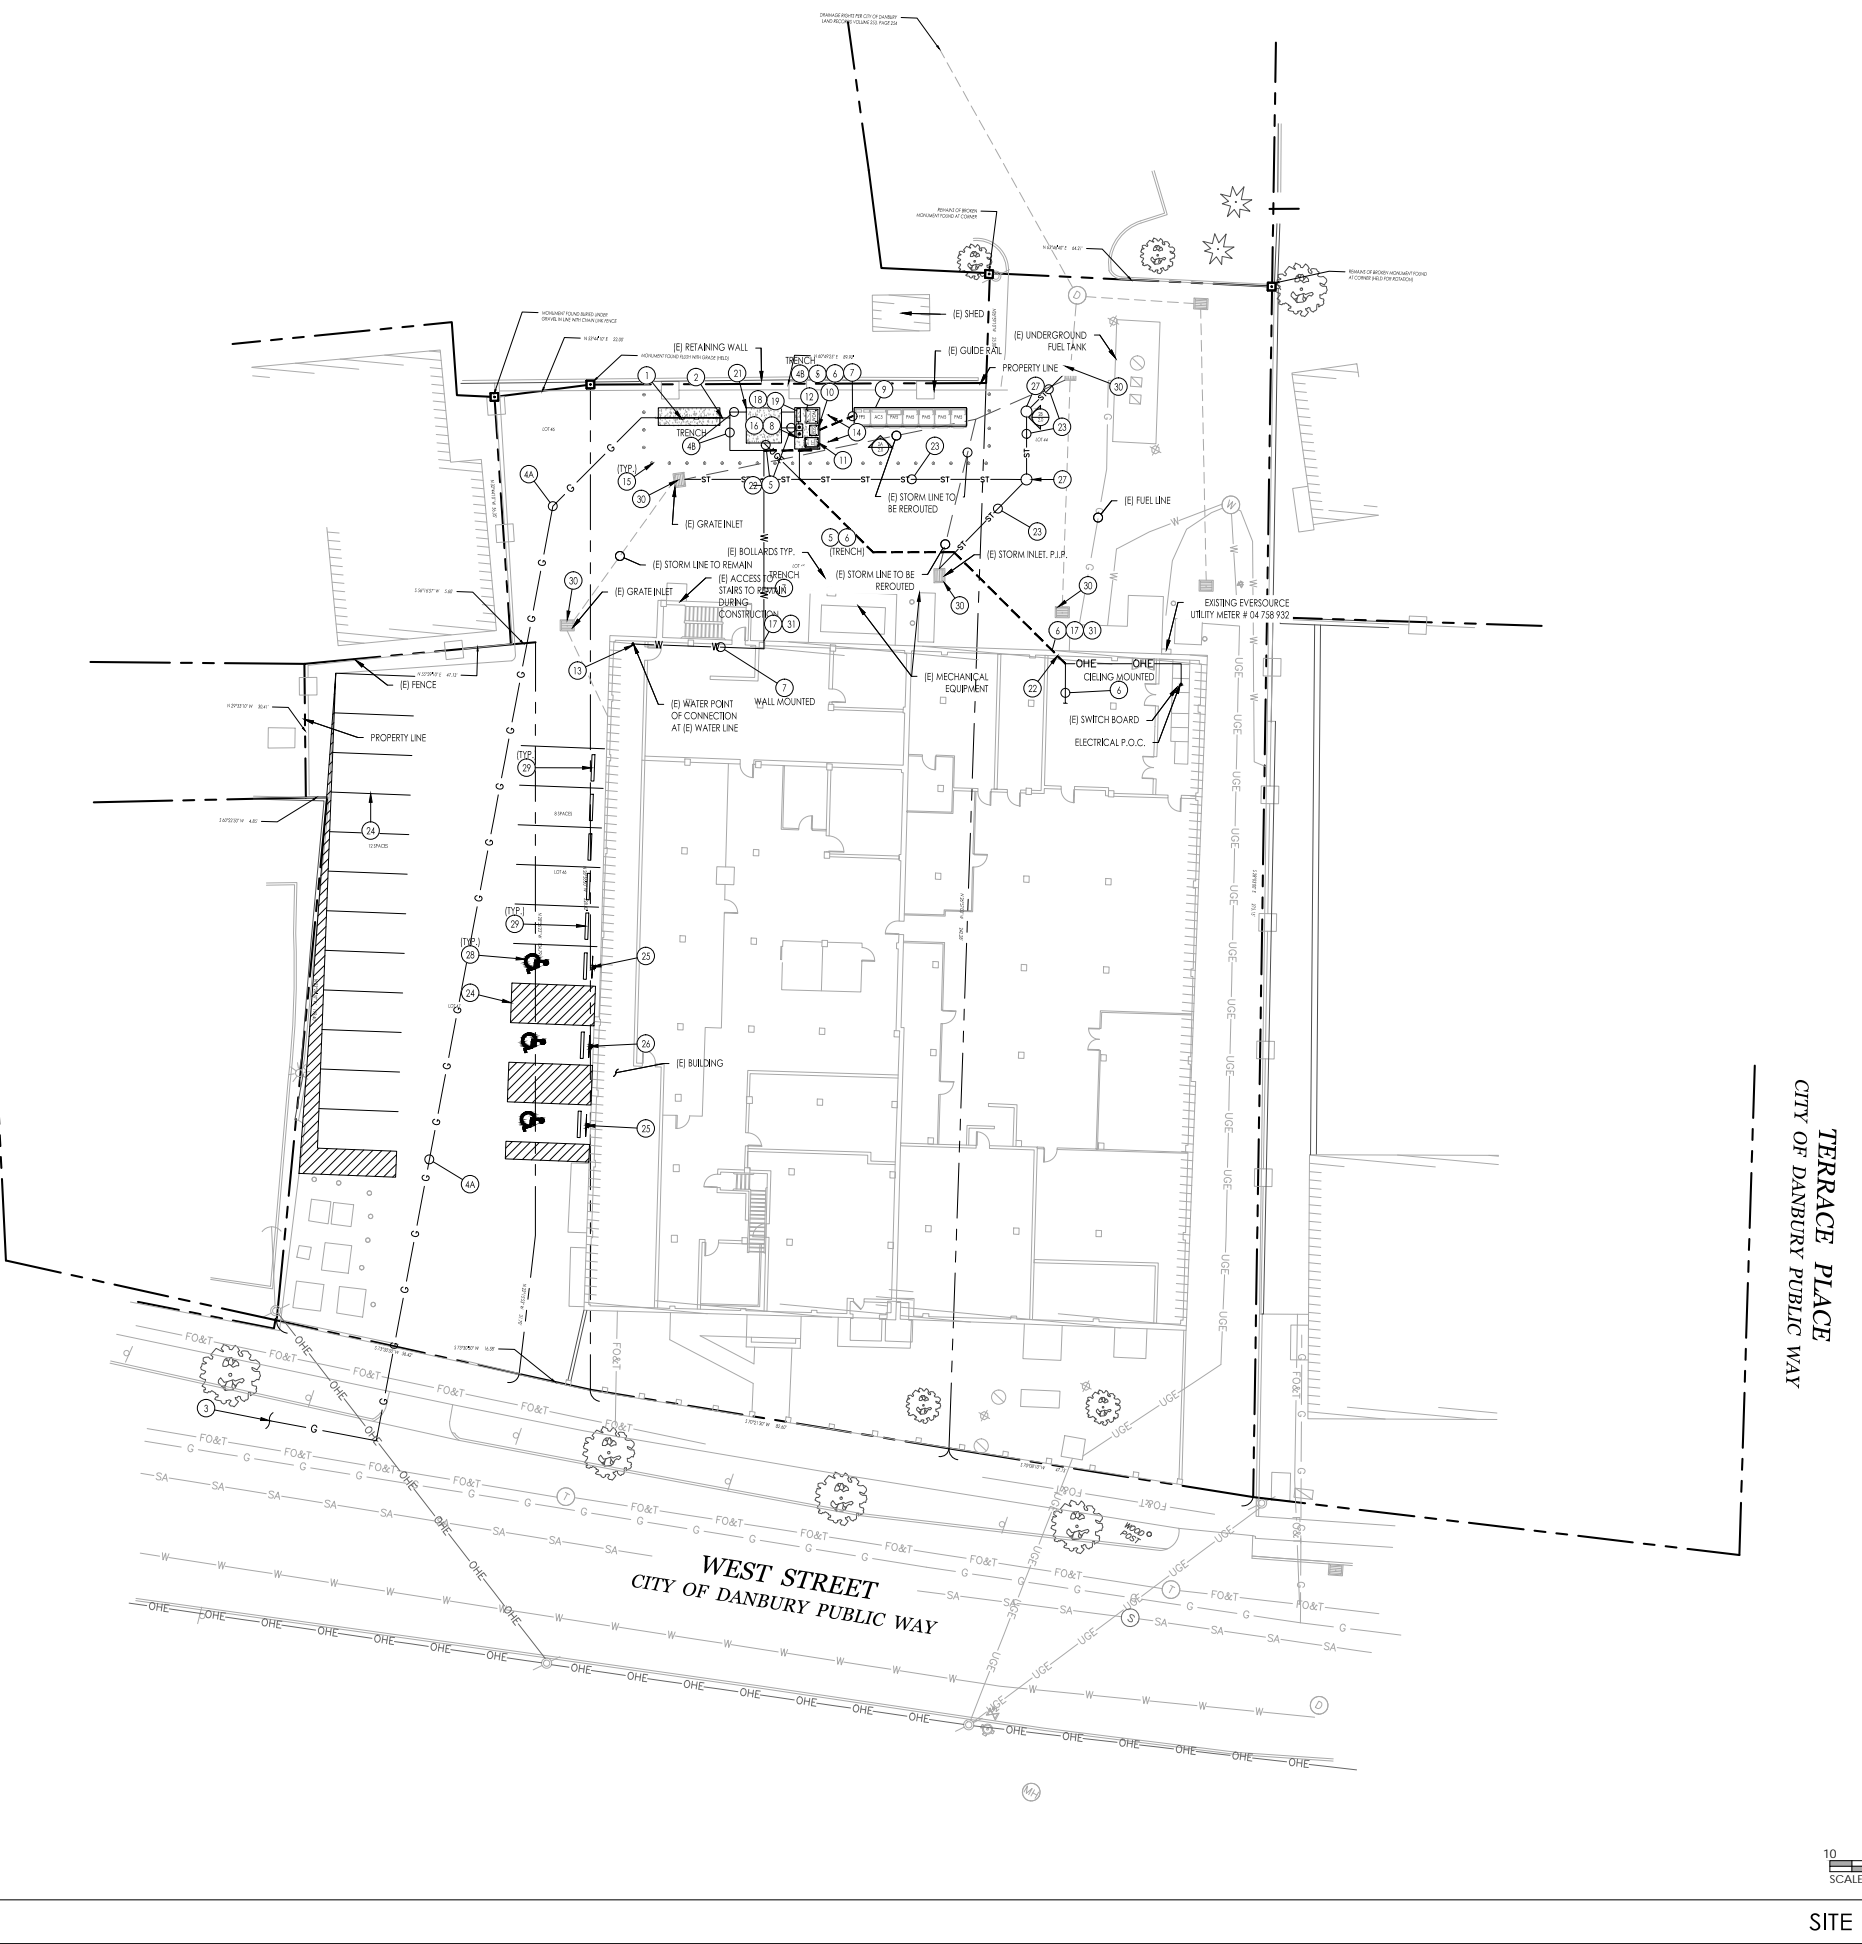

RESPONSIBILITY NOTES

1. THE FOLLOWING EQUIPMENT SHOWN ON THESE PLANS WILL BE PROVIDED AND DELIVERED BY BLOOM ENERGY, APPLICABLE TRADES TO MOUNT AND MAKE FINAL CONNECTIONS:
 - POWER DISTRIBUTION SECTION (PDS)
 - TELEMETRY CABINET (TC)
 - WATER DEIONIZATION MODULE (WDM)
 - SIGNAGE (SEE SAFETY SIGNAGE)
 - SITE KIT (SEE SITE KIT NOTES)
2. THE FOLLOWING EQUIPMENT SHOWN ON THESE PLANS WILL BE PROVIDED, DELIVERED AND MOUNTED BY BLOOM ENERGY, APPLICABLE TRADES TO MAKE FINAL CONNECTIONS:
 - CLEAN ENERGY SERVER
 - PRECAST SUPPORT PADS
3. CONTRACTOR TO REFER TO ELECTRICAL PLANS FOR ASSOCIATED WORK.

SITE KIT NOTES

1. BLOOMENERGY TO PROVIDE AND DELIVER THE SITE KIT.
2. ELECTRICAL AND PLUMBING CONTRACTOR TO INSTALL THE SITE KITS, CONSULTING OF PAD PLUMBING AND BUS BARS, ON THE PRECAST CONCRETE PAD PER MANUFACTURER SPECIFICATIONS.
3. PPM DEFLECTORS ARE NOT REQUIRED AT THIS SITE.


UTILITIES

GAS: YANKEE GAS SERVICE COMPANY
ELECTRIC: EVERSOURCE

CONDUIT & PIPE LENGTHS


TYPE	TOTAL DISTANCE FROM TRENCH TO FURTHERMOST ES LINE (LINEAR)
GAS PIPE	375
ELECTRICAL CABLE (10 1/2")	250
DATA CONDUIT	125
WATER PIPE	125

LEGEND OF UTILITY LINES



KEYNOTES

1. (N) UTILITY GAS METER SET ASSEMBLY (MSA) FOR CLEAN ENERGY SERVER. COORDINATE LOCATION & INSTALLATION REQUIREMENTS WITH UTILITY COMPANY PRIOR TO INSTALLATION. MAINTAIN MINIMUM 3'-0" CLEARANCE FROM ALL IGNITION SOURCES. CONTRACTOR TO PROVIDE PRECAST CONCRETE PAD.
2. (N) PRIVATE GAS BEER FOR CLEAN ENERGY SERVER WITH SHUT-OFF VALVE. MAINTAIN MINIMUM 3'-0" CLEARANCE FROM ALL IGNITION SOURCES & WET UTILITIES.
3. (N) GAS SERVICE BY UTILITY COMPANY. EXACT LOCATION AND LENGTH TO BE COORDINATED WITH UTILITY & BLOOM ENERGY. SIZES & TRENCHING REQUIREMENTS PER UTILITY COMPANY.
4. (N) GAS PIPE FROM (N) GAS TAP TO TERMINATE AT (N) UTILITY MSA INSTALLED BY UTILITY COMPANY. SIZES & TRENCHING REQUIREMENTS PER UTILITY COMPANY.
5. (N) GAS PIPE DATA CONDUIT & CABLE (WHERE NEEDED) FROM (N) UTILITY GAS MSA TO TERMINATE AT (N) ES UNIT INSTALLED BY CONTRACTOR.
6. (N) ELECTRICAL CONDUIT & WIRES FROM (N) ES UNIT TO (N) PDS TO (N) DISCONNECT TO (N) CT CABINET TO (N) LREC METER WITH FINAL TERMINATION AT (N) SWITCHGEAR.
7. (N) DATA CONDUIT & CABLE FROM (N) LREC METER TO TERMINATE AT (N) DATA DEMARC LOCATION.
8. (N) WATER PIPE FROM BUILDING DOMESTIC WATER SYSTEM TO (N) WDM. CONNECT TO NEAREST AVAILABLE LOCATION.
9. (N) DISCONNECT SWITCH & NEMA 3R ENCLOSURE. MOUNT TO UNSTRUT PER MANUFACTURER SPECIFICATIONS & SHEET 3.1. ENSURE LOCATION MEETS ALL REQUIRED N.E.C. CLEARANCES. PROVIDE MODEL NUMBER ON THE OUTSIDE OF THE FRONT PANEL.
10. (N) BLOOMENERGY ES-5 ENERGY SERVER.
11. (N) POWER DISTRIBUTION SECTION (PDS). CAST-IN-PLACE PAD AND MOUNTING SPECIFICATIONS PER GRADING PLAN. CONDUIT STUB-UP LOCATIONS PER ELECTRICAL CONDUIT PLAN.
12. (N) TELEMETRY CABINET (TC) WITH FACTORY WIRED CLEAN ENERGY SERVER EMERGENCY POWER-OFF SWITCH (EPO). CAST-IN-PLACE PAD AND MOUNTING SPECIFICATIONS PER GRADING PLAN. CONDUIT STUB-UP LOCATIONS PER ELECTRICAL CONDUIT DETAILS.
13. (N) WATER DEIONIZATION MODULE (WDM). CAST-IN-PLACE PAD AND MOUNTING SPECIFICATIONS PER GRADING PLAN. PIPE & CONDUIT STUB-UP LOCATIONS PER PIPE PLAN & DETAILS & ELECTRICAL CONDUIT DETAILS.
14. (N) WATER TAP.
15. (N) 10'-0" COPPER GROUNDING RODS 4'-0" APART. SPECIFICATIONS PER ONE LINE DIAGRAM.
16. (N) BOLLARD (TYP.) TYPE, SIZE AND LOCATION PER IMPACT PROTECTION PLAN. ENSURE SLEEVES FLUSH WITH GRADE AND NO ANGLES OR HOOKS EXIST THAT IMPED FORKTRUCK ACCESS.
17. (N) PROVIDE SECURITY BOXES OF CONDUIT & WIRE AT ALL ELECTRICAL STUB UP LOCATIONS.
18. (N) CORE CONDUIT AND/OR PIPE THROUGH WALL. SCAN WALL PRIOR TO CORING. CONTRACTOR SHALL PROVIDE FIRE STOP SEALANT AT ALL WALL PENETRATIONS PER LOCAL CODES.
19. (N) UTILITY APPROVED CT CABINET IN NEMA 3R ENCLOSURE. MOUNT TO UNSTRUT PER MANUFACTURER SPECIFICATIONS. ENSURE LOCATION MEETS ALL REQUIRED N.E.C. CLEARANCES. PROVIDE MODEL NUMBER ON THE OUTSIDE OF THE FRONT PANEL. COMPLETE SPECIFICATION PER ELECTRICAL SPECIFICATIONS.
20. (N) UTILITY APPROVED LREC METER. MOUNT ABOVE CT CABINET WITH UNSTRUT PER MANUFACTURER SPECIFICATIONS. ENSURE LOCATION MEETS ALL REQUIRED N.E.C. CLEARANCES. PROVIDE MODEL NUMBER ON THE OUTSIDE OF THE FRONT PANEL. COMPLETE SPECIFICATION PER ELECTRICAL SPECIFICATIONS.
21. NOT USED.
22. (N) CONCRETE PAD FOR (N) TRANSFORMER. CONTRACTOR TO VERIFY DIMENSIONS WITH BLOOMENERGY PROVIDED CUTSHEETS PRIOR TO POURING OF PAD.
23. CONTRACTOR SHALL PROVIDE ALL NECESSARY PULLBOXES FOR POWER AND DATA CONDUITS AS REQUIRED.
24. REPLACE (E) STORM LINE WITH (N) STORM LINE. PIPE SIZE AND MATERIAL TO MATCH EXISTING. EXISTING PIPE SIZE, SLOPE, AND CONDITION TO BE VERIFIED IN FIELD PRIOR TO CONSTRUCTION. CONTRACTOR TO MAINTAIN MINIMUM 0.5% SLOPE.
25. RESTRIPE (E) PARKING SPACES WITH (N) 4' WIDE WHITE THERMO PLASTIC TRAFFIC PAINT STRIPING FOR 9' X 16' PARKING STALLS. TOTAL OF 20 SPACES.
26. (N) STANDARD ACCESSIBLE SPACE PARKING SIGN. SIGN TO BE MOUNTED AT MINIMUM 6' ABOVE FINISHED GRADE. (TOTAL OF 2)
27. (N) VAN ACCESSIBLE SPACE PARKING SIGN. SIGN TO BE MOUNTED AT MINIMUM 6' ABOVE FINISHED GRADE. (TOTAL OF 2)
28. (N) CONCRETE MANHOLE AT PIPE INTERCONNECTION PER TRENCHING, ANCHORAGE, & SITE DETAILS.
29. (N) STANDARD ACCESSIBLE PARKING SPACE DECAL. (TOTAL OF 3)
30. (N) CONTRACTOR TO PROVIDE AND INSTALL CONCRETE WHEEL STOP. (TOTAL OF 8)
31. CONTRACTOR TO PROVIDE INLET PROTECTION AT EXISTING INLET LOCATIONS. (TOTAL OF 4)
32. CONTRACTOR SHALL TRANSITION ALL ABOVE GROUND NEW LINES TO UNDERGROUND TOWARD ANCILLARY EQUIPMENT. ABOVE GROUND UTILITIES SHALL BE PROTECTED AS NECESSARY. THEN ROUTED UNDERGROUND TO EQUIPMENT STUB-UP LOCATIONS PER MECHANICAL DETAIL.



SITE PLAN SCALE 1"=10'-0" 1

Know what's below.
Call before you dig.

THE CONTRACTOR IS SPECIFICALLY CAUTIONED THAT THE LOCATION AND/OR ELEVATION OF EXISTING UTILITIES AS SHOWN ON THESE PLANS IS BASED ON DESIGN DRAWINGS, RECORDS OF THE VARIOUS UTILITY COMPANIES, AND WHERE POSSIBLE, MEASUREMENTS TAKEN IN THE FIELD. CORE STATES, INC. DOES NOT GUARANTEE THAT LOCATIONS SHOWN ARE EXACT. THE CONTRACTOR MUST CONTACT THE APPROPRIATE UTILITY COMPANIES AT LEAST 72 HOURS BEFORE ANY EXCAVATION TO REQUEST EXACT FIELD LOCATIONS OF UTILITIES.



Bloomenergy
1252 Oskans Drive, Sunnyvale, CA, 94089
Tel: 408 543 1500
Fax: 408 543 1501
www.bloomenergy.com
PROPRIETARY & CONFIDENTIAL

Frontier COMMUNICATIONS
NEW CONSTRUCTION OF CLEAN ENERGY SERVER
39 NEW STREET
DANBURY, CT 06810

CORE STATES group
38 SANDRIDGE ROAD
WARREN, NJ 07059
www.corestatesgroup.com

DOCUMENTS PREPARED BY CORE STATES GROUP SHALL BE USED ONLY FOR THE SPECIFIC PROJECT AND INTENDED ANY EXTENSION OF USE TO ANY OTHER PROJECTS, BY OWNER OR ANY OTHER PARTY, WITHOUT THE EXPRESS WRITTEN CONSENT OF CORE STATES GROUP. CORE STATES GROUP USES A COMMON SENSE APPROACH TO RISK. IF USE IN A WAY OTHER THAN THAT FOR WHICH IT WAS DESIGNED, CORE STATES GROUP WILL HOLD CORE STATES GROUP HARMLESS FROM ALL CLAIMS AND LOSSES.

ISSUE	DATE	DESCRIPTION
1	10-28-16	PRELIM. SUBMISSION
2	11-07-16	PRELIM. SUBMISSION (REV 1)
3	11-10-16	PARKING RESTRIPPING
4	11-17-16	CD SET (70%)
5	11-18-16	UTILITY SUBMISSION
6	12-19-16	CD SET (95%)
7	01-18-17	ISSUE FOR PERMIT

PROJECT INFORMATION		
JOB #	BEC-21230	
DATE	10-20-16	
DRAWN BY:	MMD	
CHECKED BY:	MDS	

MODEL
(1) ES5-BABAA0

SHEET TITLE
OVERALL SITE PLAN

SHEET NUMBER
2.1

Drawing: Bloom Energy, BEC-21230 - Frontier Danbury, CT Danbury, CT, 210 Site Plan, Overall Site Plan
User: MKEMA
Date Modified: Jan 19, 2017 10:09:09
Drawing Path: \\server\projects\2016\Bloom Energy\BEC-21230 - Frontier Danbury, CT Danbury, CT, 210 Site Plan, Overall Site Plan